

PROJECT REFERENCE NO. U-2717	SHEET NO. UC-15
DESIGNED BY: DMP	
DRAWN BY: DMP	
CHECKED BY: DMP	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
DESIGN SERVICES UNIT PHONE: (919) 250-4128 FAX: (919) 250-4119	
UTILITY CONSTRUCTION PLANS ONLY	

CARROLL INVESTMENT PROPERTIES, INC.
 DB 5036 PG 606
 DB 5066 PG 1507

89

NAD 83

BROADSTONE VILLAGE APARTMENTS, LLC.
 DB 5291 PG 893

90

AREA UNDER CONSTRUCTION


+00 -L-
18m(59.06')

SEE SHEET UC-14

MATCHLINE -L- STA 32+20

SEE SHEET UC-16

MATCHLINE -L- STA 34+00

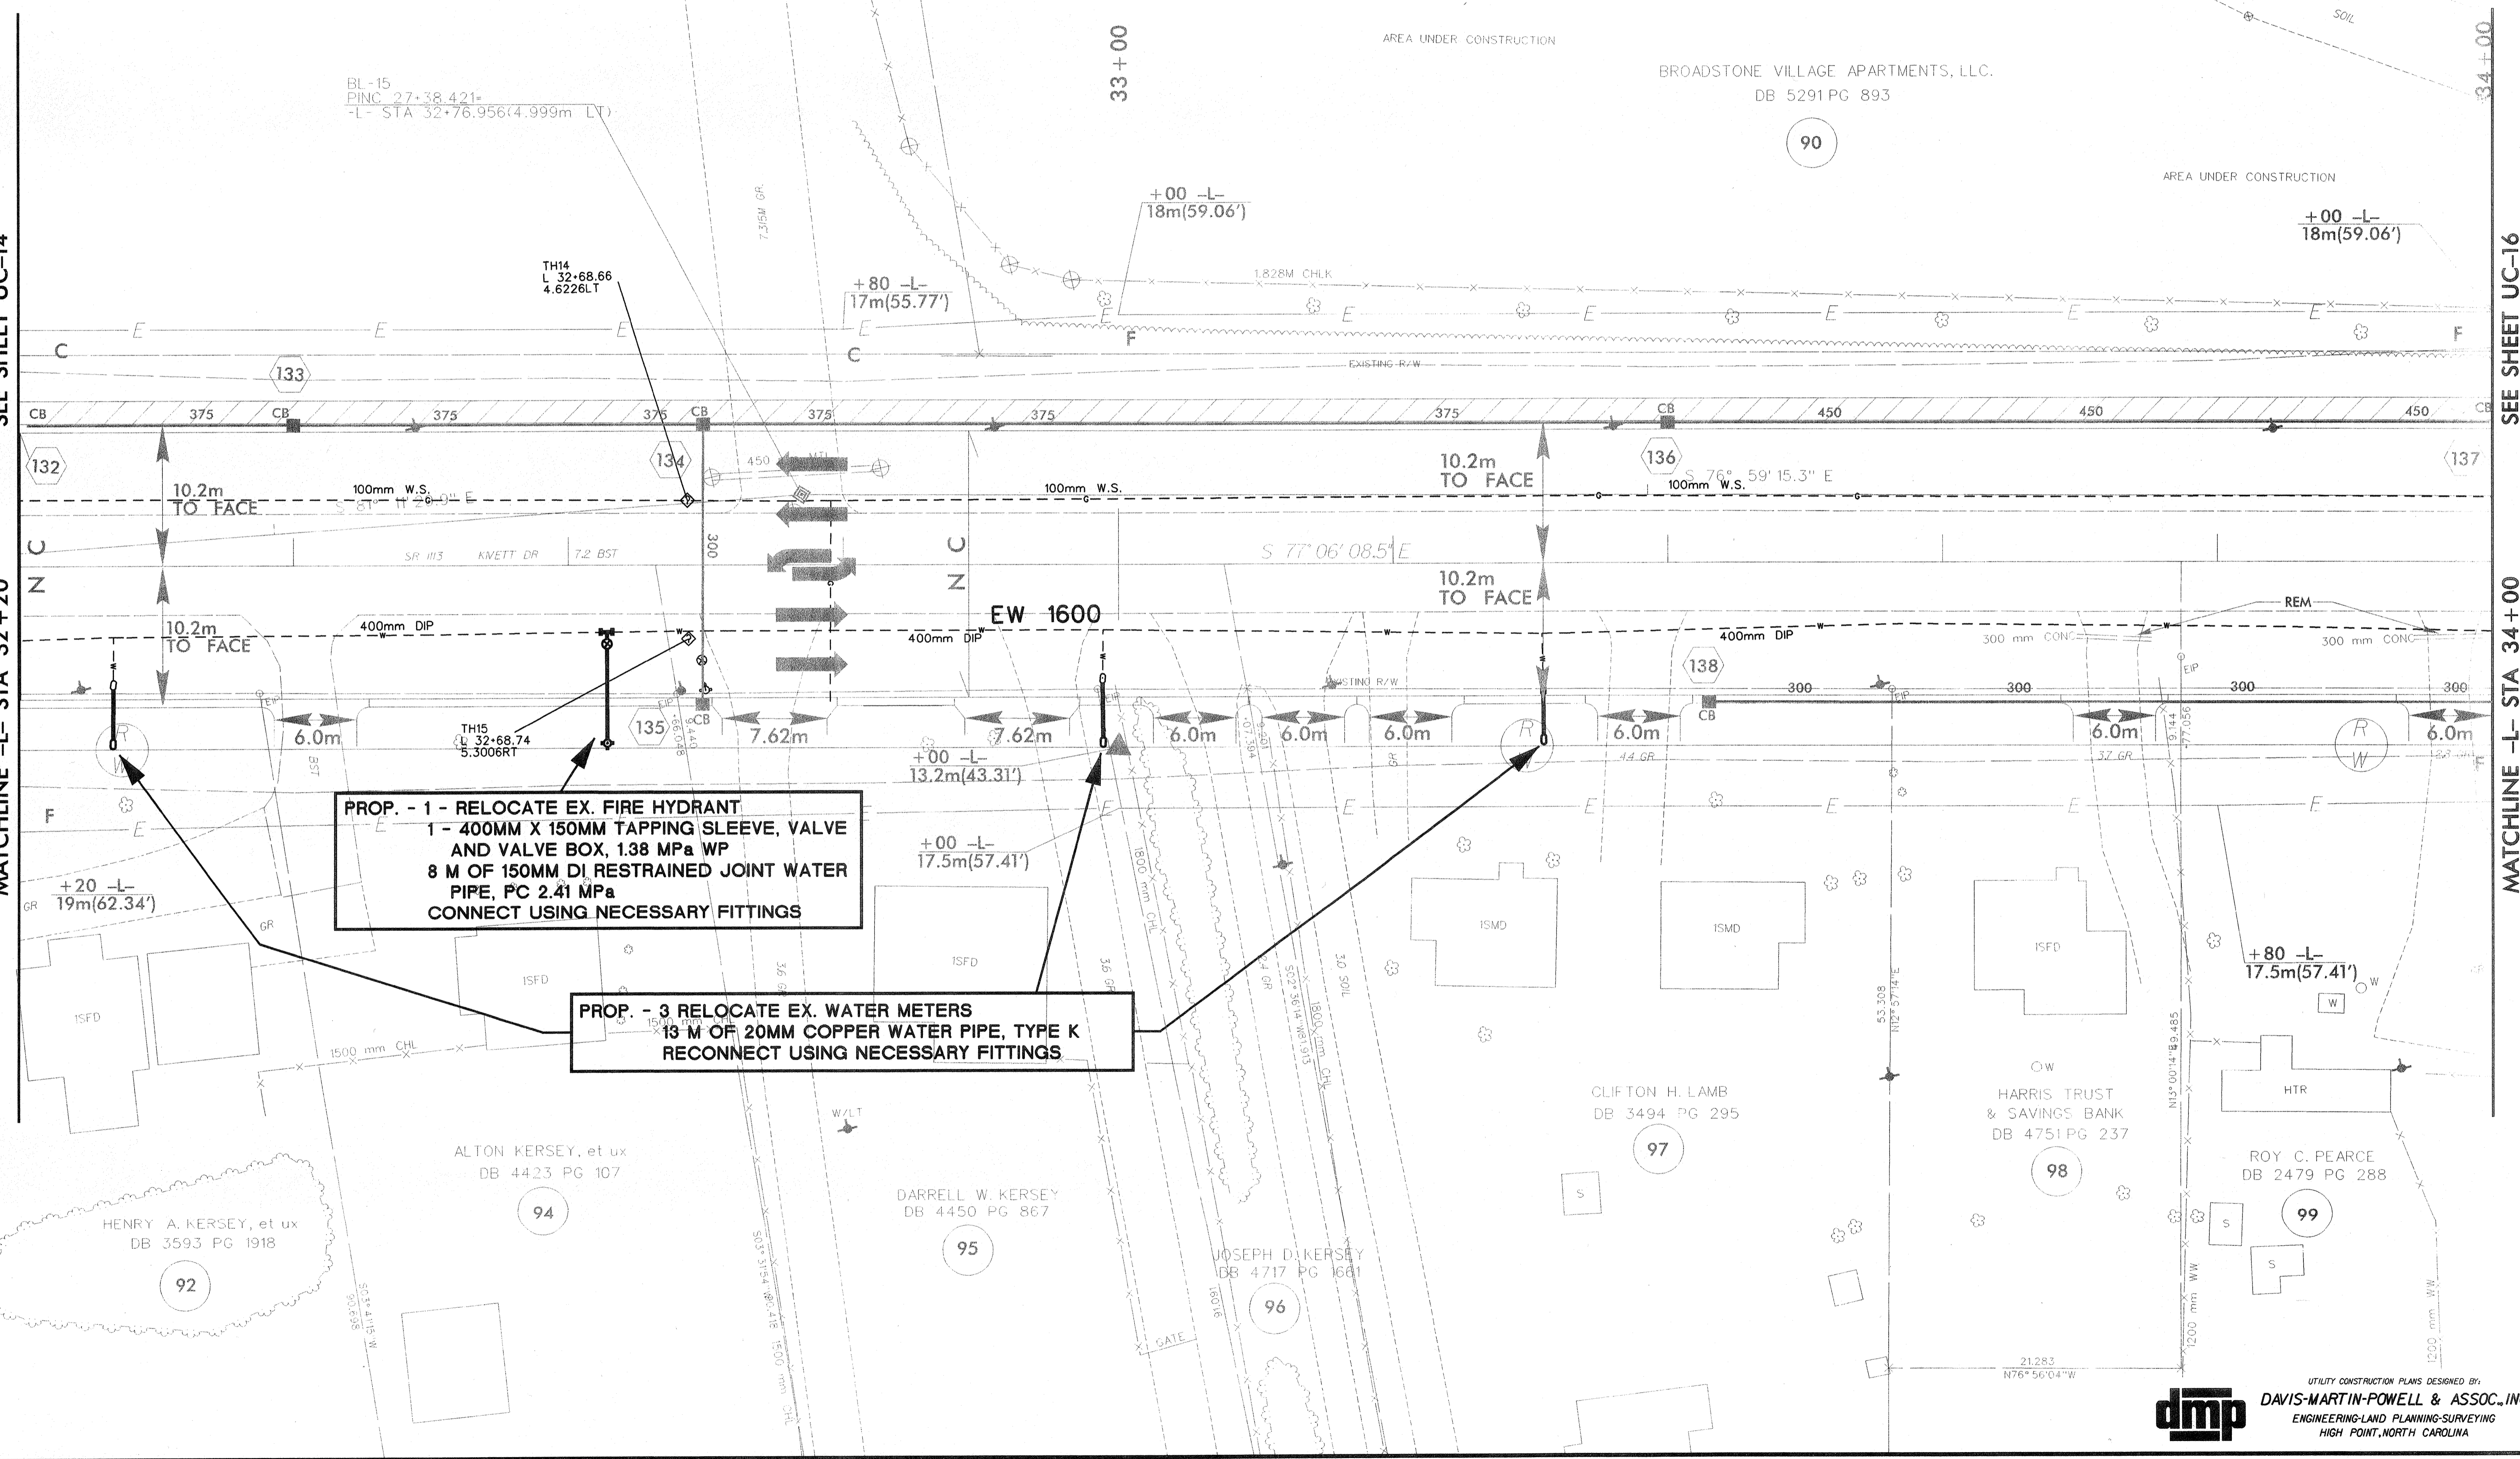

PROP. - 1 - RELOCATE EX. FIRE HYDRANT
 1 - 400MM X 150MM TAPPING SLEEVE, VALVE
 AND VALVE BOX, 1.38 MPa WP
 8 M OF 150MM DI, RESTRAINED JOINT WATER
 PIPE, PC 2.41 MPa
 CONNECT USING NECESSARY FITTINGS

PROP. - 3 RELOCATE EX. WATER METERS
 13 M OF 20MM COPPER WATER PIPE, TYPE K
 RECONNECT USING NECESSARY FITTINGS

HENRY A. KERSEY, et ux
 DB 3593 PG 1918

ALTON KERSEY, et ux
 DB 4423 PG 107

DARRELL W. KERSEY
 DB 4450 PG 867

JOSEPH D. KERSEY
 DB 4717 PG 1661

CLIFTON H. LAMB
 DB 3494 PG 295

HARRIS TRUST
 & SAVINGS BANK
 DB 4751 PG 237

ROY C. PEARCE
 DB 2479 PG 288