



SOIL TEST RESULTS


SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE ORGANIC	
							C.SAND	F.SAND	SILT	CLAY	10	40	200	%	%
S-1	8M LT	10+00	0.10-0.30	A-7-5(29)	66	29	5.1	19.5	34.9	40.6	100	97	83		
S-1A	8M LT	10+00	1.90-2.10	A-7-5(7)	56	11	11.6	36.9	31.2	20.3	100	96	60		
S-2	8.5M LT	11+00	0.60-0.70	A-7-6(24)	61	32	13.2	16.2	17.8	52.7	97	89	72		
S-2A	8.5M LT	11+00	1.70-1.80	A-5(4)	49	8	17.4	34.7	33.7	14.2	100	90	56		
S-3	11.5M LT	12+00	0.60-0.70	A-7-6(14)	41	18	8.7	19.1	41.8	30.4	99	94	77		
S-3A	11.5M LT	12+00	1.30-1.40	A-2-4(0)	30	NP	36.5	32.9	22.5	8.1	89	69	33		
S-3B	11.5M LT	12+00	1.90-2.00	A-2-4(0)	26	NP	34.1	37.9	21.9	6.1	97	79	33		
S-4	7.5M LT	13+00	0.30-0.40	A-7-5(56)	88	53	3.4	8.1	11.4	77.1	100	98	90		

PI = +10+83.000
 EL = 263.378 m
 VG = 90 m
 K = 53



INCOMPLETE PLANS
 DO NOT USE FOR R/W ACQUISITION
PRELIMINARY PLANS
 DO NOT USE FOR CONSTRUCTION

CONST. REV. _____
 R/W REV. _____

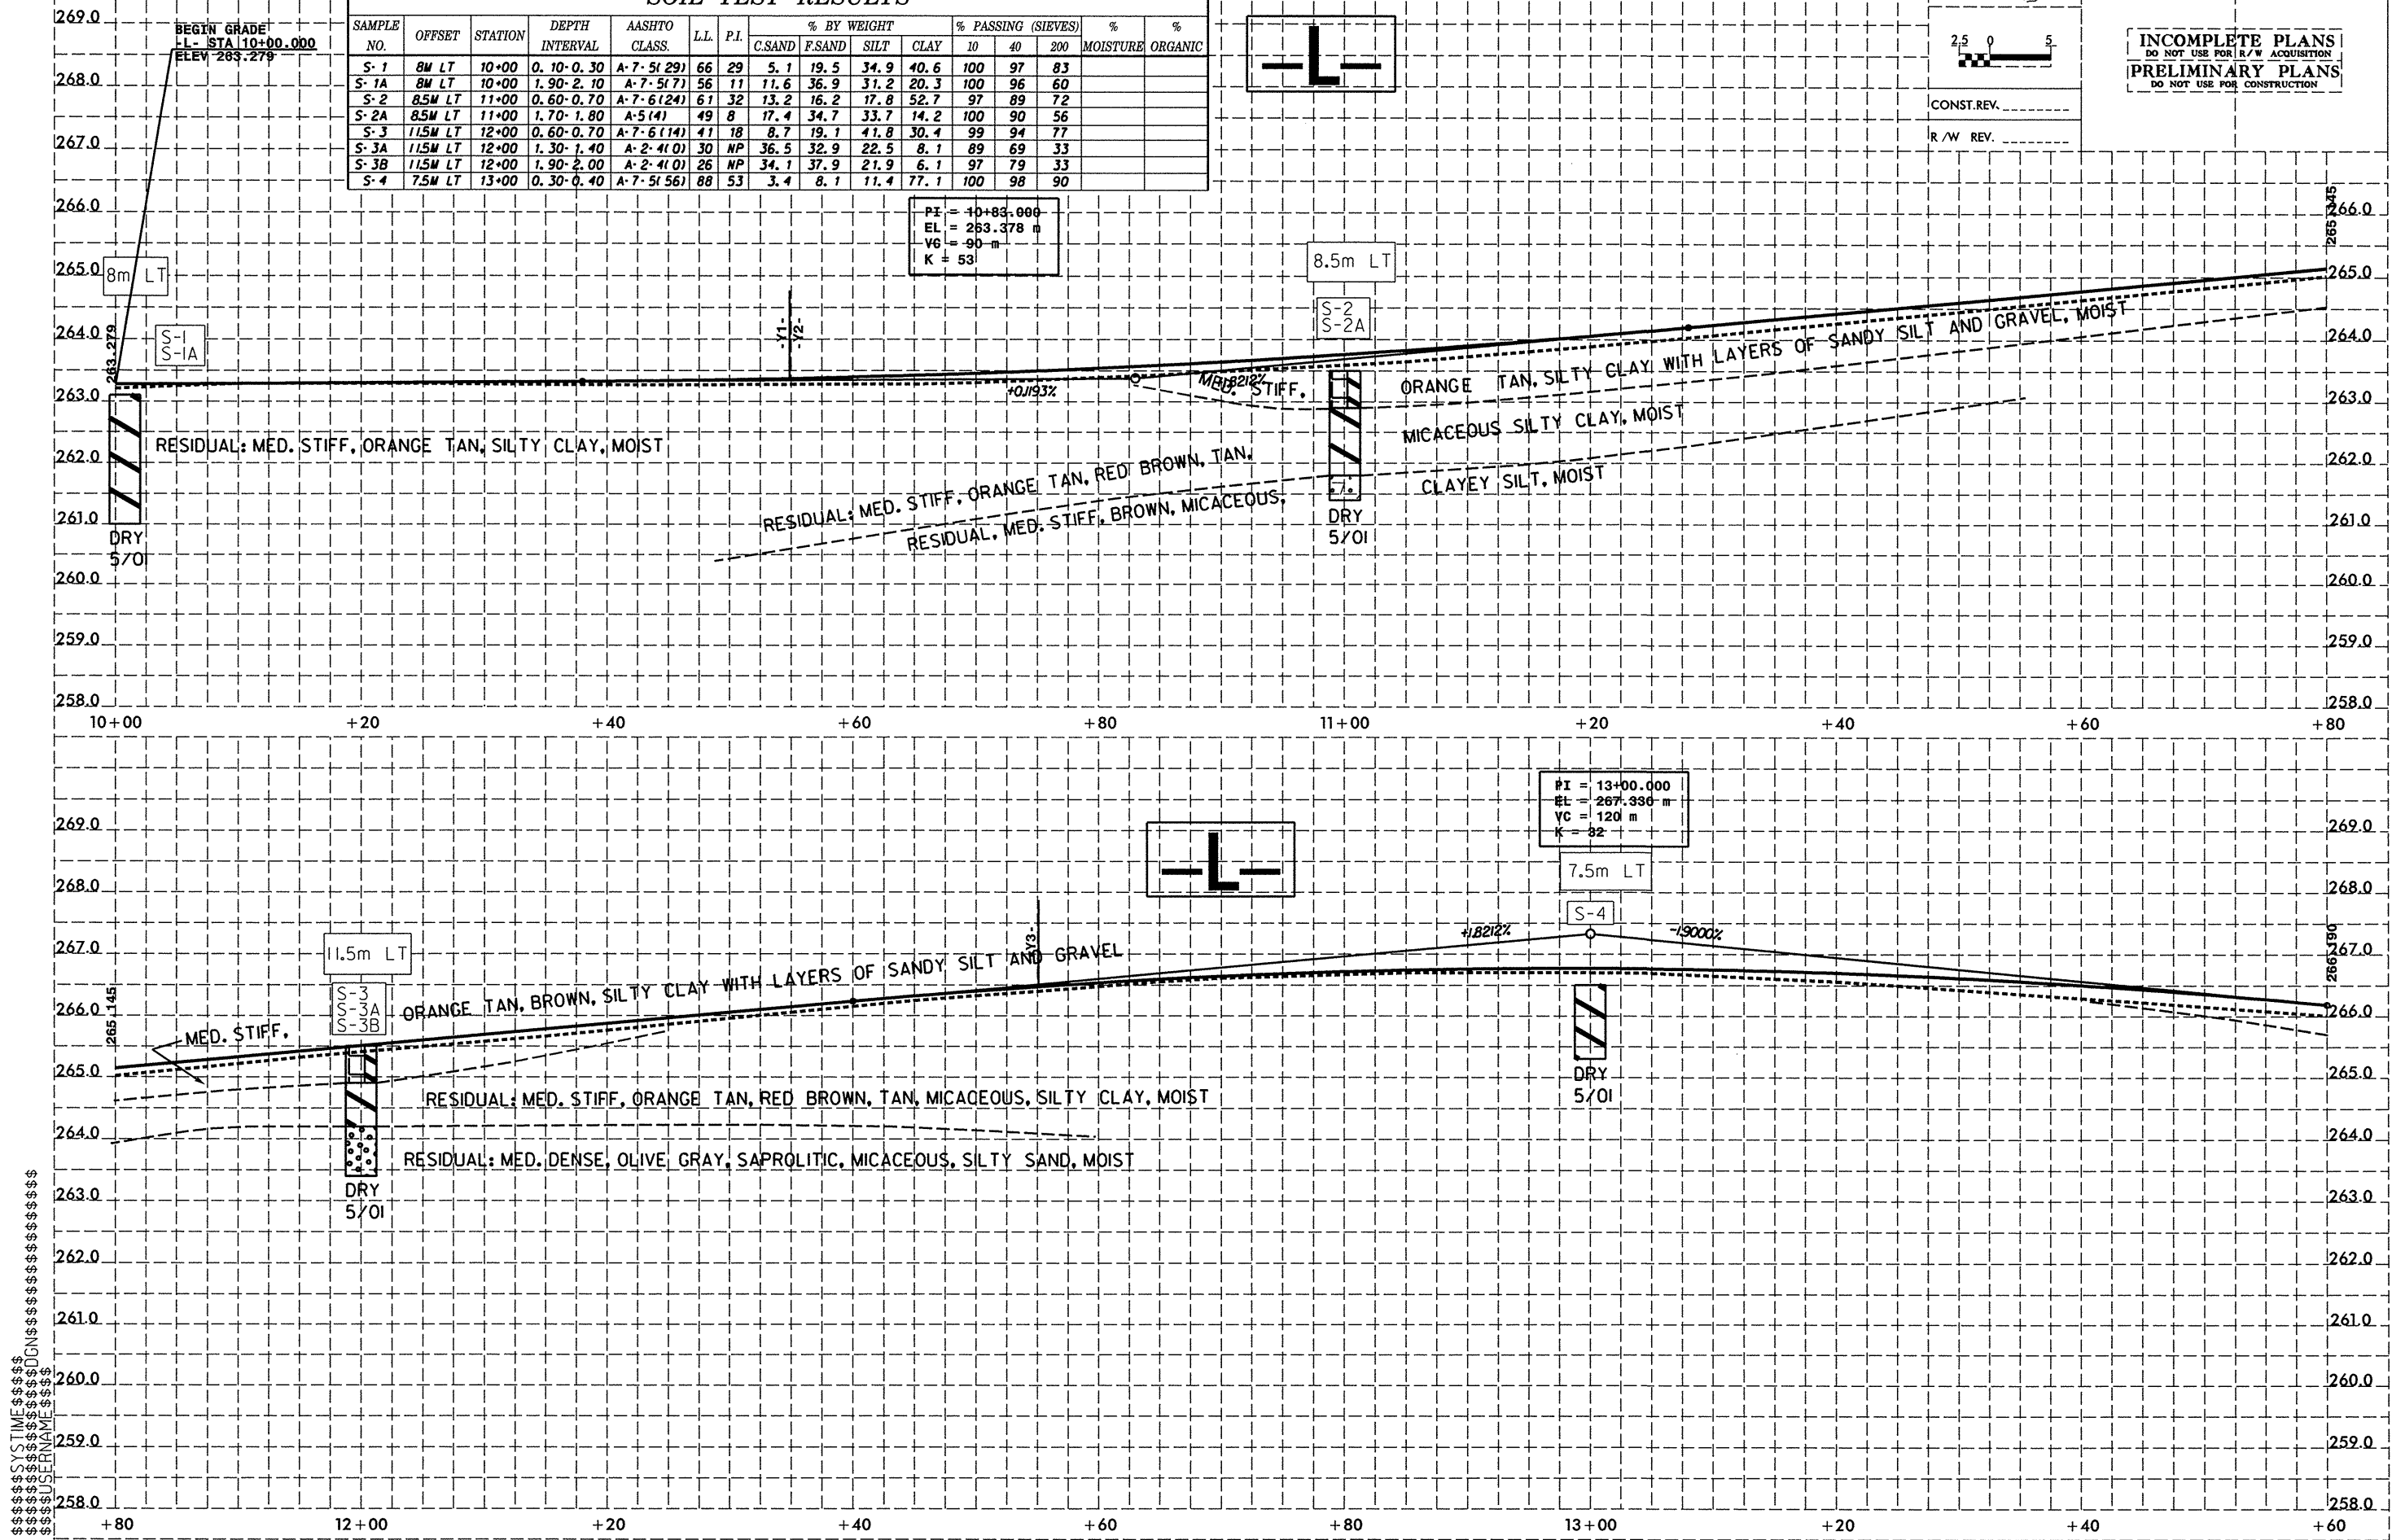

\$\$\$ SYSTEM TIME \$\$\$
 \$\$\$ VALUE \$\$\$
 \$\$\$ NAME \$\$\$
 \$\$\$ USER \$\$\$
 \$\$\$ DATE \$\$\$