


ALL WATER LINES OWNED BY DAVIDSON WATER INC.

PROP. 3 - RELOCATE EXISTING WATER METERS
 3 - 200MM X 20MM TAPPING SADDLES
 3 - 20MM CORPORATION STOPS
 5M OF 20MM COPPER WATER PIPE, TYPE K
 CONNECT USING NECESSARY FITTINGS

PROP. 332M OF 200MM DI WATER PIPE, PC 2.41 MPA WP
 1 - 200MM X 150MM DI TEE
 1 - 200MM GATE VALVE & VALVE BOX, 1.38 MPA WP
 1 - 200MM DI PLUG
 1 - 150MM GATE VALVE & VALVE BOX, 1.38 MPA WP
 27M OF 150MM PVC WATER PIPE, SDR 21, 1.38 MPA WP
 1 - 150MM 45° DI BEND
 CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING WATER METER
 1 - 200MM X 20MM TAPPING SADDLE
 1 - 20MM CORPORATION STOP
 75M OF 20MM COPPER WATER PIPE, TYPE K
 CONNECT USING NECESSARY FITTINGS

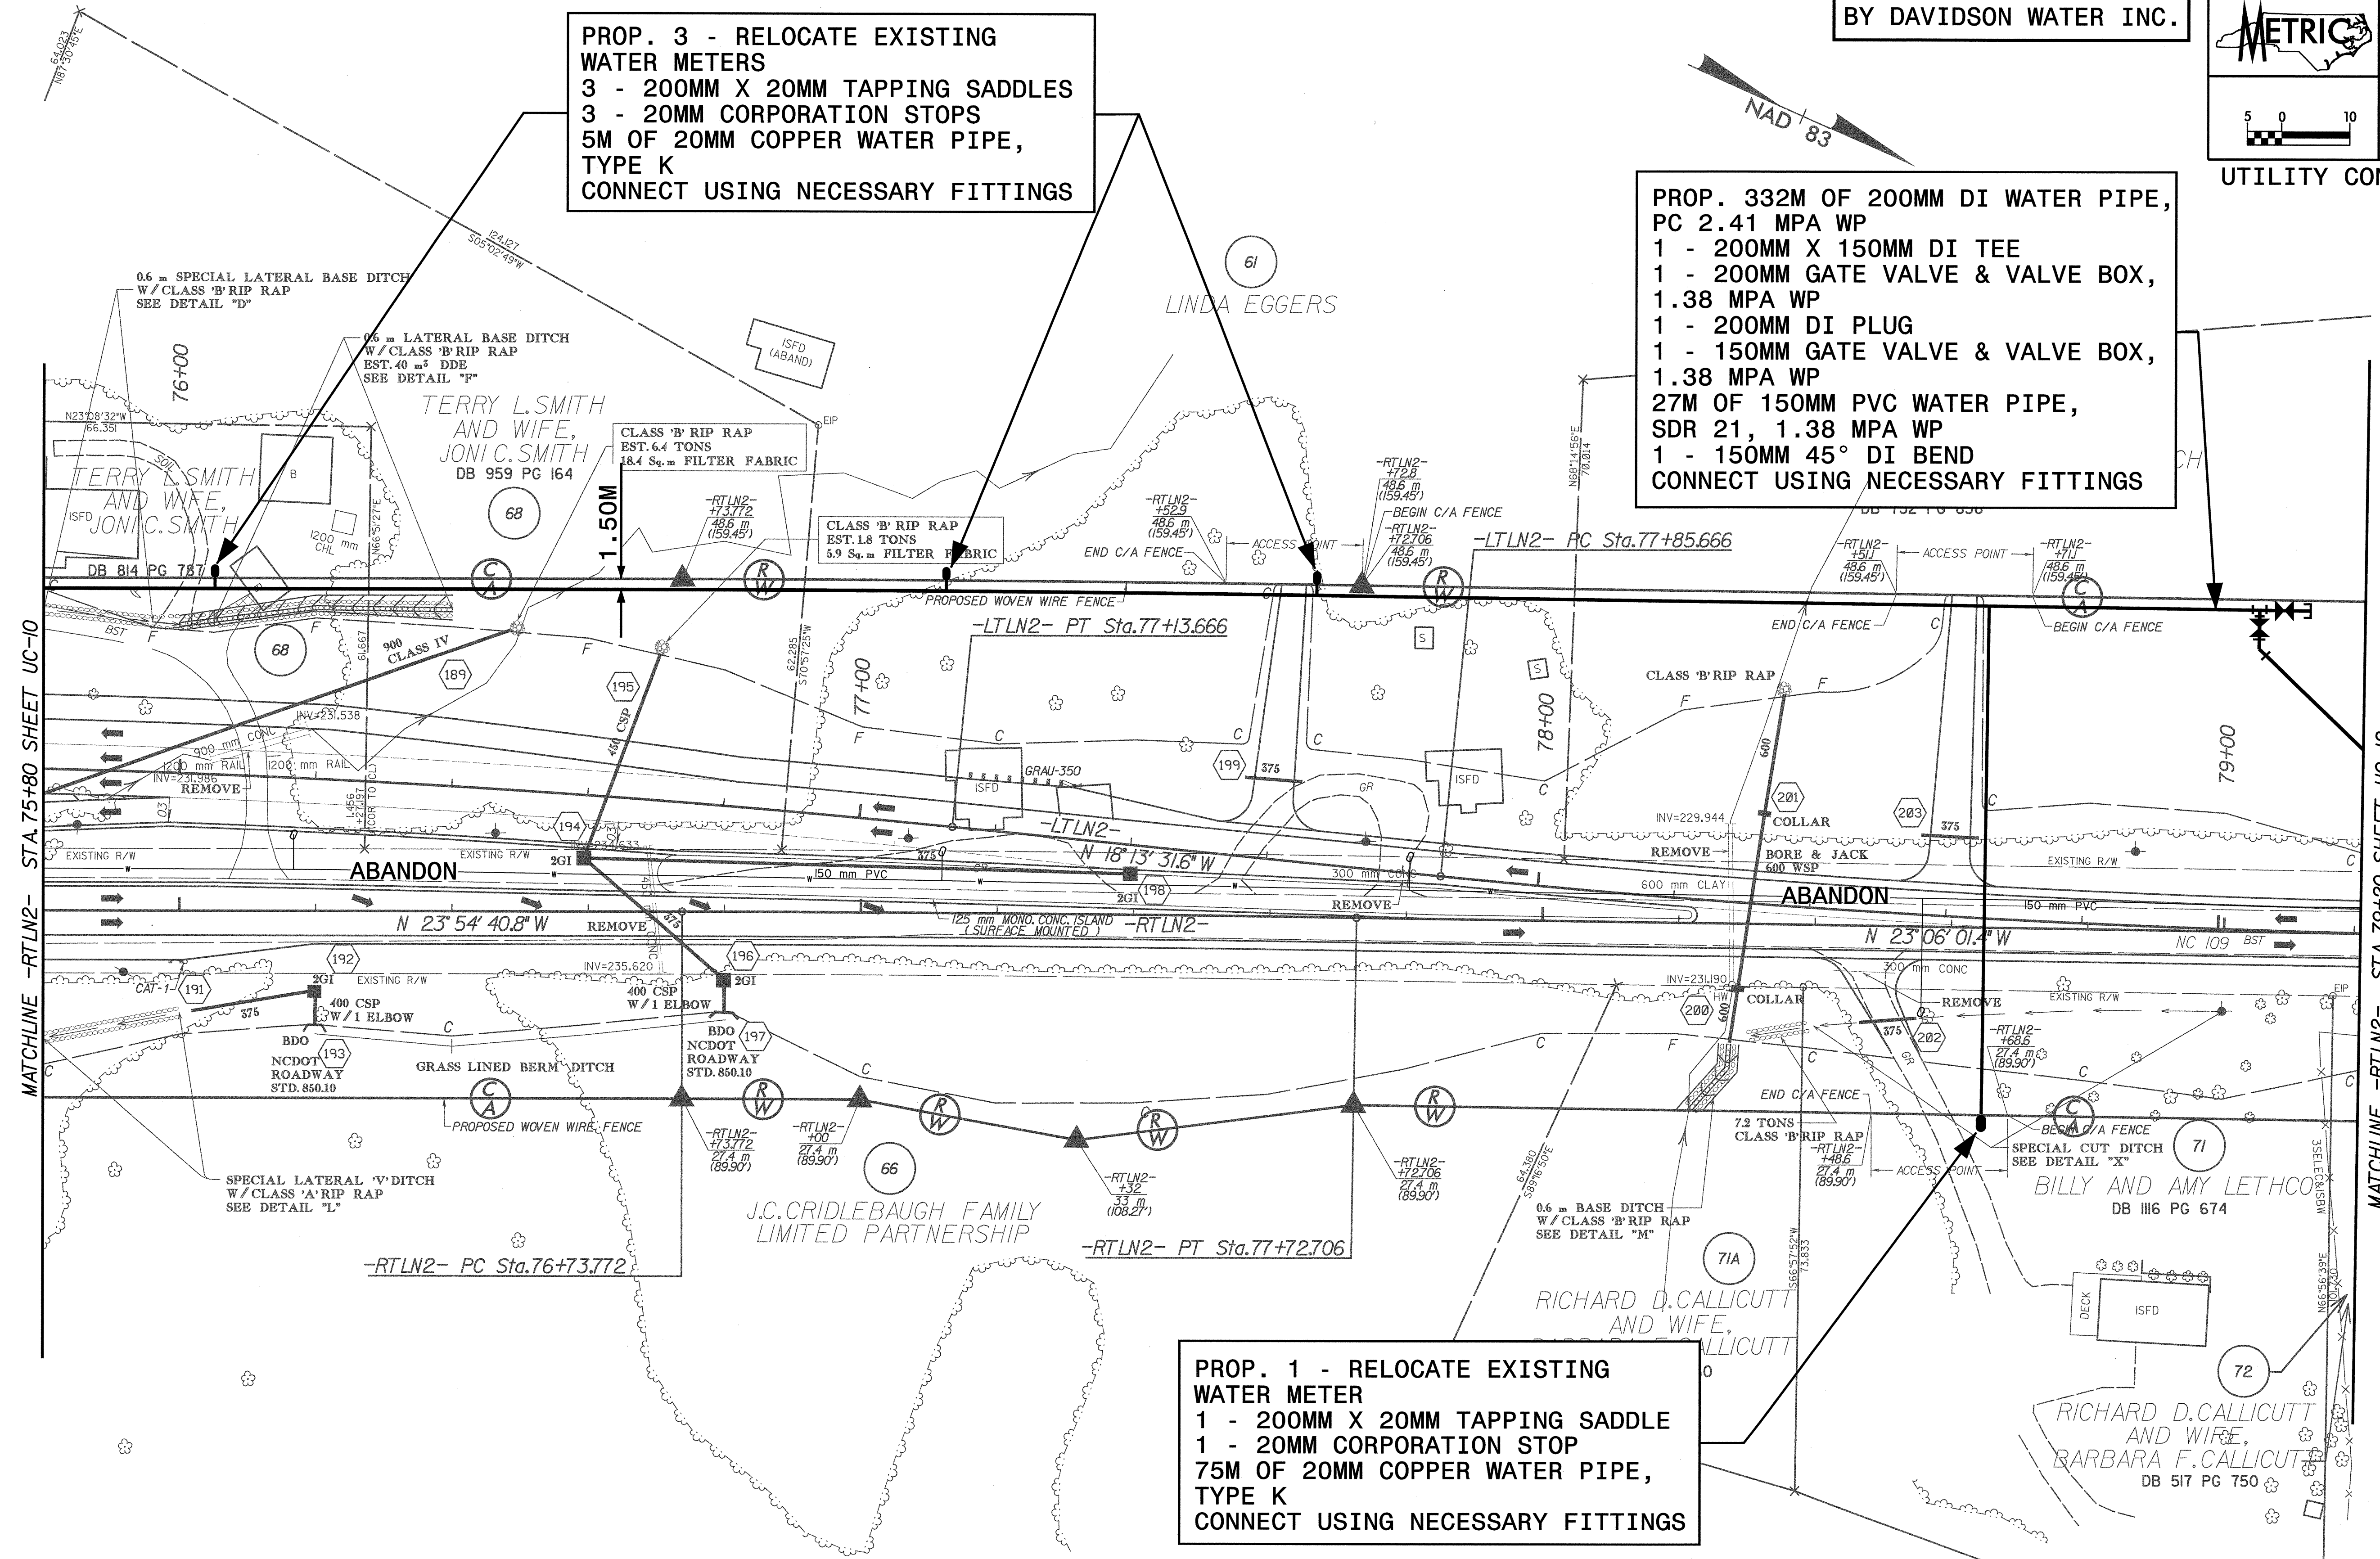

-RTL N2-
 PI Sta. 77+23.240
 Δ = 0° 48' 39.4" (RT.)
 L = 98.934
 T = 49.468
 R = 6,990.000

NOTES:
 (1) SEE SHEET 2-E FOR DRAINAGE DETAILS
 (2) SEE SHEET 36 FOR -LTLN2- & -RTL N2- PROFILES

Prepared in the Office of:
EARTH TECH
 701 Corporate Center Drive, Suite 475
 Raleigh, NC 27607
 (919) 854-6200 - (919) 854-6259(FAX)

C:\76489\2568b\temp\31133\2568buc11.psh
 08/03/2004 10:30:30 AM