

-L-  
 PI Sta. 59+77.76  
 $\Delta = 7' 25" 17.7" (RT.)$   
 $L = 226.680$   
 $T = 113.499$   
 $R = 1,750.000$   
 $S.E. = 0.03$   
 RUNOFF = 54

ALL WATER LINES OWNED  
 BY DAVIDSON WATER INC.


PROP. 3 - RELOCATE EXISTING  
 WATER METERS  
 3 - 75MM X 20MM TAPPING SADDLES  
 3 - 20MM CORPORATION STOPS  
 6M OF 20MM COPPER WATER PIPE,  
 TYPE K  
 CONNECT USING NECESSARY FITTINGS

PROP. 210M OF 75MM PVC WATER PIPE,  
 SDR 17, 1.72 MPA WP  
 1 - 75MM GATE VALVE & VALVE BOX,  
 1.38 MPA WP  
 CONNECT USING NECESSARY FITTINGS

PROP. 128M OF 200MM DI WATER PIPE,  
 PC 2.41 MPA WP  
 1 - 200MM GATE VALVE & VALVE BOX,  
 1.38 MPA WP  
 1 - 200MM DI PLUG TAPPED FOR 75MM PIPE  
 CONNECT USING NECESSARY FITTINGS

PROP. 70M OF 200MM DI WATER PIPE,  
 PC 2.41 MPA WP  
 1 - 200MM X 200MM DI TEE  
 1 - 200MM GATE VALVE & VALVE BOX,  
 1.38 MPA WP  
 1 - 200MM X 150MM DI REDUCER  
 CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING  
 WATER METER  
 1 - 150MM X 20MM TAPPING SADDLE  
 1 - 20MM CORPORATION STOP  
 12M OF 20MM COPPER WATER PIPE,  
 TYPE K  
 CONNECT USING NECESSARY FITTINGS

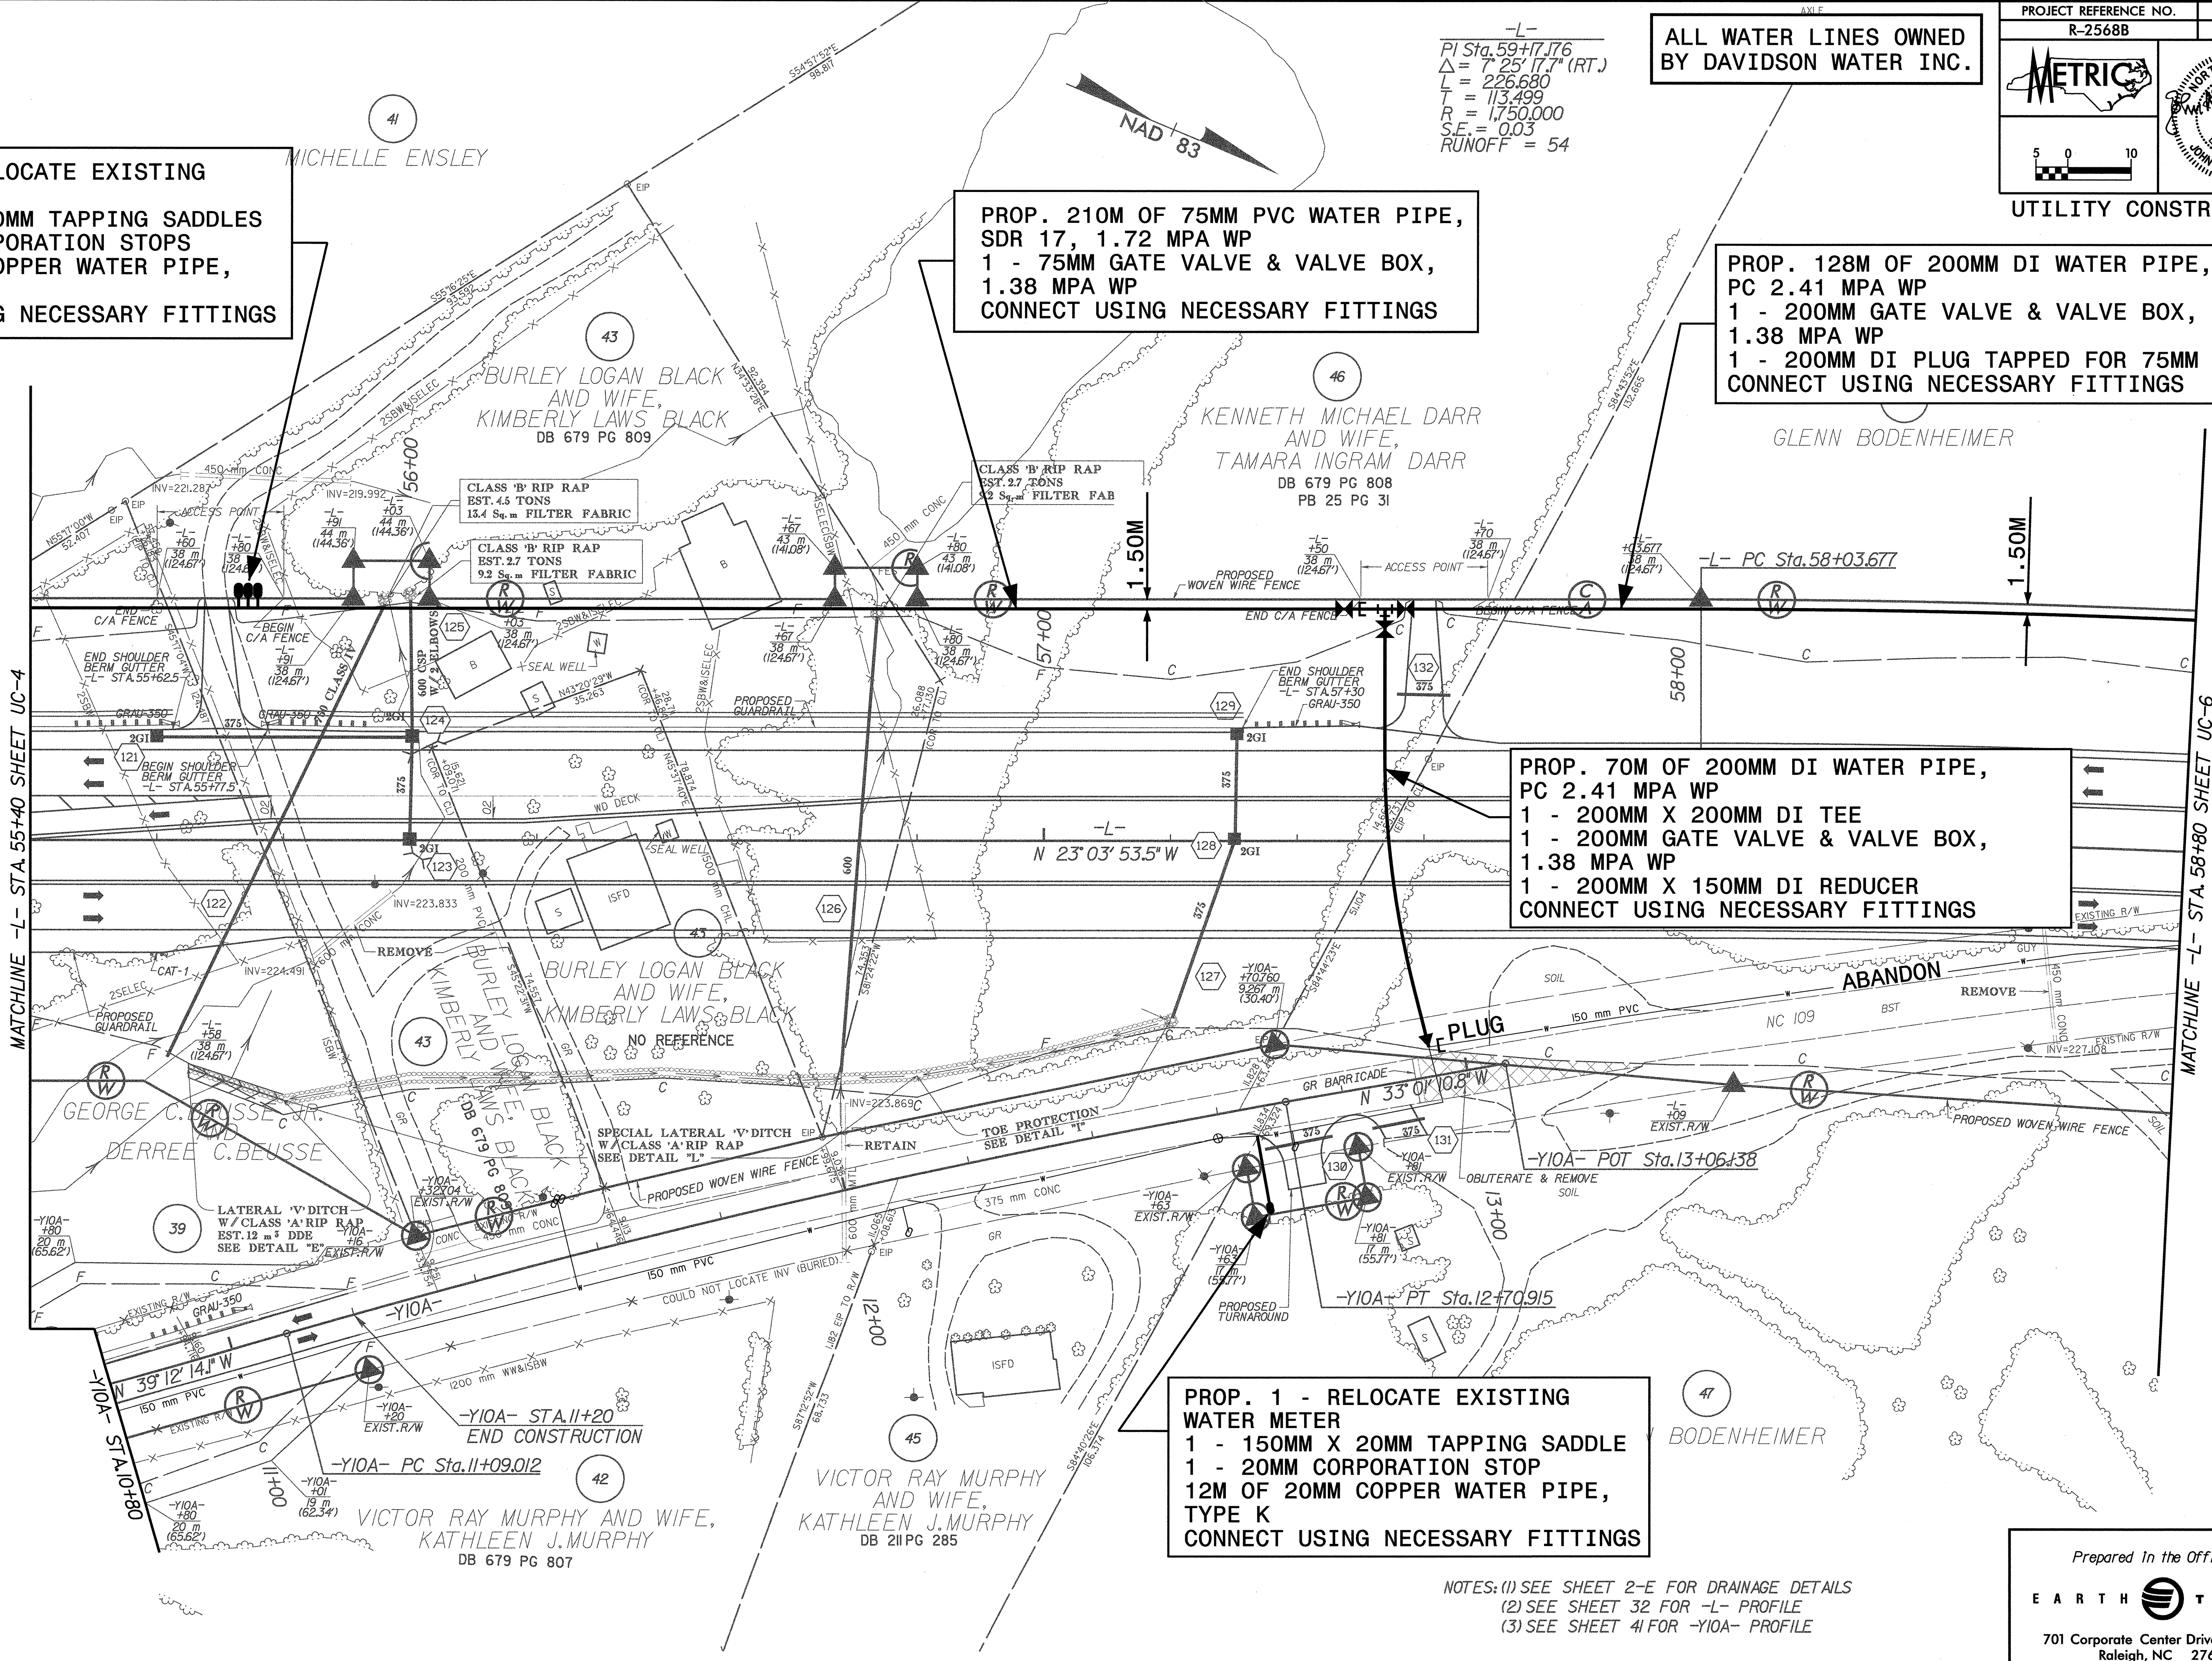

NOTES: (1) SEE SHEET 2-E FOR DRAINAGE DETAILS  
 (2) SEE SHEET 32 FOR -L- PROFILE  
 (3) SEE SHEET 41 FOR -Y10A- PROFILE

08/18/09 12:56:01 pm 12568buc5.psh  
 08/25/2004