


### SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-11	5.0	54+65	4.23 - 4.68	A-6(4)	39	13	29.4	22.7	17.5	30.4	95	77	60		
SS-12	5.0	54+65	5.75 - 6.21	A-4(0)	24	7	37.1	26.1	16.5	20.3	100	76	41		
SS-13	5.0	54+65	7.27 - 7.72	A-2-4(0)	32	NP	36.1	34.7	17.1	12.2	98	78	35		

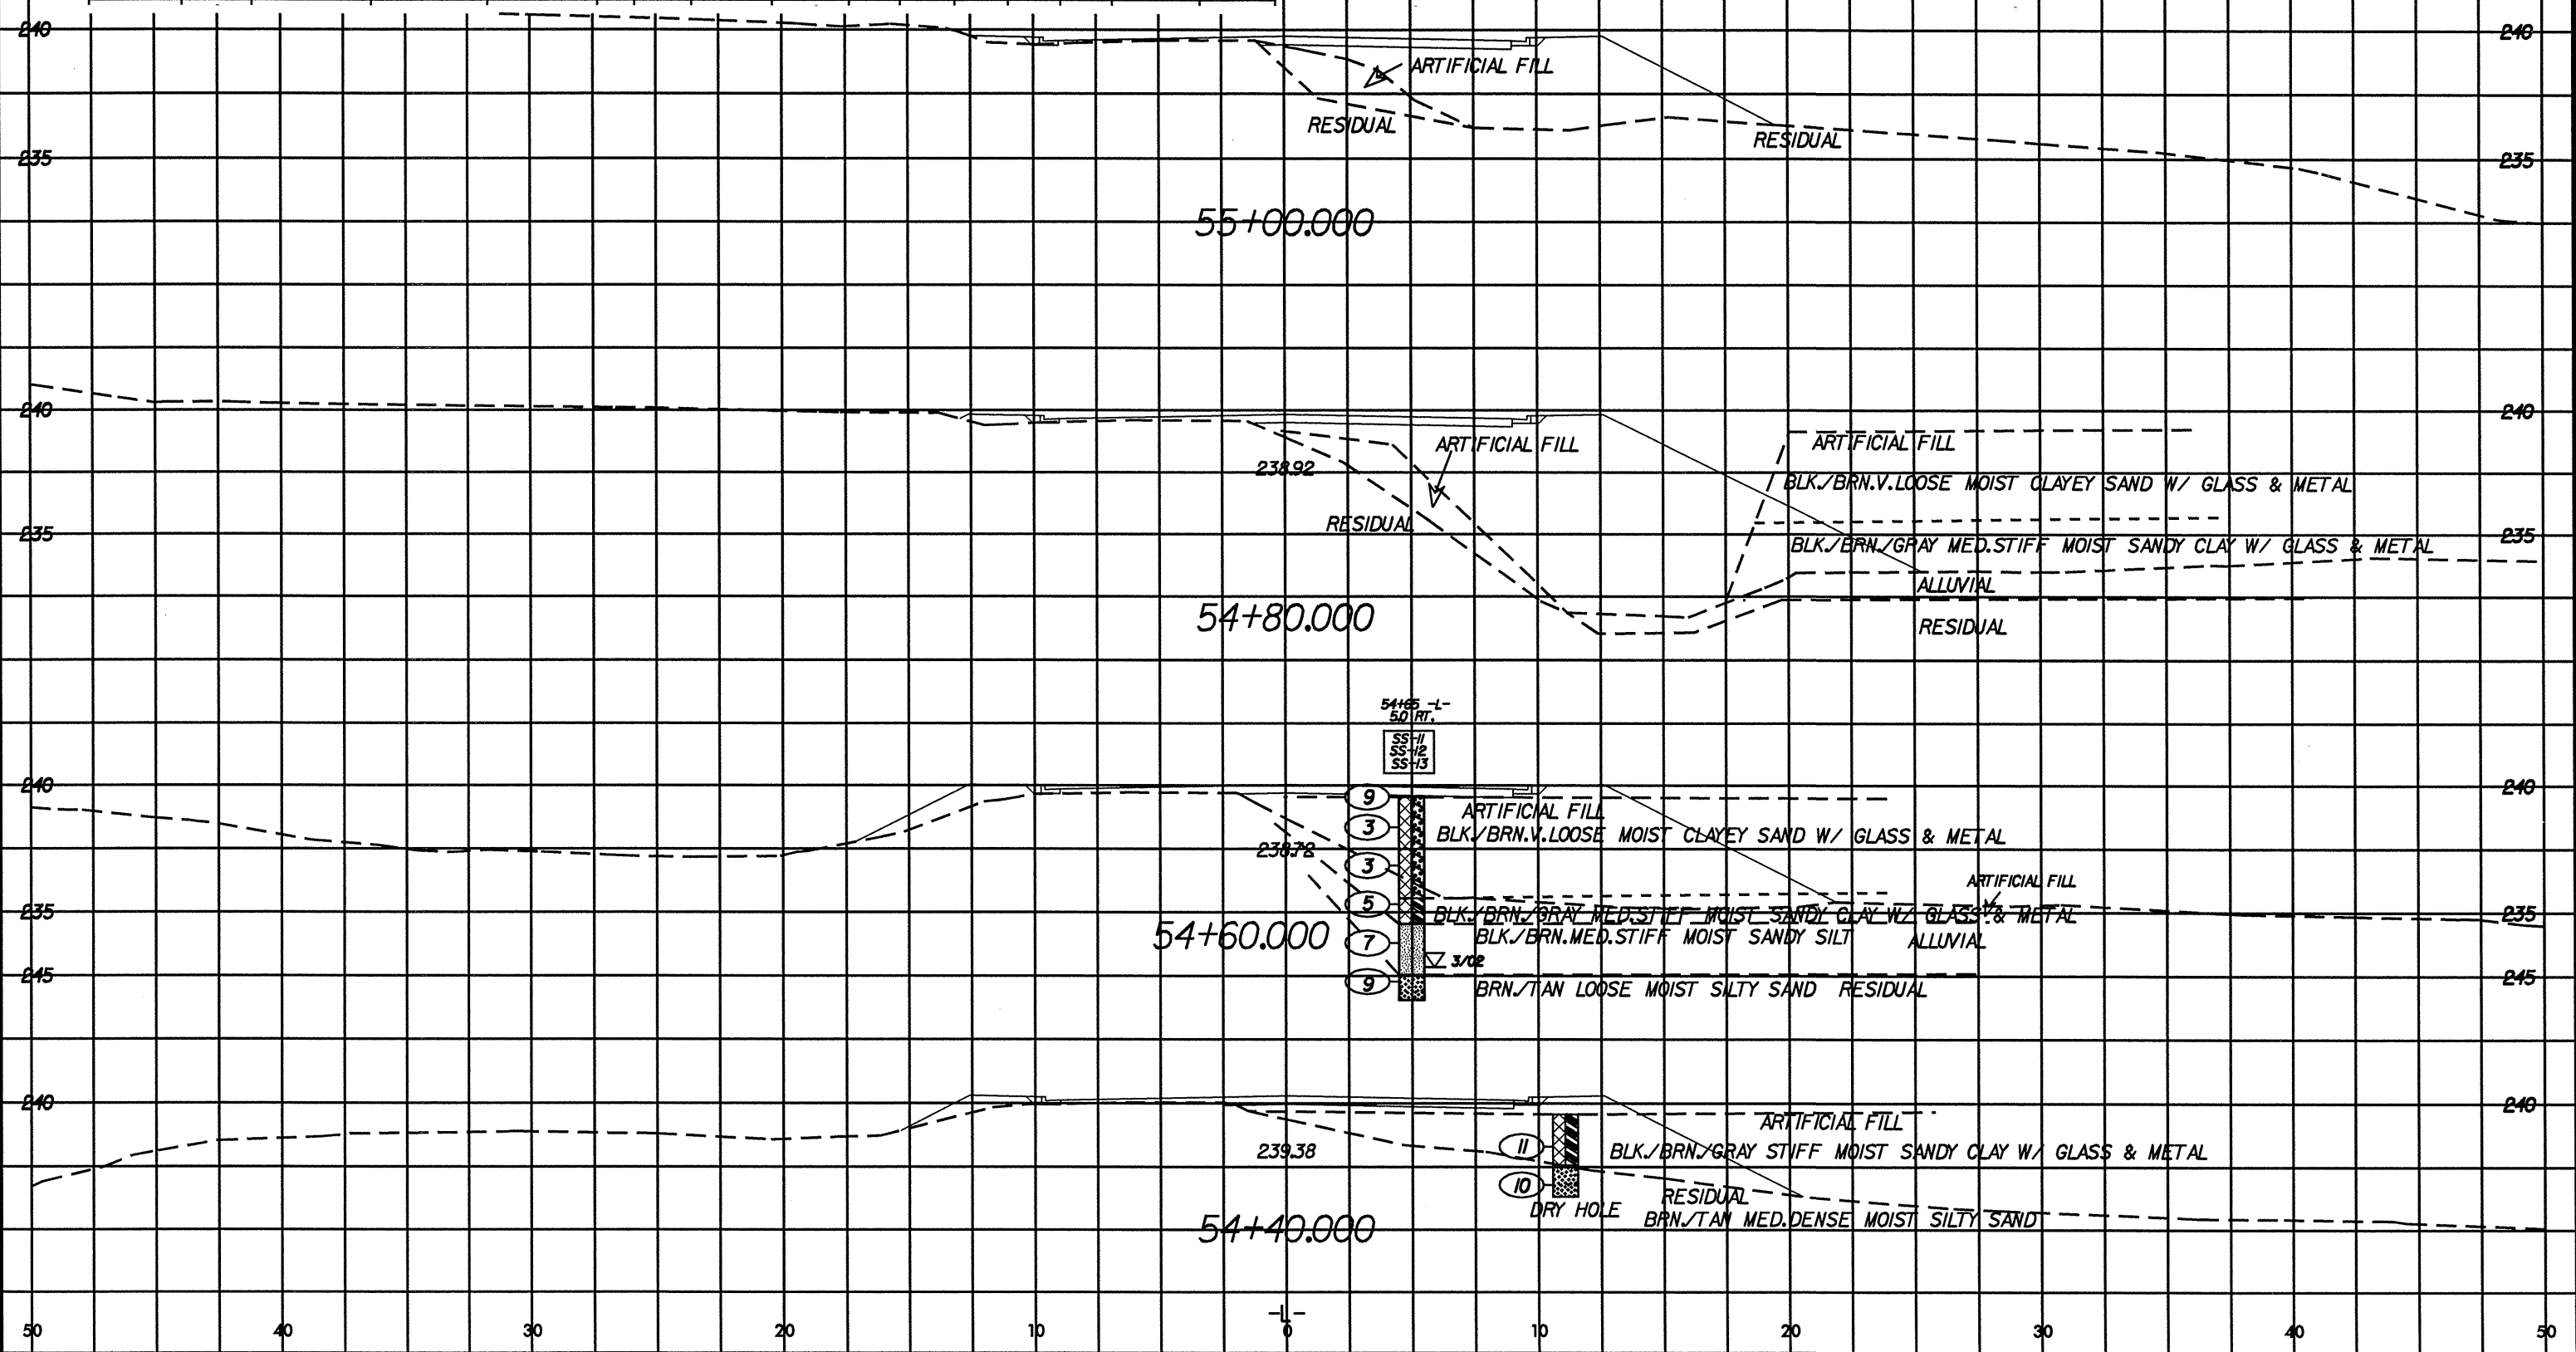

\*\*\*\*\*SYSTEMS\*\*\*\*\*  
\*\*\*\*\*USE\*\*\*\*\*