


SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	PL. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-1	10.0 LT.	51+70	0.00 - 0.45	A-2-6(1)	32	15	43.0	27.8	16.1	14.2	78	56	26		
SS-2	10.0 LT.	51+70	1.02 - 1.47	A-6(7)	40	19	28.0	18.4	13.1	40.5	95	78	54		
SS-3	10.0 LT.	51+70	4.28 - 4.73	A-6(1)	38	11	38.7	24.1	23.0	14.2	92	67	39		
SS-4	10.0 LT.	51+70	5.80 - 6.25	A-2-4(0)	40	NP	49.6	24.5	19.8	6.1	85	52	26		
SS-8A	6.0 RT.	51+85	2.28 - 2.73	A-2-6(0)	27	11	50.5	24.2	5.1	20.2	87	56	24		

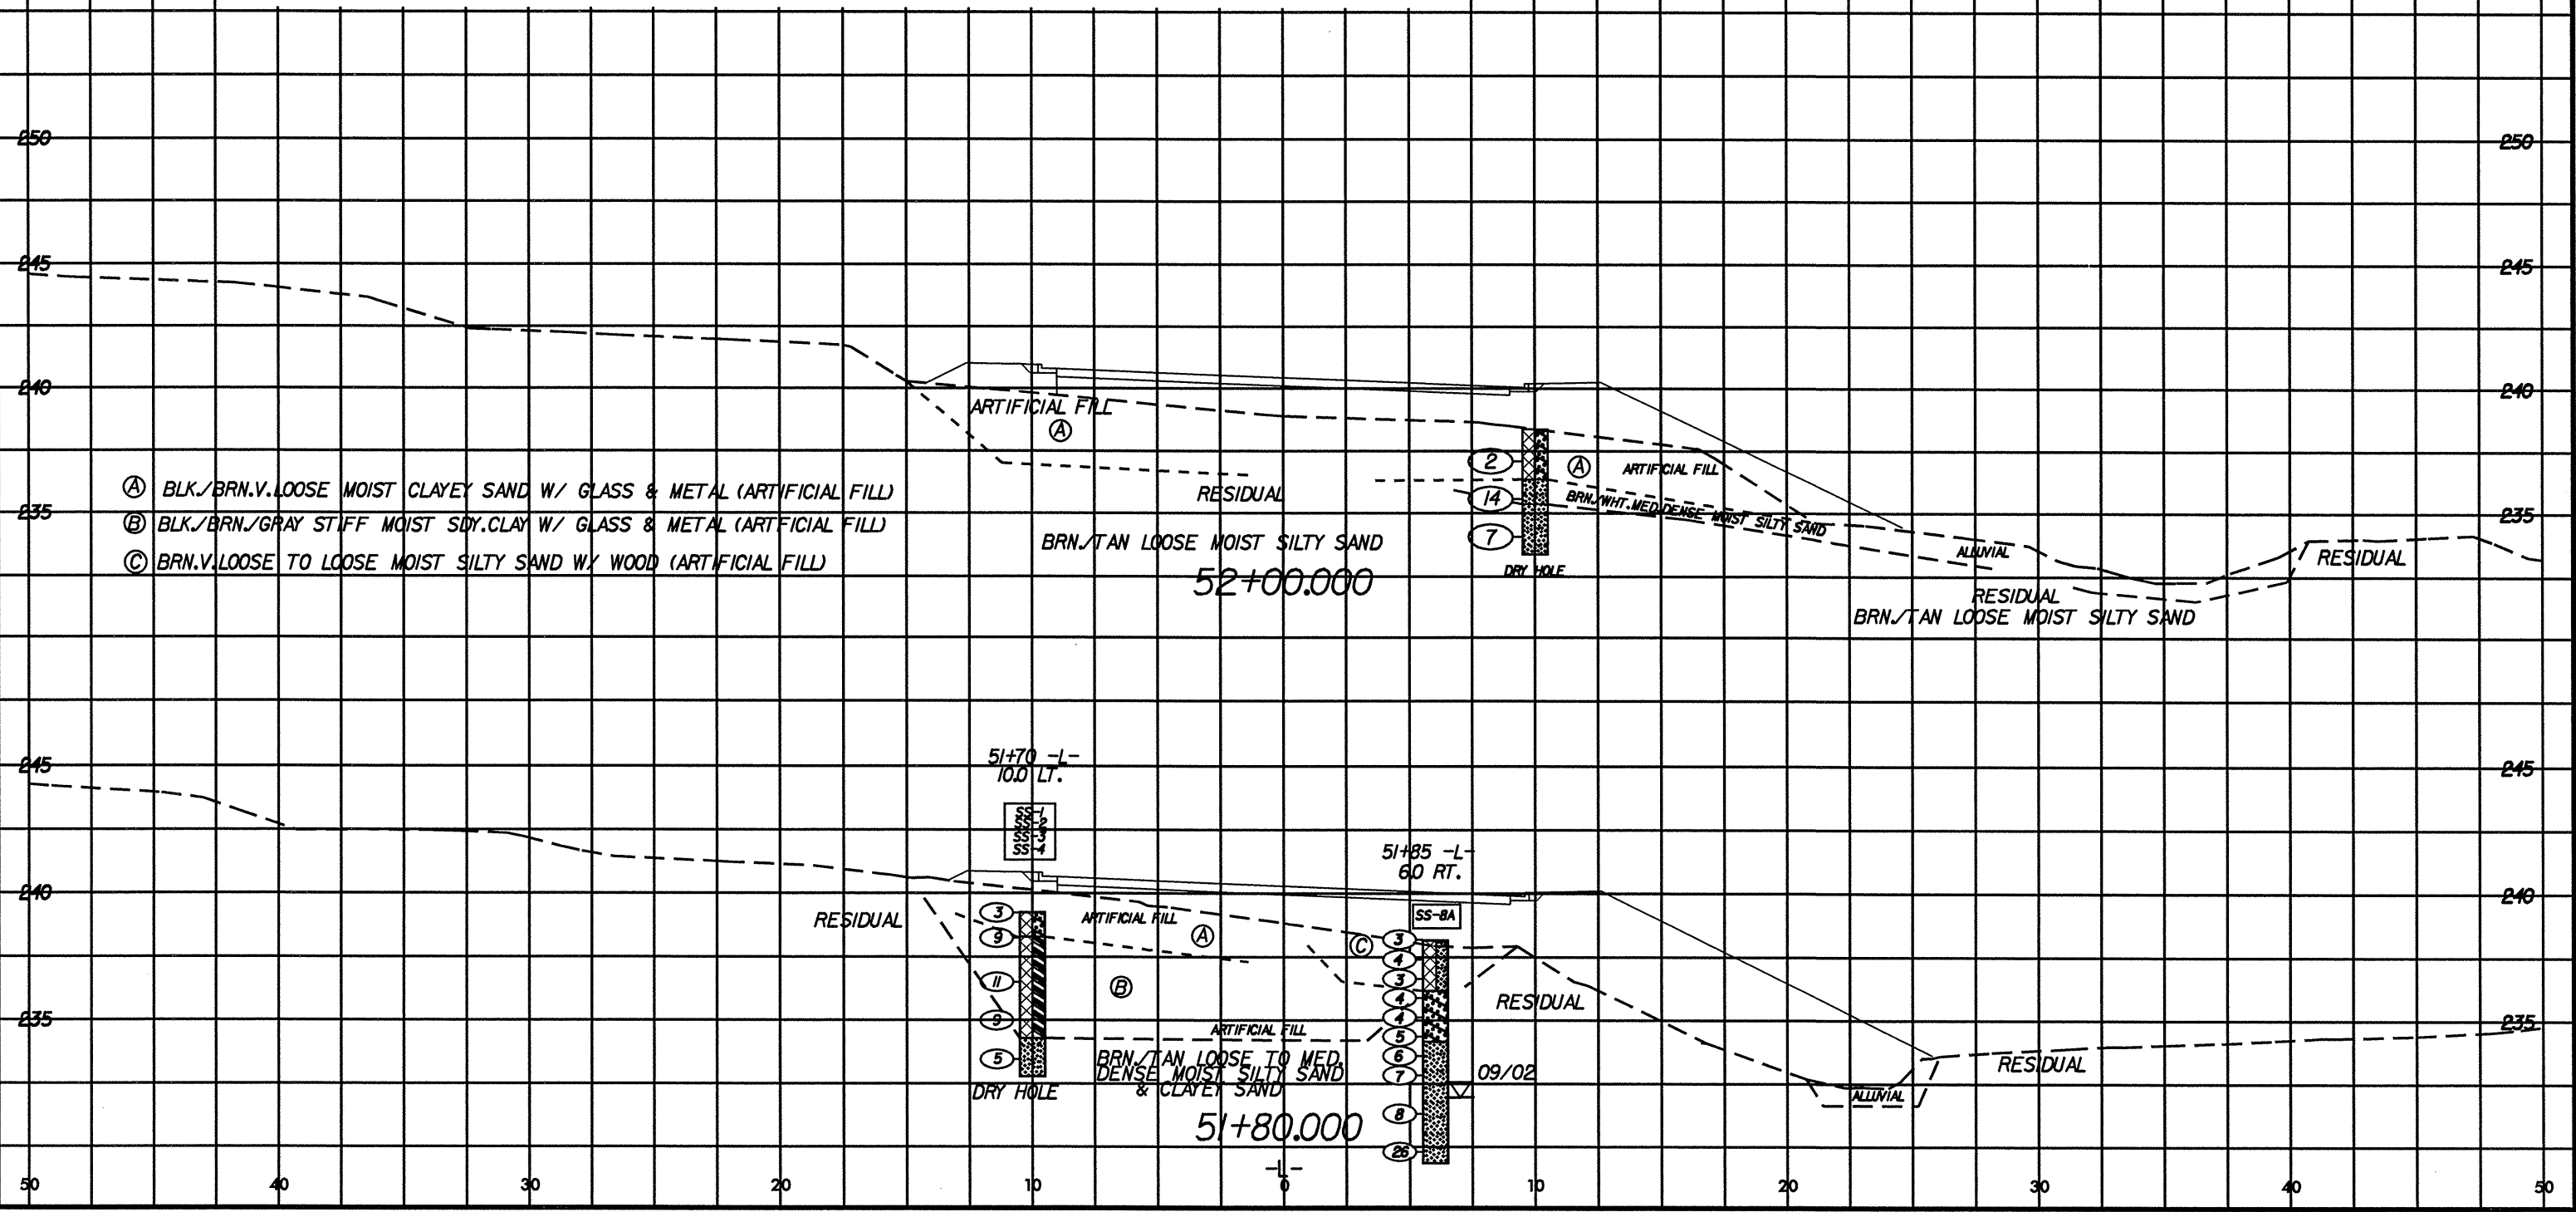

- Ⓐ BLK./BRN.V. LOOSE MOIST CLAYEY SAND W/ GLASS & METAL (ARTIFICIAL FILL)
- Ⓑ BLK./BRN./GRAY STIFF MOIST SOY. CLAY W/ GLASS & METAL (ARTIFICIAL FILL)
- Ⓒ BRN.V. LOOSE TO LOOSE MOIST SILTY SAND W/ WOOD (ARTIFICIAL FILL)

*****SYTIME*****
*****SERVING*****