


**SOIL TEST RESULTS**

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	PL. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
S-133	0.0	8+70.9-RPC	7.0-11.0	A-2-7(0)	53	23	69	9	0	22	91	43	23	18	

PROJECT REFERENCE NO. <b>R-2417BB</b>	SHEET NO. <b>19</b>
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER
<b>PRELIMINARY PLANS</b> DO NOT USE FOR CONSTRUCTION	

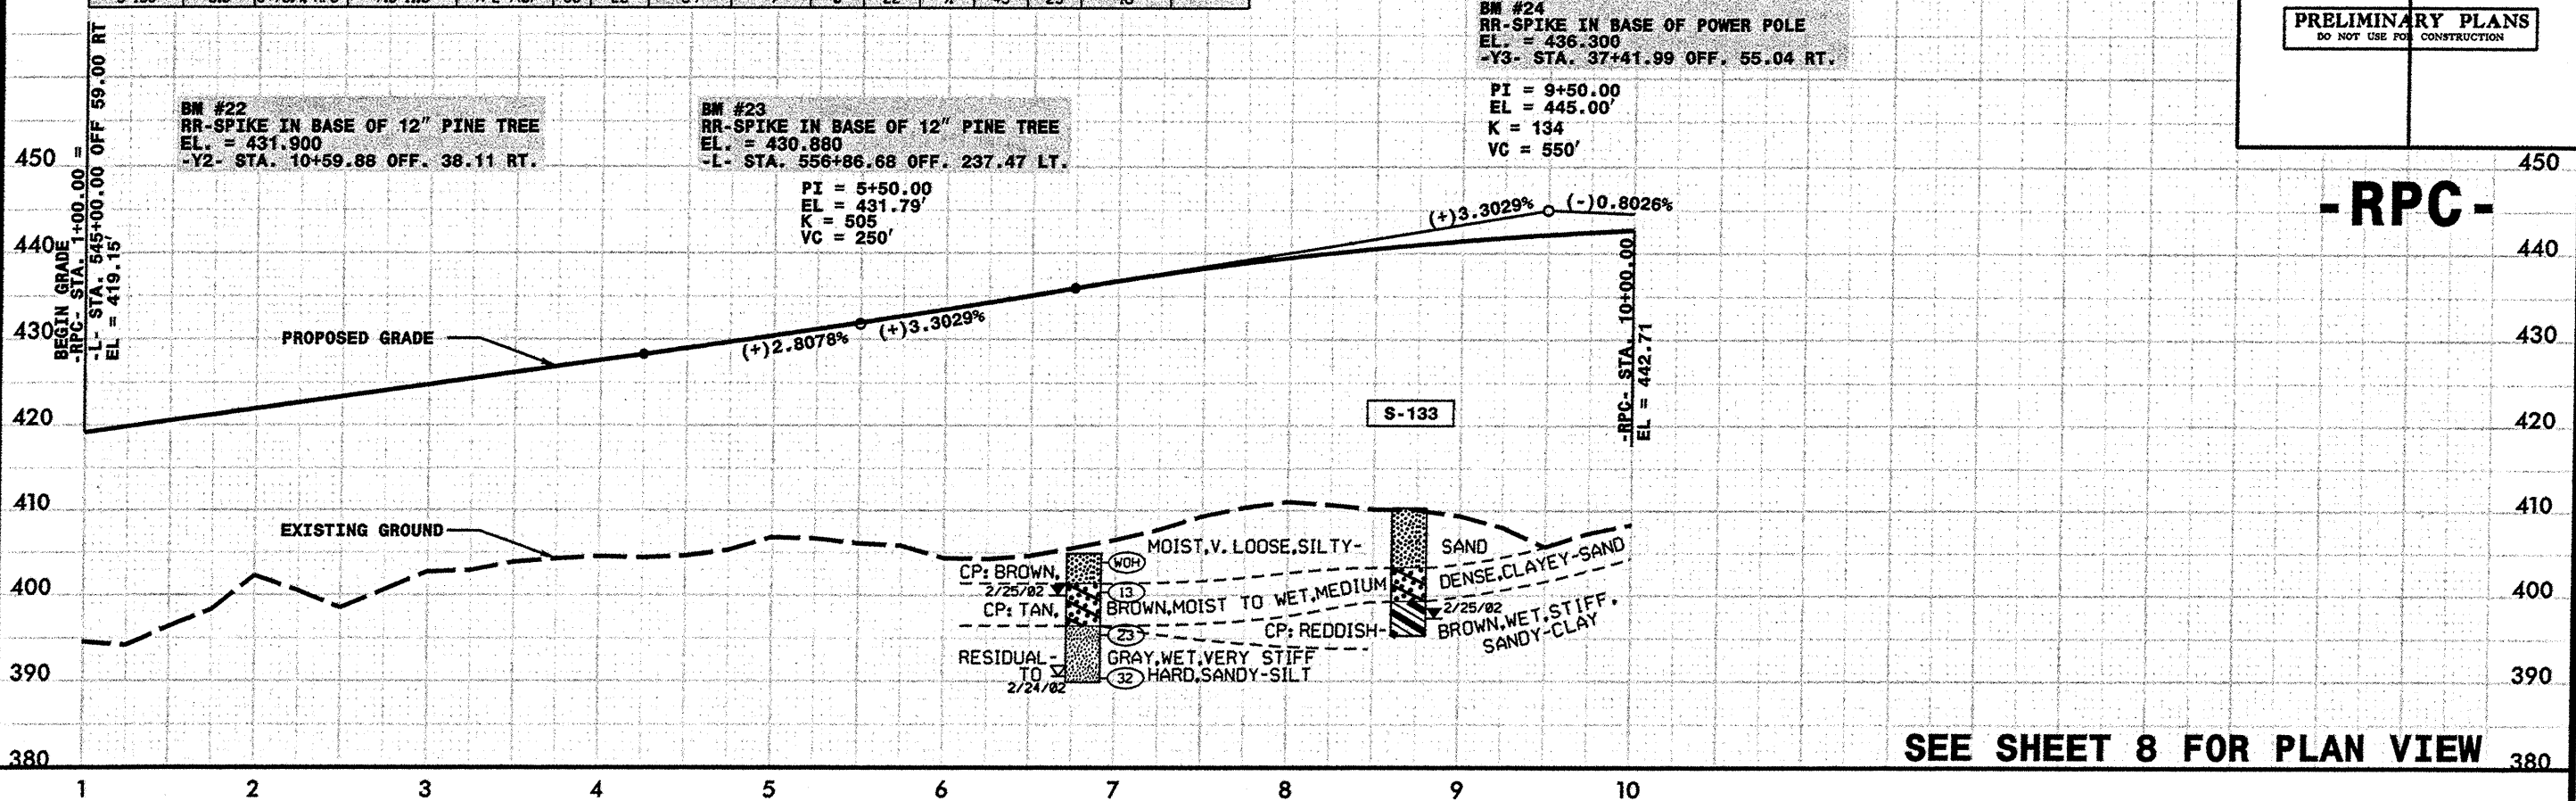

**SOIL TEST RESULTS**

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	PL. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
S-89	0.0	14+50-RPC	12.0-14.0	A-2-7(0)	41	14	67	11	8	14	100	66	23	30	
SS-108	0.0	18+50-RPC	0.0-1.5	A-2-4(0)	31	NP	45	35	14	6	88	65	25	9	
SS-109	0.0	18+50-RPC	3.5-5.0	A-1-B(0)	33	NP	92	5	1	2	100	25	3	4	
S-96	0.0	20+5-RPC	0.0-5.0	A-2-4(0)	31	NP	53	24	8	5	100	70	15	6	

