
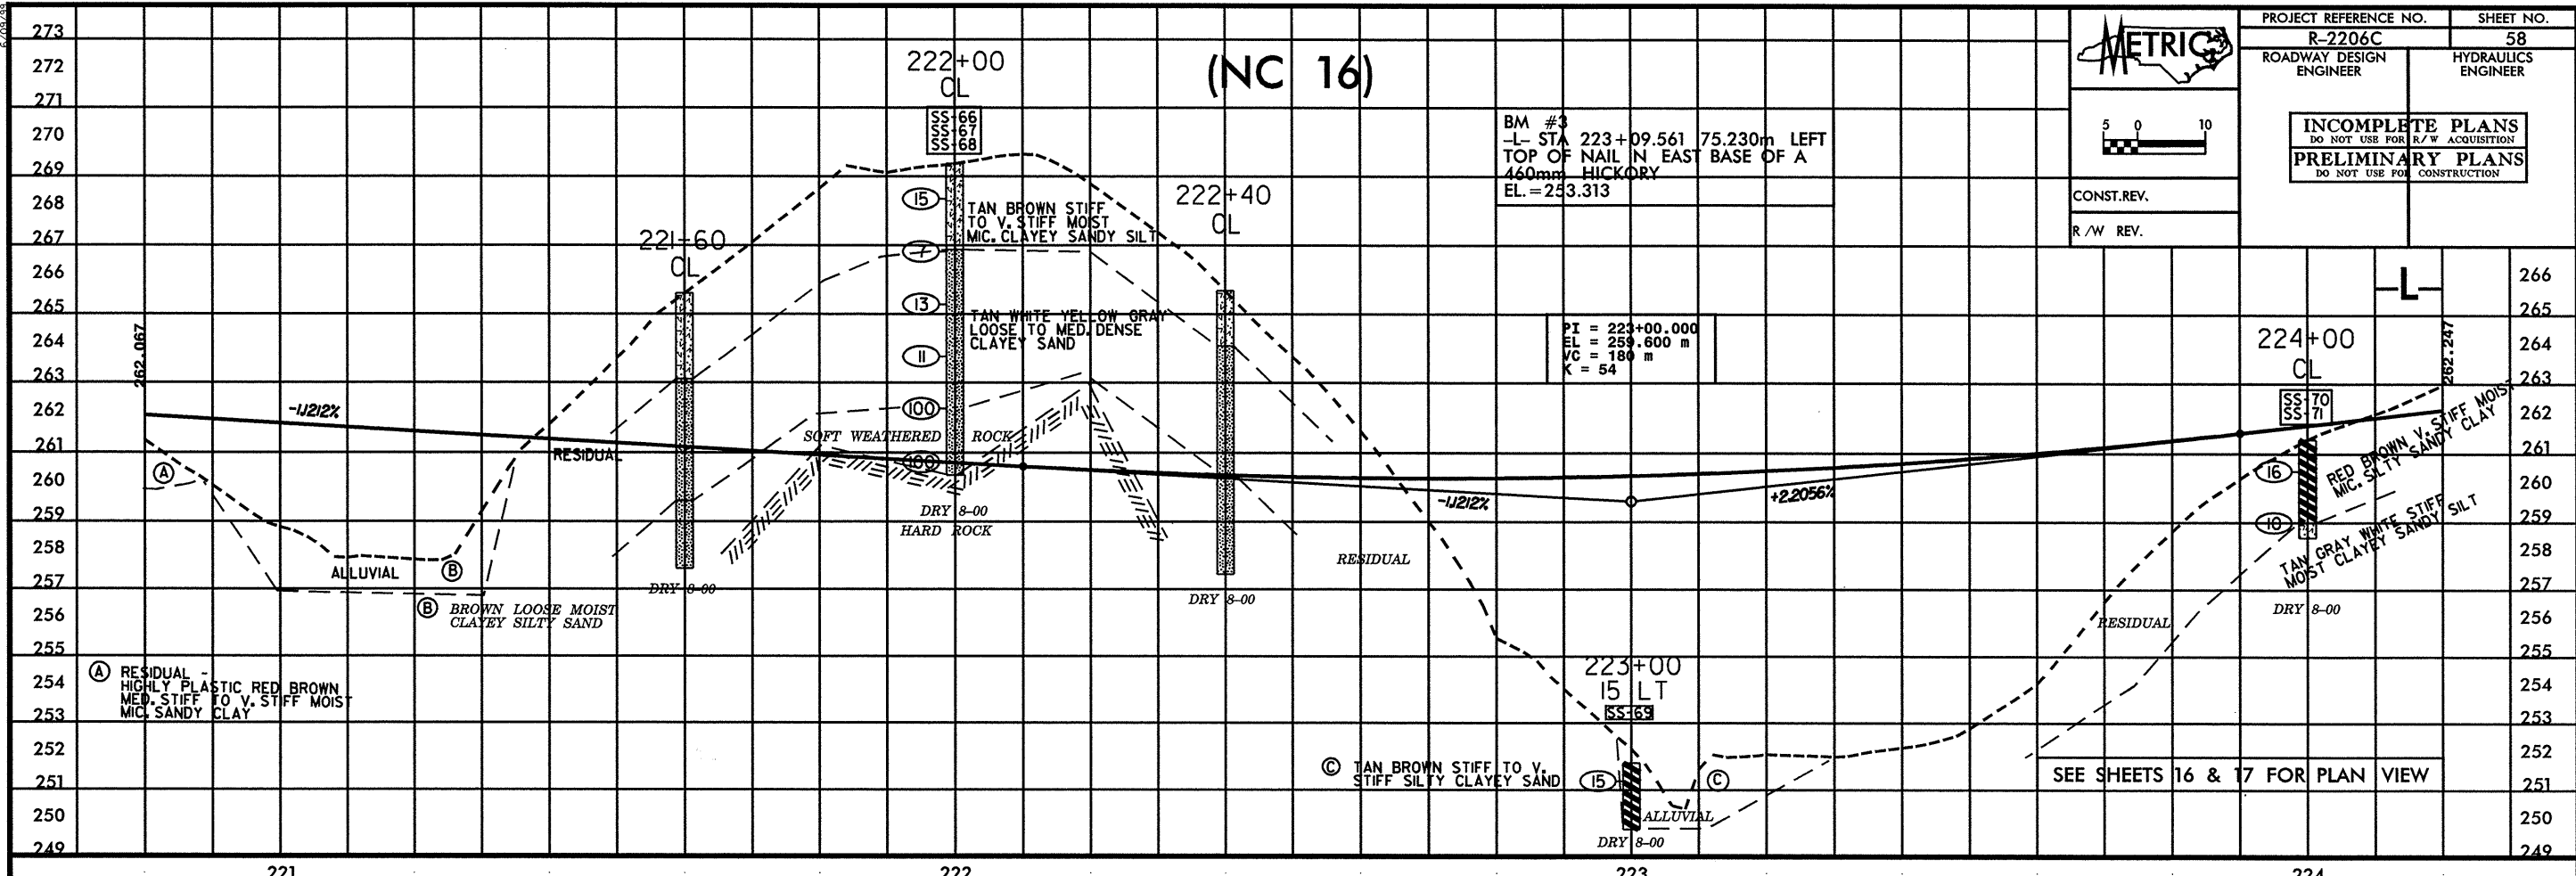


CONST. REV.
 R/W REV.



SOIL TEST RESULTS															
SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-65	30LT	220+70	1.03-1.33	A-7-6	50	36	18.3	25.2	6.1	50.4	100	93	60		
SS-66	CL	220+00	1.19-1.49	A-5	45	8	11.5	45.7	12.6	30.2	100	97	52		
SS-67	CL	220+00	2.71-3.01	A-2-4(0)	38	NP	27.2	49.3	7.4	16.1	100	88	32		
SS-68	CL	220+00	5.75-6.05	A-2-4(0)	26	NP	34.8	43.3	7.8	14.1	100	81	29		
S-69	15LT	223+00	0.0-1.0	A-7-5(7)	47	11	6.9	41.2	21.6	30.3	100	99	61		
SS-70	CL	224+00	1.05-1.35	A-7-6(12)	44	17	11.1	25.1	29.7	34.3	100	94	70		
SS-71	CL	224+00	2.57-2.87	A-5	43	NP	7.9	54.1	25.9	12.1	100	99	49		
SS-72	20RT	225+00	1.04-1.34	A-7-5(16)	61	25	19.8	19.2	12.5	48.5	100	88	64		
SS-73	20RT	225+00	2.56-2.86	A-5(1)	45	7	24.6	40	23.2	12.1	100	88	44		
SS-74	20RT	225+00	7.13-7.43	A-2-4(0)	39	NP	20.4	56.4	15.2	8.1	100	92	30		
SS-75	CL	227+00	1.16-1.46	A-7-5(7)	45	13	16.8	30.9	24	28.3	100	91	59		
SS-76	CL	227+00	2.68-2.98	A-5(5)	46	10	8.5	44	31.3	16.2	100	97	57		

C:\STIML\\$\$\$DESIGN\\$\$\$USER\NAME\\$\$\$