

5 0 10


CONST. REV.

R/W REV.

PROJECT REFERENCE NO. R-2206B	SHEET NO. 62
R/W SHEET NO.	
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER
INCOMPLETE PLANS DO NOT USE FOR R/W ACQUISITION	
WILBUR SMITH ASSOCIATES P.O. BOX 2478 RALEIGH, N. C. 27602-2478	TRANSITE CONSULTING 1800 PARROCK DRIVE, SUITE 6-10 RALEIGH, N. C. 27609

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	PL. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
S-14	20 RT	167+60	0.00-2.00	A-7-5(23)	63	29	7.1	24.2	24.2	44.4	100	96	73		
S-15	25 RT	167+60	2.00-4.00	A-5(3)	45	8	20.4	33.7	23.6	22.2	100	92	52		
SS-14A	CL	170+05	1.38-1.68	A-6(2)	32	11	31.1	26.9	13.7	28.3	100	84	45		
SS-15A	CL	170+05	2.90-3.20	A-2-4(0)	25	NP	52.1	34.5	9.3	4	95	64	17		

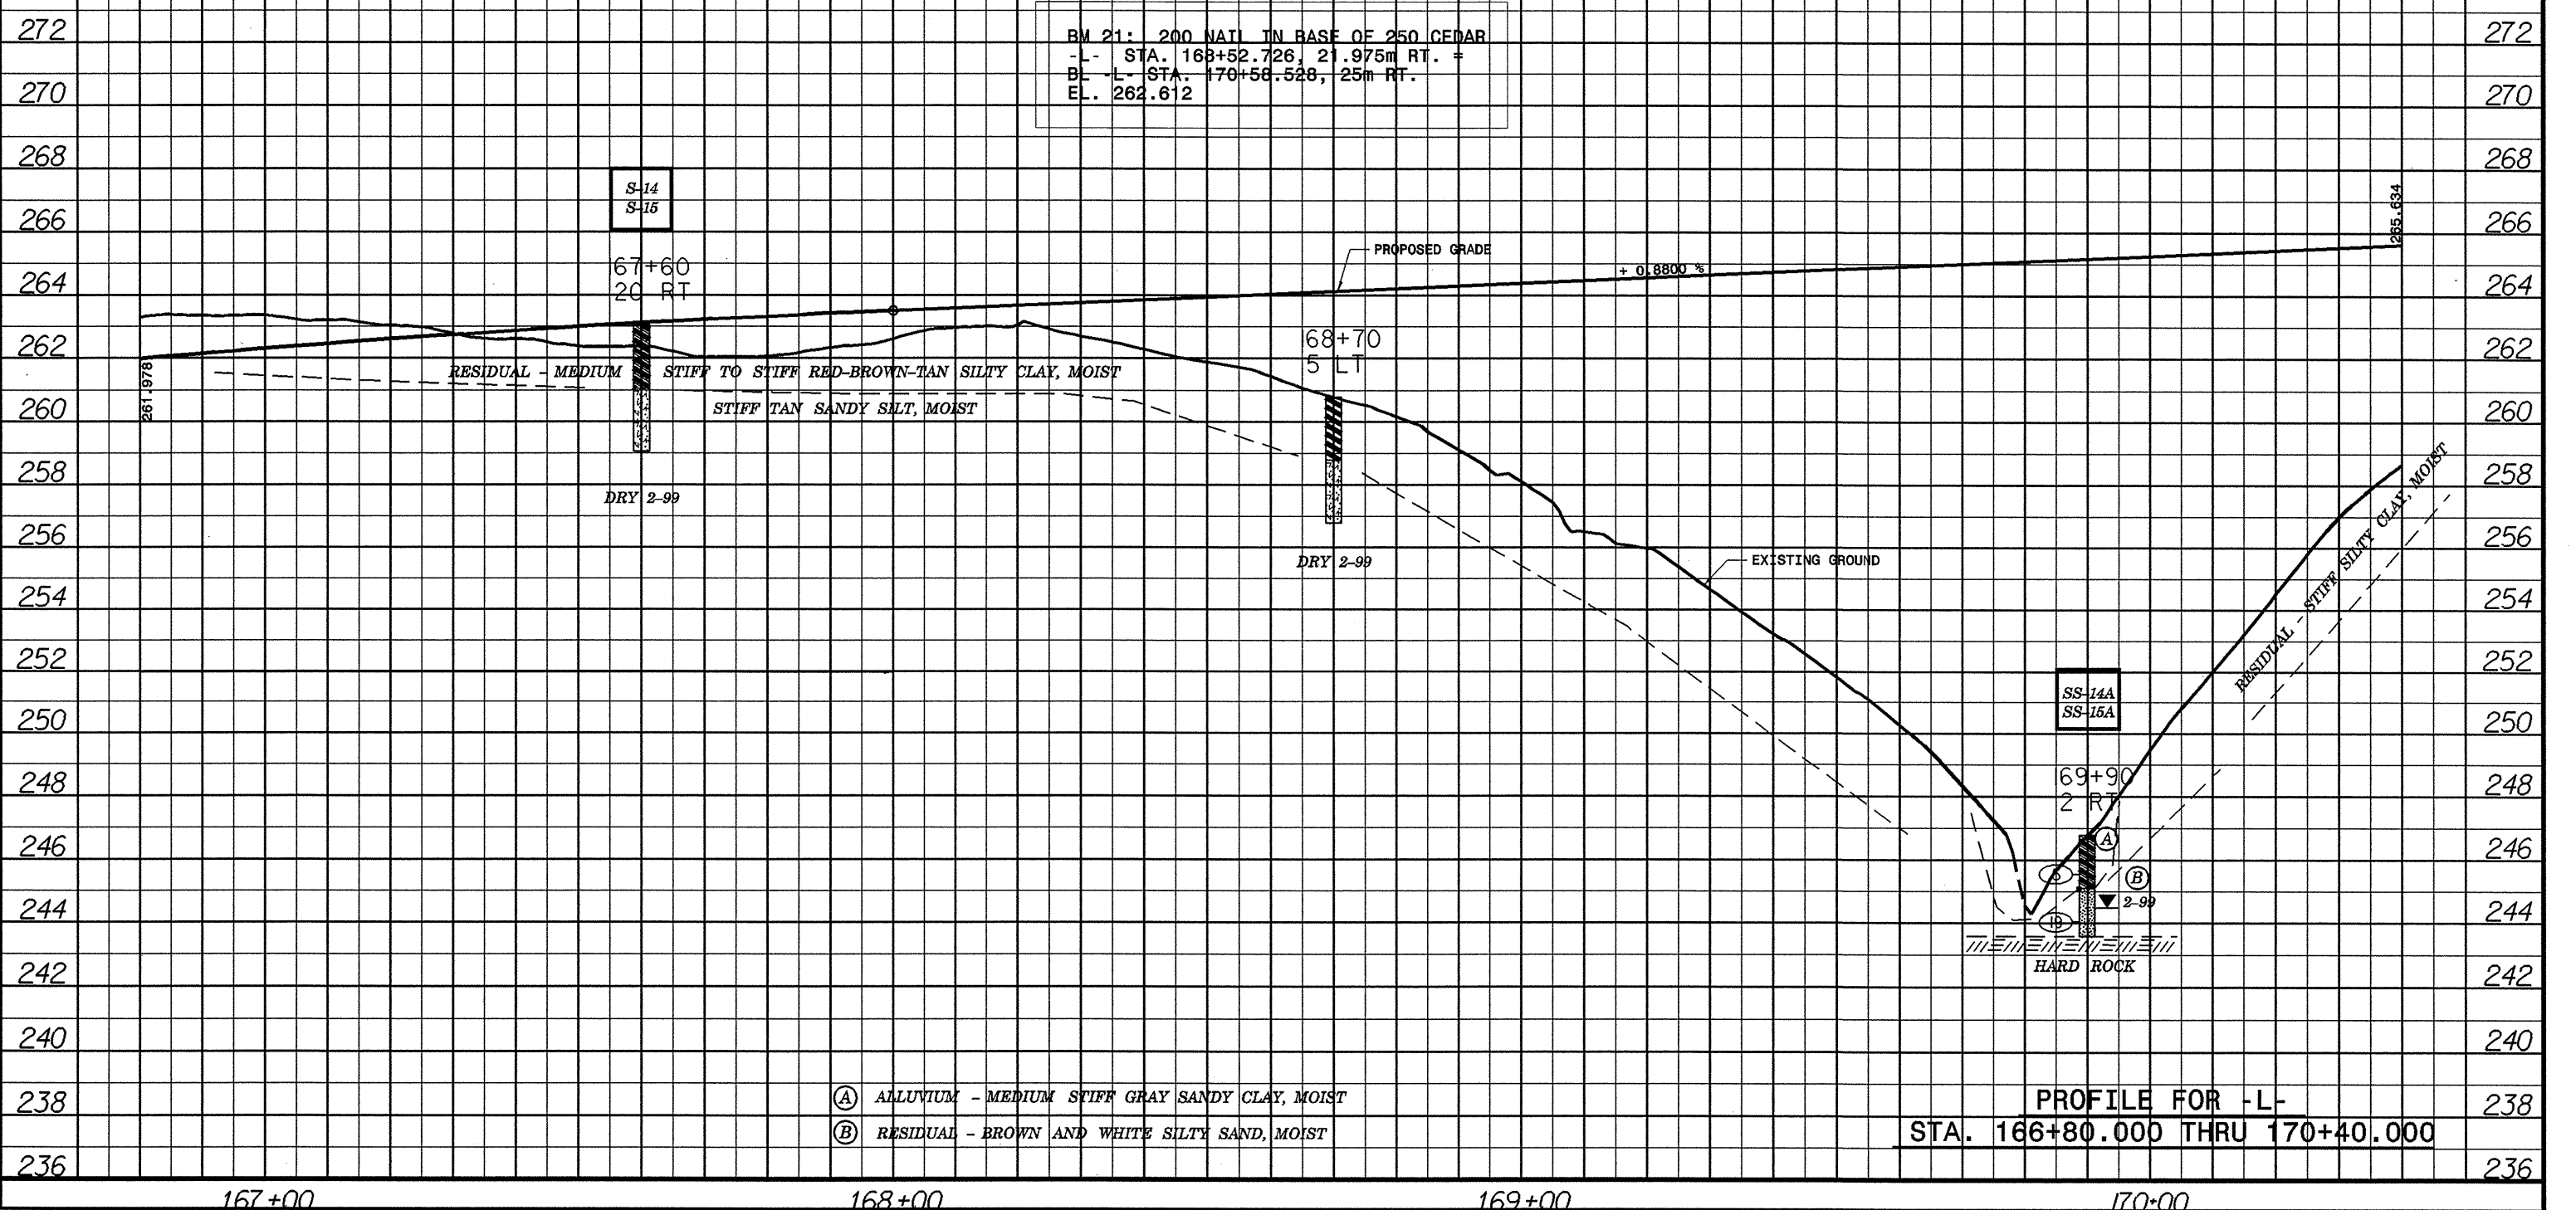

- (A) ALLUVIUM - MEDIUM STIFF GRAY SANDY CLAY, MOIST
- (B) RESIDUAL - BROWN AND WHITE SILTY SAND, MOIST