


ALL WATER LINES OWNED  
BY ROBESON COUNTY

PROJECT REFERENCE NO. R-0513BA	SHEET NO. UC-14
5 0 10	
UTILITY CONSTRUCTION	

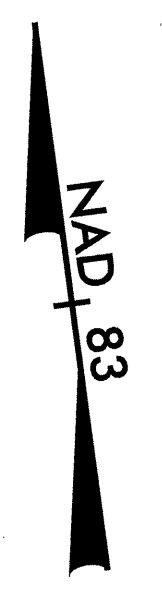

MATCH LINE -YI- STA. 18+40  
SEE SHEET UC-12


PROP. 172M OF 200MM PVC WATER PIPE, SDR 21, 1.38MPA WP  
2 - 200MM 22 1/2° DI BENDS  
CONNECT USING NECESSARY FITTINGS

PROP.  
1 - RELOCATE EXISTING FIRE HYDRANT  
5M OF 150MM DI WATER PIPE,  
PC 2.41 MPA WP  
1 - 150MM GATE VALVE & VALVE BOX,  
1.38MPA WP  
1 - 200MM X 150MM DI TEE  
CONNECT USING NECESSARY FITTINGS

PROP. 169M - FILL OR REMOVE  
ABANDONED 200MM PIPE, PVC WATER

PROP.  
1 - RELOCATE EXISTING WATER METER  
38M OF 20MM PE WATER TUBING, SDR 7,  
1.38MPA WP  
1 - 200MM X 20MM TAPPING SADDLE  
1 - 20MM CORPORATION STOP  
CONNECT USING NECESSARY FITTINGS

PROP.  
1 - RELOCATE EXISTING WATER METER  
5M OF 20MM PE WATER TUBING, SDR 7,  
1.38MPA WP  
1 - 200MM X 20MM TAPPING SADDLE  
1 - 20MM CORPORATION STOP  
CONNECT USING NECESSARY FITTINGS

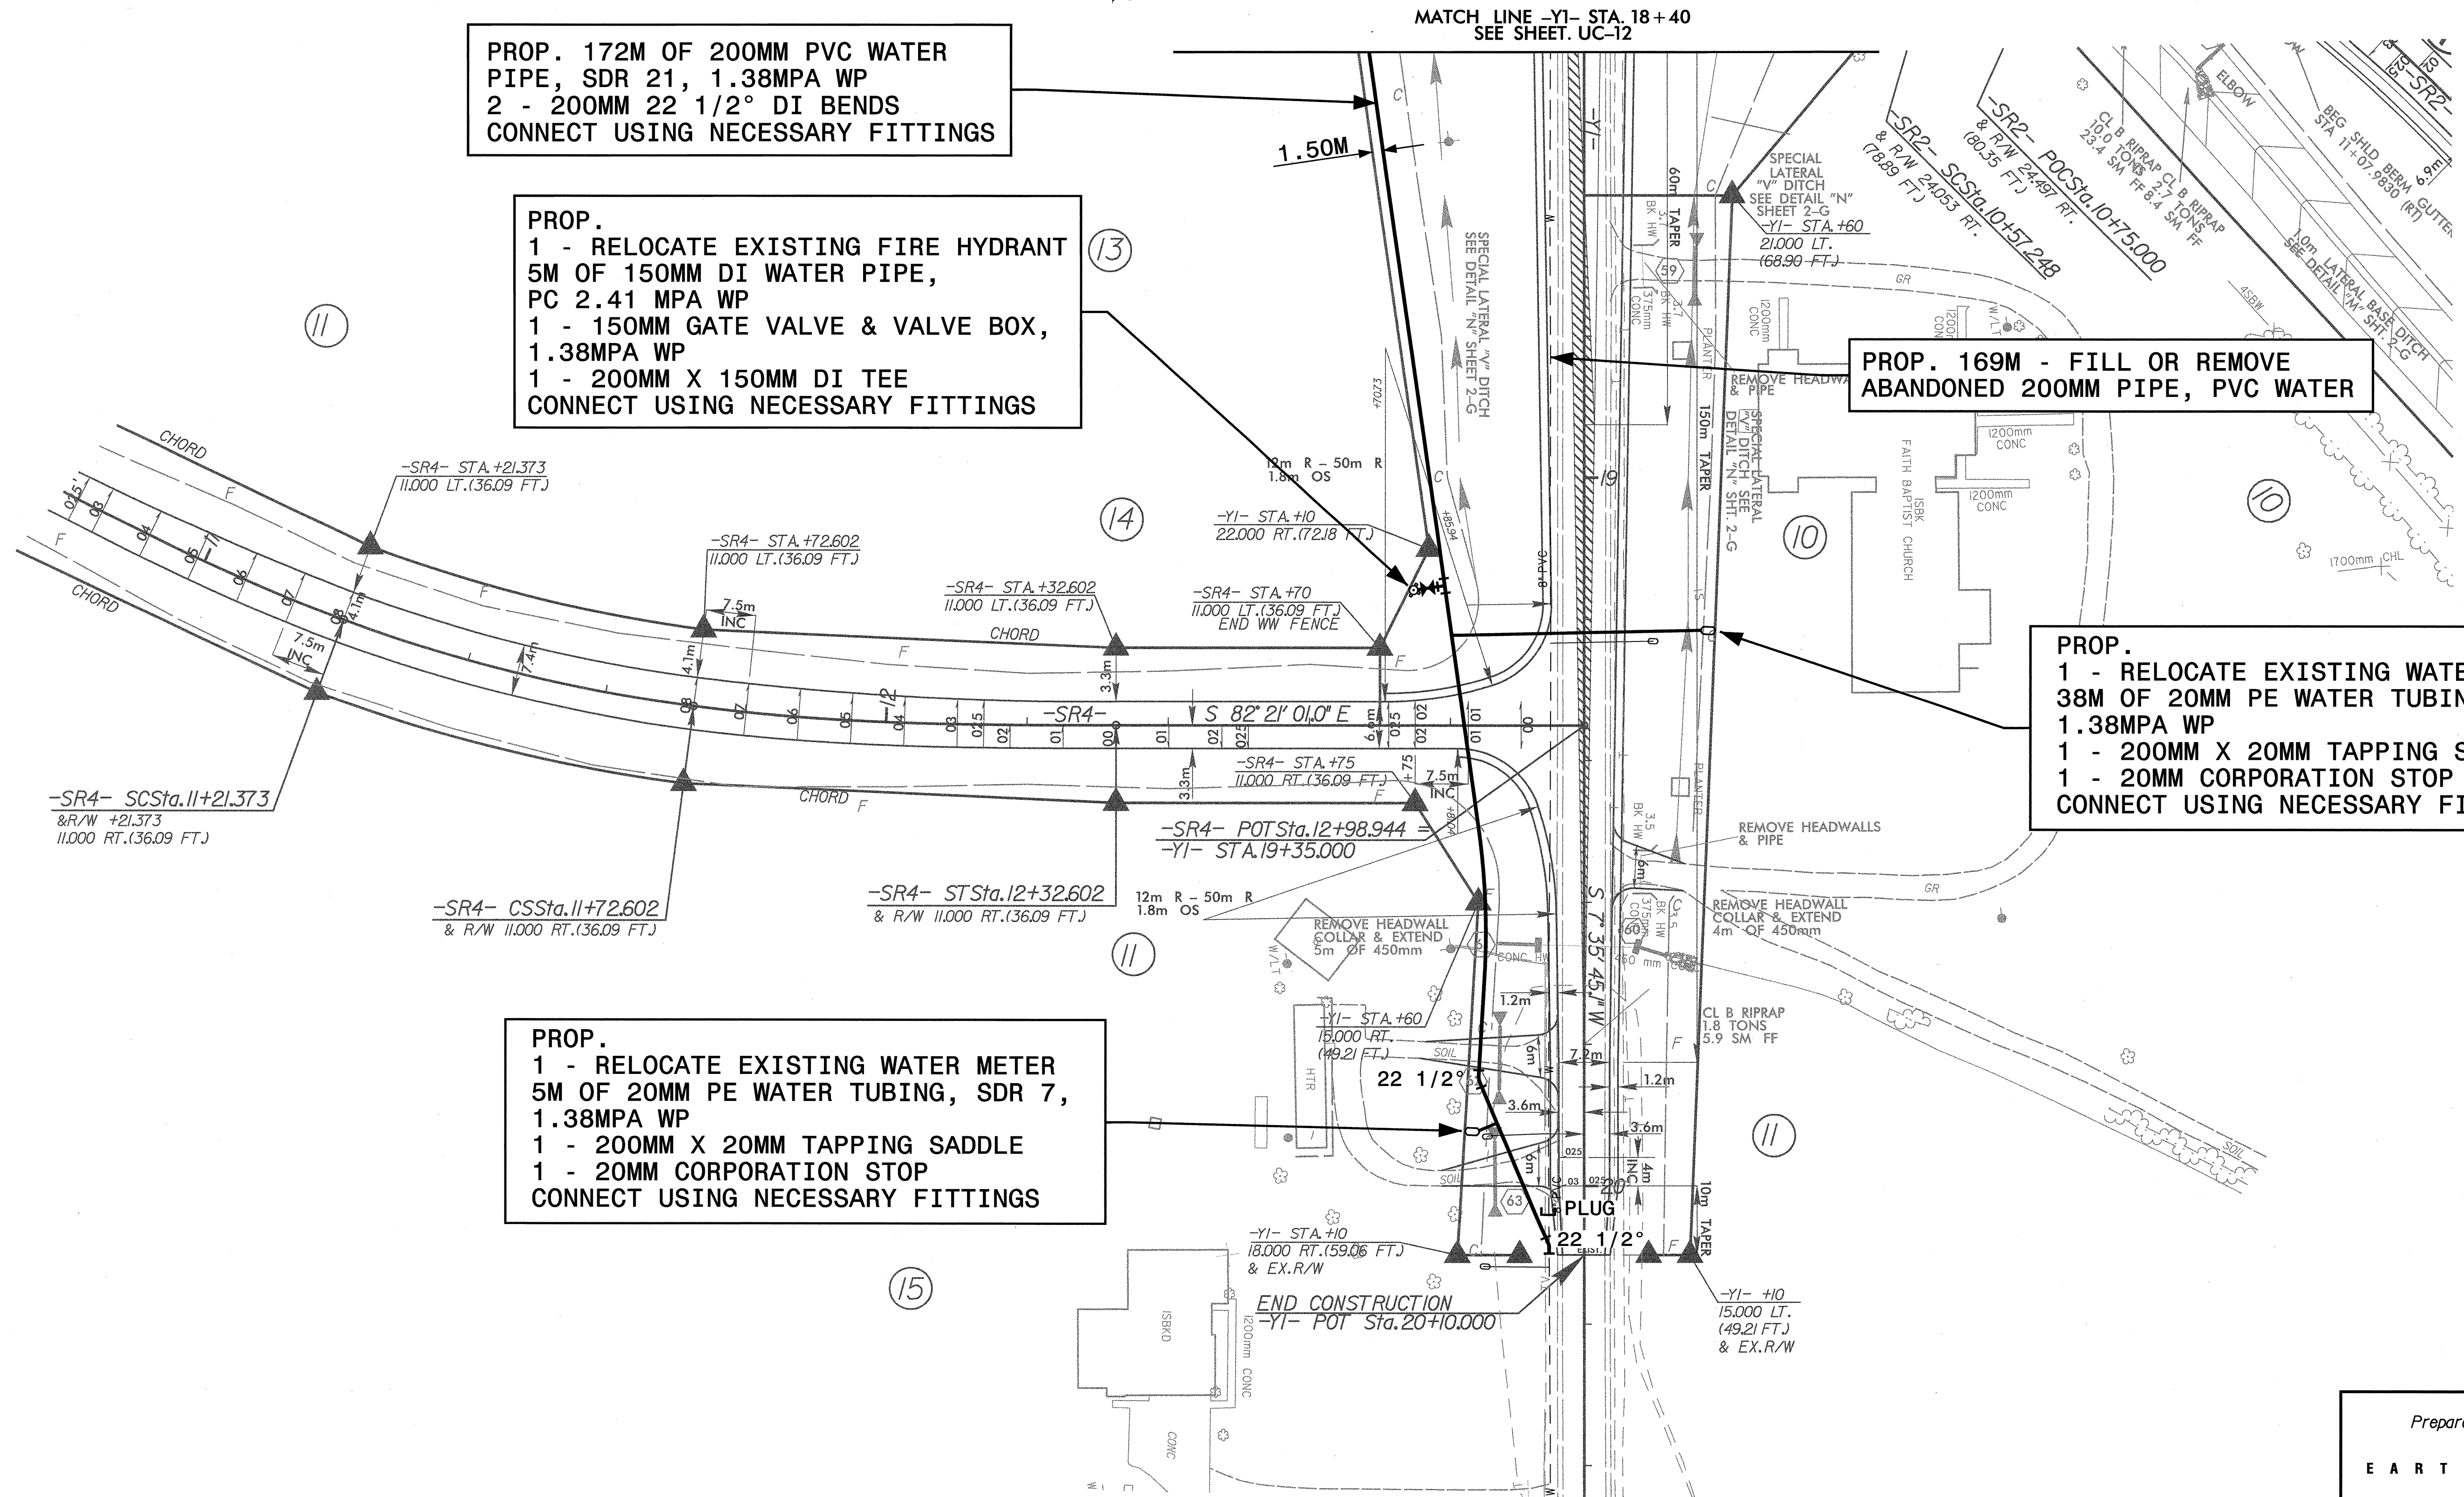

6/17/2014 CADD/F-05 13BA\_UC14 13BAUC14.pht  
 02:26:00 PM

Prepared in the Office of:  
**EARTH TECH**  
 701 Corporate Center Drive, Suite 475  
 Raleigh, NC 27607  
 (919) 854-6200 - (919) 854-6259(FAX)