

UTILITY CONSTRUCTION


ALL WATER LINES OWNED BY ROBESON COUNTY

PROP. 105M OF 200MM PVC WATER PIPE, SDR 21, 1.38MPA WP
 1 - 200MM GATE VALVE & VALVE BOX, 1.38MPA WP
 1 - RELOCATE EXISTING WATER METER
 1.5M OF 20MM PE WATER TUBING,
 SDR 7, 1.38MPA WP
 1 - 200MM X 20MM TAPPING SADDLE
 1 - 20MM CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. 60M OF 200MM PVC WATER PIPE, SDR 21, 1.38MPA WP
 2 - 200MM 22 1/2° DI BENDS
 1 - 200MM GATE VALVE & VALVE BOX, 1.38MPA WP
 CONNECT USING NECESSARY FITTINGS

PROP. 222M - FILL OR REMOVE ABANDONED 200MM PIPE, PVC WATER

PROP. 70M OF 200MM PVC WATER PIPE, SDR 21, 1.38MPA WP
 4 - 200MM 45° DI BENDS
 2 - 200MM X 200MM DI TEES
 1 - 200MM GATE VALVE & VALVE BOX, 1.38MPA WP
 CONNECT USING NECESSARY FITTINGS

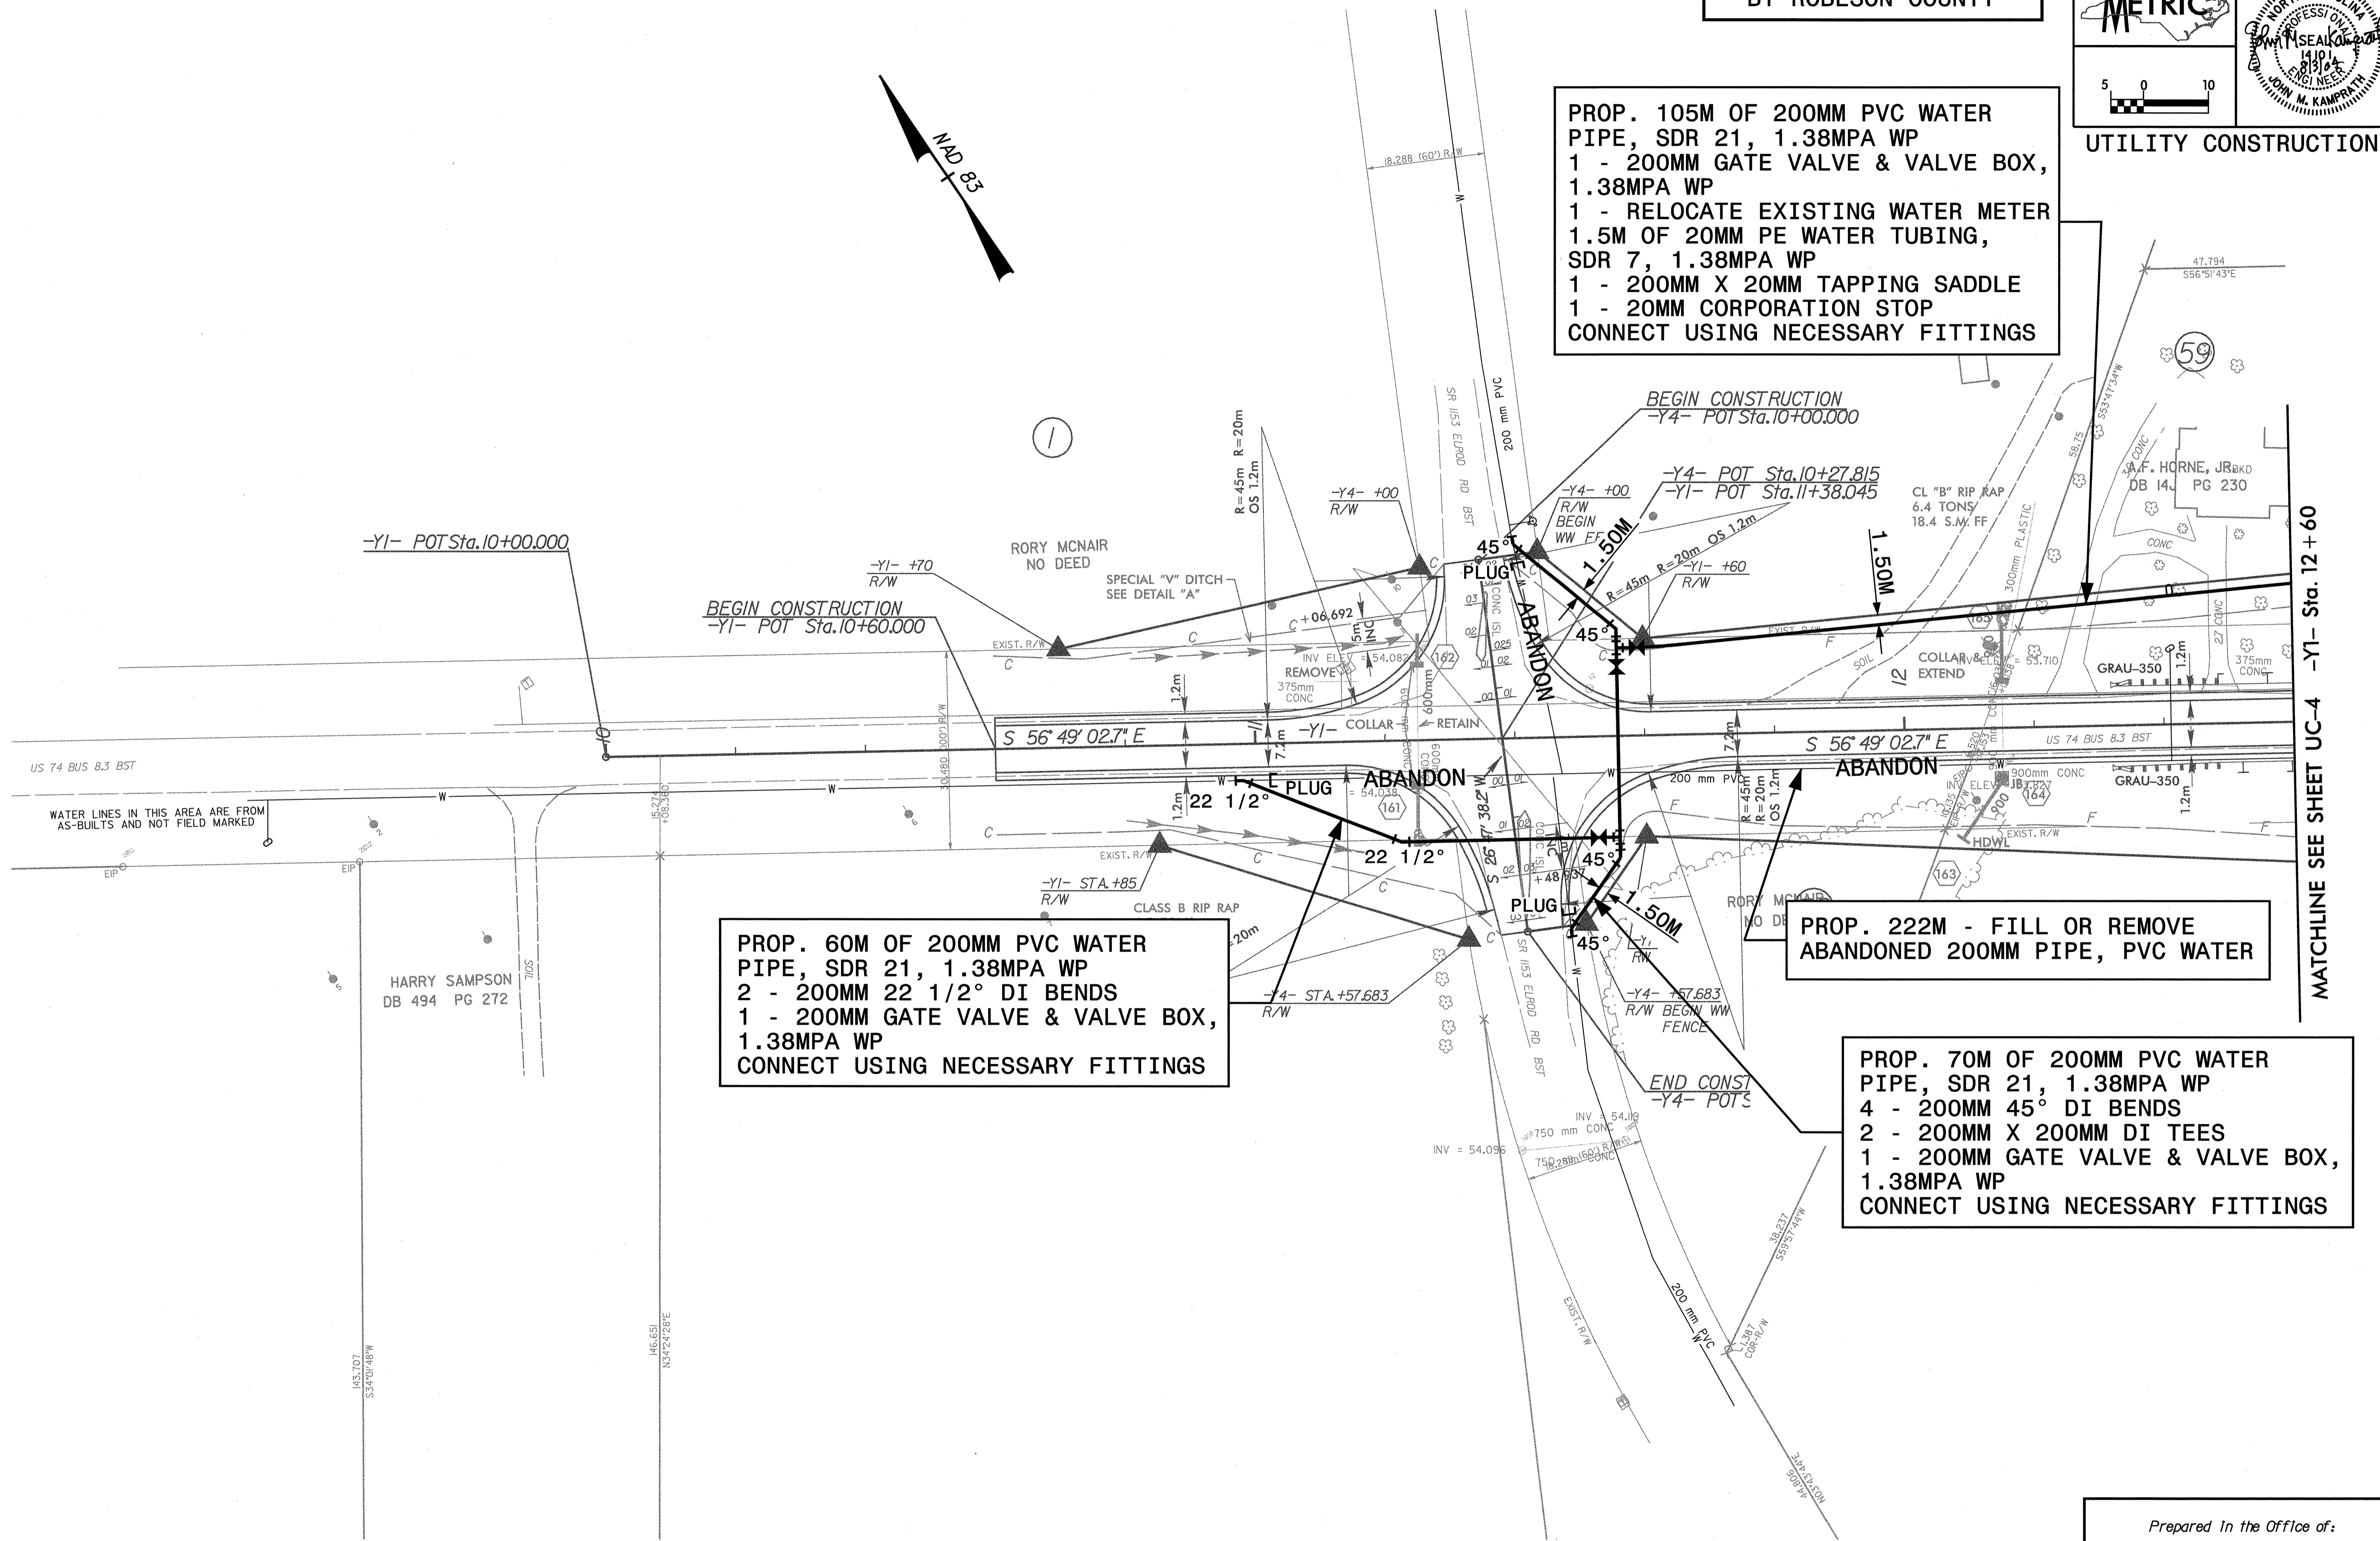

MATCHLINE SEE SHEET UC-4 -Y1- Sta. 12 + 60

S:\T055\A\CADD\05\30\05\11\AUC08.pht 02/23/2004