


SOIL SAMPLE TEST RESULTS															
SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS.	LL	PI	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	2.0 mm	425 um	75 um		
S-38	17+20	CL	0.30-0.91	A-6(5)	86	18	37.3	18.5	12	32.2	98	75	47	17.5	
S-39	17+20	CL	0.91-1.68	A-6(1)	28	13	39.1	25.8	11	24.2	99	75	39	18.4	
S-40	19+60	CL	0.30-1.62	A-2(8(1)	80	13	50.4	16.7	6.7	27.2	99	69	34		
S-41	19+60	CL	1.62-3.81	A-1(8(0)	17	NP	82.6	13.2	1.2	3.0	95	37	5		
SS-52	20+66	CL	0.76-1.21	A-2(4(0)	21	7	62	19.4	4.4	14.1	97	55	20		
SS-53	20+66	CL	1.67-1.97	A-6(7)	40	21	37	13.9	14.7	34.3	100	74	51		
SS-54	20+66	CL	3.05-3.50	A-1(8(0)	17	NP	86.1	11	0.9	2	95	35	3		
S-46	22+60	CL	0.30-2.44	A-6(9)	40	23	27.3	20.2	12.1	40.4	99	82	55	19.5	
S-47	22+60	CL	2.44-3.81	A-1(8(0)	20	NP	81.4	17.1	0.5	1	99	49	2		
SS-55	24+40	CL	0.76-1.21	A-7(8(9)	41	24	34.1	13.7	15.8	36.4	98	75	53	19.3	
SS-56	24+40	CL	2.29-2.74	A-6(7)	32	15	20.4	23.8	27.5	28.3	100	93	62	26.4	
SS-57	24+40	CL	3.05-3.50	A-2(4(0)	18	NP	21.6	52.5	13.7	12.1	100	90	34		


-SR1-

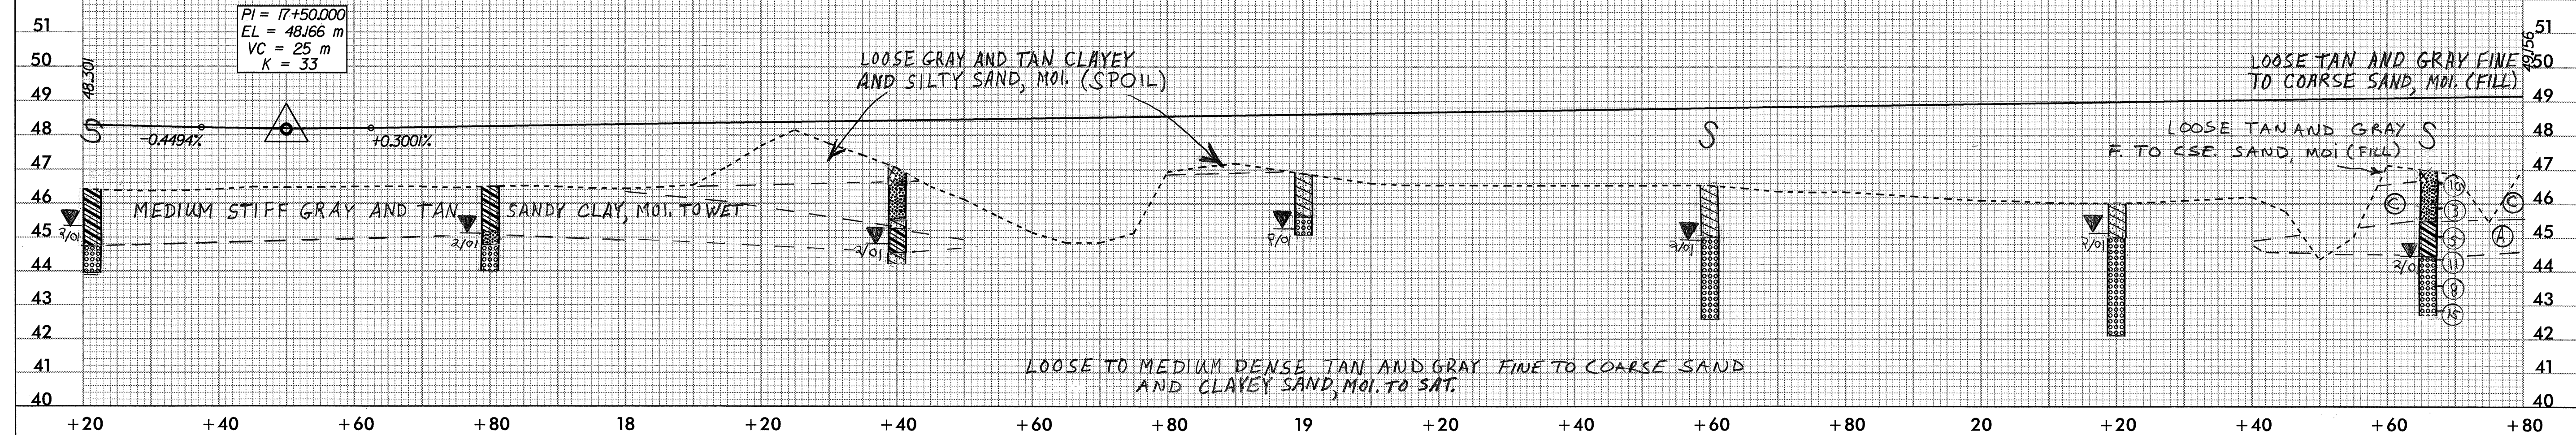

- Ⓐ MEDIUM STIFF GRAY AND TAN SANDY CLAY, MOI. TO WET
- Ⓑ SOFT GRAY CLAYEY SILT, SLIGHTLY ORGANIC, WET
- Ⓒ LOOSE TAN AND GRAY FINE TO COARSE SAND, MOI.

-SR1-

VANE			
LINE	STATION	DEPTH	READING Kpa
SR1	22+60	0.15	146
SR1	22+60	0.3	156
SR1	22+60	0.45	84
SR1	22+60	0.61	88
SR1	22+60	0.76	86
SR1	22+60	0.91	260+
SR1	22+60	1.07	260+

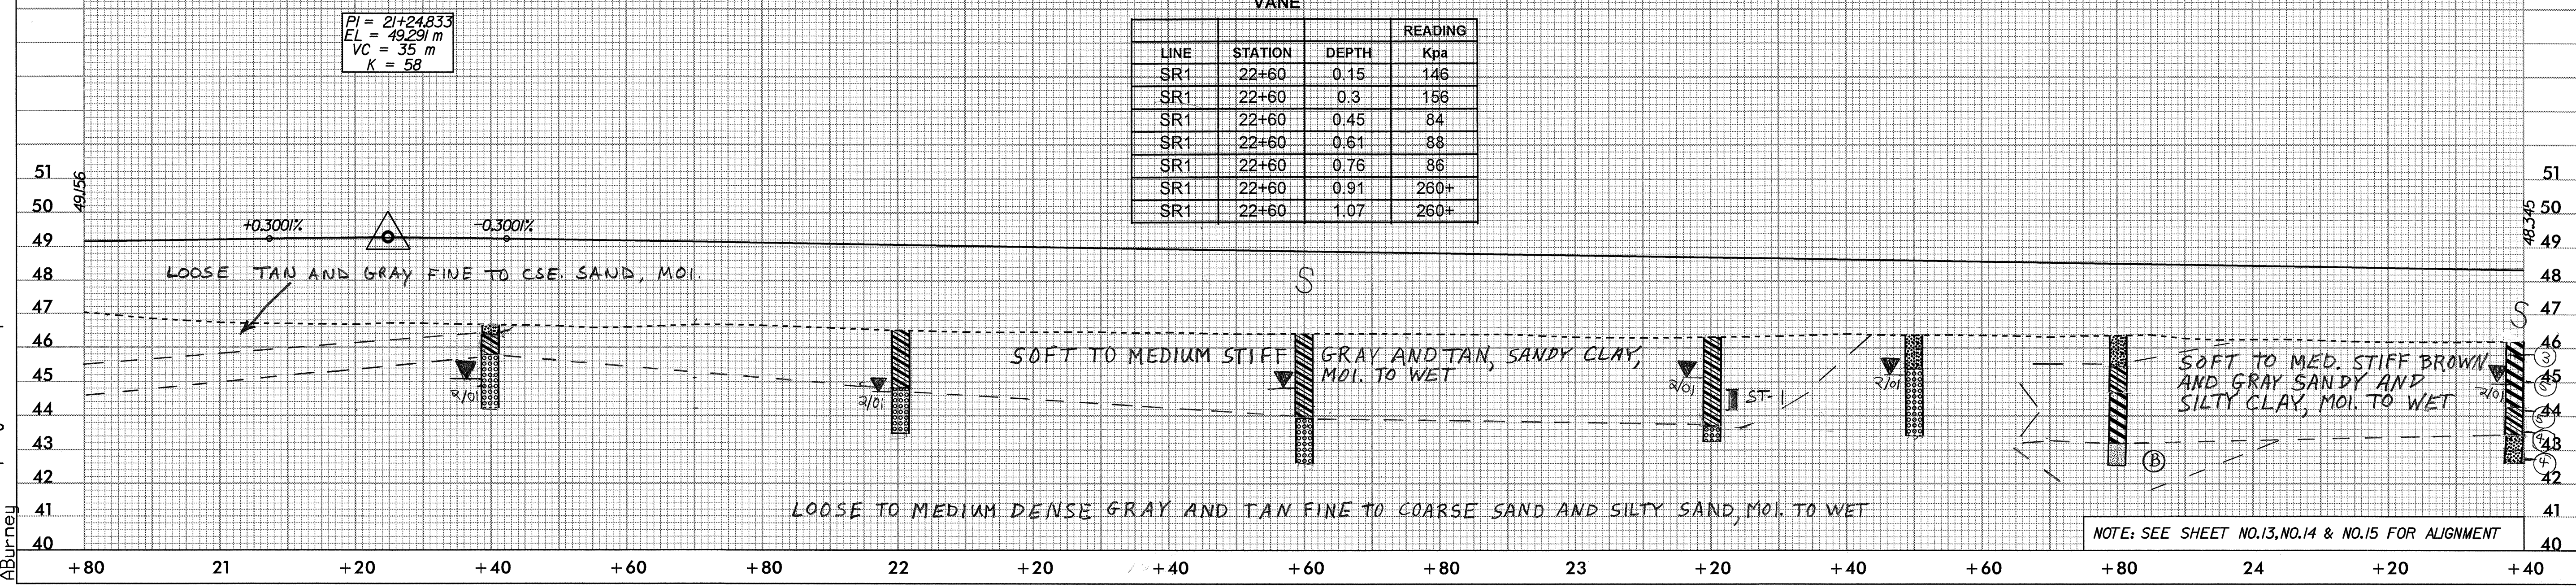

NOTE: SEE SHEET NO.13, NO.14 & NO.15 FOR ALIGNMENT

28-DEC-2000 14:55  
R:\R05138A\proj\r05138a.pf1  
Aburney