


NOTE: SEE SHEET NO.11 & NO.26 FOR ALIGNMENT

SOIL SAMPLE TEST RESULTS

SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC	
					LL	PL	C.SAND	SAND	SILT	CLAY	20 mm			425 um
S-59	15+80	CL	0.80-1.83	A-7-6(24)	52	28	12.1	9.1	18.0	60.7	100	92	81	26.8

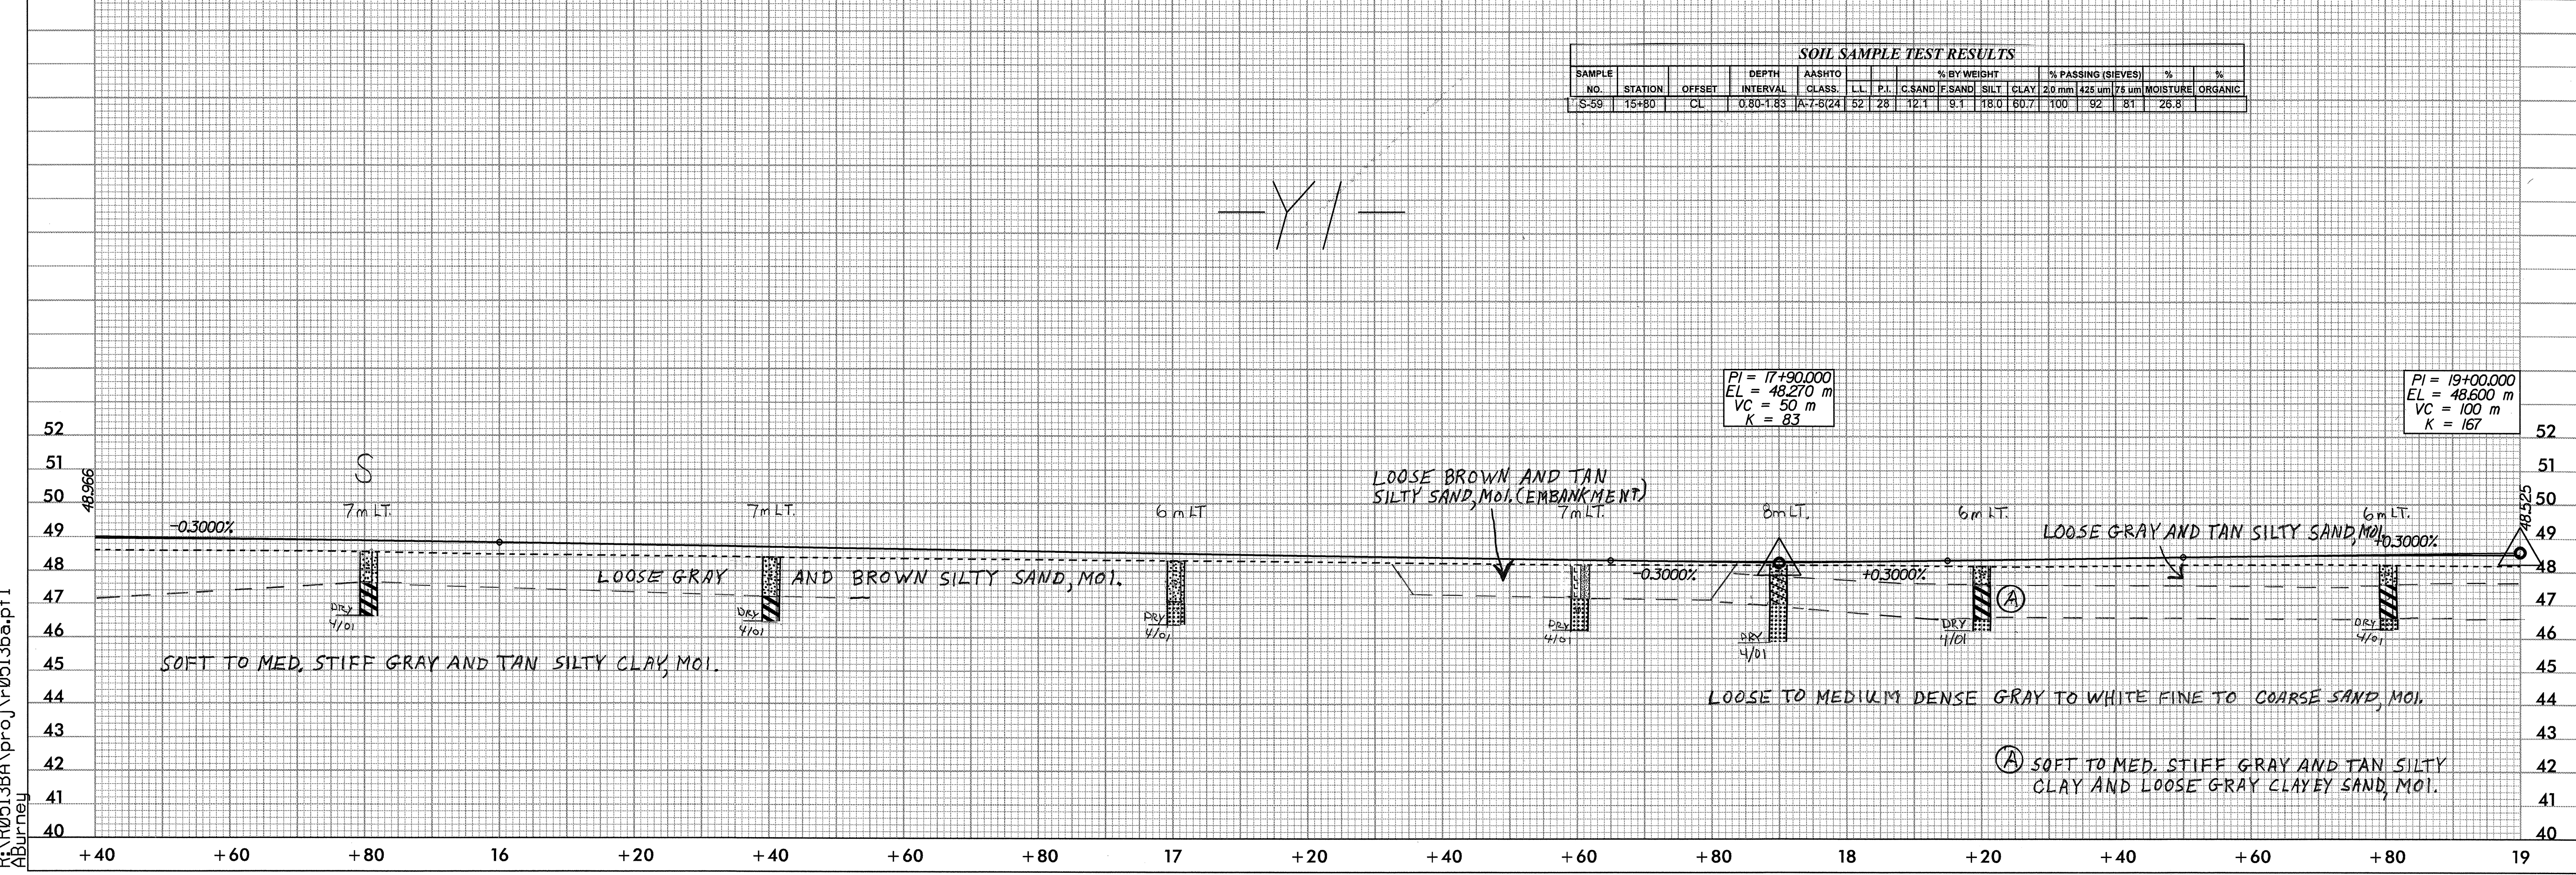

(A) SOFT TO MED. STIFF GRAY AND TAN SILTY CLAY AND LOOSE GRAY CLAYEY SAND, MOI.

28-DEC-2000 14:55
 R:\R0513BA\proj\0513ba.pf1
 Aburney