


### SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-1	135' LT	44+50	4.70-5.70	A-5(9)	48	10	4.7	33.6	39.5	22.3	100	99	73	-	-
SS-2	135' LT	44+50	9.70-10.70	A-4(0)	34	NP	21.5	31.6	36.8	10.1	100	88	55	-	-

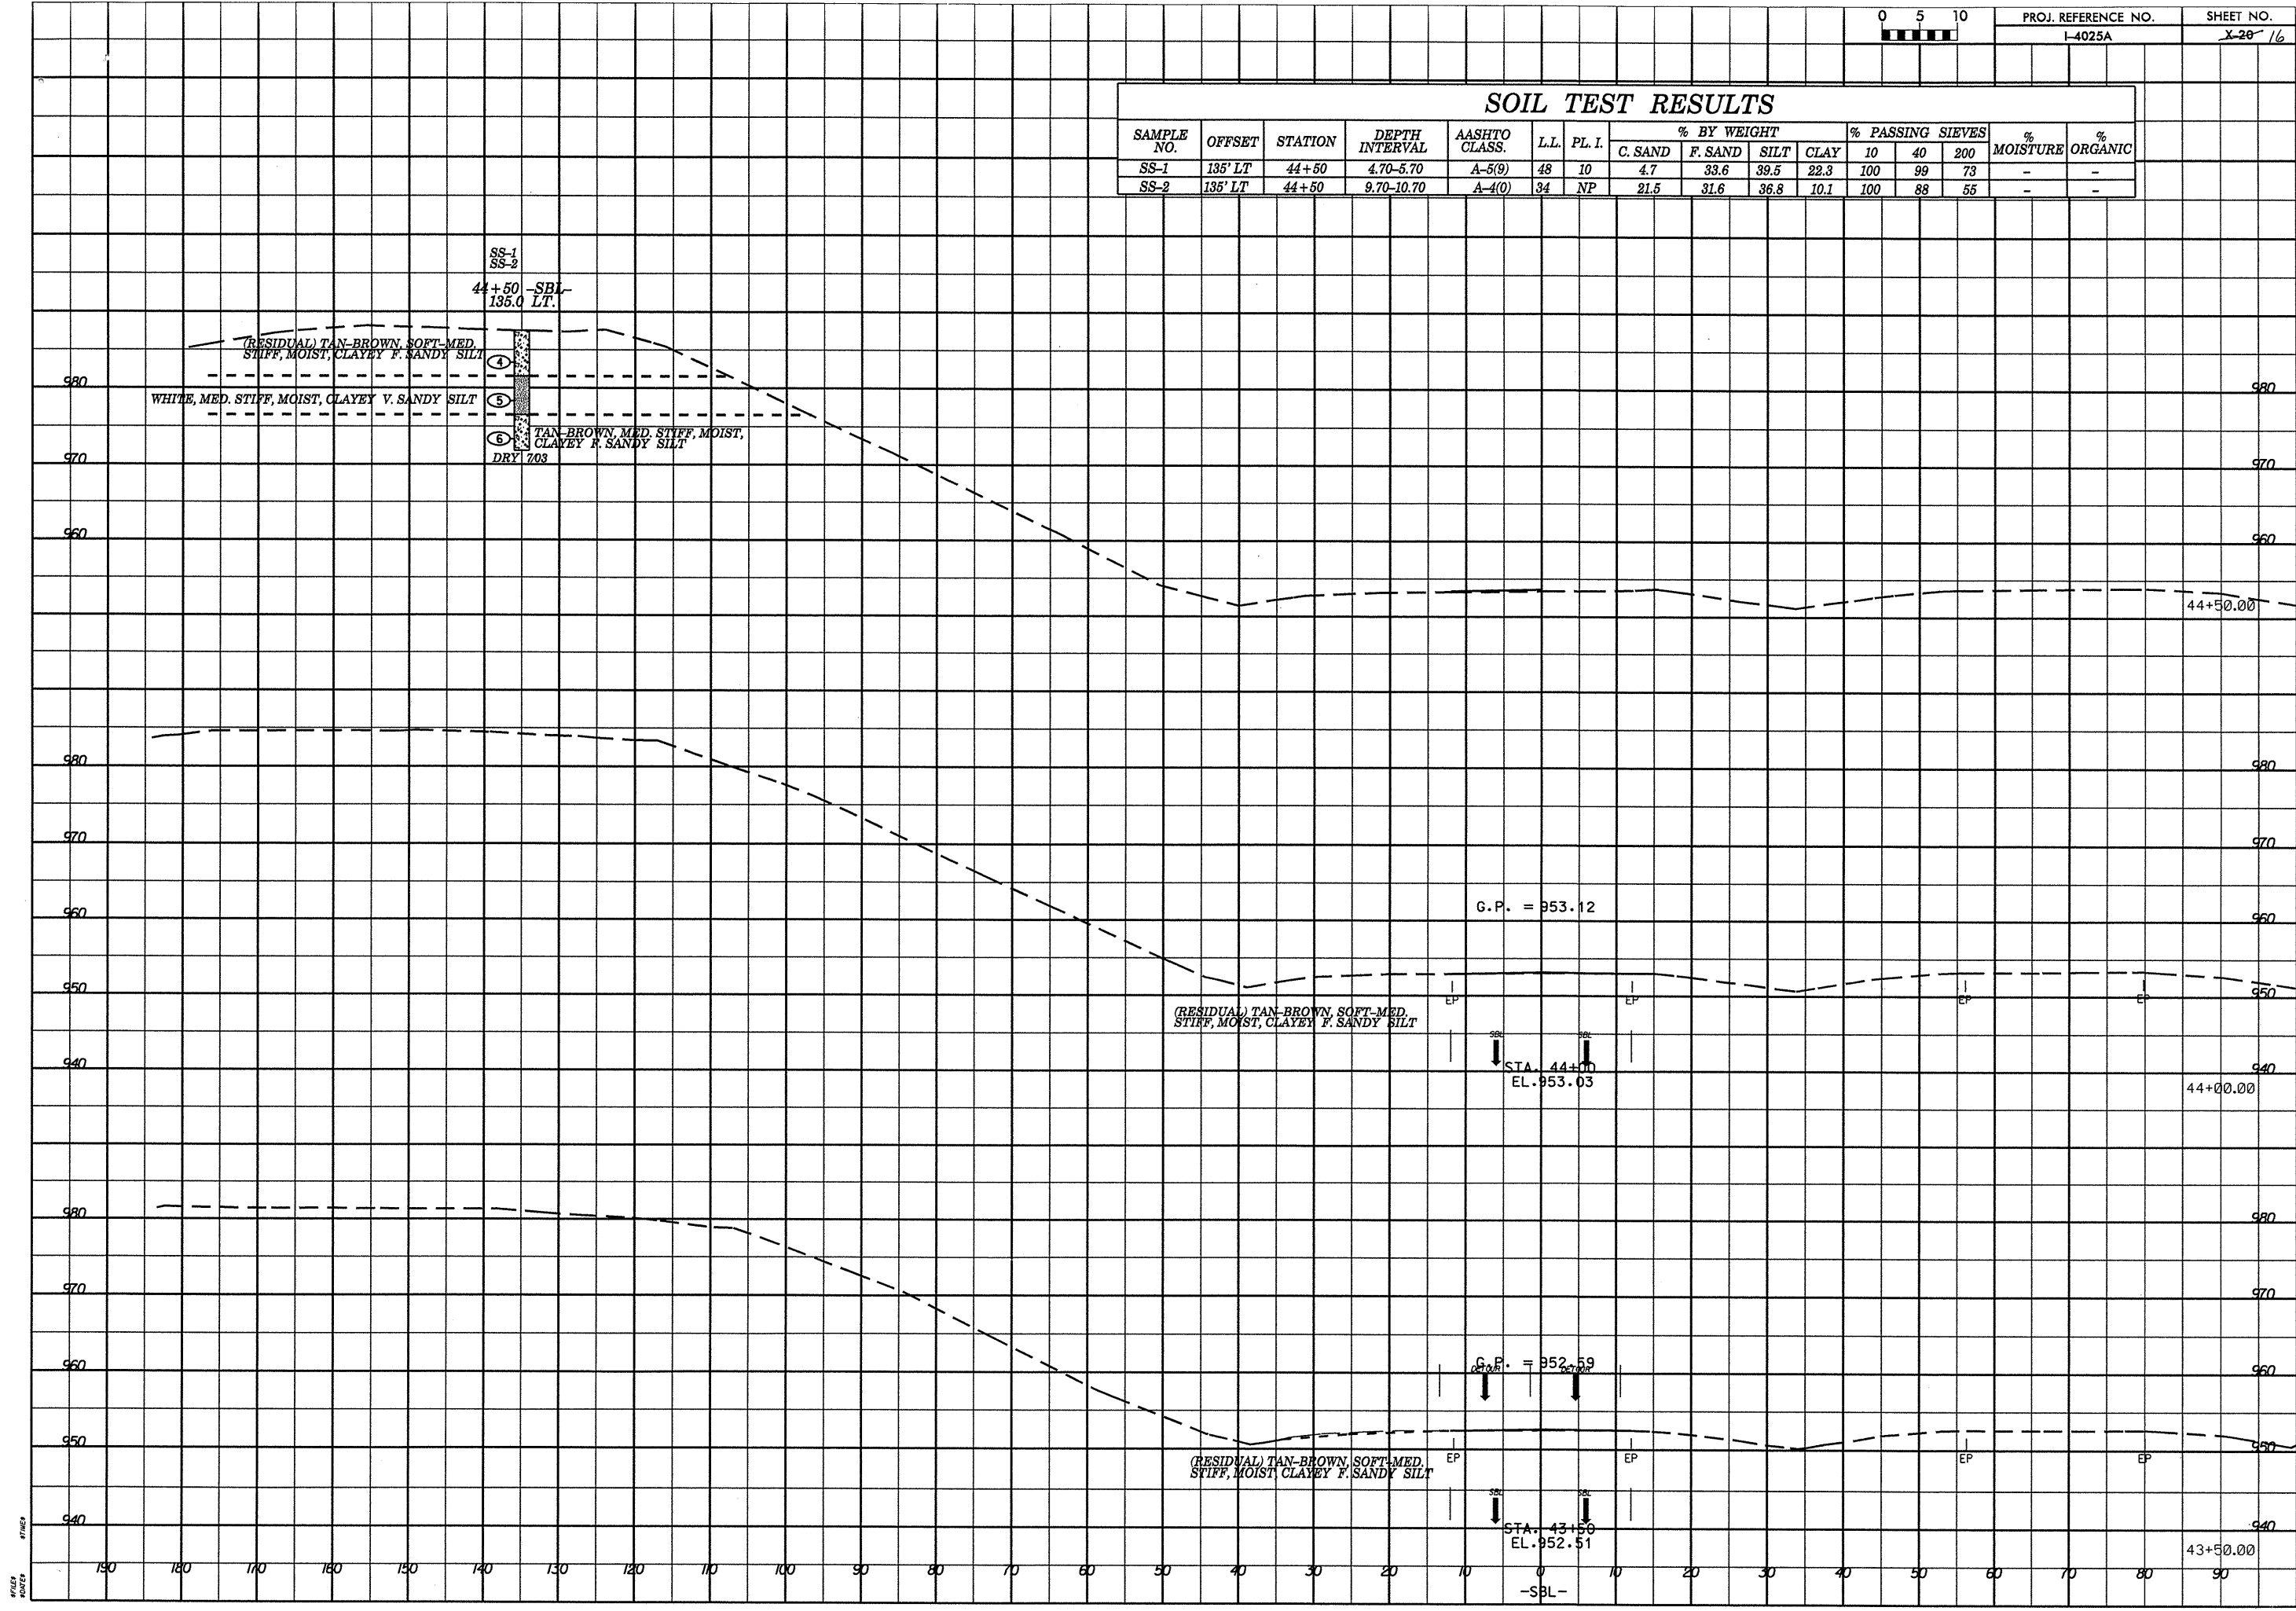

(RESIDUAL) TAN-BROWN SOFT-MED STIFF, MOIST, CLAYEY F. SANDY SILT

WHITE, MED. STIFF, MOIST, CLAYEY V. SANDY SILT

TAN-BROWN MED. STIFF, MOIST, CLAYEY F. SANDY SILT DRY 703

G.P. = 953.12

(RESIDUAL) TAN-BROWN SOFT-MED STIFF, MOIST, CLAYEY F. SANDY SILT

STA. 44+00  
EL. 953.03

(RESIDUAL) TAN-BROWN SOFT-MED STIFF, MOIST, CLAYEY F. SANDY SILT

G.P. = 952.59

STA. 43+50  
EL. 952.51

-SBL-