

METRIC

PROJECT REFERENCE NO. **R-3303** SHEET NO. **9**

R/W SHEET NO.

ROADWAY DESIGN ENGINEER HYDRAULICS ENGINEER



PRELIMINARY PLANS
DO NOT USE FOR CONSTRUCTION

INCOMPLETE PLANS
DO NOT USE FOR R/W ACQUISITION

CONST.REV.

R/W REV.

WANG ENGINEERING
15200 WESTON PARKWAY
SUITE 101
CARY, NC 27513

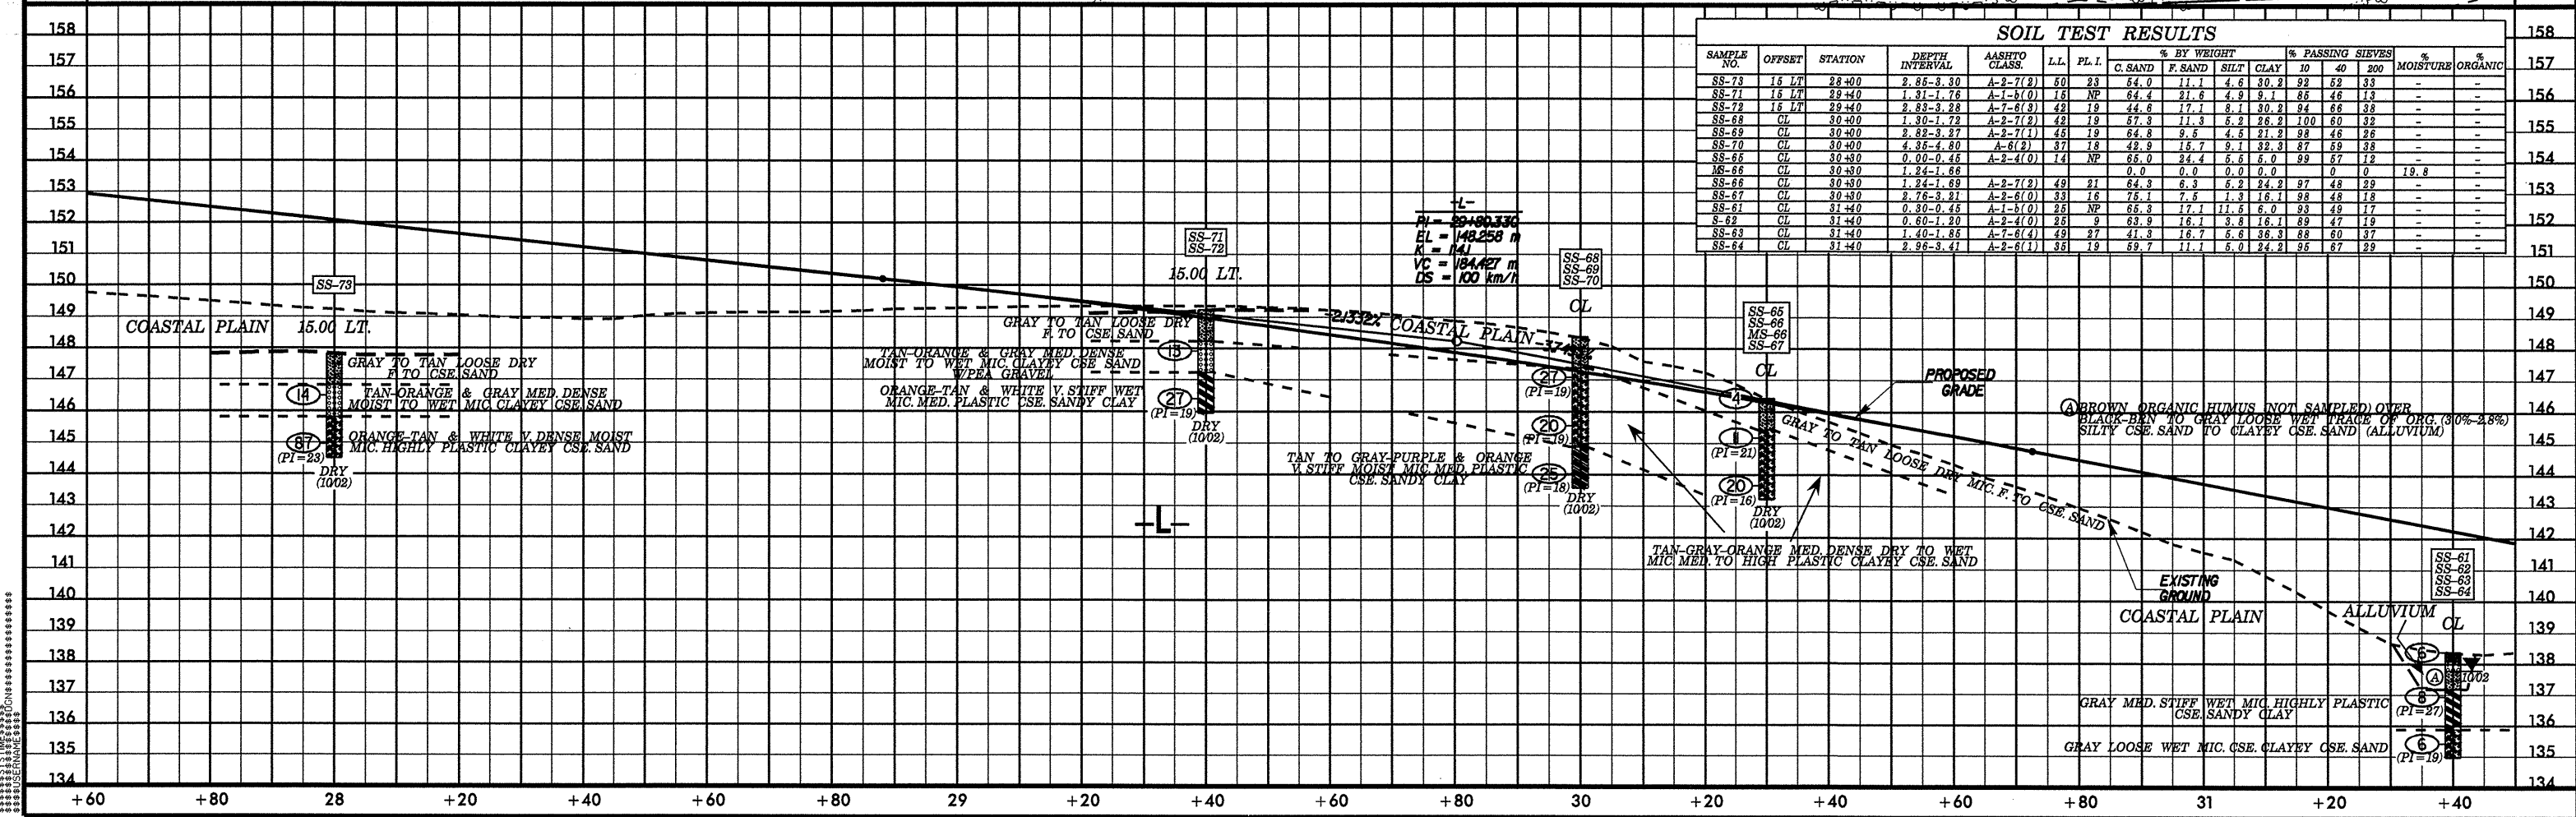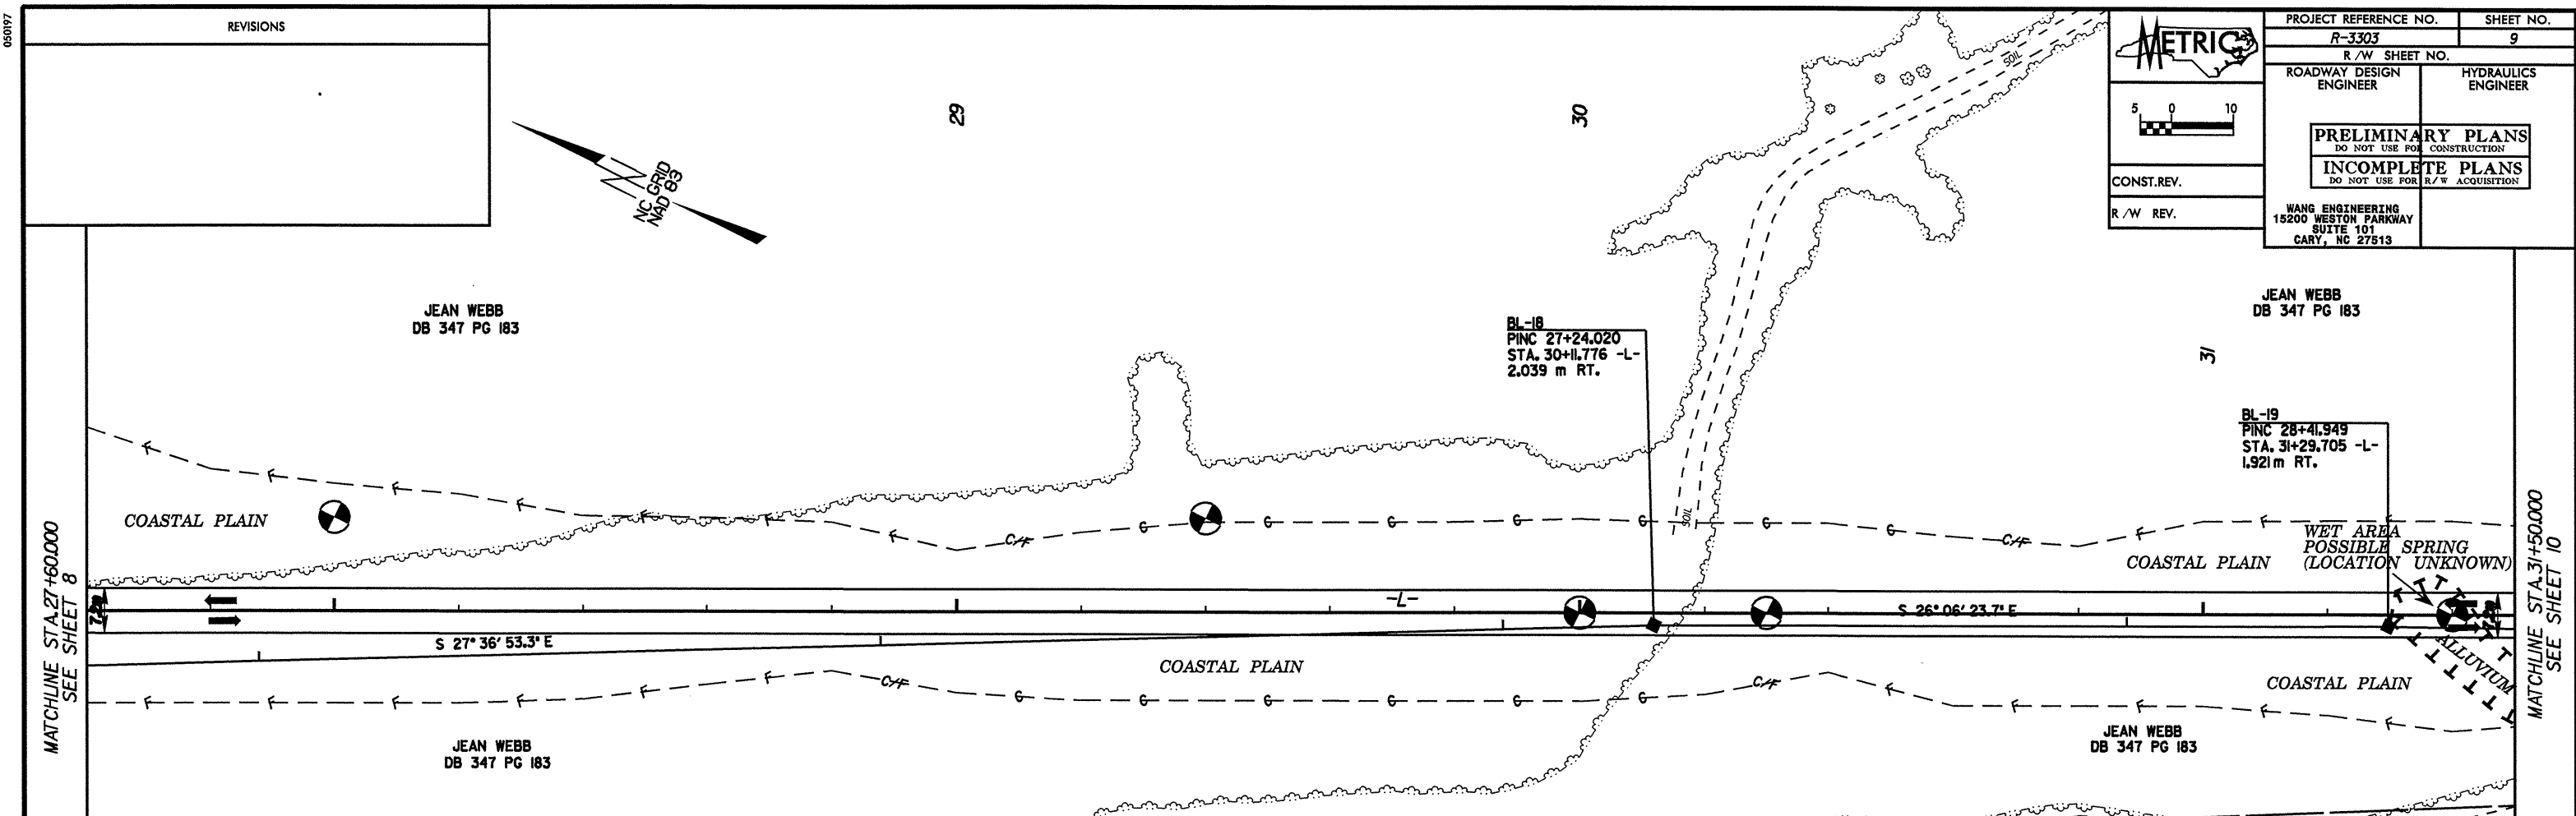

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L.I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							G. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-73	16 LT	28+00	2.85-3.30	A-2-7(2)	50	23	64.0	11.1	4.6	30.2	92	52	33	-	-
SS-71	16 LT	29+40	1.31-1.76	A-1-b(0)	15	NP	64.4	21.6	4.9	9.1	85	46	13	-	-
SS-72	16 LT	29+40	2.83-3.28	A-7-6(3)	42	19	44.8	17.1	8.1	30.2	94	66	38	-	-
SS-68	CL	30+00	1.30-1.72	A-2-7(2)	42	19	57.3	11.3	5.2	26.2	100	60	32	-	-
SS-69	CL	30+00	2.82-3.27	A-2-7(1)	45	19	64.8	9.5	4.5	21.2	98	46	26	-	-
SS-70	CL	30+00	4.35-4.80	A-6(2)	37	18	42.9	15.7	9.1	32.3	87	59	38	-	-
SS-65	CL	30+30	0.00-0.45	A-2-4(0)	14	NP	65.0	24.4	6.6	6.0	99	67	12	-	-
SS-66	CL	30+30	1.24-1.68	A-2-7(2)	49	21	64.3	6.3	5.2	24.2	97	48	29	19.8	-
SS-66	CL	30+30	1.24-1.69	A-2-7(2)	49	21	75.1	7.5	1.3	16.1	98	49	18	-	-
SS-67	CL	30+30	2.76-3.21	A-2-6(0)	33	16	65.3	17.1	11.5	6.0	93	49	17	-	-
SS-61	CL	31+40	0.30-0.45	A-1-b(0)	25	NP	65.3	17.1	11.5	6.0	93	49	17	-	-
S-62	CL	31+40	0.60-1.20	A-2-4(0)	25	9	62.9	16.1	3.8	16.1	89	47	19	-	-
SS-63	CL	31+40	1.40-1.85	A-7-6(4)	49	27	41.3	16.7	5.6	36.3	88	60	37	-	-
SS-64	CL	31+40	2.96-3.41	A-2-6(1)	35	19	59.7	11.1	5.0	24.2	95	67	29	-	-

050197