


SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L.I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-16	40 RT	47+00	4.00-5.00	A-7-5(61)	94	56	3.9	6.1	21.0	69.0	100	98	91	-	-
SS-17	40 RT	47+00	9.00-10.00	A-7-5(80)	112	62	0.2	2.0	20.6	77.2	100	100	99	-	-
S-18	52 RT	49+55	0.00-5.50	A-7-6(36)	67	45	4.3	24.8	30.4	40.6	100	98	78	-	-
S-19	52 RT	49+55	5.50-8.50	A-7-6(111)	43	21	19.3	24.0	30.4	26.4	100	85	63	-	-
SS-20	65 RT	53+00	4.40-5.40	A-7-6(27)	54	26	2.0	10.4	42.9	44.7	100	99	91	-	-
SS-21	65 RT	53+00	14.40-15.40	A-7-6(9)	44	15	18.1	27.0	40.7	14.2	100	88	64	-	-
SS-22	65 RT	53+00	19.40-20.40	A-7-6(22)	50	23	2.2	19.3	56.1	22.3	100	99	86	-	-
S-23	35 RT	56+62	4.00-24.00	A-2-4(0)	19	NP	36.1	37.3	19.5	7.1	83	60	29	-	-

PROFILE FOR -L1- LEFT
 STA. 46+00.00 TO STA. 59+00.00
 FOR PLAN SEE SHEET 7, 8

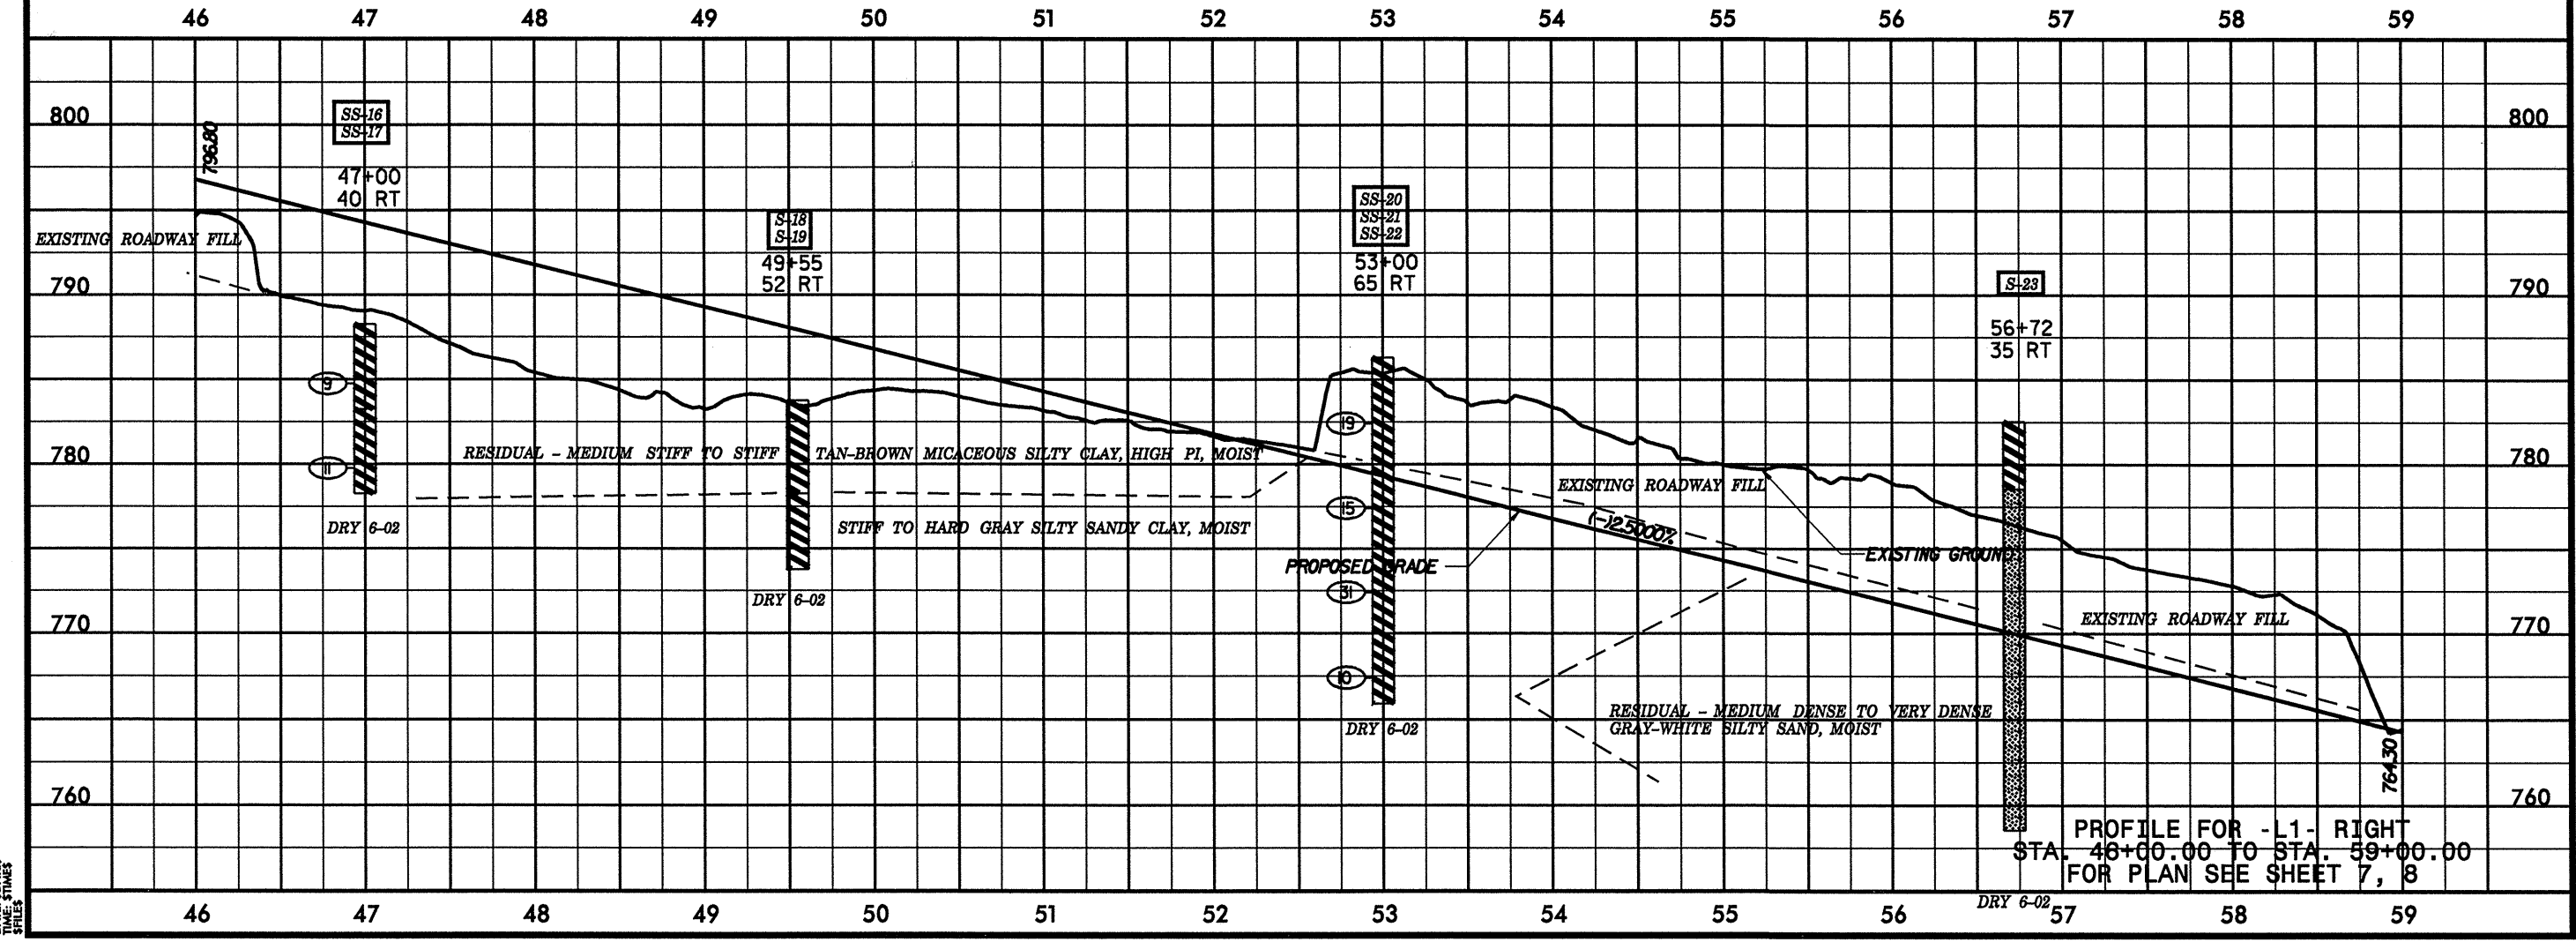

PROFILE FOR -L1- RIGHT
 STA. 46+00.00 TO STA. 59+00.00
 FOR PLAN SEE SHEET 7, 8

5/28/99 DATE PLOTTED DATE PRINTED