


SEE SHEET 6 FOR -L- PLAN VIEW

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L.	% BY WEIGHT			% PASSING SIEVES			% MOISTURE	% ORGANIC	
							C. SAND	F. SAND	SILT CLAY	10	40	200			
SS-17	33 RT	254+62	4.90-5.90	A-6(4)	31	14	16.1	39.6	21.8	22.4	98	90	51	-	-
SS-18	20 LT	257+12	3.70-4.70	A-2-4(0)	25	NP	14.7	61.6	19.6	4.1	100	96	35	-	-
SS-19	87 LT	260+44	5.30-6.30	A-4(0)	31	6	31.4	36.7	21.6	10.2	93	74	37	-	-
SS-20	87 LT	260+44	10.30-11.30	A-4(0)	33	7	34.9	34.5	24.5	6.1	100	79	38	-	-
HA-1	45 RT	260+44	0.00-6.20	A-5(3)	93	NP	14.1	15.8	37.8	32.3	100	90	75	-	-
HA-2	45 RT	260+44	6.20-6.5	A-2-4(0)	25	NP	39.2	38.6	14.1	8.1	94	74	27	-	-
ST-1	45 RT	260+44	1.0-3.0	A-7-5(20)	64	17	11.3	8.9	57.6	22.2	99	91	82	255.8	19.9

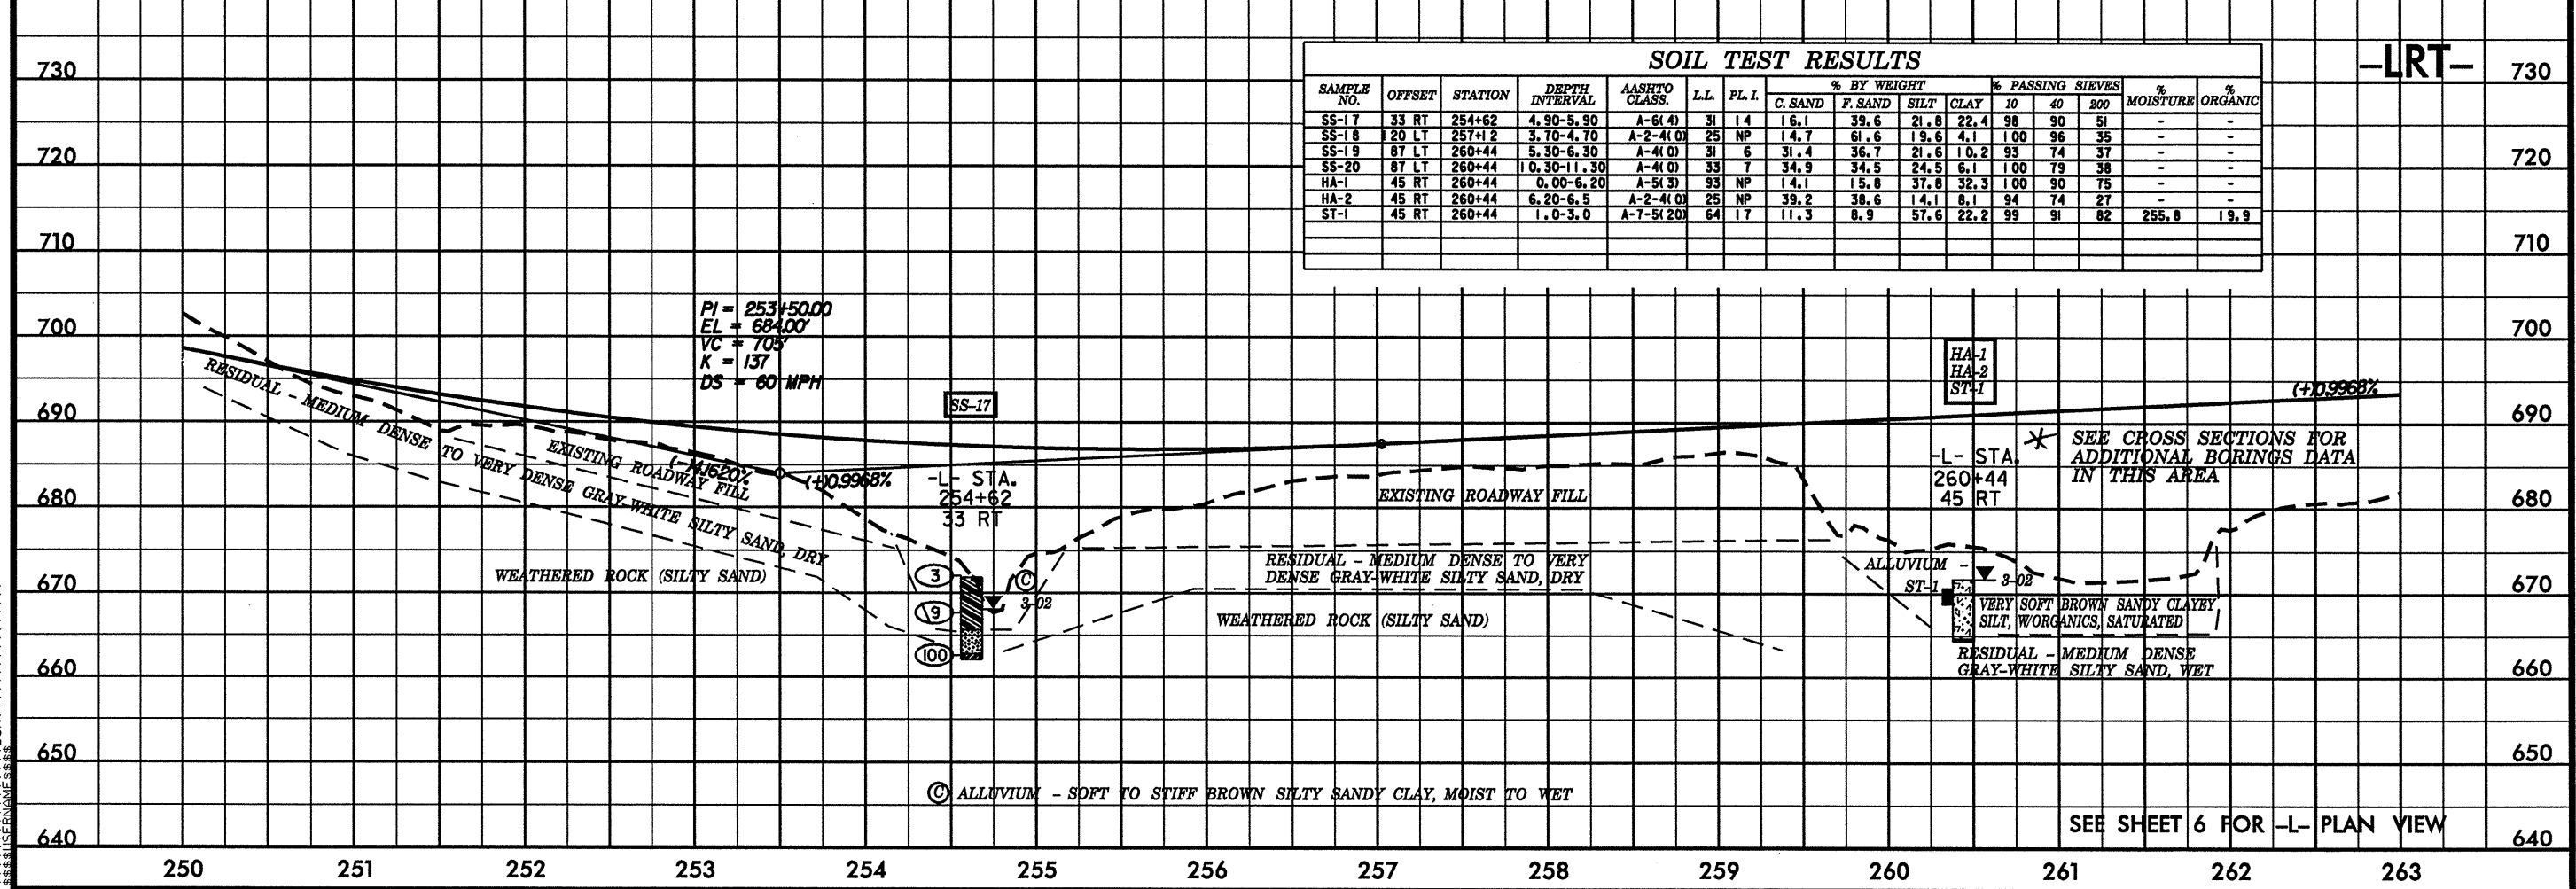

SEE SHEET 6 FOR -L- PLAN VIEW

5/28/99
 SYSTEMS
 CONSULTANTS
 ENGINEERS
 P.C.