

**PROJECT SPECIAL PROVISIONS**

Roadway

7-1-95

SP1R01

**FIELD OFFICE:****1-1-02**

The work covered by this provision consists of furnishing and maintaining a field office for the exclusive use of the Engineer at the construction site during construction of this project.

Provide a field office meeting the following minimum requirements:

**FRAME:**

Provide a frame consisting of twin 10" Junior-beam longitudinal members with C channel crossmembers and outriggers 48" (1220 mm) on center, tandem axles with electric brakes, four 7 x 14.5 eight ply tires and an A-frame hitch designed to receive a 2 5/16" (58.7 mm) ball.

**FLOOR:**

Provide a floor consisting of a .040 simplex bottom board with 2" x 6" (50 mm x 150 mm) joints spaced 16" (400 mm) on center and a 5/8" (16 mm) plywood subfloor. Use a service gauge vinyl asbestos tile covering as a finished floor covering throughout the office.

**WALLS:**

Provide exterior walls consisting of 0.019 gauge white prefinished aluminum siding with 2" x 4" (50 mm x 100 mm) studs 16" (400 mm) on center with 1" x 3" (25 mm x 75 mm) horizontal belt rails 24" (600 mm) on center. Provide interior walls that are 5/32" (4 mm) prefinished plywood paneling throughout.

**ROOF:**

Provide a roof that is 0.030 gauge galvanized metal one-piece covering with a 3/8" (9.5 mm) plywood subroof. Support the roof by truss type rafters placed 16" (400 mm) on center. Provide a finished ceiling of a 3/8" (9.5 mm) white, gypsum predeck with a minimum 8 foot (2.4 m) ceiling height.

**INSULATION:**

Provide a R-11 (3 1/2") fiberglass batt on the walls and ceilings. Provide a R-7 (2 1/2") fiberglass batt on the floor.

**PLUMBING:**

Provide supply lines that are polybutylene and drain lines that are ABS plastic.

**ELECTRICAL:**

Use non-metallic sheathed copper wiring (Romex) in accordance with the National Electric Code through the office. Equip the office with a 220/110 volt, single phase 60 Hertz system with a 100 AMP main service center equipped with a main breaker. Furnish duplex electrical receptacles spaced approximately 10 feet (3 m) on center through the office.

**LIGHTING:**

Provide 8 - 48" (1200 mm) twin tube undiffused fluorescent fixtures for the office.

**HVAC:**

Provide a 30,000 BTU end mount central air conditioner for the office with 10 KW's at electric strip heat. The system is to be ceiling ducted with adjustable diffusers and be thermostatically controlled.

**DOORS:**

Provide two 36" x 80" (900 mm x 2000 mm) aluminum-clad personnel entry doors with each having a lockset, safety chain and vision exterior doors. Provide interior doors that are 36" x 80" (900 mm x 2000 mm) hollow core wood doors and that are located as indicated in the accompanying sketch.

**WINDOWS:**

Equipped the office with seven 46" x 27" (1150 mm x 675 mm) aluminum framed operable 1 fixed window(s) equipped with screens.

**EQUIPMENT:**

Equip the office with the following as shown in the accompanying sketch.


- 34 Linear feet (10.4 m) of interior partitioning
- 36 Linear feet (10.4 m) of 30" (750 mm) flat table top on wood legs
- 36 Linear feet (10.4 m) of 12" (300 mm) shelving above table top
- 1 Handicapped restroom consisting of flush type toilet, lavatory with mixing faucets, a six-gallon (22.7 liter) electric hot water heater, light, mirror
- 2 Sets of steps with handrails
- 1 4-Drawer metal file cabinet with lock
- 6 Desk chairs with rollers
- 8 Metal folding chairs
- 1 Meeting table, approximately 36" x 48" (900 mm x 1200 mm)

The Contractor is responsible for providing the site for the field office, the sewer hook-up septic tank, drain field, water hook-up and electrical hook-up in accordance with the National Electrical Code. The Contractor is also responsible for obtaining any permits necessary in setting up the office. Bury the waterline a minimum of 12 inches (300 mm) below the surface of the ground. In addition, grade the area around the office to drain and spread 40 tons (36.3 metric tons) of aggregate base course, in accordance with Section 520 of the Standard Specifications, over a 30' x 60' (9.1 m x 18.3 m) area as directed by the Engineer.

Payment at the contract lump sum price for "Field Office" will be full compensation for all work covered by this provision including but not limited to furnishing, setting up and maintaining (excluding utilities and janitorial services) the field office; removing the field office when it is not longer needed, furnishing and placing aggregate base course and any other incidentals necessary to complete this work.

Payment will be made under:

Field Office ..... Lump Sum

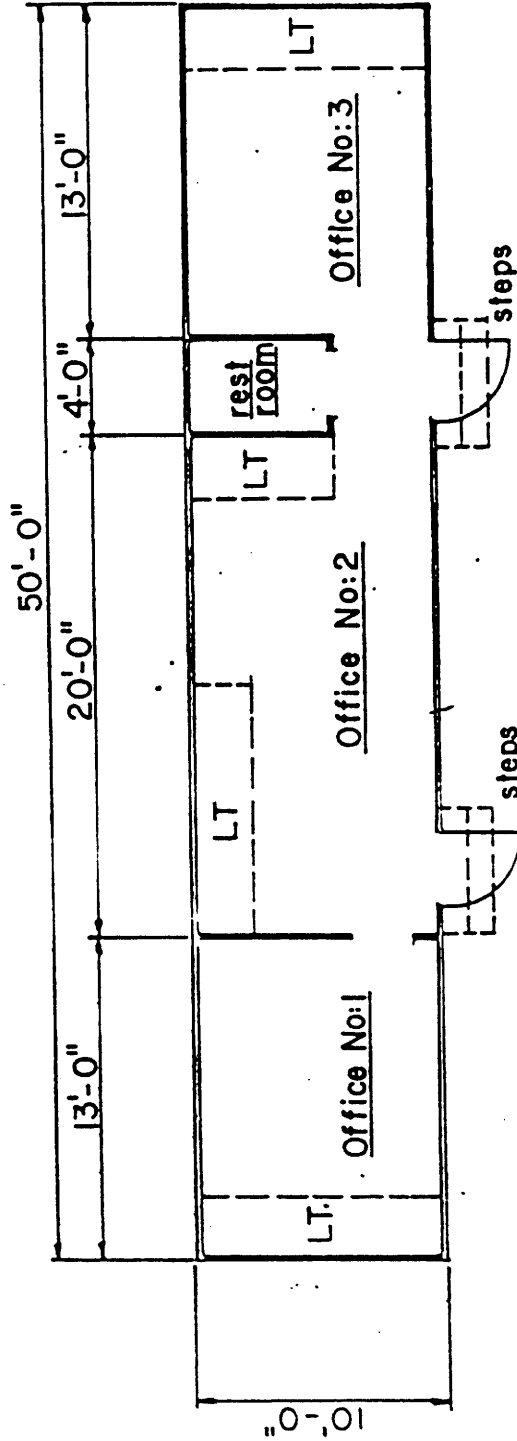

FLOOR PLAN

**PROPOSED OFFICE TRAILER**

**LEGEND:**

LT = LOW TABLES (BUILT-IN 30" WIDE & 30" HIGH) SHELVES TYPICAL OVER BUILT-IN TABLES (NO FILE DRAWERS UNDERNEATH NECESSARY).

NOTE: ALL DIMENSIONS AND HALLWAYS SHALL MEET HANDICAP CRITERIA AND REGULATIONS (DIMENSIONS SHOWN ARE MINIMAL REQUIREMENTS).

**CLEARING AND GRUBBING:**

9-17-02

Perform clearing on this project to the limits established by Method "III" shown on Standard No. 200.03 of the Roadway Standards.

The 2002 Standard Specifications shall be revised as follows:

Page 2-3, Article 200-5

Delete the first sentence of this article and insert the following:

The property owner will have no right to use or reserve for his use any timber on the project. All timber cut during the clearing operations is to become the property of the Contractor, and shall be either removed from the project by him, or else shall be satisfactorily disposed of as hereinafter provided.

SP2R01

**BUILDING REMOVAL:**

01-01-02

Remove the buildings and appurtenances listed below in accordance with Section 215 of the Standard Specifications and the following provisions:

Prior to removal of any building, comply with the notification requirements of Title 40 Code of Federal Regulations, Part 61, Subpart M, which are applicable to asbestos. Give notification to the North Carolina Department of Health and Human Services, Division of Epidemiology, Asbestos Hazard Management Branch and/or the appropriate county agency when enforcement of the Federal Regulation is performed by the county. Submit a copy of the notification to the Engineer prior to the building removal.

The Department has performed asbestos assessments for building items identified below. Copies of this report may be obtained through the Division Right-of-Way Agent. When asbestos is discovered after the opening of bids for the project, the cost of asbestos removal and disposal will be paid for in accordance with Article 104-7 of the Standard Specifications. Perform removal and disposal of asbestos in accordance with the requirements of Title 40 Code of Federal Regulations.

When a building has had or will have asbestos removed and the Contractor elects to remove the building such that it becomes a public area, the Contractor is responsible for any additional costs incurred including final air monitoring.

Comply with all Federal, State and local regulations when performing building removal and/or asbestos removal and disposal. Any fines resulting from violations of any regulation are the sole responsibility of the Contractor and the Contractor agrees to indemnify and hold harmless the Department against any assessment of such fines.

Prior to removal of any Underground Storage Tank (UST), comply with the notification requirements of the Title 40 Code of Federal Regulations, Part 280.71(a). Give notification to the appropriate regional office of the North Carolina Department of Environment, and Natural Resources, Division of Environmental Management, Groundwater Section. Submit a copy of the notification to the Engineer prior to the removal of the underground storage tank.

Permanently close UST systems by removal and dispose of in compliance with the regulations set forth in Title 40, Code of Federal Regulations, Part 280.71 and North Carolina Administrative Code Title 15A, Chapter 2, Subchapter 2N and any applicable local regulations. Assess Underground Storage Tank sites at closure for the presence of contamination as required in NCAC Title 15A, Chapter 2, Subchapter 2N, Section .0803 and as directed by the appropriate Regional Office of the Division of Environmental Management. Remove and dispose of UST systems and contents in a safe manner in conformance with requirements of American Petroleum Institute Bulletin 1604, "Removal and Disposal of Used Underground Petroleum Storage Tanks", Chapters 3 through 6. (Note: As an exception to these requirements, the filling of the tank with water as a means of expelling vapors from the tank as described in section 4.2.6.1 of API Bulletin 1604, will not be allowed. Where underground storage tanks are indicated below, there will be no direct payment for the closure or assessment. When the contract does not indicate the presence of storage tanks and storage tanks are discovered after the opening of bids for the project, the cost of closure, assessment and/or removal will be paid for in accordance with Article 104-7 of the Standard Specifications.

Disposition of any contaminated material associated with underground storage tanks will be made as provided in Article 107-26 of the Standard Specifications.

For Project R-2610B, the Contractor shall remove the buildings and appurtenances which are listed below in accordance with Section 215 of the Standard Specifications and the following provisions.

When the description of the work for an item indicates the building partially inside and partially outside the right of way and/or construction areas, but does not require the building to be cut off, the entire building shall be removed.

**Building Removal (Item #1)**

Parcel 06, Right of Survey Station 24+53.00, Survey Line L  
1 Brick Sign w/ Electrical

**Building Removal (Item #2)**

Parcel 27, Left of Survey Station 53+65.50. Survey Line L  
1 Double Pole Wood Sign

**Building Removal (Item #3)**

Parcel 27, Left of Survey Station 53+62.00, Survey Line L  
1 Double Pole Wood Sign

For Project R-2610A, the Contractor shall remove the buildings and appurtenances which are listed below in accordance with Section 215 of the Standard Specifications and the following provisions.

When the description of the work for an item indicates the building partially inside and partially outside the right of way and/or construction areas, but does not require the building to be cut off, the entire building shall be removed.

**Building Removal (Item #1)**

Parcel 10, Right of Survey Station 21+32.5, Survey Line L

1 Single Pole Sign

**Building Removal (Item #2)**

Parcel 13, Left of Survey Station 21+60, Survey Line L

1 Wood Sign

**Building Removal (Item #3)**

Parcel 21, Right of Survey Station 31+00, Survey Line L

1 Double Pole Wood Sign

**Building Removal (Item #4)**

Parcel 23, Left of Survey Station 34+90, Survey Line L

1 Double Pole Wood Sign

**Building Removal (Item #5)**

Parcel 23, Left of Survey Station 35+32, Survey Line L

1 Sign

**Building Removal (Item #6)**

Parcel 23, Left of Survey Station 36+15, Survey Line L

1 Sign

**Building Removal (Item #7)**

Parcel 23, Left of Survey Station 34+85, Survey Line L

Portable Metal Awning

**Building Removal (Item #8)**

Parcel 23A, Left of Survey Station 34+85, Survey Line L

1 ODA Sign

**Building Removal (Item #9)**

Parcel 32A, Left of Survey Station 54+00, Survey Line L

1 Portable Sign

Building Removal (Item #10)

Parcel 21, Right of Survey Station 10+16 to 10+55, Survey Line Y-9 &

Right of Survey Station 11+07 to 11+84, Survey Line Y-9

Chain Link Fence

SP2R15

**EXCAVATION OF ROCK BY USE OF EXPLOSIVES:**

**1-01-02**

The Contractor's attention is directed to Article 107-11 of the Standard Specifications.

In addition to the requirements of this Article, submit to the Engineer a written report after each blast that gives complete details of the blast procedure. Submit the blast report on forms provided by the Engineer within 24 hours after each blast.

The Engineer will, as necessary, monitor blasting operations with an engineering seismograph. In order to facilitate such work, provide to the Engineer seven days advance notice before the initial blasting is performed and 24 hours notice of subsequent blasting operations.

Cooperate with the Engineer in establishing a signal system that will allow vibrations to be effectively monitored.

The monitoring blast vibrations by the Engineer or the submission of blast reports by the Contractor in no way relieves the Contractor of his responsibilities as defined in Article 107-11.

SP2R20

**TEMPORARY DETOURS:**

**7-1-95**

Construct temporary detours required on this project in accordance with the typical sections in the plans or as directed.

Payment for the construction of the detours will be made at the contract unit prices for the various items involved. After the detours have served their purpose, remove the portions deemed unsuitable for use as a permanent part of the project as directed by the Engineer. Salvage within the right of way, as directed by the Engineer, for removal by State Forces. Pipe culverts and stockpile the aggregate base course removed from the detours at locations removed from the detours remain the property of the Contractor. Remove pipe culverts from the project when they are no longer needed. Place pavement and earth material removed from the detour in embankments or dispose of in waste areas furnished by the Contractor. Aggregate base course and earth material that is removed will be measured and will be paid for at the contract unit price per cubic yard (cubic meter) for "Unclassified Excavation". Pavement that is removed will be measured and will be paid for at the contract unit price per square yard (square meter) for "Removal of Existing Pavement". Pipe culverts that are removed will be measured and will be paid for at the contract unit price per linear foot (meter) for "Pipe Removal". Such prices and payments will be full compensation for the work of removing, salvaging, and stockpiling aggregate base course; placing and removing pipe culverts; and for placing earth material and pavement in embankments or disposing of earth material and pavement in waste areas.

SP2R30



**SHALLOW UNDERCUT:**

**2-19-02**

Perform undercut excavation and place a combination of fabric for soil stabilization and Class IV Subgrade Stabilization at locations as directed by the Engineer. Work includes performing undercut excavation, disposing of unsuitable material, furnishing and placing fabric for soil stabilization; and furnishing, placing and compacting Class IV Subgrade Stabilization.

**MATERIALS**

Fabric for Soil Stabilization.....	Section 270
Class IV Subgrade Stabilization.....	Section 1016-3, Class IV; or Material meeting gradation requirements of Table 520-1, Column C

**CONSTRUCTION METHODS**

Perform undercut excavation in accordance with Section 225.  
Place fabric for soil stabilization in accordance with Section 270.  
Place Class IV Subgrade Stabilization by back dumping material on previously placed fabric.  
Compact material to 95% of AASHTO T-99, Method "D" density or compact material to the highest density that can be reasonably obtained.

**METHOD OF MEASUREMENT**

Undercut Excavation will be measured in accordance with Section 225.  
Fabric for Soil Stabilization will be measured in accordance with Article 270-4.  
Class IV Subgrade Stabilization, as accepted in place, will be measured by the ton (metric ton), in accordance with Section 106-7.

**BASIS OF PAYMENT**

Payment will be made for quantities as measured above for the pay items listed below:

Undercut Excavation.....	Cubic Yard (Cubic Meter)
Fabric for Soil Stabilization.....	Square Yard (Square Meter)
Class IV Subgrade Stabilization.....	Ton (Metric Ton)

SP2R35

**BORROW MATERIAL:**

Borrow material consisting of A-2-5 and A-5 soils with a plasticity index less than 8 shall not be used in the top 0.3 meter of embankments nor as backfill in undercut areas unless waived in writing by the Engineer.

**BORROW EXCAVATION:**

2-19-02

Revise the 2002 Standard Specifications as follows:

Page 2-20, Article 230-6

After the first paragraph, insert the following paragraph:

"No direct payment will be made for the work of Evaluation of Potential Wetlands and Endangered Species as outlined above. Payment at the contract unit price for the pay item 'Borrow Excavation' or 'Grading - Lump Sum' will be considered full compensation for this work.'

SP2R37

**FALSE SUMPS:**

7-1-95<sub>c</sub>

Construct false sumps in accordance with the details in the plans and at locations shown in the plans or at other locations as directed by the Engineer.

Payment for the work of construction of the false sumps will be made at the contract unit price per cubic yard (cubic meter) for "Unclassified Excavation or "Borrow Excavation" depending on the source of material, or included in "Grading-Lump Sum"

SP2R40

**SHOULDER AND FILL SLOPE MATERIAL:**

5-21-02

**General:**

Perform the required shoulder and slope construction for this project in accordance with the applicable requirements of Section 560 and Section 235 of the Standard Specifications except as follows:

Construct the top 6 inches (150-mm) of shoulder and fill slopes with soils capable of supporting vegetation.

Provide soil with a P.I. greater than 6 and less than 25 and with a pH ranging from 5.5 to 6.8. Remove stones and other foreign material 2 inches (50 mm) or larger in diameter. All soil is subject to test and acceptance or rejection by the Engineer.

Obtain material from within the project limits or approved borrow source.

**Compensation:**

When the Contractor elects to obtain material from an area located beneath a proposed fill sections which does not require excavation for any reason other than to generate acceptable shoulder and fill slope material, the work of performing the excavation will be considered incidental to the item of "Borrow Excavation" or "Shoulder Borrow". If there is no pay item for "Borrow" or "Shoulder Excavation" in the contract, this work will be considered incidental to

"Unclassified Excavation". Stockpile the excavated material in a manner to facilitate measurement by the Engineer. Fill the void created by the excavation of the shoulder and fill slope material with suitable material. Payment for material used from the stockpile will be made at the contract unit price for "Borrow Excavation" or "Shoulder Borrow". If there is no pay item for "Borrow Excavation" or "Shoulder Borrow", then the material will be paid for at the contract unit price for "Unclassified Excavation". The material used to fill the void created by the excavation of the shoulder and fill slope material will be made at the contract unit price for "Unclassified Excavation", "Borrow Excavation", or "Shoulder Borrow", depending on the source of the material.

Material generated from undercut excavation, unclassified excavation or clearing and grubbing operations that is placed directly on shoulders or slope areas, will not be measured separately for payment, as payment for the work requiring the excavation will be considered adequate compensation for depositing and grading the material on the shoulders or slopes.

When undercut excavation is performed at the direction of the Engineer and the material excavated is found to be suitable for use as shoulder and fill slope material, and there is no area on the project currently prepared to receive the material generated by the undercut operation, the Contractor may construct a stockpile for use as borrow at a later date. Payment for the material used from the stockpile will be made at the contract unit price for "Borrow Excavation" or "Shoulder Borrow".

When shoulder material is obtained from borrow sources or from stockpiled material, payment for the work of shoulder construction will be made at the contract unit price per cubic yard (cubic meter) for "Borrow Excavation" or "Shoulder Borrow" in accordance with the applicable provisions of Section 230 or Section 560 of the Standard Specifications.

SP2R50

**STEP / POOL:**

**06-15-04**

**Description:**

The Contractor shall construct step / pool vanes in accordance with the details in the plans, as directed by the Engineer and this provision. This work shall include excavating the channel, and constructing step / pool vanes.

Step / pool vanes shall be constructed in accordance with the details in the plans. The purpose of the step / pool vane is to reduce water velocity and to direct stream flow away from the streambank.

**Materials:**

Materials shall meet the requirements shown below:

- Drainage Ditch Excavation.....Section 240
- Boulders.....Approximately 500 Kg to 1000 Kg

Boulders should be native stone or shot rock, angular and oblong. All rock stone shall be sound, tough, dense, resistant to the action of air and water, and suitable in all other respects for the purpose intended.

Construction Requirements:

Erosion control measures shall be constructed prior to any earth movement related to highway construction in channel change areas.

Method of Measurement:

The quantity of drainage ditch excavation to be paid for will be measured in accordance with the Standard Specifications.

The quantity of boulders to be paid for will be the actual number of metric ton of rocks, which have been furnished, placed and accepted.

Basis of Payment:

The quantity of drainage ditch excavation measured as provided for above will be paid for at the contract unit price per cubic meter for "Drainage Ditch Excavation".

The quantity of boulders measured as provided for above will be paid for at the contract unit price per metric ton for "Boulders".

Such prices and payments will be considered full compensation for all excavation, hauling, handling, furnishing and placing of native boulders, footer rocks and any incidentals necessary to complete the work.

Payment will be made under:

<b>Pay Item</b>	<b>Pay Unit</b>
Drainage Ditch Excavation.....	Cubic Meter
Boulders.....	Metric Ton

**J-HOOK VANE:**

**06-15-04**

Description:

The Contractor shall construct J-hook vanes in accordance with the details in the plans, as directed by the Engineer and this provision. This work shall include excavating the channel, and constructing J-hook vanes.

J-hook vanes shall be constructed in accordance with the details in the plans. The purpose of the J-hook vane is to reduce water velocity and to direct stream flow away from the streambank.

Materials:

Materials shall meet the requirements shown below:

Drainage Ditch Excavation.....	Section 240
Boulders.....	Approximately 3' x 2' x 2'
Filter Fabric.....	Section 876
#57 Stone.....	Section 1005

Boulders should be native stone or shot rock, angular and oblong. All rock stone shall be sound, tough, dense, resistant to the action of air and water, and suitable in all other respects for the purpose intended.

Construction Requirements:

Erosion control measures shall be constructed prior to any earth movement related to highway construction in channel change areas.

Method of Measurement:

The quantity of drainage ditch excavation to be paid for will be measured in accordance with the Standard Specifications.

The quantity of boulders to be paid for will be the actual number of metric ton of boulders, which have been furnished, placed and accepted.

The quantity of filter fabric to be paid for shall be measured in accordance with Section 876 of the Standard Specifications.

#57 Stone:

The quantity of #57 stone to be paid for will be the actual number of metric tons of stone which has been incorporated into the completed and accepted work. The stone will be measured by being weighed in trucks on certified platform scales or other certified weighing devices.

Basis of Payment:

The quantity of drainage ditch excavation measured as provided for above will be paid for at the contract unit price per cubic meter for "Drainage Ditch Excavation".

The quantity of boulders measured as provided for above will be paid for at the contract unit price per metric ton for "Boulders".

Such prices and payments will be considered full compensation for all excavation, hauling, handling, furnishing and placing of native rock, and any incidentals necessary to complete the work.

#57 Stone:

The quantity of #57 stone, measured as provided for above, will be paid for at the contract unit price per metric ton for “#57 Stone”. The above prices and payment will be full compensation for furnishing, hauling, placing and all incidentals necessary to complete the work.

The quantity of filter fabric, measured as provided above will be paid for at the contract unit price per Square Meter for “Filter Fabric for Drainage”.

Payment will be made under:

<b>Pay Item</b>	<b>Pay Unit</b>
Drainage Ditch Excavation.....	Cubic Meter
Boulders.....	Metric Ton
Filter Fabric for Drainage.....	Square Meter
#57 Stone.....	Metric Ton

**CROSS VANE ROCK WEIR WITH #57 STONE:**

**05-18-04**

Description:

The Contractor shall construct cross vane weirs in accordance with the details in the plans, as directed by the Engineer and the following provision. This work shall include excavating the channel, and constructing cross vane weirs.

Cross vane weirs shall be constructed in accordance with the detail in the plans. The purpose of the weirs is to create pools for trout stream enhancement.

Materials:

Materials shall meet the requirements shown below:

Filter Fabric.....	Section 876
Drainage Ditch Excavation.....	Section 240
Boulders.....	500 Kg to 1000 Kg
#57 Stone.....	Section 1005

All stone and boulders shall be sound, tough, dense, resistant to the action of air and water, and suitable in all other respects for the purpose intended.

Construction Requirements:

Erosion control measures shall be constructed prior to any earth movement related to highway construction in channel change areas.

Method of Measurement:

Fabric:

The quantity of filter fabric to be paid for will be the area in square meters, measured along the surface of the ground, over which filter fabric has been acceptably placed.

The quantity of drainage ditch excavation to be paid for will be measured in accordance with the Standard Specifications.

The quantity of boulders to be paid for will be the actual number of metric ton boulders which have been furnished, placed and accepted.

#57 Stone:

The quantity of #57 stone to be paid for will be the actual number of metric tons of stone which has been incorporated into the completed and accepted work. The stone will be measured by being weighed in trucks on certified platform scales or other certified weighing devices.

Basis of Payment:

Fabric:

The quantity of filter fabric, measured as provided for above will be paid for at the contract unit price per square meter for "Filter Fabric For Drainage".

The quantity of drainage ditch excavation measured as provided for above will be paid for at the contract unit price per cubic meter for "Drainage Ditch Excavation".

The quantity of boulders measured as provided for above will be paid for at the contract unit price per metric ton for "Boulders".

#57 Stone:

The quantity of #57 stone, measured as provided for above, will be paid for at the contract unit price per metric ton for "#57 Stone". The above prices and payment will be full compensation for furnishing, hauling, placing and all incidentals necessary to complete the work.

Such prices and payments will be considered full compensation for all excavation, hauling, handling, furnishing and placing of boulders fabric and any incidentals necessary to complete the work.

Payment will be made under:

Filter Fabric for Drainage.....	Square Meter
Drainage Ditch Excavation.....	Cubic Meter
Boulders.....	Metric Ton
#57 Stone.....	Metric Ton

**RESTRICTIONS ON CONSTRUCTION OF EMBANKMENT:**

02-17-04

For Project R-2610A, the Contractor shall construct the embankments to the finished graded roadway section for a minimum distance of 100 feet (30.48 meters) from the listed end bents, and shall not begin any work on the bridge end bents as listed below until the prescribed waiting periods have elapsed, or until notified by the Engineer that the settlement rate has stabilized and work on the end bents may proceed.

Bridge Description and Affected Bent	Waiting Period
SBL Bridge @ Station 18+04.666 –L- POC	(1) One Month Both End Bents
SBL Bridge @ Station 27+85.488 –L-	(1) One Month Both End Bents

The Contractor will be required to maintain the embankments at finished graded roadway section during the waiting period. Additional earth material required to maintain embankment of finished graded roadway section will be paid for at the contract unit price per cubic yard (cubic meter) for "Borrow Excavation" or "Unclassified Excavation" depending on the source of the material. Where there is no pay item for Unclassified or Borrow Excavation, the furnishing of additional material will be paid for as extra work.

SP2R65

**ENERGY DISSIPATOR BASIN:**

The Contractor shall construct the Energy Dissipator Basin at the location shown on the plans, in accordance with the details in the plans, and as directed by the Engineer.

The energy dissipator basin shall be cleaned out, when so directed by the Engineer in order to maintain its effectiveness and shall be left in place after completion of the project.

Measurement for embankment shall be in accordance with Article 225-7 of the Standard Specifications.

Measurement for drainage ditch excavation shall be in accordance with Article 240-4 of the Standard Specifications.

Measurement for Filter Fabric for Drainage shall be in accordance with Article 868-5 of the Standard Specifications.

Measurement for Plain Rip Rap, Class “A” or “B” shall be in accordance with Article 868-5 of the Standard Specifications.

The quantity of Embankment will be paid for in accordance with Article 225-8 of the Standard Specifications.



The quantity of Drainage Ditch Excavation will be paid for in accordance with Article 240-5 of the Standard Specifications.

The quantity of Filter Fabric for Drainage will be paid for in accordance with Article 868-6 of the Standard Specifications.

The quantity of Plain Rip Rap, Class "A" or "B" will be paid for in accordance with Article 868-8 of the Standard Specifications.

**CROSS VANE ROCK WEIR WITH FOOTER ROCK:**

**05-18-04**

Description:

The Contractor shall construct cross vane weirs in accordance with the details in the plans, as directed by the Engineer and the following provision. This work shall include excavating the channel, and constructing cross vane weirs.

Cross vane weirs shall be constructed in accordance with the detail in the plans. The purpose of the weirs is to create pools for trout stream enhancement.

Materials:

Materials shall meet the requirements shown below:

Filter Fabric.....	Section 876
Drainage Ditch Excavation.....	Section 240
Boulders.....	500 Kg to 1000 Kg
Footer Rock.....	0.6m x 0.6m x 0.9m

All stone and boulders shall be sound, tough, dense, resistant to the action of air and water, and suitable in all other respects for the purpose intended.

Footer rock shall not be less than 0.45m along a minor axis nor more than 1.5 m, along a major axis.

Construction Requirements:

Erosion control measures shall be constructed prior to any earth movement related to highway construction in channel change areas.

Method of Measurement:

Fabric:

The quantity of filter fabric to be paid for will be the area in square meters, measured along the surface of the ground, over which filter fabric has been acceptably placed.

The quantity of drainage ditch excavation to be paid for will be measured in accordance with the Standard Specifications.

The quantity of boulders to be paid for will be the actual number of metric ton boulders which have been furnished, placed and accepted.

Footer Rocks:

The quantity of footer rocks to be paid for will be the actual number of metric tons of rock which has been incorporated into the completed and accepted work. The rock will be measured by being weighed in trucks on certified platform scales or other certified weighing devices.

Basis of Payment:

Fabric:

The quantity of filter fabric, measured as provided for above will be paid for at the contract unit price per square meter for "Filter Fabric For Drainage".

The quantity of drainage ditch excavation measured as provided for above will be paid for at the contract unit price per cubic meter for "Drainage Ditch Excavation".

The quantity of boulders measured as provided for above will be paid for at the contract unit price per metric ton for "Boulders".

The quantity of footer rock, measured as provided for above, will be paid for at the contract unit price per metric ton for "Footer Rock". The above prices and payment will be full compensation for furnishing, hauling, placing and all incidentals necessary to complete the work.

Such prices and payments will be considered full compensation for all excavation, hauling, handling, furnishing and placing of boulders, fabric and any incidentals necessary to complete the work.

Payment will be made under:

Filter Fabric for Drainage.....	Square Meter
Drainage Ditch Excavation.....	Cubic Meter
Boulders.....	Metric Ton
Footer Rocks.....	Metric Ton

**" (mm) WELDED STEEL PIPE:**

**1-15-02**

Use \_\_\_" (mm) welded steel pipe as shown on the plans that conforms to Section 330 of the Standard Specifications.

Install the pipe by dry boring and jacking. Carefully dry bore the pipe true to the line and grade given. Hold the bore to a minimum to insure that there is no settlement. Remove and replace

any pipe that has been damaged due to the Contractor's operation at no cost to the Department. Completely fill all voids around the outside of the pipe to the satisfaction of the Engineer.

Measurement will be made in accordance with Article 330-4 of the Standard Specifications.

The quantity of pipe as measured above will be paid for at the contract unit price per linear foot (meter) for "\_\_\_" (mm) Welded Steel Pipe, \_\_\_" (mm) Thick, Grade B (By Boring and Jacking)". Such price and payment will be full compensation for all work described herein including dry boring, jacking, tools, materials, labor, workmanship, and all other incidentals necessary to complete the work.

SP3R25

Payment will be under:

\_\_\_" (mm) Welded Steel Pipe, \_\_\_" (mm) Thick, Grade B  
(By Boring and Jacking) ..... Linear Foot (Meter)

**FLOWABLE FILL:**

9-17-02

Provide and install flowable fill material in accordance with Articles 340-2 of the Standard Specifications.

Discharge flowable fill material directly from the truck into the space to be filled, or by other approved methods. The mix may be placed full depth or in lifts as site conditions dictate. The Contractor shall provide a method to plug the ends of the existing pipe in order to contain the flowable fill.

At locations where flowable fill is called for on the plans and a pay item for flowable fill is included in the contract, the quantity of flowable fill to be paid for will be the actual number of cubic yards (cubic meters) of flowable fill that have been satisfactorily placed and accepted.

The quantity of flowable fill, measured as provided above, will be paid for at the contract unit price per cubic yard (cubic meter) for "Flowable Fill". Such price and payment will be full compensation for all work covered by this provision including but not limited to the mix design, furnishing, hauling, placing and containing the flowable fill.

SP3R30

Payment will be made under:

Flowable Fill ..... Cubic Yard (Cubic Meter)

**REINFORCED BRIDGE APPROACH FILLS:**

03-18-03

Description:

This work consists of all work necessary to construct reinforced bridge approach fills in accordance with these provisions and the plans, and as directed by the Engineer.

Materials:

Geomembrane

Provide geomembrane that is impermeable, composed of polyethylene polymers or polyvinyl chloride, and meets the following physical requirements:

<u>Property</u>	<u>Requirements</u>	<u>Test Method</u>
Thickness	25 mils (0.6 mm) Minimum	ASTM D1593
Tensile Strength at Break	100 lb/inch (18 KN/M) Minimum	ASTM D638
Puncture Strength	40 lbs (0.2KN) Minimum	FTMS 101 C 2065
Moisture Vapor Transmission Rate	0.018 ounce/yard <sup>2</sup> (0.615 gm/ m <sup>2</sup> ) per Day Maximum	ASTM E96

Fabric

Refer to section 1056 for Type 2 Engineering Fabric and the following:

Use a woven fabric consisting of strong rot-proof synthetic fibers such as polypropylene, polyethylene, or polyester formed into a stable network such that the filaments or yarns retain their relative positions to each other.

<u>Fabric Property</u>	<u>Requirements</u>	<u>Test Method</u>
Minimum Flow Rate	2 gallons/min/square foot (1358 cm <sup>3</sup> /sec/square meter)	ASTM D 4491

Lamination of fabric sheets to produce the physical requirements of a fabric layer will not be accepted. Furnish letters of certification from the manufacturer with each shipment of the fabric and geomembrane attesting that the material meets the requirements of this provision; however, the material is subject to inspection, test, or rejection by the Engineer at any time.

During all periods of shipment and storage, wrap the geomembrane and fabric in a heavy-duty protective covering to protect the material from ultraviolet rays. After the protective wrapping has been removed, do not leave the material uncovered under any circumstances for longer than 4 days.

Select Material

Provide select material meeting the requirements of Class III, Type 1 or Type 2, or Class V select material of section 1016 of the Standard Specifications. When select material is required under water, use select material class V only, up to one foot (300mm) above the existing water elevation.

4" (100mm) Diameter Corrugated Drainage Pipe and Fittings

Provide pipe and fittings that meet all the applicable requirements of Section 815 or 816 of the Standard Specifications.

Construction:

Place the geomembrane and fabric as shown on the plans or as directed by the Engineer. Perform the excavation for the fabric reinforced fill to the limits shown on the plans. Provide an excavated surface free of obstructions, debris, pockets, stumps, and cleared of all vegetation. The geomembrane or fabric will be rejected if it has defects, rips, holes, flaws, deterioration or damage incurred during manufacture, transportation, handling or storage. Lay all layers smooth, and free from tension, stress, folds, wrinkles or creases. Place all the fabric layers with the machine direction (roll direction) perpendicular to the backwall face. Overlap geomembrane or fabric splices perpendicular to the backwall face a minimum of 18 inches (450 mm). Geomembrane or fabric splices parallel to the backwall face will not be allowed.

Deposit and spread select material in successive, uniform, approximately horizontal layers of not more than 10 inches (250 mm) in depth, loose measurement, for the full width of the cross section, and keep each layer approximately level. Place and compact each layer of select material fill no more than 10 inches (250 mm) thick with low ground pressure equipment. Use hand operated equipment to compact the fill material within three feet (0.9 m) of the backwall and wingwalls as directed by the Engineer. Compact select material to a density equal to at least 95% of that obtained by compacting a sample of the material in accordance with AASHTO T99 as modified by the Department. Compact the top eight inches (200 mm) of select material to a density to at least 100% of that obtained by compacting a sample of the material in accordance with AASHTO T99 as modified by the Department. Density requirements are not applicable to select material, class V; however compact the fill with at least four passes of low ground pressure equipment on the entire surface as directed by the Engineer. The compaction of each layer of select material must be inspected and approved by the Department prior to the placement of the next fill layer. No equipment will be allowed to operate on the drainage pipe or any geomembrane/fabric layer until it is covered with at least six inches (150 mm) of fill material. Compaction must not damage the drainage pipe, geomembrane, or fabric under the fill. Cover the geomembrane/fabric with a layer of fill material within four days after placement of the geomembrane/fabric. Geomembrane and fabric that is damaged as a result of installation will be replaced as directed by the Department at no additional cost.

Place the geomembrane on the ground, and attach and secure it tightly to the vertical face of the backwall and wingwalls with adhesives, duct-tape, nails or any other method approved by the Engineer. Place the first fabric layer on the surface of the geomembrane with the same dimensions of the geomembrane. No material or void is allowed between the geomembrane and

the first fabric layer. Place and fold the remaining fabric layers on the edges as shown on the plans or as directed by the Engineer. Provide vertical separation between fabric layers as specified on the plans. The number of fabric layers will be shown in the plans.

Place four inch (100 mm) diameter perforated drainage pipe along the base of the backwall and sloped to drain as shown on the plans. Completely wrap perforated drainage pipe and #78M stone with Type 2 Engineering Fabric as shown on the plan detail. Install a pipe sleeve through the bottom of or under the wing wall prior to placing concrete for the wing wall. The pipe sleeve must be of adequate strength to withstand the wingwall load. Place the pipe sleeve in position to allow the drainage pipe to go through the wing wall with a proper slope. Connect four-inch (100-mm) diameter nonperforated (plain) drainage pipe with a coupling to the perforated pipe near the inside face of the wingwall. Place the nonperforated drainage pipe through the pipe sleeve, extend down to the toe of the slope and connect, to a ditch or other drainage systems as directed by the Engineer. For bridge approaches in cut sections where no side slope is available, direct the drainage pipe outlet to the end slope down to the toe using elbows as directed by the Engineer.

Measurement and Payment:

Compensation:

All work covered by this provision will be paid for at the contract lump sum price for "Reinforced Bridge Approach Fills, Station \_\_\_\_\_". Such price and payment will be full compensation for both approach fills at each bridge installation, including but not limited to furnishing, placing and compacting select material, furnishing and placing geomembrane and woven fabric, furnishing and placing pipe sleeve, drainage pipe, and stone, furnishing and installing concrete pads at the end of outlet pipes, excavation and any other items necessary to complete the work.

Payment will be made under:

Reinforced Bridge Approach Fills, Station _____	Lump Sum	SP4R01
---	----------	--------

**PREPARATION OF SUBGRADE AND BASE:** **1-16-96**

On mainline portions and ramps of this project, prepare the subgrade and base beneath the pavement structure in accordance with the applicable sections of the Standard Specifications except use an automatically controlled fine grading machine utilizing string lines, laser controls, or other approved methods to produce final subgrade and base surfaces meeting the lines, grades, and cross sections required by the plans or established by the Engineer.

No direct payment will be made for the work required by this provision as it will be considered incidental to other work being paid for by the various items in the contract.

SP5R05

**AGGREGATE FOR SOIL-CEMENT BASE:**

**1-01-02R**

Revise the 2002 Standard Specifications as follows:

Page 5-27, Article 542-1. Delete the first sentence and substitute the following:

"The work covered by this section consists of constructing and curing a soil-cement base by treating the subgrade, existing subbase, or existing base, or any combination of these materials, by pulverizing, adding portland cement, adding aggregate when required, mixing, wetting, and compacting the mixture to the required density."

Page 5-27, Article 542-2. Add the following after line 3:

"Aggregate, Std. Size ABC.....Section 1005"

Page 5-28, Article 542-7. Add the following paragraph after the first paragraph:

"Prior to spreading cement, aggregate shall be spread at the rate shown in the plans.

Page 5-30, Article 542-16. Add the following paragraph after the first paragraph:

"The quantity of aggregate to be paid for will be the number of tons (metric tons) of aggregate that have been incorporated into the completed and accepted work. The aggregate will be measured by weighing in trucks on certified platform scales or other certified weighing devices. No deductions will be made for any moisture contained in the aggregate at the time of weighing."

Page 5-31, Article 542-17. Add the following paragraph after the first paragraph:

"The quantity of aggregate, measured as provided in Article 542-16, will be paid for at the contract unit price per ton (metric ton) for "Aggregate for Soil-Cement Base"."

Add the following at the end of the last paragraph:

"Aggregate for Soil-Cement Base.....Ton (Metric Ton)"

SP5R15

**LIME AND CEMENT TREATED SOIL**

**11-18-03**

Revise the 2002 Standard Specifications as follows:

Page 5-4, Article 501-8. In the second sentence of the first paragraph, **change 40 days to 24 days.**

Page 5-28, Article 542-7. In the second sentence of the first paragraph, **change 45 days to 24 days.**

SP5R20

**ASPHALT PAVEMENTS - SUPERPAVE**

**02-17-04**

Revise the 2002 Standard Specifications as follows:

**PRIME COAT**

Page 6-2, Article 600-9

Delete the first paragraph under this Article and substitute the following:

The quantity of prime coat to be paid will be the number of gallons (liters) of prime coat material that has been satisfactorily placed on the roadway. Each distributor load of prime coat material delivered and utilized on the project will be measured.

**ASPHALT TACK COAT**

Page 6-4, Article 605-8

Insert the following after paragraph one in this Article:

Take necessary precautions to limit the tracking and/or accumulation of tack coat material on either existing or newly constructed pavements. Excessive accumulation of tack may require corrective measures.

**FIELD VERIFICATION AND JOB MIX FORMULA ADJUSTMENTS**

Page 6-7, Article 609-4

Delete the first paragraph under this Article and substitute the following:

Conduct field verification of the mix at each plant within 30 calendar days prior to initial production of each mix design, when required by the Allowable Mix Adjustment Policy and when directed as deemed necessary.

Page 6-8, Article 609-4

Delete the first paragraph on this page and substitute the following:

Retain records of these calibrations and mix verification tests, including Superpave Gyratory Compactor (SGC) printouts, at the QC laboratory. In addition, furnish copies, including SGC printouts, to the Engineer for review and approval within one working day after beginning production of the mix.



Page 6-8, Article 609-4

Add the following sentence to the end of the last paragraph in this Article:

Any mix produced that is not verified may be assessed a price reduction at the Engineer's discretion in addition to any reduction in pay due to mix and/or density deficiencies.

Quality control minimum sampling and testing schedule:

Page 6-9, Subarticle 609-5(C)1

Delete the second sentence in the second paragraph of this Article and substitute the following:

Retain the QC compacted volumetric test specimens for 5 calendar days, commencing the day the specimens are prepared.

Page 6-9, Subarticle 609-5(C)2

At the bottom of this page, delete the sentence directly above the Accumulative Production Increment and substitute the following:

Sample and test the completed mixture from each mix design at the following minimum frequency during mix production:

Page 6-10, Subarticle 609-5(C)2

Revise Items B, C, D and E on this page as follows:

- B. Gradation on Recovered Blended Aggregate from Mix Sample (AASHTO T 30 Modified) Grade on all sieves specified on JMF
- C. Maximum Specific Gravity (AASHTO T 209 or ASTM D 2041), optional (ASTM D 6857)
- D. Bulk Specific Gravity of Compacted Specimens (AASHTO T166), optional (ASTM D 6752), Average of 3 specimens at  $N_{des}$  gyrations (AASHTO T 312)
- E. Air Voids (VTM) (AASHTO T 269), Average of 3 specimens at  $N_{des}$  gyrations

Page 6-11, Subarticle 609-5(C)2

At the top of this page, delete Item B., "Reclaimed Asphalt Pavement..." and substitute the following:

- B. Reclaimed Asphalt Pavement (RAP) Binder Content and Gradation (AASHTO T 308 Modified or T 164 and AASHTO T 30 Modified) (sampled from stockpiles or cold feed system at beginning of production and weekly thereafter). Have RAP approved for use in accordance with Article 1012-1(G). (Split Sample Required)

Page 6-11, Subarticle 609-5(C)2

Insert the following sampling and testing at the end of this Subarticle

- F. Uncompacted Void Content of Fine Aggregate, AASHTO T 304, Method A (natural sand only). Performed at Mix Design and when directed as deemed necessary. (Split Sample Required)
- G. Reclaimed Asphalt Shingle Material (RAS) Binder Content and Gradation (AASHTO T 308 Modified or T 164 and AASHTO T 30 Modified) (sampled from stockpiles or cold feed system at beginning of production and weekly thereafter). Have RAS approved for use in accordance with Article 1012-1(F). (Split Sample Required)

**CONTROL CHARTS**

Page 6-11, Subarticle 609-5(C)3

Delete the second sentence of the first paragraph in this Subarticle and substitute the following:

Record all regularly scheduled random sample or directed sample full test series results for mix incorporated into the project on control charts the same day the test results are obtained.

Page 6-12, Subarticle 609-5(C)3

Delete item 3 in the list below the second full paragraph on this page.

**CONTROL LIMITS**

Page 6-12, Subarticle 609-5(C) 4

At the bottom of this page, delete the table and substitute the following:

**CONTROL LIMITS**

<b>Mix Control Criteria</b>	<b>Target Source</b>	<b>Warning Limit</b>	<b>Moving Average Limit</b>	<b>Individual Limit</b>
2.36mm Sieve	JMF	±4.0 %	±5.0 %	±8.0 %
0.075mm Sieve	JMF	±1.5 %	±2.0 %	±2.5 %
Binder Content	JMF	±0.3 %	±0.5 %	±0.7 %
VTM @ N <sub>des</sub>	JMF	±1.0 %	±1.5 %	±2.0 %
VMA @ N <sub>des</sub>	Min. Spec. Limit	-0.5%	-0.8%	-1.0%
P <sub>0.075</sub> / P <sub>be</sub> Ratio	Max. Spec. Limit	0.0	N/A	+0.4%
%G <sub>mm</sub> @ N <sub>ini</sub>	Max. Spec. Limit	N/A	N/A	+2.0%
TSR	Min. Spec. Limit	N/A	N/A	-15.0%

## FIELD COMPACTION QUALITY CONTROL

Page 6-15, Subarticle 609-5(D)1

Delete the first and second sentences in the fourth paragraph on this page and substitute the following:

Base and intermediate mix types (surface mixes not included) utilized for pavement widening of less than 4.0 feet and all mix types used in tapers, irregular areas and intersections (excluding full width travel lanes of uniform thickness), will not be subject to the sampling and testing frequency specified above provided the pavement is compacted using approved equipment and procedures. However, the Engineer may require occasional density sampling and testing to evaluate the compaction process.

Page 6-16, Subarticle 609-5(D)1

Delete item number 2 at the top of this page. Item number 3 should be re-numbered as 2 after the specified deletion.

## LIMITED PRODUCTION PROCEDURE

Page 6-17, Subarticle 609-5(D) 5

Delete the first paragraph in this Subarticle and substitute the following:

Proceed on limited production when, for the same mix type, one of the following items occur:

- (1) Two consecutive failing lots, excluding lots representing an individual resurfacing map or portion thereof.
- (2) Three consecutive failing lots, with each lot representing an individual resurfacing map or portion thereof.
- (3) Two consecutive failing nuclear control strips.

Pavement within each construction category (New and Other), as defined in Article 610-13, and pavement placed simultaneously by multiple paving crews will be evaluated independently for limited production purposes.

Delete the first sentence in the last paragraph in this Subarticle and substitute the following:

If the Contractor does not operate by the limited production procedures as specified above, the two consecutive failing density lots, three consecutive failing lots with each lot representing an individual resurfacing map or portion thereof, or two consecutive failing nuclear control strips, whichever is applicable, and all mix produced thereafter will be considered unacceptable.

## DOCUMENTATION (RECORDS)

Page 6-18, Subarticle 609-5(E)

Delete the third and fourth sentence in the first full paragraph on this page and substitute the following:

Maintain all QC records, forms and equipment calibrations for a minimum of 3 years from their completion date.

Delete the second full paragraph on this page and substitute the following:

Falsification of test results, documentation of observations, records of inspection, adjustments to the process, discarding of samples and/or test results, or any other deliberate misrepresentation of the facts will result in the revocation of the applicable person's QMS certification. The Engineer will determine acceptability of the mix and/or pavement represented by the falsified results or documentation. If the mix and/or pavement in question is determined to be acceptable, the Engineer may allow the mix to remain in place at no pay for the mix, asphalt binder and other mix components. If the mix and/or pavement represented by the falsified results is determined not to be acceptable, remove and replace with mix, which complies with the Specifications. Payment will be made for the actual quantities of materials required to replace the falsified quantities, not to exceed the original amounts.

## QUALITY ASSURANCE

Page 6-18, Article 609-6

In Item 5 under Plant Mix Quality Assurance, add "at a frequency equal to or greater than 5% of the QC sample frequency".

In the first sentence within the paragraph below Plant Mix Quality Assurance, delete the words "of mix".

In Item 1 under Density Quality Assurance, delete the wording at the end of the sentence "at a frequency equal to or greater than 10% of the frequency required of the Contractor".

Page 6-19, Article 609-6

In Item 4 under Density Quality Assurance, add "at a frequency equal to or greater than 5% of the QC sample frequency."

Insert the following after Item 4 under Density Quality Assurance:

6. By periodically directing the recalculation of random numbers for the Quality Control core or nuclear density test locations. The original QC test locations may be tested by QA and evaluated as verification tests.

LIMITS OF PRECISION

Page 6-19, Article 609-6

In the limits of precision table, delete the last three rows and substitute the following:

QA retest of prepared QC Gyrotory Compacted

Volumetric Specimens	± 0.015
Retest of QC Core Sample	± 1.2% (% Compaction)
Comparison of QA Core Sample	± 2.0% (% Compaction)
QA Verification Core Sample	± 2.0% (% Compaction)
Nuclear Comparison of QC Test	± 2.0% (% Compaction)
QA Nuclear Verification Test	± 2.0% (% Compaction)

ASPHALT CONCRETE PLANT MIX PAVEMENTS – DESCRIPTION

Page 6-21, Article 610-1

Insert the following after the last paragraph in this Article:

A high frequency of asphalt plant mix, density, or mix and density deficiencies occurring over an extended duration of time may result in future asphalt, which is represented by mix and/or density test results not in compliance with minimum specification requirements, being excluded from acceptance at an adjusted contract unit price in accordance with Article 105-3. This acceptance process may apply to all asphalt produced and /or placed and may continue until the Engineer determines a history of quality asphalt production and placement is reestablished.

MATERIALS

Page 6-21, Article 610-2

Delete reference of Anti-strip additive (chemical) to Article 1020-2 and substitute Article 1020-8.

COMPOSITION OF MIXTURES (MIX DESIGN AND JOB MIX FORMULA)

Page 6-21, Subarticle 610-3(A)

At the end of the second paragraph under this Subarticle, add the following sentence:

In addition, submit Superpave gyrotory compactor printouts for all specimens compacted at  $N_{des}$  and  $N_{max}$  during the mix design process.

Insert the following paragraph after the second paragraph under this Subarticle:

For the final surface layer of the specified mix type, use a mix design with an aggregate blend gradation above the maximum density line on the 2.36 mm and larger sieves.

Insert the following at the end of the third paragraph under this Article:

When the percent of binder contributed from RAS or a combination of RAS and RAP exceeds 20 percent of the total binder in the completed mix, the virgin binder PG grade must be one grade below (both high and low temperature grade) the binder grade specified in Table 610-2 for the mix type.

Delete the fourth paragraph in this Subarticle and substitute the following:

For Type S 12.5D mixes, the maximum percentage of reclaimed asphalt material is limited to 15% and must be produced using virgin asphalt binder grade PG 76-22. For all other recycled mix types, when the percentage of RAP is 15 percent or less of the total mixture, the virgin binder PG grade must be as specified in Table 610-2 for the specified mix type. When the percentage of RAP is greater than 15 but not more than 25 percent of the total mixture, the virgin binder PG grade must be one grade below (both high and low temperature grade) the specified grade for the mix type. When the percentage of RAP is greater than 25 percent of the total mixture, the Engineer will establish and approve the asphalt binder grade.

Page 6-22, Subarticle 610-3(A)

Insert the following sentence at the end of the Item 4:

If natural sand is utilized in the proposed mix design, determine and report the Uncompacted Void Content of the natural sand in accordance with AASHTO T-304, Method A.

Page 6-23, Subarticle 610-3(A)

Under the quantities of mix components insert the following sentence:

When requested by the Engineer, submit to the Department's Materials and Tests Unit, in Raleigh, six (6) Superpave Gyratory Compactor specimens compacted to a height of 75 mm and to a void content (VTM) of 4.0% +/- 0.5% for performance rut testing with the Asphalt Pavement Analyzer.

JOB MIX FORMULA

Page 6-24, Subarticle 610-3(C)

Delete Table 610-1 and associated notes. Substitute the following:

**TABLE 610-1  
SUPERPAVE AGGREGATE GRADATION DESIGN CRITERIA**

Standard Sieves (mm)	Percent Passing Criteria (Control Points)											
	Mix Type (Nominal Maximum Aggregate Size)											
	4.75 mm (a)		9.5 mm (c)		12.5 mm (c)		19.0 mm		25.0 mm		37.5 mm	
	Min.	Max.	Min.	Max.	Min.	Max.	Min.	Max.	Min.	Max.	Min.	Max.
50.0												100.0
37.5									100.0	90.0	100.0	
25.0							100.0	90.0	100.0		90.0	
19.0					100.0	90.0	100.0		90.0			
12.5				100.0	90.0	100.0		90.0				
9.5		100.0	90.0	100.0		90.0						
4.75	90.0	100.0		90.0								
2.36	65.0	90.0	32.0 <b>(b)</b>	67.0 <b>(b)</b>	28.0	58.0	23.0	49.0	19.0	45.0	15.0	41.0
1.18												
0.600												
0.300												
0.150												
0.075	4.0	8.0	4.0	8.0	4.0	8.0	3.0	8.0	3.0	7.0	3.0	6.0

- (a) For Type S 4.75A, a minimum of 50% of the aggregate components shall be manufactured material from the crushing of stone.
- (b) For Type SF 9.5A, the percent passing the 2.36mm sieve shall be a minimum of 60% and a maximum of 70%.
- (c) For the final surface layer of the specified mix type, use a mix design with an aggregate blend gradation above the maximum density line on the 2.36 mm and larger sieves.

Page 6-25, Subarticle 610-3(C),

Delete Table 610-2 and associated notes. Substitute the following:

**TABLE 610-2  
SUPERPAVE MIX DESIGN CRITERIA**

Mix Type (f)	Design ESALs millions (a)	Binder PG Grade (b)	Compaction Levels			Volumetric Properties (c)			
			No. Gyration @ N <sub>ini</sub>	N <sub>des</sub>	N <sub>max</sub>	VMA % Min.	VTM %	VFA Min. - Max.	%G <sub>mm</sub> @ N <sub>ini</sub>
S-4.75A	<0.3	64 -22	6	50	75	20.0	7.0-15.0		
SF-9.5A	<0.3	64 -22	6	50	75	16.0	3.0 - 5.0	70 - 80	≤ 91.5
S-9.5B	0.3 - 3	64 -22	7	75	115	15.0	3.0 - 5.0	65 - 80	≤ 90.5
S-9.5C	3 - 30	70 -22	8	100	160	15.0	3.0 - 5.0	65 - 76	≤ 90.0
S-12.5C	3 - 30	70 -22	8	100	160	14.0	3.0 - 5.0	65 - 75	≤ 90.0
S-12.5D	> 30	76 -22	9	125	205	14.0	3.0 - 5.0	65 - 75	≤ 90.0
I-19.0B	< 3	64 -22	7	75	115	13.0	3.0 - 5.0	65 - 78	≤ 90.5
I-19.0C	3 - 30	64 -22	8	100	160	13.0	3.0 - 5.0	65 - 75	≤ 90.0
I-19.0D	> 30	70 -22	9	125	205	13.0	3.0 - 5.0	65 - 75	≤ 90.0
B-25.0B	< 3	64 -22	7	75	115	12.0	3.0 - 5.0	65 - 78	≤ 90.5
B-25.0C	> 3	64 -22	8	100	160	12.0	3.0 - 5.0	65 - 75	≤ 90.0
B-37.5C	> 3	64 -22	8	100	160	11.0	3.0 - 5.0	63 - 75	≤ 90.0
	<b>Design Parameter</b>					<b>Design Criteria</b>			
All	1. %G <sub>mm</sub> @ N <sub>max</sub>					≤ 98.0% (d)			
Mix	2. Dust to Binder Ratio (P <sub>0.075</sub> / P <sub>be</sub> )					0.6 - 1.4			
Types	3. Retained Tensile Strength (TSR) (AASHTO T 283 Modified)					85 % Min. (e)			

- Notes:**
- (a) Based on 20 year design traffic.
  - (b) When Recycled Mixes are used, select the binder grade to be added in accordance with Subarticle 610-3(A).
  - (c) Volumetric Properties based on specimens compacted to N<sub>des</sub> as modified by the Department.
  - (d) Based on specimens compacted to N<sub>max</sub> at selected optimum asphalt content.
  - (e) AASHTO T 283 Modified (No Freeze-Thaw cycle required). TSR for Type S 4.75A, Type B 25.0 and Type B 37.5 mixes is 80% minimum.
  - (f) Mix Design Criteria for Type S 4.75A may be modified subject to the approval of the Engineer



**WEATHER, TEMPERATURE, AND SEASONAL LIMITATIONS FOR PRODUCING AND PLACING ASPHALT MIXTURES**

Page 6-26, Article 610-4, Table 610-3

Delete the title of Table 610-3 and substitute the following title:

**ASPHALT PLACEMENT- MINIMUM TEMPERATURE REQUIREMENTS**

In the first column, third row; delete reference to the ACSC Types S 9.5A and S 12.5B mix.

Add the following minimum placing temperatures for mix types S 4.75A and SF 9.5A.

<b>Asphalt Concrete Mix Type</b>	<b>Minimum Air Temperature</b>	<b>Minimum Road Surface Temperature</b>
ACSC, Type S 4.75A, SF 9.5A	40°F (5°C)	50°F (10°C)

**SPREADING AND FINISHING**

Page 6-32, Article 610-8

Insert the following after the second sentence within the sixth paragraph in this Article,

Take necessary precautions during production, loading of trucks, transportation, truck exchanges with paver, folding of the paver hopper wings, and conveying material in front of the screed to prevent segregation of the asphalt mixtures.

Page 6-33, Article 610-8

At the end of the third full paragraph on this page, add the following sentence:

Waiver of the use of automatic screed controls does not relieve the Contractor of achieving plan grades and cross-slopes.

## DENSITY REQUIREMENTS

Page 6-34, Article 610-10,

Delete Table 610-4 and substitute the following table and associated notes:

**Table 610-4  
MINIMUM DENSITY REQUIREMENTS**

<b>MIX TYPE</b>	<b>MINIMUM % of <math>G_{mm}</math></b>
<b>SUPERPAVE MIXES</b>	<b>(Maximum Specific Gravity)</b>
S 4.75A	85.0 <sup>(a,b)</sup>
SF 9.5A	90.0
S 9.5X, S 12.5X, I 19.0X, B 25.0X, B 37.5X	92.0

(a) All S 4.75A pavement will be accepted for density in accordance with Article 105-3

(b) Compaction to the above specified density will be required when the S 4.75 A mix is applied at a rate of 100 lbs/sy (55 kg/m<sup>2</sup>)

Page 6-34, Article 610-10

Delete the second paragraph in this Article and substitute the following:

Compact base and intermediate mix types (surface mixes not included) utilized for pavement widening of less than 4.0 feet (1.2 meters) and all mix types used in tapers, irregular areas and intersections (excluding full width travel lanes of uniform thickness), using equipment and procedures appropriate for the pavement area width and/or shape. Compaction with equipment other than conventional steel drum rollers may be necessary to achieve adequate compaction. Occasional density sampling and testing to evaluate the compaction process may be required. Densities lower than that specified in Table 610-4 will be accepted, in accordance with Article 105-3, for the specific mix types and areas listed directly above.

## SURFACE REQUIREMENTS AND ACCEPTANCE

Page 6-35, Article 610-12

Delete the first paragraph in this Article and substitute the following:

Construct pavements using quality paving practices as detailed herein. Construct the pavement surface smooth and true to the plan grade and cross slope. Immediately correct any defective areas with satisfactory material compacted to conform with the surrounding area. Pavement imperfections resulting from unsatisfactory workmanship such as segregation, improper longitudinal joint placement or alignment, non-uniform edge alignment and excessive pavement repairs will be considered unsatisfactory and if allowed to remain in place will be accepted in accordance with Article 105-3.

When directed due to unsatisfactory laydown or workmanship, operate under the limited production procedures. Limited production for unsatisfactory laydown is defined as being restricted to the production, placement, compaction, and final surface testing (if applicable) of a sufficient quantity of mix necessary to construct only 2500 feet (750 meter) of pavement at the laydown width.

Remain on limited production until such time as satisfactory laydown results are obtained or until three consecutive 2500 foot (750 meter) sections have been attempted without achieving satisfactory laydown results. If the Contractor fails to achieve satisfactory laydown results after three consecutive 2500 foot (750 meter) sections have been attempted, cease production of that mix type until such time as the cause of the unsatisfactory laydown results can be determined. As an exception, the Engineer may grant approval to produce a different mix design of the same mix type if the cause is related to mix problem(s) rather than laydown procedures.

Mix placed under the limited production procedures for unsatisfactory laydown or workmanship will be evaluated for acceptance in accordance with Article 105-3.

#### DENSITY ACCEPTANCE

Page 6-36, Article 610-13

Delete the second paragraph on this page and substitute the following:

The pavement will be accepted for density on a lot by lot basis. A lot will consist of one day's production of a given job mix formula on a contract. As an exception, separate lots will be established when the one of the following occurs:

- (6) Portions of pavement are placed in both "New" and "Other" construction categories as defined below. A lot will be established for the portion of the pavement in the "New" construction category and a separate lot for the portion of pavement in the "Other" construction category.
- (7) Pavement is placed on multiple resurfacing maps, unless otherwise approved prior to paving. A lot will be established for each individual resurfacing map or portion thereof.
- (8) Pavement is placed simultaneously by multiple paving crews. A lot will be established for the pavement placed by each paving crew.
- (9) Pavement is placed in different layers. A lot will be established for each layer.
- (10) Control strips are placed during limited production.

The Engineer will determine the final category and quantity of each lot for acceptance purposes.

Page 6-36, Article 610-13

Delete the first sentence in the third paragraph on this page and insert the following:

The “New” construction category will be defined as pavements of uniform thickness, exclusive of irregular areas, meeting all three of the following criteria:

Delete the sixth paragraph in this Article and substitute the following:

A failing lot for density acceptance purposes is defined as a lot for which the average of all test sections, and portions thereof, fails to meet the minimum specification requirement. If additional density sampling and testing, beyond the minimum requirement, is performed and additional test sections are thereby created, then all test results shall be included in the lot average. In addition, any lot or portion of a lot that is obviously unacceptable will be rejected for use in the work.

Page 6-36, Article 610-13

Delete the last paragraph on this page and substitute the following:

Any density lot not meeting minimum density requirements detailed in Table 610-4 will be evaluated for acceptance by the Engineer. If the lot is determined to be reasonably acceptable, the mix will be paid at an adjusted contract price in accordance with Article 105-3. If the lot is determined not to be acceptable, the mix will be removed and replaced with mix meeting and compacted to the requirement of these specifications.

**BASIS OF PAYMENT, ASPHALT PAVEMENTS**

Page 6-37, Article 610-16

Add the following to the second paragraph:

The quantity of hot mix asphalt pavement, measured as provided in Article 610-15, will be paid for at the contract unit prices per ton (metric ton) for “Asphalt Concrete Surface Course, Type S 4.75A, and SF 9.5A”.

Add the following to the payment item description:

Asphalt Concrete Surface Course, Type S 4.75A .....	Ton (Metric Ton)
Asphalt Concrete Surface Course, Type SF 9.5A.....	Ton (Metric Ton)

Delete reference to the Asphalt Concrete Surface Course, Types S 9.5A and S 12.5B in both the second paragraph and in the payment description.

ASPHALT BINDER FOR PLANT MIX - METHOD OF MEASUREMENT

Page 6-39, Article 620-4

Delete the first sentence of the second paragraph on this page and substitute the following:

Where recycled plant mix is being produced, the grade of asphalt binder to be paid for will be the grade for the specified mix type as required in Table 610-2 unless otherwise approved.

CONSTRUCTION REQUIREMENTS

Page 6-43, Article 650-5

Add the following paragraph after the first paragraph under this Article:

Do not place open-graded asphalt friction course between October 31 and April 1 of the next year, unless otherwise approved. Place friction course, Type FC-1 mixes, only when the road surface temperature is 50°F (10°C) or higher and the air temperature is 50°F (10°C) or higher. The minimum air temperature for Type FC-1 Modified and FC-2 Modified mixes will be 60°F (15°C).

AGGREGATES FOR ASPHALT PLANT MIXES

Page 10-34, Subarticle 1012-1(B)4

Delete this Subarticle and substitute the following:

(4) Flat and Elongated Pieces:

Use coarse aggregate meeting the requirements of Table 1012-1 for flat and elongated pieces when tested in accordance with ASTM D 4791 (Section 8.4) on the No. 4 (4.75 mm) sieve and larger with a 5:1 aspect ratio (maximum to minimum) for all pavement types, except there is no requirement for Types S 4.75A, SF 9.5A, and S 9.5B.

Delete Table 1012-1 and substitute the following:

**Table 1012-1  
AGGREGATE CONSENSUS PROPERTIES<sup>(a)</sup>**

Mix Type	Course Aggregate Angularity <sup>(b)</sup>	Fine Aggregate Angularity % Minimum	Sand Equivalent % Minimum	Flat & Elongated 5 : 1 Ratio % Maximum
	ASTM D 5821	AASHTO T 304 Method A	AASHTO T 176	ASTM D 4791 Section 8.4
S 4.75 A		40	40	
SF 9.5 A S 9.5 B I 19.0 B B 25.0 B	75 / -	40	40	10 <sup>(c)</sup>
S 9.5 C S 12.5 C I 19.0 C B 25.0 C B 37.5 C	95 / 90	45	45	10
S 12.5 D I 19.0 D	100 / 100	45	50	10
OGAFC	100 / 100	N/A	N/A	10

- (a) Requirements apply to the course aggregate blend and/or fine aggregate blend
- (b) 95/90 denotes that 95% of the course aggregate (+No.4 or + 4.75mm sieve) has one fractured face and 90% has two or more fractured faces.
- (c) Does not apply to Mix Types SF 9.5 A or S 9.5 B

Page 10-36, Subarticle 1012-1(C)1

Insert the following after the fourth paragraph on this page:

When natural sand is utilized in “C” or “D” level asphalt mixes, do not exceed the maximum natural sand percentage in the mix design and/or production aggregate blend detailed in Table 1012-1A.

**Table 1012-1A**

<b>Uncompacted Void Content of Fine Aggregate AASHTO T 304 Method A</b>	<b>Maximum Percent Natural Sand Included in Mix Design and/or Production*</b>
Less than 42.0	10
Equal to 42.0 to 44.9	15
Equal to 45.0 and greater	20

\*Maximum percent natural sand may be exceeded with approval from Pavement Construction Engineer upon satisfactory evaluation of pavement performance testing

**FINE AGGREGATE ANGULARITY**

Page 10-36, Subarticle 1012-1(C)6

Delete reference to AASHTO TP 33 Method A and substitute AASHTO T 304, Method A.

Page 10-37, Subarticle 1012-1(H)

Delete this Subarticle. It is a duplicate of Subarticle 1012-1(F) located on Page 10-36.

**ASPHALT BINDER**

Page 10-46, Article 1020-2

Delete the first paragraph under this Article and substitute the following:

Use Performance Graded Asphalt Binder meeting the requirements of AASHTO M 320. See Article 610-3 for the specified grades. Submit a Quality Control Plan for asphalt binder production in conformance with the requirements of AASHTO R 26 to the Materials and Tests Unit.

SP6R01

**ASPHALT PAVER – FIXED STRING LINE:**

**10-21-03**

The Contractor's attention is directed to Article 610-8 of the Standard Specifications dealing with automatically controlled screeds on the asphalt pavement spreaders.

A fixed string line is required on this project.

SP6R06

**ASPHALT BINDER CONTENT OF ASPHALT PLANT MIXES:**

11-21-00<sub>R</sub>

The approximate asphalt binder content of the asphalt concrete plant mixtures used on this project will be as follows:

Asphalt Concrete Base Course, Type B 25.0__	4.3%
Asphalt Concrete Intermediate Course, Type I 19.0__	4.7%
Asphalt Concrete Surface Course, Type S 4.75A	7.0%
Asphalt Concrete Surface Course, Type SF 9.5A	6.5%
Asphalt Concrete Surface Course, Type S 9.5__	6.0%
Asphalt Concrete Surface Course, Type S 12.5__	5.5%

The actual asphalt binder content will be established during construction by the Engineer within the limits established in the Standard Specifications or Project Special Provisions.

SP6R15

**ASPHALT PLANT MIXTURES:**

7-1-95<sub>c</sub>

Place asphalt concrete base course material in trench sections with asphalt pavement spreaders made for the purpose or with other equipment approved by the Engineer.

SP6R20

**PRICE ADJUSTMENT - ASPHALT BINDER FOR PLANT MIX:**

11-21-00

Price adjustments for asphalt binder for plant mix will be made in accordance with Section 620 of the Standard Specifications as modified herein.

The base price index for asphalt binder for plant mix is \$233.32 per ton (metric ton).

This base price index represents an average of F.O.B. selling prices of asphalt binder at supplier's terminals on July 1, 2004.

SP6R25

**FINAL SURFACE TESTING - ASPHALT PAVEMENTS (RIDEABILITY) 05-18-04**

Perform acceptance testing of the longitudinal profile of the finished pavement surface in accordance with these provisions using a North Carolina Hearne Straightedge (Model No. 1). Furnish and operate the straightedge to determine and record the longitudinal profile of the pavement on a continuous graph. Final surface testing is an integral part of the paving operation and is subject to observation and inspection by the Engineer as deemed necessary.

Push the straightedge manually over the pavement at a speed not exceeding 2 miles per hour (3 kilometers per hour). For all lanes, take profiles in the right wheel path approximately 3 ft (1 m) from the right edge of pavement in the same direction as the paving operation, unless otherwise approved due to traffic control or safety considerations. Make one pass of the straightedge in each full width travel lane. The full lane width should be comparable in ride quality to the area evaluated with the Hearne Straightedge. If deviations exist at other locations across the lane width, utilize a 10 foot non-mobile straightedge or the Hearne Straightedge to



evaluate which areas may require corrective action. Take profiles as soon as practical after the pavement has been rolled and compacted but in no event later than 24 hours following placement of the pavement, unless otherwise authorized by the Engineer. Take profiles over the entire length of final surface travel lane pavement exclusive of -Y- line travel lanes less than or equal to 300 feet (90 meters) in length, turn lanes less than or equal to 300 feet (90 meters) in length, structures, approach slabs, paved shoulders, loops, and tapers or other irregular shaped areas of pavement, unless otherwise approved by the Engineer. Test in accordance with this provision all mainline travel lanes, full width acceleration or deceleration lanes, -Y- line travel lanes greater than 300 feet (90 meters) in length, ramps, full width turn lanes greater than 300 feet (90 meters) in length, and collector lanes.

At the beginning and end of each day's testing operations, and at such other times as determined necessary by the Engineer, operate the straightedge over a calibration strip so that the Engineer can verify correct operation of the straightedge. The calibration strip must be a 100 ft (30 m) section of pavement that is reasonably level and smooth. Submit each day's calibration graphs with that day's test section graphs to the Engineer. Calibrate the straightedge in accordance with the current NCDOT procedure titled "North Carolina Hearne Straightedge - Calibration and Determination of Cumulative Straightedge Index". Copies of this procedure may be obtained from the Department's Pavement Construction Section.

Plot the straightedge graph at a horizontal scale of approximately 25 ft per inch (3 m per cm) with the vertical scale plotted at a true scale. Record station numbers and references (bridges, approach slabs, culverts, etc.) on the graphs, and distances between references/stations must not exceed 100 ft (30 m). Have the operator record the Date, Project No., Lane Location, Wheel Path Location, Type Mix, and Operator's Name on the graph.

Upon completion of each day's testing, evaluate the graph, calculate the Cumulative Straightedge Index (CSI), and determine which lots, if any, require corrective action. Document the evaluation of each lot on a QA/QC-7 form. Submit the graphs along with the completed QA/QC-7 forms to the Engineer, within 24 hours after profiles are completed, for verification of the results. The Engineer will furnish results of their acceptance evaluation to the Contractor within 48 hours of receiving the graphs. In the event of discrepancies, the Engineer's evaluation of the graphs will prevail for acceptance purposes. The Engineer will retain all graphs and forms.

Use blanking bands of 0.2 inches, 0.3 inches, and 0.4 inches (5 mm, 7.5 mm, and 10 mm) to evaluate the graph for acceptance. The 0.2 inch and 0.3 inch (5 mm and 7.5 mm) blanking bands are used to determine the Straightedge Index (SEI), which is a number that indicates the deviations that exceed each of the 0.2 inch and 0.3 inch (5 mm and 7.5 mm) bands within a 100 ft (30 m) test section. The Cumulative Straightedge Index (CSI) is a number representing the total of the SEIs for one lot, which consist of not more than 25 consecutive test sections. In addition, the 0.4 inch (10 mm) blanking band is used to further evaluate deviations on an individual basis. The Cumulative Straightedge Index (CSI) will be determined by the Engineer in accordance with the current procedure titled "North Carolina Hearne Straightedge - Calibration and Determination of Cumulative Straightedge Index".

The pavement will be accepted for surface smoothness on a lot by lot basis. A test section represents pavement one travel lane wide not more than 100 ft (30 m) in length. A lot will consist of 25 consecutive test sections, except that separate lots will be established for each travel lane, unless otherwise approved by the Engineer. In addition, full width acceleration or deceleration lanes, ramps, turn lanes, and collector lanes, will be evaluated as separate lots. For any lot which is less than 2500 feet (750 m) in length, the applicable pay adjustment incentive will be prorated on the basis of the actual lot length. For any lot which is less than 2500 feet (750 m) in length, the applicable pay adjustment disincentive will be the full amount for a lot, regardless of the lot length.

If during the evaluation of the graphs, more than 5 lots within the contract limits (mainline travel lanes and full width -Y- line travel lanes greater than 300 feet in length only) require corrective action, then proceed on limited production for unsatisfactory laydown in accordance with Article 610-12. Proceeding on limited production is based upon the Contractor's initial evaluation of the straightedge test results and must begin immediately upon obtaining those results. Additionally, the Engineer may direct the Contractor to proceed on limited production in accordance with Article 610-12 due to unsatisfactory laydown or workmanship.

Limited production for unsatisfactory laydown is defined as being restricted to the production, placement, compaction, and final surface testing of a sufficient quantity of mix necessary to construct only 2500 feet (750 meter) of pavement at the laydown width. Once this lot is complete, the final surface testing graphs will be evaluated jointly by the Contractor and the Engineer. Remain on limited production until such time as satisfactory laydown results are obtained or until three consecutive 2500 foot (750 meter) sections have been attempted without achieving satisfactory laydown results. The Engineer will determine if normal production may resume based upon the CSI for the limited production lot and any adjustments to the equipment, placement methods, and/or personnel performing the work. Once on limited production, the Engineer may require the Contractor to evaluate the smoothness of the previous asphalt layer and take appropriate action to reduce and/or eliminate corrective measures on the final surface course. Additionally, the Contractor may be required to demonstrate acceptable laydown techniques off the project limits prior to proceeding on the project.

If the Contractor fails to achieve satisfactory laydown results after three consecutive 2500 foot (750 meter) sections have been attempted, cease production of that mix type until such time as the cause of the unsatisfactory laydown results can be determined.

As an exception, the Engineer may grant approval to produce a different mix design of the same mix type if the cause is related to mix problem(s) rather than laydown procedures. If production of a new mix design is allowed, proceed under the limited production procedures detailed above.

If the Contractor does not operate by the limited production procedures as specified above, the 5 lots, which require corrective action, will be considered unacceptable and may be subject to removal and replacement. Mix placed under the limited production procedures for unsatisfactory laydown will be evaluated for acceptance in accordance with Article 105-3.

After initially proceeding under limited production, the Contractor shall immediately notify the Engineer if any additional lot on the project requires corrective action. The Engineer will determine if limited production procedures are warranted for continued production.

The pay adjustment schedule for the Cumulative Straightedge Index (CSI) test results per lot is as follows:

<b>Pay Adjustment Schedule for Cumulative Straightedge Index (CSI)</b> (Obtained by adding SE Index of up to 25 consecutive 100 ft. (30m) sections)				
*CSI	<u>ACCEPTANCE</u>  <u>CATEGORY</u>	<u>CORRECTIVE</u>  <u>ACTION</u>	<u>PAY ADJUSTMENT</u>	
			<b>Before Corrective Action</b>	<b>After Corrective Action</b>
0-0	Acceptable	None	\$300 incentive	None
1-0 or 2-0	Acceptable	None	\$100 incentive	None
3-0 or 4-0	Acceptable	None	No Adjustment	No Adjustment
1-1, 2-1, 5-0 or 6-0	Acceptable	Allowed	\$300 disincentive	\$300 disincentive
3-1, 4-1, 5-1 or 6-1	Acceptable	Allowed	\$600 disincentive	\$600 disincentive
Any other Number	Unacceptable	Required	Per CSI after Correction(s) (not to exceed 100% Pay)	

**\*Either Before or After Corrective Actions**

Correct any deviation that exceeds a 0.4 inch (10 mm) blanking band such that the deviation is reduced to 0.3 inches (7.5 mm) or less.

Corrective actions shall be performed at the Contractor's expense and shall be presented for evaluation and approval by the Engineer prior to proceeding. Any corrective action performed shall not reduce the integrity or durability of the pavement which is to remain in place. Corrective action for deviation repair may consist of overlaying, removing and replacing, indirect heating and rerolling. Scraping of the pavement with any blade type device will not be allowed as a corrective action. Provide overlays of the same type mix, full roadway width, and to the length and depth established by the Engineer. Tapering of the longitudinal edges of the overlay will not be allowed.

Corrective actions will not be allowed for lots having a CSI of 40 or better. If the CSI indicates "Allowed" corrective action, the Contractor may elect to take necessary measures to reduce the CSI in lieu of accepting the disincentive. Take corrective actions as specified if the CSI indicates "Required" corrective action. The CSI after corrective action should meet or exceed "Acceptable" requirements.

Where corrective action is allowed or required, the test section(s) requiring corrective action will be retested, unless the Engineer directs the retesting of the of the entire lot. No disincentive will apply after corrective action if the CSI is 40 or better. If the retested lot after corrective action has a CSI indicating a disincentive, the appropriate disincentive will be applied.

Incentive pay adjustments will be based only on the initially measured CSI, as determined by the Engineer, prior to any corrective work. Where corrective actions have been taken, payment will be based on the CSI determined after correction, not to exceed 100 percent payment.

Areas excluded from testing by the N.C. Hearne Straightedge will be tested by using a non-mobile 10-foot (3 m) straightedge. Assure that the variation of the surface from the testing edge of the straightedge between any two contact points with the surface is not more than 1/8 inch (3 mm). Correct deviations exceeding the allowable tolerance in accordance with the corrective actions specified above, unless the Engineer permits other corrective actions.

Furnish the North Carolina Hearne Straightedge(s) necessary to perform this work. Maintain responsibility for all costs relating to the procurement, handling, and maintenance of these devices. The Department has entered into a license agreement with a manufacturer to fabricate, sell, and distribute the N.C. Hearne Straightedge. The Department's Pavement Construction Section may be contacted for the name of the current manufacturer and the approximate price of the straightedge.

No direct payment will be made for the work covered by this section. Payment at the contract unit prices for the various items covered by those sections of the specifications directly applicable to the work constructed will be full compensation for all work covered by this section including, but not limited to, performing testing in accordance with this specification, any corrective work required as a result of this testing and any additional traffic control as may be necessary.

SP6R45

**CONSTRUCTION SURVEYING:**

**01-20-04**

Add the following after the first sentence of Section 801-1 of the January 2002 Standard Specifications:

Provide a stakeout of areas where an environmental permit is required prior to performing any construction in or adjacent to these areas. Stake out limits of the permitted work areas according to the approved permit drawings. Provide clear delineation by use of pink or other highly visible flagging. Insure construction limits do not exceed approved permitted work areas. Immediately notify the Resident Engineer of any variations of the stakeout limits when compared to the approved permit drawings.

Replace the fifth paragraph of Section 801-4 of the January 2002 Standard Specifications with the following:

Partial payments for the item of "Construction Surveying" will be made on each particular payment estimate based upon the percentage complete of the item of "Construction Surveying" as determined by the Engineer. The Contractor is required to submit a certified statement each month indicating the percentage of "Construction Surveying" work completed. The Resident Engineer will determine if the amount indicated is reasonably correct and the Resident Engineer will pay accordingly on the next partial pay estimate.

SP8R02

**DISPOSAL OF WASTE AND DEBRIS:**

**2-19-02**

Revise the 2002 Standard Specifications as follows:

**Page 8-9, Subarticle 802-2(7. Buffer Zones:)**

At the end of the last sentence in this subarticle, add the words "unless superseded by an environmental permit."

SP8R03

**MODIFIED CONCRETE FLUME WITH CONCRETE OUTLET:**

**3-19-96**

At locations shown in the plans, construct concrete flumes, 6" x 8" (150 mm x 200 mm) concrete curb, and apron in accordance with the details in the plans. Use materials meeting the requirements of Section 825 of the Standard Specifications except that the concrete must be Class "B" or of higher compressive strength.

Each concrete flume, 6" x 8" (150 mm x 200 mm) concrete curb, and apron completed and accepted will be paid for at the contract unit price per each for "Modified Concrete Flume". Such price and payment will be full compensation for all materials, labor, equipment, tools, removing and disposing of the temporary slope drains, and any other incidentals necessary to complete the work satisfactorily.

The concrete curb and ditch outside the pay limits of the apron will be measured and paid for in accordance with Section 846 and 850 of the Standard Specifications.

SP8R10

Payment will be made under:

Modified Concrete Flume.....Each

**ENDWALLS:**

**6-18-02**

Revise the 2002 Standard Specifications as follows:

Page 8-24, Article 838-2

Delete the last two paragraphs of this article and insert the following:

"Use either portland concrete, brick masonry, or precast concrete for the endwall unless otherwise specified on the Drainage Summary Sheet of the Plans."

SP8R27

**GUARDRAIL POSTS AND OFFSET BLOCKS:**

06-22-04

Revise the *2002 Standard Specifications* as follows:

Page 10-69, Subarticle 1046-3

Delete this sub-article in its entirety and replace with the following:

**1046-3 POSTS AND OFFSET BLOCKS.****(A) General:**

The Contractor may at his option furnish either of the following types of steel guardrail posts. Only one type of post will be permitted at any one continuous installation. Use structural steel posts throughout the project, unless otherwise directed or detailed in the plans.

1. Steel W6 x 8.5 or W6 x 9.0 posts
2. Steel 4.5" x 6.0" "C" shape posts (C150 x 12.2 kg/m)

The Contractor may at his option furnish either of the following types of treated timber posts if specifically directed or detailed in the plans. Only one type of post will be permitted at any one continuous installation.

1. Timber 6" x 8" (152 mm x 203 mm) posts.
2. Timber 8" x 8" (203 mm x 203 mm) posts.

**(B) Structural Steel Posts:**

Fabricate steel posts for guardrail of the size and weight shown on the plans from structural steel complying with the requirements of Section 1072. Metal from which C shape posts are fabricated shall meet the requirements of ASTM A570 for any grade of steel, except that mechanical requirements shall meet the requirements of ASTM A36. Punch or drill the holes for connecting bolts. Burning will not be permitted. After fabrication, the posts shall be galvanized in accordance with Section 1076.

**(C) Treated Timber Posts:**

Timber guardrail posts shall be of treated southern pine meeting the requirements of Article 1082-2 and 1082-3.

Bore bolt holes to a driving fit for the bolts. A minus tolerance of 1 percent will be allowed in the length of the post. Perform all framing and boring before the posts receive preservative treatment.

**(D) Offset Blocks:**

Provide 8-inch deep recycled plastic or composite offset blocks that have been approved for use with the guardrail shown in the standard drawings and/or plans. Only one type of offset block will be permitted at any one continuous installation. Prior to beginning the installation of recycled offset block, submit the FHWA acceptance letter for each type of block to the Engineer for approval.

Treated timber offset blocks with steel beam guardrail will not be allowed unless required by Specifications, directed by the Engineer or detailed in the plans. Steel offset blocks with steel beam guardrail will not be allowed.

Recycled plastic or composite offset blocks shall be made from no less than 50% recycled plastic or composite, and shall meet the following minimum requirements:

- Specific Gravity: ..... 0.950
- Compressive Strength in Lateral Direction:..... 1600 psi (11 MPa)
- Maximum Water Absorption: ..... 10% by weight
- Maximum Termite and Ant Infestation:..... 10%
- Testing..... Shall pass NCHRP Report 350, Test Level 3 by CRASH TESTING

Revise the *2002 Standard Roadway Drawings* as follows:

Sheet 4 of 6, Standard 862.03, delete the note and substitute the following:

Note: The midpost and offset block of the WTR section will require special bolt hole drilling in the thrie beam offset block and line post.

SP8R57

**GUARDRAIL ANCHOR UNITS, TYPE M-350:**

**04-20-04**

**DESCRIPTION**

Furnish and install guardrail anchor units in accordance with the details in the plans, the applicable requirements of Section 862 of the Standard Specifications, and at locations shown in the plans.

**MATERIALS**

The Contractor may, at his option, furnish any one of the following guardrail anchor units.

The guardrail anchor unit (SRT-350) as manufactured by:

TRINITY INDUSTRIES, INC.  
 2525 N. STEMMONS FREEWAY  
 DALLAS, TEXAS 75207  
 TELEPHONE: 1-800-644-7976

The guardrail anchor unit (FLEAT) as manufactured by:

ROAD SYSTEMS, INC.  
1507 EAST 4TH STREET  
BIG SPRINGS, TEXAS 79720  
TELEPHONE: 915-263-2435

The guardrail anchor unit (REGENT) as manufactured by:

ENERGY ABSORPTION SYSTEMS, INC.  
ONE EAST WACKER DRIVE  
CHICAGO, ILLINOIS 60601-2076  
TELEPHONE: 312-467-6750

Prior to installation the Contractor shall submit to the Engineer:

1. FHWA acceptance letter for each guardrail anchor unit certifying it meets the requirements of NCHRP Report 350, Test Level 3, in accordance with Section 106-2 of the Standard Specifications.
2. Certified working drawings and assembling instructions from the manufacturer for each guardrail anchor unit in accordance with Section 105-2 of the Specifications.

No modifications shall be made to the guardrail anchor unit without the express written permission from the manufacturer. Perform installation in accordance with the details in the plans, and details and assembling instructions furnished by the manufacturer.

**CONSTRUCTION**

Guardrail end delineation is required on all approach and trailing end sections for both temporary and permanent installations. Guardrail end delineation consists of yellow reflective sheeting applied to the entire end section of the guardrail in accordance with Section 1088-3 of the Standard Specifications and is incidental to the cost of the guardrail anchor unit.

**MEASUREMENT AND PAYMENT**

Measurement and payment will be made in accordance with Articles 862-5 and 862-6 of the Standard Specifications.

Payment will be made under:

Guardrail Anchor Units, Type M-350..... Each

SP8R60



**GUARDRAIL ANCHOR UNITS, TYPE 350:****04-20-04****DESCRIPTION**

Furnish and install guardrail anchor units in accordance with the details in the plans, the applicable requirements of Section 862 of the Standard Specifications, and at locations shown in the plans.

**MATERIALS**

The Contractor may at his option, furnish any one of the guardrail anchor units.

Guardrail anchor unit (ET-2000) as manufactured by:

TRINITY INDUSTRIES, INC.  
2525 N. STEMMONS FREEWAY  
DALLAS, TEXAS 75207  
TELEPHONE: 1-800-644-7976

The guardrail anchor unit (SKT 350) as manufactured by:

ROAD SYSTEMS, INC.  
3616 OLD HOWARD COUNTY AIRPORT  
BIG SPRING, TEXAS 79720  
TELEPHONE: (915) 263-2435

Prior to installation the Contractor shall submit to the Engineer:

1. FHWA acceptance letter for each guardrail anchor unit certifying it meets the requirements of NCHRP Report 350, Test Level 3, in accordance with Section 106-2 of the Standard Specifications.
2. Certified working drawings and assembling instructions from the manufacturer for each guardrail anchor unit in accordance with Section 105-2 of the Specifications.

No modifications shall be made to the guardrail anchor unit without the express written permission from the manufacturer. Perform installation in accordance with the details in the plans, and details and assembling instructions furnished by the manufacturer.

**CONSTRUCTION**

Guardrail end delineation is required on all approach and trailing end sections for both temporary and permanent installations. Guardrail end delineation consists of yellow reflective sheeting applied to the entire end section of the guardrail in accordance with Section 1088-3 of the Standard Specifications and is incidental to the cost of the guardrail anchor unit.

**MEASUREMENT AND PAYMENT**

Measurement and payment will be made in accordance with Articles 862.5 and 862-6 of the Standard Specifications.

Payment will be made under:

Guardrail Anchor Units, Type 350..... Each

SP8R65

**IMPACT ATTENUATOR UNITS, TYPE 350:**

**04-20-04**

**DESCRIPTION**

Furnish and install impact attenuator units and any components necessary to connect the impact attenuator units in accordance with the manufacturer’s requirement, the details in the plans and at locations shown in the plans.

**MATERIALS**

**NON-GATING IMPACT ATTENUATOR UNITS:**

The impact attenuator unit (QUADGUARD) as manufactured by:

ENERGY ABSORPTION SYSTEMS, INC.  
ONE EAST WACKER DRIVE  
CHICAGO, ILLINOIS 60601-2076  
TELEPHONE: 312-467-6750

The impact attenuator unit (TRACC) as manufactured by:

TRINITY INDUSTRIES, INC.  
2525 N. STEMMONS FREEWAY  
DALLAS, TEXAS 75207  
TELEPHONE: 1-800-644-7976

**GATING IMPACT ATTENUATOR UNITS:**

The impact attenuator unit (BRAKEMASTER) as manufactured by:

ENERGY ABSORPTION SYSTEMS, INC.  
ONE EAST WACKER DRIVE  
CHICAGO, ILLINOIS 60601-2076  
TELEPHONE: 312-467-6750

The impact attenuator unit (CAT) as manufactured by:

TRINITY INDUSTRIES, INC.  
2525 N. STEMMONS FREEWAY  
DALLAS, TEXAS 75207  
TELEPHONE: 1-800-644-7976

Prior to installation the Contractor shall submit to the Engineer:

1. FHWA acceptance letter for each impact attenuator unit certifying it meets the requirements of NCHRP Report 350, Test Level 3, in accordance with Section 106-2 of the Standard Specifications.
2. Certified working drawings and assembling instructions from the manufacturer for each impact attenuator unit in accordance with Section 105-2 of the Specifications.

No modifications shall be made to the impact attenuator unit without the express written permission from the manufacturer. Perform installation in accordance with the details in the plans, and details and assembling instructions furnished by the manufacturer.

**CONSTRUCTION METHODS**

If the median width is 40 feet (12.2 meters) or less, the Contractor must supply one of the NON-GATING Impact Attenuator Units listed in the Materials Section herein.

If the median width is greater than 40 feet (12.2 meters), the Contractor may use any of the GATING or NON-GATING Impact Attenuator Units listed in the Materials Section herein.

**MEASUREMENT AND OF PAYMENT**

Impact attenuator units will be measured and paid for at the contract unit price per each for "Impact Attenuator Unit, Type 350". Such prices and payment will be full compensation for all work covered by this provision including but not limited to furnishing, installing and all incidentals necessary to complete the work.

Payment will be made under:

Impact Attenuator Unit, Type 350 ..... Each

SP8R75

**PREFORMED SCOUR HOLE WITH LEVEL SPREADER APRON: 10-15-02**

Description:

Construct and maintain preformed scour holes with spreader aprons at the locations shown on the plans and in accordance with the details in the plans. Work includes excavation, shaping and maintaining the hole and apron, furnishing and placing filter fabric, rip rap (class as specified in the plans) and permanent soil reinforcement matting.

Materials:

Materials shall meet the requirements of Division 10 and this provision:

- Plain rip rap.....Article 1042
- Filter Fabric.....Article 1042-2

The permanent soil reinforcement matting shall be permanent erosion control reinforcement mat and shall be constructed of 100% coconut fiber stitch bonded between a heavy duty UV stabilized cusped (crimped) netting overlaid with a heavy duty UV stabilized top net. The three nettings shall be stitched together on 1.5 inch (38 mm) centers UV stabilized polyester thread to form a permanent three dimensional structure. The mat shall have the following physical properties:

Property	Test Method	Value	Unit
Ground Cover	Image Analysis	93	%
Thickness	ASTM D1777	0.63 (16)	in (mm)
Mass Per Unit Area	ASTM D3776	0.92 (0.50)	lb/sy (kg/m <sup>2</sup> )
Tensile Strength	ASTM D5035	480 (714.2)	lb/ft (kg/m)
Elongation	ASTM D5035	49	%
Tensile Strength	ASTM D5035	960 (1428.5)	lb/ft (kg/m)
Elongation	ASTM D5035	31	%
Tensile Strength	ASTM D1682	177 (80.3)	lbs (kg)
Elongation	ASTM D1682	22	%
Resiliency	ASTM D1777	>80	%
UV Stability *	ASTM D4355	151 (68.5)	lbs (kg)
Color(Permanent Net)		UV Black	
Porosity (Permanent Net)	Calculated	>95	%
Minimum Filament Diameter (permanent net)	Measured	0.03 (0.8)	in (mm)

\*ASTM D1682 Tensile Strength and % strength retention of material after 1000 hours of exposure in a Xenon-arc weatherometer.

A certification (Type 1, 2, or 3) from the manufacturer showing:

- 1) the chemical and physical properties of the mat used, and
- 2) conformance of the mat with this specification will be required.

**Soil Preparation:**

All areas to be protected with the mat shall be brought to final grade and seeded in accordance with Section 1660. The surface of the soil shall be smooth, firm, stable and free of rocks, clods, roots or other obstructions which would prevent the mat from lying in direct contact with the soil surface. Areas where the mat is to be placed will not need to be mulched.

**Measurement:**

The quantity of "Preformed Scour Holes with Level Spreader Aprons" to be paid for shall be the actual number which have been incorporated into the completed and accepted work.

**Basis of Payment:**

The quantity of scour holes with spreader aprons, measured as provided above, will be paid for at the contract unit price each for "Preformed Scour Hole with Level Spreader Apron." Such price and payment will be full compensation for all work covered by this provision.

SP8R105

**STREET SIGNS AND MARKERS AND ROUTE MARKERS:****7-1-95**

Move any existing street signs, markers, and route markers out of the construction limits of the project and install the street signs and markers and route markers so that they will be visible to the traveling public if there is sufficient right of way for these signs and markers outside of the construction limits.

Near the completion of the project and when so directed by the Engineer, move the signs and markers and install them in their proper location in regard to the finished pavement of the project.

Stockpile any signs or markers that cannot be relocated due to lack of right of way, or any signs and markers that will no longer be applicable after the construction of the project, at locations directed by the Engineer for removal by others.

The Contractor will be responsible to the owners for any damage to any street signs and markers or route markers during the above described operations.

No direct payment will be made for relocating, reinstalling, and/or stockpiling the street signs and markers and route markers as such work will be considered incidental to other work being paid for by the various items in the contract.

SP9R01

**AGGREGATE PRODUCTION:**

11-20-01

Provide aggregate from a producer who utilizes the new Aggregate Quality Control/Quality Assurance Program that is in effect at the time of shipment.

No price adjustment is allowed to contractors or producers who utilize the new program. Participation in the new program does not relieve the producer of the responsibility of complying with all requirements of the Standard Specifications. Copies of this procedure are available upon request from the Materials and Test Unit.

SP10R05

**CONCRETE BRICK AND BLOCK PRODUCTION:**

11-20-01

Provide concrete brick and block from a producer who utilizes the new Solid Concrete Masonry Brick/Unit Quality Control/Quality Assurance Program that is in effect on the date that material is received on the project.

No price adjustment is allowed to contractors or producers who utilize the new program. Participation in the new program does not relieve the producer of the responsibility of complying with all requirements of the Standard Specifications. Copies of this procedure are available upon request from the Materials and Test Unit.

SP10R10

**FINE AGGREGATE:**

11-19-02

Revise the 2002 Standard Specifications as follows:

Page 10-17, Table 1005-2

Make the following change to the table:

For Standard Size 2MS the following gradation change applies.

The minimum percent shown for material passing the No. 8 (2.36mm) sieve has been changed from 84 to **80**.

SP10R15

**BORROW MATERIAL**

02-17-04

Revise the 2002 Standard Specifications as follows:

Page 10-44

Section 1018-2 II (b) Delete the last sentence in its entirety.

SP10R17

**METAL POSTS AND RAILS:**01-21-03<sub>R</sub>

Revise the 2002 Standard Specifications as follows:

**1050-3 METAL POSTS AND RAILS.**

**Page 10-72, (A) Chain Link Fence: Delete paragraphs 2 and 3, and replace with the following:**

Steel H posts must have a minimum yield strength of 45,000 pi (310 MPa) and weigh 3.26 pounds per foot (4.85 kg/m). Galvanize steel H posts in accordance with ASTM F 1043 with a Type A coating. Aluminum H posts must weigh 1.25 pounds per foot (1.86 kg/m).

Roll formed steel line posts must be a 1.625" x 1.875" (41.3 mm x 47.6 mm) section weighing 2.40 lb/lf (3.57 kg/m) after galvanizing and be formed from 0.121" (3.1 mm) thick sheet having a minimum yield strength of 45,000 psi (310 MPa). Roll formed steel brace rails and top rails must be a 1.250" x 1.625" (31.8 mm x 41.3 mm) section weighing 1.35 lb/lf (2.01 kg/m) after galvanizing and be formed from 0.080" (2.0 mm) thick sheet steel having a minimum yield strength of 45,000 pi (310 Map). Galvanize all roll formed members after fabrication in accordance with ASTM F 1043 with a Type A coating.

**Page 10-73, (A) Chain Link Fence: Delete sentence one of paragraph four and replace with the following:**

Vinyl coated posts must be pipe posts meeting the requirements of AASHTO M 181, and have a fusion bonded vinyl coating of at least 6 mils (0.15 mm) thick.

Add the following as the penultimate paragraph:

For pipe 1.90" OD and under, the outside diameter at any point shall not vary more than 1/64" (0.4 mm) over nor more than 1/32" (0.8 mm) under the standard specified. For pipe 2.375" OD and over, the outside diameter shall not vary more than  $\pm 1\%$  from the standard specified nor shall the minimum wall thickness at any point be more than 12.5% under the nominal wall thickness specified.

**Page 10-73 (B) Woven Wire Fence: Add the following as the penultimate paragraph:**

For pipe 1.90" OD and under, the outside diameter at any point shall not vary more than 1/64" (0.4 mm) over nor more than 1/32" (0.8 mm) under the standard specified. For pipe 2.375" OD and over, the outside diameter shall not vary more than  $\pm 1\%$  from the standard specified nor shall the minimum wall thickness at any point be more than 12.5% under the nominal wall thickness specified.

**1050-7 FITTINGS AND ACCESSORIES**

Page 10-75, delete the last sentence of the last paragraph and replace with the following:  
The vinyl coating must be at least 6 mils (0.15 mm) thick, except that the coating on tension wire, hog rings, and tie wires must be at least 20 mils (0.50 mm) thick.

SP10R20

**COATED, PAVED AND LINED CORRUGATED STEEL CULVERT PIPE:** 10-21-03

Revise the 2002 Standard Specifications as follows:

**Section 1032-4(E) Optional Coatings for Bituminous Coated Pipe and Pipe Arch:**

Page 10-58. Delete Numbers 2. and 3., and substitute the following;

2. Type B: In lieu of Type B, Half Bituminous Coated and Partially Paved galvanized pipe, aluminized pipe or polymeric coated pipe without bituminous coating and paving may be used.
3. Type C: In lieu of Type C, Fully Bituminous Coated and Partially Paved galvanized pipe, aluminized pipe or polymeric coated pipe without a bituminous coating and paving may be used.

SP10R25

**DRUMS:**

07-16-02

Revise the 2002 Standard Specifications as follows:

Page 10-195, Subarticle 1089-5(C)

Delete the first (1<sup>st</sup>) sentence of the first (1<sup>st</sup>) paragraph and insert the following:

“Provide a minimum of three orange and two white alternating horizontal circumferential stripes covering the entire outside with each drum.”

SP11R05

**PAVEMENT MARKING GENERAL REQUIREMENTS:**

07-16-02

Revise the 2002 Standard Specifications as follows:

Page 12-10, Subarticle 1205-3(J)

Delete the first (1<sup>st</sup>) sentence of the first (1<sup>st</sup>) paragraph and insert the following:



“Have at least one member of every pavement marking crew working on a project certified through the NCDOT Pavement Marking Technician Certification Process. For more information contact the Traffic Control, Marking and Delineation Section of the North Carolina Department of Transportation at 919-250-4151 or <http://www.doh.dot.state.nc.us/preconstruct/traffic/congestion/TC/>”

SP12R01

**PERMANENT SEEDING AND MULCHING:**

**07-01-95**

The Department desires that permanent seeding and mulching be established on this project as soon as practical after slopes or portions of slopes have been graded. As an incentive to obtain an early stand of vegetation on this project, the Contractor's attention is called to the following:

For all permanent seeding and mulching that is satisfactorily completed in accordance with the requirements of Section 1660, "Seeding and Mulching", and within the following percentages of elapsed contract times, an additional payment will be made to the Contractor as an incentive additive. The incentive additive will be determined by multiplying the number of acres of seeding and mulching satisfactorily completed times the contract unit bid price per acre for "Seeding and Mulching" times the appropriate percentage additive.

<u>Percentage of Elapsed Contract Time</u>	<u>Percentage Additive</u>
0% - 30%	30%
30.01% - 50%	15%

Percentage of elapsed contract time is defined as the number of calendar days from the date of availability of the contract to the date the permanent seeding and mulching is acceptably completed divided by the total original contract time.

SP16R01