



-Y2-

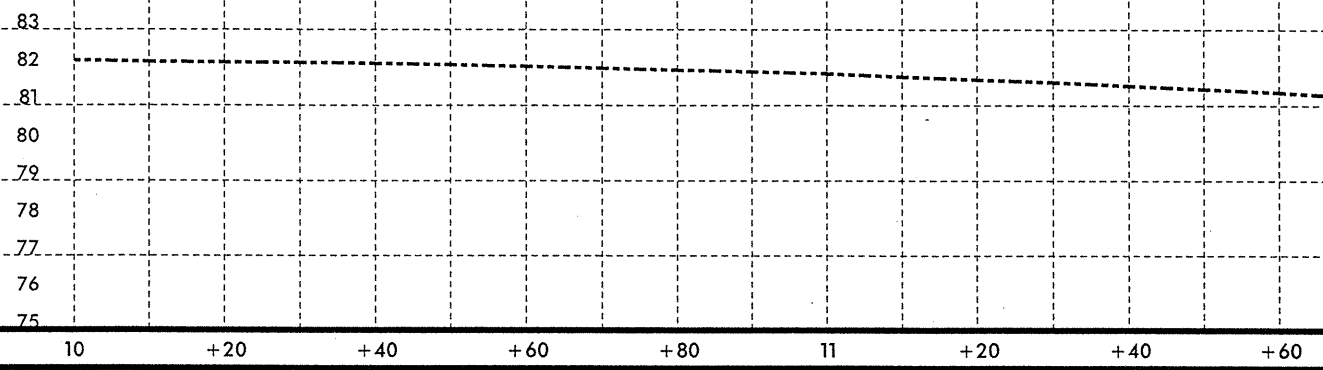

-Y3REV-

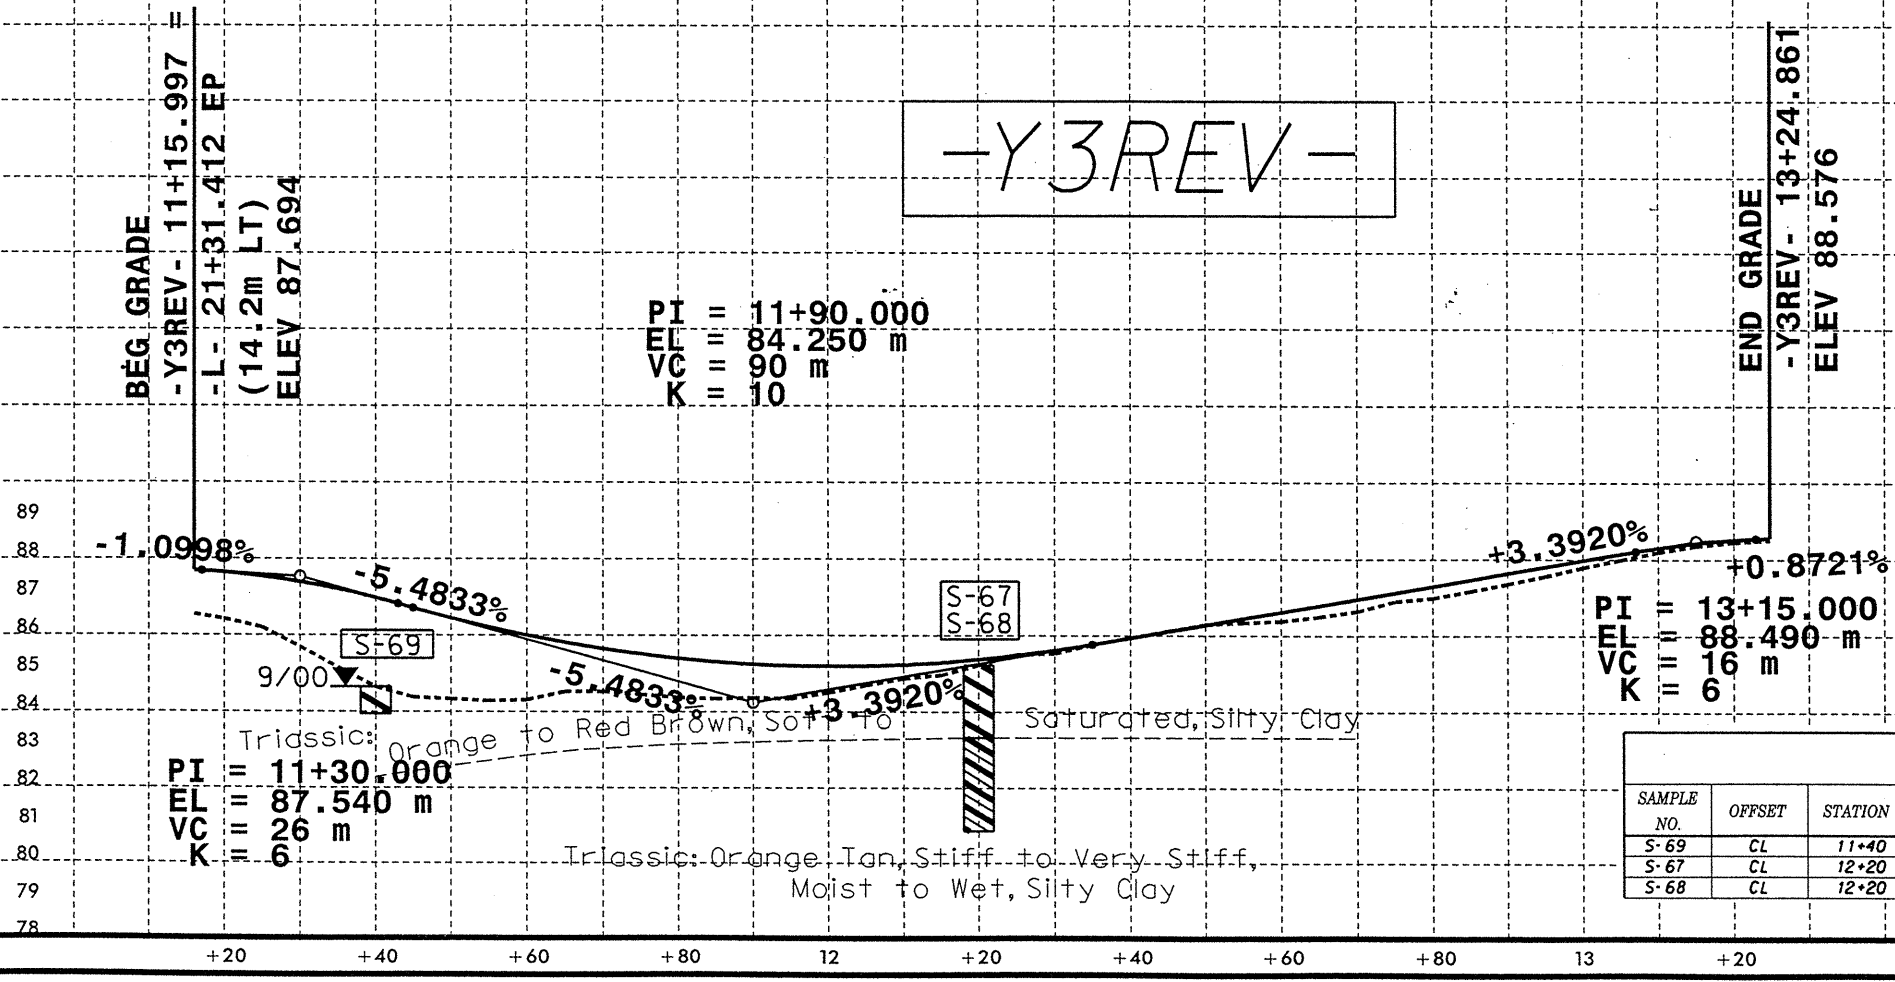

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
S-69	CL	11+40	0.10-0.70	A-7-6(29)	51	30	3.7	5.3	35.5	55.4	96	93	90	-	-
S-67	CL	12+20	0.45-1.90	A-7-6(51)	72	43	0.2	1.8	22.0	76.0	100	100	99	-	-
S-68	CL	12+20	1.90-4.35	A-6(13)	36	13	2.9	2.9	51.1	43.1	100	98	95	-	-

*****SYTIME*****
*****PRINTED ON 11/15/00*****