


PROJECT REFERENCE NO. U-0620	SHEET NO. UC-11
DESIGNED BY: DMP	
DRAWN BY: DMP	
CHECKED BY: DMP	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
DESIGN SERVICES UNIT PHONE: (919) 250-4128 FAX: (919) 250-4119	UTILITY CONSTRUCTION PLANS ONLY

UTILITY CONSTRUCTION

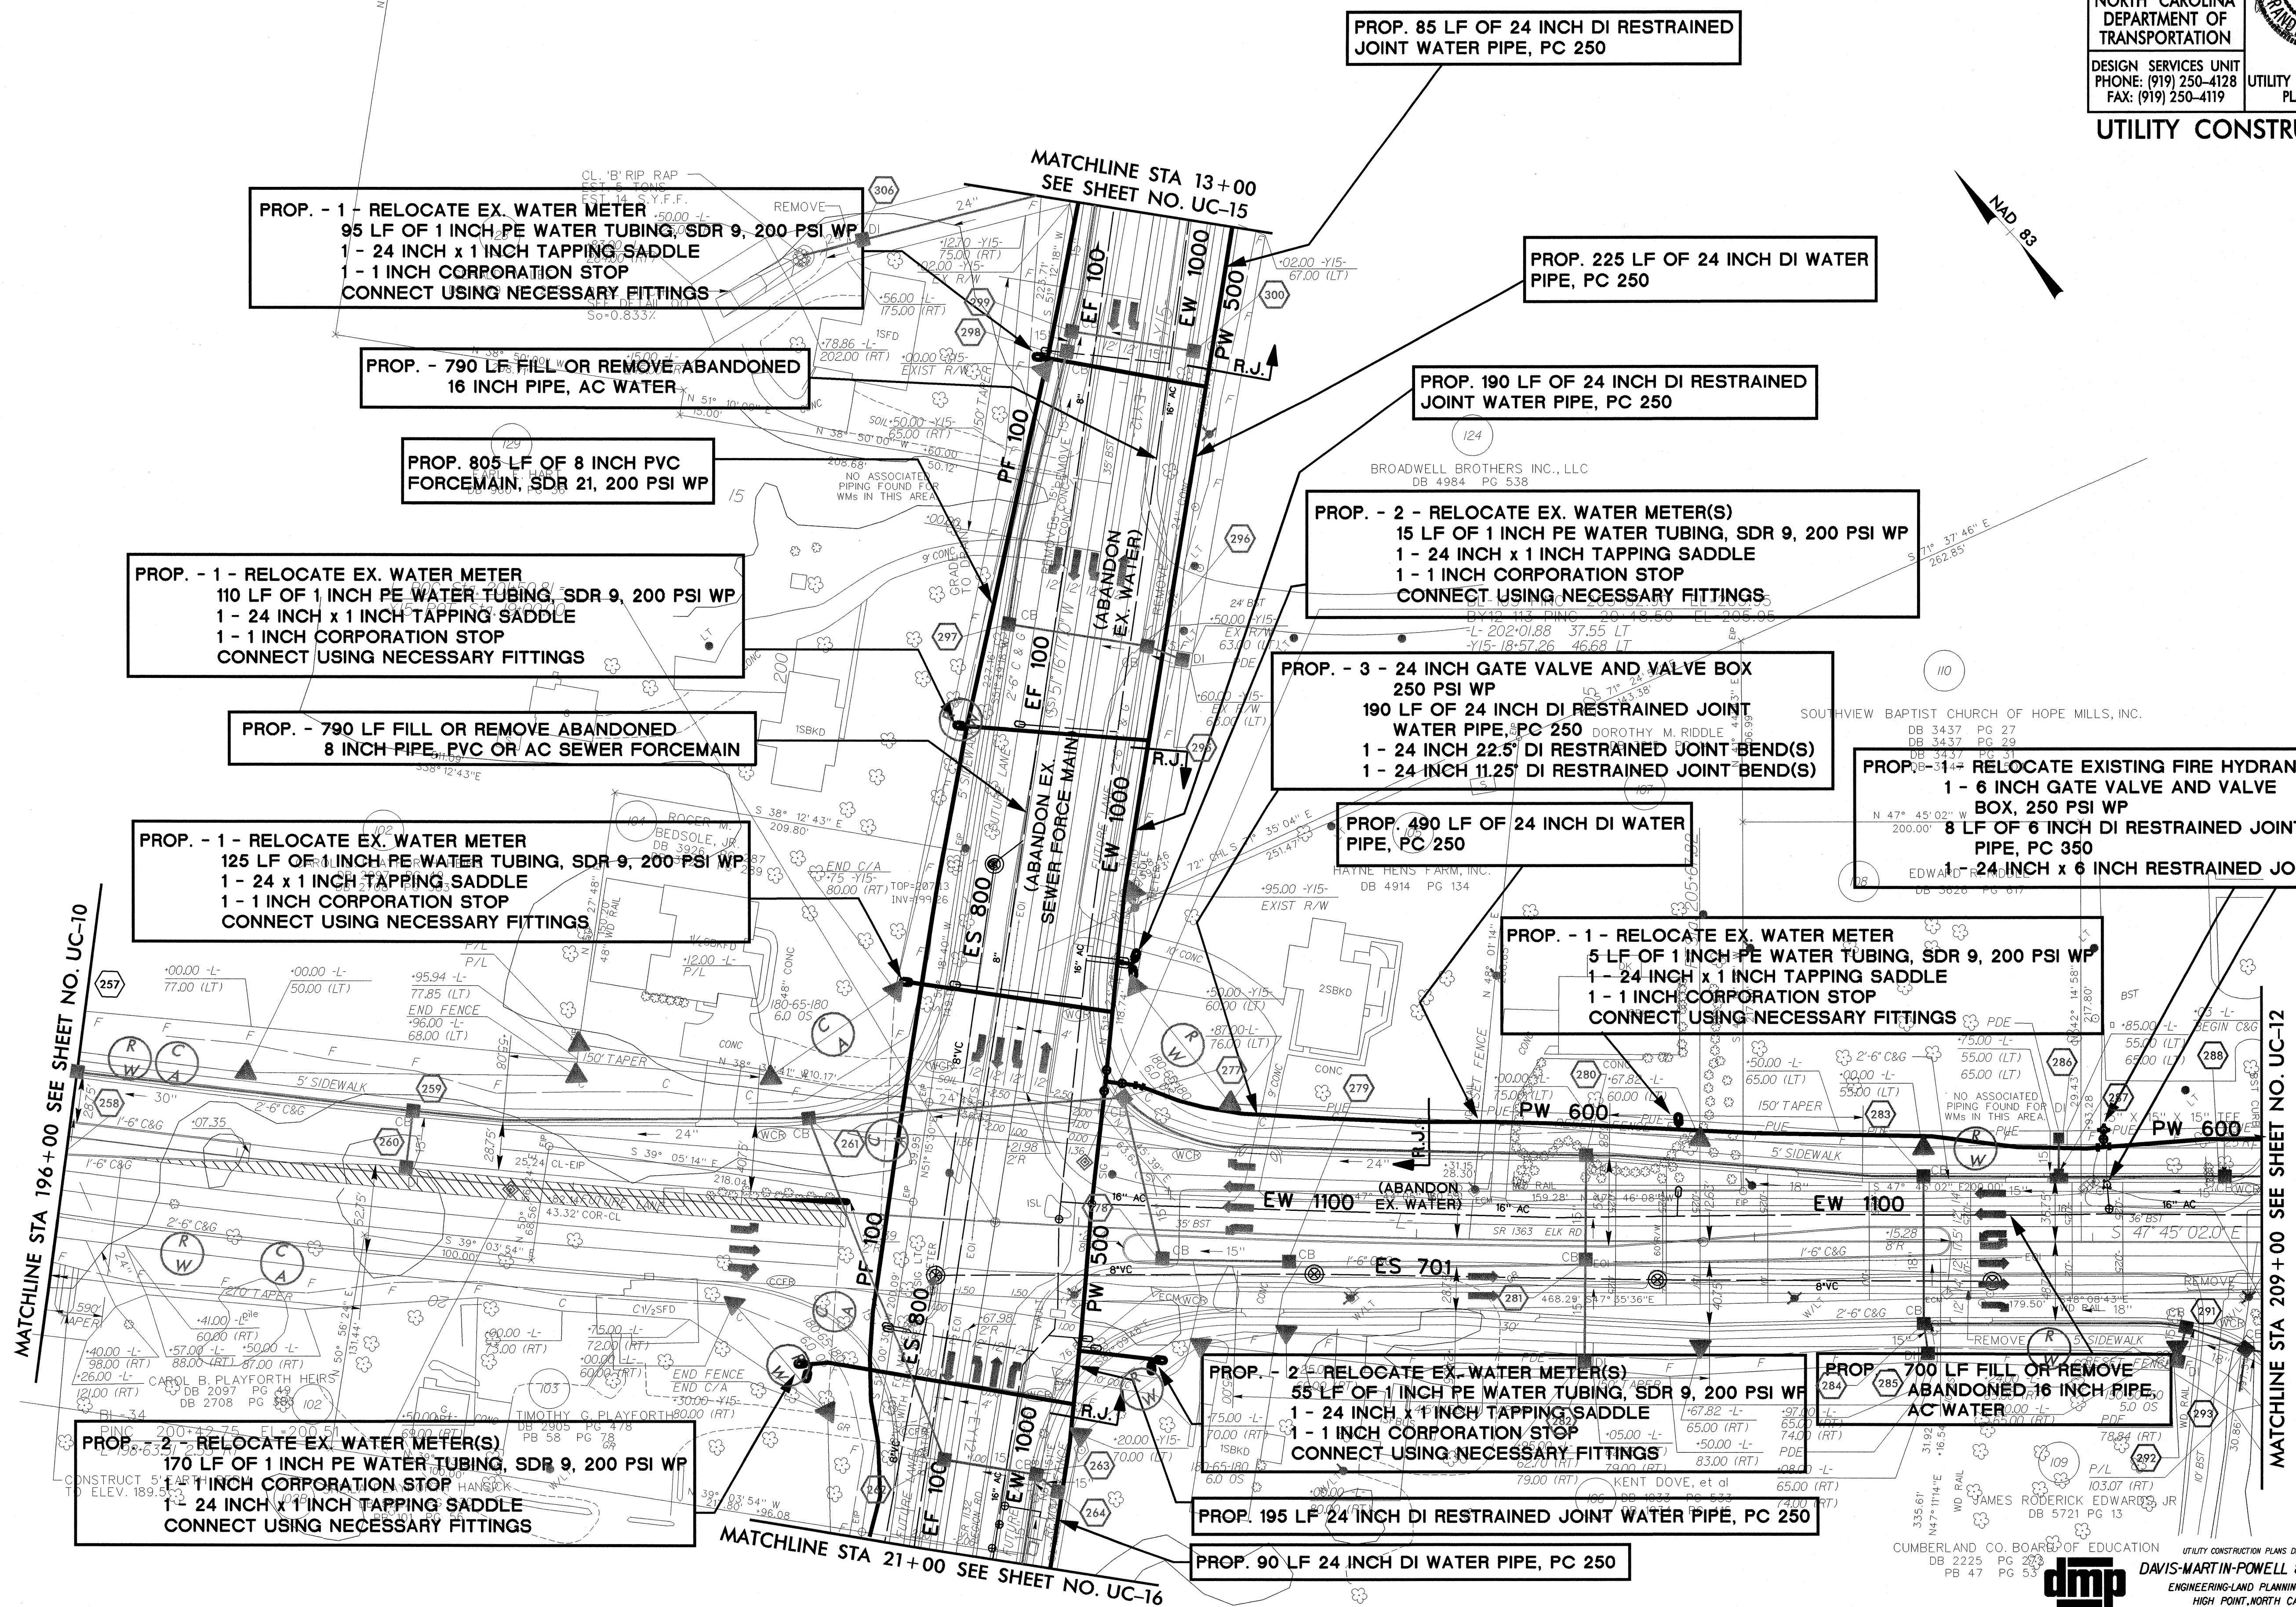

PROP. - 1 - RELOCATE EX. WATER METER
 95 LF OF 1 INCH PE WATER TUBING, SDR 9, 200 PSI WP
 1 - 24 INCH x 1 INCH TAPPING SADDLE
 1 - 1 INCH CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. - 790 LF FILL OR REMOVE ABANDONED
 16 INCH PIPE, AC WATER

PROP. 805 LF OF 8 INCH PVC
 FORCEMAIN, SDR 21, 200 PSI WP

PROP. - 1 - RELOCATE EX. WATER METER
 110 LF OF 1 INCH PE WATER TUBING, SDR 9, 200 PSI WP
 1 - 24 INCH x 1 INCH TAPPING SADDLE
 1 - 1 INCH CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. - 790 LF FILL OR REMOVE ABANDONED
 8 INCH PIPE, PVC OR AC SEWER FORCEMAIN

PROP. - 1 - RELOCATE EX. WATER METER
 125 LF OF 1 INCH PE WATER TUBING, SDR 9, 200 PSI WP
 1 - 24 x 1 INCH TAPPING SADDLE
 1 - 1 INCH CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. 85 LF OF 24 INCH DI RESTRAINED
 JOINT WATER PIPE, PC 250

PROP. 225 LF OF 24 INCH DI WATER
 PIPE, PC 250

PROP. 190 LF OF 24 INCH DI RESTRAINED
 JOINT WATER PIPE, PC 250

PROP. - 2 - RELOCATE EX. WATER METER(S)
 15 LF OF 1 INCH PE WATER TUBING, SDR 9, 200 PSI WP
 1 - 24 INCH x 1 INCH TAPPING SADDLE
 1 - 1 INCH CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. - 3 - 24 INCH GATE VALVE AND VALVE BOX
 250 PSI WP
 190 LF OF 24 INCH DI RESTRAINED JOINT
 WATER PIPE, PC 250
 1 - 24 INCH 22.5" DI RESTRAINED JOINT BEND(S)
 1 - 24 INCH 11.25" DI RESTRAINED JOINT BEND(S)

PROP. 490 LF OF 24 INCH DI WATER
 PIPE, PC 250

PROP. - 1 - RELOCATE EXISTING FIRE HYDRANT
 1 - 6 INCH GATE VALVE AND VALVE
 BOX, 250 PSI WP
 8 LF OF 6 INCH DI RESTRAINED JOINT WATER
 PIPE, PC 350
 1 - 24 INCH x 6 INCH RESTRAINED JOINT TEE

PROP. - 1 - RELOCATE EX. WATER METER
 5 LF OF 1 INCH PE WATER TUBING, SDR 9, 200 PSI WP
 1 - 24 INCH x 1 INCH TAPPING SADDLE
 1 - 1 INCH CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. - 2 - RELOCATE EX. WATER METER(S)
 170 LF OF 1 INCH PE WATER TUBING, SDR 9, 200 PSI WP
 1 - 1 INCH CORPORATION STOP
 1 - 24 INCH x 1 INCH TAPPING SADDLE
 CONNECT USING NECESSARY FITTINGS

PROP. - 2 - RELOCATE EX. WATER METER(S)
 55 LF OF 1 INCH PE WATER TUBING, SDR 9, 200 PSI WP
 1 - 24 INCH x 1 INCH TAPPING SADDLE
 1 - 1 INCH CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. 700 LF FILL OR REMOVE
 ABANDONED 16 INCH PIPE,
 AC WATER

PROP. 195 LF 24 INCH DI RESTRAINED JOINT WATER PIPE, PC 250

PROP. 90 LF 24 INCH DI WATER PIPE, PC 250

MATCHLINE STA 196+00 SEE SHEET NO. UC-10

MATCHLINE STA 209+00 SEE SHEET NO. UC-12

MATCHLINE STA 21+00 SEE SHEET NO. UC-16

DATE PLOTTED: 11/10/04 11:58 AM