
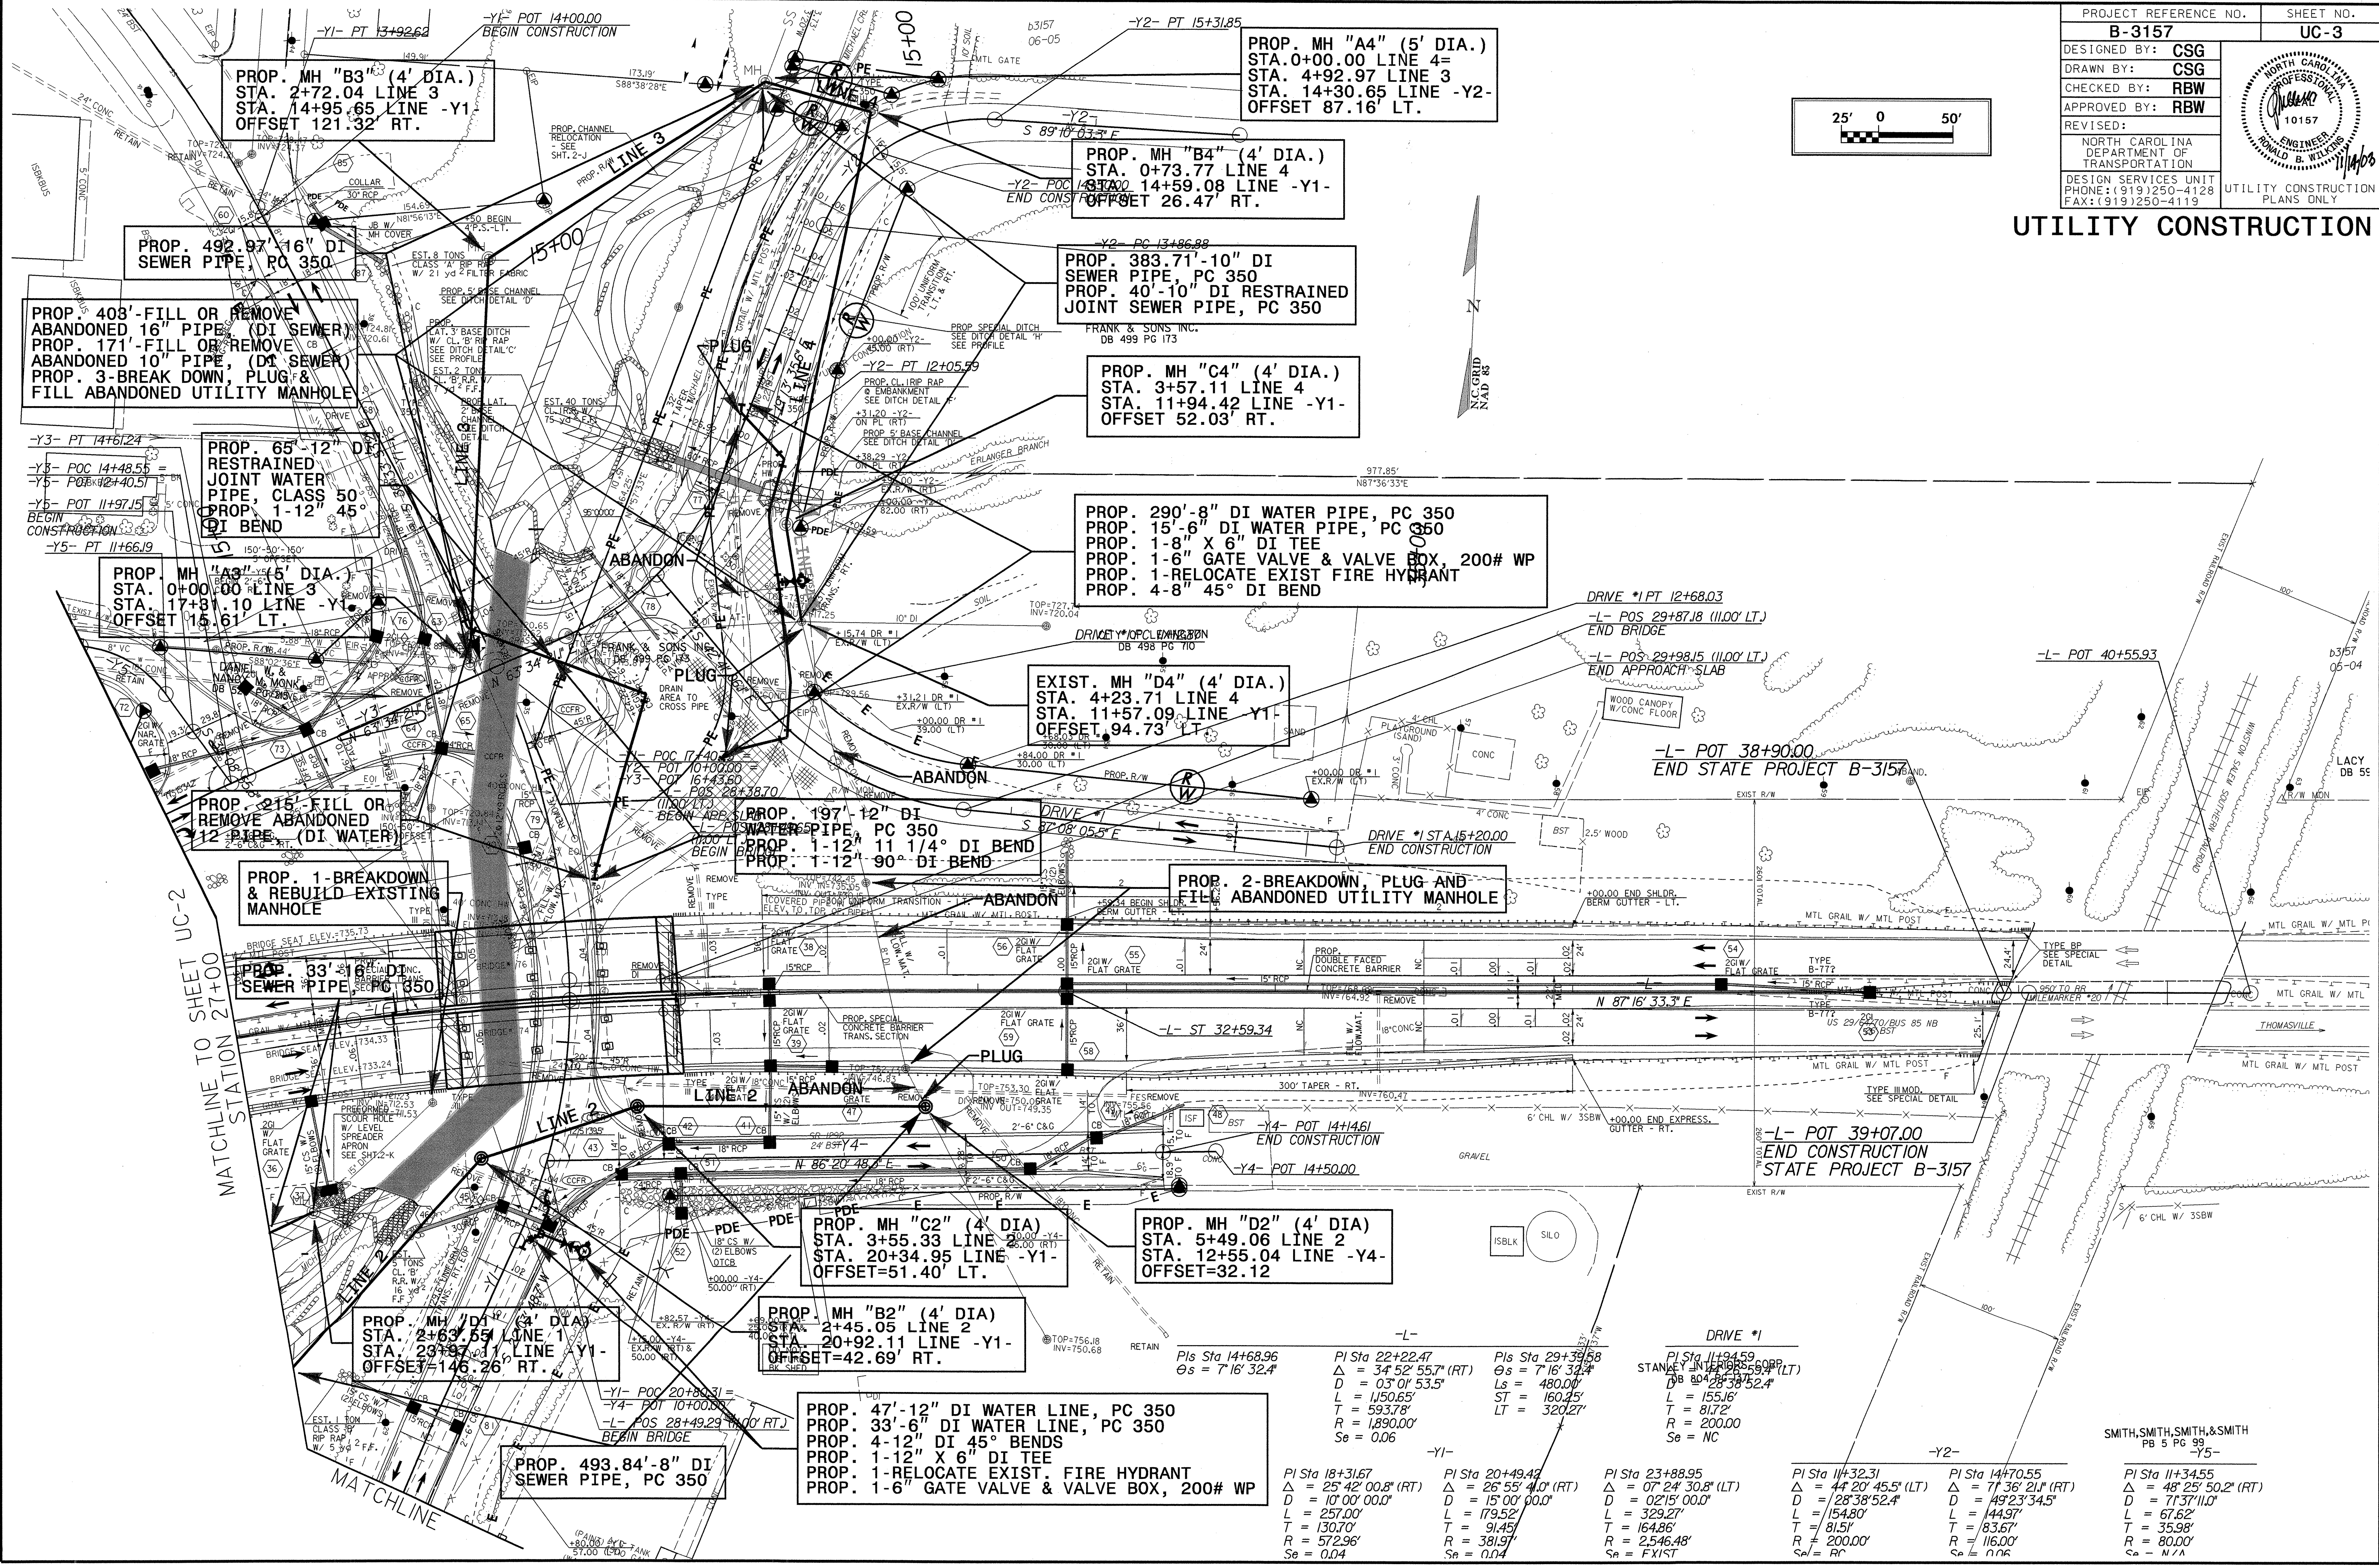


UTILITY CONSTRUCTION

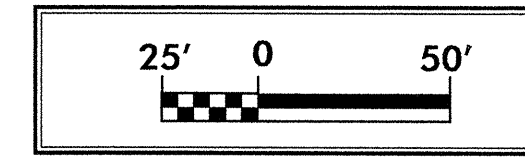

MATCHLINE TO SHEET UC-2
STATION 27+00

MATCHLINE

PROP. 47'-12" DI WATER LINE, PC 350
 PROP. 33'-6" DI WATER LINE, PC 350
 PROP. 4'-12" DI 45° BENDS
 PROP. 1-12" X 6" DI TEE
 PROP. 1-RELOCATE EXIST. FIRE HYDRANT
 PROP. 1-6" GATE VALVE & VALVE BOX, 200# WP

DRIVE #1
 STANLEY INTERCHANGES CORP.
 DB 804 PG 237
 D = 2838.52'
 L = 155.16'
 T = 81.72'
 R = 200.00'
 Se = NC

<p>PI Sta 18+31.67 Δ = 25° 42' 00.8" (RT) D = 10' 00' 00.0" L = 257.00' T = 130.70' R = 572.98' Se = 0.04</p>	<p>PI Sta 22+22.47 Δ = 34° 52' 55.7" (RT) D = 03' 01' 53.5" L = 1,150.65' T = 593.78' R = 1,890.00' Se = 0.06</p>	<p>PI Sta 29+39.68 Δ = 26° 55' 40" (RT) D = 15' 00' 00.0" L = 179.52' T = 91.45' R = 381.97' Se = 0.04</p>	<p>PI Sta 23+88.95 Δ = 07° 24' 30.8" (LT) D = 02' 15' 00.0" L = 329.27' T = 164.86' R = 2,546.48' Se = EXIST</p>	<p>PI Sta 11+32.31 Δ = 44° 20' 45.5" (LT) D = 28° 38' 52.4" L = 154.80' T = 81.51' R = 200.00' Se = R</p>	<p>PI Sta 14+70.55 Δ = 71° 36' 21.1" (RT) D = 49' 23' 34.5" L = 144.97' T = 83.67' R = 116.00' Se = 0.06</p>	<p>PI Sta 11+34.55 Δ = 48° 25' 50.2" (RT) D = 71' 37' 11.0" L = 67.62' T = 35.98' R = 80.00' Se = N/A</p>
---	---	--	--	---	--	---

SMITH, SMITH, SMITH, & SMITH
 PB 5 PG 99
 -Y5-

06-NOV-2003 11:59
 W:\Utilities\B3157UC3\Projects\B3157UC3\p3.dwg
 User: dls21455