


SECTION AT END BENT-1

*#16 G1 BAR MAY BE SHIFTED SLIGHTLY, AS NECESSARY, TO CLEAR DIAPHRAGM AND REINFORCING STEEL.

SECTION AT END BENT-2

*#16 G2 BAR MAY BE SHIFTED SLIGHTLY, AS NECESSARY, TO CLEAR DIAPHRAGM AND REINFORCING STEEL.

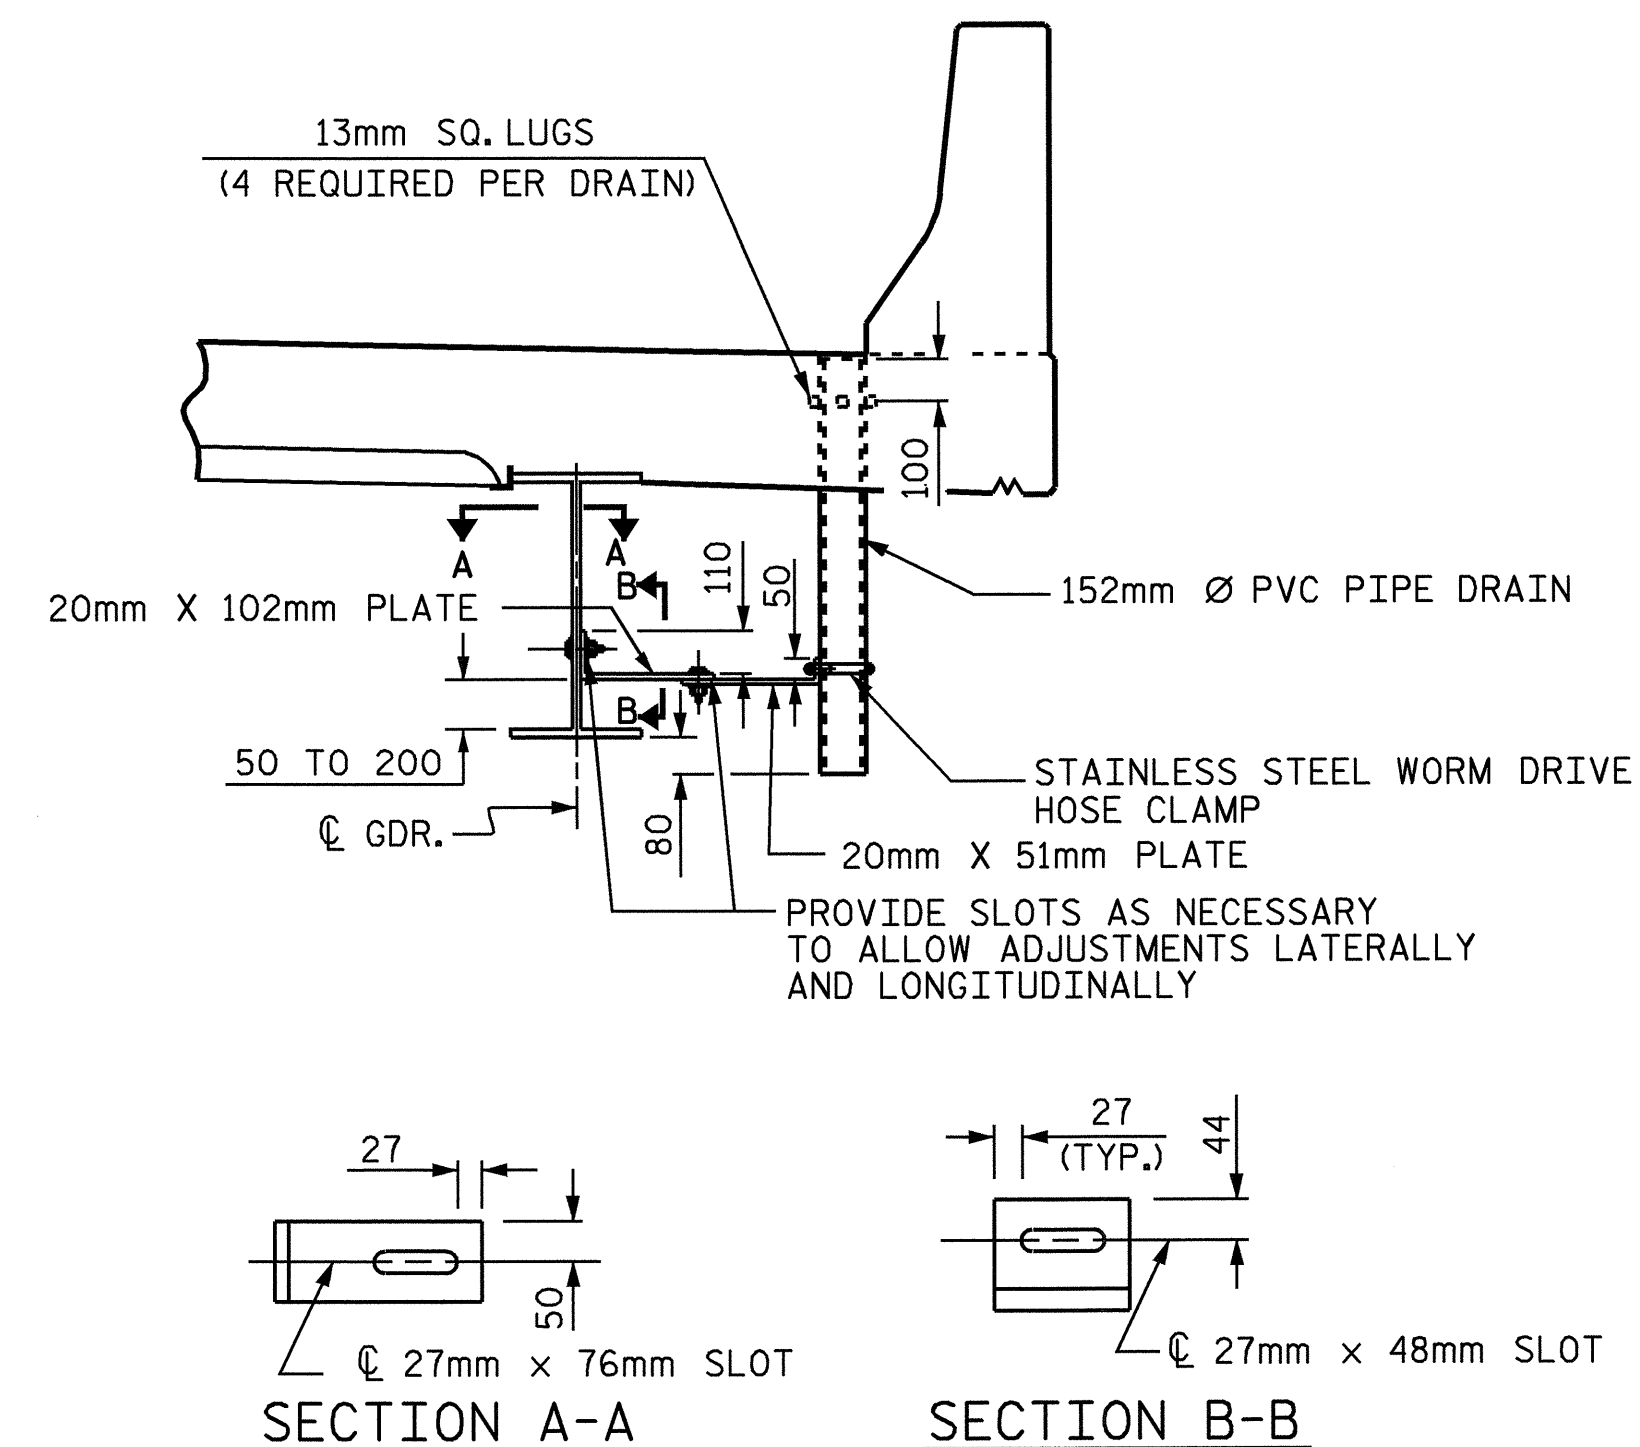

DRAIN CONNECTOR DETAIL

(28 DRAINS REQUIRED)

COUPLING IN DRAIN PIPE WILL BE PERMITTED AS APPROVED BY THE ENGINEER.


4-13mm SQ. LUGS TO BE GLUED TO THE PVC PLASTIC PIPE AT EQUAL SPACES AROUND THE PIPE DRAIN APPROXIMATELY 100mm FROM THE TOP OF THE PIPE.

BOLT SIZE TO BE SAME AS DIAPHRAGM AND CROSSFRAME CONNECTIONS. STAINLESS STEEL WORM HOSE CLAMP SHALL BE COMMERCIAL QUALITY.

PVC DECK DRAINS SHALL BE PAINTED WITH TWO COATS OF BROWN PRIMER MEETING THE REQUIREMENTS OF ARTICLE 1080-12 OF THE STANDARD SPECIFICATIONS. EACH COAT SHALL BE 0.050mm THICK. DECK DRAINS SHALL BE ROUGHENED PRIOR TO PAINTING. NO SEPARATE PAYMENT SHALL BE MADE FOR PAINTING PVC DECK DRAINS AS THIS IS CONSIDERED INCIDENTAL TO THE PAY ITEM FOR REINFORCED CONCRETE DECK SLAB.

TOP OF THE FLOOR DRAINS TO BE SET 10mm BELOW SURFACE OF SLAB.

THE 152mm Ø PVC PIPE AND FITTINGS SHALL BE SCHEDULE AND CONFORM TO ASTM D1785

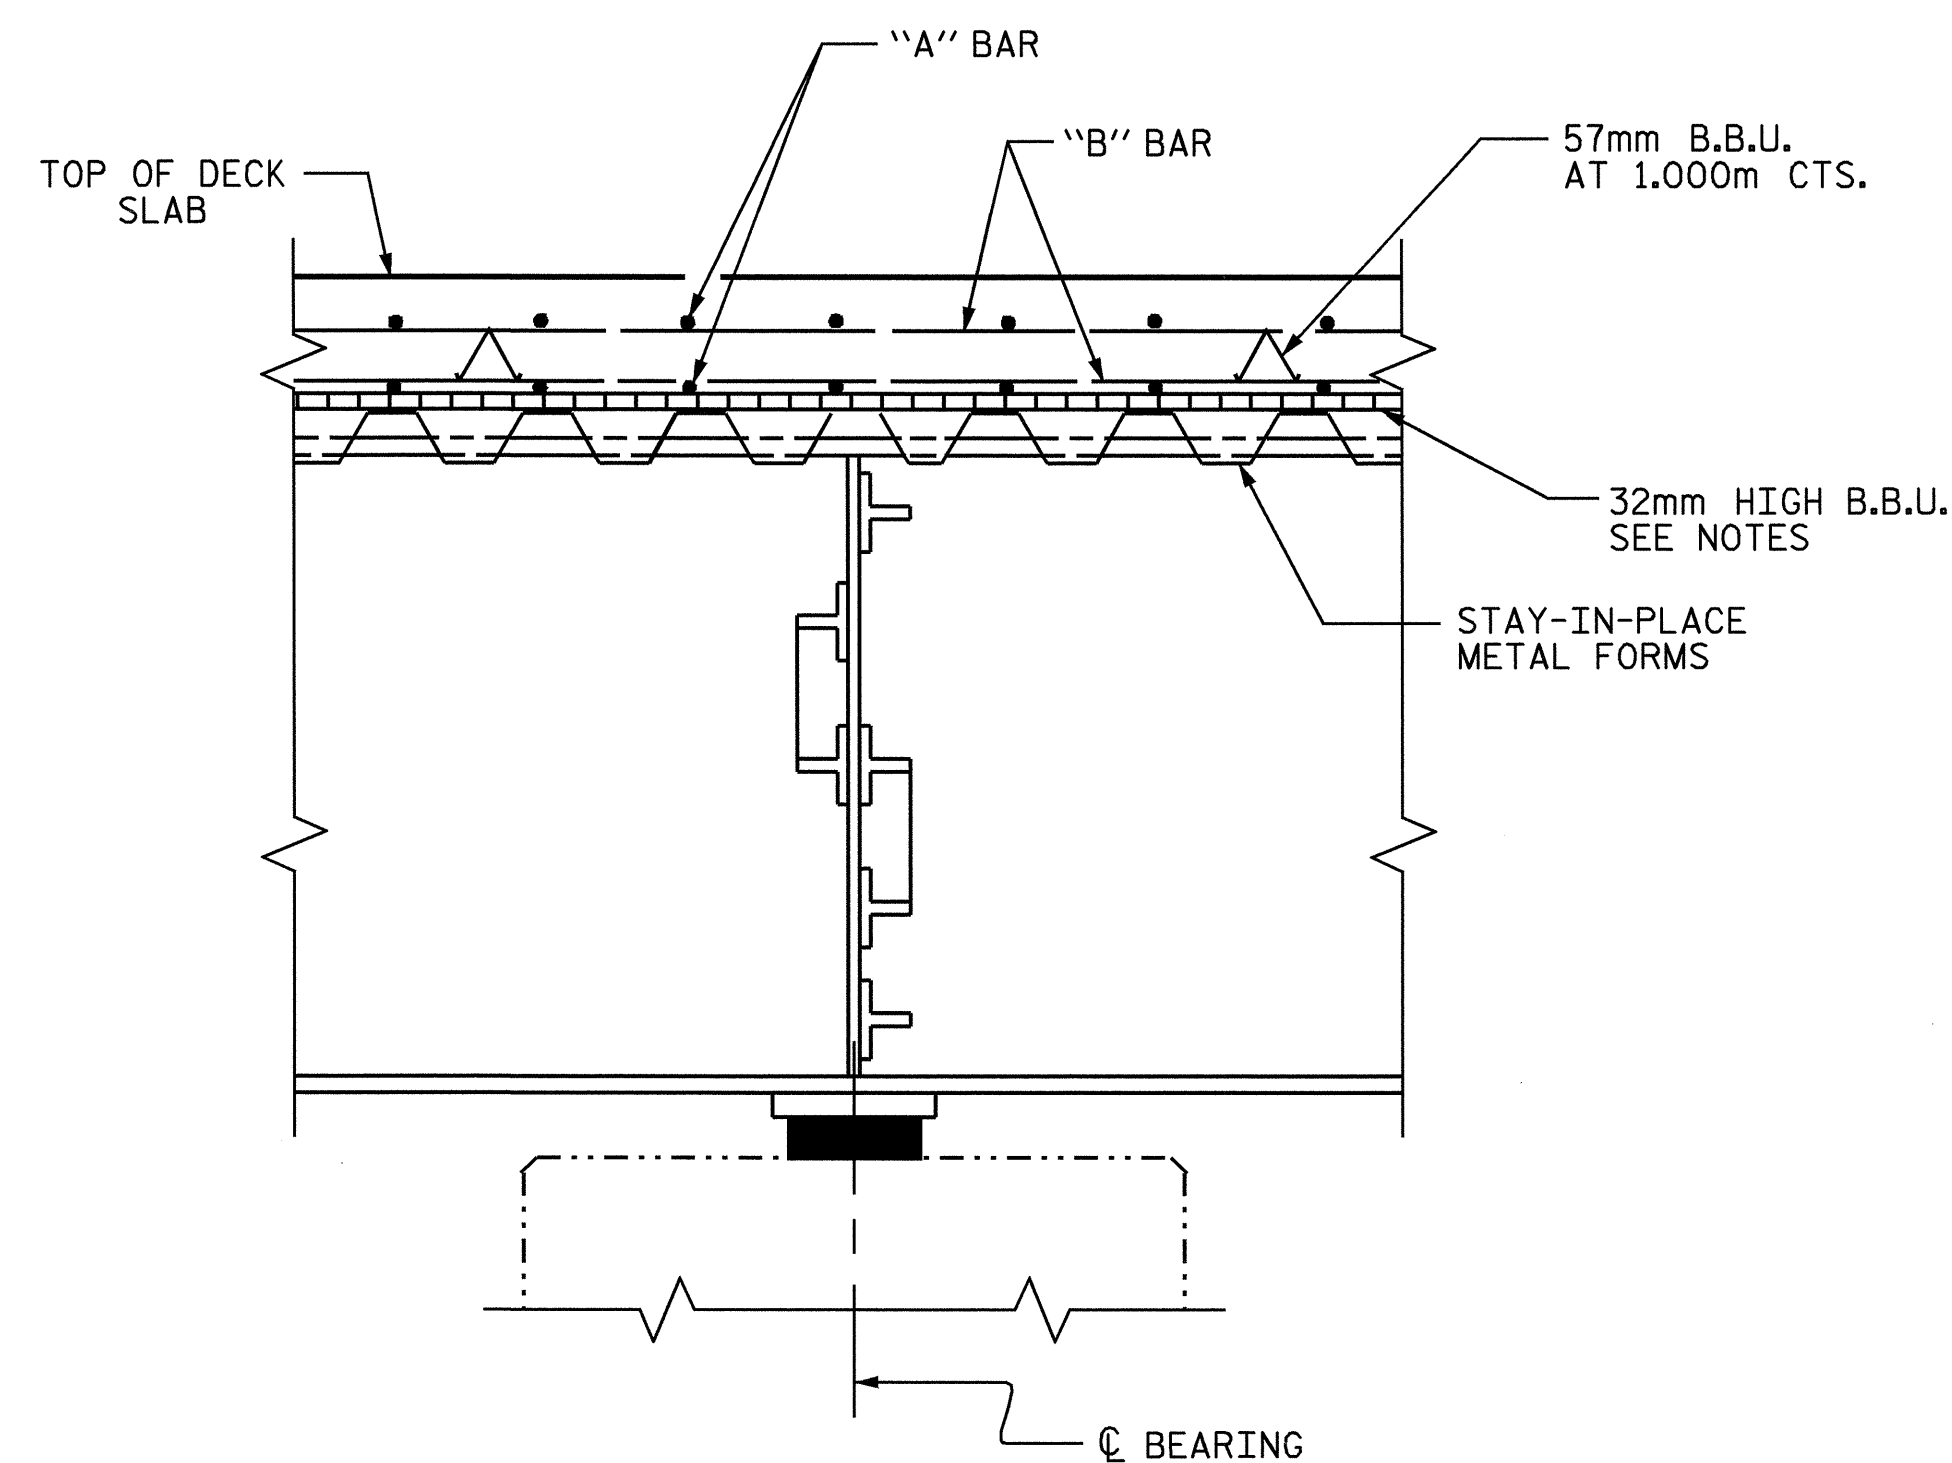

SECTION AT BENT

DRAWN BY : B.N.BARODAWALA DATE : 10-5-04
 CHECKED BY : MIKE ALLEN DATE : 11-04

21-DEC-2004 07:36
 W:\SquadL\R-0977a\str4\bbarodawala\R0977A.sd.TS.04.dgn
 lsutton



PROJECT NO. R-0977A
CHEROKEE COUNTY
 STATION: 41+19.524-LREV-

SHEET 2 OF 2

STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

SUPERSTRUCTURE

TYPICAL SECTIONS

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	S-128
1			3			TOTAL SHEETS
2			4			230

STR. #4