



Rev 3/6/01

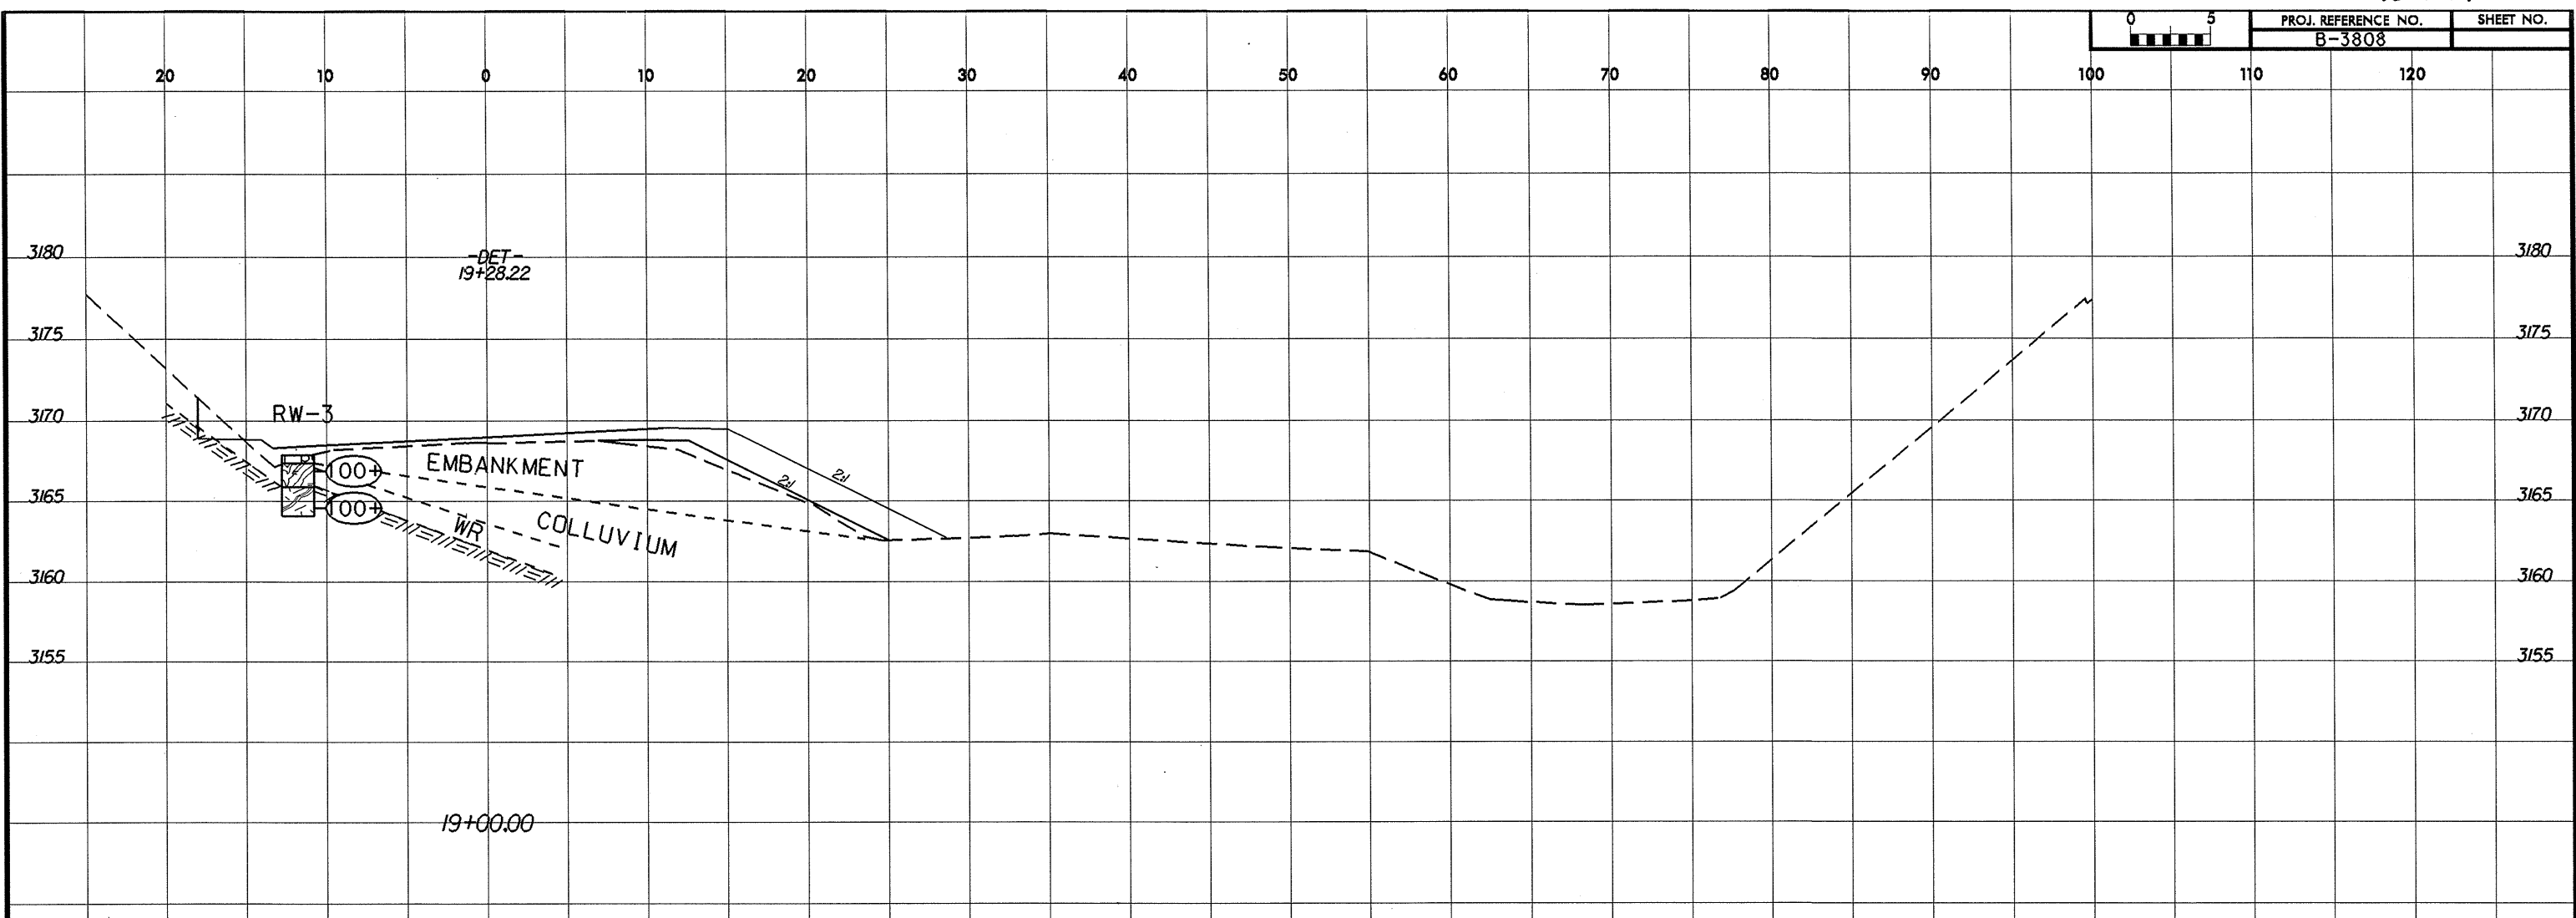

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
SS-12	12' LT	18+50	1.5-2.5	A-1-b(0)	30	NP	41	36	15	8	42	31	11
SS-13	12' LT	18+50	4.0-5.0	A-1-b(0)	32	NP	36	39	15	10	84	44	16

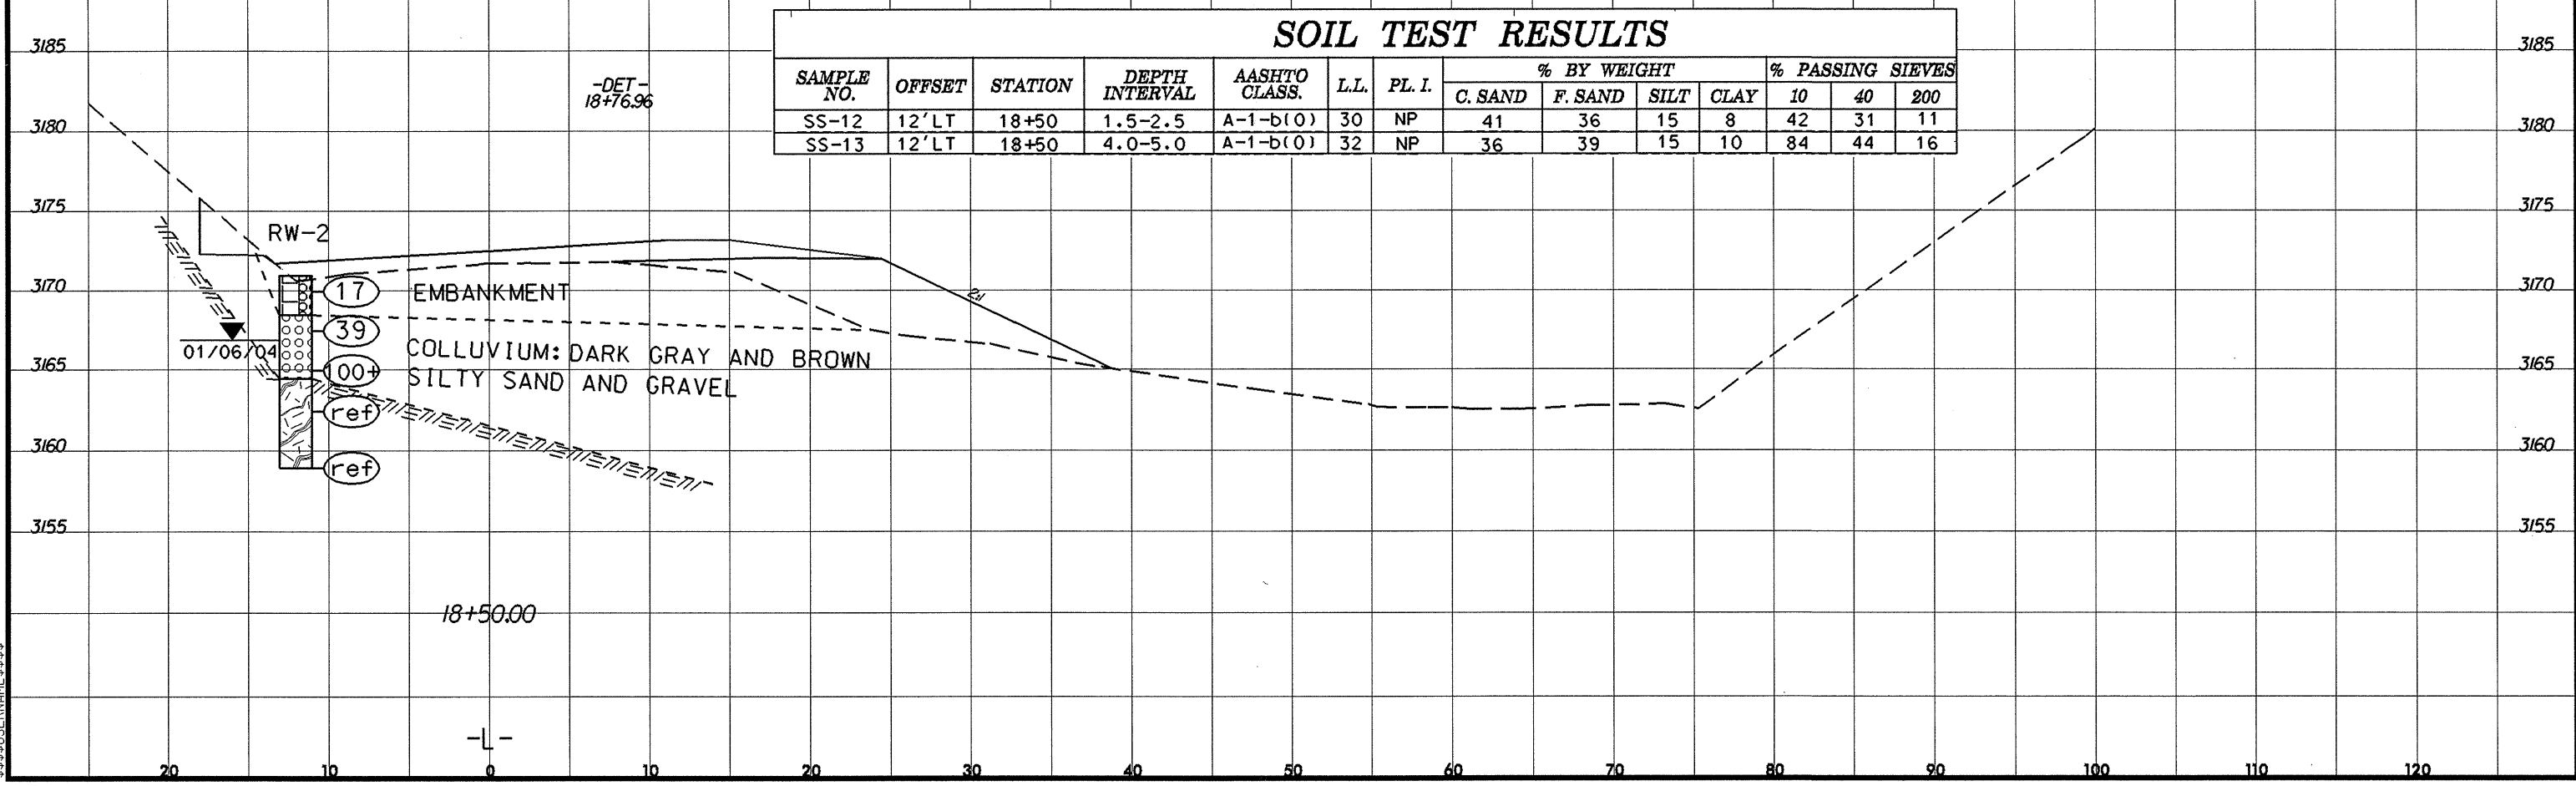

SYSTEMS CONDITIONS SHEET