
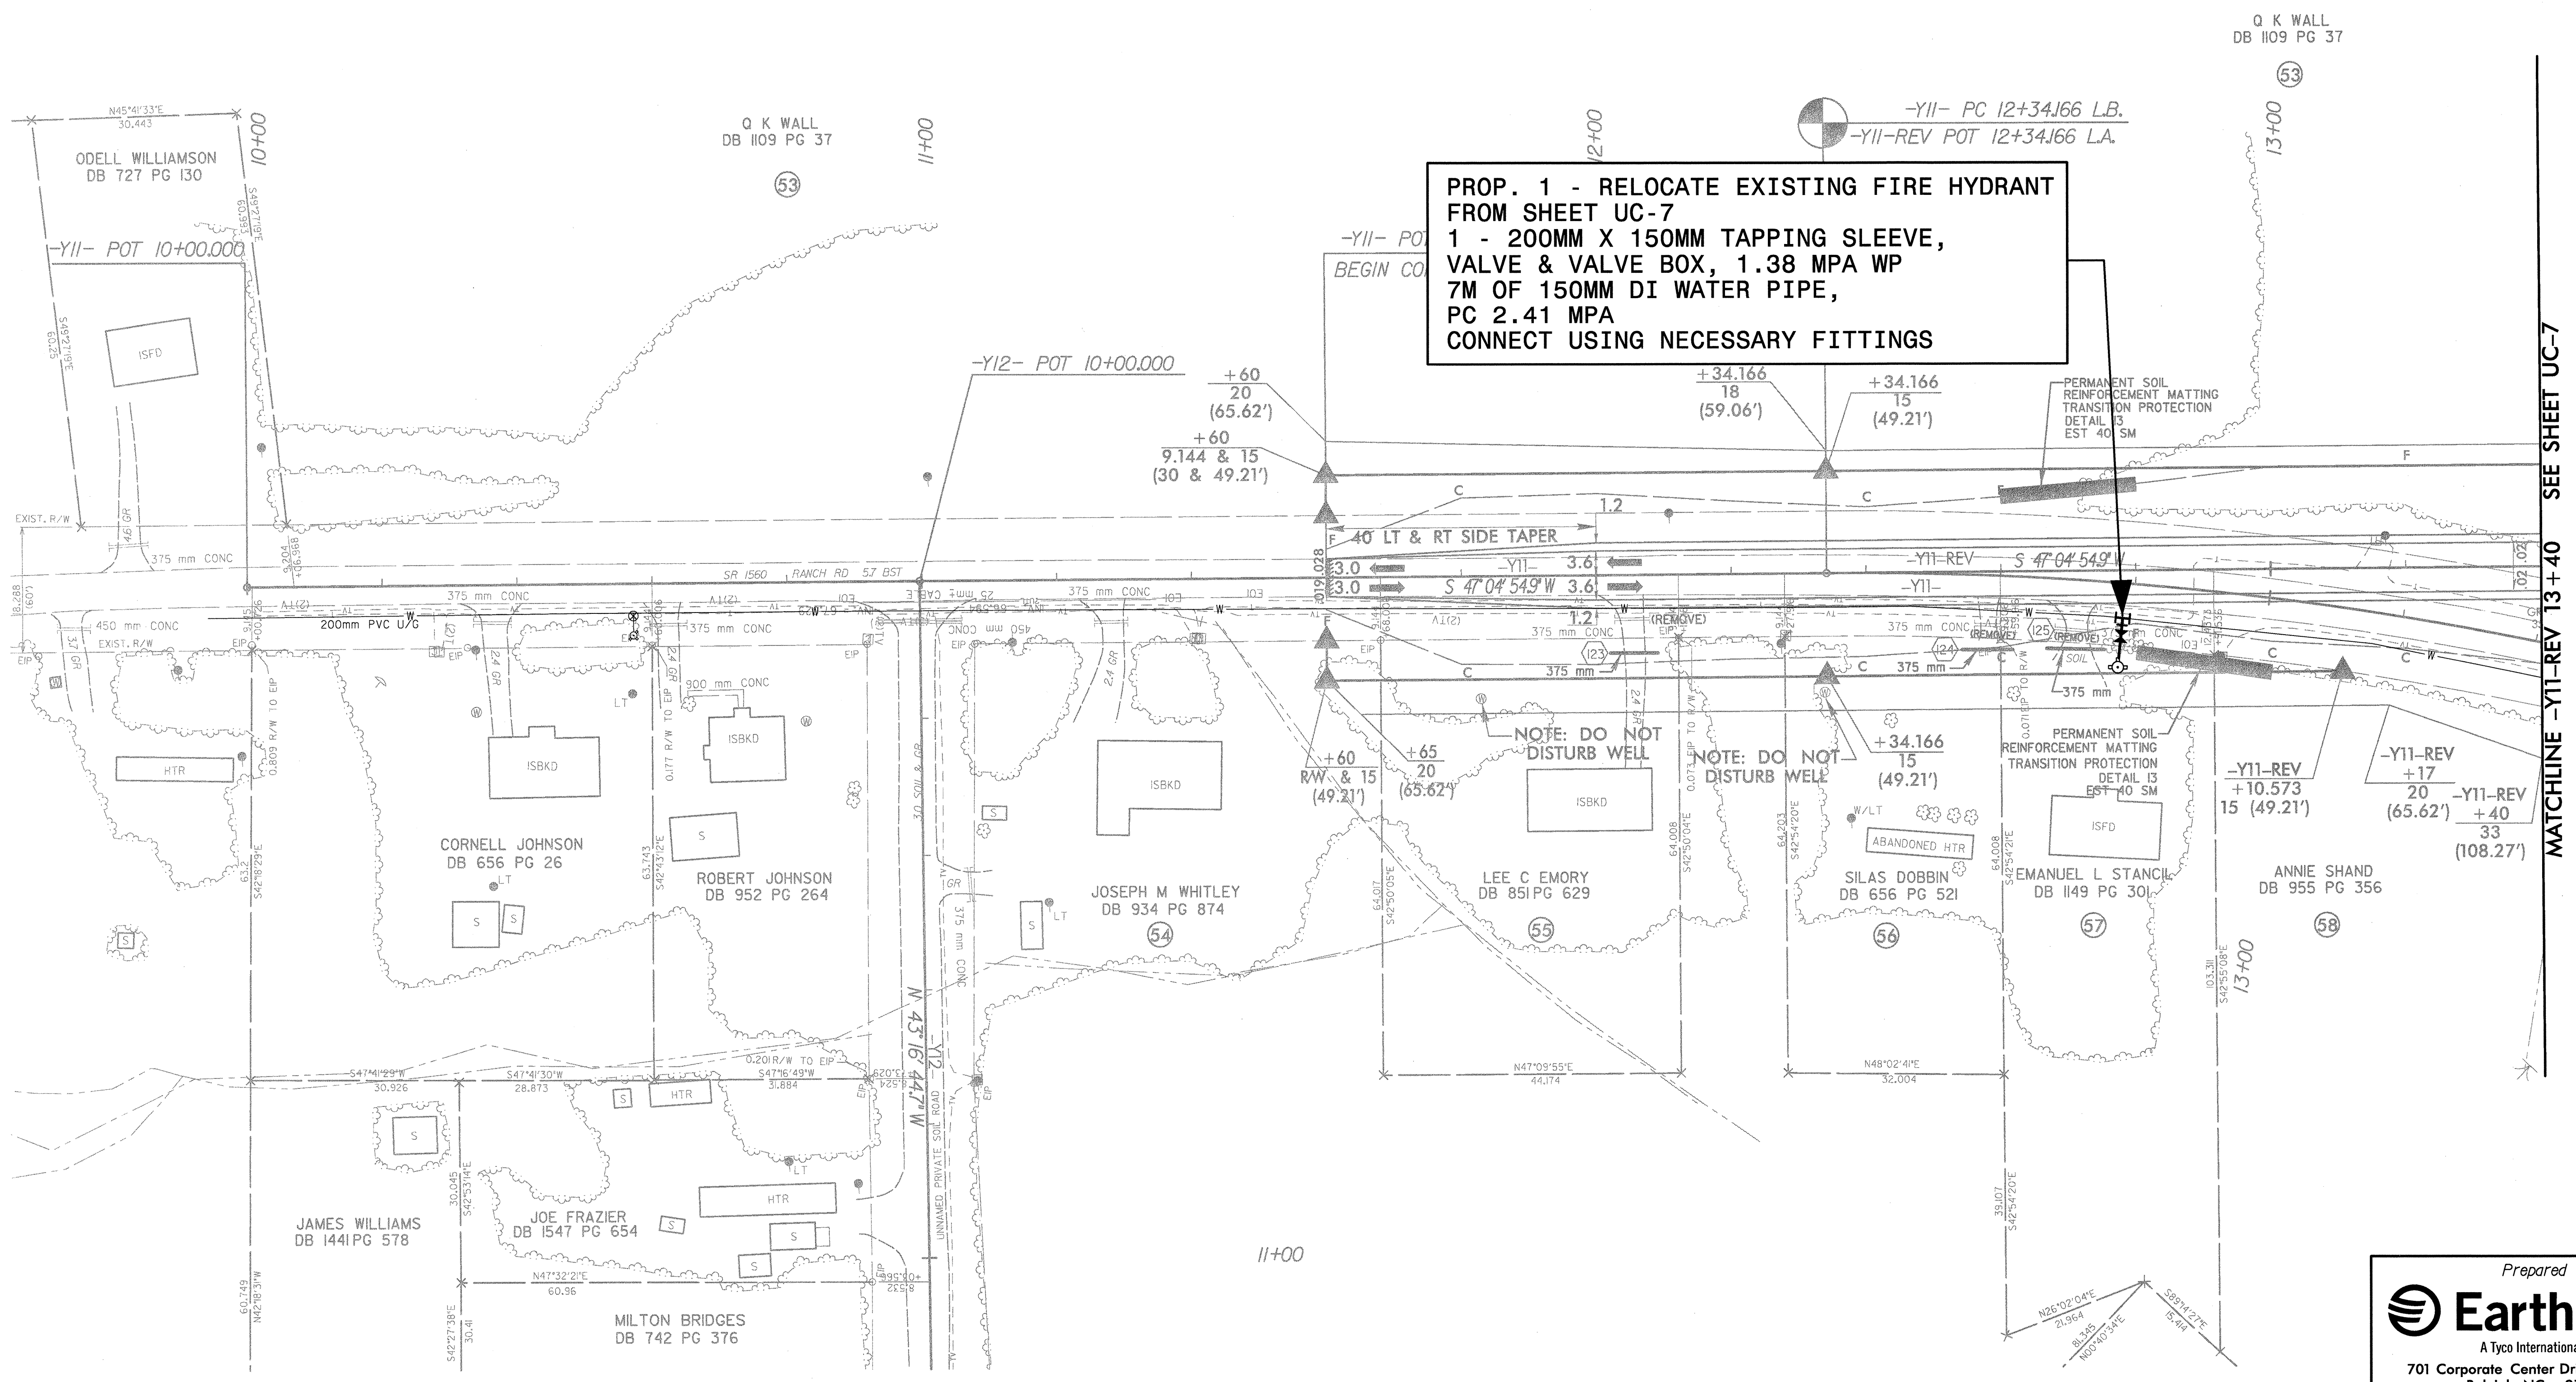


ALL WATER AND SEWER LINES OWNED BY JOHNSTON COUNTY

PROJECT REFERENCE NO. R-2552B	SHEET NO. UC-5

UTILITY CONSTRUCTION

-Y11-
 $PI = 13+31.101$
 $\Delta = 21^{\circ}30'04.3" (RT)$
 $L = 191.589$
 $T = 96.935$
 $R = 510.541$

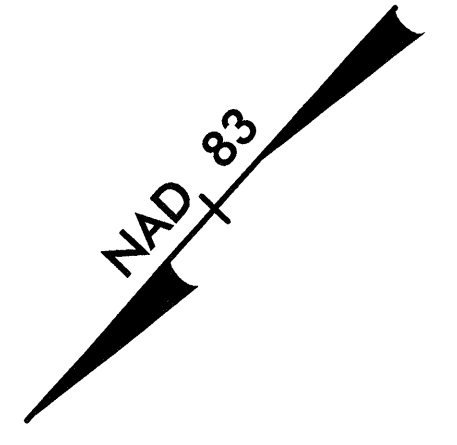

PROP. 1 - RELOCATE EXISTING FIRE HYDRANT FROM SHEET UC-7
 1 - 200MM X 150MM TAPPING SLEEVE,
 VALVE & VALVE BOX, 1.38 MPA WP
 7M OF 150MM DI WATER PIPE,
 PC 2.41 MPA
 CONNECT USING NECESSARY FITTINGS

Prepared by:

 A Tyco International Ltd. Company
 701 Corporate Center Drive, Suite 475
 Raleigh, NC 27607
 (919) 854-6200 - (919) 854-6259(fax)

g:\1997\nc-2552b\p\0\nc-2552buc5.psh
 01/28/2005 02:55:44 PM