




PROJECT REFERENCE NO. R-2552B	SHEET NO. 39
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER
PRELIMINARY PLANS DO NOT USE FOR CONSTRUCTION	
CONST. REV. _____	
R/W REV. _____	




SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	PL. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
S-293	CL	86+40	0.50-1.00	A-7-5(28)	69	25	3.2	15.7	8.4	72.7	100	98	85		
SS-294	CL	88+00	1.03-1.48	A-7-5(25)	65	26	1.2	23.4	14.8	60.5	100	100	80	27	
SS-295	CL	88+00	4.07-4.52	A-4(5)	39	9	1.4	67.6	10.8	20.2	100	100	61	30.5	

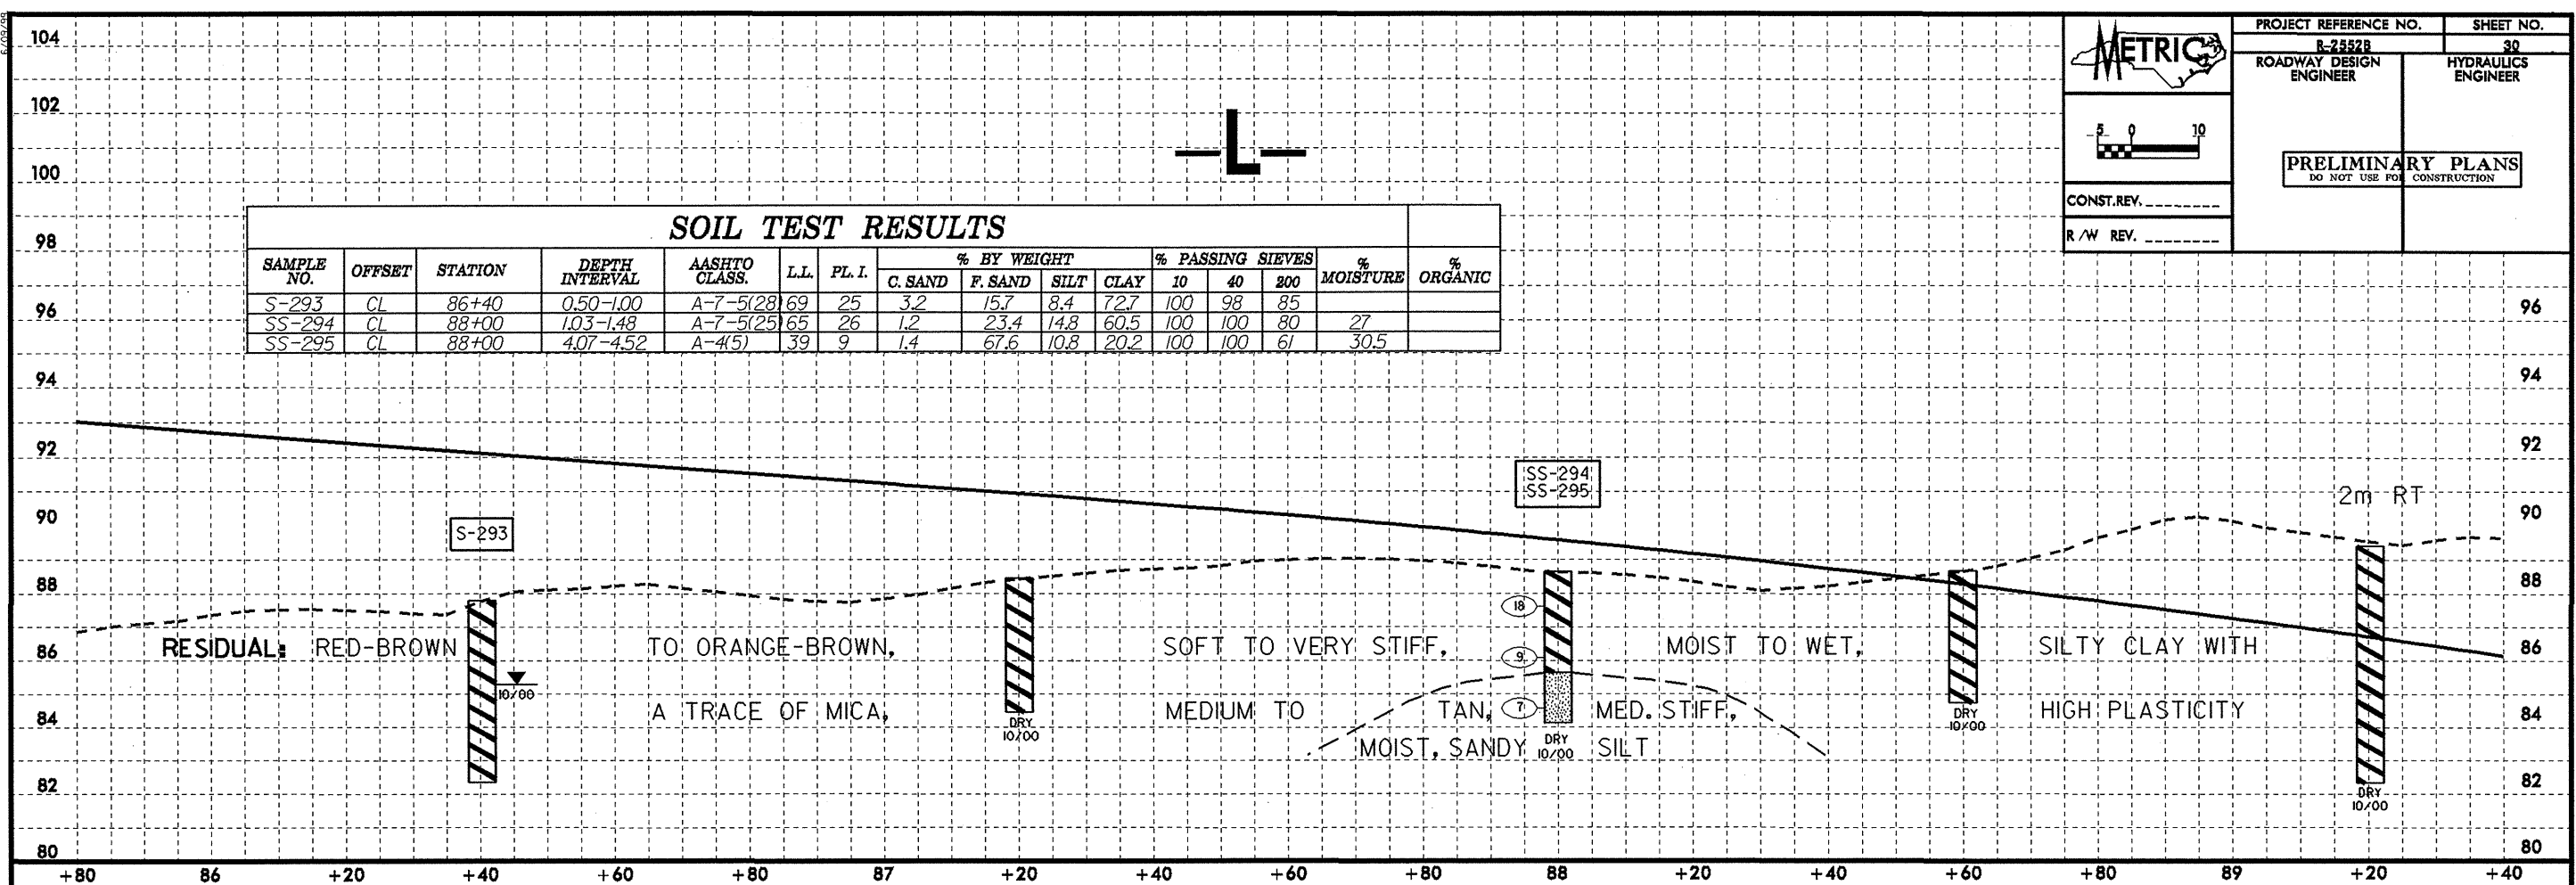

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	PL. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-296	CL	89+80	1.19-1.64	A-7-5(22)	63	22	1.0	26.8	13.6	58.5	100	100	79	22.8	
SS-297	CL	89+80	2.71-3.16	A-7-5(17)	58	21	3.0	34.5	30.2	32.3	100	99	71		
SS-298	CL	89+80	4.23-4.68	A-5(1)	43	NP	1.0	56.5	30.4	12.1	100	99	57	14.9	
S-299	CL	91+00	0.00-0.95	A-7-6(28)	59	37	4.8	24.8	15.8	54.5	100	97	75	28.5	
S-300	CL	91+00	2.00-2.50	A-7-5(28)	70	25	1.8	16.5	33.2	48.4	100	100	85		
S-301	CL	91+60	0.50-1.00	A-7-6(8)	46	25	27.9	27.2	6.6	38.3	100	83	49		
S-302	CL	91+60	1.35-1.80	A-2-4(0)	21	NP	21.0	49.2	21.7	8.1	93	81	35		
S-308	CL	93+00	0.00-0.91	A-4(0)	21	4	21.4	44.8	9.5	24.2	96	83	39		
S-309	CL	93+00	1.75-2.00	A-7-5(17)	63	15	1.6	26.9	25.1	46.5	100	99	78		

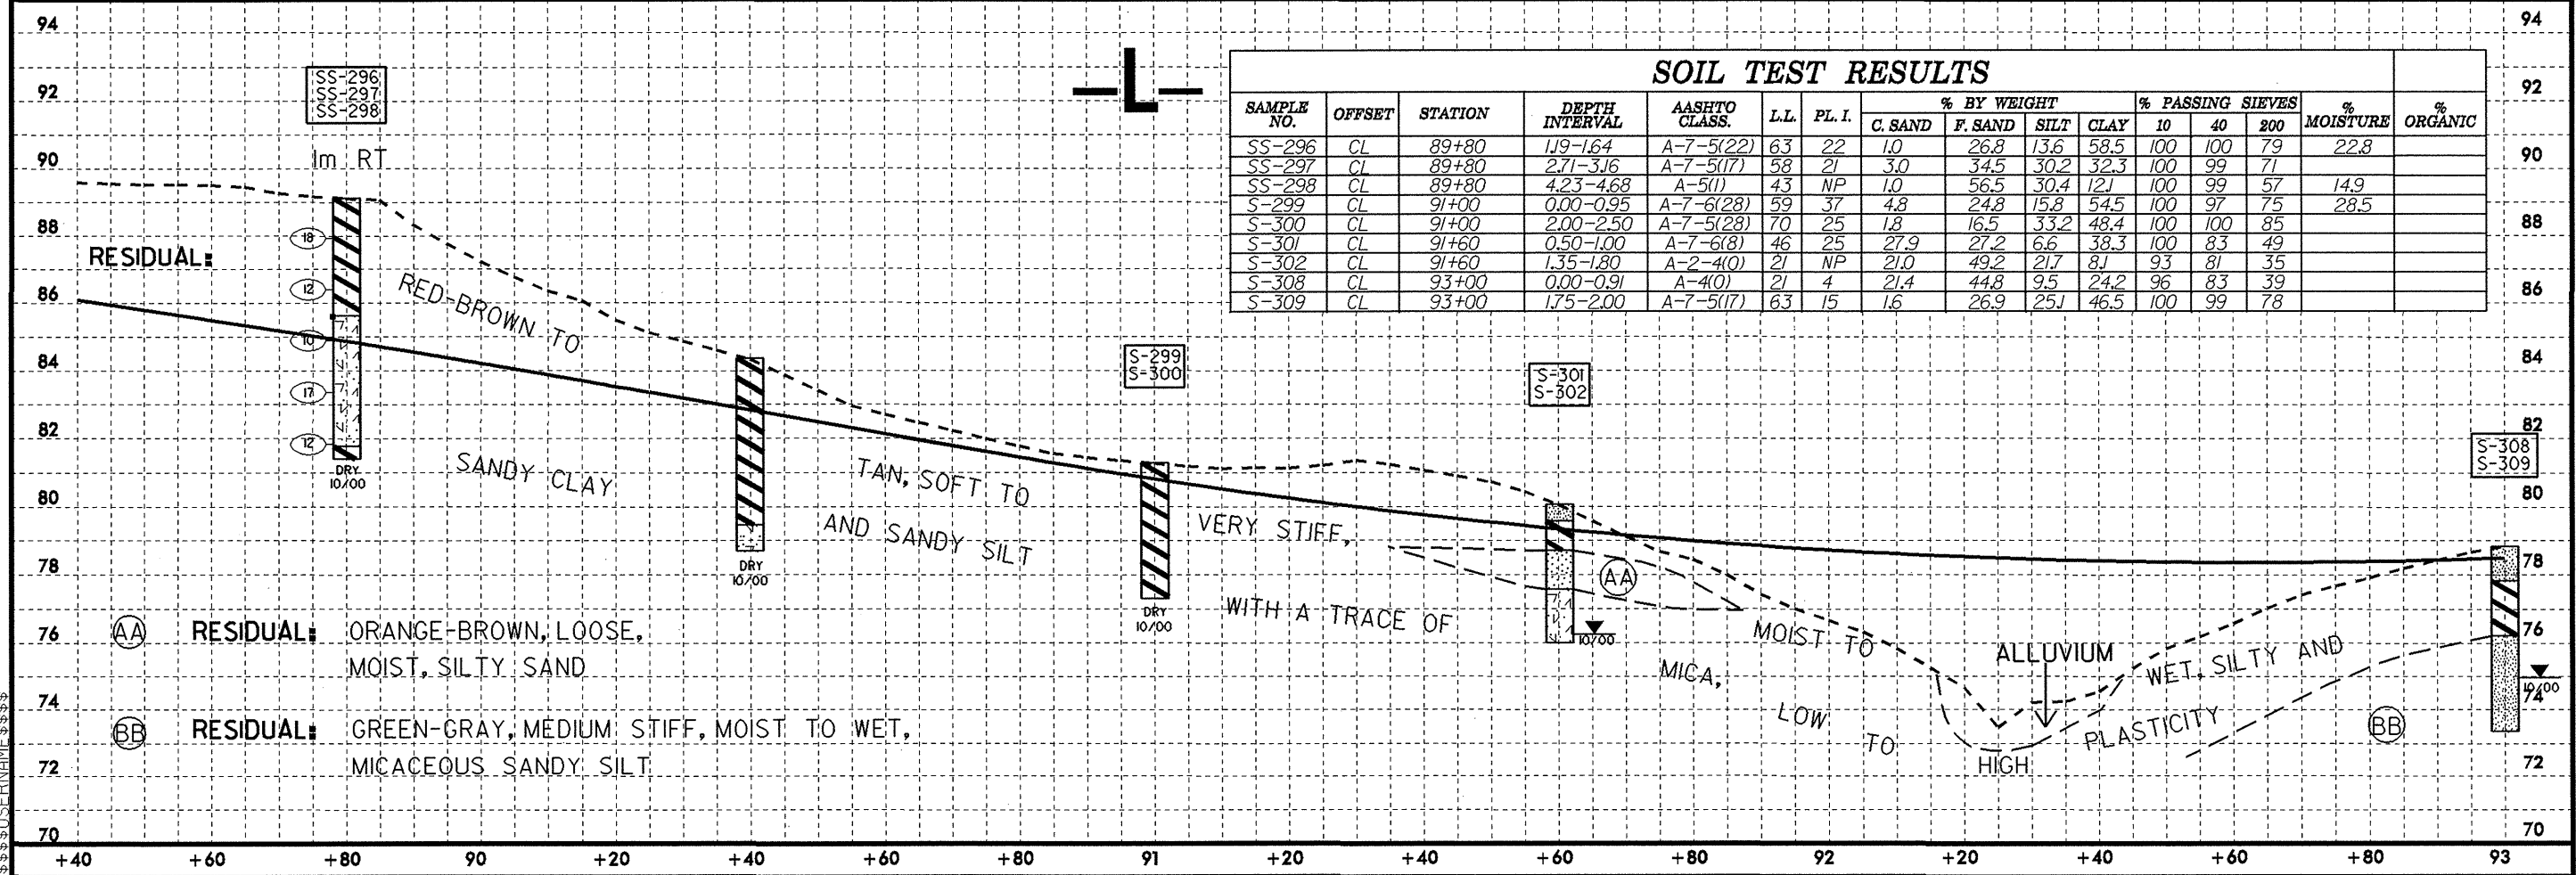

\$\$\$\$\$SYTIME\$\$\$\$\$
 \$\$\$\$\$\$DGN\$\$\$\$\$
 \$\$\$\$\$\$USER\$\$\$\$\$