
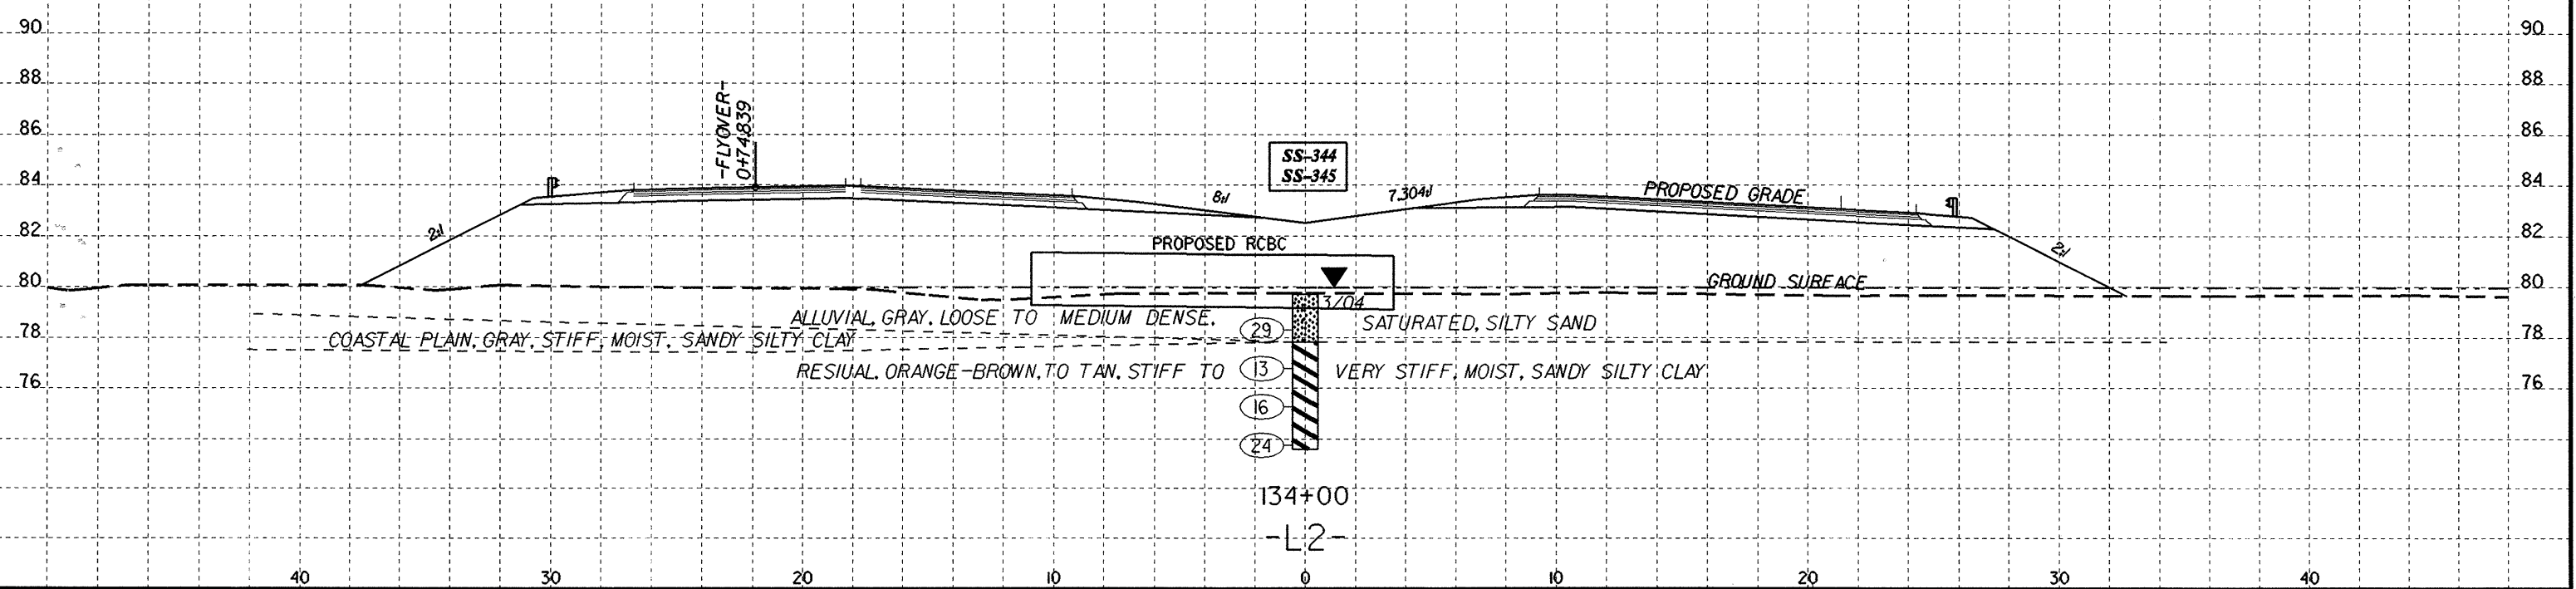


SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
SS-344	0	134+00	2.63-3.08	A-7-6(21)	66	39	9.7	24.0	30.1	36.3	80	76	60
SS-345	0	134+00	4.15-4.60	A-7-5(16)	65	25	9.5	33.6	32.7	24.2	95	90	63
SS-341	30	134+13	1.08-1.53	A-2-4(0)	16	NP	33.6	43.3	13.0	10.1	93	78	26
SS-342	30	134+13	2.60-3.05	A-7-5(9)	51	19	11.9	46.5	15.4	26.2	100	96	57
SS-343	30	134+13	4.12-4.57	A-7-5(30)	77	34	3.8	29.4	40.6	26.2	100	99	76

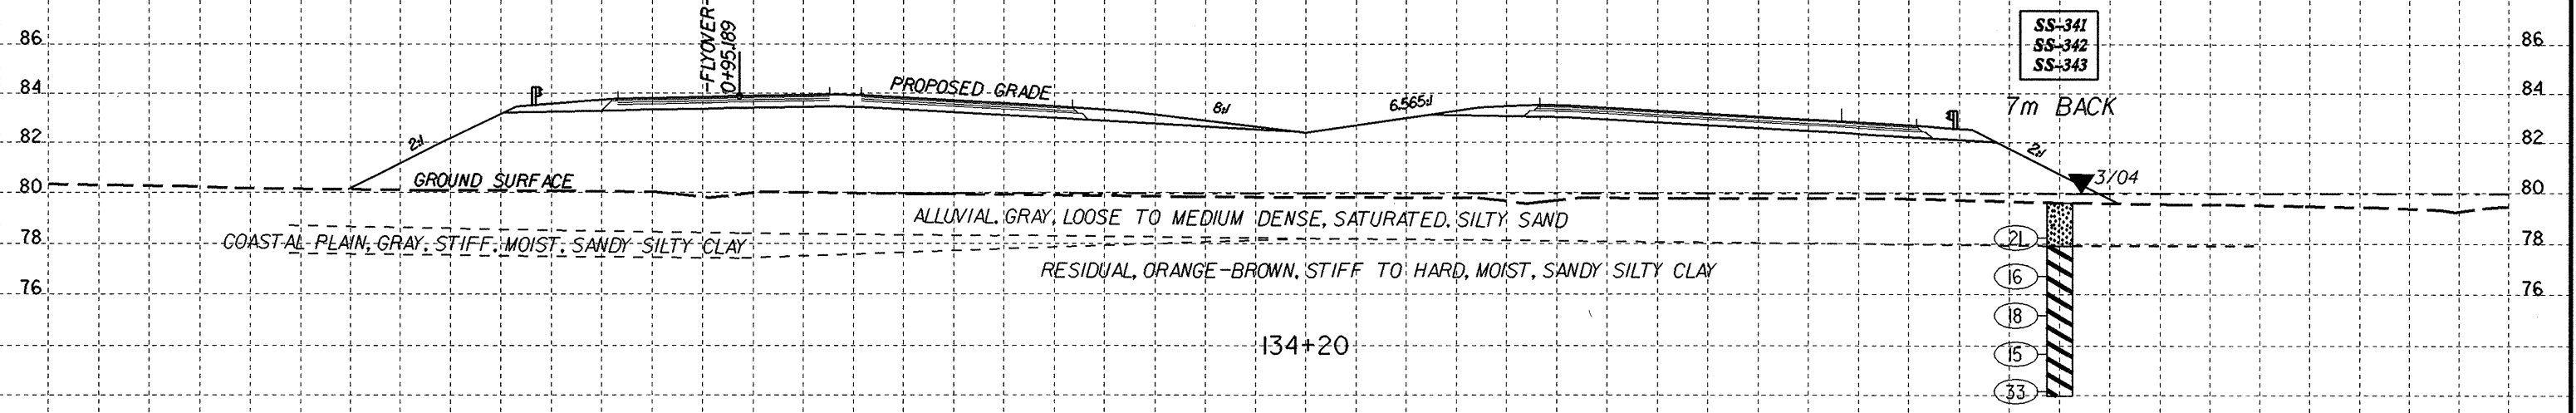

134+00
-L2-