


ALL WATER LINES ARE OWNED BY
ONSLOW COUNTY PUBLIC UTILITIES

MAKE CONNECTIONS USING
NECESSARY FITTINGS

-L-
PI Sta 44+62.75
Δ = 41° 03' 44.6" (LT)
D = 7' 30" 00.0"
L = 547.50'
T = 286.10'
R = 763.94'
SE = SEE PLANS





-L-
PI Sta 51+04.53
Δ = 34° 19' 40.3" (RT)
D = 7' 30" 00.0"
L = 457.70'
T = 235.95'
R = 763.94'
SE = SEE PLANS

PROP. 1237' - 8" PVC WATER PIPE,
SDR 21, 200# WP
PROP. 368' - 3/4" PE WATER TUBING,
SDR 9, 200# WP
PROP. (2) - 8" 45° DI BENDS
PROP. (6) - 3/4" CORPORATION STOP
PROP. (6) - 8" X 3/4" TAPPING SADDLE
PROP. (6) - RELOCATE EXIST. WATER
METER
PROP. (2) - RECONNECT EXIST. WATER
METER

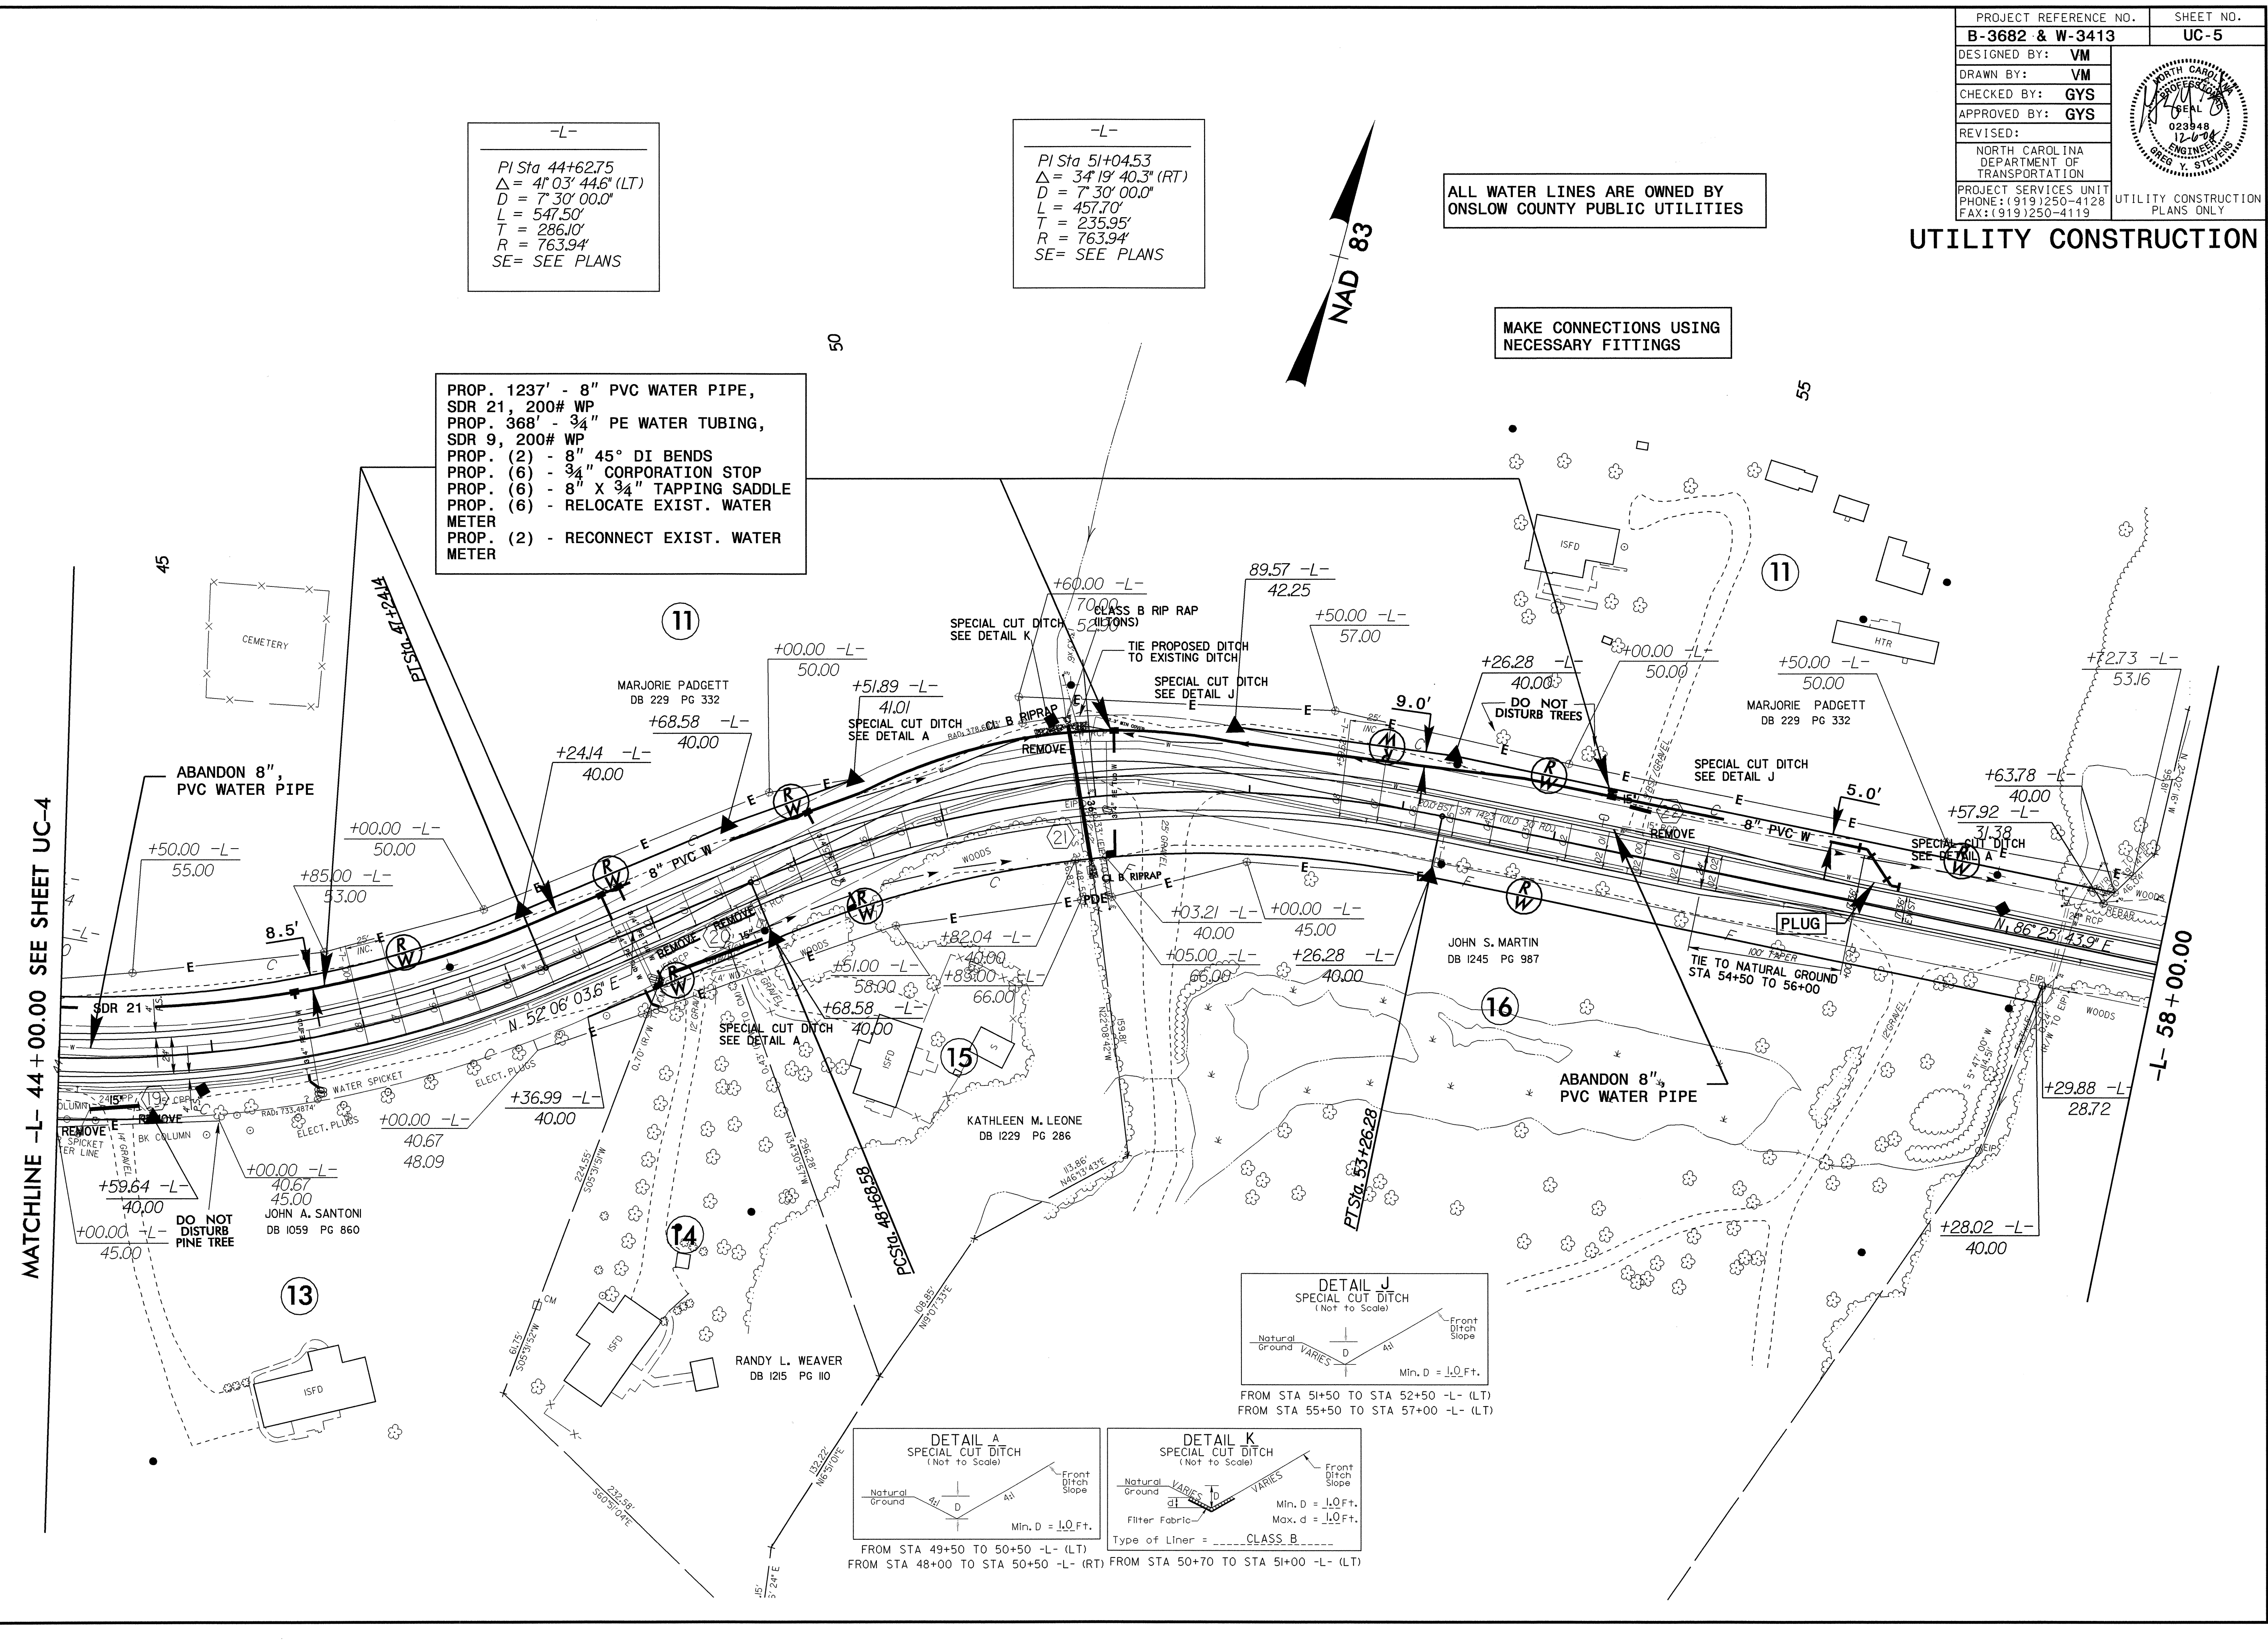

MATCHLINE -L- 44+00.00 SEE SHEET UC-4

-L- 58+00.00

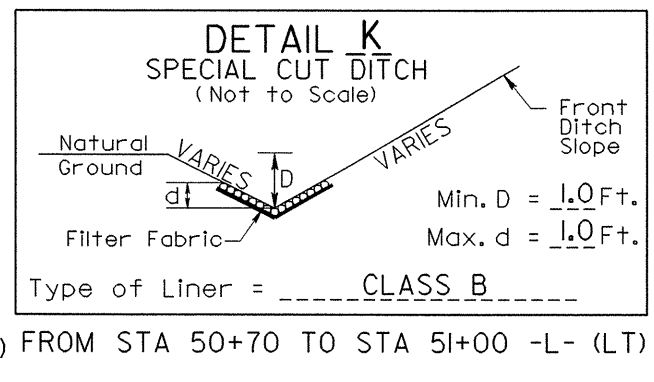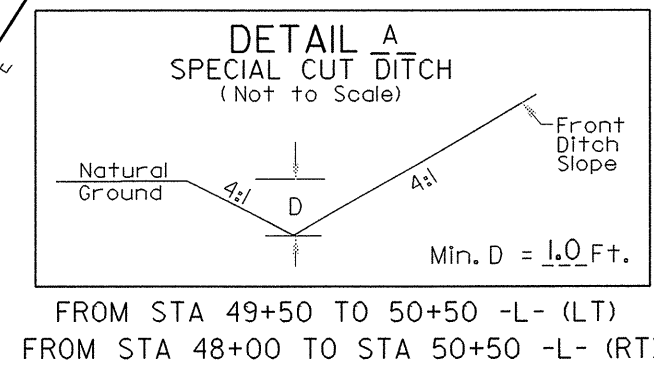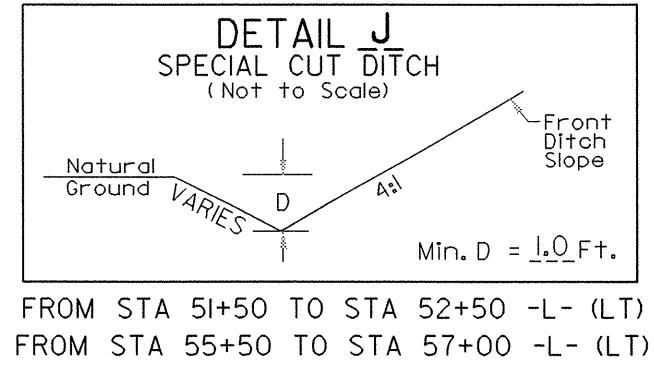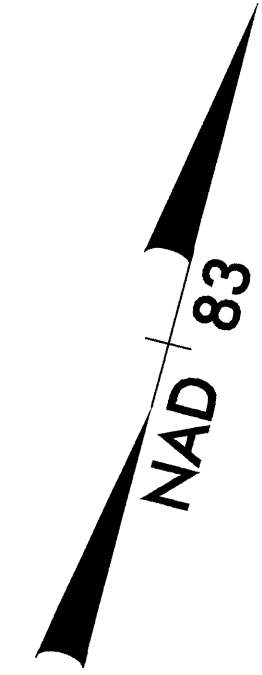

06-DEC-2004 08:00 Prj:\03682-ut-uc-Rev07-UC05.psh
 06-DEC-2004 08:00 Prj:\03682-ut-uc-Rev07-UC05.psh
 06-DEC-2004 08:00 Prj:\03682-ut-uc-Rev07-UC05.psh