


PROJECT REFERENCE NO.	SHEET NO.
B-3682 & W-3413	UC-4
DESIGNED BY: VM	
DRAWN BY: VM	
CHECKED BY: GYS	
APPROVED BY: GYS	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION PROJECT SERVICES UNIT PHONE: (919) 250-4128 FAX: (919) 250-4119	
UTILITY CONSTRUCTION PLANS ONLY	



UTILITY CONSTRUCTION

-L-	-Y-
PI Sta 32+68.15 Δ = 6° 54' 30.9" (LT) D = 4' 00' 00.0" L = 172.71' T = 86.46' R = 1,432.39' SE= SEE PLANS	PI Sta 14+72.74 Δ = 39° 04' 40.0" (LT) D = 17' 30' 00.0" L = 223.30' T = 116.19' R = 327.40' SE= SEE PLANS

-L-
PI Sta 38+39.63 Δ = 13° 11' 28.9" (RT) D = 3' 00' 00.0" L = 439.71' T = 220.83' R = 1,909.86' SE= SEE PLANS




MAKE CONNECTIONS USING NECESSARY FITTINGS

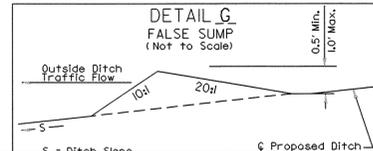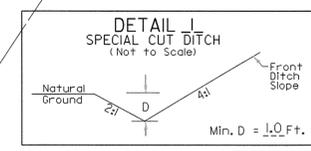

8/17/99
 06 DEC 2004 07:58 AM P:\proj\B3682 UC\B3682 uc_LUC_Rdwj06 UC04.psh
 06 DECEMBER 2004 07:58 AM P:\proj\B3682 UC\B3682 uc_LUC_Rdwj06 UC04.psh

MATCHLINE -L- 31+00.00 SEE SHEET UC-3

MATCHLINE -L- 44+00.00 SEE SHEET UC-5

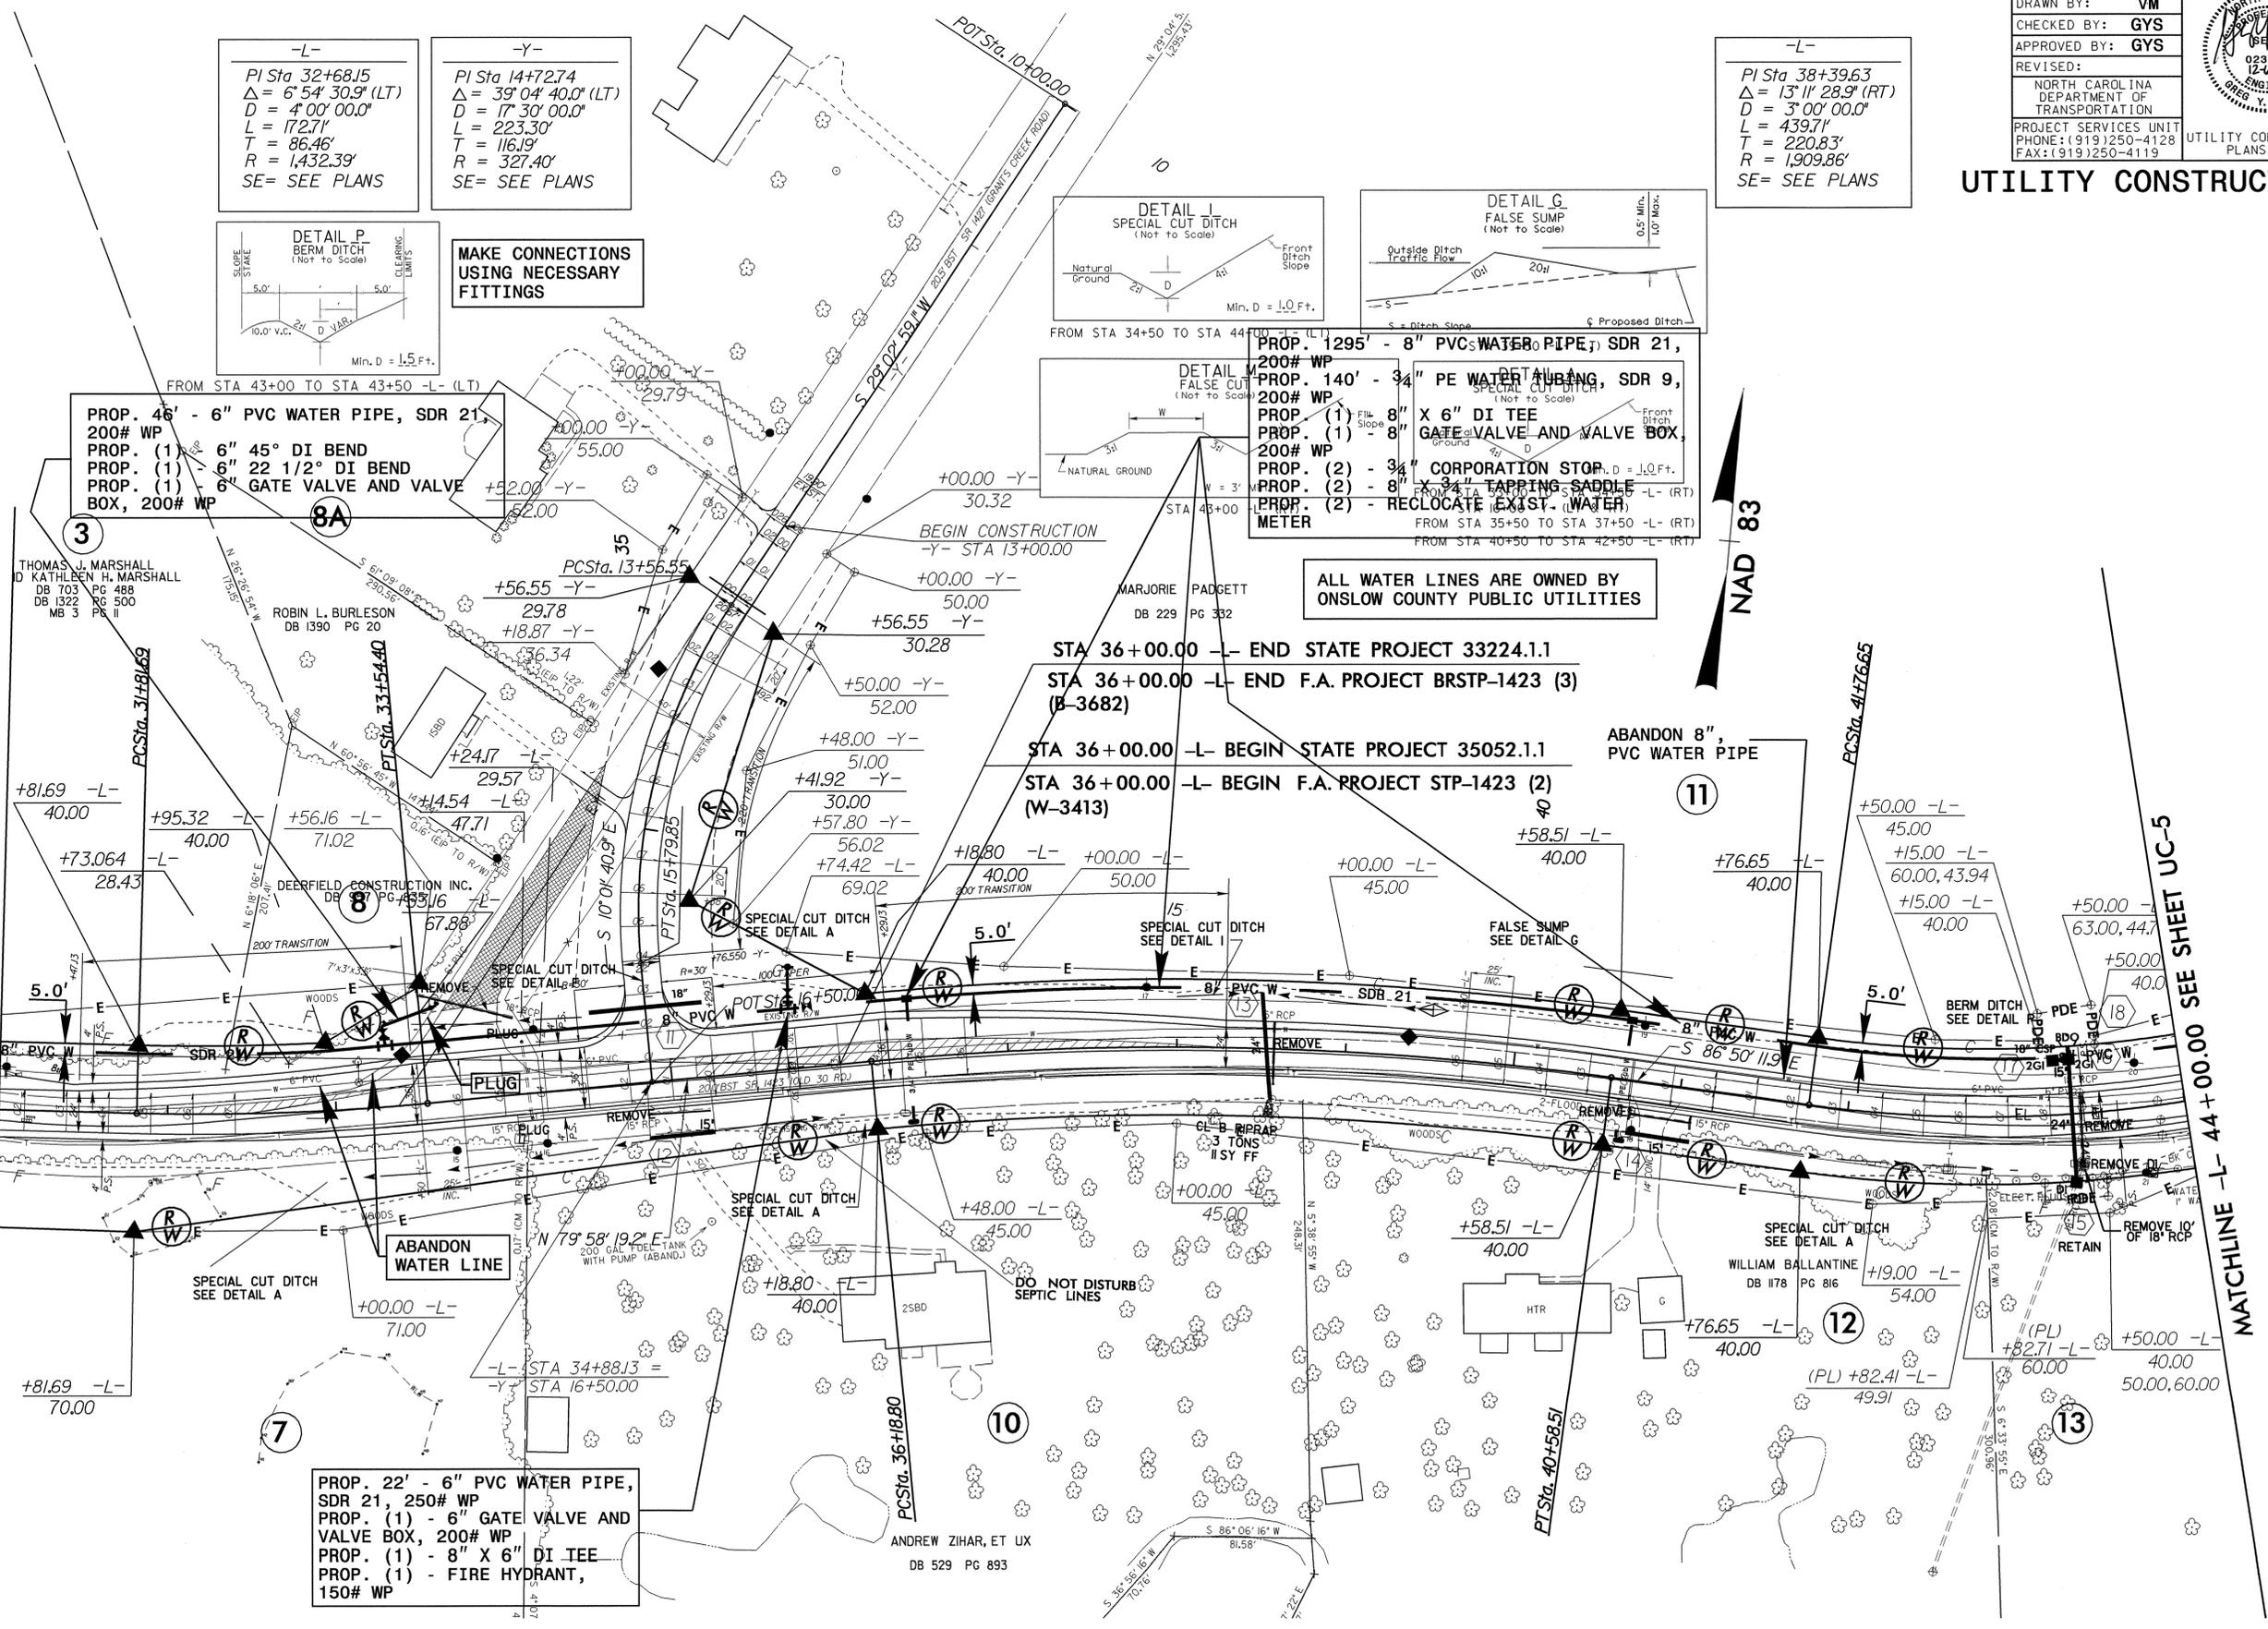

FROM STA 43+00 TO STA 43+50 -L- (LT)
 PROP. 46' - 6" PVC WATER PIPE, SDR 21,
 200# WP
 PROP. (1) - 6" 45° DI BEND
 PROP. (1) - 6" 22 1/2° DI BEND
 PROP. (1) - 6" GATE VALVE AND VALVE
 BOX, 200# WP

FROM STA 34+50 TO STA 44+00 -L- (LT)
 PROP. 1295' - 8" PVC WATER PIPE, SDR 21,
 200# WP
 PROP. 140' - 3/4" PE WATER MAIN, SDR 9,
 200# WP
 PROP. (1) - 8" X 6" DI TEE
 PROP. (1) - 8" GATE VALVE AND VALVE BOX,
 200# WP
 PROP. (2) - 3/4" CORPORATION STOP,
 200# WP
 PROP. (2) - 8" TAPPING SADDLE
 PROP. (2) - RELOCATE EXIST. WATER
 METER
 FROM STA 35+50 TO STA 37+50 -L- (RT)
 FROM STA 40+50 TO STA 42+50 -L- (RT)

ALL WATER LINES ARE OWNED BY ONSLOW COUNTY PUBLIC UTILITIES

STA 36+00.00 -L- END STATE PROJECT 33224.1.1
 STA 36+00.00 -L- END F.A. PROJECT BRSTP-1423 (3)
 (B-3682)
 STA 36+00.00 -L- BEGIN STATE PROJECT 35052.1.1
 STA 36+00.00 -L- BEGIN F.A. PROJECT STP-1423 (2)
 (W-3413)

ABANDON 8" PVC WATER PIPE

PROP. 22' - 6" PVC WATER PIPE,
 SDR 21, 250# WP
 PROP. (1) - 6" GATE VALVE AND
 VALVE BOX, 200# WP
 PROP. (1) - 8" X 6" DI TEE
 PROP. (1) - FIRE HYDRANT,
 150# WP

ANDREW ZIHAR, ET UX
DB 529 PG 893