| PROJECT REFERENCE NO. | SHEET NO. |
|---|---|
| 37631 | UC-3 |

DESIGNED BY: NSH
DRAWN BY: NSH
CHECKED BY: JSM
APPROVED BY: JSM
REVISED:

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
DESIGN SERVICES UNIT
PHONE:(919)250-4128
FAX:(919)250-4119

UTILITY CONSTRUCTION PLANS ONLY

# UTILITY CONSTRUCTION

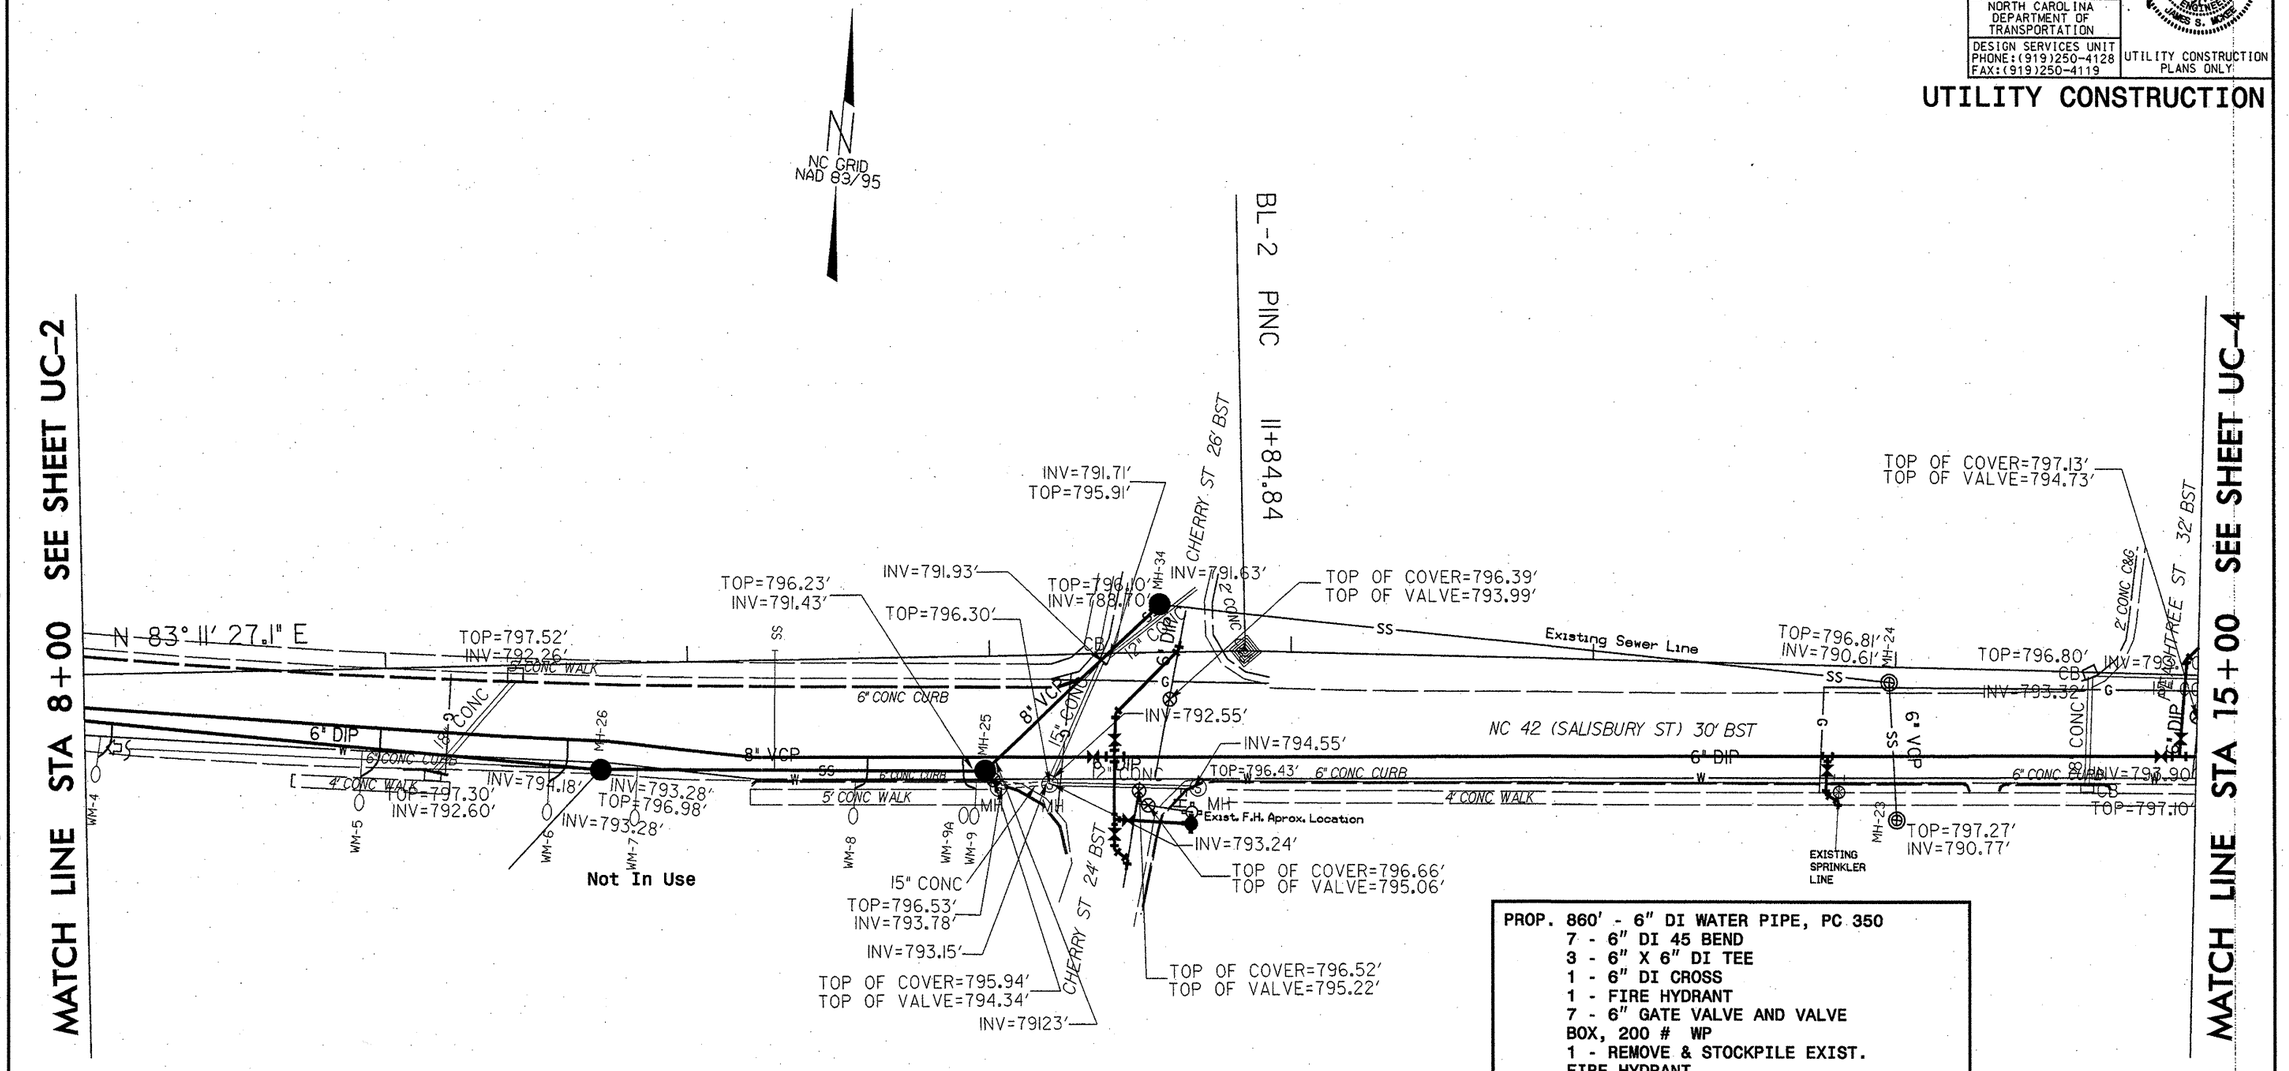


PROP. 860' - 6" DI WATER PIPE, PC 350
7 - 6" DI 45 BEND
3 - 6" X 6" DI TEE
1 - 6" DI CROSS
1 - FIRE HYDRANT
7 - 6" GATE VALVE AND VALVE BOX, 200 # WP
1 - REMOVE & STOCKPILE EXIST. FIRE HYDRANT
3 - 6" TRANSITION COUPLING (CI TO DI)

PROP. 380' - 8" DI SEWER PIPE, PC 350
3 - 4' DIA. PRECAST M.H.

NOTE: INSTALL SEWER PIPE IN EXISTING ALIGNMENT

PROP. 77' - ¾" COPPER WATER PIPE, TYPE K
4 - ¾" CORPORATION STOP
5 - ¾" CURB STOP
CONNECT USING NECESSARY FITTINGS

SCALE: 1" = 25'

8/17/99

14-MAR-2006 16:15
s:\specdes\utilities\lsm\nsh\ddc_and_wbs\wbs_37631_asheboro_randolphco\proj_psh\Salisbury_ut_UC3_S05_WBS_37631_Asheboro.dgn
nhamdan AT PS214518