


Project Special Provisions  
Structure

Table of Contents

	Page #
Maintenance & Protection of Traffic Beneath Proposed Structure at Station 79+49.43 -L- (8-13-04)	1
Pot Bearings (6-7-05)	2
Thermal Sprayed Coatings (Metallization) (6-7-05)	5
Evazote Joint Seals (8-13-04)	10
Elastomeric Concrete (10-12-01)	14
Falsework and Formwork (7-18-06)	16
Submittal of Working Drawings (9-16-08)	21
Optional Disc Bearings (6-7-05)	28
Crane Safety (8-15-05)	32
Piles (10-21-08)	33
Shipping Steel Structural Members (7-18-06)	43
Grout for Structures (7-12-07)	44
High Strength Bolts (11-17-06)	46
Adhesively Anchored Anchor Bolts or Dowels (6-11-07)	46
Direct Tension Indicators (6-12-09)	48
Curing Concrete (6-12-09)	49
Forms for Concrete Bridge Decks (6-12-09)	49
Soldier Pile Retaining Walls (6-12-09)	49

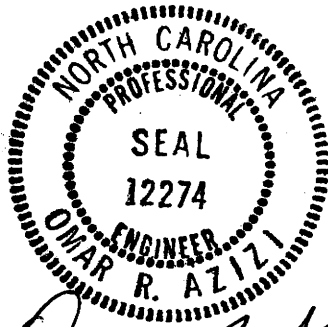

*Omar R. Azizi*  
6-12-09

**PROJECT SPECIAL PROVISIONS**  
**STRUCTURE**

PROJECT U-4444AA

CUMBERLAND COUNTY

**MAINTENANCE AND PROTECTION OF TRAFFIC**  
**BENEATH PROPOSED STRUCTURE AT STATION 79+49.43 -L-**

(8-13-04)

**1.0 GENERAL**

Maintain traffic on Honeycutt Road as shown in Traffic Control Plans and as directed by the Engineer.

Provide a minimum temporary vertical clearance of 16'-3" at all times during construction.

Submit plans and calculations for review and approval for protecting traffic and bracing girders, as described herein, at the above station before beginning work at this location. Have the drawings and design calculations prepared, signed, and sealed by a North Carolina Registered Professional Engineer. The approval of the Engineer will not relieve the Contractor of the responsibility for the safety of the method or equipment.

**2.0 PROTECTION OF TRAFFIC**

Protect traffic from any operation that affords the opportunity for construction materials, equipment, tools, etc. to be dropped into the path of traffic beneath the structure. Based on Contractor means and methods determine and clearly define all dead and live loads for this system, which, at a minimum, shall be installed between beams or girders over any travelway or shoulder area where traffic is maintained. Install the protective system before beginning any construction operations over traffic. In addition, for these same areas, keep the overhang falsework in place until after the rails have been poured.

**3.0 BRACING GIRDERS**

Brace girders to resist wind forces, weight of forms and other temporary loads, especially those eccentric to the vertical axis of the member during all stages of erection and construction. Before casting of intermediate diaphragms, decks, or connecting steel diaphragms do not allow the horizontal movement of girders to exceed ½ inch (13mm).

**4.0 BASIS OF PAYMENT**

Payment at the contract unit prices for the various pay items will be full compensation for the above work.

**POT BEARINGS****1.0 GENERAL**

This item consists of furnishing, fabrication and installation of pot bearings in accordance with AASHTO LRFD Bridge Design Specifications, the Standard Specifications, the recommendations of the manufacturer and the details shown on the plans and as specified herein.

Fixed pot bearings consist of a sole plate, a disc of elastomer in a steel cylinder with a snug fitting steel piston, masonry plate, anchor bolts, nuts and washers. Expansion pot bearings consist of a sole plate, a top steel plate with a polished stainless steel sheet facing bearing on a fixed pot bearing with a layer of virgin polytetrafluoroethylene (PTFE) material on its top, masonry plate, anchor bolt assembly which includes anchor bolts, nuts, washers, pipe sleeves, a closure plate, grout and various sizes of standard pipe and any other necessary material as detailed on the plans.

**2.0 MATERIALS**

Use pot bearings produced by the same manufacturer.

Use AASHTO M270 Grade 50W (345W) for all steel in the pot bearings. Clean, coat, and seal the plates in the pot bearing assemblies except for the areas with special facings and the internal surfaces of pot, in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)". Metallization of the internal surfaces of the pot is permitted provided these surfaces are then polished to a surface smoother than 60 micro inches (0.0015 mm). Coat surfaces to a thickness of 8 mils (0.200 mm) minimum on all external parts. Repair surfaces that are abraded or damaged after the application of metallizing in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)".

Galvanize all fill plates specified on the plans. Provide anchor bolts and nuts in accordance with the Standard Specifications.

When the maximum plan dimension of the sheet is 12" (300 mm) or less, provide a stainless steel sheet in expansion pot bearings that is at least 16 gage or 1/16" (1.6 mm). When the maximum plan dimension is greater than 12" (300 mm), provide a stainless steel sheet that is at least 11 gage or 1/8" (3 mm). Ensure that all stainless steel sheets are in conformance with ASTM A240/A167 Type 304 and polished to a minimum #8 mirror surface finish.

Blast clean the surface of the plate that will be attached to the stainless sheet to a near white condition in accordance with the Standard Specifications. Position and clamp the back of the stainless sheet that is to be in contact with the steel plate on the steel plate. Apply the stainless steel to the blast cleaned surface of the steel plate as soon as possible after blasting and before any visible oxidation of the blast cleaned surface occurs. Weld the stainless sheet continuously around its perimeter using a tungsten inert gas, wire-fed welder.

For the PTFE sheet, used as a mating surface for the stainless sheet, provide an unfilled virgin PTFE Sheet (Recessed) or a glass-fiber filled PTFE sheet, resulting from skiving billets formed under hydraulic pressure and heat. Provide resin that conforms to the requirements of ASTM D4894 or D4895.

To bond the PTFE and the piston, use heat cured high temperature epoxy capable of withstanding temperature of -320°F to 500°F (-195°C to 260°C).

Provide a neoprene or natural rubber elastomer with a durometer hardness of 50 that allows for a minimum rotation of 0.02 radians. Place a 1/64" (0.4 mm) thick unfilled PTFE disc on either side of the elastomer inside the bearing. Use a brass sealing ring with the neoprene or natural rubber elastomer.

### 3.0 DESIGN

Have the manufacturer design the pot bearings for the loads and movements shown on the contract plans. However, use the anchor bolt size, length, spacing and masonry plate thickness as shown on the contract plans and provide an overall height of the bearing assembly that is at least the height shown on the contract plans, but no more than 1/2 inch (13 mm) greater than this height. Either combine, cast as a single piece, or weld together the sole plate and top plate/piston and the cylinder with the masonry plate.

When designing the bearings, use the following allowable bearing stresses:

- On confined elastomer: 3500 psi (24.1 MPa)
- On PTFE Sliding Surface, filled or unfilled PTFE (recessed): 3500 psi (24.1 MPa)

Submit eight sets of shop drawings and one set of design calculations for review, comments and acceptance. Have a North Carolina Registered Professional Engineer check and seal the shop drawings and design calculations.

After the Engineer reviews the drawings and, if necessary, corrections are made, submit one 22" x 34" reproducible set of the working drawings.

### 4.0 SAMPLING AND TESTING

#### A. Sampling

The manufacturer is responsible for randomly selecting and testing sample bearings from completed lots of bearings. The manufacturer is also responsible for certifying that the completed bearings and their components have been tested and are in compliance with the requirements of this Special Provision. The manufacturer shall furnish results of the tests to the Materials and Tests Engineer.

## B. Testing

### 1. Proof Load Test

Load a test bearing to 150% of the bearing's rated design capacity and simultaneously subject it to a rotational range of 0.02 radians (1.146°) for a period of 1 hour.

Have the bearing visually examined both during the test and upon disassembly after the test. Any resultant visual defects, such as extruded or deformed elastomer or PTFE, damaged seals or rings, or cracked steel is cause for rejection.

Keep the steel bearing plate and steel piston in continuous and uniform contact for the duration of the test. Any observed lift-off is cause for rejection.

### 2. Sliding Coefficient of Friction

For all guided and non-guided expansion type bearings, measure the sliding coefficient of friction at the bearing's design capacity in accordance with the test method described below, and on the fifth and fiftieth cycles, at a sliding speed of 1 in/min (25 mm/min).

Calculate the sliding coefficient of friction as the horizontal load required to maintain continuous sliding of one bearing, divided by the bearing's vertical design capacity.

The test results are evaluated as follows:

- A maximum measured sliding coefficients of friction of 3%.
- A visual examination both during and after the test. Any resultant visual defects, such as bond failure, physical destruction, cold flow of PTFE to the point of debonding, or damaged components is cause for rejection of the lot.

Using undamaged test bearings in the work is permitted.

### 3. Test Method

For the test method and equipment, meet the following requirements:

- a. Arrange the test to determine the coefficient of friction on the first movement of the manufactured bearing.
- b. Clean the bearing surface prior to testing.
- c. Conduct the test at maximum working stress for the PTFE surface with the test load applied continuously for 12 hours prior to measuring friction.

- d. Determine the first movement static and dynamic coefficient of friction of the test bearing at a sliding speed of less than 1 in/min (25 mm/min), not to exceed:
- |      |               |
|------|---------------|
| 0.04 | unfilled PTFE |
| 0.08 | filled PTFE   |
- e. Subject the bearing specimen to 100 movements of at least 1 inch (25 mm) of relative movement and, if the test facility permits, the full design movement at a speed of less than 1 ft/min (300 mm/min). Following this test determine the static and kinetic coefficient of friction again. The specimen is considered a failure if it exceeds the values measured in (d) above or if it shows any signs of bond failure or other defects.

Bearings represented by test specimens passing the above requirements are approved for use in the structure subject to on-site inspection for visible defects.

## 5.0 INSTALLATION

Prior to shipment, seal the joint between the steel piston and the steel cylinder with a bead of caulk. Store pot bearings delivered to the bridge site under cover on a platform above the ground surface. Protect the bearings from injury at all times and, before placing the bearings, dry and clean all dirt, oil, grease or other foreign substances from the bearing. Do not disassemble the bearings during installation, except at the manufacturer's direction. Place the bearings in accordance with the recommendations of the manufacturer, Contract Drawings, and as directed by the Engineer. If there is any discrepancy between the recommendations of the manufacturer, Special Provisions, and Contract Drawings, the Engineer is the sole judge in reconciling any such discrepancy.

Provide preformed bearing pads under the masonry plates in accordance with Article 1079-1 of the Standard Specifications.

Do not install any bearing before the Engineer approves it.

## 6.0 BASIS OF PAYMENT

Payment will be at the lump sum contract price bid for "Pot Bearings" which price will be full compensation for furnishing all labor, materials, tools, equipment and incidentals required to complete the work in accordance with the Standard Specifications, this Special Provision, the manufacturer's requirements and as directed by the Engineer.

## THERMAL SPRAYED COATINGS (METALLIZATION)

(6-07-05)

### 1.0 DESCRIPTION

Apply a thermal sprayed coating (TSC) and sealer to metal surfaces as specified herein when called for on the plans or by other Special Provisions, or when otherwise approved by the Engineer in accordance with the SSPC-CS 23.00/AWS C2.23/NACE No. 12

Specification. Only Arc Sprayed application methods are used to apply TSC coatings, the Engineer must approve other methods of application.

## 2.0 QUALIFICATIONS

Only use NCDOT approved TSC Contractors meeting the following requirements:

1. Who have the capability of blast cleaning steel surfaces to SSPC SP-5 and SP-10 Finishes.
2. Who employ a Spray Operator(s) qualified in accordance with AWS C.16/C2.16M2002 and a Quality Control Inspector(s) who have documented training in the applicable test procedures of ASTM D-3276 and SSPC-CS 23.00.

A summary of the contractor's related work experience and the documents verifying each Spray Operator's and Quality Control Inspector's qualifications are submitted to the Engineer before any work is performed.

## 3.0 MATERIALS

Provide wire in accordance with the metallizing equipment manufacturer's recommendations. Use the wire alloy specified on the plans which meets the requirements in Annex C of the SSPC-CS 23.00 Specification. Have the contractor provide a certified analysis (NCDOT Type 2 Certification) for each lot of wire material.

Apply an approved sealer to all metallized surfaces in accordance with Section 9 of SSPC-CS 23. The sealer must either meet SSPC Paint 27 or is an alternate approved by the Engineer.

## 4.0 SURFACE PREPARATION AND TSC APPLICATION

Grind flame cut edges to remove the carbonized surface prior to blasting. Bevel all flame cut edges in accordance with Article 442-10(D) regardless of included angle. Blast clean surfaces to be metallized with grit or mineral abrasive in accordance with Steel Structures Painting Council SSPC SP-5/10(as specified) to impart an angular surface profile of 2.5 - 4.0 mils (0.063 - 0.100 mm). Surface preparation hold times are in accordance with Section 7.32 of SSPC-CS 23. If flash rusting occurs prior to metallizing, blast clean the metal surface again. Apply the thermal sprayed coating only when the surface temperature of the steel is at least 5°F (3°C) above the dew point.

At the beginning of each work period or shift, conduct bend tests in accordance with Section 6.5 of SSPC-CS 23.00. Any disbonding or delamination of the coating that exposes the substrate requires corrective action, additional testing, and the Engineer's approval before resuming the metallizing process.

Apply TSC with the alloy to the thickness specified on the plans or as provided in the table below. All spot results (the average of 3 to 5 readings) must meet the minimum requirement. No additional tolerance (as allowed by SSPC PA-2) is permitted. (For Steel

Beams: For pieces with less than 200 ft<sup>2</sup> (18.6m<sup>2</sup>) measure 2 spots/surface per piece and for pieces greater than 200 ft<sup>2</sup> (18.6m<sup>2</sup>) add 1 additional spots/surface for each 500 ft<sup>2</sup> (46.5m<sup>2</sup>).

<b>Application</b>	<b>Thickness</b>	<b>Alloy</b>	<b>Seal Coat</b>
Pot Bearings	8 mil	85/15 Zinc (W-Zn-Al-2)	0.5 mil
Armored Joint Angles	8 mil	85/15 Zinc (W-Zn-Al-2)	0.5 mil
Modular Joints	8 mil	99.99% Zn (W-Zn-1)	0.5 mil
Expansion Joint Seals	8 mil	99.99% Zn (W-Zn-1)	0.5 mil
Optional Disc Bearings	8 mil	85/15 Zinc (W-Zn-Al-2)	0.5 mil

When noted on the plans or as specified in the above chart, apply the sealer to all metallized surfaces in accordance with the manufacturer's recommendations and these provisions. Apply the seal coat only when the air temperature is above 40°F (4°C) and the surface temperature of the steel is at least 5°F (3°C) above the dew point. If the sealer is not applied within eight hours after the final application of TSC, the applicator verifies acceptable TSC surfaces and obtains approval from the Engineer before applying the sealer.



## 5.0 INSPECTION FREQUENCY

The TSC Contractor must conduct the following tests at the specified frequency and the results documented in a format approved by the Engineer.

Test/Standard	Location	Frequency	Specification
Ambient Conditions	Site	Each Process	5°F (3°C) above the dew point
Abrasive Properties	Site	Each Day	Size, angularity, cleanliness
Surface Cleanliness SSPC Vis 1	All Surfaces	Visual All Surfaces	SSPC-SP-10 Atmospheric Service SSPC-SP - 5 Immersion Service
Surface Profile ASTM D-4417 Method C	Random Surfaces	3 per 500 ft <sup>2</sup>	2.5 - 4.0 mils
Bend Test SSPC-CS 23.00	Site	5 per shift	Pass Visual
Thickness SSPC PA-2R SSPC-CS 23.00	Each Surface	Use the method in PA-2 Appendix 3 for Girders and Appendix 4 for frames and miscellaneous steel. See Note 1.	Zn - 8 mils minimum Al - 8 mils minimum Zn Al - 8 mils minimum  Areas with more than twice the minimum thickness are inspected for compliance to the adhesion and cut testing requirements of this specification.
Adhesion ASTM 4541	Random Surfaces Splice Areas	1 set of 3 per 500 ft <sup>2</sup>	Zn > 500 psi Al > 1000 psi Zn Al > 750 psi
Cut Test - SSPC-CS 23.00	Random Surfaces	3 sets of 3 per 500 ft <sup>2</sup>	No peeling or delamination
Job Reference Std. SSPC-CS 23.00	Site	1 per job	Meets all the above requirements

## 6.0 REPAIRS

All Repairs are to be performed in accordance with the procedures below, depending on whether the repair surface is hidden or exposed. As an exception to the following, field welded splices on joint angles and field welding bearing plates to girders may be repaired in accordance with the procedures for hidden surfaces.

**For hidden surfaces (including but not limited to interior girders, interior faces of exterior girders, and below-grade sections of piles):**

1. Welding of metallized surfaces may be performed only if specifically permitted by the Engineer. Remove metallizing at the location of field welds by blast cleaning (SSPC SP-6 finish), or hand (SSPC SP-2 finish) or power tool cleaning (SSPC SP-3 finish) just prior to welding. Clean sufficiently to prevent contamination of the weld. All repairs to welded connections are metallized in accordance with SSPC CS 23.00.
2. Minor areas less than or equal to  $0.1 \text{ ft}^2$  ( $9300\text{mm}^2$ ) exposing the substrate are metallized in accordance with SSPC CS 23.00 or painted in accordance with ASTM A780, "Repair of Damaged and Uncoated Areas of Hot Dip Galvanized Coatings."
3. Large areas greater than  $0.1 \text{ ft}^2$  ( $9300\text{mm}^2$ ) exposing the substrate are metallized in accordance with SSPC CS 23.00.
4. Damaged (burnished) areas not exposing the substrate with less than the specified coating thickness are metallized in accordance with SSPC CS 23.00 or painted in accordance with ASTM A780, "Repair of Damaged and Uncoated Areas of Hot Dip Galvanized Coatings."
5. Damaged (burnished) areas not exposing the substrate with more than the specified coating thickness are not repaired.
6. Defective coating is repaired by either method 2 or 3 depending on the area of the defect.

**For Exposed Surfaces (including but not limited to exterior faces of exterior girders and above-grade sections of piles):**

1. Welding of metallized surfaces may be performed only if specifically permitted by the Engineer. Remove metallization at the location of field welds by blast cleaning (SSPC SP-6 finish), or hand (SSPC SP-2 finish) or power tool cleaning (SSPC SP-3 finish) just prior to welding. Clean sufficiently to prevent contamination of the weld. All repairs to welded connections are metallized in accordance with SSPC CS 23.00.
2. All areas exposing the substrate are metallized in accordance with SSPC CS 23.00
3. Defective coating is repaired by either method 2 or 3 depending on the area of the defect.

#### **7.0 TWELVE MONTH OBSERVATION PERIOD**

The contractor maintains responsibility for the coating system for a twelve (12) month observation period beginning upon the satisfactory completion of all the work required in the plans or as directed by the engineer. The contractor must guarantee the coating system under the payment and performance bond (refer to article 109-10). To successfully

complete the observation period, the coating system must meet the following requirements after twelve(12) months service:

- No visible rust, contamination or application defect is observed in any coated area.
- Painted surfaces have a uniform color and gloss.
- Surfaces have an adhesion of no less than 500 psi (3.45 MPa) when tested in accordance with ASTM D-4541.

**8.0 BASIS OF PAYMENT**

The contract price bid for the bridge component to which the coating is applied will be full compensation for the thermal sprayed coating.

**EVAZOTE JOINT SEALS**

**(8-13-04)**

**1.0 SEALS**

Use preformed seals compatible with concrete and resistant to abrasion, oxidation, oils, gasoline, salt and other materials that are spilled on or applied to the surface. Use a low-density closed cell, cross-linked ethylene vinyl acetate polyethylene copolymer nitrogen blown material for the seal.

Use seals manufactured with grooves 1/8" (3 mm) ± wide by 1/8" (3 mm) ± deep and spaced between 1/4 (6 mm) and 1/2 inch (13 mm) apart along the bond surface running the length of the joint. Use seals sized so that the depth of the seal meets the manufacturer's recommendation, but is not less than 70% of the uncompressed width. Provide a seal designed so that, when compressed, the center portion of the top does not extend upward above the original height of the seal by more than 1/4 inch (6 mm). Splice the seal using the heat welding method by placing the joint material ends against a teflon heating iron of 350°F (177°C) for 7 - 10 seconds, then pressing the ends together tightly. Do not test the welding until the material has completely cooled. Use material that resists weathering and ultraviolet rays. Provide a seal that has a working range of 30% tension and 60% compression and is watertight along its entire length including the ends.

Provide seals that meet the requirements given below.

TEST	TEST METHOD	REQUIREMENT
Elongation at break	ASTM D3575	210 ± 15%
Tensile strength, psi (kPa)	ASTM D3575	110 ± 15 (755 ± 100)
Compression Recovery (% of original width)	AASHTO T42 50% compr. for 22 hr. @ 73°F (23°C) 1/2 hr. recovery	87 ± 3

TEST	TEST METHOD	REQUIREMENT
Weather/Deterioration	AASHTO T42 Accelerated Weathering	No deterioration for 10 years min.
Compression/Deflection	@ 50% deflection of original width  @ 50% deflection of original width	10 psi (69 kPa) min.  60 psi (414 kPa) max.
Tear Strength, psi (kPa)	ASTM D624	16 ± 3 (110 ± 20)
Density	ASTM D545	2.8 to 3.4
Water Absorption (% vol/vol)	ASTM D3575 Total immersion for 3 months	3

Have the top of the evazote seal clearly shop marked. Inspect the evazote seals upon receipt to ensure that the marks are clearly visible upon installation.

**2.0 ADHESIVES**

Use a two component, 100% solid, modified epoxy adhesive with the seal that meets the requirements of ASTM C881, Type 1, Grade 3, Class B & C and has the following physical properties:

- Tensile strength..... 3500 psi (24.1 MPa) min.
- Compressive strength..... 7000 psi (48.3 MPa) min.
- Shore D Hardness ..... 75 psi (0.5 MPa) min.
- Water Absorption..... 0.25% by weight

Use an adhesive that is workable to 40°F (4°C). When installing in temperatures below 40°F (4°C) or for application on moist, difficult to dry concrete surfaces, use an adhesive specified by the manufacturer of the joint material.

**3.0 SAWING THE JOINTS**

When the plans call for sawing the joints, the joints shall be initially formed to a width as shown on the plans including the blackout for the elastomeric concrete. Complete placement of the elastomeric concrete after the reinforced concrete deck slab has cured for seven full days and reached a minimum strength of 3000 psi (20.7 Mpa).

Cure the elastomeric concrete for a minimum of 2 days prior to sawing the elastomeric concrete to the final width and depth as specified in the plans.

When sawing the joint to receive the evazote seal, always use a rigid guide to control the saw in the desired direction. To control the saw and to produce a straight line as indicated on the plans, anchor and positively connect a template or a track to the bridge deck. Do not saw the joint by visual means such as a chalk line. Fill the holes used for holding the template or track to the deck with an approved, flowable non-shrink, non-metallic grout.

Saw cut to the desired width and depth in one or two passes of the saw by placing and spacing two metal blades on the saw shaft to the desired width for compression seals.

The desired depth is the depth of the seal plus 1/4 inch (6 mm) above the top of the seal plus approximately 1 inch (25 mm) below the bottom of the seal. An irregular bottom of sawed joint is permitted as indicated on the plans. Grind exposed corners on saw cut edges to a 1/4" (6 mm) chamfer.

Remove any staining or deposited material resulting from sawing with a wet blade to the satisfaction of the Engineer.

Use extreme care to saw the joint straight to the desired width and to prevent any chipping or damage to sawed edges of the joint.

#### **4.0 PREPARATIONS FOR SAWED JOINTS**

When the plans call for sawing the joint, the Engineer thoroughly inspects the sawed joint opening for spalls, popouts, cracks, etc. Make all necessary repairs prior to blast cleaning and installing the seal.

Immediately before sealing, clean the joints by sandblasting with clean dry sand. Sandblast to provide a firm, clean joint surface free of curing compound, loose material and any foreign matter. Sandblast without causing pitting or uneven surfaces. The aggregate in the elastomeric concrete may be exposed after sandblasting.

After blasting, either brush the surface with clean brushes made of hair, bristle or fiber, blow the surface with compressed air, or vacuum the surface until all traces of blast products and abrasives are removed from the surface, pockets, and corners.

If nozzle blasting, use compressed air that does not contain detrimental amounts of water or oil.

Examine the blast cleaned surface and remove any traces of oil, grease or smudge deposited in the cleaning operations.

Bond the seal to the blast cleaned surface on the same day the surface is blast cleaned.

#### **5.0 PREPARATIONS FOR ARMORED JOINTS**

When the plans call for armored joints, form the joint and blockout openings in accordance with the plans. If preferred, wrap the temporary form with polyethylene sheets to allow for easier removal. Do not use form release agents.

##### **A. Submittals**

Submitting detailed working drawings is not required; however, submitting catalog cuts of the proposed material is required. In addition, direct the joint supplier to provide an angle segment placing plan.

## B. Surface Preparation

Prepare the surface within the 48 hours prior to placing the elastomeric concrete. Do not place the elastomeric concrete until the surface preparation is completed and approved.

### 1. Angle Assembly

Clean and free metallized steel of all foreign contaminants and blast the non-metallized steel surfaces to SSPC SP-10. Blast-cleaning anchor studs is not required.

### 2. Concrete

Prior to placing the elastomeric concrete, thoroughly clean and dry all concrete surfaces. Sandblast the concrete surface in the blockout and clear the surface of all loose debris.

## C. Elastomeric Concrete Placement

Make sure that a manufacturer's representative is present when placing elastomeric concrete. Do not place elastomeric concrete if the ambient air temperature is below 45°F (7°C).

Prepare and apply a primer, as per manufacturer's recommendations, to all vertical concrete faces, all steel components to be in contact with elastomeric concrete, and to areas specified by the manufacturer. Align the angles with the joint opening.

Prepare, batch, and place the elastomeric concrete in accordance with the manufacturer's instructions. Place the elastomeric concrete in the areas specified on the plans while the primer is still tacky and within 2 hours after applying the primer. Pay careful attention to properly consolidate the concrete around the steel and anchors. Trowel the elastomeric concrete to a smooth finish.

## D. Joint Preparation

Prior to installing the seal, the Engineer thoroughly inspects the armored joint opening for proper alignment and full consolidation of elastomeric concrete under the angle assemblies. Make all necessary repairs prior to cleaning the joint opening and installing the seal.

Clean the armored joint opening with a pressure washer rated at 3000 psi (20.7 MPa) minimum at least 24 hours after placing the elastomeric concrete. Dry the cleaned surface prior to installing the seal.

Examine the cleaned surface and remove traces of oil, grease or smudge deposited during the cleaning operations.

Bond the seal to the cleaned surface on the same day the surface is cleaned.

## 6.0 SEAL INSTALLATION

Install the joint seal according to the manufacturer's procedures and recommendations and as recommended below. Do not install the joint seal if the ambient air temperature is below 45°F (7°C). Have a manufacturer's representative present during the installation of the first seal of the project.

Begin installation at the low end of the joint after applying the mixed epoxy to the sides of both the joint material and both sides of the joint, making certain to completely fill the grooves with epoxy. With gloved hands, compress the material and with the help of a blunt probe, push it down into the joint until it is recessed approximately 1/4 inch (6 mm) below the surface. Do not push the seal at an angle that would stretch the material. Once work on a joint begins, do not stop until it is completed. Clean the excess epoxy off the surface of the joint material *quickly* and *thoroughly*. Do not use solvents to remove excess epoxy. Remove excess epoxy in accordance with the joint manufacturer's recommendations.

Install the seal so that it is watertight. Testing of the joint seal is not required, but it is observed until final inspection.

## 7.0 BASIS OF PAYMENT

Payment for all evazote joint seals will be at the lump sum contract price bid for "Evazote Joint Seals" which prices and payment will be full compensation for furnishing all material, including elastomeric concrete when required, labor, tools and equipment necessary for installing these units in place and accepted.

## ELASTOMERIC CONCRETE

(10-12-01)

### 1.0 DESCRIPTION

Elastomeric concrete is a mixture of a two-part polymer consisting of polyurethane and/or epoxy, and kiln-dried aggregate. Have the manufacturer supply it as a unit. Use the concrete in the blocked out areas on both sides of the bridge deck joints as indicated on the plans.

**2.0 MATERIALS**

Provide materials that comply with the following minimum requirements at 14 days.

CONCRETE PROPERTIES	TEST METHOD	MINIMUM REQUIREMENT
Bond Strength to Concrete, psi (MPa)	<sup>(a)</sup> STM D638 (D638M)	450 (3.1)
Brittleness by Impact, ft-lb (kg-m)	Ball Drop	7 (0.97)
Compressive Strength, psi (MPa)	ASTM D695 (D695M)	2800 (19.3)

BINDER PROPERTIES (without aggregate)	TEST METHOD	MINIMUM REQUIREMENT
Tensile Strength, psi (MPa)	ASTM D638 (D638M)	800 (5.5)
Ultimate Elongation	ASTM D638 (D638M)	150%
Tear Resistance, lb/in (kN/m)	ASTM D624	90 (15.7)

In addition to the requirements above, use elastomeric concrete that also resists water, chemical, UV, and ozone exposure and withstands extreme temperature (freeze-thaw) changes.

Furnish a manufacturer's certification verifying that the materials satisfy the above requirements. Provide samples of elastomeric concrete to the Engineer, if requested, to independently verify conformance with the above requirements.

Require a manufacturer's representative to be present on site during the installation of the elastomeric concrete.

**3.0 BASIS OF PAYMENT**

No separate payment will be made for elastomeric concrete. The lump sum contract price bid for "Evazote Joint Seals" will be full compensation for furnishing and placing the Elastomeric Concrete.



**FALSEWORK AND FORMWORK**

(7-18-06)

**1.0 DESCRIPTION**

Use this Special Provision as a guide to develop temporary works submittals required by the Standard Specifications or other provisions; no additional submittals are required herein. Such temporary works include, but are not limited to, falsework and formwork.

Falsework is any temporary construction used to support the permanent structure until it becomes self-supporting. Formwork is the temporary structure or mold used to retain plastic or fluid concrete in its designated shape until it hardens. Access scaffolding is a temporary structure that functions as a work platform that supports construction personnel, materials, and tools, but is not intended to support the structure. Scaffolding systems that are used to temporarily support permanent structures (as opposed to functioning as work platforms) are considered to be falsework under the definitions given. Shoring is a component of falsework such as horizontal, vertical, or inclined support members. Where the term "temporary works" is used, it includes all of the temporary facilities used in bridge construction that do not become part of the permanent structure.

Design and construct safe and adequate temporary works that will support all loads imposed and provide the necessary rigidity to achieve the lines and grades shown on the plans in the final structure.

**2.0 MATERIALS**

Select materials suitable for temporary works; however, select materials that also ensure the safety and quality required by the design assumptions. The Engineer has authority to reject material on the basis of its condition, inappropriate use, safety, or nonconformance with the plans. Clearly identify allowable loads or stresses for all materials or manufactured devices on the plans. Revise the plan and notify the Engineer if any change to materials or material strengths is required.

**3.0 DESIGN REQUIREMENTS****A. Working Drawings**

Provide working drawings for items as specified in the contract, or as required by the Engineer, with design calculations and supporting data in sufficient detail to permit a structural and safety review of the proposed design of the temporary work.

When concrete placement is involved, include data such as the drawings of proposed sequence, rate of placement, direction of placement, and location of all construction joints. Submit the number of copies as called for by the contract.

When required, have the drawings and calculations prepared under the guidance of, and sealed by, a North Carolina Registered Professional Engineer who is knowledgeable in temporary works design.

Design falsework and formwork requiring submittals in accordance with the 1995 AASHTO *Guide Design Specifications for Bridge Temporary Works* except as noted herein.

### 1. Wind Loads

Table 2.2 of Article 2.2.5.1 is modified to include wind velocities up to 110 mph (177 km/hr). In addition, Table 2.2A is included to provide the maximum wind speeds by county in North Carolina.

**Table 2.2 - Wind Pressure Values**

Height Zone feet (m) above ground	Pressure, lb/ft <sup>2</sup> (kPa) for Indicated Wind Velocity, mph (km/hr)				
	70 (112.7)	80 (128.7)	90 (144.8)	100 (160.9)	110 (177.0)
0 to 30 (0 to 9.1)	15 (0.72)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)
30 to 50 (9.1 to 15.2)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)
50 to 100 (15.2 to 30.5)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)
over 100 (30.5)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)	50 (2.39)

### 2. Time of Removal

The following requirements replace those of Article 3.4.8.2.

Do not remove forms until the concrete has attained strengths required in Article 420-16 of the Standard Specifications and these Special Provisions.

Do not remove forms until the concrete has sufficient strength to prevent damage to the surface.

**Table 2.2A - Steady State Maximum Wind Speeds by Counties in North Carolina**

COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)
Alamance	70 (112.7)	Franklin	70 (112.7)	Pamlico	100 (160.9)
Alexander	70 (112.7)	Gaston	70 (112.7)	Pasquotank	100 (160.9)
Alleghany	70 (112.7)	Gates	90 (144.8)	Pender	100 (160.9)
Anson	70 (112.7)	Graham	80 (128.7)	Perquimans	100 (160.9)
Ashe	70 (112.7)	Granville	70 (112.7)	Person	70 (112.7)
Avery	70 (112.7)	Greene	80 (128.7)	Pitt	90 (144.8)
Beaufort	100 (160.9)	Guilford	70 (112.7)	Polk	80 (128.7)
Bertie	90 (144.8)	Halifax	80 (128.7)	Randolph	70 (112.7)
Bladen	90 (144.8)	Harnett	70 (112.7)	Richmond	70 (112.7)
Brunswick	100 (160.9)	Haywood	80 (128.7)	Robeson	80 (128.7)
Buncombe	80 (128.7)	Henderson	80 (128.7)	Rockingham	70 (112.7)
Burke	70 (112.7)	Hertford	90 (144.8)	Rowan	70 (112.7)
Cabarrus	70 (112.7)	Hoke	70 (112.7)	Rutherford	70 (112.7)
Caldwell	70 (112.7)	Hyde	110 (177.0)	Sampson	90 (144.8)
Camden	100 (160.9)	Iredell	70 (112.7)	Scotland	70 (112.7)
Carteret	110 (177.0)	Jackson	80 (128.7)	Stanley	70 (112.7)
Caswell	70 (112.7)	Johnston	80 (128.7)	Stokes	70 (112.7)
Catawba	70 (112.7)	Jones	100 (160.9)	Surry	70 (112.7)
Cherokee	80 (128.7)	Lee	70 (112.7)	Swain	80 (128.7)
Chatham	70 (112.7)	Lenoir	90 (144.8)	Transylvania	80 (128.7)
Chowan	90 (144.8)	Lincoln	70 (112.7)	Tyrell	100 (160.9)
Clay	80 (128.7)	Macon	80 (128.7)	Union	70 (112.7)
Cleveland	70 (112.7)	Madison	80 (128.7)	Vance	70 (112.7)
Columbus	90 (144.8)	Martin	90 (144.8)	Wake	70 (112.7)
Craven	100 (160.9)	McDowell	70 (112.7)	Warren	70 (112.7)
Cumberland	80 (128.7)	Mecklenburg	70 (112.7)	Washington	100 (160.9)
Currituck	100 (160.9)	Mitchell	70 (112.7)	Watauga	70 (112.7)
Dare	110 (177.0)	Montgomery	70(112.7)	Wayne	80 (128.7)
Davidson	70 (112.7)	Moore	70 (112.7)	Wilkes	70 (112.7)
Davie	70 (112.7)	Nash	80 (128.7)	Wilson	80 (128.7)
Duplin	90 (144.8)	New Hanover	100 (160.9)	Yadkin	70 (112.7)
Durham	70 (112.7)	Northampton	80 (128.7)	Yancey	70 (112.7)
Edgecombe	80 (128.7)	Onslow	100 (160.9)		
Forsyth	70 (112.7)	Orange	70 (112.7)		

Note on the working drawings any anchorages, connectors, inserts, steel sleeves or other such devices used as part of the falsework or formwork that remains in the permanent structure. If the plan notes indicate that the structure contains the necessary corrosion protection required for a Corrosive Site, epoxy coat, galvanize, metallize or otherwise protect these devices as directed by the Engineer. Any coating required by the Engineer will be considered incidental to the various pay items requiring temporary works.

#### B. Review and Approval

The Engineer is responsible for the review and approval of temporary works' drawings.

Submit the working drawings sufficiently in advance of proposed use to allow for their review, revision (if needed), and approval without delay to the work.

Do not start construction of any temporary work for which working drawings are required until the drawings have been approved. Such approval does not relieve the Contractor of the responsibility for the accuracy and adequacy of the working drawings.

The time period for review of the working drawings does not begin until complete drawings and design calculations, when required, are received by the Engineer.

On the drawings, show all information necessary to allow the design of any component to be checked independently as determined by the Engineer.

If requested by the Engineer, submit with the working drawings manufacturer's catalog data listing the weight of all construction equipment that will be supported on the temporary work. Show anticipated total settlements and/or deflections of falsework and forms on the working drawings. Include falsework footing settlements, joint take-up, and deflection of beams or girders. Falsework hangers that support concentrated loads and are installed at the edge of thin top flange concrete girders (such as bulb tee girders) shall be spaced so as not to exceed 75% of the manufacturer's stated safe working load. Use of dual leg hangers (such as Meadow Burke HF-42 and HF-43) are not allowed. Design the falsework and forms supporting deck slabs and overhangs on girder bridges so that there will be no differential settlement between the girders and the deck forms during placement of deck concrete.

#### 4.0 CONSTRUCTION REQUIREMENTS

All requirements of Section 420 of the Standard Specifications apply.

Construct temporary works in conformance with the approved working drawings. Ensure that the quality of materials and workmanship employed is consistent with that assumed in the design of the temporary works. Do not weld falsework members to any portion of the permanent structure unless approved. Show any welding to the permanent structure on the approved construction drawings.

Provide tell-tales attached to the forms and extending to the ground, or other means, for accurate measurement of falsework settlement. Make sure that the anticipated compressive settlement and/or deflection of falsework does not exceed 1 inch (25 mm). For cast-in-place concrete structures, make sure that the calculated deflection of falsework flexural members does not exceed 1/240 of their span regardless of whether or not the deflection is compensated by camber strips.

#### A. Maintenance and Inspection

Inspect and maintain the temporary work in an acceptable condition throughout the period of its use. Certify that the manufactured devices have been maintained in a condition to allow them to safely carry their rated loads. Clearly mark each piece so that its capacity can be readily determined at the job site.

Perform an in-depth inspection of an applicable portion(s) of the temporary works, in the presence of the Engineer, not more than 24 hours prior to the beginning of each concrete placement. Inspect other temporary works at least once a month to ensure that they are functioning properly. Have a North Carolina Registered Professional Engineer inspect the cofferdams, shoring, sheathing, support of excavation structures, and support systems for load tests prior to loading.

#### B. Foundations

Determine the safe bearing capacity of the foundation material on which the supports for temporary works rest. If required by the Engineer, conduct load tests to verify proposed bearing capacity values that are marginal or in other high-risk situations.

The use of the foundation support values shown on the contract plans of the permanent structure is permitted if the foundations are on the same level and on the same soil as those of the permanent structure.

Allow for adequate site drainage or soil protection to prevent soil saturation and washout of the soil supporting the temporary works supports.

If piles are used, the estimation of capacities and later confirmation during construction using standard procedures based on the driving characteristics of the pile is permitted. If preferred, use load tests to confirm the estimated capacities; or, if required by the Engineer conduct load tests to verify bearing capacity values that are marginal or in other high risk situations.

The Engineer reviews and approves the proposed pile and soil bearing capacities.

### 5.0 REMOVAL

Unless otherwise permitted, remove and keep all temporary works upon completion of the work. Do not disturb or otherwise damage the finished work.

Remove temporary works in conformance with the contract documents. Remove them in such a manner as to permit the structure to uniformly and gradually take the stresses due to its own weight.

#### **6.0 METHOD OF MEASUREMENT**

Unless otherwise specified, temporary works will not be directly measured.

#### **7.0 BASIS OF PAYMENT**

Payment at the contract unit prices for the various pay items requiring temporary works will be full compensation for the above falsework and formwork.

### **SUBMITTAL OF WORKING DRAWINGS**

(9-16-08)

#### **1.0 GENERAL**

Submit working drawings in accordance with Article 105-2 of the *Standard Specifications* and this provision. For this provision, "submittals" refers to only those listed in this provision. The list of submittals contained herein does not represent a list of required submittals for the project. Submittals are only necessary for those items as required by the contract. Make submittals that are not specifically noted in this provision directly to the Resident Engineer. Either the Structure Design Unit or the Geotechnical Engineering Unit or both units will jointly review submittals.

If a submittal contains variations from plan details or specifications or significantly affects project cost, field construction or operations, discuss the submittal with and submit all copies to the Resident Engineer. State the reason for the proposed variation in the submittal. To minimize review time, make sure all submittals are complete when initially submitted. Provide a contact name and information with each submittal. Direct any questions regarding submittal requirements to the Resident Engineer, Structure Design Unit contacts or the Geotechnical Engineering Unit contacts noted below.

In order to facilitate in-plant inspection by NCDOT and approval of working drawings, provide the name, address and telephone number of the facility where fabrication will actually be done if different than shown on the title block of the submitted working drawings. This includes, but is not limited to, precast concrete items, prestressed concrete items and fabricated steel or aluminum items.

**2.0 ADDRESSES AND CONTACTS**

For submittals to the Structure Design Unit, use the following addresses:

Via US mail:

Mr. G. R. Perfetti, P. E.  
State Bridge Design Engineer  
North Carolina Department  
of Transportation  
Structure Design Unit  
1581 Mail Service Center  
Raleigh, NC 27699-1581

Attention: Mr. P. D. Lambert, P. E.

Via other delivery service:

Mr. G. R. Perfetti, P. E.  
State Bridge Design Engineer  
North Carolina Department  
of Transportation  
Structure Design Unit  
1000 Birch Ridge Drive  
Raleigh, NC 27610

Attention: Mr. P. D. Lambert, P. E.

For submittals to the Geotechnical Engineering Unit, use the following addresses:

For projects in Divisions 1-7, use the following Eastern Regional Office address:

Via US mail:

Mr. K. J. Kim, Ph. D., P. E.  
Eastern Regional Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Eastern Regional Office  
1570 Mail Service Center  
Raleigh, NC 27699-1570

Via other delivery service:

Mr. K. J. Kim, Ph. D., P. E.  
Eastern Regional Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Eastern Regional Office  
3301 Jones Sausage Road, Suite 100  
Garner, NC 27529

For projects in Divisions 8-14, use the following Western Regional Office address:

Via US mail:

Mr. John Pilipchuk, L. G., P. E.  
Western Regional Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Western Regional Office  
5253 Z Max Boulevard  
Harrisburg, NC 28075

Via other delivery service:

Mr. John Pilipchuk, L. G., P. E.  
Western Region Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Western Regional Office  
5253 Z Max Boulevard  
Harrisburg, NC 28075

Direct any questions concerning submittal review status, review comments or drawing markups to the following contacts:

Primary Structures Contact:

Paul Lambert  
(919) 250 – 4041  
(919) 250 – 4082 facsimile  
[plambert@ncdot.gov](mailto:plambert@ncdot.gov)

Secondary Structures Contacts:

James Gaither (919) 250 – 4042  
David Stark (919) 250 – 4044

Eastern Regional Geotechnical Contact (Divisions 1-7):

K. J. Kim  
(919) 662 – 4710  
(919) 662 – 3095 facsimile  
[kkim@ncdot.gov](mailto:kkim@ncdot.gov)

Western Regional Geotechnical Contact (Divisions 8-14):

John Pilipchuk  
(704) 455 – 8902  
(704) 455 – 8912 facsimile  
[jpilipchuk@ncdot.gov](mailto:jpilipchuk@ncdot.gov)

### 3.0 SUBMITTAL COPIES

Furnish one complete copy of each submittal, including all attachments, to the Resident Engineer. At the same time, submit the number of hard copies shown below of the same complete submittal directly to the Structure Design Unit and/or the Geotechnical Engineering Unit.

The first table below covers “Structure Submittals”. The Resident Engineer will receive review comments and drawing markups for these submittals from the Structure Design Unit. The second table in this section covers “Geotechnical Submittals”. The Resident Engineer will receive review comments and drawing markups for these submittals from the Geotechnical Engineering Unit.



Unless otherwise required, submit one set of supporting calculations to either the Structure Design Unit or the Geotechnical Engineering Unit unless both units require submittal copies in which case submit a set of supporting calculations to each unit. Provide additional copies of any submittal as directed by the Engineer.

**STRUCTURE SUBMITTALS**

<b>Submittal</b>	<b>Copies Required by Structure Design Unit</b>	<b>Copies Required by Geotechnical Engineering Unit</b>	<b>Contract Reference Requiring Submittal <sup>1</sup></b>
Arch Culvert Falsework	5	0	Plan Note, SN Sheet & "Falsework and Formwork"
Box Culvert Falsework <sup>7</sup>	5	0	Plan Note, SN Sheet & "Falsework and Formwork"
Cofferdams	6	2	Article 410-4
Evazote Joint Seals <sup>6</sup>	9	0	"Evazote Joint Seals"
Expansion Joint Seals (hold down plate type with base angle)	9	0	"Expansion Joint Seals"
Expansion Joint Seals (modular)	2, then 9	0	"Modular Expansion Joint Seals"
Expansion Joint Seals (strip seals)	9	0	"Strip Seals"
Falsework & Forms <sup>2</sup> (substructure)	8	0	Article 420-3 & "Falsework and Formwork"
Falsework & Forms (superstructure)	8	0	Article 420-3 & "Falsework and Formwork"
Girder Erection over Railroad	5	0	Railroad Provisions
Maintenance and Protection of Traffic Beneath Proposed Structure	8	0	"Maintenance and Protection of Traffic Beneath Proposed Structure at Station ____"
Metal Bridge Railing	8	0	Plan Note
Metal Stay-in-Place Forms	8	0	Article 420-3
Metalwork for Elastomeric Bearings <sup>4,5</sup>	7	0	Article 1072-10

Miscellaneous Metalwork <sup>4,5</sup>	7	0	Article 1072-10
Optional Disc Bearings <sup>4</sup>	8	0	“Optional Disc Bearings”
Overhead Signs	13	0	Article 903-3(C) & Applicable Provisions
Pile Splicers	7	2	Subarticle 450-7(C) & “Piles”
Pile Points	7	2	Subarticle 450-7(D) & “Piles”
Placement of Equipment on Structures (cranes, etc.)	7	0	Article 420-20
Pot Bearings <sup>4</sup>	8	0	“Pot Bearings”
Precast Concrete Box Culverts	2, then 1 reproducible	0	“Optional Precast Reinforced Concrete Box Culvert at Station ____”
Precast Retaining Wall Panels	10	1	Article 1077-2
Prestressed Concrete Cored Slab (detensioning sequences) <sup>3</sup>	6	0	Article 1078-11
Prestressed Concrete Deck Panels	6 and 1 reproducible	0	Article 420-3
Prestressed Concrete Girder (strand elongation and detensioning sequences)	6	0	Articles 1078-8 and 1078- 11
Removal of Existing Structure over Railroad	5	0	Railroad Provisions
Revised Bridge Deck Plans (adaptation to prestressed deck panels)	2, then 1 reproducible	0	Article 420-3
Revised Bridge Deck Plans (adaptation to modular expansion joint seals)	2, then 1 reproducible	0	“Modular Expansion Joint Seals”
Sound Barrier Wall Casting Plans	10	0	Article 1077-2 & “Sound Barrier Wall”
Sound Barrier Wall Steel Fabrication Plans <sup>5</sup>	7	0	Article 1072-10 & “Sound Barrier Wall”
Structural Steel <sup>4</sup>	2, then 7	0	Article 1072-10

Temporary Detour Structures	10	2	Article 400-3 & “Construction, Maintenance and Removal of Temporary Structure at Station _____”
TFE Expansion Bearings <sup>4</sup>	8	0	Article 1072-10

**FOOTNOTES**

1. References are provided to help locate the part of the contract where the submittals are required. References in quotes refer to the provision by that name. Articles and subarticles refer to the *Standard Specifications*.
2. Submittals for these items are necessary only when required by a note on plans.
3. Submittals for these items may not be required. A list of pre-approved sequences is available from the producer or the Materials & Tests Unit.
4. The fabricator may submit these items directly to the Structure Design Unit.
5. The two sets of preliminary submittals required by Article 1072-10 of the *Standard Specifications* are not required for these items.
6. Submittals for Fabrication Drawings are not required. Submittals for Catalogue Cuts of Proposed Material are required. See Section 5.A of the referenced provision.
7. Submittals are necessary only when the top slab thickness is 18” or greater.

**GEOTECHNICAL SUBMITTALS**

Submittal <sup>1</sup>	Copies Required by Geotechnical Engineering Unit	Copies Required by Structure Design Unit	Contract Reference Requiring Submittal <sup>2</sup>
Crosshole Sonic Logging (CSL) Reports	1	0	“Crosshole Sonic Logging”
Drilled Pier Construction Sequence Plans	1	0	“Drilled Piers”
Pile Driving Analyzer (PDA) Reports	2	0	“Pile Driving Analyzer”
Pile Driving Equipment Data <sup>3</sup>	1	0	Article 450-5 & “Piles”
Retaining Walls	8	2	Applicable Provisions
Contractor Designed Shoring	7	2	“Temporary Shoring”, “Anchored Temporary Shoring” & “Temporary Soil Nail Walls”

**FOOTNOTES**

1. With the exception of “Pile Driving Equipment Data”, electronic copies of geotechnical submittals are required. See referenced provision.
2. References are provided to help locate the part of the contract where the submittals are required. References in quotes refer to the provision by that name. Articles refer to the *Standard Specifications*.
3. Download Pile Driving Equipment Data Form from following link:  
<http://www.ncdot.org/doh/preconstruct/highway/geotech/formdet/>  
Submit one hard copy of the completed form to the Resident Engineer. Submit a second copy of the completed form electronically, by facsimile or via US Mail or other delivery service to the Geotechnical Engineering Unit. Electronic submission is preferred. See second page of form for submittal instructions.

**OPTIONAL DISC BEARINGS**

(3-6-09)

**1.0 GENERAL**

This item consists of furnishing, fabrication and installation of disc bearings in accordance with AASHTO LRFD Bridge Design Specifications, the Standard Specifications, the recommendations of the manufacturer and as specified herein. In addition, all plan notes pertaining to furnishing and installing pot bearing assemblies shall also apply to disc bearing assemblies, except as noted herein.

Disc Bearings consist of a polyether urethane structural element (disc) confined by upper and lower steel bearing plates. Equip disc bearings with a shear restriction mechanism to prevent movement of the disc. Supply disc bearings as fixed bearings and guided expansion bearings as designated by the Contract Documents.

Fixed disc bearings allow rotation but no longitudinal or transverse movement in the bearing plane. Fixed bearings consist of a sole plate, an elastomer disc, upper bearing plate, lower bearing plate, masonry plate, anchor bolts, nuts and washers.

Guided expansion disc bearings allow rotation and only longitudinal movement in the bearing plane. Guided expansion disc bearings consist of a sole plate, a top steel plate with a polished stainless steel sheet facing bearing on a fixed disc bearing with a layer of virgin polytetrafluoroethylene (PTFE) material on its top, masonry plate, anchor bolt assembly which includes anchor bolts, nuts, washers, pipe sleeves, a closure plate, grout and various sizes of standard pipe and any other necessary material as detailed on the plans. To allow longitudinal movement, bond a polytetrafluoroethylene (PTFE) sheet to the upper steel bearing plate. Support a sliding steel top bearing plate with the upper steel bearing plate. Face the mating surface of the sliding steel top bearing plate with polished stainless steel. Use either a guide bar or keyway system to restrict transverse movement. Face the sliding surfaces of the guide bar or keyway systems with either PTFE sheets or stainless steel.

**2.0 MATERIALS**

Use disc bearings produced by the same manufacturer.

Use AASHTO M270 Grade 50W (345W) for all steel in the disc bearings. Clean, coat, and seal the plates in the disc bearing assemblies except for the areas with special facings and the areas that come in contact with the elastomer disc, in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)". Coat surfaces to a thickness of 8 mils (0.200 mm) minimum on all external parts. Repair surfaces that are abraded or damaged after the application of metallizing in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)".

Provide anchor bolts and nuts in accordance with the Standard Specifications.

When the maximum plan dimension of the sheet is 12" (300 mm) or less, provide a stainless steel sheet in expansion disc bearings that is at least 16 gage or 1/16" (1.6 mm).

When the maximum plan dimension is greater than 12" (300 mm), provide a stainless steel sheet that is at least 11 gage or 1/8" (3 mm). Ensure that all stainless steel sheets are in conformance with ASTM A240/A167 Type 304 and polished to a minimum #8 mirror surface finish.

Blast clean the surface of the plate that will be attached to the stainless sheet to a near white condition in accordance with the Standard Specifications. Position and clamp the back of the stainless sheet that is to be in contact with the steel plate on the steel plate. Apply the stainless steel to the blast cleaned surface of the steel plate as soon as possible after blasting and before any visible oxidation of the blast cleaned surface occurs. Weld the stainless sheet continuously around its perimeter using a tungsten inert gas, wire-fed welder.

For the PTFE sheet, used as a mating surface for the stainless sheet, provide an unfilled virgin PTFE Sheet (Recessed) or a glass-fiber filled PTFE sheet, resulting from skiving billets formed under hydraulic pressure and heat. Provide resin that conforms to the requirements of ASTM D4894 or D4895.

To bond the PTFE and the bearing plate, use heat cured high temperature epoxy capable of withstanding temperature of -320°F to 500°F (-195 °C to 260 °C).

Mold the polyether urethane structural element from a polyether urethane compound. Conform the physical properties of the polyether urethane to the following requirements:

Physical Property	ASTM Test Method	Requirements	
		Min.	Max.
Hardness, Type D Durometer	D2240	60	64
Tensile Stress psi (Mpa) At 100% elongation At 200% elongation	D412	2000 (13.8) 3700 (25.5)	----
Tensile Strength psi (Mpa)	D412	5000 (34.5)	----
Ultimate Elongation %	D412	220	----
Compression Set % 22 hrs. at 158°F (70°C)	D395	----	40

### 3.0 DESIGN

Design the disc bearings for the loads and movements shown on the contract plans. However, use the anchor bolt size, length, spacing and masonry plate thickness as shown on the contract plans and provide an overall height of the bearing assembly that is at least the height shown on the contract plans, but no more than 1/2 inch (13 mm) greater than this height. Either combine and cast the sole plate and top plate/upper bearing plate and the

lower bearing plate and masonry plate as a single unit or weld together prior to the installation of the disc.

When designing the bearings, use the following allowable bearing stresses:

- On polyether urethane structural element: 5000 psi (34.5 MPa)
- On PTFE Sliding Surface, filled or unfilled PTFE (recessed): 3500 psi (24.1 MPa)

Submit eight sets of shop drawings and one set of design calculations for review, comments and acceptance. Have a North Carolina Registered Professional Engineer check and seal the shop drawings and design calculations.

After the Engineer reviews the drawings and, if necessary, corrections are made, submit one 22" x 34" reproducible set of the working drawings.

#### 4.0 SAMPLING AND TESTING

##### A. Sampling

The manufacturer is responsible for randomly selecting and testing sample bearings from completed lots of bearings. The manufacturer is also responsible for certifying that the completed bearings and their components have been tested and are in compliance with the requirements of this Special Provision. The manufacturer shall furnish the results of the tests to the Materials and Tests Engineer.

##### B. Testing

###### 1. Proof Load Test

Load a test bearing to 150% of the bearing's rated design capacity and simultaneously subject it to a rotational range of 0.02 radians (1.146°) for a period of 1 hour.

Have the bearing visually examined both during the test and upon disassembly after the test. Any resultant visual defects, such as extruded or deformed elastomer or PTFE, damaged seals or rings, or cracked steel is cause for rejection.

Keep continuous and uniform contact between the polyether urethane element and the bearing plates and between the sliding steel top plate and the upper bearing plate for the duration of the test. Any observed lift-off is cause for rejection.

###### 2. Sliding Coefficient of Friction

For all guided and non-guided expansion type bearings, measure the sliding coefficient of friction at the bearing's design capacity in accordance with the test method described below, and on the fifth and fiftieth cycles, at a sliding speed of 1 in/min (25 mm/min).

Calculate the sliding coefficient of friction as the horizontal load required to maintain continuous sliding of one bearing, divided by the bearing's vertical design capacity.

The test results are evaluated as follows:

- A maximum measured sliding coefficient of friction of 3%.
- A visual examination both during and after the test. Any resultant visual defects, such as bond failure, physical destruction, cold flow of PTFE to the point of debonding, or damaged components is cause for rejection of the lot.

Using undamaged test bearings in the work is permitted.

### 3. Test Method

The test method and equipment shall meet the following requirements:

- f. Arrange the test to determine the coefficient of friction on the first movement of the manufactured bearing.
- g. Clean the bearing surface prior to testing.
- h. Conduct the test at maximum working stress for the PTFE surface with the test load applied continuously for 12 hours prior to measuring friction.
- i. Determine the first movement static and dynamic coefficient of friction of the test bearing at a sliding speed of less than 1 in/min (25 mm/min), not to exceed:
 

0.04	unfilled PTFE
0.08	filled PTFE
- j. Subject the bearing specimen to 100 movements of at least 1 inch (25 mm) of relative movement and, if the test facility permits, the full design movement at a speed of less than 1 ft/min (300 mm/min). Following this test determine the static and kinetic coefficient of friction again. The specimen is considered a failure if it exceeds the values measured in (d) above or if it shows any signs of bond failure or other defects.

Bearings represented by test specimens passing the above requirements are approved for use in the structure subject to on-site inspection for visible defects.

## 5.0 INSTALLATION

Store disc bearings delivered to the bridge site under cover on a platform above the ground surface. Protect the bearings from injury at all times and, before placing the bearings, dry and clean all dirt, oil, grease or other foreign substances from the bearing. Do not disassemble the bearings during installation, except at the manufacturer's direction. Place the bearings in accordance with the recommendations of the manufacturer, Contract Drawings, and as directed by the Engineer. If there is any discrepancy between the



recommendations of the manufacturer, Special Provisions, and Contract Drawings, the Engineer is the sole judge in reconciling any such discrepancy.

Provide preformed bearing pads under the masonry plates in accordance with Article 1079-1 of the Standard Specifications.

Do not install any bearing before the Engineer approves it.

## 6.0 BASIS OF PAYMENT

Payment for all optional disc bearings will be at the lump sum contract price bid for "Pot Bearings" which includes full compensation for furnishing all disc bearings, labor, materials, tools, equipment, testing and incidentals required to complete the work in accordance with the Standard Specifications, this Special Provision, the manufacturer's requirements and as directed by the Engineer.

### CRANE SAFETY

(8-15-05)

Comply with the manufacturer specifications and limitations applicable to the operation of any and all cranes and derricks. Prime contractors, sub-contractors, and fully operated rental companies shall comply with the current Occupational Safety and Health Administration regulations (OSHA).

Submit all items listed below to the Engineer prior to beginning crane operations involving critical lifts. A critical lift is defined as any lift that exceeds 75 percent of the manufacturer's crane chart capacity for the radius at which the load will be lifted or requires the use of more than one crane. Changes in personnel or equipment must be reported to the Engineer and all applicable items listed below must be updated and submitted prior to continuing with crane operations.

### CRANE SAFETY SUBMITTAL LIST

- A. **Competent Person:** Provide the name and qualifications of the "Competent Person" responsible for crane safety and lifting operations. The named competent person will have the responsibility and authority to stop any work activity due to safety concerns.
- B. **Riggers:** Provide the qualifications and experience of the persons responsible for rigging operations. Qualifications and experience should include, but not be limited to, weight calculations, center of gravity determinations, selection and inspection of sling and rigging equipment, and safe rigging practices.
- C. **Crane Inspections:** Inspection records for all cranes shall be current and readily accessible for review upon request.
- D. **Certifications:** By July 1, 2006, crane operators performing critical lifts shall be certified by NC CCO (National Commission for the Certification of Crane Operators), or satisfactorily complete the Carolinas AGC's Professional Crane Operator's Proficiency Program. Other approved nationally accredited programs will be

considered upon request. All crane operators shall also have a current CDL medical card. Submit a list of anticipated critical lifts and corresponding crane operator(s). Include current certification for the type of crane operated (small hydraulic, large hydraulic, small lattice, large lattice) and medical evaluations for each operator.

**PILES**

(3-6-09)

Remove Section 450 of the *Standard Specifications* and replace with the following.

**1.0 DESCRIPTION**

Furnish and install steel and prestressed concrete piles with the required resistance, penetration into natural ground and embedment in the cap or footing in accordance with the contract and accepted submittals. Drive and drill in piles and use pile tips and accessories as shown on plans. Preauger through embankments, galvanize, restrike, redrive, splice, cut off and build up piles and perform pile driving analyzer (PDA) testing as necessary or required.

**2.0 MATERIALS**

Refer to Division 10 of the *Standard Specifications*:

<b>Item</b>	<b>Section</b>
Flowable Fill, Non-Excavatable	340
Portland Cement Concrete	1000
Reinforcing Steel	1070
Steel Plates	1072
Steel and Prestressed Concrete Piles	1084

For drilled-in piles, use Class A Concrete in accordance with Article 1000-4 of the *Standard Specifications* except as modified herein. Provide concrete with a slump of 6 to 8 inches (150 to 200 mm). Use an approved high-range water reducer to achieve this slump.

For galvanized steel piles, see Section 1076 of the *Standard Specifications*. Use approved steel pile points and pile splicers. Obtain a list of approved pile points and splicers from: <https://apps.dot.state.nc.us/vendor/approvedproducts/>

**3.0 PILE LENGTHS**

The estimated pile lengths shown on the plans are for bid purposes only. Provide piles of sufficient lengths for the required resistance, penetration into natural ground and embedment in the cap or footing. At the Contractor's option and no additional cost to the Department, make investigations as necessary to determine required pile lengths.

#### 4.0 CONSTRUCTION METHODS

##### A. Handling and Storing Piles

Handle, transport and store piles so that piles are kept clean and undamaged. Do not use chains, cables or hooks that can damage or scar piles. Do not damage coatings on steel piles. When handling prestressed concrete piles, support piles at pick-up points as shown on the plans.

Protect steel piles as far as practicable from corrosion. Store piles above ground upon platform skids, or other supports, and keep free from dirt, grease, vegetation and other foreign material. Damaged, bent or cracked piles will be rejected.

##### B. Pile Installation

If applicable, completely excavate for caps and footings before installing piles. If applicable and unless noted otherwise on the plans, construct embankments to bottom of cap or footing elevations for a horizontal distance of 50 ft (15 m) from any pile except where fill slopes are within 50 ft (15 m) of a pile.

Install piles with the following tolerances.

1. Axial alignment within  $\frac{1}{4}$  inch per foot (21 mm per meter) of vertical or batter shown on the plans
2. Horizontal alignment within 3" (75 mm) of plan location, longitudinally and transversely
3. Pile embedment in the cap or footing within 3" (75 mm) more and 2" (50 mm) less of the embedment shown on the plans

No additional payment will be made for increased cap or footing dimensions due to piles installed out of position.

If necessary, build up prestressed concrete piles or splice steel piles as shown on the plans. Do not use more than 3 sections (2 splices) of steel piling per pile. Cut off piles at required elevations along a plane normal to the axis of the pile as necessary. Do not damage or spall piles when cutting off prestressed concrete piles.

##### C. Pile Accessories

If required, use pile accessories including steel pile points, pipe pile plates and pile splicers as shown on the plans. Perform any welding in accordance with Article 1072-20 of the *Standard Specifications* and the accepted submittals. Weld steel plates with the specified dimensions to pipe piles as shown on the plans.

Attach steel pile points to steel piles in accordance with the manufacturer's instructions. The minimum weld length is twice the flange width for H piles.

Use steel pile tips with prestressed concrete piles as shown on the plans. Use pile splicers for splicing steel pile tips and attach pile splicers in accordance with the manufacturer's instructions.

#### D. Driven Piles

Drive piles in accordance with the accepted submittals and this provision. Unless otherwise approved, do not drive piles within 50 ft (15 m) of cast-in-place concrete until the concrete cures for at least 3 days.

When preaugering before driving piles or using a vibratory hammer to install the initial portions of steel piles, submit these pile installation methods with the proposed pile driving methods and equipment for review and acceptance. The Engineer will approve the preaugering depth, auger diameter and depth of pile installation with the vibratory hammer. Do not use vibratory hammers to install prestressed concrete piles.

Limit driving stresses in accordance with the *AASHTO LRFD Bridge Design Specifications*. If a tip elevation is noted on the plans, drive piles to the minimum required driving resistance and tip elevation. Otherwise, drive piles to the minimum required driving resistance and a penetration into natural ground of at least 10 ft (3 m). Also, drive piles to the required tip elevation or penetration into natural ground, whichever is lower, in a continuous operation unless stopped due to exceeding the maximum blow count or driving stresses, insufficient pile length or other approved reasons. Natural ground within an area of a new embankment is defined as the bottom of the embankment or footings, whichever is lower.

Protect coatings in an approved manner when driving steel piles through templates. Redrive piles raised or moved laterally due to driving adjacent piles.

##### 1. Driving Equipment

Submit the proposed pile driving methods and equipment (pile driving equipment data form) including the pile driving hammer, hammer cushion, pile helmet and cushion for review and acceptance. Do not submit more than two pile driving hammers per pile type per submittal. Submit this information for review and acceptance at least 30 calendar days before driving piles. All equipment is subject to satisfactory field performance.

Drive piles with accepted driving equipment using air, steam or diesel hammers. Use pile driving hammers that will not overstress piles and provide the required driving resistance at a blows per foot ranging from 30 to 180. Use a variable energy hammer to drive prestressed concrete piles.

Operate air and steam hammers within the manufacturer's specified ranges and 10% of the manufacturer's rated speed in blows per minute or a rate approved by the Engineer. Use a plant and equipment for air or steam hammers with sufficient capacity to maintain, under working conditions, the volume and pressure specified by the manufacturer. Equip the plant and equipment with accurate pressure gauges

that are easily accessible. Provide striking parts of air and steam hammers that weigh at least one-third the weight of the pile helmet and pile, with a minimum weight of 2,750 lbs.

Equip open-end (single acting) diesel hammers with a graduated scale (jump stick) extending above the ram cylinder, graduated rings or grooves on the ram or an electric sound activated remote measuring instrument to determine the hammer stroke during driving. Equip closed-end (double acting) diesel hammers with a calibrated bounce chamber pressure gauge mounted near the ground and provide a current calibrated chart or graph equating bounce chamber pressure and gauge hose length to equivalent energy. Submit this chart or graph with the proposed pile driving methods and equipment for closed-end diesel hammers.

Hold pile heads in position with pile helmets that closely fit over the pile heads and extend down the sides of piles a sufficient distance. Protect pile heads of prestressed concrete piles from direct impact with accepted pile cushions. Use pile cushions made of pine plywood with a minimum thickness of 4" (100 mm). Unless otherwise approved, provide a new pile cushion for each prestressed concrete pile. Replace pile cushions during driving when a cushion is compressed more than one-half its original thickness or begins to burn.

The Engineer may inspect the hammer cushion before beginning driving and periodically throughout the project. Expose the hammer cushion for inspection as directed by the Engineer. Replace or repair any hammer cushion that is less than 25% of its original thickness.

## 2. Required Driving Resistance

The Engineer will determine the acceptability of the proposed pile driving methods and equipment and provide the blows per foot and equivalent set for 10 blows for the required driving resistance. The minimum required driving resistance is equal to the factored resistance noted on the plans plus any additional resistance for downdrag and scour, if applicable, divided by a resistance factor. When performing PDA testing in accordance with the *AASHTO LRFD Bridge Design Specifications*, the resistance factor is 0.75. Otherwise, the resistance factor for the wave equation analysis is 0.60.

Unless otherwise approved, stop driving piles when refusal is reached. Refusal is defined as 240 blows per foot or any equivalent set.

## 3. Redriving Piles

Once the required pile penetration is achieved, the Contractor may choose to or the Engineer may require the Contractor to stop driving, wait and restrrike or redrive piles to achieve the required driving resistance. If the Contractor chooses to restrrike or redrive piles, no payment will be made for restrrikes or redrives. If the Engineer requires the Contractor to restrrike or redrive piles, payment will be made in accordance with this provision. When the Engineer requires restrrikes or redrives,

the Engineer will determine the number of restrikes or redrives and the time to wait after stopping driving and between restrikes and redrives. The time to wait will range from 4 to 24 hours.

Use the same pile driving methods, equipment and compressed pile cushion from the previous driving to restrike or redrive the pile unless the cushion is unacceptable due to deterioration. Do not use a cold diesel hammer for a restrike or redrive, unless it is impractical to do otherwise as determined by the Engineer. In general, warm up the hammer by applying at least 20 blows to a previously driven pile or timber mats on the ground.

#### 4. Pile Driving Analyzer

If required, test piles with a pile driving analyzer (PDA) manufactured by Pile Dynamics, Inc., analyze data and provide PDA reports. Perform PDA testing in accordance with ASTM D4945. Either the Engineer will perform the PDA testing and analysis or use a PDA Consultant prequalified by the NCDOT Contractual Services Unit for Pile Driving Analyzer Work (work code 3060) to perform the PDA testing and analysis and provide a PDA report.

The Engineer will determine the number of piles and which piles to be tested with a PDA. Do not drive piles with a PDA until the proposed pile driving methods and equipment has been preliminarily accepted. Notify the Engineer of the pile driving schedule a minimum of 7 calendar days in advance.

The Engineer will complete the review and acceptance of the proposed pile driving methods and equipment and provide the blows per foot and equivalent set for 10 blows for the required driving resistance within 10 calendar days after the Engineer receives the PDA report or the Engineer finishes PDA testing. A PDA report for or PDA testing on multiple piles may be required as determined by the Engineer before the 10 day time period begins.

##### a. Preparation

Provide piles for PDA testing that are 5 ft (1.5 m) longer than the estimated pile lengths shown on the plans. Supply an AC electrical power source of a voltage and frequency suitable for computer equipment.

Provide a shelter to protect the PDA equipment and operator from conditions of sun, water, wind and temperature. The shelter should have a minimum floor size of 6 ft by 6 ft (1.8 m by 1.8 m) and a minimum roof height of 8 ft (2.4 m). If necessary, heat or cool the shelter to maintain a temperature between 50 and 85 degrees F (10 and 30 degrees C). Place the shelter within 75 ft (23 m) of the pile such that the PDA cables reach the computer and the operator can clearly observe the pile. The Engineer may waive the shelter requirement if weather conditions allow.

Drill up to a total of 16 bolt holes in either 2 or 4 sides of the pile, as directed by the PDA Consultant or Engineer, at an approximate distance equal to 3 times the pile diameter below the pile head. If the PDA Consultant or Engineer chooses to drill the bolt holes, provide the necessary equipment, tools and assistance to do so. A hammer drill is required for concrete piles. Allow for 2 hours per pile to drill holes.

Lift, align and rotate the pile to be tested with a PDA as directed by the PDA Consultant or Engineer. Place the pile in the leads and template so that the PDA instruments and their accompanying wires will not be damaged. Attach PDA instruments as directed by the PDA Consultant or Engineer after the pile is placed in the leads and the template.

b. Testing

Use only the preliminarily accepted pile driving methods and equipment to drive piles with the PDA instruments attached. Drive piles in accordance with this provision and as directed by the PDA Operator or Engineer. The PDA Operator or Engineer may require the Contractor to modify the pile installation procedure during driving. Dynamic measurements will be recorded and used to evaluate the hammer performance, driving resistance and stresses, energy transfer, pile integrity and various soil parameters such as quake and damping.

If required, reattach the PDA instruments and restrike or redrive the pile in accordance with this provision. Obtain the required stroke and at least 6" (150 mm) of penetration as directed by the PDA Operator or Engineer. Dynamic measurements will be recorded during restriking and redriving. The Engineer will determine when PDA testing has been satisfactorily completed.

The Contractor is responsible in terms of both actual expense and time delays for any damage to the PDA instruments and supporting equipment due to the Contractor's fault or negligence. Replace any damaged equipment at no additional cost to the Department.

c. Analysis

When using a PDA Consultant, analyze data with the CAsE Pile Wave Analysis Program (CAPWAP), version 2006 or later. At a minimum, analysis is required for a hammer blow near the end of initial drive and for each restrike and redrive. Additional CAPWAP analysis may be required as determined by the PDA Consultant or Engineer.

d. Report

When using a PDA Consultant, submit three hard copies and an electronic copy (PDF on CD or DVD) of PDA reports sealed by a Professional Engineer

registered in North Carolina within 7 calendar days of completing field testing. Include the following in the PDA Report:

- i. Title Sheet
  - NCDOT TIP number and WBS element number
  - Project description
  - County
  - Bridge station number
  - Pile location
  - Personnel
  - Report date
- ii. Introduction
- iii. Site and Subsurface Conditions (including water table elevation)
- iv. Pile Details
  - Pile type and length
  - Required driving resistance and resistance factor
  - Concrete compressive strength and/or steel pile yield strength
  - Pile splice type and locations
  - Pile batter
  - Installation methods including use of jetting, preaugering, spudding, vibratory hammer, template, barge, etc.
- v. Driving Details
  - Hammer make, model and type
  - Hammer and pile cushion type and thickness
  - Pile helmet weight
  - Hammer efficiency and operation data including fuel settings, bounce chamber pressure, blows per minute, equipment volume and pressure
  - Ground or mud line elevation and template reference elevation at the time of driving
  - Final pile tip elevation
  - Driving data (ram stroke, blows per foot (0.3 meter) and set for last 10 hammer blows)
  - Restrike and redrive information



## vi. PDA Field Work Details

## vii. CAPWAP Analysis Results

- Table showing percent skin and tip, skin and toe damping, skin and toe quake and match quality

## viii. Summary/Conclusions

## ix. Attachments

- Boring log(s)
- Pile driving equipment data form (from Contractor)
- Field pile driving inspection data (from Engineer)
- Accelerometer and strain gauge locations
- Accelerometer and strain gauge serial numbers and calibration information
- PDA hardware model and CAPWAP software version information
- Electronic copy of all PDA data and executable CAPWAP input and output files

## E. Drilled-in Piles

If required, perform pile excavation to specified elevations shown on the plans. Excavate holes with diameters that will result in at least 3" (75 mm) of clearance all around piles. Before filling holes, support and center piles in excavations and when noted on the plans, drive piles to the required driving resistance. Remove any fluid from excavations, and at the Contractor's option, fill holes with either concrete or flowable fill unless required otherwise in the contract.

## 1. Pile Excavation

Use equipment of adequate capacity and capable of drilling through soil, rock, boulders, debris, man-made objects and any other materials encountered. Blasting is not permitted to advance excavations. Blasting for core removal is only permitted when approved by the Engineer. Dispose of drilling spoils in accordance with Section 802 of the *Standard Specifications* and as directed by the Engineer. Drilling spoils consist of all excavated materials including fluids removed from excavations by pumps or drilling tools.

If unstable, caving or sloughing soils are anticipated or encountered, stabilize excavations with either slurry or steel casing. When using slurry, submit slurry details including product information, manufacturer's recommendations for use, slurry equipment details and written approval from the slurry supplier that the mixing water is acceptable before beginning drilling. When using steel casing, use either the sectional type or one continuous corrugated or non-corrugated piece.

Steel casings should consist of clean watertight steel of ample strength to withstand handling and driving stresses and the pressures imposed by concrete, earth and backfill. Use steel casings with an outside diameter equal to the hole size and a minimum wall thickness of ¼ inch (6 mm).

## 2. Filling Holes

Check the water inflow rate at the bottom of holes after all pumps have been removed. If the inflow rate is less than 6" (150 mm) per half hour, remove any fluid and free fall concrete or flowable fill into excavations. Ensure that concrete or flowable fill flows completely around piles. If the water inflow rate is greater than 6" (150 mm) per half hour, propose and obtain acceptance of a procedure for placing concrete or flowable fill before filling holes. Place concrete or flowable fill in a continuous manner and remove all casings.

## 5.0 MEASUREMENT AND PAYMENT

\_\_\_\_\_ *Prestressed Concrete Piles*, \_\_\_\_\_ *Steel Piles* and \_\_\_\_\_ *Galvanized Steel Piles* will be measured and paid for in linear feet (meters). Piles will be measured as the pile length before installation minus any pile cut-offs. No payment will be made for pile cut-offs or cutting off piles. No payment will be made for damaged, defective or rejected piles or any piles for falsework, bracing, templates or temporary work bridges. The contract unit price bid for \_\_\_\_\_ *Prestressed Concrete Piles*, \_\_\_\_\_ *Steel Piles* and \_\_\_\_\_ *Galvanized Steel Piles* will also be full compensation for driving piles and any preaugering.

For driven piles, once the required resistance and pile penetration is achieved, the Contractor may drive the remaining portion of piles to grade in lieu of cutting off piles provided the remaining portions do not exceed 5 ft (1.5 m) and the piles can be driven without being damaged or reaching the maximum blow count or refusal. When this occurs, the additional length of piles driven will be measured and paid for at the contract unit price bid for \_\_\_\_\_ *Prestressed Concrete Piles*, \_\_\_\_\_ *Steel Piles* and \_\_\_\_\_ *Galvanized Steel Piles*.

For prestressed concrete piles that are built up, the build-up will be measured and paid for at the contract unit price bid for \_\_\_\_\_ *Prestressed Concrete Piles*. Steel pile tips are not included in the measurement of prestressed concrete piles. No separate payment will be made for steel pile tips or pile splicers and any associated hardware or welding. Steel pile tips and pile splicers will be considered incidental to the contract unit price bid for \_\_\_\_\_ *Prestressed Concrete Piles*.

*Steel Pile Points* and *Pipe Pile Plates* will be measured and paid for in units of each.

*Pile Redrives* will be measured and paid for in units of each. *Pile Redrives* will be measured as the number of restrikes or redrives required by the Engineer. No payment will be made for restrikes or redrives when the Contractor chooses to restrike or redrive piles.

*PDA Testing* will be measured and paid for in units of each. No payment for *PDA Testing* will be made if the Engineer performs PDA testing. If the Engineer does not perform PDA testing, *PDA Testing* will be measured as one per pile. The contract unit price bid for *PDA Testing* will be full compensation for performing PDA testing the first time a pile is tested with a PDA, performing analysis on data collected during initial drive, restrikes and redrives and providing the PDA report. Subsequent PDA testing of the same piles will be considered incidental to the contract unit price bid for *Pile Redrives*.

*PDA Assistance* will be measured and paid for in units of each. *PDA Assistance* will be measured as one per pile. The contract unit price bid for *PDA Assistance* will be full compensation for the Contractor's assistance to perform the PDA testing during initial drive, restrikes and redrives.

*Pile Excavation in Soil* and *Pile Excavation Not in Soil* will be measured and paid for in linear feet (meters). Not in soil is defined as material with a rock auger penetration rate of less than 2" (50 mm) per 5 minutes of drilling at full crowd force. Once not in soil is encountered, seams, voids and weathered rock less than 3 ft (1 m) thick with a rock auger penetration rate of greater than 2" (50 mm) per 5 minutes of drilling at full crowd force will be paid for at the contract unit price bid for *Pile Excavation Not in Soil*. Seams, voids and weathered rock greater than 3 ft (1 m) thick will be paid for at the contract unit price bid for *Pile Excavation in Soil* where not in soil is no longer encountered. The contract unit price bid for *Pile Excavation in Soil* and *Pile Excavation Not in Soil* will also be full compensation for filling holes with either concrete or flowable fill.

Payment will be made under:

<b>Pay Item</b>	<b>Pay Unit</b>
_____ Prestressed Concrete Piles	Linear Foot (Meter)
_____ Steel Piles	Linear Foot (Meter)
_____ Galvanized Steel Piles	Linear Foot (Meter)
Steel Pile Points	Each
Pipe Pile Plates	Each
Pile Redrives	Each
PDA Testing	Each
PDA Assistance	Each
Pile Excavation in Soil	Linear Foot (Meter)
Pile Excavation Not in Soil	Linear Foot (Meter)

**SHIPPING STEEL STRUCTURAL MEMBERS**

(7-18-06)


Section 1072-23 Marking and Shipping

Add the following paragraphs after the third paragraph of the Section.


Load and ship steel beams and girders in accordance with the Figure below for all types of transportation.

Below is the sketches provided to Materials and Tests Unit on May 8, 1991. When the contractor wishes to place members on trucks not in accordance with these limits, to ship by rail, to attach shipping restraints to the members, to ship horizontally curved steel members, or to invert members, he shall submit a shipping plan prior to shipping. See also Article 1072-11.

**LIMITS FOR PLACEMENT OF BEAMS AND GIRDERS DURING SHIPMENT**

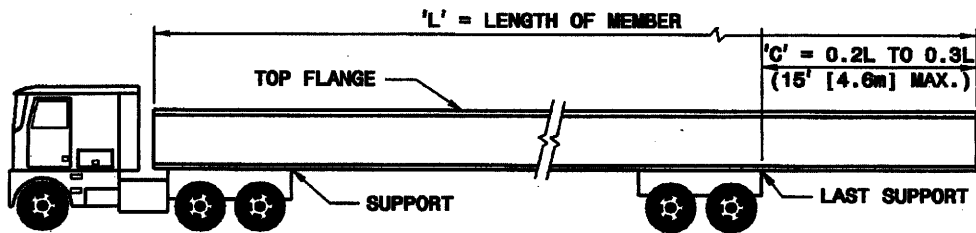

**WHEN 'C' = 15' (4.6m) OR LESS**

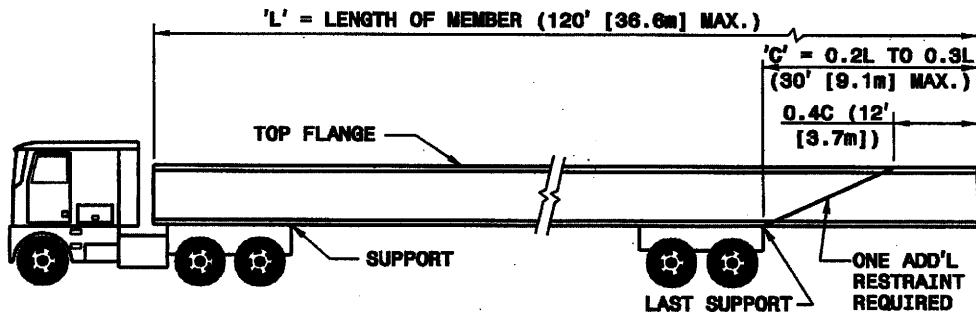

**WHEN 'C' = OVER 15' (4.6m) THRU 30' (9.1m)**

L	MIN. 'C'	MAX 'C'
75 (22.9m)	15 (4.6m)	22½ (6.9m)
80 (24.4m)	16 (4.9m)	24 (7.3m)
85 (25.9m)	17 (5.2m)	25½ (7.8m)
90 (27.4m)	18 (5.5m)	27 (8.2m)
95 (29.0m)	19 (5.8m)	28½ (8.7m)
100 (30.5m)	20 (6.1m)	30 (9.1m)
105 (32.0m)	21 (6.4m)	30 (9.1m)
110 (33.5m)	22 (6.7m)	30 (9.1m)
115 (35.1m)	23 (7.0m)	30 (9.1m)
120 (36.6m)	24 (7.3m)	30 (9.1m)

NOTES: ALL DIMENSIONS ARE IN FEET (METERS).  
 TRUCK LOADING SHOWN FOR SIMPLICITY  
 DIMENSIONS APPLY TO ALL TYPES OF SHIPMENTS.

**GROUT FOR STRUCTURES**

(7-12-07)

**1.0 DESCRIPTION**

This special provision addresses grout for use in structures, including continuous flight auger (CFA) piles, micropiles, soil nail and anchored retaining walls and backfilling crosshole sonic logging (CSL) tubes or grout pockets, shear keys, dowel holes and recesses for cored slabs and box beams. This provision does not apply to grout placed in post-tensioning ducts for bridge beams, girders, or decks. Provide grout composed of portland cement, water and at the Contractor's option, fine aggregate and/or pozzolan. If necessary, use set controlling admixtures. Proportion, mix and place grout in accordance with the plans, the applicable section of the *Standard Specifications* or special provision for the application and this provision.

**2.0 MATERIALS**

Refer to Division 10 of the *Standard Specifications*:

<b>Item</b>	<b>Article</b>
Portland Cement	1024-1
Water	1024-4
Fine Aggregate	1014-1
Fly Ash	1024-5
Ground Granulated Blast Furnace Slag	1024-6
Admixtures	1024-3

At the Contractor's option, use an approved packaged grout in lieu of the materials above with the exception of the water. Contact the Materials and Tests (M&T) Unit for a list of approved packaged grouts. Consult the manufacturer to determine if the packaged grout selected is suitable for the application and meets the compressive strength and shrinkage requirements.

**3.0 REQUIREMENTS**

Unless required elsewhere in the Contract, provide non-metallic grout with minimum compressive strengths as follows:

<b>Property</b>	<b>Requirement</b>
Compressive Strength @ 3 days	2500 psi (17.2 MPa)
Compressive Strength @ 28 days	4500 psi (31.0 MPa)

For applications other than micropiles, soil nails and ground anchors, use non-shrink grout with shrinkage of less than 0.15%.

When using approved packaged grout, a grout mix design submittal is not required. Submit grout mix designs in terms of saturated surface dry weights on M&T Form 312U in

accordance with the applicable section of the *Standard Specifications* or special provision for the structure. Use an approved testing laboratory to determine the grout mix proportions. Adjust proportions to compensate for surface moisture contained in the aggregates at the time of mixing. Changes in the saturated surface dry mix proportions will not be permitted unless a revised grout mix design submittal is accepted.

For each grout mix design, provide laboratory test results for compressive strength, density, flow and if applicable, aggregate gradation and shrinkage. Submit compressive strength for at least 3 cube and 2 cylinder specimens at the age of 3, 7, 14 and 28 days for a total of at least 20 specimens tested. Perform laboratory tests in accordance with the following:

Property	Test Method
Compressive Strength	AASHTO T106 and T22
Density	AASHTO T133
Flow for Sand Cement Grout	ASTM C939 (as modified below)
Flow for Neat Cement Grout (no fine aggregate)	Marsh Funnel and Cup API RP 13B-1, Section 2.2
Aggregate Gradation for Sand Cement Grout	AASHTO T27
Shrinkage for Non-shrink Grout	ASTM C1090

When testing grout for flow in accordance with ASTM C939, modify the flow cone outlet diameter from ½ to ¾ inch (13 to 19 mm).

When grout mix designs are submitted, the Engineer will review the mix designs and notify the Contractor as to their acceptability. Do not use grout mix designs until written acceptance has been received. Acceptance of grout mix designs or use of approved packaged grouts does not relieve the Contractor of responsibility to furnish a product that meets the Contract requirements.

Upon written request from the Contractor, a grout mix design accepted and used satisfactorily on a Department project may be accepted for use on other projects.

#### 4.0 SAMPLING AND PLACEMENT

The Engineer will determine the locations to sample grout and the number and type of samples collected for field and laboratory testing. Use API RP 13B-1 for field testing grout flow and density of neat cement grout. The compressive strength of the grout will be considered the average compressive strength test results of 3 cube or 2 cylinder specimens at 28 days.

Do not place grout if the grout temperature is less than 50°F (10°C) or more than 90°F (32°C) or if the air temperature measured at the location of the grouting operation in the shade away from artificial heat is below 40°F (4°C).

Provide grout at a rate that permits proper handling, placing and finishing in accordance with the manufacturer's recommendations unless directed otherwise by the Engineer. Use

grout free of any lumps and undispersed cement. Agitate grout continuously before placement.

Control grout delivery so the interval between placing batches in the same component does not exceed 20 minutes. Place grout before the time between adding the mixing water and placing the grout exceeds that in the table below.

<b>ELAPSED TIME FOR PLACING GROUT (with continuous agitation)</b>		
<b>Air or Grout Temperature Whichever is Higher</b>	<b>Maximum Elapsed Time</b>	
	<b>No Set Retarding Admixture Used</b>	<b>Set Retarding Admixture Used</b>
90°F (32°C) or above	30 min.	1 hr. 15 min.
80°F (27°C) through 89°F (31°C)	45 min.	1 hr. 30 min.
79°F (26°C) or below	60 min.	1 hr. 45 min.

## 5.0 MISCELLANEOUS

Comply with Articles 1000-9 through 1000-12 of the *Standard Specifications* to the extent applicable for grout in lieu of concrete.

### **HIGH STRENGTH BOLTS**

**(11-17-06)**

In Section 440-8(A) of the *Standard Specifications*, revise the third paragraph and insert a new paragraph four, respectively, as follows:

“Make sure that plain bolts and washers have a thin coat of lubricant at the time of installation.”

“Use nuts that are pre-waxed by the producer/supplier prior to shipping to the project.”

### **ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS**

**(6-11-07)**

#### 1.0 GENERAL

Installation and Testing of Adhesively anchored anchor bolts and dowels shall be in accordance with Section 420-13, 420-21 and 1081-1 of the *Standard Specifications* except as modified in this provision.

#### 2.0 INSTALLATION

Installation of the adhesive anchors shall be in accordance with manufacturer's recommendations and shall occur when the concrete is above 40 degrees Fahrenheit and has reached its 28 day strength.

The anchors shall be installed before the adhesive's initial set ('gel time').

### 3.0 FIELD TESTING

Replace the third paragraph of Section 420-13 (C) with the following:

“In the presence of the Engineer, field test the anchor bolt or dowel in accordance with the test level shown on the plans and the following:.

Level One Field testing: Test a minimum of 1 anchor but not less than 10% of all anchors to 50% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Level Two Field testing: Test a minimum of 2 anchors but not less than 10% of the all anchors to 80% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Testing should begin only after the Manufacturer’s recommended cure time has been reached. For testing, apply and hold the test load for three minutes. If the jack experiences any drop in gage reading, the test must be restarted. For the anchor to be deemed satisfactory, the test load must be held for three minutes with no movement or drop in gage reading.”

### 4.0 REMOVAL AND REPLACEMENT OF FAILED TEST SPECIMENS:

Remove all anchors and dowels that fail the field test without damage to the surrounding concrete. Redrill holes to remove adhesive bonding material residue and clean the hole in accordance with specifications. For reinstalling replacement anchors or dowels, follow the same procedures as new installations. Do not reuse failed anchors or dowels unless approved by the Engineer.

### 5.0 USAGE

The use of adhesive anchors for overhead installments is not permitted without written permission from the Engineer.

### 6.0 BASIS OF PAYMENT

No separate measurement or payment will be made for furnishing, installing, and testing anchor bolts/dowels. Payment at the contract unit prices for the various pay items will be full compensation for all materials, equipment, tools, labor, and incidentals necessary to complete the work.



**DIRECT TENSION INDICATORS****(8-18-09)**

The 2006 Standard Specifications shall be revised as follows:

Replace Section **440-8(C)(6) – Direct Tension Indicators** with the following:

Supply direct tension indicators in accordance with the requirements of ASTM F959 and Article 1072-7.

Furnish the Engineer with at least one metal feeler gage for each container of direct tension indicators shipped before beginning installation.

Make sure that the lot number on the containers of direct tension indicators is for the same lot number tested as indicated on the test documents.

Furnish to the Engineer three samples of load indicating washers from each lot number, each size and type for tests and two each of the metal feeler gages required for performing the tests.

Install the direct tension indicator under the bolt head. If it is necessary to install the direct tension indicator under the nut, or if the bolt head shall be turned, install additional hardened washers between the nut or bolt head and the direct tension indicator.

Provide a tension indicating device on the project for determining the tension imposed on a fastener when the protrusions on direct tension indicator are properly compressed.

Test 3 samples from each lot of direct tension indicators in the presence of the Engineer. Achieve a minimum bolt tension of 5% greater than that required by Table 440-1 of Article 440-8.

Do not substitute direct tension indicators for hardened steel washers required with short slotted or oversized holes. If desired, use direct tension indicators in conjunction with hardened steel washers.

Install direct tension indicators initially to a snug tight condition as specified in Subarticle 440-8(C)(3). After initial tightening, fully tighten beginning at the most rigid part of the joint and continuing toward its free edges.

For tightening fasteners containing direct tension indicators, use a clean and lubricated wrench. Maintain air supply and hoses in good condition and provide air pressure of at least 100 psi at the wrench.

When tightening the fasteners, ensure that the part of the fastener being restrained from turning does not rotate during the tightening process. Ensure that no portion of the direct tension indicator protrusions is accidentally partially flattened before installing in the structural steel joints.

Do not reuse direct tension indicators. If it is necessary to loosen a bolt previously tensioned, discard and replace the direct tension indicator.

### **CURING CONCRETE**

(8-18-09)

The 2006 Standard Specifications shall be revised as follows:

Replace the first paragraph of Section **420-15(A) – Curing Concrete – General** with the following:

Unless otherwise specified in the contract, use any of the following methods except for membrane curing compounds on bridge deck and approach slab, or on concrete which is to receive epoxy protective coating in accordance with 420-18. Advise the Engineer in advance of the proposed method. Have all material, equipment, and labor necessary to promptly apply the curing on the site before placing any concrete. Cure all patches in accordance with this article. Improperly cured concrete is considered defective.

Replace the third paragraph of Section **420-15(C) – Curing Concrete – Membrane Curing Compound Method** with the following:

Seal the surface with a single uniform coating of the specified type of curing compound applied at the rate of coverage recommended by the manufacturer or as directed, but not less than 1 gallon per 150 square feet of surface area.

### **FORMS FOR CONCRETE BRIDGE DECKS**

(8-18-09)

The 2006 Standard Specifications shall be revised as follows:

In Section **420-3(D) – Forms for Concrete Bridge Decks** replace *AASHTO Standard Specifications* with *AASHTO LRFD Bridge Construction Specifications* and *AASHTO LRFD Bridge Design Specifications*.

In Section **420-3(D)(1) – Precast Prestressed Concrete Panels** replace *AASHTO Standard Specifications* with *AASHTO LRFD Bridge Design Specifications*.

### **SOLDIER PILE RETAINING WALLS**

(SPECIAL)

#### **1.0 GENERAL**

A soldier pile retaining wall consists of steel H piles driven or placed in drilled holes and partially filled with concrete and precast concrete panels set in the pile flanges. Timber lagging is typically used for temporary support of excavations during construction. Design and construct soldier pile retaining walls based on actual elevations and dimensions in accordance with the contract and accepted submittals. For this provision, “soldier pile wall” refers to a soldier pile retaining wall. Also, “panels” refers to precast concrete panels.

## 2.0 SUBMITTALS

Two submittals are required which include the soldier pile wall design and construction submittals. Provide 11 hard copies of working drawings and 3 hard copies of design calculations for the soldier pile wall design submittal and 4 hard copies of the soldier pile wall construction submittal. Also, submit an electronic copy (PDF on CD or DVD) of each submittal. Provide the soldier pile wall construction submittal at least 30 calendar days before conducting the soldier pile wall preconstruction meeting. Do not begin soldier pile wall construction until both submittals are accepted.

### A. Soldier Pile Wall Design Submittal

The Retaining Wall Plans show plan views, typical sections, details, notes and elevation or profile views (wall envelope) for each soldier pile wall. When noted on plans and before beginning soldier pile wall design, survey existing ground elevations shown on the plans and submit a revised wall envelope for review and acceptance. Use the accepted revised wall envelope for design.

Design soldier pile walls in accordance with the plans and Section 5.6 of the *AASHTO Standard Specifications for Highway Bridges* unless otherwise required. Use a maximum pile spacing of 10 ft. Design walls for a maximum deflection of 1.5% of the wall height (difference between the top of the leveling pad and grade elevation) or 3", whichever is less. Provide temporary support of excavations taller than 5 ft. and timber lagging in accordance with the *AASHTO Guide Design Specifications for Bridge Temporary Works*.

At the Contractor's option, use driven or drilled-in piles for soldier pile walls. Install drilled-in piles by excavating holes with diameters that result in at least 3" of clearance all around piles.

Use panels for soldier pile walls. Design panels in accordance with the plans and the Load Factor Design method of Section 8 of the *AASHTO Standard Specifications for Highway Bridges* unless otherwise required. Provide reinforcement of sufficient density to satisfy Section 8.16.8.4 of the AASHTO specifications. Use a minimum panel thickness of 6".

Fill voids behind panels with no. 57 stone. Use 6 inch thick aggregate leveling pads beneath panels. Unless required otherwise on the plans, embed top of leveling pads a minimum of 1 ft below where finished grade intersects the front face of soldier pile walls.

Provide geocomposite drain strips centered between each pair of adjacent piles. Attach drain strips to the excavation face, front face of timber lagging or back face of panels. Connect drain strips to leveling pads. Extend continuous drains along base of panels or in front of piles and leveling pads. Provide drains meeting the requirements of an aggregate shoulder drain in accordance with Roadway Standard Drawing No. 816.02.

Unless shown otherwise on the plans, use cast-in-place reinforced concrete coping at top of walls for soldier pile walls with panels with dimensions shown on the plans. Extend coping a minimum of 6" above where finished grade intersects the back of soldier pile walls unless required otherwise on the plans. At the Contractor's option, connect coping to panels with dowels or extend coping down the back of panels a minimum of 6".

Submit working drawings and design calculations for review and acceptance in accordance with Article 105-2 of the *Standard Specifications*. Submit working drawings showing plan views, wall profiles with pile locations, typical sections and details of piles, drainage, temporary support of excavations, leveling pads, panels and reinforcing. Submit design calculations including deflection calculations for each wall section with different surcharge loads, geometry or material parameters. When using a software program for design, provide a hand calculation verifying the analysis of the tallest wall section. Also, submit design calculations for temporary support of excavations, if applicable. Have soldier pile walls designed, detailed and sealed by a Professional Engineer registered in North Carolina.

#### B. Soldier Pile Wall Construction Plan Submittal

Provide project specific installation information including a detailed construction sequence. For driven piles, submit proposed pile driving methods and equipment in accordance with Article 450-5 of the *Standard Specifications*. For drilled-in piles, submit installation details including drilling equipment and the method for stabilizing holes. Also, submit the method for temporary support of excavations during construction, if applicable, and any other information shown on the plans or requested by the Engineer.

If alternate installation procedures are proposed or necessary, a revised construction plan submittal may be required. If the work deviates from the accepted submittal without prior approval, the Engineer may suspend soldier pile wall construction until a revised plan is submitted and accepted.

### 3.0 MATERIALS

Provide Type 3 Manufacturer's Certifications in accordance with Article 106-3 of the *Standard Specifications* for soldier pile wall materials with the exception of steel piles and panels. Load, transport, unload and store soldier pile wall materials such that they are kept clean and free of damage. Damaged panels with excessive discoloration, chips or cracks as determined by the Engineer will be rejected.

Use timber lagging with a minimum allowable bending stress of 1000 psi that meets the requirements of Article 1082-1 of the *Standard Specifications*.

A. Steel Piles

Use steel H piles meeting the requirements of Article 1084-1 of the *Standard Specifications*. Galvanize steel piles in accordance with Section 1076 of the *Standard Specifications*.

For drilled-in piles, use excavatable flowable fill in accordance with Article 340-2 of the *Standard Specifications* and Class A Concrete in accordance with Article 1000-4 of the *Standard Specifications* except as modified herein. Provide concrete with a slump of 6 to 8 inches. Use an approved high-range water reducer to achieve this slump.

B. Wall Drainage Systems

Wall drainage systems consist of drain strips, drains and outlet components. Provide minimum average roll values (MARV) in accordance with ASTM D4759 for test reports. Identify, store and handle drain strips in accordance with ASTM D4873. Drain strips with defects, flaws, deterioration or damage will be rejected. Do not leave drain strips uncovered for more than 7 days.

Use at least 12 inch wide prefabricated geocomposite drain strips consisting of a non-woven polypropylene geotextile bonded to one side of an HDPE or polystyrene drainage core, e.g., sheet drain. Provide drain strips with cores meeting the following requirements.

Core Property	Test Method	Requirement (MARV)
(b) Thickness	ASTM D5199	¼ - ½ inch
Compressive Strength	(c) ASTM D1621	40 psi
Flow Rate (with a gradient of 1.0)	(d) ASTM D4716	5 gpm

\* per ft of width tested

Use drain and outlet materials meeting the requirements of Section 816 of the *Standard Specifications*.

C. Precast Concrete Panels

Provide precast concrete panels meeting the requirements of Sections 1000 and 1077 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Produce panels within ¼ inch of the panel dimensions shown in the accepted submittals.

A minimum compressive strength of 4000 psi at 28 days is required. For testing panels for compressive strength, 4 cylinders are required per 2000 ft<sup>2</sup> of panel face area or a single day's production, whichever is less.

Provide a final finish in accordance with Article 1077-11 of the *Standard Specifications*.

**D. No. 57 Stone**

Use standard size no. 57 stone meeting the requirements of Class VI Select Material in accordance with Section 1016 of the *Standard Specifications*.

**E. Leveling Pads**

Use Class VI Select Material in accordance with Section 1016 of the *Standard Specifications* for aggregate leveling pads.

**F. Concrete Coping**

Provide concrete coping meeting the requirements of Section 1000 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Use Class A Concrete for accordance with Article 1000-4 of the *Standard Specifications*.

**G. Joint Materials**

Use joint materials in accordance with Section 1028 of the *Standard Specifications*.

**4.0 SOLDIER PILE WALL PRECONSTRUCTION MEETING**

Before starting soldier pile wall construction, conduct a preconstruction meeting to discuss the construction and inspection of the soldier pile walls. Schedule this meeting after all soldier pile wall submittals have been accepted. The Resident or Bridge Maintenance Engineer, Bridge Construction Engineer, Geotechnical Operations Engineer, Contractor and Soldier Pile Wall Contractor Superintendent will attend this preconstruction meeting.

**5.0 CONSTRUCTION METHODS**

Control drainage during construction in the vicinity of soldier pile walls. Direct run off away from soldier pile walls and areas above and behind walls. Contain and maintain no. 57 stone and backfill and protect material from erosion.

Perform necessary clearing and grubbing in accordance with Section 200 of the *Standard Specifications*. Notify the Engineer before blasting in the vicinity of soldier pile walls. Perform blasting in accordance with the contract. Install foundations located behind soldier pile walls and within a horizontal distance equal to the tallest wall section before beginning soldier pile wall construction.

Do not excavate behind soldier pile walls. If overexcavation occurs and is not approved, repair walls at no additional cost to the Department with a method proposed by the Contractor and accepted by the Engineer. A revised soldier pile wall construction plan submittal may be required.

Install piles before excavating. Cure concrete for drilled-in piles a minimum of 7 days before proceeding with soldier pile wall construction.

Use equipment and methods reviewed and accepted in the construction plan or approved by the Engineer. Inform the Engineer of any deviations from the accepted plan.

#### A. Pile Installation

Install piles in accordance with the accepted submittals and this provision. Do not splice piles. If necessary, cut off piles at elevations shown in the accepted submittals.

For driven piles, drive piles with no negative batter (piles leaning forward) to the specified elevations in accordance with Section 450 of the *Standard Specifications* with the following exceptions.

- At the Contractor's option and when approved by the Engineer, use vibratory hammers to install full depth of piles
- Drive piles such that piles are within 1 inch (25 mm) of plan location in lieu of Article 450-6 of the *Standard Specifications*

For drilled-in piles, excavate holes with the dimensions shown in the accepted submittals. Perform pile excavation to required elevations and place piles horizontally and vertically within 1 inch of plan location with no negative batter. If overexcavation occurs, fill to required elevations with no. 57 stone before setting piles. Before placing concrete, support and center piles in excavations and remove any fluid from drilled holes. After placing piles in holes, fill around piles with concrete to the elevations shown in the accepted submittals. Remove any fluid above the concrete and fill remaining portions of holes with flowable fill.

##### 1. Pile Excavation

Use equipment of adequate capacity and capable of drilling through soil, rock, boulders, debris, man-made objects and any other materials encountered. Blasting is not permitted to advance excavations. Blasting for core removal is only permitted when approved by the Engineer. Dispose of drilling spoils in accordance with Section 802 of the *Standard Specifications* and as directed by the Engineer. Drilling spoils consist of all excavated materials including fluids removed from excavations by pumps or drilling tools.

If unstable, caving or sloughing soils are anticipated or encountered, stabilize excavations with either slurry or steel casing. When using slurry, submit slurry details including product information, manufacturer's recommendations for use, slurry equipment details and written approval from the slurry supplier that the mixing water is acceptable before beginning drilling. When using steel casing, use either the sectional type or one continuous corrugated or non-corrugated piece. Steel casings should consist of clean watertight steel of ample strength to withstand handling and driving stresses and the pressures imposed by concrete, earth and backfill. Use steel casings with an outside diameter equal to the hole size and a minimum wall thickness of  $\frac{1}{4}$  inch.

## 2. Concrete Placement

Check the water inflow rate at the bottom of holes after all pumps have been removed. If the inflow rate is less than 6" per half hour, remove any fluid and free fall concrete into excavations. Ensure that concrete flows completely around piles. If the water inflow rate is greater than 6" per half hour, propose and obtain acceptance of a concrete placement procedure before placing concrete. Place concrete in a continuous manner and remove all casings.

### B. Excavation

Construct soldier pile walls from the top down by removing material in front of walls and in between piles as needed in accordance with the following.

Excavate in staged horizontal lifts with heights not to exceed 5 ft. Use timber lagging or some other approved method for temporary support of excavations in accordance with the accepted submittals. Install temporary support within 24 hours of excavating each lift unless approved otherwise by the Engineer. The installation may be delayed if it can be demonstrated that the delay will not adversely affect the excavation face stability. If the excavation face will be exposed for more than 24 hours, use polyethylene sheets anchored at the top and bottom of the lift to protect the face from changes in moisture content.

If the excavation face becomes unstable at any time, suspend soldier pile wall construction and temporarily stabilize the face by immediately placing an earth berm against the unstable face. Soldier pile wall construction may not proceed until remedial measures are proposed by the Contractor and accepted by the Engineer. A revised soldier pile wall construction plan submittal may be required.

Do not excavate subsequent lifts until the temporary support for the preceding lift has been installed.

### C. Wall Drainage Systems

Install wall drainage systems as shown in the accepted submittals. Place and secure geocomposite drain strips with the geotextile side facing away from the wall face. Ensure that drain strips continuously contact the surface to which they are attached and allow for full flow the entire height of the wall. Discontinuous drain strips are not allowed. If splices are needed, overlap drain strips a minimum of 12" such that flow is not impeded. Connect drain strips to leveling pads by embedding strip ends at least 4" into the no. 57 stone.

Construct drains in accordance with Section 816 of the *Standard Specifications*. Provide drains with positive drainage toward outlets.



#### D. Leveling Pads and Panels

Construct leveling pads and drains at elevations and with dimensions shown in the accepted submittals. Construct drains in accordance with Section 816 of the *Standard Specifications*. Compact no. 57 stone for aggregate leveling pads with a vibratory compactor to the satisfaction of the Engineer.

Set panels against pile flanges as shown in the accepted submittals. Ensure at least 2" of contact in the horizontal direction between the panel faces and pile flanges. If contact can not be maintained, remove panels, fill gaps with joint filler and reset panels. Support panels securely until enough no. 57 stone or backfill is placed to hold panels in place.

#### E. Backfill

Backfill behind panels with no. 57 stone. Ensure all voids between panels and piles and the excavation face are filled with no. 57 stone and compact stone to the satisfaction of the Engineer.

#### F. Coping

Construct concrete coping as shown in the accepted submittals. Construct coping in accordance with Section 420 of the *Standard Specifications*. Do not remove forms until concrete achieves a minimum compressive strength of 2400 psi. Provide a Class 2 Surface Finish for coping in accordance with Article 420-17 of the *Standard Specifications*.

Construct coping joints at a maximum spacing of 10 ft. Half-inch thick expansion joints in accordance with Article 420-10 of the *Standard Specifications* are required every third joint. Half-inch deep grooved contraction joints in accordance with Subarticle 825-10(B) of the *Standard Specifications* are required for the remaining joints. Stop coping reinforcement 2" from either side of expansion joints. Seal joints above and behind soldier pile walls between coping and ditches with joint sealer.

#### G. Coating Cleaning and Repair

After wall construction is complete, clean exposed galvanized surfaces of piles with a 2500 psi pressure washer. Repair galvanized surfaces that are exposed and damaged in accordance with Article 1076-6 of the *Standard Specifications*. Measurement and Payment

*Soldier Pile Retaining Walls* will be measured and paid for in square feet. Soldier pile walls will be measured as the exposed face area with the wall height equal to the difference between the top and bottom of wall elevation. The top of wall elevation is defined as the top of concrete coping. The bottom of wall elevation is defined as where the finished grade intersects the front face of the soldier pile wall. No payment will be made for portions of soldier pile walls below bottom of wall elevations.

The contract unit price bid for *Soldier Pile Retaining Walls* will be full compensation for design, submittals, furnishing labor, tools, equipment and materials, installing piles, excavating, providing temporary support of excavations, wall drainage systems, reinforcement, leveling pads, backfill, no. 57 stone, coping and any incidentals necessary to design and construct soldier pile walls in accordance with this provision.

Payment will be made under:

<b>Pay Item</b>	<b>Pay Unit</b>
Soldier Pile Retaining Walls	Square Foot