

**PROJECT SPECIAL PROVISIONS**

**ROADWAY**

**EXISTING STRUCTURE PLANS:**

Plan sheets for the existing structure are available at the following web address:  
<http://www.ncdot.org/doh/preconstruct/ps/contracts/letting.html>

**SUBMITTAL OF WORKING DRAWINGS**

**SPECIAL**

**General**

Submit working drawings in accordance with Article 105-2 of the *Standard Specifications* and this provision. For this provision, "submittals" refers to only those listed in this provision. The list of submittals contained herein does not represent a complete list of required submittals for the project. Submittals are only necessary for those items as required by the contract. **Make submittals that are not specifically noted in this provision directly to the Resident Engineer.**

To minimize review time, make sure all submittals are complete when initially submitted. The first submittal may be made via email. Provide a contact name and information with each submittal. Direct any questions regarding submittal requirements to the Resident Engineer or State Bridge Management Unit.

**Addresses and Contacts**

<p>Mr. Rick Nelson, PE Asst. State Bridge Management Engineer NC Dept. of Transportation State Bridge Management Unit 4809 Beryl Drive Raleigh, NC 27606 Fax: 919.733.2348 Ph: 919.733.4362 Email: enelson@ncdot.gov</p>	<p>Mr. Aaron Dacey Coatings &amp; Corrosion Engineer NC Dept. of Transportation Materials &amp; Tests Unit 1563 Mail Service Center Raleigh, NC 27699-1563 Fax: 919.733.8742 Ph: 919.329.4090 Email: adacey@ncdot.gov</p>
--	---

Furnish one complete copy of each submittal, including all attachments, to the Resident Engineer. At the same time, submit the number of copies shown below of the same complete submittal directly to the State Bridge Management Unit and the Materials&Tests Unit.

The table below covers "Submittals". The Resident Engineer will receive review comments and drawing markups for these submittals from the State Bridge Management Unit.

Unless otherwise required, submit one set of supporting calculations to the State Bridge Management Unit. Provide additional copies of any submittal as directed by the Engineer.

**SUBMITTALS**

<b>Submittal</b>	<b>Copies Required by SBMU</b>	<b>Copies Required by Materials &amp; Tests</b>	<b>Contract Reference Requiring Submittal</b>
Bridge Painting Submittals (Under Structure Platforms, Containment, Product Data, Health & Safety, QC Plan, etc.)	1 via email, Then 5 hard copies	1 via email	Special Provision

**FALSEWORK AND FORMWORK**

(8-4-09)

**Description**

Use this Special Provision as a guide to develop temporary works submittals required by the Standard Specifications or other provisions; no additional submittals are required herein. Such temporary works include, but are not limited to, falsework and formwork.

Falsework is any temporary construction used to support the permanent structure until it becomes self-supporting. Formwork is the temporary structure or mold used to retain plastic or fluid concrete in its designated shape until it hardens. Access scaffolding is a temporary structure that functions as a work platform that supports construction personnel, materials, and tools, but is not intended to support the structure. Scaffolding systems that are used to temporarily support permanent structures (as opposed to functioning as work platforms) are considered to be falsework under the definitions given. Shoring is a component of falsework such as horizontal, vertical, or inclined support members. Where the term "temporary works" is used, it includes all of the temporary facilities used in bridge construction that do not become part of the permanent structure.

Design and construct safe and adequate temporary works that will support all loads imposed and provide the necessary rigidity to achieve the lines and grades shown on the plans in the final structure.

**Materials**

Select materials suitable for temporary works; however, select materials that also ensure the safety and quality required by the design assumptions. The Engineer has authority to reject material on the basis of its condition, inappropriate use, safety, or nonconformance with the plans. Clearly identify allowable loads or stresses for all materials or manufactured devices on the plans. Revise the plan and notify the Engineer if any change to materials or material strengths is required.

## Design Requirements

### Working Drawings:

Provide working drawings for items as specified in the contract, or as required by the Engineer, with design calculations and supporting data in sufficient detail to permit a structural and safety review of the proposed design of the temporary work.

When concrete placement is involved, include data such as the drawings of proposed sequence, rate of placement, direction of placement, and location of all construction joints. Submit the number of copies as called for by the contract.

When required, have the drawings and calculations prepared under the guidance of, and sealed by, a North Carolina Registered Professional Engineer who is knowledgeable in temporary works design.

Design falsework and formwork requiring submittals in accordance with the 1995 AASHTO Guide Design Specifications for Bridge Temporary Works except as noted herein.

### Wind Loads:

Table 2.2 of Article 2.2.5.1 is modified to include wind velocities up to 110 mph (177 km/hr). In addition, Table 2.2A is included to provide the maximum wind speeds by county in North Carolina.

**Table 2.2 - Wind Pressure Values**

Height Zone feet (m) above ground	Pressure, lb/ft <sup>2</sup> (kPa) for Indicated Wind Velocity, mph (km/hr)				
	70 (112.7)	80 (128.7)	90 (144.8)	100 (160.9)	110 (177.0)
0 to 30 (0 to 9.1)	15 (0.72)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)
30 to 50 (9.1 to 15.2)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)
50 to 100 (15.2 to 30.5)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)
over 100 (30.5)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)	50 (2.39)

### Time of Removal:

The following requirements replace those of Article 3.4.8.2.

Do not remove forms until the concrete has attained strengths required in Article 420-16 of the Standard Specifications and these Special Provisions.

Do not remove forms until the concrete has sufficient strength to prevent damage to the surface.

**Table 2.2A - Steady State Maximum Wind Speeds by Counties in North Carolina**

COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)
Alamance	70 (112.7)	Franklin	70 (112.7)	Pamlico	100 (160.9)
Alexander	70 (112.7)	Gaston	70 (112.7)	Pasquotank	100 (160.9)
Alleghany	70 (112.7)	Gates	90 (144.8)	Pender	100 (160.9)
Anson	70 (112.7)	Graham	80 (128.7)	Perquimans	100 (160.9)
Ashe	70 (112.7)	Granville	70 (112.7)	Person	70 (112.7)
Avery	70 (112.7)	Greene	80 (128.7)	Pitt	90 (144.8)
Beaufort	100 (160.9)	Guilford	70 (112.7)	Polk	80 (128.7)
Bertie	90 (144.8)	Halifax	80 (128.7)	Randolph	70 (112.7)
Bladen	90 (144.8)	Harnett	70 (112.7)	Richmond	70 (112.7)
Brunswick	100 (160.9)	Haywood	80 (128.7)	Robeson	80 (128.7)
Buncombe	80 (128.7)	Henderson	80 (128.7)	Rockingham	70 (112.7)
Burke	70 (112.7)	Hertford	90 (144.8)	Rowan	70 (112.7)
Cabarrus	70 (112.7)	Hoke	70 (112.7)	Rutherford	70 (112.7)
Caldwell	70 (112.7)	Hyde	110 (177.0)	Sampson	90 (144.8)
Camden	100 (160.9)	Iredell	70 (112.7)	Scotland	70 (112.7)
Carteret	110 (177.0)	Jackson	80 (128.7)	Stanley	70 (112.7)
Caswell	70 (112.7)	Johnston	80 (128.7)	Stokes	70 (112.7)
Catawba	70 (112.7)	Jones	100 (160.9)	Surry	70 (112.7)
Cherokee	80 (128.7)	Lee	70 (112.7)	Swain	80 (128.7)
Chatham	70 (112.7)	Lenoir	90 (144.8)	Transylvania	80 (128.7)
Chowan	90 (144.8)	Lincoln	70 (112.7)	Tyrell	100 (160.9)
Clay	80 (128.7)	Macon	80 (128.7)	Union	70 (112.7)
Cleveland	70 (112.7)	Madison	80 (128.7)	Vance	70 (112.7)
Columbus	90 (144.8)	Martin	90 (144.8)	Wake	70 (112.7)
Craven	100 (160.9)	McDowell	70 (112.7)	Warren	70 (112.7)
Cumberland	80 (128.7)	Mecklenburg	70 (112.7)	Washington	100 (160.9)
Currituck	100 (160.9)	Mitchell	70 (112.7)	Watauga	70 (112.7)
Dare	110 (177.0)	Montgomery	70 (112.7)	Wayne	80 (128.7)
Davidson	70 (112.7)	Moore	70 (112.7)	Wilkes	70 (112.7)
Davie	70 (112.7)	Nash	80 (128.7)	Wilson	80 (128.7)
Duplin	90 (144.8)	New Hanover	100 (160.9)	Yadkin	70 (112.7)
Durham	70 (112.7)	Northampton	80 (128.7)	Yancey	70 (112.7)
Edgecombe	80 (128.7)	Onslow	100 (160.9)		
Forsyth	70 (112.7)	Orange	70 (112.7)		

Note on the working drawings any anchorages, connectors, inserts, steel sleeves or other such devices used as part of the falsework or formwork that remains in the permanent structure. If the plan notes indicate that the structure contains the necessary corrosion protection required for a Corrosive Site, epoxy coat, galvanize, metallize or otherwise protect these devices as directed by the Engineer. Any coating required by the Engineer will be considered incidental to the various pay items requiring temporary works.

### **Review and Approval**

The Engineer is responsible for the review and approval of temporary works' drawings. Submit the working drawings sufficiently in advance of proposed use to allow for their review, revision (if needed), and approval without delay to the work.

Do not start construction of any temporary work for which working drawings are required until the drawings have been approved. Such approval does not relieve the Contractor of the responsibility for the accuracy and adequacy of the working drawings.

The time period for review of the working drawings does not begin until complete drawings and design calculations, when required, are received by the Engineer.

On the drawings, show all information necessary to allow the design of any component to be checked independently as determined by the Engineer.

If requested by the Engineer, submit with the working drawings manufacturer's catalog data listing the weight of all construction equipment that will be supported on the temporary work. Show anticipated total settlements and/or deflections of falsework and forms on the working drawings. Include falsework footing settlements, joint take-up, and deflection of beams or girders. Falsework hangers that support concentrated loads and are installed at the edge of thin top flange concrete girders (such as bulb tee girders) shall be spaced so as not to exceed 75% of the manufacturer's stated safe working load. Use of dual leg hangers (such as Meadow Burke HF-42 and HF-43) are not allowed. Design the falsework and forms supporting deck slabs and overhangs on girder bridges so that there will be no differential settlement between the girders and the deck forms during placement of deck concrete.

### **Construction Requirements**

All requirements of Section 420 of the Standard Specifications apply.

Construct temporary works in conformance with the approved working drawings. Ensure that the quality of materials and workmanship employed is consistent with that assumed in the design of the temporary works. Do not weld falsework members to any portion of the permanent structure unless approved. Show any welding to the permanent structure on the approved construction drawings.

Provide tell-tales attached to the forms and extending to the ground, or other means, for accurate measurement of falsework settlement. Make sure that the anticipated compressive settlement and/or deflection of falsework does not exceed 1 inch (25 mm). For cast-in-place concrete structures, make sure that the calculated deflection of falsework flexural members does not exceed 1/240 of their span regardless of whether or not the deflection is compensated by camber strips.

**Maintenance and Inspection:**

Inspect and maintain the temporary work in an acceptable condition throughout the period of its use. Certify that the manufactured devices have been maintained in a condition to allow them to safely carry their rated loads. Clearly mark each piece so that its capacity can be readily determined at the job site.

Perform an in-depth inspection of an applicable portion(s) of the temporary works, in the presence of the Engineer, not more than 24 hours prior to the beginning of each concrete placement. Inspect other temporary works at least once a month to ensure that they are functioning properly. Have a North Carolina Registered Professional Engineer inspect the cofferdams, shoring, sheathing, support of excavation structures, and support systems for load tests prior to loading.

**Foundations:**

Determine the safe bearing capacity of the foundation material on which the supports for temporary works rest. If required by the Engineer, conduct load tests to verify proposed bearing capacity values that are marginal or in other high-risk situations.

The use of the foundation support values shown on the contract plans of the permanent structure is permitted if the foundations are on the same level and on the same soil as those of the permanent structure.

Allow for adequate site drainage or soil protection to prevent soil saturation and washout of the soil supporting the temporary works supports.

If piles are used, the estimation of capacities and later confirmation during construction using standard procedures based on the driving characteristics of the pile is permitted. If preferred, use load tests to confirm the estimated capacities; or, if required by the Engineer conduct load tests to verify bearing capacity values that are marginal or in other high risk situations.

The Engineer reviews and approves the proposed pile and soil bearing capacities.

**Removal**

Unless otherwise permitted, remove and keep all temporary works upon completion of the work. Do not disturb or otherwise damage the finished work.

Remove temporary works in conformance with the contract documents. Remove them in such a manner as to permit the structure to uniformly and gradually take the stresses due to its own weight.

**Method of Measurement**

Unless otherwise specified, temporary works will not be directly measured.

**Basis of Payment**

Payment at the contract unit prices for the various pay items requiring temporary works will be full compensation for the above falsework and formwork.

**ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS**

(6-11-07)

**General**

Installation and Testing of Adhesively anchored anchor bolts and dowels shall be in accordance with Section 420-13, 420-21 and 1081-1 of the Standard Specifications except as modified in this provision.

**Installation**

Installation of the adhesive anchors shall be in accordance with manufacturer's recommendations and shall occur when the concrete is above 40 degrees Fahrenheit and has reached its 28 day strength.

The anchors shall be installed before the adhesive's initial set ('gel time').

**Field Testing**

Replace the third paragraph of Section 420-13 (C) with the following:

"In the presence of the Engineer, field test the anchor bolt or dowel in accordance with the test level shown on the plans and the following:

Level One Field testing: Test a minimum of 1 anchor but not less than 10% of all anchors to 50% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Level Two Field testing: Test a minimum of 2 anchors but not less than 10% of the all anchors to 80% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Testing should begin only after the Manufacturer's recommended cure time has been reached. For testing, apply and hold the test load for three minutes. If the jack experiences any drop in gage reading, the test must be restarted. For the anchor to be deemed satisfactory, the test load must be held for three minutes with no movement or drop in gage reading."

**Removal and Replacement of Failed Test specimens:**

Remove all anchors and dowels that fail the field test without damage to the surrounding concrete. Redrill holes to remove adhesive bonding material residue and clean the hole in accordance with specifications. For reinstalling replacement anchors or dowels, follow the same procedures as new installations. Do not reuse failed anchors or dowels unless approved by the Engineer.

**Usage**

The use of adhesive anchors for overhead installments is not permitted without written permission from the Engineer.

**Basis of Payment**

No separate measurement or payment will be made for furnishing, installing, and testing anchor bolts/dowels. Payment at the contract unit prices for the various pay items will be full compensation for all materials, equipment, tools, labor, and incidentals necessary to complete the work.

**CLEANING AND PAINTING EXISTING STRUCTURE****SPECIAL****SCOPE OF WORK**

This work shall consist of furnishing all labor, equipment, and materials to clean and paint the structural steel of the existing bridges. Work includes: removing, containment and disposal of the existing paint system; preparation of the surface to be painted and applying the new paint system; traffic control, portable lighting; seeding and mulching all grassed areas disturbed; and all incidental items necessary to complete the project as specified and shown on the plans.

The contractor shall be responsible for fulfilling all requirements of the NCDOT Standard Specifications for Roads and Structures dated July 2006, except as otherwise specified herein.

**Bridge #332 Mecklenburg County:** The bridge was built in 1971 and carries I-277 over Johnson St, Seaboard St., Norfolk Southern Railroad and CSX Railroad. The superstructure consists of 20 spans of various I-Beams and plate girders (See Structure Plans). The bridge is 1189' in length with a concrete deck and a 180'-9" clear deck width. The minimum vertical clearances are:

Johnson St: 14'-10"

Seaboard St.: 29'-6"

NSRR: 31'-11"

CSXT: 32'-10"

The existing paint system is aluminum over red lead, and the estimated area to be cleaned and painted is 270,669 sq. ft.

**SPECIALTY ITEMS:**

**SSPC QP-2 Certification** - The existing paint systems include toxic substances such as red lead oxide, which are considered hazardous if improperly removed. Only contractors who are currently SSPC QP-2, Category A certified, and have successfully<sup>1</sup> completed lead paint removal on similar structures within 18 months prior to this bid, may bid on and perform this work.

<sup>1</sup> Successfully: Lead abatement work completed in accordance with contract specifications, free of citation from safety or environmental agencies. Lead abatement work shall include but not be limited to: abrasive blasting; waste handling, storage and disposal; worker safety during lead abatement activities (fall protection, PPE, etc.); and containment. This requirement is in addition to the contractor pre-qualification requirements covered by NCDOT Std. Specification, Section 102-2.



**The apparent low bidder shall submit a list of projects for which QP2 work was performed within the last 18 months including owner contact information and submit to the Assistant State Bridge Management Engineer a "Lead Abatement Affidavit" by 12:00 noon of the third day following the opening of bids. This form may be downloaded from:**

**<http://www.ncdot.gov/projects/ncbridges/>**

**Pre-Construction Meeting** – The following submittals must be submitted to the Engineer for review and approval prior to scheduling the pre-construction meeting:

Work Schedule, Containment drawings, Wash Water Sampling and Disposal Plan, Health & Safety Plan, Environmental Compliance Plan, Quality Control Plan (including, Personnel Qualifications, Product Data sheets for blast media and paint, Coating MSDS and test reports for each batch of paint to be used on the project, and paint repair procedures).

When requesting a pre-construction meeting the Contractor must contact the Engineer at least 7 working days in advance of the desired pre-construction date.

**Work Schedule** –Schedule shall be kept up to date, with a copy of the revised schedule being provided to the Engineer in a timely manner.

**Twelve-month Observation Period** - The Contractor maintains responsibility for the coating system for a twelve (12) month observation period beginning upon the satisfactory completion of all the work required in the plans or as directed by the Engineer. The Contractor must guarantee the coating system under the payment and performance bond (refer to Article 109-10). To successfully complete the observation period, the coating system must meet the following requirements after twelve (12) months service:

- No visible rust, contamination or application defect is observed in any coated area.
- Painted surfaces have a uniform color and gloss.
- Painted surfaces have an adhesion that meets an ASTM D-3359, 3A rating.

Final acceptance is made only after the paint system meets the above requirements.

**Containment Plan** - No work begins until the Contractor furnishes the Engineer with a containment plan for surface preparation and coating operations and the Engineer reviews and responds in writing about the acceptability of said plan. Such plan must meet or exceed the requirements of a Class 2A containment in accordance with SSPC Guide 6. Enclosure drawings, loads supported by the structure and the ventilation system must be prepared, signed and sealed by a Registered North Carolina Professional Engineer.

In the containment plan describe how debris are contained and collected. Describe the type of tarpaulin and bracing materials and the maximum designed wind load. Describe the dust collection system and how a negative pressure of 0.03 inches of water column is maintained inside the enclosure while blasting operations are being conducted. Describe how the airflow inside the containment structure is designed to meet all applicable OSHA Standards. Describe how water run-off from rain will be routed by or through the enclosure. Describe how wash water will be contained and paint chips separated. Describe what physical containment will be provided during painting application to protect vehicles and areas not to be painted.

Prior to beginning work, the contractor shall inspect the containment and submit a written statement certifying that the erected structure complies with the approved detailed drawings.

**Wash water Sampling and Disposal Plan** - No work begins until the Contractor furnishes the Engineer with a Wash Water and Disposal Plan and the Engineer reviews and approves in writing said plan. All wash water shall be collected and sampled prior to disposal. Representative sampling and testing methodology shall conform to 15A NCAC 02B.0103, "Analytical Procedures". Wash water shall be tested for pollutants listed in 15A NCAC 02B.0211 (3), 15A NCAC 02T.0505 (b)(1) and 15A NCAC 2T.0905 (h) (See link below for NCDOT Guidelines for Managing Bridge Wash Water). Depending on the test results, wash water disposal methods shall be described in the disposal plan. Wash water shall be disposed of in accordance with all current state and federal regulations and the "NCDOT Guidelines for Managing Bridge Wash Water" available at the below link.

<http://www.ncdot.gov/projects/nbridges/>

**Waste Handling of Paint and Abrasives** – Use a company from the below list of approved waste management companies. Immediately after award of the contract, the Contractor arranges for waste containers, testing, transportation and disposal of all waste. No work begins until the Contractor furnishes the Engineer with a written waste disposal plan. Any alternative method for handling waste must be pre-approved by the Engineer.

Southern Logistics, Inc. – 312 Orvil Wright Blvd, Greensboro, NC 27409 (Ph. 336-662-0292)  
A&D Environmental – PO Box 484, High Point, NC 27261 (Ph. 336-434-7750)  
Poseidon Environmental Services, Inc. – 837 Boardman-Canfield Rd #209, Youngstown, OH (Ph. 330-726-1560)

All removed paint and spent abrasive media shall be tested for lead following the SW-846 TCLP Method 1311 Extraction, as required in 40 CFR 261, Appendix 11, to determine whether it must be disposed of as hazardous waste. Random sampling using composite samples of at least 20% (minimum of 2 composite samples) of the waste is required for characterization of the waste. A composite sample consists of equal mass samples from 3 to 4 drums. The Contractor shall furnish the Engineer certified test reports showing TCLP results of the paint chips stored on site, with disposal being in accordance with "Flowchart on Lead Waste Identification and Disposal".

([www.wastenotnc.org/hwhome/guidance/guidance.htm](http://www.wastenotnc.org/hwhome/guidance/guidance.htm)).

Until test results are received, all waste shall be considered hazardous waste and be stored and labeled as "Lead Waste-Pending Testing". Waste containers shall be stored in a covered and secured storage container. Once test results are received, waste shall be labeled as either "Hazardous Waste" or "Lead Waste Pending Disposal".

Once the waste has been collected, and the quantity determined, the Contractor prepares the appropriate shipping documents and manifests and presents them to the Engineer for waste shipment and disposal. The Engineer will verify the type and quantity of waste and obtain a Provisional EPA ID number from the NC Hazardous Waste Section.

North Carolina Department of Environment & Natural Resources  
1646 Mail Service Center  
Raleigh, NC 27699  
Phone (919) 508-5400 Fax (919) 715-4061

At the time of shipping the Engineer will sign, date and add the ID number in the appropriate section on the manifest. The cost for waste disposal (including any lab fees) is included in the bid price for this contract. Note NC Hazardous Waste Management Rules (15A NCAC 13A) for more information. Provisional EPA ID numbers may be obtained at this link:

[www.wastenotnc.org/HWHOME/ProvisionalIDRequirements.pdf](http://www.wastenotnc.org/HWHOME/ProvisionalIDRequirements.pdf)

Testing labs shall be certified in accordance with North Carolina State Laboratory Public Health Environmental Sciences . List of certified laboratories may be obtained at this link:

(<http://slphreporting.ncpublichealth.com/EnvironmentalSciences/Certification/CertifiedLaboratory.asp>)

All test results shall be documented on the lab analysis as follows:

1. For leachable lead
  - a. Soils/Solid/Liquid- EPA 1311/200.7/6010

All sampling shall be done in presence of the Engineer's representative

**Equipment Mobilization** - The equipment used in any travel lanes and paved shoulder must be mobile equipment on wheels that has the ability to moved on/off the roadway in less than 30 minutes. All work conducted in travel lanes must be from truck or trailer supported platforms and all equipment must be self propelled or attached to a tow vehicle at all times.

#### **SUBLETTING OF CONTRACT:**

Only contractors certified to meet SSPC QP-2, Category A, and have successfully completed lead paint removal on similar structures within 18 months prior to this bid are qualified for this work. Work is only sublet by approval of the Engineer.

#### **SPECIFICATIONS:**

The North Carolina Department of Transportation (NCDOT) *Standard Specifications for Roads and Structures dated July 2006*, together with these Special Provisions apply to this project. Surface preparation and painting are performed in accordance with Section 442 except where otherwise noted in these Special Provisions. The Paint materials must meet the applicable materials specifications under Section 1080. Materials approvals are in accordance with 4.0 Materials of this Special Provision.

**CLEANING AND PAINTING BRIDGE #332****1.0 PREPARATION OF SURFACES:**

- 1.1 Power washing with low pressure water -- Before any other surface preparation are conducted, all surfaces shall be power washed to remove dust, salts, dirt and other contaminants.
- 1.2 Blasting is done with recyclable steel grit meeting the requirements of Section 1080-15. The profile must be between 1.0 and 3.0 mils when measured on a smooth steel surface. A minimum of two tests per beam/girder and two tests per span of diaphragms/cross bracing shall be conducted and documented.
- 1.3 Before the contractor departs from the work site at the end of the work day, all debris generated during surface preparation are collected in approved containers.
- 1.4 The Contractor cleans a two square foot area at each structure to demonstrate the specified finish and the inspector preserves this area by covering it with tape, plastic or some other suitable means so that it can be retained as a site standard.
- 1.5 Any area of corroded steel (steel which has lost more than 50% of its original thickness) must not be painted until the Engineer observes its condition.
- 1.6 All parts of the bridges not to be painted, and the travelling public, shall be protected from overspray. The Contractor shall submit a plan to protect all parts of bridge that are not required to be painted, in addition to a plan to protect the traveling public and surrounding environment while applying all layers paint to a structure.
- 1.7 Surface chloride levels for painting are  $7 \text{ ug/cm}^2$  or below.
- 1.8 All weld splatter, slag or other surface defects resulting in a raised surface above the final paint layer shall be removed prior to application of primer coat.

**2.0 PAINTING OF STEEL:**

Paint System 1, as specified in these special provisions and Section 442 of NCDOT's Standard Specifications, is to be used for this work. System 1 is an inorganic zinc primer and acrylic topcoats used over blast cleaned surfaces in accordance with SSPC-SP-10 (Near White Blast).

Any area where newly applied paint fails to meet the specifications must be repaired or replaced by the Contractor. The Engineer approves all repair processes before the repair is made. Repaired areas must meet the specifications. The Contractor properly tapers repair areas and applies an additional finish coat of paint to areas where the tape adhesion test is conducted.

All layers of paint that are not fully completed shall be tapered no less than 6" until successive coats are applied.

**MATERIALS:**

Only paint suppliers that have a NCDOT qualified inorganic zinc primer may furnish paints for this project. All paints applied to a structure must be from the same supplier. Before any paints are applied the Contractor provides the Engineer a manufacturer's certification that each batch of paint meets the requirements of the applicable Section 1080 of the *Standard Specifications*.

The inspector randomly collects a one pint sample of each paint product used on the project. Additional samples may be collected as needed to verify compliance to the specifications.

**INSPECTION:**

Quality Assurance Inspection - The Contractor furnishes all necessary apparatus such as ladders, scaffolds and platforms as required for the inspector to have reasonable and safe access to all parts of the work. The contractor illuminates the surfaces to be inspected to a minimum of 50-foot candles of light.

Contractor must insure that chloride levels on the surfaces are  $7 \text{ ug/cm}^2$  or lower using an acceptable sample method in accordance with SSPC Guide 15. The frequency of testing shall be 2 tests per span after all surface preparation has been completed and immediately prior to painting. Test areas selected shall represent the greatest amount of corrosion in the span as determined by the Engineers' representative.

NCDOT reserves the right for ongoing QA (Quality Assurance) inspection to include but not limited to surface contamination testing, adhesion pull testing and DFT readings as necessary to assure quality.


The Contractor informs the Engineer of all scheduled and unannounced inspections from SSPC, OSHA, EPA and/or others that come on site and furnishes the Engineer a copy of all inspection reports.

Inspection Instruments - The Contractor furnishes at least the following calibrated instruments at site and conducts the quality control testing:

- Sling Psychrometer - ASTM E-337 – bulb type
- Surface Temperature Thermometer
- Wind Speed Indicator
- Tape Profile Tester – ASTM D-4417 Method C
- Surface Condition Standards – SSPC VIS-1 and VIS-3
- Wet Film Thickness Gage – ASTM D-4414
- Dry Film Thickness Gage – SSPC-PA2 Modified
- Solvent Rub Test Kit – ASTM D-4752
- Adhesion Test Kit – ASTM D-3359 Method A (Tape Test)
- Adhesion Pull test – ASTM D-4541
- Surface Contamination Analysis Kit or (Chloride Level Test Kit)

The contractor maintains a daily quality control record in accordance with Section 442-12 and such records must be available at the job site for review by the inspector and be submitted to the Engineer as directed. In addition to the information required on M&T-610, the Contractor shall submit all DFT readings as required on M&T611.

- A. The dry film thickness is measured at each spot as indicated on the attached diagram at no less than three random locations along each girder in each span. Also dry film thickness is measured at no less than six random spots per span on diaphragms/"K" frames. Each spot is an average of three to five readings in accordance with SSPC PA-2.

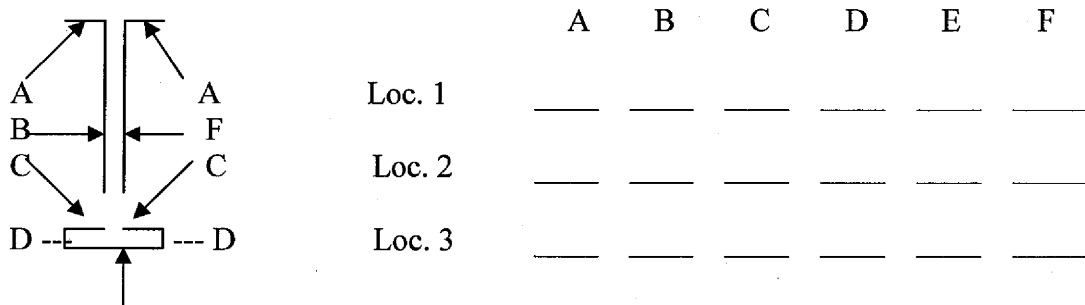

E Randomly select one A, one C and one D spot along with B, E and F.

- B. Two random adhesion tests (1 test=3 dollies) per span are conducted on interior surfaces in accordance with ASTM D-4541 after the prime coat has been properly cured in accordance with ASTM D-4752 with no less than a 4 resistance rating, and will be touched up by the Contractor. The required minimum average adhesion is 400 psi.
- C. Cure of the intermediate and stripe coats shall be accessed by utilizing the thumb test prior to the application of any successive layers of paint.
- D. One random Cut Tape adhesion test per span is conducted in accordance with ASTM D-3359 on interior surface after the finish coat is cured. Repair areas shall be properly tapered and touched up by the Contractor.

**SAFETY AND ENVIRONMENTAL COMPLIANCE PLANS:**

Personnel access boundaries are delineated for each work site using signs, tape, cones or other approved means. Submit copies of safety and environmental compliance plans that comply with SSPC QP-2 Certification requirements.

**ENVIRONMENTAL MONITORING:**

Comply with Section 442-13(B) of NCDOT's Standard Specifications.

A "Competent Person"<sup>2</sup> is on site during all surface preparation activities and monitors the effectiveness of containment and dust collection systems. Any visible emissions outside the containment enclosure or pump monitoring results exceeding the level of 30 µg/m<sup>3</sup> TWA is justification to suspend the work. Before any work begins the Contractor provides a written summary of the responsible person's safety training.

#### **HEALTH AND SAFETY RESPONSIBILITY:**

Comply with Section 442-13(C) of NCDOT's Standard Specifications. Insure employee blood sampling test results are less than 50 micrograms per deciliter. Remove employees with a blood sampling test of 50 or more micrograms per deciliter from work activities involving any lead exposure.

An employee who has been removed with a blood level of 50 micrograms per deciliter or more shall have two consecutive blood sampling tests indicating that the employee's blood lead level is at or below 40 micrograms per deciliter before returning to work activities involving any lead exposure.

#### **STORAGE OF PAINT AND EQUIPMENT:**

The Prime Contractor provides a location for materials, equipment and waste storage. Tarpaulins are spread over all pavements and surfaces underneath equipment utilized for abrasive recycling and other lead handling equipment or containers.

#### **UTILITIES:**

The Contractor protects all utility lines or mains which may be supported on, under, or adjacent to bridge work sites from damage and paint over-spray.

#### **PAYMENT:**

The cost of inspection, surface preparation and repainting the existing structure is included in the lump sum price bid for "Cleaning and Repainting of Bridge # \_\_\_\_". This price is full compensation for furnishing all inspection equipment, all paint, cleaning abrasives, cleaning solvents and all other materials; preparing and cleaning surfaces to be painted; applying paint in the field; protecting work, traffic and property; and furnishing blast cleaning equipment, paint spraying equipment, brushes, rollers and any other hand or power tools and any other equipment; containment, handling and disposal of debris and wash water, all personal protective equipment, and all personal hygiene requirements.

---

<sup>2</sup> **Competent Person** as defined in OSHA 29 CFR 1926.62 is one who is capable of identifying existing and predictable hazards in the surroundings or working conditions which are unsanitary, hazardous, or dangerous to employees, and who have authorization to take prompt corrective measures to eliminate them.

This price shall be full compensation for all inspection equipment, all materials and labor necessary to fully contain the blast debris; daily collection of the blast debris into the specified containers; and any measures necessary to ensure conformance to all safety and environmental regulations as directed by the Engineer.

### **MANAGING BRIDGE WASH WATER**

#### **1.0 Description**

Collect and properly dispose of Bridge Wash Water from bridge decks.

#### **2.0 Construction Methods**

- (A) Prepare a written Bridge Wash Water management plan in accordance with the Guidelines for Managing Bridge Wash Water available at <http://www.ncdot.org/doh/preconstruct/ps/contracts/letting.html>. Submit plan and obtain approval from the Engineer prior to beginning of the bridge cleaning operation.
- (B) Prior to final payment, submit a paper copy of all completed records pertaining to disposal of Bridge Wash Water.

#### **3.0 Measurement and Payment**

Payment for collecting, sampling, testing, pH adjustment, monitoring, handling, discharging, hauling, disposing of the bridge wash water, documentation, record keeping, and obtaining permits if applicable, shall be included in the payment for other items.

### **PAINT SAMPLING AND TESTING:**

8-15-06

(SP10 R 45)

Revise the 2006 Standard Specifications as follows:

Page 10-190, Article 1080-4, Delete the first paragraph and replace with the following:

All paint will be sampled, either at the point of manufacture or at the point of destination. Inspection and sampling will be performed at the point of manufacture wherever possible. The Contractor shall not begin painting until the analysis of the paint has been performed, and the paint has been accepted.



**QUALIFICATION OF WELDS AND PROCEDURES:**

(7-21-09)

SP10 R43

**Page 10-143, Subarticle 1072-20(D) Qualification of Welds and Procedures**, replace the third sentence of the first paragraph with the following:

For all prequalified field welds, submit Welding Procedure Specifications (WPS) for each joint configuration for approval at least 30 days prior to performing any welding. In lieu of this, use the WPS provided and preapproved by the Department. These preapproved WPS are available from the Materials and Tests Unit or at:

[http://www.ncdot.org/doh/operations/materials/structural/appr\\_proc.html](http://www.ncdot.org/doh/operations/materials/structural/appr_proc.html). Use non-prequalified welds only if approved by the Engineer. Submit WPS for all non-prequalified welds to the Engineer for approval. At no cost to the Department, demonstrate their adequacy in accordance with the requirements of the Bridge Welding Code.

**CHANNELIZING DEVICES (Drums)**

7-20-10

R10 R60

**Revise the 2006 Standard Specifications as follows:**

**Page 10-236, Subarticle 1089-5 (A) Drums (1) General**, replace the paragraph with the following:

## (1) General

Provide drums composed of a body, alternating orange and white 4 band pattern of Type III-High Intensity Microprismatic sheeting and ballasts that have been evaluated by NTPEP.

The following guidelines will be used during the transition from drums with the standard 5 banded engineer's grade sheeting to the new 4 banded configuration.

- (a) All **new** drums purchased **after July 20, 2010** shall have the new sheeting and 4 band configuration.
- (b) Existing 5 band drums with Engineer's Grade sheeting (both new and used devices in existing inventories) will be allowed for use on all on-going construction projects until project completion and will also be allowed for use on other projects until a sunset date has been established.
- (c) Intermixing of "old drums" and "new drums" on the same project is acceptable during the transition.
- (d) 4 band drums with Engineer's Grade sheeting will not be allowed at anytime.

**Page 10-236, Subarticle 1089-5 (A) Drums (3) Retroreflective Stripes, replace the paragraph with the following:**

**(3) Retroreflective Bands**

Provide a minimum of 4 retroreflective bands- 2 orange and 2 white alternating horizontal circumferential bands. The top band shall always be orange. Use a 6" to 8" wide band Type III – High Intensity microprismatic retroreflective sheeting or better that meets the requirement of Section 1093 for each band. Do not exceed 2" for any non-reflective spaces between orange and white stripes. Do not splice the retroreflective sheeting to create the 6-inch band. Apply the retroreflective sheeting directly to the drum surface. Do not apply the retroreflective sheeting over a pre-existing layer of retroreflective sheeting. Do not place bands over any protruding corrugations areas. No damage to the reflective sheeting should result from stacking and unstacking the drums, or vehicle impact.

**Page 10-237, Subarticle 1089-5 (B) Skinny-Drums (1) General, replace the paragraph with the following:**

**(1) General**

All existing skinny-drums that do not have Type III-High Intensity microprismatic sheeting as a minimum will have the same transition requirements as drums as stated above. All new skinny-drums purchased after July 20, 2010 shall have Type III – High Intensity microprismatic sheeting as the minimum. Type IV and higher grade sheeting is acceptable for use on both new and used devices.

Provide skinny-drums composed of a body, reflective bands, and ballasts that have been evaluated by NTPEP.

**Page 10-237, Subarticle 1089-5 (B) Skinny Drums (3) Retroreflective Stripes, replace the paragraph with the following**

**(3) Retroreflective Bands**

Provide a minimum of 4 retroreflective bands- 2 orange and 2 white alternating horizontal circumferential bands for each skinny-drum. The top band shall always be orange. Use a 6" to 8" wide band Type III – High Intensity microprismatic retroreflective sheeting or better that meets the requirement of Section 1093 for each band. Do not exceed 2" for any non-reflective spaces between orange and white stripes. Do not splice the retroreflective sheeting to create the 6-inch band. Apply the retroreflective sheeting directly to the skinny-drum surface. Do not apply the retroreflective sheeting over a pre-existing layer of retroreflective sheeting. Do not place bands over any protruding corrugations areas. No damage to the reflective sheeting should result from stacking and unstacking the skinny-drums, or vehicle impact.

**CHANGEABLE MESSAGE SIGNS**

(11-21-06)

R11 R11

Revise the *2006 Standard Specifications* as follows:

**Page 11-9, Article 1120-3**, Replace the 3rd sentence with the following:

Sign operator will adjust flash rate so that no more than two messages will be displayed and be legible to a driver when approaching the sign at the posted speed.