


**Project Special Provisions
Culverts and Walls**

Table of Contents

	Page
	#
Falsework and Formwork (8-4-09)	1
Submittal of Working Drawings (1-27-10)	6
Crane Safety (8-15-05)	13
Grout for Structures (7-12-07)	13
Adhesively Anchored Anchor Bolts or Dowels (6-11-07)	16
Soil Nail Retaining Walls (9-21-10)	17
MSE Retaining Walls (10-19-10)	33
Anchored Sheet Pile Retaining Walls (SPECIAL)	43

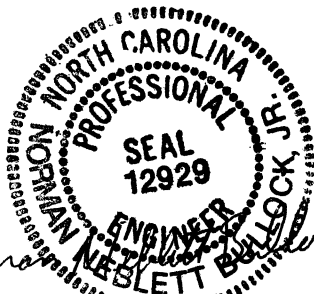

Norman Neslett Bullock, Jr.

 3/3/11

PROJECT SPECIAL PROVISIONS
CULVERTS AND WALLS

PROJECT R-2519A

YANCEY COUNTY

FALSEWORK AND FORMWORK

(8-4-09)

1.0 DESCRIPTION

Use this Special Provision as a guide to develop temporary works submittals required by the Standard Specifications or other provisions; no additional submittals are required herein. Such temporary works include, but are not limited to, falsework and formwork.

Falsework is any temporary construction used to support the permanent structure until it becomes self-supporting. Formwork is the temporary structure or mold used to retain plastic or fluid concrete in its designated shape until it hardens. Access scaffolding is a temporary structure that functions as a work platform that supports construction personnel, materials, and tools, but is not intended to support the structure. Scaffolding systems that are used to temporarily support permanent structures (as opposed to functioning as work platforms) are considered to be falsework under the definitions given. Shoring is a component of falsework such as horizontal, vertical, or inclined support members. Where the term “temporary works” is used, it includes all of the temporary facilities used in bridge construction that do not become part of the permanent structure.

Design and construct safe and adequate temporary works that will support all loads imposed and provide the necessary rigidity to achieve the lines and grades shown on the plans in the final structure.

2.0 MATERIALS

Select materials suitable for temporary works; however, select materials that also ensure the safety and quality required by the design assumptions. The Engineer has authority to reject material on the basis of its condition, inappropriate use, safety, or nonconformance with the plans. Clearly identify allowable loads or stresses for all materials or manufactured devices on the plans. Revise the plan and notify the Engineer if any change to materials or material strengths is required.

3.0 DESIGN REQUIREMENTS

A. Working Drawings

Provide working drawings for items as specified in the contract, or as required by the Engineer, with design calculations and supporting data in sufficient detail to permit a structural and safety review of the proposed design of the temporary work.

When concrete placement is involved, include data such as the drawings of proposed sequence, rate of placement, direction of placement, and location of all construction joints. Submit the number of copies as called for by the contract.

When required, have the drawings and calculations prepared under the guidance of, and sealed by, a North Carolina Registered Professional Engineer who is knowledgeable in temporary works design.

Design falsework and formwork requiring submittals in accordance with the 1995 AASHTO *Guide Design Specifications for Bridge Temporary Works* except as noted herein.

1. Wind Loads

Table 2.2 of Article 2.2.5.1 is modified to include wind velocities up to 110 mph (177 km/hr). In addition, Table 2.2A is included to provide the maximum wind speeds by county in North Carolina.

Table 2.2 - Wind Pressure Values

Height Zone feet (m) above ground	Pressure, lb/ft ² (kPa) for Indicated Wind Velocity, mph (km/hr)				
	70 (112.7)	80 (128.7)	90 (144.8)	100 (160.9)	110 (177.0)
0 to 30 (0 to 9.1)	15 (0.72)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)
30 to 50 (9.1 to 15.2)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)
50 to 100 (15.2 to 30.5)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)
over 100 (30.5)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)	50 (2.39)

2. Time of Removal

The following requirements replace those of Article 3.4.8.2.

Do not remove forms until the concrete has attained strengths required in Article 420-16 of the Standard Specifications and these Special Provisions.

Do not remove forms until the concrete has sufficient strength to prevent damage to the surface.

Table 2.2A - Steady State Maximum Wind Speeds by Counties in North Carolina

COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)
Alamance	70 (112.7)	Franklin	70 (112.7)	Pamlico	100 (160.9)
Alexander	70 (112.7)	Gaston	70 (112.7)	Pasquotank	100 (160.9)
Alleghany	70 (112.7)	Gates	90 (144.8)	Pender	100 (160.9)
Anson	70 (112.7)	Graham	80 (128.7)	Perquimans	100 (160.9)
Ashe	70 (112.7)	Granville	70 (112.7)	Person	70 (112.7)
Avery	70 (112.7)	Greene	80 (128.7)	Pitt	90 (144.8)
Beaufort	100 (160.9)	Guilford	70 (112.7)	Polk	80 (128.7)
Bertie	90 (144.8)	Halifax	80 (128.7)	Randolph	70 (112.7)
Bladen	90 (144.8)	Harnett	70 (112.7)	Richmond	70 (112.7)
Brunswick	100 (160.9)	Haywood	80 (128.7)	Robeson	80 (128.7)
Buncombe	80 (128.7)	Henderson	80 (128.7)	Rockingham	70 (112.7)
Burke	70 (112.7)	Hertford	90 (144.8)	Rowan	70 (112.7)
Cabarrus	70 (112.7)	Hoke	70 (112.7)	Rutherford	70 (112.7)
Caldwell	70 (112.7)	Hyde	110 (177.0)	Sampson	90 (144.8)
Camden	100 (160.9)	Iredell	70 (112.7)	Scotland	70 (112.7)
Carteret	110 (177.0)	Jackson	80 (128.7)	Stanley	70 (112.7)
Caswell	70 (112.7)	Johnston	80 (128.7)	Stokes	70 (112.7)
Catawba	70 (112.7)	Jones	100 (160.9)	Surry	70 (112.7)
Cherokee	80 (128.7)	Lee	70 (112.7)	Swain	80 (128.7)
Chatham	70 (112.7)	Lenoir	90 (144.8)	Transylvania	80 (128.7)
Chowan	90 (144.8)	Lincoln	70 (112.7)	Tyrell	100 (160.9)
Clay	80 (128.7)	Macon	80 (128.7)	Union	70 (112.7)
Cleveland	70 (112.7)	Madison	80 (128.7)	Vance	70 (112.7)
Columbus	90 (144.8)	Martin	90 (144.8)	Wake	70 (112.7)
Craven	100 (160.9)	McDowell	70 (112.7)	Warren	70 (112.7)
Cumberland	80 (128.7)	Mecklenburg	70 (112.7)	Washington	100 (160.9)
Currituck	100 (160.9)	Mitchell	70 (112.7)	Watauga	70 (112.7)
Dare	110 (177.0)	Montgomery	70(112.7)	Wayne	80 (128.7)
Davidson	70 (112.7)	Moore	70 (112.7)	Wilkes	70 (112.7)
Davie	70 (112.7)	Nash	80 (128.7)	Wilson	80 (128.7)
Duplin	90 (144.8)	New Hanover	100 (160.9)	Yadkin	70 (112.7)
Durham	70 (112.7)	Northampton	80 (128.7)	Yancey	70 (112.7)
Edgecombe	80 (128.7)	Onslow	100 (160.9)		
Forsyth	70 (112.7)	Orange	70 (112.7)		

Note on the working drawings any anchorages, connectors, inserts, steel sleeves or other such devices used as part of the falsework or formwork that remains in the permanent structure. If the plan notes indicate that the structure contains the necessary corrosion protection required for a Corrosive Site, epoxy coat, galvanize or metalize these devices. Electroplating will not be allowed. Any coating required by the Engineer will be considered incidental to the various pay items requiring temporary works.

B. Review and Approval

The Engineer is responsible for the review and approval of temporary works' drawings.

Submit the working drawings sufficiently in advance of proposed use to allow for their review, revision (if needed), and approval without delay to the work.

Do not start construction of any temporary work for which working drawings are required until the drawings have been approved. Such approval does not relieve the Contractor of the responsibility for the accuracy and adequacy of the working drawings.

The time period for review of the working drawings does not begin until complete drawings and design calculations, when required, are received by the Engineer.

On the drawings, show all information necessary to allow the design of any component to be checked independently as determined by the Engineer.

If requested by the Engineer, submit with the working drawings manufacturer's catalog data listing the weight of all construction equipment that will be supported on the temporary work. Show anticipated total settlements and/or deflections of falsework and forms on the working drawings. Include falsework footing settlements, joint take-up, and deflection of beams or girders. Falsework hangers that support concentrated loads and are installed at the edge of thin top flange concrete girders (such as bulb tee girders) shall be spaced so as not to exceed 75% of the manufacturer's stated safe working load. Use of dual leg hangers (such as Meadow Burke HF-42 and HF-43) are not allowed. Design the falsework and forms supporting deck slabs and overhangs on girder bridges so that there will be no differential settlement between the girders and the deck forms during placement of deck concrete.

4.0 CONSTRUCTION REQUIREMENTS

All requirements of Section 420 of the Standard Specifications apply.

Construct temporary works in conformance with the approved working drawings. Ensure that the quality of materials and workmanship employed is consistent with that assumed in the design of the temporary works. Do not weld falsework members to any portion of the permanent structure unless approved. Show any welding to the permanent structure on the approved construction drawings.

Provide tell-tales attached to the forms and extending to the ground, or other means, for accurate measurement of falsework settlement. Make sure that the anticipated compressive settlement and/or deflection of falsework does not exceed 1 inch (25 mm). For cast-in-place concrete structures, make sure that the calculated deflection of falsework flexural members does not exceed 1/240 of their span regardless of whether or not the deflection is compensated by camber strips.

A. Maintenance and Inspection

Inspect and maintain the temporary work in an acceptable condition throughout the period of its use. Certify that the manufactured devices have been maintained in a condition to allow them to safely carry their rated loads. Clearly mark each piece so that its capacity can be readily determined at the job site.

Perform an in-depth inspection of an applicable portion(s) of the temporary works, in the presence of the Engineer, not more than 24 hours prior to the beginning of each concrete placement. Inspect other temporary works at least once a month to ensure that they are functioning properly. Have a North Carolina Registered Professional Engineer inspect the cofferdams, shoring, sheathing, support of excavation structures, and support systems for load tests prior to loading.

B. Foundations

Determine the safe bearing capacity of the foundation material on which the supports for temporary works rest. If required by the Engineer, conduct load tests to verify proposed bearing capacity values that are marginal or in other high-risk situations.

The use of the foundation support values shown on the contract plans of the permanent structure is permitted if the foundations are on the same level and on the same soil as those of the permanent structure.

Allow for adequate site drainage or soil protection to prevent soil saturation and washout of the soil supporting the temporary works supports.

If piles are used, the estimation of capacities and later confirmation during construction using standard procedures based on the driving characteristics of the pile is permitted. If preferred, use load tests to confirm the estimated capacities; or, if required by the Engineer conduct load tests to verify bearing capacity values that are marginal or in other high risk situations.

The Engineer reviews and approves the proposed pile and soil bearing capacities.

5.0 REMOVAL

Unless otherwise permitted, remove and keep all temporary works upon completion of the work. Do not disturb or otherwise damage the finished work.

Remove temporary works in conformance with the contract documents. Remove them in such a manner as to permit the structure to uniformly and gradually take the stresses due to its own weight.

6.0 METHOD OF MEASUREMENT

Unless otherwise specified, temporary works will not be directly measured.

7.0 BASIS OF PAYMENT

Payment at the contract unit prices for the various pay items requiring temporary works will be full compensation for the above falsework and formwork.

SUBMITTAL OF WORKING DRAWINGS

(1-27-10)

1.0 GENERAL

Submit working drawings in accordance with Article 105-2 of the *Standard Specifications* and this provision. For this provision, "submittals" refers to only those listed in this provision. The list of submittals contained herein does not represent a list of required submittals for the project. Submittals are only necessary for those items as required by the contract. Make submittals that are not specifically noted in this provision directly to the Resident Engineer. Either the Structure Design Unit or the Geotechnical Engineering Unit or both units will jointly review submittals.

If a submittal contains variations from plan details or specifications or significantly affects project cost, field construction or operations, discuss the submittal with and submit all copies to the Resident Engineer. State the reason for the proposed variation in the submittal. To minimize review time, make sure all submittals are complete when initially submitted. Provide a contact name and information with each submittal. Direct any questions regarding submittal requirements to the Resident Engineer, Structure Design Unit contacts or the Geotechnical Engineering Unit contacts noted below.

In order to facilitate in-plant inspection by NCDOT and approval of working drawings, provide the name, address and telephone number of the facility where fabrication will actually be done if different than shown on the title block of the submitted working drawings. This includes, but is not limited to, precast concrete items, prestressed concrete items and fabricated steel or aluminum items.

2.0 ADDRESSES AND CONTACTS

For submittals to the Structure Design Unit, use the following addresses:

Via US mail:

Mr. G. R. Perfetti, P. E.
State Bridge Design Engineer
North Carolina Department
of Transportation
Structure Design Unit
1581 Mail Service Center
Raleigh, NC 27699-1581

Attention: Mr. P. D. Lambert, P. E.

Via other delivery service:

Mr. G. R. Perfetti, P. E.
State Bridge Design Engineer
North Carolina Department
of Transportation
Structure Design Unit
1000 Birch Ridge Drive
Raleigh, NC 27610

Attention: Mr. P. D. Lambert, P. E.

Submittals may also be made via email.

Send submittals to:

plambert@ncdot.gov (Paul Lambert)

Send an additional e-copy of the submittal to the following address:

jgather@ncdot.gov (James Gaither)

For submittals to the Geotechnical Engineering Unit, use the following addresses:

For projects in Divisions 1-7, use the following Eastern Regional Office address:

Via US mail:

Mr. K. J. Kim, Ph. D., P. E.
Eastern Regional Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Eastern Regional Office
1570 Mail Service Center
Raleigh, NC 27699-1570

Via other delivery service:

Mr. K. J. Kim, Ph. D., P. E.
Eastern Regional Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Eastern Regional Office
3301 Jones Sausage Road, Suite 100
Garner, NC 27529

For projects in Divisions 8-14, use the following Western Regional Office address:

Via US mail:

Mr. John Pilipchuk, L. G., P. E.
Western Regional Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Western Regional Office
5253 Z Max Boulevard
Harrisburg, NC 28075

Via other delivery service:

Mr. John Pilipchuk, L. G., P. E.
Western Region Geotechnical
Manager
North Carolina Department
of Transportation
Geotechnical Engineering Unit
Western Regional Office
5253 Z Max Boulevard
Harrisburg, NC 28075

The status of the review of structure-related submittals sent to the Structure Design Unit can be viewed from the Unit's web site, via the "Contractor Submittal" link.

Direct any questions concerning submittal review status, review comments or drawing markups to the following contacts:

Primary Structures Contact:	Paul Lambert (919) 250 – 4041 (919) 250 – 4082 facsimile plambert@ncdot.gov
Secondary Structures Contacts:	James Gaither (919) 250 – 4042 David Stark (919) 250 – 4044
Eastern Regional Geotechnical Contact (Divisions 1-7):	K. J. Kim (919) 662 – 4710 (919) 662 – 3095 facsimile kkim@ncdot.gov
Western Regional Geotechnical Contact (Divisions 8-14):	John Pilipchuk (704) 455 – 8902 (704) 455 – 8912 facsimile jpilipchuk@ncdot.gov

3.0 SUBMITTAL COPIES

Furnish one complete copy of each submittal, including all attachments, to the Resident Engineer. At the same time, submit the number of hard copies shown below of the same complete submittal directly to the Structure Design Unit and/or the Geotechnical Engineering Unit.

The first table below covers "Structure Submittals". The Resident Engineer will receive review comments and drawing markups for these submittals from the Structure Design Unit. The second table in this section covers "Geotechnical Submittals". The Resident Engineer will receive review comments and drawing markups for these submittals from the Geotechnical Engineering Unit.

Unless otherwise required, submit one set of supporting calculations to either the Structure Design Unit or the Geotechnical Engineering Unit unless both units require submittal copies in which case submit a set of supporting calculations to each unit. Provide additional copies of any submittal as directed by the Engineer.

STRUCTURE SUBMITTALS

Submittal	Copies Required by Structure Design Unit	Copies Required by Geotechnical Engineering Unit	Contract Reference Requiring Submittal ¹
Arch Culvert Falsework	5	0	Plan Note, SN Sheet & "Falsework and Formwork"
Box Culvert Falsework ⁷	5	0	Plan Note, SN Sheet & "Falsework and Formwork"
Cofferdams	6	2	Article 410-4
Evazote Joint Seals ⁶	9	0	"Evazote Joint Seals"
Expansion Joint Seals (hold down plate type with base angle)	9	0	"Expansion Joint Seals"
Expansion Joint Seals (modular)	2, then 9	0	"Modular Expansion Joint Seals"
Expansion Joint Seals (strip seals)	9	0	"Strip Seals"
Falsework & Forms ² (substructure)	8	0	Article 420-3 & "Falsework and Formwork"
Falsework & Forms (superstructure)	8	0	Article 420-3 & "Falsework and Formwork"
Girder Erection over Railroad	5	0	Railroad Provisions
Maintenance and Protection of Traffic Beneath Proposed Structure	8	0	"Maintenance and Protection of Traffic Beneath Proposed Structure at Station ____"
Metal Bridge Railing	8	0	Plan Note
Metal Stay-in-Place Forms	8	0	Article 420-3
Metalwork for Elastomeric Bearings ^{4,5}	7	0	Article 1072-10

R-2519A**246**

Miscellaneous Metalwork ^{4,5}	7	0	Article 1072-10
Optional Disc Bearings ⁴	8	0	“Optional Disc Bearings”
Overhead Signs	13	0	Article 903-3(C) & Applicable Provisions
Pile Splicers	7	2	Subarticle 450-7(C) & “Piles”
Pile Points	7	2	Subarticle 450-7(D) & “Piles”
Placement of Equipment on Structures (cranes, etc.)	7	0	Article 420-20
Pot Bearings ⁴	8	0	“Pot Bearings”
Precast Concrete Box Culverts	2, then 1 reproducible	0	“Optional Precast Reinforced Concrete Box Culvert at Station ____”
Precast Retaining Wall Panels	10	1	Article 1077-2
Prestressed Concrete Cored Slab (detensioning sequences) ³	6	0	Article 1078-11
Prestressed Concrete Deck Panels	6 and 1 reproducible	0	Article 420-3
Prestressed Concrete Girder (strand elongation and detensioning sequences)	6	0	Articles 1078-8 and 1078- 11
Removal of Existing Structure over Railroad	5	0	Railroad Provisions
Revised Bridge Deck Plans (adaptation to prestressed deck panels)	2, then 1 reproducible	0	Article 420-3
Revised Bridge Deck Plans (adaptation to modular expansion joint seals)	2, then 1 reproducible	0	“Modular Expansion Joint Seals”
Sound Barrier Wall Casting Plans	10	0	Article 1077-2 & “Sound Barrier Wall”
Sound Barrier Wall Steel Fabrication Plans ⁵	7	0	Article 1072-10 & “Sound Barrier Wall”
Structural Steel ⁴	2, then 7	0	Article 1072-10

			Article 400-3 & “Construction, Maintenance and Removal of Temporary Structure at Station _____”
Temporary Detour Structures	10	2	
TFE Expansion Bearings ⁴	8	0	Article 1072-10

FOOTNOTES

1. References are provided to help locate the part of the contract where the submittals are required. References in quotes refer to the provision by that name. Articles and subarticles refer to the *Standard Specifications*.
2. Submittals for these items are necessary only when required by a note on plans.
3. Submittals for these items may not be required. A list of pre-approved sequences is available from the producer or the Materials & Tests Unit.
4. The fabricator may submit these items directly to the Structure Design Unit.
5. The two sets of preliminary submittals required by Article 1072-10 of the *Standard Specifications* are not required for these items.
6. Submittals for Fabrication Drawings are not required. Submittals for Catalogue Cuts of Proposed Material are required. See Section 5.A of the referenced provision.
7. Submittals are necessary only when the top slab thickness is 18” or greater.

GEOTECHNICAL SUBMITTALS

Submittal¹	Copies Required by Geotechnical Engineering Unit	Copies Required by Structure Design Unit	Contract Reference Requiring Submittal²
Crosshole Sonic Logging (CSL) Reports	1	0	“Crosshole Sonic Logging”
Drilled Pier Construction Sequence Plans	1	0	“Drilled Piers”
Pile Driving Analyzer (PDA) Reports	2	0	“Pile Driving Analyzer”
Pile Driving Equipment Data ³	1	0	Article 450-5 & “Piles”
Retaining Walls	8	2	Applicable Provisions “Temporary Shoring”, “Anchored Temporary Shoring” & “Temporary Soil Nail Walls”
Contractor Designed Shoring	7	2	

FOOTNOTES

1. With the exception of “Pile Driving Equipment Data”, electronic copies of geotechnical submittals are required. See referenced provision.
2. References are provided to help locate the part of the contract where the submittals are required. References in quotes refer to the provision by that name. Articles refer to the *Standard Specifications*.
3. Download Pile Driving Equipment Data Form from following link:
<http://www.ncdot.org/doh/preconstruct/highway/geotech/formdet/>
Submit one hard copy of the completed form to the Resident Engineer. Submit a second copy of the completed form electronically, by facsimile or via US Mail or other delivery service to the Geotechnical Engineering Unit. Electronic submission is preferred. See second page of form for submittal instructions.

CRANE SAFETY

(8-15-05)

Comply with the manufacturer specifications and limitations applicable to the operation of any and all cranes and derricks. Prime contractors, sub-contractors, and fully operated rental companies shall comply with the current Occupational Safety and Health Administration regulations (OSHA).

Submit all items listed below to the Engineer prior to beginning crane operations involving critical lifts. A critical lift is defined as any lift that exceeds 75 percent of the manufacturer's crane chart capacity for the radius at which the load will be lifted or requires the use of more than one crane. Changes in personnel or equipment must be reported to the Engineer and all applicable items listed below must be updated and submitted prior to continuing with crane operations.

CRANE SAFETY SUBMITTAL LIST

- A. **Competent Person:** Provide the name and qualifications of the "Competent Person" responsible for crane safety and lifting operations. The named competent person will have the responsibility and authority to stop any work activity due to safety concerns.
- B. **Riggers:** Provide the qualifications and experience of the persons responsible for rigging operations. Qualifications and experience should include, but not be limited to, weight calculations, center of gravity determinations, selection and inspection of sling and rigging equipment, and safe rigging practices.
- C. **Crane Inspections:** Inspection records for all cranes shall be current and readily accessible for review upon request.
- D. **Certifications:** By July 1, 2006, crane operators performing critical lifts shall be certified by NC CCO (National Commission for the Certification of Crane Operators), or satisfactorily complete the Carolinas AGC's Professional Crane Operator's Proficiency Program. Other approved nationally accredited programs will be considered upon request. All crane operators shall also have a current CDL medical card. Submit a list of anticipated critical lifts and corresponding crane operator(s). Include current certification for the type of crane operated (small hydraulic, large hydraulic, small lattice, large lattice) and medical evaluations for each operator.

GROUT FOR STRUCTURES

(7-12-07)

1.0 DESCRIPTION

This special provision addresses grout for use in structures, including continuous flight auger (CFA) piles, micropiles, soil nail and anchored retaining walls and backfilling crosshole sonic logging (CSL) tubes or grout pockets, shear keys, dowel holes and recesses for cored slabs and box beams. This provision does not apply to grout placed in post-tensioning ducts for bridge beams, girders, or decks. Provide grout composed of portland

cement, water and at the Contractor's option, fine aggregate and/or pozzolan. If necessary, use set controlling admixtures. Proportion, mix and place grout in accordance with the plans, the applicable section of the *Standard Specifications* or special provision for the application and this provision.

2.0 MATERIALS

Refer to Division 10 of the *Standard Specifications*:

Item	Article
Portland Cement	1024-1
Water	1024-4
Fine Aggregate	1014-1
Fly Ash	1024-5
Ground Granulated Blast Furnace Slag	1024-6
Admixtures	1024-3

At the Contractor's option, use an approved packaged grout in lieu of the materials above with the exception of the water. Contact the Materials and Tests (M&T) Unit for a list of approved packaged grouts. Consult the manufacturer to determine if the packaged grout selected is suitable for the application and meets the compressive strength and shrinkage requirements.

3.0 REQUIREMENTS

Unless required elsewhere in the Contract, provide non-metallic grout with minimum compressive strengths as follows:

Property	Requirement
Compressive Strength @ 3 days	2500 psi (17.2 MPa)
Compressive Strength @ 28 days	4500 psi (31.0 MPa)

For applications other than micropiles, soil nails and ground anchors, use non-shrink grout with shrinkage of less than 0.15%.

When using approved packaged grout, a grout mix design submittal is not required. Submit grout mix designs in terms of saturated surface dry weights on M&T Form 312U in accordance with the applicable section of the *Standard Specifications* or special provision for the structure. Use an approved testing laboratory to determine the grout mix proportions. Adjust proportions to compensate for surface moisture contained in the aggregates at the time of mixing. Changes in the saturated surface dry mix proportions will not be permitted unless a revised grout mix design submittal is accepted.

For each grout mix design, provide laboratory test results for compressive strength, density, flow and if applicable, aggregate gradation and shrinkage. Submit compressive strength for at least 3 cube and 2 cylinder specimens at the age of 3, 7, 14 and 28 days for a total of at least 20 specimens tested. Perform laboratory tests in accordance with the following:

Property	Test Method
Compressive Strength	AASHTO T106 and T22
Density	AASHTO T133
Flow for Sand Cement Grout	ASTM C939 (as modified below)
Flow for Neat Cement Grout (no fine aggregate)	Marsh Funnel and Cup API RP 13B-1, Section 2.2
Aggregate Gradation for Sand Cement Grout	AASHTO T27
Shrinkage for Non-shrink Grout	ASTM C1090

When testing grout for flow in accordance with ASTM C939, modify the flow cone outlet diameter from ½ to ¾ inch (13 to 19 mm).

When grout mix designs are submitted, the Engineer will review the mix designs and notify the Contractor as to their acceptability. Do not use grout mix designs until written acceptance has been received. Acceptance of grout mix designs or use of approved packaged grouts does not relieve the Contractor of responsibility to furnish a product that meets the Contract requirements.

Upon written request from the Contractor, a grout mix design accepted and used satisfactorily on a Department project may be accepted for use on other projects.

4.0 SAMPLING AND PLACEMENT

The Engineer will determine the locations to sample grout and the number and type of samples collected for field and laboratory testing. Use API RP 13B-1 for field testing grout flow and density of neat cement grout. The compressive strength of the grout will be considered the average compressive strength test results of 3 cube or 2 cylinder specimens at 28 days.

Do not place grout if the grout temperature is less than 50°F (10°C) or more than 90°F (32°C) or if the air temperature measured at the location of the grouting operation in the shade away from artificial heat is below 40°F (4°C).

Provide grout at a rate that permits proper handling, placing and finishing in accordance with the manufacturer's recommendations unless directed otherwise by the Engineer. Use grout free of any lumps and undispersed cement. Agitate grout continuously before placement.

Control grout delivery so the interval between placing batches in the same component does not exceed 20 minutes. Place grout before the time between adding the mixing water and placing the grout exceeds that in the table below.

ELAPSED TIME FOR PLACING GROUT (with continuous agitation)		
Air or Grout Temperature Whichever is Higher	Maximum Elapsed Time	
	No Set Retarding Admixture Used	Set Retarding Admixture Used
90°F (32°C) or above	30 min.	1 hr. 15 min.
80°F (27°C) through 89°F (31°C)	45 min.	1 hr. 30 min.
79°F (26°C) or below	60 min.	1 hr. 45 min.

5.0 MISCELLANEOUS

Comply with Articles 1000-9 through 1000-12 of the *Standard Specifications* to the extent applicable for grout in lieu of concrete.

ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS

(6-11-07)

1.0 GENERAL

Installation and Testing of Adhesively anchored anchor bolts and dowels shall be in accordance with Section 420-13, 420-21 and 1081-1 of the *Standard Specifications* except as modified in this provision.

2.0 INSTALLATION

Installation of the adhesive anchors shall be in accordance with manufacturer's recommendations and shall occur when the concrete is above 40 degrees Fahrenheit and has reached its 28 day strength.

The anchors shall be installed before the adhesive's initial set ('gel time').

3.0 FIELD TESTING

Replace the third paragraph of Section 420-13 (C) with the following:

"In the presence of the Engineer, field test the anchor bolt or dowel in accordance with the test level shown on the plans and the following:

Level One Field testing: Test a minimum of 1 anchor but not less than 10% of all anchors to 50% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the

remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Level Two Field testing: Test a minimum of 2 anchors but not less than 10% of the all anchors to 80% of the yield load shown on the plans. If less than 60 anchors are to be installed, install and test the required number of anchors prior to installing the remaining anchors. If more than 60 anchors are to be installed, test the first 6 anchors prior to installing the remaining anchors, then test 10% of the number in excess of 60 anchors.

Testing should begin only after the Manufacturer's recommended cure time has been reached. For testing, apply and hold the test load for three minutes. If the jack experiences any drop in gage reading, the test must be restarted. For the anchor to be deemed satisfactory, the test load must be held for three minutes with no movement or drop in gage reading."

4.0 REMOVAL AND REPLACEMENT OF FAILED TEST SPECIMENS:

Remove all anchors and dowels that fail the field test without damage to the surrounding concrete. Redrill holes to remove adhesive bonding material residue and clean the hole in accordance with specifications. For reinstalling replacement anchors or dowels, follow the same procedures as new installations. Do not reuse failed anchors or dowels unless approved by the Engineer.

5.0 USAGE

The use of adhesive anchors for overhead installments is not permitted without written permission from the Engineer.

6.0 BASIS OF PAYMENT

No separate measurement or payment will be made for furnishing, installing, and testing anchor bolts/dowels. Payment at the contract unit prices for the various pay items will be full compensation for all materials, equipment, tools, labor, and incidentals necessary to complete the work.

SOIL NAIL RETAINING WALLS

(9-21-10)

1.0 GENERAL

A soil nail is defined as a steel bar grouted in a drilled hole inclined at an angle below horizontal. A soil nail retaining wall consists of soil nails spaced at a regular pattern and connected to a cast-in-place reinforced concrete face with nail heads embedded in the concrete. Shotcrete is used for temporary support of the excavation during construction. Design and construct soil nail retaining walls based on actual elevations and dimensions in

accordance with the contract and accepted submittals. For this provision, “soil nail wall” refers to a soil nail retaining wall and “Soil Nail Wall Contractor” refers to the contractor installing soil nails and applying shotcrete. Also, “concrete facing” refers to a cast-in-place reinforced concrete face.

2.0 SUBMITTALS

Three submittals are required. These submittals include (1) Soil Nail Wall Contractor personnel and experience, (2) soil nail wall design and (3) soil nail wall construction plan. Provide 11 hard copies of working drawings and 3 hard copies of design calculations for the soil nail wall design submittal and 4 hard copies of the remaining submittals. Also, submit an electronic copy (PDF on CD or DVD) of each submittal. Allow 10 calendar days for the review of the Soil Nail Wall Contractor personnel and experience submittal. After the personnel and experience submittal is accepted, submit the remaining submittals at least 30 calendar days before starting soil nail wall construction. Do not begin soil nail wall construction including preconstruction test panels or sacrificial soil nails for verification tests until the construction plan is accepted.

A. Soil Nail Wall Contractor Personnel and Experience Submittal

Use a Soil Nail Wall Contractor prequalified by the NCDOT Contractual Services Unit for anchored retaining walls work (work code 3020). Submit documentation that the Soil Nail Wall Contractor has successfully completed at least 5 soil nail wall projects and 500 soil nails within the last 3 years with wall heights similar to those for this project and an exposed face area for all 5 walls of at least 10,000 ft² (930 m²). Documentation should include the General Contractor and Owner’s name and current contact information with descriptions of each past project.

Provide verification of employment with the Soil Nail Wall Contractor for the Superintendent, Project Manager and Nozzlemen assigned to this project. Submit documentation that the Superintendent and Project Manager each have a minimum of 5 years experience in soil nail wall construction with past projects of scope and complexity similar to that anticipated for this project. Documentation should include resumes, references, certifications, project lists, experience descriptions and details, etc. Submit documentation that each Nozzelman is certified as an ACI Shotcrete Nozzelman by the American Concrete Institute (ACI) in accordance with ACI Certification Publication CP-60. Nozzlemen should be certified in either dry or wet mix vertical based on how the shotcrete will be applied for this project. Perform work with the personnel submitted and accepted. If personnel changes are required during construction, suspend soil nail wall construction until replacement personnel are submitted and accepted.

B. Soil Nail Wall Design Submittal

A Design Engineer is required to design soil nail walls. Use a Design Engineer approved as a Geotechnical Engineer (key person) for a consultant prequalified by the NCDOT Contractual Services Unit for the anchored retaining wall design discipline.

The Design Engineer may also act as the Project Manager provided the Design Engineer meets the Project Manager requirements above.

The Retaining Wall Plans show a plan view, typical sections, details, notes and an elevation or profile view (wall envelope) for each soil nail wall. Before beginning soil nail wall design, survey existing ground elevations shown on the plans and other elevations in the vicinity of soil nail walls as needed. Based on these elevations, finished grades and actual soil nail wall dimensions and details, submit revised wall envelopes for review and acceptance. Use the accepted revised wall envelopes for design.

Design soil nail walls in accordance with the plans and the allowable stress design method in the *FHWA Geotechnical Engineering Circular No. 7 "Soil Nail Walls"* (Publication No. FHWA-IF-03-017) unless otherwise required. When a note on plans requires a live load (traffic) surcharge, use a surcharge load of 250 psf (12 kPa). For steel beam guardrail with 8' (2.4 m) posts above soil nail walls, design walls for an additional horizontal load of 300 lbs/linear ft (4.38 kN/linear m) of wall. For concrete barrier rails with moment slabs above soil nail walls, design walls for an additional horizontal load of 500 lbs/linear ft (7.30 kN/linear m) of wall. Apply additional loads to the back of soil nail walls at a depth of 2 ft (0.6m) below grade elevation.

Do not extend soil nails beyond right-of-way or easement lines. If existing or future obstructions such as foundations, guardrail, fence or handrail posts, pavements, pipes, inlets or utilities will interfere with soil nails, maintain a minimum clearance of 6" (150 mm) between the obstruction and the nails. Use soil nails meeting the following requirements unless otherwise approved.

- Minimum vertical and horizontal spacing of 3 ft (1 m)
- Minimum inclination of 12 degrees below horizontal
- Clearance between the end of the bar and the hole of 6" (150 mm)
- Diameter ranging from 6 to 10 inches (150 to 250 mm)

Four inch (100 mm) diameter soil nails may be approved for drill holes in rock at the discretion of the Engineer.

Geocomposite drain strips are required between the shotcrete and excavation face. Space drain strips to miss nail heads and on 10 ft (3 m) centers, maximum. Connect drain strips to leveling pads. Extend continuous drains along base of concrete facing in front of leveling pads. Provide drains meeting the requirements of an aggregate shoulder drain in accordance with Roadway Standard Drawing No. 816.02.

For temporary facing, use a minimum shotcrete thickness of 4" (100 mm) and reinforce shotcrete with #4 (#13) whaler bars around each nail head. Two reinforcing bars (one on each side of the nail head) in both the vertical and horizontal directions for a total of 4 whaler bars per soil nail are required.

For permanent facing, use a minimum cast-in-place reinforced concrete thickness of 8" (200 mm). Extend concrete facing a minimum of 6" (150 mm) above where finished grade intersects the back of soil nail walls unless required otherwise on the plans.

When barriers are required above soil nail walls, use concrete barrier rails with moment slabs as shown on the plans.

Use 6 inch (150 mm) thick aggregate leveling pads beneath concrete facing. Unless required otherwise on the plans, embed top of leveling pads a minimum of 1 ft (0.3 m) below where finished grade intersects the front face of soil nail walls.

Submit working drawings and design calculations including unit grout/ground bond strengths for review and acceptance in accordance with Article 105-2 of the *Standard Specifications*. Submit working drawings showing plan views, wall profiles with soil nail locations including known test nail locations, typical sections and soil nail, drainage, shotcrete, leveling pad, concrete facing and reinforcing details. If necessary, include details on working drawings for concrete barrier rails with moment slabs and obstructions extending through walls or interfering with soil nails, concrete barrier rails and moment slabs. Submit design calculations for each wall section with different surcharge loads, geometry or material parameters. A minimum of one analysis is required for each wall section with different soil nail lengths. When using a software program for design, provide a hand calculation verifying the analysis of the section with the longest soil nails. Have soil nail walls designed, detailed and sealed by the Design Engineer.

C. Soil Nail Wall Construction Plan Submittal

Submit detailed project specific information including the following.

1. Excavation methods and equipment.
2. List and sizes of proposed drilling rigs and tools, tremies and grouting equipment.
3. Sequence and step-by-step description of soil nail wall construction including details of excavations, drilling and grouting methods, soil nail and wall drainage system installation and facing construction.
4. Shotcrete equipment and placement details including mix process, test panels, thickness measuring gauges and application methods.
5. Soil nail testing details, procedures and plan sealed by a Professional Engineer registered in North Carolina with calibration certificates dated within 90 calendar days of the submittal date.
6. Examples of construction and test nail records to be provided in accordance with Sections 6.0 and 7.0, Item F, respectively.
7. Grout mix design including laboratory test results in accordance with the *Grout for Structures* provision and acceptable ranges for grout flow and density.

8. Shotcrete mix design in accordance with the *Shotcrete* provision.
9. Other information shown on the plans or requested by the Engineer.

If alternate installation and testing procedures are proposed or necessary, a revised construction plan submittal may be required. If the work deviates from the accepted submittal without prior approval, the Engineer may suspend soil nail wall construction until a revised plan is submitted and accepted.

3.0 MATERIALS

Provide Type 3 Manufacturer's Certifications in accordance with Article 106-3 of the *Standard Specifications* for soil nail and wall drainage materials. Store steel materials on blocking a minimum of 12" (300 mm) above the ground and protect it at all times from damage; and when placing in the work make sure it is free from dirt, dust, loose mill scale, loose rust, paint, oil or other foreign materials. Load, transport, unload and store soil nail wall materials such that they are kept clean and free of damage. Do not crack, fracture or otherwise damage grout inside sheathing of shop grouted encapsulated soil nails. Damaged or deformed materials will be rejected.

A. Soil Nails

A soil nail consists of a grouted steel bar with corrosion protection and a nail head assembly. Use epoxy coated or encapsulated deformed steel bars meeting the requirements of AASHTO M275 or M31, Grade 60 or 75 (420 or 520). Splice bars in accordance with Article 1070-10 of the *Standard Specifications*.

For epoxy coated bars, provide epoxy coated reinforcing steel meeting the requirements of Article 1070-8 of the *Standard Specifications*.

For encapsulated bars, use unperforated corrugated high-density polyethylene (HDPE) sheathing a minimum of 0.04" (1 mm) thick meeting the requirements of AASHTO M252. Provide at least 0.4" (10 mm) of grout cover between the bar and sheathing and at least 0.8" (20 mm) of grout cover between the sheathing and drill hole wall.

Fabricate centralizers from schedule 40 polyvinyl chloride (PVC) plastic pipe or tube, steel or other material not detrimental to steel bars (no wood). Size centralizers to position the bar within 1 inch (25 mm) of the drill hole center and allow a tremie to be inserted to the bottom of the hole. Use centralizers that do not interfere with grout placement or flow around bars. For encapsulated bars, centralizers are required both inside and outside of encapsulation.

Use grout in accordance with the contract.

Nail head assemblies consist of steel bearing plates, washers, nuts and shear studs. Provide steel bearing plates meeting the requirements of ASTM A36 and washers and

hex nuts in accordance with the bar manufacturer’s recommendations. Provide welded stud shear connectors in accordance with Article 1072-8 of the *Standard Specifications*.

B. Wall Drainage Systems

Wall drainage systems consist of drain strips, drains and outlet components. Furnish certifications with minimum average roll values (MARV) as defined by ASTM D4439 for core compressive strength and flow rate properties of drain strips. For testing drain strips, a lot is defined as a single day’s production. Identify, store and handle drain strips in accordance with ASTM D4873. Drain strips with defects, flaws, deterioration or damage will be rejected. Do not leave drain strips uncovered for more than 7 days.

Use at least 12 inch (300 mm) wide prefabricated geocomposite drain strips consisting of a non-woven polypropylene geotextile bonded to one side of an HDPE or polystyrene drainage core, e.g., sheet drain. Provide drain strips with cores meeting the following requirements.

Core Property	ASTM Test Method	Requirement (MARV ¹)
(a) Thickness	D5199	¼ - ½ inch (6 – 13 mm)
Compressive Strength	(b) D1621	40 psi (276 kPa)
Flow Rate (with a gradient of 1.0)	(c) D4716	5 gpm (1 l/s) ²
¹ MARV does not apply to thickness		
² per ft (m) of width tested		

Use drain and outlet materials meeting the requirements of subsurface drainage materials in accordance with Section 1044 of the *Standard Specifications*.

C. Shotcrete

Use shotcrete in accordance with the contract.

D. Reinforcing Steel

Use deformed steel bar and welded wire reinforcement meeting the requirements of reinforcing steel in accordance with Section 1070 of the *Standard Specifications*.

E. Leveling Pads

Use Class VI Select Material in accordance with Section 1016 of the *Standard Specifications* for aggregate leveling pads.

F. Concrete Facing

Provide concrete facing meeting the requirements of Section 1000 of the *Standard Specifications*. Use Class A Concrete in accordance with Article 1000-4 of the *Standard Specifications* and curing agents for concrete in accordance with Section 1026 of the *Standard Specifications*.

G. Masonry

Use masonry for brick veneers in accordance with Section 1040 of the *Standard Specifications*.

H. Joint Materials

Use joint materials in accordance with Section 1028 of the *Standard Specifications*.

4.0 PRECONSTRUCTION MEETING

Before starting soil nail wall construction, conduct a preconstruction meeting to discuss the construction, inspection and testing of the soil nail walls. Schedule this meeting after all soil nail wall submittals have been accepted. The Resident or Bridge Maintenance Engineer, Bridge Construction Engineer, Geotechnical Operations Engineer, Contractor and Soil Nail Wall Contractor Superintendent and Project Manager will attend this preconstruction meeting.

5.0 CONSTRUCTION METHODS

Control drainage during construction in the vicinity of soil nail walls. Direct run off away from soil nail walls and areas above and behind walls.

Perform necessary clearing and grubbing in accordance with Section 200 of the *Standard Specifications*. Notify the Engineer before blasting in the vicinity of soil nail walls. Perform blasting in accordance with the contract. Install foundations located behind soil nail walls and within a horizontal distance equal to the longest soil nail length before beginning soil nail wall construction.

Do not excavate behind soil nail walls. If overexcavation occurs, repair walls at no additional cost to the Department with a method proposed by the Contractor and accepted by the Engineer. A revised soil nail wall construction plan may be required.

Perform any welding in accordance with the contract. At the Contractor's option, welding may be performed in the field in lieu of employing an American Institute of Steel Construction (AISC) certified fabricator in accordance with Subarticle 1072-1(A) of the *Standard Specifications*. For field welding, use welders certified as a bridge welder in accordance with the NCDOT Field Welder Certification Program.

Use equipment and methods reviewed and accepted in the construction plan or approved by the Engineer. Inform the Engineer of any deviations from the accepted plan.

A. Excavation

Construct soil nail walls from the top down by removing material in front of walls and providing an excavation face to receive shotcrete meeting the following tolerances.

- Within 2" (50 mm) of the location shown on the plans
- Within 2% of vertical
- No negative batter (excavation face leaning forward)

Excavate in accordance with the accepted submittals and in staged horizontal lifts with heights not to exceed the vertical soil nail spacing. Do not excavate more than 3 ft (1 m) below where soil nails will be installed. Remove any cobbles, boulders, rubble or debris that will protrude more than 2" (50 mm) into the required shotcrete thickness. Rocky ground such as colluvium, boulder fills and weathered rock may be difficult to excavate without leaving voids.

Apply shotcrete to the excavation face within 24 hours of excavating the lift unless approved otherwise by the Engineer. The application of shotcrete may be delayed if it can be demonstrated that the delay will not adversely affect the excavation face stability. If the excavation face will be exposed for more than 24 hours, use polyethylene sheets anchored at the top and bottom of the lift to protect the face from changes in moisture content.

If the excavation face becomes unstable at any time, suspend soil nail wall construction and temporarily stabilize the face by immediately placing an earth berm against the unstable face. Soil nail wall construction may not proceed until remedial measures are proposed by the Contractor and accepted by the Engineer. A revised soil nail wall construction plan submittal may be required.

Do not excavate the next lift until the soil nail installations, shotcrete application, nail head assemblies and soil nail testing for the preceding lift are complete and the soil nails for the preceding lift are accepted by the Engineer. Also, do not excavate the next lift until the grout and shotcrete for the preceding lift have cured at least 3 days and 1 day, respectively.

B. Soil Nail Installation

Install soil nails in the same way as acceptable verification test nails. Drill and grout soil nails the same day and do not leave drill holes open overnight.

Control drilling and grouting to prevent excessive ground movements, damaging structures and pavements and fracturing rock and soil formations. If ground heave or subsidence occurs, suspend soil nail wall construction and take action to minimize movement. If structures or pavements are damaged, suspend wall construction and repair structures and pavements at no additional cost to the Department with a method

proposed by the Contractor and accepted by the Engineer. The Engineer may require a revised soil nail wall construction plan when corrective action is necessary.

1. Drilling

Use drilling rigs capable of drilling through whatever materials are encountered to the dimensions and orientations required for the soil nail wall design. Drill straight and clean holes at locations shown in the accepted submittals. Drill hole locations and inclinations are required to be within 6" (150 mm) and 2 degrees, respectively, of that shown in the accepted submittals unless approved otherwise by the Engineer.

Stabilize drill holes with temporary casings if unstable, caving or sloughing material is anticipated or encountered. Do not use drilling fluids to stabilize drill holes or remove cuttings.

2. Soil Nail Bars

Use centralizers to center steel bars in drill holes. Securely attach centralizers at maximum 8 ft (2.4 m) intervals along bars. Attach uppermost and lowermost centralizers 18" (450 mm) from the top and bottom of drill holes.

Before placing soil nail bars, allow the Engineer to check location, orientation and cleanliness of drill holes. Provide steel bars as shown in the accepted submittals and insert bars without difficulty or forcing insertion. Do not vibrate or drive soil nail bars. If a bar can not be completely inserted easily, remove the bar and clean or redrill the hole.

3. Grouting

Remove oil, rust inhibitors, residual drilling fluids and similar foreign materials from holding tanks/hoppers, stirring devices, pumps, lines, tremie pipes and all other equipment in contact with grout before use.

Place grout with a tremie in accordance with the contract and accepted submittals. Inject grout at the lowest point of drill holes through a tremie pipe, e.g., grout tube, casing, hollow-stem auger or drill rod, in one continuous operation. Fill drill holes progressively from the bottom to top and withdraw tremie at a slow even rate as the hole is filled to prevent voids in the grout. Extend tremie pipe into grout a minimum of 5 ft (1.5 m) at all times except when grout is initially placed in a drill hole.

Provide grout free of segregation, intrusions, contamination, structural damage or inadequate consolidation (honeycombing). Cold joints in grout are not allowed except for soil nails that are tested. Extract temporary casings as grout is placed. Monitor and record grout volumes during placement.

4. Nail Heads

After shotcreting, attach nail head assemblies as shown in the accepted submittals. Before shotcrete reaches initial set, seat plates and tighten nuts so plates contact shotcrete uniformly. If uniform contact is not possible, install nail head assemblies on a mortar pad to provide even bearing against shotcrete.

C. Wall Drainage Systems

Install wall drainage systems as shown in the accepted submittals. Before shotcreting, place and secure geocomposite drain strips with the geotextile side against the excavation face. For highly irregular excavation faces, the Engineer may allow placing drain strips after shotcreting with weep holes through the shotcrete. Ensure that drain strips continuously contact the excavation face and allow for full flow the entire height of the wall. Discontinuous drain strips are not allowed. If splices are needed, overlap drain strips a minimum of 12" (300 mm) such that flow is not impeded. Connect drain strips to leveling pads by embedding strip ends at least 4" (100 mm) into the no. 57 stone.

Construct drains in accordance with Section 816 of the *Standard Specifications*. Provide drains with positive drainage toward outlets.

D. Shotcreting

Perform shotcreting in accordance with the contract and accepted submittals. Use nozzlemen who were accepted in the Soil Nail Wall Contractor personnel and experience submittal and made satisfactory preconstruction test panels.

Clean the excavation face and ungrouted zones of drill holes near the face of loose materials, mud, rebound and other foreign material. Moisten surfaces to receive shotcrete. Secure reinforcement to prevent movement and vibration while shotcreting.

Direct shotcrete at right angles to the excavation face except when placing shotcrete around reinforcing bars. Rotate nozzle steadily in a small circular pattern. Apply shotcrete from the bottom up. Make shotcrete surface uniform and free of sloughing or sagging.

Completely fill ungrouted zones of drill holes near the excavation face and any other voids with shotcrete. Consider subsurface conditions and resulting potential for voids when estimating shotcrete quantities. No additional payment will be made for unanticipated shotcrete quantities.

Taper construction joints to a thin edge over a minimum distance equal to the shotcrete thickness. Wet the joint surface before applying shotcrete on adjacent sections.

Repair surface defects as soon as possible after placement. Remove any shotcrete which lacks uniformity, exhibits segregation, honeycombing or lamination or contains

any voids or sand pockets and replace with fresh shotcrete to the satisfaction of the Engineer.

E. Leveling Pads and Concrete Facing

Construct leveling pads and drains at elevations and with dimensions shown in the accepted submittals. Construct drains in accordance with Section 816 of the *Standard Specifications*. Compact no. 57 stone for aggregate leveling pads with a vibratory compactor to the satisfaction of the Engineer.

Construct cast-in-place reinforced concrete facing in accordance with the accepted submittals and Section 420 of the *Standard Specifications*. Do not remove forms until concrete achieves a minimum compressive strength of 2400 psi (16.5 MPa). Unless required otherwise on the plans, provide a Class 2 Surface Finish for concrete facing in accordance with Article 420-17 of the *Standard Specifications*.

Construct concrete facing joints at a maximum spacing of 30 ft (9 m) unless required otherwise on the plans. Half-inch (13 mm) thick expansion joints in accordance with Article 420-10 of the *Standard Specifications* are required every third joint. Half-inch (13 mm) deep grooved contraction joints in accordance with Subarticle 825-10(B) of the *Standard Specifications* are required for the remaining joints. Stop reinforcement 2" (50 mm) from either side of expansion joints.

If a brick veneer is required as shown on the plans, construct brick masonry in accordance with Section 830 of the *Standard Specifications*. Anchor brick veneers to concrete facing with approved brick to concrete type anchors according to the manufacturer's specifications with a minimum vertical spacing of 16" (400 mm) and a minimum horizontal spacing of 32" (800 mm) with each row staggered 16" (400 mm) from the row of anchors above and below.

Seal joints above and behind soil nail walls between concrete facing and ditches with joint sealer.

6.0 CONSTRUCTION RECORDS

Provide 2 original hard copies of soil nail wall construction records including the following within 24 hours of completing each lift.

1. Names of Soil Nail Wall Contractor, Superintendent, Nozzleman, Drill Rig Operator, Project Manager and Design Engineer
2. Wall description, county, NCDOT contract, TIP and WBS element number
3. Wall station and number and lift location, dimensions, elevations and description
4. Soil nail locations, diameters, lengths and inclinations, bar types, sizes and grades, corrosion protection and temporary casing information

5. Date and time drilling begins and ends, soil nail bars are placed, grout and shotcrete are mixed and/or arrives on-site and grout placement and shotcrete application begins and ends
6. Grout volume, temperature, flow and density records
7. Ground and surface water conditions and elevations, if applicable
8. Weather conditions including air temperature at time of grout placement and shotcrete application
9. All other pertinent details related to soil nail wall construction

After completing each soil nail wall or stage of a soil nail wall, submit electronic copies (PDF on CD or DVD) of all corresponding construction records.

7.0 TESTING

Verification and proof tests are required as shown on the plans. For this provision, “verification tests” are performed on test nails not incorporated into the wall, i.e., sacrificial soil nails and “proof tests” are performed on test nails incorporated into the wall, i.e., production soil nails assuming test nails are acceptable in accordance with this provision. “Verification test nails” refer to soil nails on which verification tests are performed and “proof test nails” refer to soil nails on which proof tests are performed.

In general, 1 verification test for each soil type with a minimum of 2 tests per soil nail wall and proof tests on 5 percent of production soil nails with a minimum of 1 test per nail row are required. More or less soil nail testing may be required depending on the subsurface conditions encountered. The Engineer will decide the actual number and locations of verification and proof tests. The approximate locations of known verification test nails are shown on the plans.

Do not test soil nails until grout and shotcrete achieve the required 3 day compressive strength. Do not begin construction of any production soil nails until verification tests are satisfactorily completed.

A. Testing Equipment

Use testing equipment that includes the following.

- 2 dial gauges with rigid supports
- hydraulic jack and pressure gauge
- jacking block or reaction frame
- electrical resistance load cell (verification tests only)

Use dial gauges capable of measuring to 0.001” (0.025 mm) and accommodating the maximum anticipated movement. Provide pressure gauges graduated in 100 psi (690 kPa) increments or less. Submit identification number and calibration records for

each load cell, jack and pressure gauge with the soil nail wall construction plan. Calibrate the jack and pressure gauge as a unit.

Align testing equipment to ensure uniform loading. Use a jacking block or reaction frame that does not damage the shotcrete or contact the shotcrete face within 3 ft (1 m) of test nails. Align dial gauges within 5 degrees of the test nail axis. Place dial gauges opposite each other on either side of the test nail. Set up testing equipment and measuring devices such that resetting or repositioning the components before completing testing is not required.

B. Test Nails

Test nails have both unbonded and bond lengths. Grout only the bond lengths before testing. Minimum required unbonded and bond lengths are 3 ft (1 m) and 10 ft (3 m), respectively.

Soil nail bars for production soil nails may be overstressed under higher test nail loads. Use larger or higher grade steel bars to allow for higher loads instead of shortening bond lengths to less than the minimum. Any costs associated with higher capacity bars will be considered incidental to the soil nail testing pay items.

C. Verification Tests

Install sacrificial soil nails in accordance with the accepted submittals and this provision. Use the same equipment, methods and drill hole diameter for sacrificial soil nails as will be used for production soil nails.

Use the following equation to determine maximum bond lengths, L_{BVT} (ft or m), for verification test nails.

$$L_{BVT} \leq \frac{C_{RT} \times A_t \times f_y}{Q_{ALL} \times 3},$$

where,

C_{RT} = reduction coefficient, 0.9 for Grade 60 and 75 (420 and 520) bars or 0.8 for Grade 150 (1035) bars,

A_t = bar area (in² or m²),

f_y = bar yield stress (ksi or kPa) and

Q_{ALL} = allowable unit grout/ground bond strength (kips/ft or kN/m).

Use the following equation to determine design test loads, DTL_{VT} (kips or kN), for verification test nails.

$$DTL_{VT} = L_{BVT} \times Q_{ALL}$$

Calculate DTL_{VT} based on as-built bond lengths. Perform verification tests by incrementally loading test nails to failure or a maximum test load of 300 percent of DTL_{VT} according to the following schedule.

Load	Hold Time
AL*	1 minute
0.25 DTL_{VT}	10 minutes
0.50 DTL_{VT}	10 minutes
0.75 DTL_{VT}	10 minutes
1.00 DTL_{VT}	10 minutes
1.25 DTL_{VT}	10 minutes
1.50 DTL_{VT}	60 minutes (creep test)
1.75 DTL_{VT}	10 minutes
2.00 DTL_{VT}	10 minutes
2.50 DTL_{VT}	10 minutes
3.00 DTL_{VT}	10 minutes
AL*	1 minute

*Alignment load (AL) is the minimum load required to align testing equipment and should not exceed 0.05 DTL_{VT} .

Reset dial gauges to zero after applying alignment load. Record test nail movement at each load increment and permanent set after load is reduced to alignment load.

Monitor test nails for creep at the 1.50 DTL_{VT} load increment. Measure and record test nail movement during the creep portion of the test at 1, 2, 3, 5, 6, 10, 20, 30, 50 and 60 minutes. Repump jack as needed to maintain the intended load during hold times.

D. Proof Tests

Use the following equation to determine maximum bond lengths, L_{BPT} (ft or m), for proof test nails.

$$L_{BPT} \leq \frac{C_{RT} \times A_t \times f_y}{Q_{ALL} \times 1.5},$$

where variables are as defined in Item C above.

Use the following equation to determine design test loads, DTL_{PT} (kips or kN), for proof test nails.

$$DTL_{PT} = L_{BPT} \times Q_{ALL}$$

Calculate DTL_{PT} based on as-built bond lengths. Perform proof tests by incrementally loading test nails to failure or a maximum test load of 150 percent of DTL_{PT} according to the following schedule.

Load	Hold Time
AL*	Until movement stabilizes
0.25 DTL_{PT}	Until movement stabilizes
0.50 DTL_{PT}	Until movement stabilizes
0.75 DTL_{PT}	Until movement stabilizes
1.00 DTL_{PT}	Until movement stabilizes
1.25 DTL_{PT}	Until movement stabilizes
1.50 DTL_{PT}	10 or 60 minutes (creep test)
AL*	1 minute

*Alignment load (AL) is the minimum load required to align testing equipment and should not exceed 0.05 DTL_{PT} .

Reset dial gauges to zero after applying alignment load. Record test nail movement at each load increment and monitor test nails for creep at the 1.50 DTL_{PT} load increment. Measure and record test nail movement at 1, 2, 3, 5, 6 and 10 minutes. When the test nail movement between 1 minute and 10 minutes exceeds 0.04" (1 mm), maintain the maximum test load for an additional 50 minutes and record movements at 20, 30, 50 and 60 minutes. Repump jack as needed to maintain the intended load during hold times.

E. Test Nail Acceptance

Test nail acceptance is based on the following criteria.

1. For verification tests, total creep movement is less than 0.08" (2 mm) between the 6 and 60 minute readings and creep rate is linear or decreasing throughout the creep test load hold time.
2. For proof tests, total creep movement is less than 0.04" (1 mm) between the 1 and 10 minute readings or less than 0.08" (2 mm) between the 6 and 60 minute readings and creep rate is linear or decreasing throughout the creep test load hold time.
3. Total test nail movement at maximum test load exceeds 80 percent of the theoretical elastic elongation of the test nail unbonded length.
4. Pullout failure does not occur at or before the 2.0 DTL_{VT} or 1.5 DTL_{PT} load increment. Pullout failure is defined as the inability to increase the load while test nail movement continues. Record the pullout failure load as part of the test data.

Maintain stability of test nail unbonded lengths for subsequent grouting. If the test nail unbonded length of a proof test nail can not be satisfactorily grouted after testing, do

not incorporate the test nail into the wall and replace the nail with another production soil nail at no additional cost to the Department.

F. Test Nail Results

Submit 2 original hard copies of test nail records including movement versus load plots for each load increment within 24 hours of completing each test. The Engineer will review the test records and associated construction records to determine if the test nail is acceptable.

If the Engineer determines a verification test nail is unacceptable, revise the soil nail wall design and/or installation methods. Submit a revised soil nail wall design and/or construction plan for review and acceptance and provide an acceptable verification test nail with the revised design and/or installation methods at no additional cost to the Department.

If the Engineer determines a proof test nail is unacceptable, either perform additional proof tests on adjacent production soil nails or revise the soil nail wall design for the production soil nails represented by the unacceptable proof test nail as determined by the Engineer. Submit a revised soil nail wall design and/or construction plan for review and acceptance and provide an acceptable proof test nail with the revised design and/or installation methods at no additional cost to the Department. If required, remove representative production soil nails and/or provide new production soil nails with the revised design and/or installation methods at no additional cost to the Department.

After completing soil nail testing for each wall or wall stage, submit electronic copies (PDF on CD or DVD) of all corresponding test records.

8.0 MEASUREMENT AND PAYMENT

Soil Nail Retaining Walls will be measured and paid for in square feet (meters). Soil nail walls will be measured as the exposed face area with the wall height equal to the difference between the top and bottom of wall elevation. The top of wall elevation is defined as the top of concrete facing. The bottom of wall elevation is as shown on the plans and no payment will be made for portions of soil nail walls below bottom of wall elevations.

The contract unit price for *Soil Nail Retaining Walls* will be full compensation for providing design, submittals, labor, tools, equipment and soil nail wall materials, excavating, installing soil nails and wall drainage systems, grouting, shotcreting including test panels, welding and providing reinforcement, leveling pads, concrete facing and any incidentals necessary to design and construct soil nail walls in accordance with this provision. If necessary, the contract unit price for *Soil Nail Retaining Walls* will also be full compensation for providing brick veneers in accordance with the contract.

The contract unit price for *Soil Nail Retaining Walls* does not include the cost for fences, handrails, ditches, guardrail and barriers associated with soil nail walls as payment for these items will be made elsewhere in the contract.

Soil Nail Verification Tests and *Soil Nail Proof Tests* will be measured and paid for in units of each, depending on the type of test. Soil nail tests will be measured as the number of initial verification or proof tests required by the Engineer or as shown on the plans. No payment will be made for subsequent tests performed on the same test nails or replacement nails. The contract unit prices for *Soil Nail Verification Tests* and *Soil Nail Proof Tests* will be full compensation for soil nail testing in accordance with Section 7.0 of this provision.

Payment will be made under:

Pay Item	Pay Unit
Soil Nail Retaining Walls	Square Foot (Meter)
Soil Nail Verification Tests	Each
Soil Nail Proof Tests	Each

MECHANICALLY STABILIZED EARTH RETAINING WALLS (10-19-10)

1.0 GENERAL

A. Description

A mechanically stabilized earth (MSE) retaining wall consists of steel or geogrid reinforcements in the reinforced zone connected to vertical facing elements. The facing elements may be precast concrete panels or segmental retaining wall (SRW) units unless required otherwise on the plans or the *NCDOT Policy for Mechanically Stabilized Earth Retaining Walls* prohibits the use of SRW units. Design and construct MSE retaining walls based on actual elevations and dimensions in accordance with the contract and accepted submittals. Use an MSE Wall Installer prequalified by the NCDOT Contractual Services Unit for MSE retaining walls work (work code 3015). For this provision, “MSE wall” refers to a mechanically stabilized earth retaining wall and “MSE Wall Vendor” refers to the vendor supplying the chosen MSE wall system. Also, “blocks” refer to SRW units and “panels” refer to precast concrete panels.

B. MSE Wall Systems

Use an MSE wall system approved by the Department in accordance with any NCDOT restrictions for the chosen system, the plans and the NCDOT MSE wall policy. Value engineering proposals for other MSE wall systems will not be considered. Do not use MSE wall systems with SRW units or conditional approval for critical walls or MSE walls connected to critical walls. Critical walls are defined in the NCDOT MSE wall policy. Obtain the list of approved MSE wall systems and NCDOT MSE wall policy from:

C. Aggregate

“Aggregate” refers to fine or coarse aggregate. Coarse aggregate is required in the reinforced zone for critical walls and when noted on the plans. Otherwise, aggregate is required in the reinforced zone for MSE walls.

2.0 DESIGN SUBMITTAL

Submit 11 hard copies of working drawings and 3 hard copies of design calculations and an electronic copy (PDF on CD or DVD) of each for the MSE wall design submittal. Provide the submittal at least 30 calendar days before conducting the MSE wall preconstruction meeting. Do not begin MSE wall construction until the design submittal is accepted.

A Design Engineer is required to design MSE walls. Use a Design Engineer approved as a Geotechnical Engineer (key person) for a consultant prequalified by the NCDOT Contractual Services Unit for the MSE retaining wall design discipline.

The Retaining Wall Plans show a plan view, typical sections, details, notes and an elevation or profile view (wall envelope) for each MSE wall. Before beginning MSE wall design, survey existing ground elevations shown on the plans and other elevations in the vicinity of MSE walls as needed. Based on these elevations, finished grades and actual MSE wall dimensions and details, submit revised wall envelopes for review and acceptance. Use the accepted revised wall envelopes for design.

Design MSE walls in accordance with any NCDOT restrictions for the chosen MSE wall system, the plans and the *AASHTO LRFD Bridge Design Specifications* unless otherwise required. Also, design MSE walls with a uniform reinforcement length throughout the wall height and a minimum reinforcement length of $0.7H$ or 6' (1.8 m), whichever is greater, unless shown otherwise on the plans with H as defined below. Extend the reinforced zone a minimum of 6" (150 mm) beyond the end of reinforcement as shown on the plans. Use the simplified method for determining maximum reinforcement loads and design factors for reinforcement approved by the Department for the chosen MSE wall system or default values in accordance with the AASHTO LRFD specifications. Design steel components including reinforcement and connection materials for nonaggressive backfill with corrosion losses in accordance with the AASHTO LRFD specifications.

When a note on plans requires a live load (traffic) surcharge, use a surcharge load of 250 psf (12 kPa) in accordance with Figure C11.5.5-3 of the AASHTO LRFD specifications. For steel beam guardrail with 8' (2.4 m) posts above MSE walls, design upper two rows of reinforcement for an additional horizontal load of 300 lbs/linear ft (4.38 kN/linear m) of wall in accordance with the AASHTO LRFD specifications. If existing or future obstructions such as foundations, guardrail, fence or handrail posts, pavements, pipes, inlets or utilities will interfere with reinforcement, maintain a minimum clearance of 3" (75 mm) between the obstruction and reinforcement unless otherwise approved. Place reinforcement within 3" (75 mm) above the corresponding connection elevation.

Use 6 inch (150 mm) thick cast-in-place unreinforced concrete leveling pads beneath panels and blocks that are continuous at steps and extend a minimum of 6" (150 mm) in

front of and behind bottom row of panels and blocks. Unless required otherwise on the plans, embed top of leveling pads in accordance with the following.

EMBEDMENT DEPTH

Front Slope (H:V)	Minimum Facing Embedment Depth (whichever is greater)	
6:1 or Flatter (except abutment walls)	H/20	1 ft (0.3 m) for $H \leq 10'$ 2 ft (0.6 m) for $H > 10'$
6:1 or Flatter (abutment walls)	H/10	2 ft (0.6 m)
Steeper than 6:1 to 3:1	H/10	2 ft (0.6 m)
Steeper than 3:1 to 2:1	H/7	2 ft (0.6 m)

Front slope is as shown on the plans and H is the maximum design height plus embedment per wall as shown on the plans

When a note on plans requires a drain, extend a continuous drain along the base of the reinforced zone behind the aggregate. Provide drains meeting the requirements of an aggregate shoulder drain in accordance with Roadway Standard Drawing No. 816.02.

For MSE walls with panels, place a minimum of 2 bearing pads in each horizontal panel joint such that the final horizontal joint opening is 3/4 inch (19 mm). Additional bearing pads may be required for panels wider than 5 ft (1.5 m) as determined by the Engineer. Cover joints on the back of panels with filter fabric a minimum of 12" (250 mm) wide.

For MSE walls with SRW units, place coarse aggregate between and behind blocks for a horizontal distance of at least 18" (450 mm) and fill any block core spaces with coarse aggregate.

Separation fabric is required between aggregate and overlying fill or pavement section with the exception of when concrete pavement is placed directly on aggregate. Separation fabric may also be required between coarse aggregate and backfill or natural ground as determined by the Engineer.

Unless shown otherwise on the plans, use reinforced concrete coping at top of walls with dimensions as shown on the plans. Extend coping a minimum of 6" (150 mm) above where finished grade intersects the back of MSE walls unless required otherwise on the plans. Cast-in-place concrete coping is required for MSE walls with SRW units and when noted on the plans. At the Contractor's option, connect cast-in-place concrete coping to panels and blocks with dowels or extend coping down the back of MSE walls. Also, connect cast-in-place leveling concrete for precast concrete coping to panels with dowels. When barriers are required above MSE walls, use concrete barrier rails with moment slabs as shown on the plans.

Submit working drawings and design calculations for review and acceptance in accordance with Article 105-2 of the *Standard Specifications*. Submit working drawings showing plan

views, wall profiles with required resistances, typical sections with reinforcement and connection details, aggregate type and separation fabric locations and details of leveling pads, facing elements, coping, bin walls, slip joints, etc. If necessary, include details on working drawings for concrete barrier rails with moment slabs, geogrid splices, reinforcement connected to end bent caps and obstructions extending through walls or interfering with reinforcement, concrete barrier rails and moment slabs. Submit design calculations for each wall section with different surcharge loads, geometry or material parameters. A minimum of one analysis is required for each wall section with different reinforcement lengths. When designing MSE walls with computer software other than MSEW, verify the design with MSEW version 3.0 or later, manufactured by ADAMA Engineering, Inc. At least one MSEW analysis is required per 100 ft (30 m) of wall length with a minimum of one MSEW analysis for the wall section with the longest reinforcement length. Submit electronic executable MSEW input and output files with the design calculations. Have MSE walls designed, detailed and sealed by the Design Engineer.

3.0 MATERIALS

A. Certifications, Storage and Handling

Provide certifications in accordance with Article 106-3 of the *Standard Specifications*. Furnish Type 3 Manufacturer's Certifications for MSE wall materials with the exception of precast elements and the following. For reinforcement, provide Type 1 Certified Mill Test Reports for tensile strength. For SRW units, provide Type 1 Certified Mill Test Reports or Type 4 Certified Test Reports for all block properties with the exception of durability. When a note on plans requires freeze-thaw durable blocks, provide Type 2 Typical Certified Mill Test Reports or Type 5 Typical Certified Test Reports for durability.

Store steel materials on blocking a minimum of 12" (300 mm) above the ground and protect it at all times from damage; and when placing in the work make sure it is free from dirt, dust, loose mill scale, loose rust, paint, oil or other foreign materials. Load, transport, unload and store MSE wall materials such that they are kept clean and free of damage.

Damaged panels or blocks with excessive discoloration, chips or cracks as determined by the Engineer will be rejected. Do not damage reinforcement connection hardware or mechanisms in handling and storing panels or blocks. Mark, store and transport panels in accordance with Section 1077 of the *Standard Specifications*.

Label each pallet of blocks with the information listed in Article 1077-13 of the *Standard Specifications*. Do not transport SRW units away from the casting yard until the concrete strength reaches 4000 psi (27.6 MPa) and a period of at least 5 days elapses after casting unless otherwise approved.

Identify, store and handle geogrids and fabrics in accordance with ASTM D4873. Geogrids and fabrics with defects, flaws, deterioration or damage will be rejected. Do not leave geogrids and fabrics uncovered for more than 7 days.

B. Facing Elements

Provide facing elements produced by a manufacturer approved or licensed by the MSE Wall Vendor.

1. Precast Concrete Panels

Provide precast concrete panels meeting the requirements of Sections 1000 and 1077 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Accurately locate and secure reinforcement connection hardware and maintain required concrete cover. Produce panels within 1/4 inch (6 mm) of the panel dimensions shown in the accepted submittals.

A minimum compressive strength of 4000 psi (27.6 MPa) at 28 days is required. For testing panels for compressive strength, at least 4 cylinders are required per 2000 ft² (186 m²) of panel face area or a single day's production, whichever is less.

Unless required otherwise on the plans, provide panels with a smooth flat final finish in accordance with Article 1077-11 of the *Standard Specifications*.

2. Segmental Retaining Wall (SRW) Units

Unless required otherwise on the plans, provide SRW units with a vertical straight face and a concrete gray color with no tints, dyes or pigments. Before beginning block production, obtain approval of sample blocks of the type, face and color proposed for the project.

Use blocks meeting the requirements of Section 1040 of the *Standard Specifications* and ASTM C1372 with the exception of absorption, compressive strength and unit height requirements. Test blocks in accordance with ASTM C140 with the exception of the number of units in a lot. For testing blocks, a lot is defined as 5000 units or a single day's production, whichever is less, and at least 6 blocks are required per lot.

Provide blocks with a maximum absorption of 5% and a unit height within 1/16 inch (2 mm) of the dimension shown in the accepted submittals.

A minimum compressive strength of 4000 psi (27.6 MPa) at 28 days is required for blocks with the exception of freeze-thaw durable blocks. When a note on plans requires freeze-thaw durable SRW units, a minimum compressive strength of 5500 psi (37.9 MPa) at 28 days is required.

Test freeze-thaw durable blocks in accordance with ASTM C1262. Test specimens in water. Freeze-thaw durable blocks are acceptable if the weight loss of each of 4 of the 5 specimens after 150 cycles does not exceed 1% of its initial weight.

C. Reinforcement

Provide reinforcement supplied by the MSE Wall Vendor or a manufacturer approved or licensed by the vendor.

1. Steel (Inextensible) Reinforcement

Use welded wire reinforcement grids (mesh, mats and ladders) meeting the requirements of Article 1070-3 of the *Standard Specifications* and metallic strips meeting the requirements of ASTM A572 or A1011 with a grade as specified in the accepted submittals. Galvanize steel reinforcement in accordance with Section 1076 of the *Standard Specifications*.

2. Geogrid (Extensible) Reinforcement

Use geogrids that have been approved by the Department for the chosen MSE wall system. Obtain the list of approved geogrids for each MSE wall system from the website shown elsewhere in this provision.

Test geogrids in accordance with ASTM D6637. Machine direction (MD) and cross-machine direction (CD) are as defined by ASTM D4439. Provide minimum average roll values (MARV) as defined by ASTM D4439 for tensile strength of geogrids. For testing geogrids, a lot is defined as a single day's production.

D. Aggregate

Provide aggregate meeting the requirements of Sections 1005 and 1014 of the *Standard Specifications*.

1. Fine Aggregate

Use fine aggregate meeting the requirements of standard size nos. 1S, 2S, 2MS or 4S in accordance with Table 1005-2 of the *Standard Specifications*. When using steel reinforcement with fine aggregate, provide aggregate meeting the electrochemical requirements of Article 7.3.6.3 of the *AASHTO LRFD Bridge Construction Specifications* tested in accordance with the following methods:

Property	AASHTO Test Method
pH	T289
Resistivity	T288
Chlorides	T291
Sulfates	T290

2. Coarse Aggregate

Use coarse aggregate meeting the requirements of standard size nos. 5, 57, 57M, 6M, 67 or 78M in accordance with Table 1005-1 of the *Standard Specifications*.

E. Coping, Leveling Concrete and Pads

Provide concrete coping and leveling pads meeting the requirements of Section 1000 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Provide precast coping meeting the requirements of Section 1077 of the *Standard Specifications* and leveling concrete for precast coping meeting the requirements of Section 1000 of the *Standard Specifications*.

Use Class A Concrete for coping, leveling concrete and pads in accordance with Article 1000-4 of the *Standard Specifications* and curing agents for concrete in accordance with Section 1026 of the *Standard Specifications*. For testing precast coping for compressive strength, at least 4 cylinders are required per 40 yd³ (31 m³) of concrete or a single day's production, whichever is less.

F. Wall Drainage Systems

Wall drainage systems consist of drains and outlet components. Use drain and outlet materials meeting the requirements of subsurface drainage materials in accordance with Section 1044 of the *Standard Specifications*.

G. Bearing Pads

Use bearing pads approved by the Department for the chosen MSE wall system that meet the material requirements in Section 3.6.1.a of the *FHWA Manual "Design and Construction of Mechanically Stabilized Earth Walls and Reinforced Soil Slopes – Volume I"* (Publication No. FHWA-NHI-10-024). Obtain the list of approved bearing pads for each MSE wall system from the website shown elsewhere in this provision.

H. Geotextile Fabrics

Use filter and separation fabrics meeting the requirements of Type 2 Engineering Fabric in accordance with Section 1056 of the *Standard Specifications*.

I. Miscellaneous Components

Miscellaneous components may include attachment devices, connectors (e.g., pins, bars, plates, etc.), dowels, fasteners (e.g., bolts, nuts, etc.) and any other MSE wall components not included above. Galvanize steel components in accordance with Section 1076 of the *Standard Specifications*. Provide miscellaneous components approved by the Department for the chosen MSE wall system. Obtain the list of approved miscellaneous components for each MSE wall system from the website shown elsewhere in this provision.

J. Joint Sealer

Use joint sealer in accordance with Section 1028 of the *Standard Specifications*.

4.0 CORROSION MONITORING

Corrosion monitoring is required for MSE walls with steel reinforcement. The Engineer will determine the number of monitoring locations and where to install the instrumentation. Contact the NCDOT Materials & Tests (M&T) Unit before beginning wall construction. M&T will provide the corrosion monitoring instrumentation kits and if necessary, assistance with installation.

5.0 PRECONSTRUCTION MEETING

Before starting MSE wall construction, conduct a preconstruction meeting to discuss the construction and inspection of the MSE walls. Schedule this meeting after all MSE wall submittals have been accepted. The Resident or Bridge Maintenance Engineer, Bridge Construction Engineer, Geotechnical Operations Engineer, Contractor and MSE Wall Installer Superintendent will attend this preconstruction meeting.

6.0 SITE ASSISTANCE

Provide a representative employed by the MSE Wall Vendor to assist and guide the MSE Wall Installer on-site for at least 8 hours when the first panels or blocks are set and the first reinforcement layer is placed unless otherwise approved. If problems are encountered during construction, the Engineer may require the vendor representative to return to the site for a time period determined by the Engineer at no additional cost to the Department.

7.0 CONSTRUCTION METHODS

Control drainage during construction in the vicinity of MSE walls. Direct run off away from MSE walls, aggregate and backfill. Contain and maintain aggregate and backfill and protect material from erosion.

Perform necessary clearing and grubbing in accordance with Section 200 of the *Standard Specifications*. Excavate as necessary for MSE walls in accordance with the accepted submittals. If applicable and at the Contractor's option, "temporary shoring for wall construction" may be used in lieu of temporary slopes to construct MSE walls. Temporary shoring for wall construction is defined as temporary shoring not shown on the plans or required by the Engineer including shoring for OSHA reasons or the Contractor's convenience.

Unless required otherwise on the plans, install foundations located in the reinforced zone before placing aggregate or the first reinforcement layer. Notify the Engineer when foundation excavation is complete. Do not place leveling pad concrete, aggregate or reinforcement until obtaining approval of the excavation depth and foundation material.

Construct cast-in-place concrete leveling pads at elevations and with dimensions shown in the accepted submittals and in accordance with Section 420 of the *Standard Specifications*. Cure leveling pads a minimum of 24 hours before placing panels or blocks.

Erect and support panels or blocks with no negative batter (wall face leaning forward) such that the final position is as shown in the accepted submittals. Stagger vertical joints to create a running bond when possible unless shown otherwise in the accepted submittals. Place blocks with a maximum joint width of 3/8 inch (10 mm).

Set panels with a vertical joint width of 1/2 to 1 inch (13 to 25 mm). Place bearing pads in horizontal panel joints and cover panel joints with filter fabrics as shown in the accepted submittals. Attach filter fabrics to back of panels with adhesives, tapes or other approved methods.

Construct MSE walls with a vertical and horizontal tolerance of 3/4 inch (19 mm) when measured with a 10 ft (3 m) straight edge and a final overall vertical plumbness (batter) of less than 1/2 inch per 10 ft (13 mm per 3 m) of wall height.

Place reinforcement at the locations and elevations shown in the accepted submittals. Do not splice steel reinforcement. Geogrids may be spliced once per reinforcement length in accordance with the accepted submittals. Contact the Engineer when unanticipated existing or future obstructions such as foundations, guardrail, fence or handrail posts, pavements, pipes, inlets or utilities will interfere with reinforcement. To avoid obstructions, deflect, skew and modify reinforcement as shown in the accepted submittals. Place reinforcement in slight tension free of kinks, folds, wrinkles or creases.

Place aggregate in the reinforced zone in 8 to 10 inch (200 to 250 mm) thick lifts. Compact fine aggregate in accordance with Subarticle 235-4(C) of the *Standard Specifications*. Use only hand operated compaction equipment within 3 ft (1 m) of the wall face. At a distance greater than 3 ft (1 m), compact aggregate with at least 4 passes of an 8 – 10 ton (7.3 - 9.1 metric ton) vibratory roller. Smooth wheeled or rubber tired rollers are also acceptable for compacting aggregate. Do not use sheepsfoot, grid rollers or other types of compaction equipment with feet. Compact aggregate in a direction parallel to the wall face. Do not displace or damage reinforcement when placing and compacting aggregate. End dumping directly on geogrids is not permitted. Do not operate heavy equipment on reinforcement until it is covered with at least 8" (200 mm) of aggregate. Replace any damaged reinforcement to the satisfaction of the Engineer. Backfill for wall construction outside the reinforced zone in accordance with Article 410-8 of the *Standard Specifications*.

If a drain is required, install wall drainage systems as shown in the accepted submittals and in accordance with Section 816 of the *Standard Specifications*. Provide drains with positive drainage towards outlets.

Place and construct coping and leveling concrete as shown in the accepted submittals. Construct cast-in-place concrete coping and leveling concrete in accordance with Section 420 of the *Standard Specifications*. When single faced precast concrete barriers are placed in front of MSE walls, stop coping just above barriers such that coping does not interfere with placing barriers up against wall faces. Do not remove forms until concrete achieves a minimum compressive strength of 2400 psi (16.5 MPa). Provide a Class 2 Surface Finish for cast-in-place concrete coping in accordance with Article 420-17 of the *Standard Specifications*.

Construct cast-in-place concrete coping joints at a maximum spacing of 10 ft (3 m) to coincide with vertical joints between panels or blocks. Half-inch (13 mm) thick expansion joints in accordance with Article 420-10 of the *Standard Specifications* are required every third joint. Half-inch (13 mm) deep grooved contraction joints in accordance with Subarticle 825-10(B) of the *Standard Specifications* are required for the remaining joints. Stop coping reinforcement 2” (50 mm) from either side of expansion joints.

When separation fabric is required, overlap fabric a minimum of 18” (450 mm) with seams oriented parallel to the wall face. Seal joints above and behind MSE walls between coping and ditches with joint sealer.

8.0 MEASUREMENT AND PAYMENT

MSE Retaining Walls will be measured and paid for in square feet (meters). MSE walls will be measured as the exposed face area with the wall height equal to the difference between the top and bottom of wall elevation. The top of wall elevation is defined as the top of coping or top of panels or blocks for MSE walls without coping. The bottom of wall elevation is as shown on the plans and no payment will be made for portions of MSE walls below bottom of wall elevations.

The contract unit price for *MSE Retaining Walls* will be full compensation for providing design, submittals, labor, tools, equipment and MSE wall materials, excavating, backfilling, hauling and removing excavated materials and providing site assistance, leveling pads, facing elements, reinforcement, aggregate, wall drainage systems, fabrics, bearing pads, coping, miscellaneous components and any incidentals necessary to design and construct MSE walls in accordance with this provision. If necessary, the contract unit price for *MSE Retaining Walls* will also be full compensation for reinforcement connected to and aggregate behind end bent caps in the reinforced zone in accordance with the contract.

No separate payment will be made for temporary shoring for wall construction. Temporary shoring for wall construction will be considered incidental to the contract unit price for *MSE Retaining Walls*.

The contract unit price for *MSE Retaining Walls* does not include the cost for fences, handrails, ditches, guardrail and barriers associated with MSE walls as payment for these items will be made elsewhere in the contract.

Payment will be made under:

Pay Item	Pay Unit
MSE Retaining Walls	Square Foot (Meter)

ANCHORED SHEET PILE RETAINING WALLS**(SPECIAL)****1.0 GENERAL**

A ground anchor is defined as a steel bar or multi-strand tendon grouted in a drilled hole inclined at an angle below horizontal. An anchored retaining wall consists of ground anchors connected to steel sheet piles with a cast-in-place coping attached to the top of the piles. Typically, sheet piles are vibrated or driven below the scour elevation or as noted on plans. Design and construct anchored retaining walls based on actual elevations and dimensions in accordance with the contract and accepted submittals. For this provision, "anchored wall" refers to an anchored sheet pile retaining wall and "Anchored Wall Contractor" refers to the contractor installing the ground anchors.

2.0 SUBMITTALS

Three submittals are required. These submittals include (1) Anchored Wall Contractor personnel and experience, (2) anchored wall design and (3) anchored wall construction plan. Provide 11 hard copies of working drawings and 3 hard copies of design calculations for the anchored wall design submittal and 4 hard copies of the remaining submittals. Also, submit an electronic copy (PDF on CD or DVD) of each submittal. Allow 10 calendar days for the review of the Anchored Wall Contractor personnel and experience submittal. After the personnel and experience submittal is accepted, submit the remaining submittals at least 30 calendar days before starting anchored wall construction. Do not begin anchored wall construction until the construction plan is accepted.

A. Anchored Wall Contractor Personnel and Experience Submittal

Use an Anchored Wall Contractor prequalified by the NCDOT Contractual Services Unit for anchored retaining walls work (work code 3020). Submit documentation that the Anchored Wall Contractor has successfully completed at least 5 anchored wall projects and 150 ground anchors within the last 3 years with wall heights similar to those for this project and an exposed face area for all walls of at least 5,000 ft² (930 m²). Documentation should include the General Contractor and Owner's name and current contact information with descriptions of each past project.

Provide verification of employment with the Anchored Wall Contractor for the Superintendent and Project Manager assigned to this project. Submit documentation that the Superintendent and Project Manager each have a minimum of 5 years experience in anchored wall construction with past projects of scope and complexity similar to that anticipated for this project. Documentation should include resumes, references, certifications, project lists, experience descriptions and details, etc. Perform work with the personnel submitted and accepted. If personnel changes are required during construction, suspend anchored wall construction until replacement personnel are submitted and accepted.

B. Anchored Wall Design Submittal

A Design Engineer is required to design anchored walls. Use a Design Engineer approved as a Geotechnical Engineer (key person) for a consultant prequalified by the NCDOT Contractual Services Unit for the anchored retaining wall design discipline. The Design Engineer may also act as the Project Manager provided the Design Engineer meets the Project Manager requirements above.

The Retaining Wall Plans show a plan view, typical sections, details, notes and an elevation or profile view (wall envelope) for each anchored wall. Before beginning anchored wall design, survey existing ground elevations shown on the plans and other elevations in the vicinity of anchored walls as needed. Based on these elevations, finished grades and actual anchored wall dimensions and details, submit revised wall envelopes for review and acceptance. Use the accepted revised wall envelopes for design.

Design anchored walls in accordance with the plans and the *AASHTO LRFD Bridge Design Specifications* unless otherwise required. Also, design walls for a maximum deflection of 0.5% of the exposed wall height. When a note on plans requires a live load (traffic) surcharge, use a surcharge load of 250 psf (12 kPa) with a load factor of 1.75 in accordance with Article 3.11.6.2 of the AASHTO LRFD specifications. For steel beam guardrail with 8' (2.4 m) posts above anchored walls, design walls for an additional horizontal load of 300 lbs/linear ft (4.38 kN/linear m) of wall. For concrete barrier rails with moment slabs above anchored walls, design walls for an additional horizontal load of 500 lbs/linear ft (7.30 kN/linear m) of wall. Apply additional loads to the back of anchored walls at a depth of 2 ft (0.6m) below grade elevation.

Do not extend ground anchors beyond right-of-way or easement lines. If existing or future obstructions such as foundations, guardrail, fence or handrail posts, pavements, pipes, inlets or utilities will interfere with ground anchors, maintain a minimum clearance of 6" (150 mm) between the obstruction and the anchors. Where ground anchors go through piles, the designer is responsible for proposing reinforcement details.

Use grouted ground anchors meeting the following requirements unless otherwise approved.

- Minimum bond length of 10 ft (3 m) in rock and 15 ft (4.6 m) in soil
- Minimum unbonded length of 15 ft (4.6 m)
- Minimum extension of unbonded length behind the critical failure surface of 5 ft (1.5 m) or H/5, whichever is greater, where H is the design height plus embedment as shown on the plans
- Minimum inclination of 12 degrees below horizontal
- Clearance between the end of the tendon and the hole of 6" (150 mm)
- Diameter ranging from 6 to 10 inches (150 to 250 mm)
- Minimum grout cover of ½ inch (13 mm) over encapsulation

Four inch (100 mm) diameter ground anchors may be approved for drill holes in rock at the discretion of the Engineer.

Submit working drawings and design calculations including unit grout/ground bond strengths and lock-off loads for review and acceptance in accordance with Article 105-2 of the *Standard Specifications*. Submit working drawings showing plan views, wall profiles with pile and anchor locations including known performance test anchor locations, typical sections and details of piles, ground anchors, reinforced webs, drainage, temporary support of excavations, leveling pads, concrete facing and reinforcing. If necessary, include details on working drawings for concrete barrier rails with moment slabs and obstructions extending through walls or interfering with piles, ground anchors, concrete barrier rails and moment slabs. Submit design calculations including deflection calculations for each wall section with different surcharge loads, geometry or material parameters. A minimum of one analysis is required for each wall section with different ground anchor lengths. When using a software program for design, provide a hand calculation verifying the analysis of the section with the longest ground anchors. Also, submit design calculations for temporary support of excavations and overburden cover over the uppermost ground anchor. Have anchored walls designed, detailed and sealed by the Design Engineer.

C. Anchored Wall Construction Plan Submittal

Submit detailed project specific information including the following.

1. Excavation methods and equipment.
2. For driven sheet piles, proposed pile driving methods and equipment in accordance with Article 450-5 of the *Standard Specifications*.
3. For ground anchors, list and sizes of proposed drilling rigs and tools, tremies and grouting equipment.
4. Sequence and step-by-step description of anchored wall construction including details of excavations and temporary support of excavations, drilling and grouting methods, ground anchor and wall drainage system installation and facing construction.
5. Ground anchor testing details, procedures and plan sealed by a Professional Engineer registered in North Carolina with calibration certificates dated within 90 calendar days of the submittal date.
6. Example of construction records to be provided in accordance with Section 6.0.
7. Grout mix design including laboratory test results in accordance with the *Grout for Structures* provision and acceptable ranges for grout flow and density.
8. Other information shown on the plans or requested by the Engineer.

If alternate installation and testing procedures are proposed or necessary, a revised construction plan submittal may be required. If the work deviates from the accepted

submittal without prior approval, the Engineer may suspend anchored wall construction until a revised plan is submitted and accepted.

3.0 MATERIALS

Provide Type 3 Manufacturer's Certifications in accordance with Article 106-3 of the *Standard Specifications* for ground anchor and wall drainage materials. Store steel materials on blocking a minimum of 12" (300 mm) above the ground and protect it at all times from damage; and when placing in the work make sure it is free from dirt, dust, loose mill scale, loose rust, paint, oil or other foreign materials. Load, transport, unload and store anchored wall materials such that they are kept clean and free of damage. Damaged or deformed materials will be rejected.

A. Steel Sheet Piles

Use steel sheet piles meeting the requirements of Article 1084-2(B) of the *Standard Specifications*. Provide welded stud shear connectors in accordance with Article 1072-8 of the *Standard Specifications*.

B. Ground Anchors

A ground anchor consists of a grouted steel bar or multi-strand tendon and anchorage with steel, corrosion protection and miscellaneous elements. Use high-strength steel bars meeting the requirements of AASHTO M275 or seven-wire strands meeting the requirements of ASTM A886 or Article 1070-5 of the *Standard Specifications*. Splice bars in accordance with Article 1070-10 of the *Standard Specifications*. Do not splice strands.

Provide Class I corrosion protection (encapsulated tendon) for ground anchors in accordance with *FHWA Geotechnical Engineering Circular No. 4 "Ground Anchors and Anchored Systems"* (Publication No. FHWA-IF-99-015). Provide sheaths including grease-filled and grout-filled sheaths for unbonded lengths and encapsulation for bond lengths of ground anchors meeting the requirements of Article 6.3.4 of the *AASHTO LRFD Bridge Construction Specifications*. Use trumpets, bondbreakers, spacers and centralizers meeting the requirements of Articles 6.3.3 and 6.3.5 of the *AASHTO LRFD specifications*.

Use grout in accordance with the contract.

Fabricate centralizers from schedule 40 polyvinyl chloride (PVC) plastic pipe or tube, steel or other material not detrimental to steel bars (no wood). Size centralizers to position the bar within 1 inch (25 mm) of the drill hole center and allow a tremie to be inserted to the bottom of the hole. Use centralizers that do not interfere with grout placement or flow around bars. For encapsulated bars, centralizers are required both inside and outside of encapsulation.

Anchorage consist of steel bearing plates with washers and hex nuts for bars or steel wedge plates and wedges for strands. Provide bearing plates meeting the requirements

of Article 6.3.3 of the AASHTO LRFD Specifications and grease-filled anchorage covers, washers, hex nuts, wedge plates and wedges in accordance with the tendon manufacturer's recommendations.

Wall Drainage Systems

Anchored Sheet Pile Wall drainage systems consist of weep holes that are capable of relieving hydrostatic pressure. Weep holes should be located approximately 3 meters apart and within the bottom third of the exposed wall. Adjacent weep holes should be approximately level with each other and can be stepped as required to maintain a uniform appearance. Provide subsurface drainage in accordance with Article 410-9 of the Standard Specifications. If desired, substitute geocomposite drain strips, meeting the requirements below, for the vertical drains consisting of subdrain fine aggregate.

Use at least 12 inch (300 mm) wide prefabricated geocomposite drain strips consisting of a non-woven polypropylene geotextile bonded to one side of an HDPE or polystyrene drainage core, e.g., sheet drain. Provide drain strips with cores meeting the following requirements.

Core Property	ASTM Test Method	Requirement (MARV ¹)
Thickness	D5199	¼ - ½ inch (6 - 13 mm)
Compressive Strength	D1621	40 psi (276 kPa)
Flow Rate (with a gradient of 1.0)	D4716	5 gpm (1 l/s) ²

¹ MARV does not apply to thickness

² per ft (m) of width tested

Use drain and outlet materials meeting the requirements of subsurface drainage materials in accordance with Section 1044 of the *Standard Specifications*.

C. Select Material

Provide select material meeting the requirements of Class III, V or VI Select Material in accordance with Section 1016 of the *Standard Specifications*.

D. Concrete Coping

Provide concrete coping meeting the requirements of Section 1000 of the *Standard Specifications* and reinforcing steel meeting the requirements of Section 1070 of the *Standard Specifications*. Use Class A Concrete in accordance with Article 1000-4 of the *Standard Specifications* and curing agents for concrete in accordance with Section 1026 of the *Standard Specifications*.

E. Separation Fabrics

Use separation fabrics meeting the requirements of Type 2 Engineering Fabric in accordance with Section 1056 of the *Standard Specifications*.

F. Joint Materials

Use joint materials in accordance with Section 1028 of the *Standard Specifications*.

4.0 PRECONSTRUCTION MEETING

Before starting anchored wall construction, conduct a preconstruction meeting to discuss the construction, inspection and testing of the anchored walls. Schedule this meeting after all anchored wall submittals have been accepted. The Resident or Bridge Maintenance Engineer, Bridge Construction Engineer, Geotechnical Operations Engineer, Contractor and Anchored Wall Contractor Superintendent and Project Manager will attend this preconstruction meeting.

5.0 CONSTRUCTION METHODS

Control drainage during construction in the vicinity of anchored walls. Direct run off away from anchored walls and areas above and behind walls. Contain and maintain select material and protect material from erosion.

Perform necessary clearing and grubbing in accordance with Section 200 of the *Standard Specifications*. Notify the Engineer before blasting in the vicinity of anchored walls. Perform blasting in accordance with the contract. Install foundations located behind anchored walls and within a horizontal distance equal to the longest ground anchor length before beginning anchored wall construction.

Do not excavate behind anchored walls. If overexcavation occurs, repair walls at no additional cost to the Department with a method proposed by the Contractor and accepted by the Engineer. A revised anchored wall construction plan may be required.

Perform any welding in accordance with the contract. At the Contractor's option, welding may be performed in the field in lieu of employing an American Institute of Steel Construction (AISC) certified fabricator in accordance with Subarticle 1072-1(A) of the *Standard Specifications*. For field welding, use welders certified as a bridge welder in accordance with the NCDOT Field Welder Certification Program.

Use equipment and methods reviewed and accepted in the construction plan or approved by the Engineer. Inform the Engineer of any deviations from the accepted plan.

A. Pile Installation

Install piles in accordance with the accepted submittals and this provision. If required, remove any existing riprap or boulders prior to installing sheet piles. Contact the Engineer if the design pile embedment is not achieved. Do not splice piles. If necessary, cut off piles at elevations shown in the accepted submittals.

Install piles within 1 inch (25 mm) horizontally and vertically of plan location and with no negative batter (piles leaning forward).

For driven piles, drive piles to the specified elevations in accordance with Section 450 of the *Standard Specifications* with the exception of Article 450-6 or at the Contractor's option and when approved by the Engineer, use vibratory hammers to install full depth of piles.

B. Excavation

Construct anchored walls from the top down by removing material in front of walls and in between piles as needed.

If necessary, excavate in accordance with the accepted submittals and in staged horizontal lifts with heights not to exceed 5 ft (1.5 m). Use an approved method for temporary support of excavations in accordance with the accepted submittals.

Install temporary support or permanent sheet piling within 24 hours of excavating each lift unless approved otherwise by the Engineer. The installation may be delayed if it can be demonstrated that the delay will not adversely affect the excavation face stability. If the excavation face will be exposed for more than 24 hours, use polyethylene sheets anchored at the top and bottom of the lift to protect the face from changes in moisture content.

If the excavation face becomes unstable at any time, suspend anchored wall construction and temporarily stabilize the face by immediately placing an earth berm against the unstable face. Anchored wall construction may not proceed until remedial measures are proposed by the Contractor and accepted by the Engineer. A revised anchored wall construction plan submittal may be required.

Do not excavate the next lift until the temporary or permanent support of excavations for the preceding lift is installed and the preceding row of ground anchors are accepted by the Engineer.

C. Ground Anchors

Fabricate, install and test ground anchors in accordance with the accepted submittals, Articles 6.4 and 6.5 of the *AASHTO LRFD Bridge Construction Specifications* and the following requirements unless otherwise approved.

- Materials in accordance with this provision are required instead of materials conforming to Articles 6.4 and 6.5.3 of the AASHTO LRFD specifications
- Heat-shrink sheaths for unbonded lengths of ground anchors are not permitted
- An electrical resistance load cell is required for performance tests
- Performance tests are required for a minimum of 2 ground anchors or 5% of anchors, whichever is greater, per anchored wall instead of the requirements in Article 6.5.5.2 of the AASHTO LRFD specifications
- An additional load increment equal to the alignment load (AL) is required between the maximum test and lock-off loads in Table 6.5.5.2-1 of the AASHTO LRFD specifications

- Competent rock in Article 6.5.5.5 of the AASHTO LRFD specifications will be as determined by the Engineer
- The lock-off load is as shown in the accepted submittals

See Article 6.5.5.3 of the AASHTO LRFD specifications for proof test requirements. Submit identification number and calibration records for each load cell, jack and pressure gauge with the anchored wall construction plan. Calibrate the jack and pressure gauge as a unit. ~~The approximate locations of known performance test anchors are shown on the plans. The Engineer will decide the actual number and locations of performance tests.~~

D. Concrete Coping

Construct cast-in-place reinforced concrete coping in accordance with the accepted submittals and Section 420 of the *Standard Specifications*. Do not remove forms until concrete achieves a minimum compressive strength of 2400 psi (16.5 MPa). Unless required otherwise on the plans, provide a Class 2 Surface Finish for concrete facing in accordance with Article 420-17 of the *Standard Specifications*.

Construct concrete coping joints at a maximum spacing of 30 ft (9 m) unless required otherwise on the plans. Half-inch (13 mm) thick expansion joints in accordance with Article 420-10 of the *Standard Specifications* are required every third joint. Half-inch (13 mm) deep grooved contraction joints in accordance with Subarticle 825-10(B) of the *Standard Specifications* are required for the remaining joints. Stop reinforcement 2" (50 mm) from either side of expansion joints.

Seal joints above and behind anchored walls between concrete facing and ditches with joint sealer.

E. Backfill

Backfill behind sheet piles with suitable backfill or select material, as shown in the accepted submittals. Ensure all voids between sheet piles are filled and compacted material to the satisfaction of the Engineer. Place separation fabric between the existing or excavated ground and the selected backfill material, overlap fabric a minimum of 18" (450 mm) with seams oriented parallel to the wall face.

6.0 CONSTRUCTION RECORDS

Provide 2 original hard copies of anchored wall construction records including the following within 24 hours of completing each row of ground anchors.

1. Names of Anchored Wall Contractor, Superintendent, Drill Rig Operator, Project Manager and Design Engineer
2. Wall description, county, NCDOT contract, TIP and WBS element number
3. Wall station and number and lift location, dimensions, elevations and description

4. Ground anchor locations, diameters, lengths and inclinations, tendon types, sizes and grades, corrosion protection and temporary casing information
 5. Date and time drilling begins and ends, tendons are placed, grout is mixed and/or arrives on-site and grout placement begins and ends
 6. Grout volume, temperature, flow and density records
-
7. Ground and surface water conditions and elevations, if applicable
 8. Weather conditions including air temperature at time of grout placement
 9. Ground anchor testing records including movement versus load plots for each load increment
 10. All other pertinent details related to anchored wall construction

The Engineer will review the construction records to determine if the ground anchors are acceptable. If the Engineer determines a ground anchor is unacceptable, revise the anchored wall design and/or installation methods. Submit a revised anchored wall design and/or construction plan for review and acceptance and provide an acceptable ground anchor with the revised design and/or installation methods at no additional cost to the Department. If required, replace the ground anchor and/or provide additional anchors with the revised design and/or installation methods at no additional cost to the Department.

After completing each anchored wall or stage of an anchored wall, submit electronic copies (PDF on CD or DVD) of all corresponding construction records.

7.0 MEASUREMENT AND PAYMENT

Anchored Sheet Pile Retaining Wall will be measured and paid for in square feet (meters). Anchored walls will be measured as the exposed face area with the wall height equal to the difference between the top and bottom of wall elevation. The top of wall elevation is defined as the top of concrete coping. The bottom of wall elevation is as shown on the plans and no payment will be made for portions of anchored walls below bottom of wall elevations.

The contract unit price for *Anchored Sheet Pile Retaining Wall* will be full compensation for providing design, submittals, labor, tools, equipment and anchored wall materials, excavating, welding, installing piles, ground anchors and wall drainage systems, grouting, ground anchor testing, backfilling, select material, reinforcement, concrete facing, backfill, fabrics and any incidentals necessary to design and construct anchored walls in accordance with this provision. If necessary, the contract unit price for *Anchored Sheet Pile Retaining Wall* will also be full compensation for providing brick veneers in accordance with the contract.

The contract unit price for *Anchored Sheet Pile Retaining Wall* does not include the cost for fences, handrails, ditches, guardrail and barriers associated with anchored walls as payment for these items will be made elsewhere in the contract.

Payment will be made under:

Pay Item

Pay Unit

~~Anchored Sheet Pile Retaining Wall~~

~~Square Foot (Meter)~~

