


RAILROAD SPECIAL PROVISIONS FOR ROADBED

TABLE OF CONTENTS

RAILROAD ROADBED

Railroad Roadbed	2
Clearing and Grubbing – Method II	2
Ownership of Materials	2
Excavation	2
36” Welded Steel Pipe	3
36” Welded Steel Pipe, Open Cut	5
Remove Existing Headwalls	6
Railroad Track to be Removed	6
Embankment	7
Bituminous Coated Corrugated Metal Pipe (BCCMP)	8
Sub-Ballast	10
Maintenance of Track Roadbed	11
Pipe Removal	11

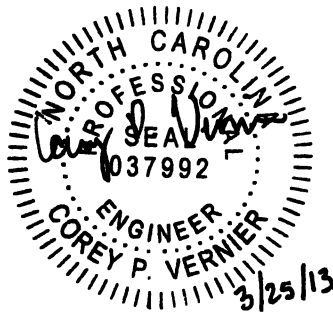

Revised 4-5-13

Project: TIP P-5208D

County: Cabarrus

186

RAILROAD ROADBED

The Standard Specifications for Roads and Structures, January 2012 of the North Carolina Department of Transportation, hereinafter referred to as the Standard Specifications, shall apply to the articles of the Project Special Provisions.

CLEARING AND GRUBBING - METHOD II:

Perform clearing on this project to the limits established by Method "II" shown on Standard Drawing No. 200.02 of the 2012 Roadway Standard Drawings.

The work shall be performed in accordance with Section 200, "Clearing and Grubbing", of the Standard Specifications, except that grubbing will be performed on all cleared excavation and embankment areas and will include all stumps, roots and other embedded debris. All debris from the clearing and grubbing operations, including stumps and roots, shall be disposed of at an existing public disposal site currently permitted by NCDENR.

OWNERSHIP OF MATERIALS

All salvaged material originally furnished by the Department's Contractor shall remain the property of the Contractor, and he shall give consideration to this when making his bid. All salvaged track materials owned by the Department's Contractor shall be disposed of by the Contractor, and the construction area shall be left in a neat and orderly condition.

All salvaged track material either existing or furnished by NSR is and shall remain the property of the NSR except as noted in the track to be removed section of the special provisions.

EXCAVATION

This work shall be performed in accordance with Section 225, "ROADWAY EXCAVATION" of the Standard Specifications. The applicable typical roadbed template will be maintained throughout the railway portion of the project.

Material excavated within the proximities of existing track(s), as defined in the table below, shall be used in embankment within the railroad right of way. Any of this material that is not used in construction of the project shall be disposed of within the railroad right of way within the project limits, and the contractor shall submit, to the Engineer for approval, a plan showing locations and methods of placement for this disposal. The limits where this requirement applies are:

Begin Station	End Station	Left Limit	Right Limit
10409+00	10440+00	20' LT of Centerline Existing Main Track	33' RT of Centerline Existing Main Track
10436+00	10440+00	20' LT of Centerline Existing Spur Track	20' RT of Centerline Existing Spur Track

Project: *TIP P-5208D***187**

County: Cabarrus

36" WELDED STEEL PIPE**(Special)****330-1 DESCRIPTION**

This work shall consist of furnishing and installing 36" welded steel pipe by trenchless methods as shown in the contract, plans and as directed. The thickness of the wall shall be 0.532 inches.

330-2 MATERIALS

Refer to Division 10.

Item

Welded Steel Pipe

Section

1032-5

Use suppliers of metal pipe culverts, fittings and all other accessories covered by this section that meet the Department's Brand Certification program requirements for metal pipe culverts and are listed on the Materials and Tests Unit's pre-approved list for suppliers of metal pipe culvert. The pre-approved list is available on the Department's website

330-3 PIPE INSTALLATION

Replace section 330-3 of the 2012 Standard Specifications with the following:

The pipe shall be installed by dry boring and jacking under the tracks as shown in the plans. The pipe shall be carefully dry bored true to the line and grade given. The bore shall be held to a minimum to insure that there will be no settlement. All voids around the outside of the pipe shall be completely filled to the satisfaction of the Engineer.

The Contractor shall submit to the Railroad Engineer and the NCDOT Engineer a complete plan and schedule for pipe installation 2 weeks prior to the expected commencement of work. The submission shall include complete details of the sheeting, shoring and bracing for the protection of Railroad roadbed, materials and equipment pertinent to the operation. The Contractor shall not proceed with the pipe installation until he has received acceptance of the plan and schedule from the Railroad Engineer and the NCDOT Engineer.

Conduct a pre-construction meeting in the presence of the Railroad Engineer and the Engineer at least 48 hours before the beginning of the pipe installation to discuss the method of installation to assure the pipe is installed true to line and grade. The methods that will be used to insure there is no settlement of the pipe or the railroad roadbed section above the pipe.

All work shall be done with a RWIC/flagman on site and the work shall be performed during allowable work periods. Work shall stop when a train is passing. The Contractor shall have no claim against the Railroad or the Department for any delays caused by NSR's train operations.

The boring operation shall be progressed on a 24-hour basis without stoppage (except for adding lengths of pipe) until the leading edge of the pipe has reached the receiving pit. The installation

shall be carried on without interruption, insofar as practicable, to prevent the pipe from becoming firmly set in the embankment.

The front of the pipe shall be provided with mechanical arrangements or devices that will positively prevent the auger from leading the pipe so that no unsupported excavation is ahead of the pipe.

The auger and cutting head arrangement shall be removable from within the pipe in the event an obstruction is encountered. If the obstruction cannot be removed without excavation in advance of the pipe, the pipe shall be abandoned in place and immediately filled with grout. A new installation procedure and revised plans must be submitted to, and approved by, the Engineering Representative before work can resume.

The over-cut by the cutting head shall not exceed the outside diameter of the pipe by more than 1/2 inch. If voids should develop or if the bored hole diameter is greater than the outside diameter of the pipe by more than 1 inch, the voids shall be pressure grouted.

When boring and jacking pipe 36 inches and larger in diameter and the boring is halted within a distance less than 20 feet to the centerline of track, the heading shall be shored and braced if the track is active.

Any pipe damaged during the operation shall be removed and replaced by the Contractor at his expense.

The pits or trenches excavated to facilitate the pipe installation shall be backfilled immediately after the installation has been completed.

330-4 MEASUREMENT AND PAYMENT

36" Welded Steel Pipe, 0.532" Thick, Grade B in Soil will be measured and paid as the actual number of linear feet of pipe measured along the flow line to the nearest foot, which has been installed in soil.

36" Welded Steel Pipe, 0.532" Thick, Grade B Not in Soil will be measured and paid as the actual number of linear feet of pipe measured along the flow line to the nearest foot which has been installed in non-soil, as observed and confirmed by the Engineer. Non-soil is defined as all material other than soil. The Contractor shall request and obtain the Engineer's observation and confirmation of the limits of the installation not in soil before and during the installation of the pipe or portion of the pipe not in soil.

Failure of the Contractor to request and obtain the Engineer's observation and confirmation of the limits of the pipe not in soil before and during the installation will result in the payment at the unit price for *36" Welded Steel Pipe, 0.532" Thick, Grade B in Soil*.

Such payment will include, but is not limited to, furnishing all labor, tools, equipment, materials and incidentals, miscellaneous grading or excavation necessary to complete the work.

Project: *TIP P-5208D***189**

County: Cabarrus

Installations that become damaged or are abandoned will be replaced at no cost to the Department.

Payment will be made under:

Pay Item	Pay Unit
36" Welded Steel Pipe, 0.532" Thick, Grade B in Soil	Linear Foot
36" Welded Steel Pipe, 0.532" Thick, Grade B Not in Soil	Linear Foot

36" WELDED STEEL PIPE, OPEN CUT (Special)
Station 10435+50

330-1 DESCRIPTION

This work shall consist of furnishing and installing 36" welded steel pipe, grade B, by Open Cut as shown in the contract, plans and as directed by the Engineer. The thickness of the wall shall be 0.532 inches. The pipe shall extend the proposed 36" WSP that is to be installed trenchless in accordance with the plans and specs at this location.

330-2 MATERIALS

Refer to Division 10.

Item	Section
Welded Steel Pipe	1032-5

Use suppliers of metal pipe culverts, fittings and all other accessories covered by this section that meet the Department's Brand Certification program requirements for metal pipe culverts and are listed on the Materials and Tests Unit's pre-approved list for suppliers of metal pipe culvert. The pre-approved list is available on the Department's website

Construction Methods

Install the pipe in accordance with the applicable requirements of Section 300 of the *Standard Specifications* and as directed by the Engineer.

Measurement and Payment

36" Welded Steel Pipe, 0.532" Thick, Grade B, Open Cut, will be measured and paid as the actual number of linear feet of pipe that has been incorporated into the completed and accepted work. Measurement of pipe will be made by counting the number of joints used and multiplying by the length of the joint to obtain the number of linear feet of pipe installed and accepted. Measurements of partial joints will be made along the longest length of the partial joint to the nearest 0.1 ft. Select bedding and backfill material will be included in the cost of the installed pipe.

Project: *TIP P-5208D***190**

County: Cabarrus

Payment will be made under:

Pay Item	Pay Unit
36" Welded Steel Pipe, 0.532" Thick, Grade B, Open Cut	Linear Foot

REMOVE EXISTING HEADWALLS (Special)

Description

The contractor shall remove existing headwalls at locations shown on the plans.

Construction Methods

The contractor shall remove and dispose of existing headwalls at locations shown on the plans after the pipes they are attached to are abandoned and filled with flowable fill in accordance with the Standard Specifications.

Measurement and Payment

Remove Existing Headwalls will be paid for in accordance with Section 226, Grading, of the Standard Specifications.

Pay Item	Pay Unit
Grading	Lump Sum (LS)

RAILROAD TRACK TO BE REMOVED (Special)

The Department's Contractor shall remove the existing spur track as shown in the plans and dispose of the materials appropriately in accordance with local regulations.

Description

Furnish the labor, materials, tools and equipment necessary to remove the existing track which includes the rail, cross ties, tie plates, anchors, spikes and disposal of the materials.

Ownership of Material

All salvaged material from the removal of the existing spur track shall remain the property of the Department's Contractor except for the wooden cross ties. The cross ties will remain the property of NSR and shall be removed and neatly stacked at a location directed by the Railroad Engineer. The contractor shall give consideration to the salvage value of the materials when making his bid.

Measurement and Payment

The quantity of "Railroad Track to be Removed", which is to be paid for, will be the actual number of track feet of track which is acceptably removed, measured between the rails along

Project: TIP P-5208D

191

County: Cabarrus

the center line of the track prior to the track being removed.

Payment will be made under:

Pay Item	Pay Unit
Railroad Track to be Removed	TF

EMBANKMENT

(Special)

This work shall be performed in accordance with Section 235, "EMBANKMENTS", of the Standard Specifications including the following:

All earth fills shall be made in uniform layers of not more than 6 inches thick after compaction. Rock may be placed in compacted layers of not more than 24 inches thick. Each fully compacted layer shall extend the full width of the cross section. Each layer shall be free from mud, snow, ice, or excessive (standing) water before a subsequent layer is placed.

Sandy or rocky material shall be spread in full width layers to form drainage planes from the center through the edge of the embankment. Pockets of open materials surrounded by more impervious material shall be avoided.

The fills shall be formed with suitable materials from on-site cuts and/or necessary suitable material from borrow pits. Organic material such as brush, stumps, roots and trees or other perishable items shall not be placed in embankments. Coal or organic shale shall not be included in the embankment. Bituminous material shall not be used in railroad embankment. In fill sections, after stripping the topsoil and organic material, the entire area which the embankment is to be placed shall be plowed and scarified for a minimum depth of 6 inches.

The initial lift and all future fill layers shall be compacted to 95 percent of maximum density per Standard Proctor in accordance with ASTM D698-T and AASHTO T 99, or 90 percent of maximum density per Modified Proctor in accordance with ASTM D-1557AASHTO T180, except that a minimum of the top **2 feet of fill shall be compacted to 100 percent Standard Proctor.**

The top 12 inches of the subgrade in all cut sections that will be cut to subgrade elevation shall be plowed, scarified and compacted to 100 percent Standard Proctor. The Engineer shall determine the AASHTO test method to be used after review of the soil analysis.

The Contractor shall notify the Engineer of when fill layers are ready for compaction testing. Successive layers shall not be placed prior to an acceptable density being obtained on each layer. The moisture content of the soil shall be controlled as necessary to obtain the specified densities based upon the optimum moisture content for each material. Water shall be added to the soil when, in the

opinion of the Engineer, additional moisture may be necessary to obtain the specified density. Soil that is too wet shall be allowed to dry or be worked by plowing, discing, harrowing, or other means to dry the material to a workable moisture content.

In the event a specified density is not obtained, the Engineer may order additional rolling, watering, or drying of the soil as necessary to obtain the specified density. Fill layers not meeting a specified density after additional working shall be removed and new material shall be placed and compacted to the specified density at no cost to the Department.

The Contractor may be restricted from using partial or completed roadbed as construction haul roads. Any embankment or roadbed that is damaged by hauling activities shall be repaired by the Contractor at no cost to the Department.

BITUMINOUS COATED CORRUGATED METAL PIPE (BCCMP) (Special)

DESCRIPTION

Furnish and install drainage pipe at locations and size called for in the contract documents. The work includes construction of joints and connections to other pipes, endwalls and drainage structures.

MATERIALS

Corrugated Steel Pipe

Corrugated steel culvert pipe and pipe arch shall meet ASTM A760, Type 1 pipe.

Corrugations shall be annular riveted with a profile of 2-2/3 inches x 1/2 inch unless otherwise specified.

Bituminous coating shall be applied to the inner and outer surfaces of the pipe and conform to the requirements of AASHTO M 190, Type A.

Coupling bands shall be one or two piece annular corrugated, made from galvanized steel and fully bituminous coated, with a minimum width of 24 inches. Bands may be one gage lighter than the pipe gage. Bands shall be made of steel sheet conforming to ASTM Specification A 525 and AASHTO Designation M 218. Dimple band couplers shall not be used.

Coupling bands shall be fastened using a minimum of three (3) 1/2 inch diameter galvanized bolts. Culverts 48 inches and larger require 24 inch wide bands with a minimum of four (4) 1/2 inch diameter rods and "silo" type lugs.

Acceptance

Acceptance of corrugated steel culvert pipe and its accessories will be based on, but not limited

Project: *TIP P-5208D***193**

County: Cabarrus

to, visual inspections, classification requirements and check samples taken from material delivered to the project and conformance to the annual Brand Registration. Culvert pipe materials not meeting the above requirements will be rejected, unless written approval is obtained from the State Materials Engineer.

310-3 PIPE INSTALLATION

Install pipe, pipe tees and elbows according to Section 300 of NCDOT Standard Specifications including the following:

BCCMP with a diameter of 42 inches or larger shall be field strutted (if not manufacturer strutted). Ties and struts shall be removed by the Contractor upon completion of the embankment.

Where BCCMP has to be cut to achieve the proper length, such cutting shall be done with an abrasive saw so as to prevent damage to the pipe coating. Flame cutting shall not be permitted. Damage to the shop coating by this or any other work shall be field repaired by the Contractor by using asphalt paint. Repairs shall be at no cost to the Department or the Railroad.

310-6 MEASUREMENT AND PAYMENT

Pipe will be measured and paid as the actual number of linear feet of pipe that has been incorporated into the completed and accepted work. Measurement of pipe will be made by counting the number of joints used and multiplying by the length of the joint to obtain the number of linear feet of pipe installed and accepted. Measurements of partial joints will be made along the longest length of the partial joint to the nearest 0.1 ft. Select bedding and backfill material will be included in the cost of the installed pipe.

Payment will be made under:

Pay Item	Pay Unit
___" B.C.C.M.P. Pipe Culverts, ___" Thick	Linear Foot

SUB-BALLAST**(Special)****Description**

The Contractor will furnish and place sub-ballast as shown in the plans. The sub-ballast shall be placed after the subgrade has been graded, compacted and accepted.

Materials

The sub-ballast shall be composed of crusher-run, meeting the following requirements and the gradation shown in Table 1:

- Sub ballast shall be produced from sound rock meeting the gradations shown in the table 1 (AASHTO T 27 and T 11, AASHTO T 88 as modified for Base Course and Stabilizer).
- The material shall be free from organics and deleterious material (AASHTO T 112).
- The material shall not have a Liquid Limit (LL) in excess of 25 (AASHTO T 89) or a Plasticity Index (PI) in excess of 6 (AASHTO T 90).
- The material shall have a percentage of wear (LA Abrasion, AASHTO T 96) no greater than 50 percent.
- The material shall meet NCDOT's soundness requirements (AASHTO T 104).

Sieve Size	Percent Passing Standard Sieve Size by Weight					
	2"	1"	3/8"	#10	#40	#200
Sub-ballast	100	90-100	50-84	26-50	12-30	5-12

Table 1**Sub-ballast****Construction Methods**

After the subgrade has been finished to proper grade and cross-section, the sub-ballast shall be placed on the subgrade with a mechanical spreader capable of placing the material in a uniform loose depth and without segregation, except for areas inaccessible to a mechanical spreader. The aggregate material may be placed by other methods approved by the Engineer. The sub-ballast section shall be constructed in two layers of equal thickness. Each layer of sub-ballast shall be fully compacted in lifts not to exceed 6" in thickness after compaction. Each layer of sub-ballast shall be compacted to a density of 100% of the Standard Proctor determined by AASHTO T 180 and maintained to the required cross-section during compaction. Moisture content shall be maintained within 2% +/- of optimum moisture to obtain the desired density. Water shall be added to the material if necessary to obtain the desired density. If the material is too wet to obtain the desired density, the material shall be worked by discing, harrowing or other means to dry the material to a workable moisture content.

195

Revised 3-26-13

Measurement and Payment

The quantity for *Sub-Ballast* to be paid for will be the actual number of tons of sub-ballast which has been used to construct the track roadbed sections, measured as provided for in Article 520-11 of the Standard Specifications. Such price and payment will be full compensation for all furnishing, weighing, hauling, and placing of sub-ballast and for any other work necessary for the construction of the track roadbed section.

Pay Item	Pay Unit
Sub-ballast	Ton

MAINTENANCE OF TRACK ROADBED

(Special)

The Contractor shall be responsible for the maintenance of the track roadbed during the construction period. Ditches and temporary pipes shall be provided and maintained as may be necessary to satisfactorily drain the sub-grade. Where previously approved sub-grade is damaged by natural causes, by hauling equipment or other traffic the Contractor shall restore the sub-grade to the required lines, grades and typical sections and to the required density at no additional cost to the Department. There will be no direct payment for maintenance of the track roadbed. All cost associated with maintaining the track roadbed will be incidental to other items of work.

PIPE REMOVAL

Remove the temporary 36” welded steel pipe as shown on the contract plans.

The work shall be performed in accordance with Section 340, “Pipe Removal”, of the Standard Specifications, except the contractor shall not leave the pipe in place or fill it with flowable fill. The pipe and associated headwalls shall be removed and the disturbed area backfilled in accordance with the Standard Specifications.