

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	42293.1.1 (B-5134)	1	10

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS
GEOTECHNICAL ENGINEERING UNIT

STRUCTURE
SUBSURFACE INVESTIGATION

PROJ. REFERENCE NO. 42293.1.1 (B-5134) F.A. PROJ. BRSTP-0200(2)
COUNTY UNION
PROJECT DESCRIPTION BRIDGE NO. 72 ON NC 200 OVER
CHINKAPIN CREEK

SITE DESCRIPTION _____

CONTENTS

<u>SHEET</u>	<u>DESCRIPTION</u>
1	TITLE SHEET
2	LEGEND
3	SITE PLAN
4	PROFILE
5-6	CROSS SECTIONS
7-8	BORE LOGS
9	SOIL TEST RESULTS
10	AERIAL PHOTO

CAUTION NOTICE

THE SUBSURFACE INFORMATION AND THE SUBSURFACE INVESTIGATION ON WHICH IT IS BASED WERE MADE FOR THE PURPOSE OF STUDY, PLANNING, AND DESIGN, AND NOT FOR CONSTRUCTION OR PAY PURPOSES. THE VARIOUS FIELD BORING LOGS, ROCK CORES, AND SOIL TEST DATA AVAILABLE MAY BE REVIEWED OR INSPECTED IN RALEIGH BY CONTACTING THE N. C. DEPARTMENT OF TRANSPORTATION, GEOTECHNICAL ENGINEERING UNIT AT (919) 250-4088. NEITHER THE SUBSURFACE PLANS AND REPORTS, NOR THE FIELD BORING LOGS, ROCK CORES, OR SOIL TEST DATA ARE PART OF THE CONTRACT.

GENERAL SOIL AND ROCK STRATA DESCRIPTIONS AND INDICATED BOUNDARIES ARE BASED ON A GEOTECHNICAL INTERPRETATION OF ALL AVAILABLE SUBSURFACE DATA AND MAY NOT NECESSARILY REFLECT THE ACTUAL SUBSURFACE CONDITIONS BETWEEN BORINGS OR BETWEEN SAMPLED STRATA WITHIN THE BOREHOLE. THE LABORATORY SAMPLE DATA AND THE IN SITU (IN-PLACE) TEST DATA CAN BE RELIED ON ONLY TO THE DEGREE OF RELIABILITY INHERENT IN THE STANDARD TEST METHOD. THE OBSERVED WATER LEVELS OR SOIL MOISTURE CONDITIONS INDICATED IN THE SUBSURFACE INVESTIGATIONS ARE AS RECORDED AT THE TIME OF THE INVESTIGATION. THESE WATER LEVELS OR SOIL MOISTURE CONDITIONS MAY VARY CONSIDERABLY WITH TIME ACCORDING TO CLIMATIC CONDITIONS INCLUDING TEMPERATURES, PRECIPITATION, AND WIND, AS WELL AS OTHER NON-CLIMATIC FACTORS.

THE BIDDER OR CONTRACTOR IS CAUTIONED THAT DETAILS SHOWN ON THE SUBSURFACE PLANS ARE PRELIMINARY ONLY AND IN MANY CASES THE FINAL DESIGN DETAILS ARE DIFFERENT. FOR BIDDING AND CONSTRUCTION PURPOSES, REFER TO THE CONSTRUCTION PLANS AND DOCUMENTS FOR FINAL DESIGN INFORMATION ON THIS PROJECT. THE DEPARTMENT DOES NOT WARRANT OR GUARANTEE THE SUFFICIENCY OR ACCURACY OF THE INVESTIGATION MADE, NOR THE INTERPRETATIONS MADE, OR OPINION OF THE DEPARTMENT AS TO THE TYPE OF MATERIALS AND CONDITIONS TO BE ENCOUNTERED. THE BIDDER OR CONTRACTOR IS CAUTIONED TO MAKE SUCH INDEPENDENT SUBSURFACE INVESTIGATIONS AS HE DEEMS NECESSARY TO SATISFY HIMSELF AS TO CONDITIONS TO BE ENCOUNTERED ON THIS PROJECT. THE CONTRACTOR SHALL HAVE NO CLAIM FOR ADDITIONAL COMPENSATION OR FOR AN EXTENSION OF TIME FOR ANY REASON RESULTING FROM THE ACTUAL CONDITIONS ENCOUNTERED AT THE SITE OFFERING FROM THOSE INDICATED IN THE SUBSURFACE INFORMATION.

PROJECT: 42293.1.1
ID: B-5134

PERSONNEL

C. L. SMITH


J. K. STICKNEY

INVESTIGATED BY J. E. BEVERLY

CHECKED BY C. B. LITTLE

SUBMITTED BY C. B. LITTLE

DATE JANUARY 2013

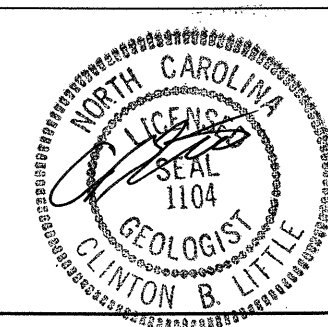

1-25-13

DRAWN BY: C. E. BURRIS

NOTE - THE INFORMATION CONTAINED HEREIN IS NOT IMPLIED OR GUARANTEED BY THE N. C. DEPARTMENT OF TRANSPORTATION AS BEING ACCURATE NOR IS IT CONSIDERED TO BE PART OF THE PLANS, SPECIFICATIONS, OR CONTRACT FOR THE PROJECT.

NOTE - BY HAVING REQUESTED THIS INFORMATION THE CONTRACTOR SPECIFICALLY WAIVES ANY CLAIMS FOR INCREASED COMPENSATION OR EXTENSION OF TIME BASED ON DIFFERENCES BETWEEN THE CONDITIONS INDICATED HEREIN AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
DIVISION OF HIGHWAYS
GEOTECHNICAL ENGINEERING UNIT

PROJECT REFERENCE NO. 42293.1.I (B-5)34	SHEET NO. 2
--	----------------

SUBSURFACE INVESTIGATION

SOIL AND ROCK LEGEND, TERMS, SYMBOLS, AND ABBREVIATIONS


SOIL DESCRIPTION	GRADATION	ROCK DESCRIPTION	TERMS AND DEFINITIONS																																																																																																																																														
<p>SOIL IS CONSIDERED TO BE THE UNCONSOLIDATED, SEMI-CONSOLIDATED, OR WEATHERED EARTH MATERIALS THAT CAN BE PENETRATED WITH A CONTINUOUS FLIGHT POWER AUGER, AND YIELD LESS THAN 100 BLOWS PER FOOT ACCORDING TO STANDARD PENETRATION TEST (AASHTO T206, ASTM D-1586). SOIL CLASSIFICATION IS BASED ON THE AASHTO SYSTEM. BASIC DESCRIPTIONS GENERALLY SHALL INCLUDE: CONSISTENCY, COLOR, TEXTURE, MOISTURE, AASHTO CLASSIFICATION, AND OTHER PERTINENT FACTORS SUCH AS MINERALOGICAL COMPOSITION, ANGULARITY, STRUCTURE, PLASTICITY, ETC. EXAMPLE:</p> <p style="text-align: center;"><i>VERY STIFF, GRAV. SILTY CLAY, MOST WITH INTERBEDDED FINE SAND LAYERS, HIGHLY PLASTIC, A-7-6</i></p>	<p>WELL GRADED - INDICATES A GOOD REPRESENTATION OF PARTICLE SIZES FROM FINE TO COARSE. UNIFORM - INDICATES THAT SOIL PARTICLES ARE ALL APPROXIMATELY THE SAME SIZE. (ALSO POORLY GRADED)</p> <p>GAP-GRADED - INDICATES A MIXTURE OF UNIFORM PARTICLES OF TWO OR MORE SIZES.</p> <p style="text-align: center;">ANGULARITY OF GRAINS</p> <p>THE ANGULARITY OR ROUNDNESS OF SOIL GRAINS IS DESIGNATED BY THE TERMS: ANGULAR, SUBANGULAR, SUBROUNDED, OR ROUNDED.</p>	<p>HARD ROCK IS NON-COASTAL PLAIN MATERIAL THAT IF TESTED, WOULD YIELD SPT REFUSAL. AN INFERRED ROCK LINE INDICATES THE LEVEL AT WHICH NON-COASTAL PLAIN MATERIAL WOULD YIELD SPT REFUSAL. SPT REFUSAL IS PENETRATION BY A SPLIT SPOON SAMPLER EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS. IN NON-COASTAL PLAIN MATERIAL, THE TRANSITION BETWEEN SOIL AND ROCK IS OFTEN REPRESENTED BY A ZONE OF WEATHERED ROCK. ROCK MATERIALS ARE TYPICALLY DIVIDED AS FOLLOWS:</p> <p>WEATHERED ROCK (WR) NON-COASTAL PLAIN MATERIAL THAT WOULD YIELD SPT N VALUES > 100 BLOWS PER FOOT IF TESTED.</p> <p>CRYSTALLINE ROCK (CR) FINE TO COARSE GRAIN IGNEOUS AND METAMORPHIC ROCK THAT WOULD YIELD SPT REFUSAL IF TESTED. ROCK TYPE INCLUDES GRANITE, GNEISS, GABBRO, SCHIST, ETC.</p> <p>NON-CRYSTALLINE ROCK (NCR) FINE TO COARSE GRAIN METAMORPHIC AND NON-COASTAL PLAIN SEDIMENTARY ROCK THAT WOULD YIELD SPT REFUSAL IF TESTED. ROCK TYPE INCLUDES PHYLLITE, SLATE, SANDSTONE, ETC.</p> <p>COASTAL PLAIN SEDIMENTARY ROCK (CP) COASTAL PLAIN SEDIMENTS CEMENTED INTO ROCK, BUT MAY NOT YIELD SPT REFUSAL. ROCK TYPE INCLUDES LIMESTONE, SANDSTONE, CEMENTED SHELL BEDS, ETC.</p>	<p>ALLUVIUM (ALLUV.) - SOILS THAT HAVE BEEN TRANSPORTED BY WATER.</p> <p>AQUIFER - A WATER BEARING FORMATION OR STRATA.</p> <p>ARENACEOUS - APPLIED TO ROCKS THAT HAVE BEEN DERIVED FROM SAND OR THAT CONTAIN SAND.</p> <p>ARGILLACEOUS - APPLIED TO ALL ROCKS OR SUBSTANCES COMPOSED OF CLAY MINERALS, OR HAVING A NOTABLE PROPORTION OF CLAY IN THEIR COMPOSITION, AS SHALE, SLATE, ETC.</p> <p>ARTESIAN - GROUND WATER THAT IS UNDER SUFFICIENT PRESSURE TO RISE ABOVE THE LEVEL AT WHICH IT IS ENCOUNTERED, BUT WHICH DOES NOT NECESSARILY RISE TO OR ABOVE THE GROUND SURFACE.</p> <p>CALCAREOUS (CALC.) - SOILS THAT CONTAIN APPRECIABLE AMOUNTS OF CALCIUM CARBONATE.</p> <p>COLLUVIUM - ROCK FRAGMENTS MIXED WITH SOIL DEPOSITED BY GRAVITY ON SLOPE OR AT BOTTOM OF SLOPE.</p> <p>CORE RECOVERY (REC.) - TOTAL LENGTH OF ALL MATERIAL RECOVERED IN THE CORE BARREL DIVIDED BY TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE.</p> <p>DIKE - A TABULAR BODY OF IGNEOUS ROCK THAT CUTS ACROSS THE STRUCTURE OF ADJACENT ROCKS OR CUTS MASSIVE ROCK.</p> <p>DIP - THE ANGLE AT WHICH A STRATUM OR ANY PLANAR FEATURE IS INCLINED FROM THE HORIZONTAL.</p> <p>DIP DIRECTION (DIP AZIMUTH) - THE DIRECTION OR BEARING OF THE HORIZONTAL TRACE OF THE LINE OF DIP, MEASURED CLOCKWISE FROM NORTH.</p> <p>FAULT - A FRACTURE OR FRACTURE ZONE ALONG WHICH THERE HAS BEEN DISPLACEMENT OF THE SIDES RELATIVE TO ONE ANOTHER PARALLEL TO THE FRACTURE.</p> <p>FISSILE - A PROPERTY OF SPLITTING ALONG CLOSELY SPACED PARALLEL PLANES.</p> <p>FLOAT - ROCK FRAGMENTS ON SURFACE NEAR THEIR ORIGINAL POSITION AND DISLODGED FROM PARENT MATERIAL.</p> <p>FLOOD PLAIN (FP) - LAND BORDERING A STREAM, BUILT OF SEDIMENTS DEPOSITED BY THE STREAM.</p> <p>FORMATION (FM.) - A MAPPABLE GEOLOGIC UNIT THAT CAN BE RECOGNIZED AND TRACED IN THE FIELD.</p> <p>JOINT - FRACTURE IN ROCK ALONG WHICH NO APPRECIABLE MOVEMENT HAS OCCURRED.</p> <p>LEDGE - A SHELF-LIKE RIDGE OR PROJECTION OF ROCK WHOSE THICKNESS IS SMALL COMPARED TO ITS LATERAL EXTENT.</p> <p>LENS - A BODY OF SOIL OR ROCK THAT THINS OUT IN ONE OR MORE DIRECTIONS.</p> <p>MOTTLED (MOT.) - IRREGULARLY MARKED WITH SPOTS OF DIFFERENT COLORS. MOTTLING IN SOILS USUALLY INDICATES POOR AERATION AND LACK OF GOOD DRAINAGE.</p> <p>PERCHED WATER - WATER MAINTAINED ABOVE THE NORMAL GROUND WATER LEVEL BY THE PRESENCE OF AN INTERVENING IMPERVIOUS STRATUM.</p> <p>RESIDUAL (RES.) SOIL - SOIL FORMED IN PLACE BY THE WEATHERING OF ROCK.</p> <p>ROCK QUALITY DESIGNATION (RQD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF CORE RUN AND EXPRESSED AS A PERCENTAGE.</p> <p>SAPROLITE (SAP.) - RESIDUAL SOIL THAT RETAINS THE RELIC STRUCTURE OR FABRIC OF THE PARENT ROCK.</p> <p>SILL - AN INTRUSIVE BODY OF IGNEOUS ROCK OF APPROXIMATELY UNIFORM THICKNESS AND RELATIVELY THIN COMPARED WITH ITS LATERAL EXTENT, THAT HAS BEEN EMPLACED PARALLEL TO THE BEDDING OR SCHISTOSITY OF THE INTRUDED ROCKS.</p> <p>SLICKENSIDE - POLISHED AND STRIATED SURFACE THAT RESULTS FROM FRICTION ALONG A FAULT OR SLIP PLANE.</p> <p>STANDARD PENETRATION TEST (PENETRATION RESISTANCE) (SPT) - NUMBER OF BLOWS IN OR BPF OF A 140 LB. HAMMER FALLING 30 INCHES REQUIRED TO PRODUCE A PENETRATION OF 1 FOOT INTO SOIL WITH A 2 INCH OUTSIDE DIAMETER SPLIT SPOON SAMPLER. SPT REFUSAL IS PENETRATION EQUAL TO OR LESS THAN 0.1 FOOT PER 60 BLOWS.</p> <p>STRATA CORE RECOVERY (SCREC.) - TOTAL LENGTH OF STRATA MATERIAL RECOVERED DIVIDED BY TOTAL LENGTH OF STRATUM AND EXPRESSED AS A PERCENTAGE.</p> <p>STRATA ROCK QUALITY DESIGNATION (SRQD) - A MEASURE OF ROCK QUALITY DESCRIBED BY TOTAL LENGTH OF ROCK SEGMENTS WITHIN A STRATUM EQUAL TO OR GREATER THAN 4 INCHES DIVIDED BY THE TOTAL LENGTH OF STRATA AND EXPRESSED AS A PERCENTAGE.</p> <p>TOPSOIL (TS.) - SURFACE SOILS USUALLY CONTAINING ORGANIC MATTER.</p>																																																																																																																																														
<p style="text-align: center;">SOIL LEGEND AND AASHTO CLASSIFICATION</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>GENERAL CLASS.</th> <th>GRANULAR MATERIALS (<= 35% PASSING #200)</th> <th>SILT-CLAY MATERIALS (> 35% PASSING #200)</th> <th>ORGANIC MATERIALS</th> </tr> </thead> <tbody> <tr> <td>GROUP CLASS.</td> <td>A-1, A-3, A-2-4, A-2-5, A-2-6, A-2-7</td> <td>A-4, A-5, A-6, A-7</td> <td>A-1, A-2, A-3, A-4, A-5, A-6, A-7</td> </tr> <tr> <td>SYMBOL</td> <td></td> <td></td> <td></td> </tr> <tr> <td>% PASSING</td> <td>50, 60, 70, 80, 90, 100</td> <td>10, 20, 30, 40, 50, 60, 70, 80, 90, 100</td> <td>10, 20, 30, 40, 50, 60, 70, 80, 90, 100</td> </tr> <tr> <td>LIQUID LIMIT PLASTIC INDEX</td> <td>6, 10, 15, 20, 25, 30</td> <td>4, 8, 12, 16, 20, 24, 28, 32, 36, 40, 44, 48, 52, 56, 60, 64, 68, 72, 76, 80, 84, 88, 92, 96, 100</td> <td>10, 20, 30, 40, 50, 60, 70, 80, 90, 100</td> </tr> <tr> <td>GROUP INDEX</td> <td>0, 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100</td> <td></td> <td></td> </tr> <tr> <td>USUAL TYPES OF MAJOR MATERIALS</td> <td>STONE FRAGS, GRAVEL, AND SAND</td> <td>FINE SAND, SILTY OR CLAYEY GRAVEL AND SAND</td> <td>SILTY SOILS, CLAYEY SOILS</td> </tr> <tr> <td>GEN. RATINGS AS A SUBGRADE</td> <td>EXCELLENT TO GOOD</td> <td>FAIR TO POOR</td> <td>FAIR TO POOR, POOR, UNSUITABLE</td> </tr> </tbody> </table> <p style="text-align: center;">PI OF A-7-5 SUBGROUP IS ≤ LL - 30 ; PI OF A-7-6 SUBGROUP IS > LL - 30</p>	GENERAL CLASS.	GRANULAR MATERIALS (<= 35% PASSING #200)	SILT-CLAY MATERIALS (> 35% PASSING #200)	ORGANIC MATERIALS	GROUP CLASS.	A-1, A-3, A-2-4, A-2-5, A-2-6, A-2-7	A-4, A-5, A-6, A-7	A-1, A-2, A-3, A-4, A-5, A-6, A-7	SYMBOL				% PASSING	50, 60, 70, 80, 90, 100	10, 20, 30, 40, 50, 60, 70, 80, 90, 100	10, 20, 30, 40, 50, 60, 70, 80, 90, 100	LIQUID LIMIT PLASTIC INDEX	6, 10, 15, 20, 25, 30	4, 8, 12, 16, 20, 24, 28, 32, 36, 40, 44, 48, 52, 56, 60, 64, 68, 72, 76, 80, 84, 88, 92, 96, 100	10, 20, 30, 40, 50, 60, 70, 80, 90, 100	GROUP INDEX	0, 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100			USUAL TYPES OF MAJOR MATERIALS	STONE FRAGS, GRAVEL, AND SAND	FINE SAND, SILTY OR CLAYEY GRAVEL AND SAND	SILTY SOILS, CLAYEY SOILS	GEN. RATINGS AS A SUBGRADE	EXCELLENT TO GOOD	FAIR TO POOR	FAIR TO POOR, POOR, UNSUITABLE	<p style="text-align: center;">MINERALOGICAL COMPOSITION</p> <p>MINERAL NAMES SUCH AS QUARTZ, FELDSPAR, MICA, TALC, KAOLIN, ETC. ARE USED IN DESCRIPTIONS WHENEVER THEY ARE CONSIDERED OF SIGNIFICANCE.</p> <p style="text-align: center;">COMPRESSIBILITY</p> <p>SLIGHTLY COMPRESSIBLE LIQUID LIMIT LESS THAN 31 MODERATELY COMPRESSIBLE LIQUID LIMIT EQUAL TO 31-50 HIGHLY COMPRESSIBLE LIQUID LIMIT GREATER THAN 50</p> <p style="text-align: center;">PERCENTAGE OF MATERIAL</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>ORGANIC MATERIAL</th> <th>GRANULAR SOILS</th> <th>SILT - CLAY SOILS</th> <th>OTHER MATERIAL</th> </tr> </thead> <tbody> <tr> <td>TRACE OF ORGANIC MATTER</td> <td>2 - 3%</td> <td>3 - 5%</td> <td>TRACE</td> </tr> <tr> <td>LITTLE ORGANIC MATTER</td> <td>3 - 5%</td> <td>5 - 12%</td> <td>LITTLE</td> </tr> <tr> <td>MODERATELY ORGANIC</td> <td>5 - 10%</td> <td>12 - 20%</td> <td>SOME</td> </tr> <tr> <td>HIGHLY ORGANIC</td> <td>>10%</td> <td>>20%</td> <td>HIGHLY</td> </tr> <tr> <td></td> <td></td> <td></td> <td>35% AND ABOVE</td> </tr> </tbody> </table> <p style="text-align: center;">GROUND WATER</p> <p>▽ WATER LEVEL IN BORE HOLE IMMEDIATELY AFTER DRILLING ▽ STATIC WATER LEVEL AFTER 24 HOURS ▽ PW PERCHED WATER, SATURATED ZONE, OR WATER BEARING STRATA ○ SPRING OR SEEP</p> <p style="text-align: center;">MISCELLANEOUS SYMBOLS</p> <p> ROADWAY EMBANKMENT (RE) WITH SOIL DESCRIPTION SOIL SYMBOL ARTIFICIAL FILL (AF) OTHER THAN ROADWAY EMBANKMENT INFERRERD SOIL BOUNDARY INFERRERD ROCK LINE ALLUVIAL SOIL BOUNDARY DIP & DIP DIRECTION OF ROCK STRUCTURES</p> <p> SPT TEST BORING AUGER BORING CORE BORING MONITORING WELL PIEZOMETER INSTALLATION SLOPE INDICATOR INSTALLATION CONE PENETROMETER TEST SOUNDING ROD</p> <p> TEST BORING W/ CORE SPT N-VALUE SPT REFUSAL</p>	ORGANIC MATERIAL	GRANULAR SOILS	SILT - CLAY SOILS	OTHER MATERIAL	TRACE OF ORGANIC MATTER	2 - 3%	3 - 5%	TRACE	LITTLE ORGANIC MATTER	3 - 5%	5 - 12%	LITTLE	MODERATELY ORGANIC	5 - 10%	12 - 20%	SOME	HIGHLY ORGANIC	>10%	>20%	HIGHLY				35% AND ABOVE	<p style="text-align: center;">ROCK HARDNESS</p> <p>VERY HARD CANNOT BE SCRATCHED BY KNIFE OR SHARP PICK. BREAKING OF HAND SPECIMENS REQUIRES SEVERAL HARD BLOWS OF THE GEOLOGIST'S PICK.</p> <p>HARD CAN BE SCRATCHED BY KNIFE OR PICK ONLY WITH DIFFICULTY. HARD HAMMER BLOWS REQUIRED TO DETACH HAND SPECIMEN.</p> <p>MODERATELY HARD CAN BE SCRATCHED BY KNIFE OR PICK. GOUGES OR GROOVES TO 0.25 INCHES DEEP CAN BE EXCAVATED BY HARD BLOW OF A GEOLOGIST'S PICK. HAND SPECIMENS CAN BE DETACHED BY MODERATE BLOWS.</p> <p>MEDIUM HARD CAN BE GROOVED OR GOUGED 0.05 INCHES DEEP BY FIRM PRESSURE OF KNIFE OR PICK POINT. CAN BE EXCAVATED IN SMALL CHIPS TO PIECES 1 INCH MAXIMUM SIZE BY HARD BLOWS OF THE POINT OF A GEOLOGIST'S PICK.</p> <p>SOFT CAN BE GROOVED OR GOUGED READILY BY KNIFE OR PICK. CAN BE EXCAVATED IN FRAGMENTS FROM CHIPS TO SEVERAL INCHES IN SIZE BY MODERATE BLOWS OF A PICK POINT. SMALL, THIN PIECES CAN BE BROKEN BY FINGER PRESSURE.</p> <p>VERY SOFT CAN BE CARVED WITH KNIFE. CAN BE EXCAVATED READILY WITH POINT OF PICK. PIECES 1 INCH OR MORE IN THICKNESS CAN BE BROKEN BY FINGER PRESSURE. CAN BE SCRATCHED READILY BY FINGER NAIL.</p>	<p style="text-align: center;">TEXTURE OR GRAIN SIZE</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>U.S. STD. SIEVE SIZE OPENING (MM)</th> <th>4</th> <th>10</th> <th>40</th> <th>60</th> <th>200</th> <th>270</th> </tr> </thead> <tbody> <tr> <td>BOULDER (BLDR.)</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> <tr> <td>COBBLE (COB.)</td> <td></td> <td>4.76</td> <td>2.00</td> <td>0.42</td> <td>0.25</td> <td>0.075</td> </tr> <tr> <td>GRAVEL (GR.)</td> <td></td> <td></td> <td>2.0</td> <td>0.25</td> <td>0.075</td> <td>0.005</td> </tr> <tr> <td>COARSE SAND (CSE. SD.)</td> <td></td> <td></td> <td></td> <td>0.25</td> <td>0.075</td> <td>0.005</td> </tr> <tr> <td>FINE SAND (F. SD.)</td> <td></td> <td></td> <td></td> <td></td> <td>0.075</td> <td>0.005</td> </tr> <tr> <td>SILT (SL.)</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td>0.005</td> </tr> <tr> <td>CLAY (CL.)</td> <td></td> <td></td> <td></td> <td></td> <td></td> <td></td> </tr> </tbody> </table> <p style="text-align: center;">SOIL MOISTURE - CORRELATION OF TERMS</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>SOIL MOISTURE SCALE (ATTERBERG LIMITS)</th> <th>FIELD MOISTURE DESCRIPTION</th> <th>GUIDE FOR FIELD MOISTURE DESCRIPTION</th> </tr> </thead> <tbody> <tr> <td>LL - LIQUID LIMIT</td> <td>- SATURATED - (SAT.)</td> <td>USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE</td> </tr> <tr> <td>PL - PLASTIC LIMIT</td> <td>- WET - (W)</td> <td>SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE</td> </tr> <tr> <td>OM - OPTIMUM MOISTURE</td> <td>- MOIST - (M)</td> <td>SOLID; AT OR NEAR OPTIMUM MOISTURE</td> </tr> <tr> <td>SL - SHRINKAGE LIMIT</td> <td>- DRY - (D)</td> <td>REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE</td> </tr> </tbody> </table> <p style="text-align: center;">PLASTICITY</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>NONPLASTIC</th> <th>PLASTICITY INDEX (PI)</th> <th>DRY STRENGTH</th> </tr> </thead> <tbody> <tr> <td>LOW PLASTICITY</td> <td>0-5</td> <td>VERY LOW</td> </tr> <tr> <td>MED. PLASTICITY</td> <td>6-15</td> <td>SLIGHT</td> </tr> <tr> <td>HIGH PLASTICITY</td> <td>16-25</td> <td>MEDIUM</td> </tr> <tr> <td></td> <td>26 OR MORE</td> <td>HIGH</td> </tr> </tbody> </table> <p style="text-align: center;">COLOR</p> <p>DESCRIPTIONS MAY INCLUDE COLOR OR COLOR COMBINATIONS (TAN, RED, YELLOW-BROWN, BLUE-GRAY). MODIFIERS SUCH AS LIGHT, DARK, STREAKED, ETC. ARE USED TO DESCRIBE APPEARANCE.</p>	U.S. STD. SIEVE SIZE OPENING (MM)	4	10	40	60	200	270	BOULDER (BLDR.)							COBBLE (COB.)		4.76	2.00	0.42	0.25	0.075	GRAVEL (GR.)			2.0	0.25	0.075	0.005	COARSE SAND (CSE. SD.)				0.25	0.075	0.005	FINE SAND (F. SD.)					0.075	0.005	SILT (SL.)						0.005	CLAY (CL.)							SOIL MOISTURE SCALE (ATTERBERG LIMITS)	FIELD MOISTURE DESCRIPTION	GUIDE FOR FIELD MOISTURE DESCRIPTION	LL - LIQUID LIMIT	- SATURATED - (SAT.)	USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE	PL - PLASTIC LIMIT	- WET - (W)	SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE	OM - OPTIMUM MOISTURE	- MOIST - (M)	SOLID; AT OR NEAR OPTIMUM MOISTURE	SL - SHRINKAGE LIMIT	- DRY - (D)	REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE	NONPLASTIC	PLASTICITY INDEX (PI)	DRY STRENGTH	LOW PLASTICITY	0-5	VERY LOW	MED. PLASTICITY	6-15	SLIGHT	HIGH PLASTICITY	16-25	MEDIUM		26 OR MORE	HIGH
GENERAL CLASS.	GRANULAR MATERIALS (<= 35% PASSING #200)	SILT-CLAY MATERIALS (> 35% PASSING #200)	ORGANIC MATERIALS																																																																																																																																														
GROUP CLASS.	A-1, A-3, A-2-4, A-2-5, A-2-6, A-2-7	A-4, A-5, A-6, A-7	A-1, A-2, A-3, A-4, A-5, A-6, A-7																																																																																																																																														
SYMBOL																																																																																																																																																	
% PASSING	50, 60, 70, 80, 90, 100	10, 20, 30, 40, 50, 60, 70, 80, 90, 100	10, 20, 30, 40, 50, 60, 70, 80, 90, 100																																																																																																																																														
LIQUID LIMIT PLASTIC INDEX	6, 10, 15, 20, 25, 30	4, 8, 12, 16, 20, 24, 28, 32, 36, 40, 44, 48, 52, 56, 60, 64, 68, 72, 76, 80, 84, 88, 92, 96, 100	10, 20, 30, 40, 50, 60, 70, 80, 90, 100																																																																																																																																														
GROUP INDEX	0, 1, 2, 3, 4, 5, 6, 7, 8, 9, 10, 11, 12, 13, 14, 15, 16, 17, 18, 19, 20, 21, 22, 23, 24, 25, 26, 27, 28, 29, 30, 31, 32, 33, 34, 35, 36, 37, 38, 39, 40, 41, 42, 43, 44, 45, 46, 47, 48, 49, 50, 51, 52, 53, 54, 55, 56, 57, 58, 59, 60, 61, 62, 63, 64, 65, 66, 67, 68, 69, 70, 71, 72, 73, 74, 75, 76, 77, 78, 79, 80, 81, 82, 83, 84, 85, 86, 87, 88, 89, 90, 91, 92, 93, 94, 95, 96, 97, 98, 99, 100																																																																																																																																																
USUAL TYPES OF MAJOR MATERIALS	STONE FRAGS, GRAVEL, AND SAND	FINE SAND, SILTY OR CLAYEY GRAVEL AND SAND	SILTY SOILS, CLAYEY SOILS																																																																																																																																														
GEN. RATINGS AS A SUBGRADE	EXCELLENT TO GOOD	FAIR TO POOR	FAIR TO POOR, POOR, UNSUITABLE																																																																																																																																														
ORGANIC MATERIAL	GRANULAR SOILS	SILT - CLAY SOILS	OTHER MATERIAL																																																																																																																																														
TRACE OF ORGANIC MATTER	2 - 3%	3 - 5%	TRACE																																																																																																																																														
LITTLE ORGANIC MATTER	3 - 5%	5 - 12%	LITTLE																																																																																																																																														
MODERATELY ORGANIC	5 - 10%	12 - 20%	SOME																																																																																																																																														
HIGHLY ORGANIC	>10%	>20%	HIGHLY																																																																																																																																														
			35% AND ABOVE																																																																																																																																														
U.S. STD. SIEVE SIZE OPENING (MM)	4	10	40	60	200	270																																																																																																																																											
BOULDER (BLDR.)																																																																																																																																																	
COBBLE (COB.)		4.76	2.00	0.42	0.25	0.075																																																																																																																																											
GRAVEL (GR.)			2.0	0.25	0.075	0.005																																																																																																																																											
COARSE SAND (CSE. SD.)				0.25	0.075	0.005																																																																																																																																											
FINE SAND (F. SD.)					0.075	0.005																																																																																																																																											
SILT (SL.)						0.005																																																																																																																																											
CLAY (CL.)																																																																																																																																																	
SOIL MOISTURE SCALE (ATTERBERG LIMITS)	FIELD MOISTURE DESCRIPTION	GUIDE FOR FIELD MOISTURE DESCRIPTION																																																																																																																																															
LL - LIQUID LIMIT	- SATURATED - (SAT.)	USUALLY LIQUID; VERY WET, USUALLY FROM BELOW THE GROUND WATER TABLE																																																																																																																																															
PL - PLASTIC LIMIT	- WET - (W)	SEMISOLID; REQUIRES DRYING TO ATTAIN OPTIMUM MOISTURE																																																																																																																																															
OM - OPTIMUM MOISTURE	- MOIST - (M)	SOLID; AT OR NEAR OPTIMUM MOISTURE																																																																																																																																															
SL - SHRINKAGE LIMIT	- DRY - (D)	REQUIRES ADDITIONAL WATER TO ATTAIN OPTIMUM MOISTURE																																																																																																																																															
NONPLASTIC	PLASTICITY INDEX (PI)	DRY STRENGTH																																																																																																																																															
LOW PLASTICITY	0-5	VERY LOW																																																																																																																																															
MED. PLASTICITY	6-15	SLIGHT																																																																																																																																															
HIGH PLASTICITY	16-25	MEDIUM																																																																																																																																															
	26 OR MORE	HIGH																																																																																																																																															
<p style="text-align: center;">ABBREVIATIONS</p> <p>AR - AUGER REFUSAL BT - BORING TERMINATED CL - CLAY CPT - CONE PENETRATION TEST CSE - COARSE DMT - DILATOMETER TEST DPT - DYNAMIC PENETRATION TEST e - VOID RATIO F - FINE FOSS. - FOSSILIFEROUS FRAC. - FRACTURED, FRACTURES FRAGS. - FRAGMENTS HL - HIGHLY</p> <p>MED. - MEDIUM MICA - MICACEOUS MOD. - MODERATELY NP - NON PLASTIC ORG. - ORGANIC PMT - PRESSUREMETER TEST SAP. - SAPROLITIC SD. - SAND, SANDY SL. - SILT, SILTY SLI. - SLIGHTLY TCR - TRICONE REFUSAL w - MOISTURE CONTENT V - VERY</p> <p>VST - VANE SHEAR TEST WE. - WEATHERED W - UNIT WEIGHT W_d - DRY UNIT WEIGHT</p> <p style="text-align: center;">SAMPLE ABBREVIATIONS</p> <p>S - BULK SS - SPLIT SPOON ST - SHELBY TUBE RS - ROCK RT - RECOMPACTED TRIAXIAL RATIO CBR - CALIFORNIA BEARING RATIO</p>	<p style="text-align: center;">EQUIPMENT USED ON SUBJECT PROJECT</p> <p>DRILL UNITS: <input type="checkbox"/> MOBILE B-____ <input type="checkbox"/> BK-51 <input type="checkbox"/> CME-45C <input checked="" type="checkbox"/> CME-550 <input type="checkbox"/> PORTABLE HOIST</p> <p>ADVANCING TOOLS: <input type="checkbox"/> CLAY BITS <input type="checkbox"/> 6" CONTINUOUS FLIGHT AUGER <input type="checkbox"/> 8" HOLLOW AUGERS <input type="checkbox"/> HARD FACED FINGER BITS <input type="checkbox"/> TUNG-CARBIDE INSERTS <input checked="" type="checkbox"/> CASING <input checked="" type="checkbox"/> W/ ADVANCER <input type="checkbox"/> TRICONE _____ *STEEL TEETH <input checked="" type="checkbox"/> TRICONE 2 1/8" *TUNG-CARB. <input type="checkbox"/> CORE BIT</p> <p>HAMMER TYPE: <input checked="" type="checkbox"/> AUTOMATIC <input type="checkbox"/> MANUAL</p> <p>CORE SIZE: <input type="checkbox"/> -B____ <input type="checkbox"/> -N____ <input type="checkbox"/> -H____</p> <p>HAND TOOLS: <input type="checkbox"/> POST HOLE DIGGER <input type="checkbox"/> HAND AUGER <input type="checkbox"/> SOUNDING ROD <input type="checkbox"/> VANE SHEAR TEST</p>	<p style="text-align: center;">FRACTURE SPACING</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>TERM</th> <th>SPACING</th> </tr> </thead> <tbody> <tr> <td>VERY WIDE</td> <td>MORE THAN 10 FEET</td> </tr> <tr> <td>WIDE</td> <td>3 TO 10 FEET</td> </tr> <tr> <td>MODERATELY CLOSE</td> <td>1 TO 3 FEET</td> </tr> <tr> <td>CLOSE</td> <td>0.16 TO 1 FEET</td> </tr> <tr> <td>VERY CLOSE</td> <td>LESS THAN 0.16 FEET</td> </tr> </tbody> </table> <p style="text-align: center;">BEDDING</p> <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th>TERM</th> <th>THICKNESS</th> </tr> </thead> <tbody> <tr> <td>VERY THICKLY BEDDED</td> <td>> 4 FEET</td> </tr> <tr> <td>THICKLY BEDDED</td> <td>1.5 - 4 FEET</td> </tr> <tr> <td>THINLY BEDDED</td> <td>0.16 - 1.5 FEET</td> </tr> <tr> <td>VERY THINLY BEDDED</td> <td>0.03 - 0.16 FEET</td> </tr> <tr> <td>THICKLY LAMINATED</td> <td>0.008 - 0.03 FEET</td> </tr> <tr> <td>THINLY LAMINATED</td> <td>< 0.008 FEET</td> </tr> </tbody> </table> <p style="text-align: center;">INDURATION</p> <p>FOR SEDIMENTARY ROCKS, INDURATION IS THE HARDENING OF THE MATERIAL BY CEMENTING, HEAT, PRESSURE, ETC.</p> <p>FRIABLE RUBBING WITH FINGER FREES NUMEROUS GRAINS; GENTLE BLOW BY HAMMER DISINTEGRATES SAMPLE.</p> <p>MODERATELY INDURATED GRAINS CAN BE SEPARATED FROM SAMPLE WITH STEEL PROBE; BREAKS EASILY WHEN HIT WITH HAMMER.</p> <p>INDURATED GRAINS ARE DIFFICULT TO SEPARATE WITH STEEL PROBE; DIFFICULT TO BREAK WITH HAMMER.</p> <p>EXTREMELY INDURATED SHARP HAMMER BLOWS REQUIRED TO BREAK SAMPLE; SAMPLE BREAKS ACROSS GRAINS.</p>	TERM	SPACING	VERY WIDE	MORE THAN 10 FEET	WIDE	3 TO 10 FEET	MODERATELY CLOSE	1 TO 3 FEET	CLOSE	0.16 TO 1 FEET	VERY CLOSE	LESS THAN 0.16 FEET	TERM	THICKNESS	VERY THICKLY BEDDED	> 4 FEET	THICKLY BEDDED	1.5 - 4 FEET	THINLY BEDDED	0.16 - 1.5 FEET	VERY THINLY BEDDED	0.03 - 0.16 FEET	THICKLY LAMINATED	0.008 - 0.03 FEET	THINLY LAMINATED	< 0.008 FEET	<p style="text-align: center;">BENCH MARK: BM 1 RAIL ROAD SPIKE IN TELEPHONE POLE</p> <p>STA. 13+08.08 31.42 LT -L- N 477062.3500 E 152126.4600 ELEVATION: 497.29 FT.</p> <p>NOTES: STRATIGRAPHY SHOWN THROUGH BORINGS</p> <p>CAR = CASING ADVANCER REFUSAL</p>																																																																																																																				
TERM	SPACING																																																																																																																																																
VERY WIDE	MORE THAN 10 FEET																																																																																																																																																
WIDE	3 TO 10 FEET																																																																																																																																																
MODERATELY CLOSE	1 TO 3 FEET																																																																																																																																																
CLOSE	0.16 TO 1 FEET																																																																																																																																																
VERY CLOSE	LESS THAN 0.16 FEET																																																																																																																																																
TERM	THICKNESS																																																																																																																																																
VERY THICKLY BEDDED	> 4 FEET																																																																																																																																																
THICKLY BEDDED	1.5 - 4 FEET																																																																																																																																																
THINLY BEDDED	0.16 - 1.5 FEET																																																																																																																																																
VERY THINLY BEDDED	0.03 - 0.16 FEET																																																																																																																																																
THICKLY LAMINATED	0.008 - 0.03 FEET																																																																																																																																																
THINLY LAMINATED	< 0.008 FEET																																																																																																																																																

CITY OF MONROE
(LAKE TWITTY)
DB 237 PG 279
DB 240 PG 210

GRIFFIN RAYMOND III, LLC
DB 4088 PG 868


-L- Sta. 13+00.00
Begin TIP Project B-5134

NANCY B. GRIFFIN
DB 302 PG 395

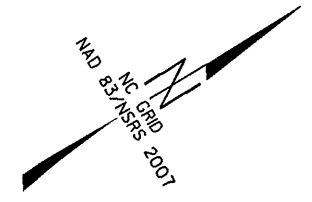

-L-
PI Sta 18+42.73
 $\Delta = 6^{\circ} 04' 41.5''$ (LT)
D = 2' 14' 48.8"
L = 270.52'
T = 135.38'
R = 2,550.00'


JERRY LANE BAUCOM
CAROL P. BAUCOM
DB 302 PG 675

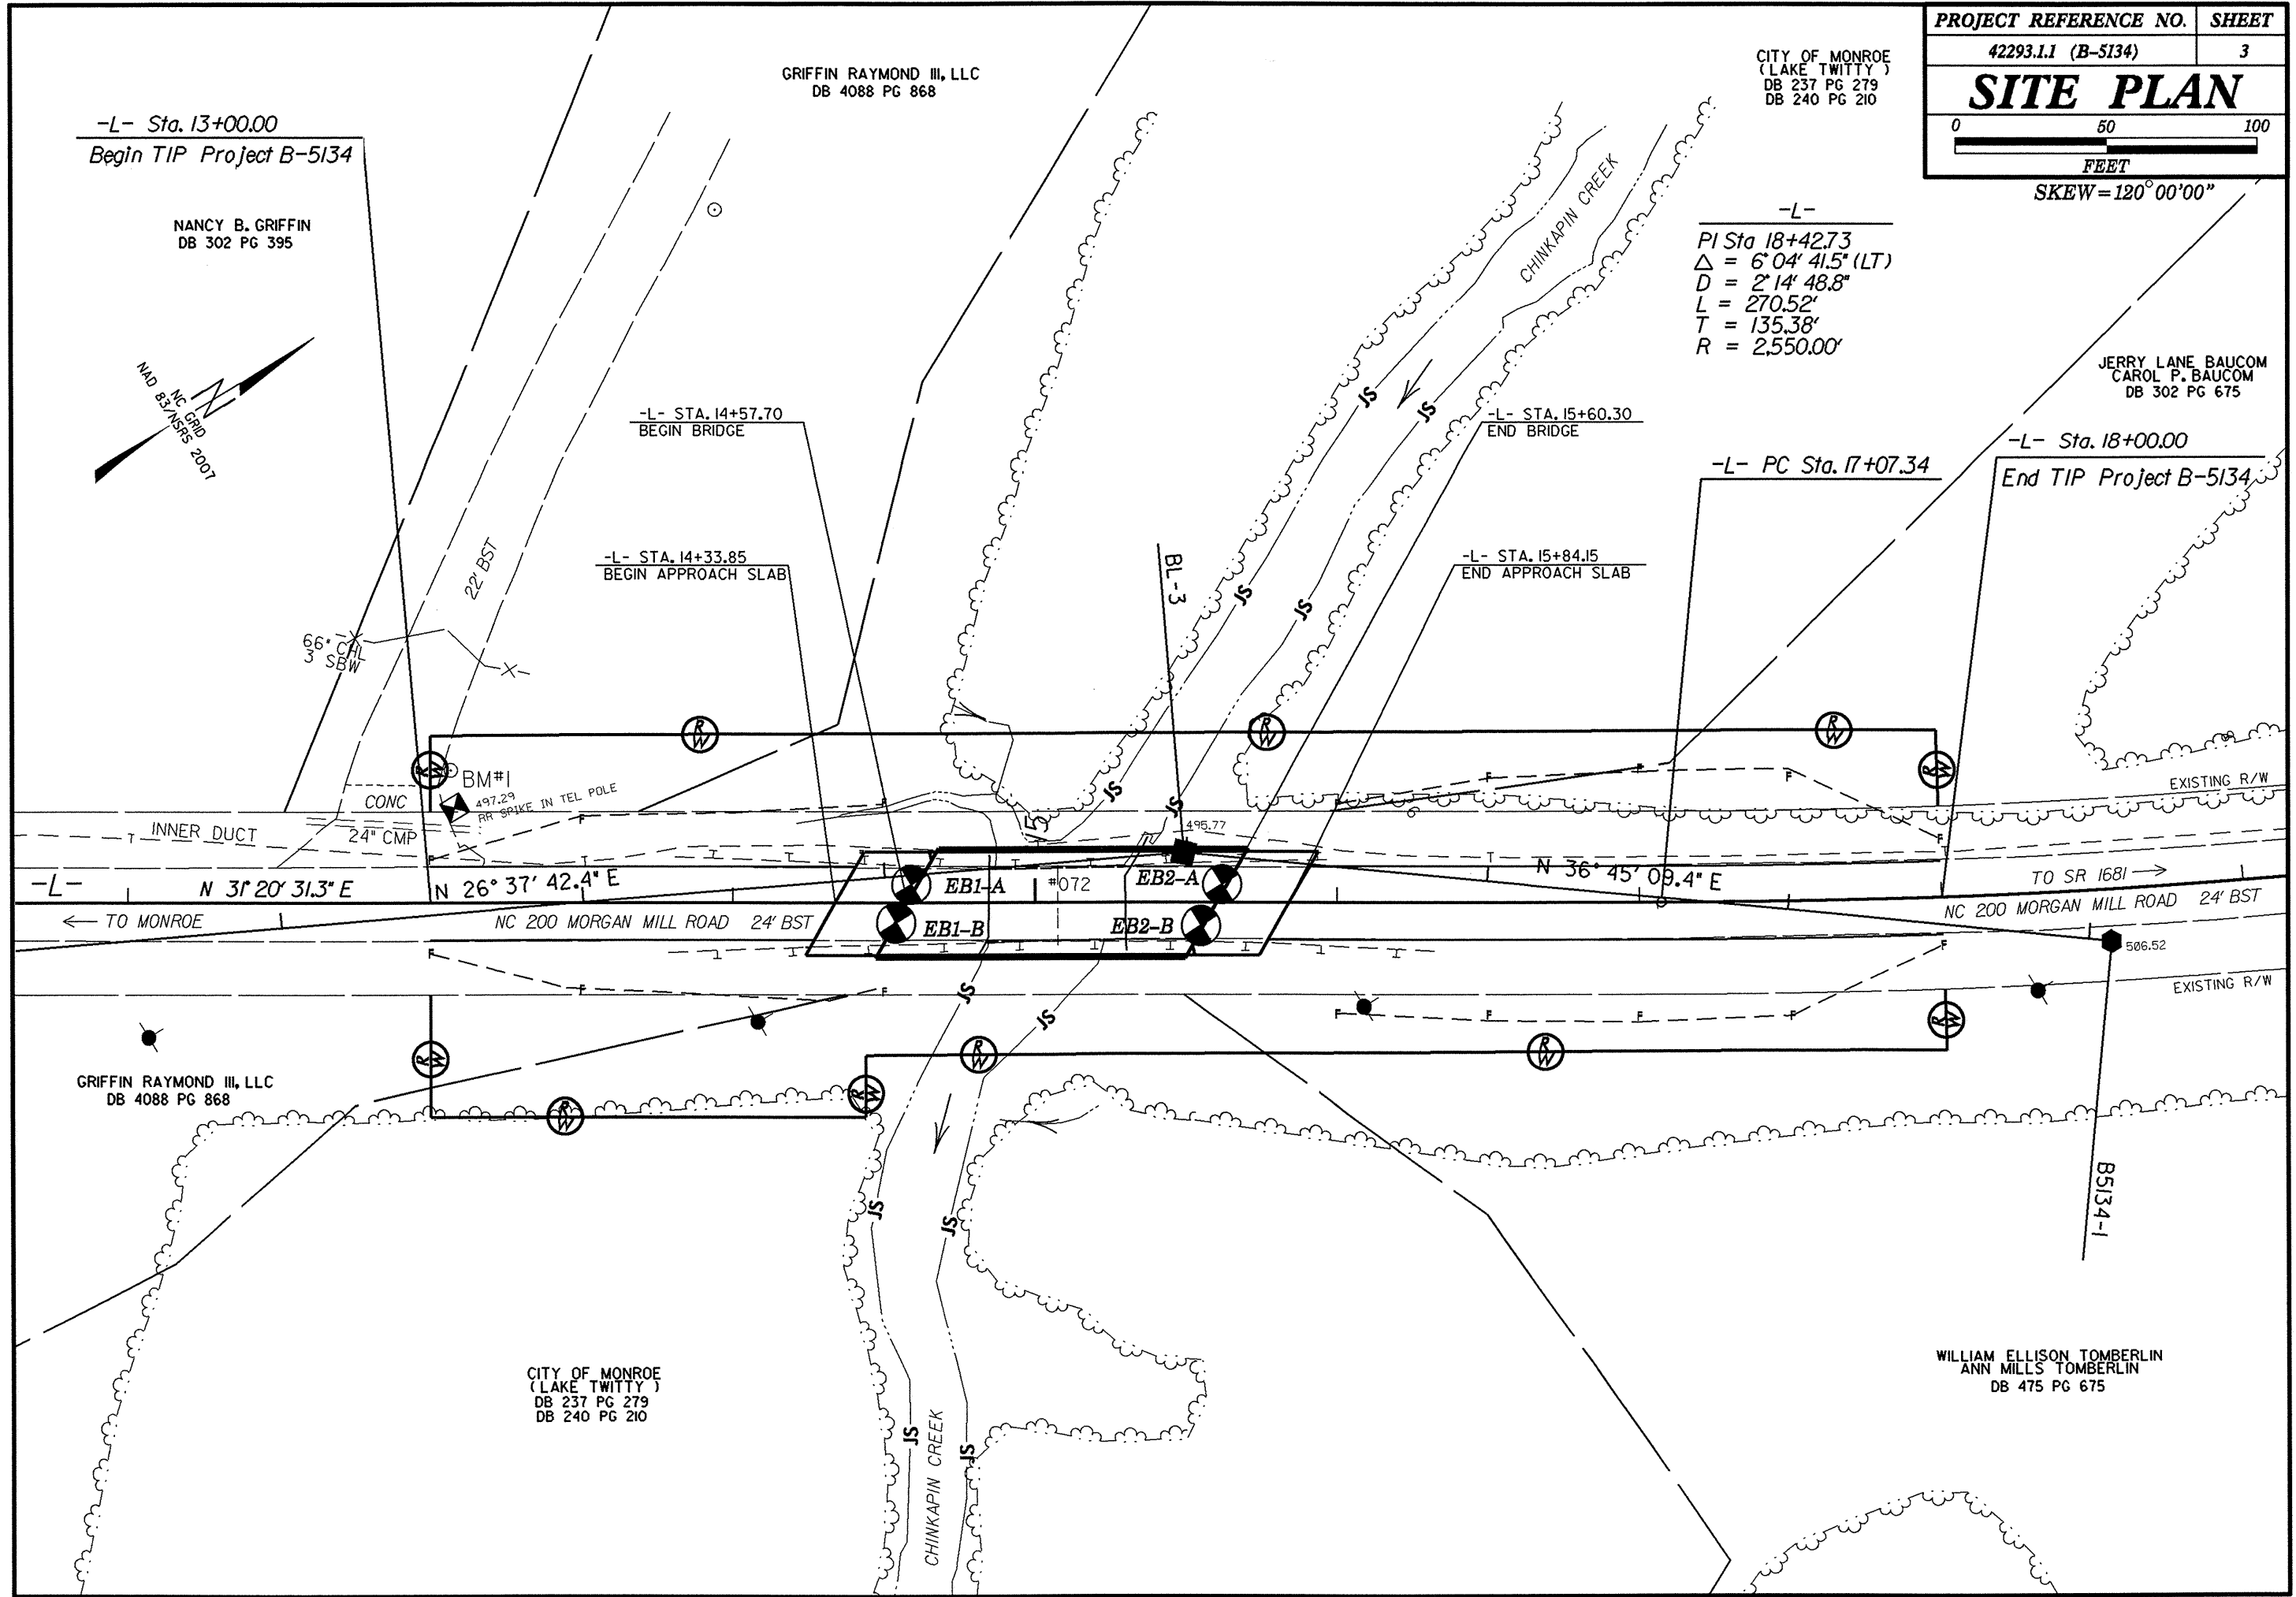


GRIFFIN RAYMOND III, LLC
DB 4088 PG 868

CITY OF MONROE
(LAKE TWITTY)
DB 237 PG 279
DB 240 PG 210


WILLIAM ELLISON TOMBERLIN
ANN MILLS TOMBERLIN
DB 475 PG 675

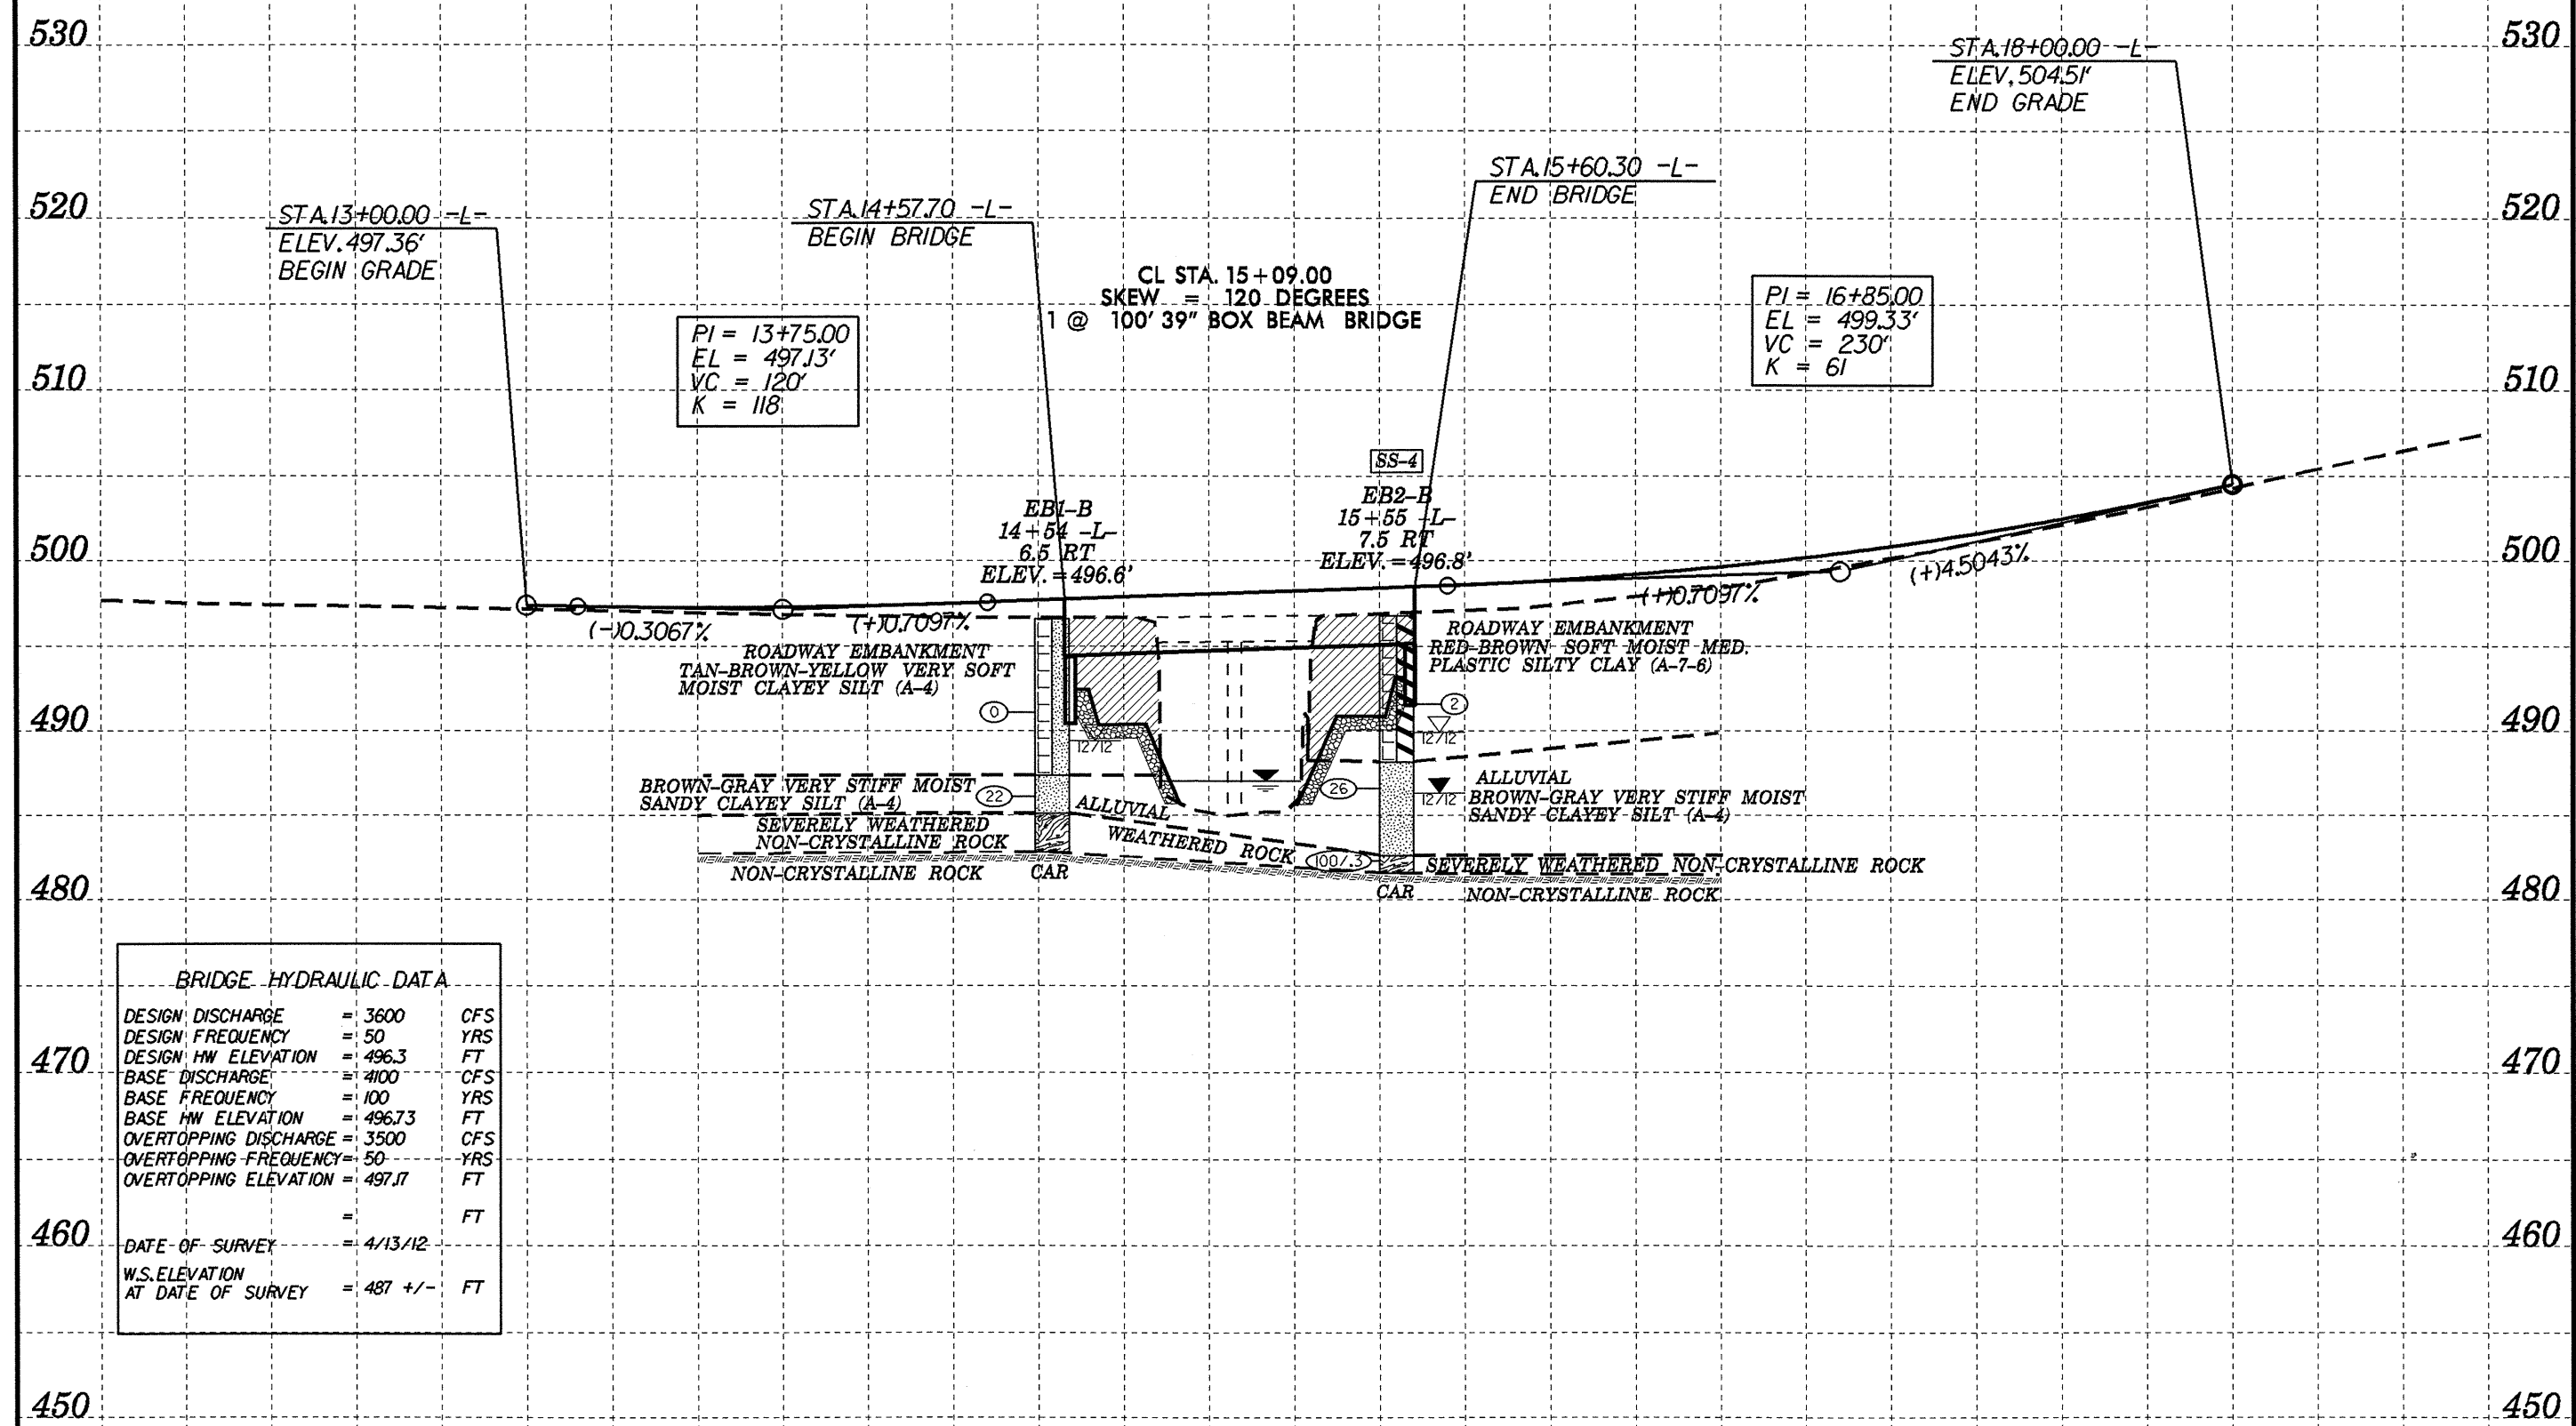


BRIDGE HYDRAULIC DATA		
DESIGN DISCHARGE	= 3600	CFS
DESIGN FREQUENCY	= 50	YRS
DESIGN HW ELEVATION	= 496.3	FT
BASE DISCHARGE	= 4100	CFS
BASE FREQUENCY	= 100	YRS
BASE HW ELEVATION	= 496.73	FT
OVERTOPPING DISCHARGE	= 3500	CFS
OVERTOPPING FREQUENCY	= 50	YRS
OVERTOPPING ELEVATION	= 497.17	FT
DATE OF SURVEY	= 4/13/12	FT
W.S. ELEVATION AT DATE OF SURVEY	= 487 +/-	FT

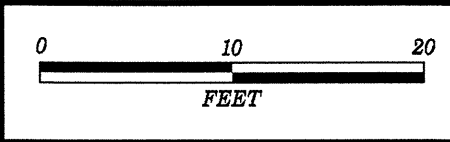


PROJECT REFERENCE NO.	SHEET
42293.1.1 (B-5134)	5
SECTION THROUGH EB-1 STA. 14+57.70 -L- SKEW=120°00'00"	

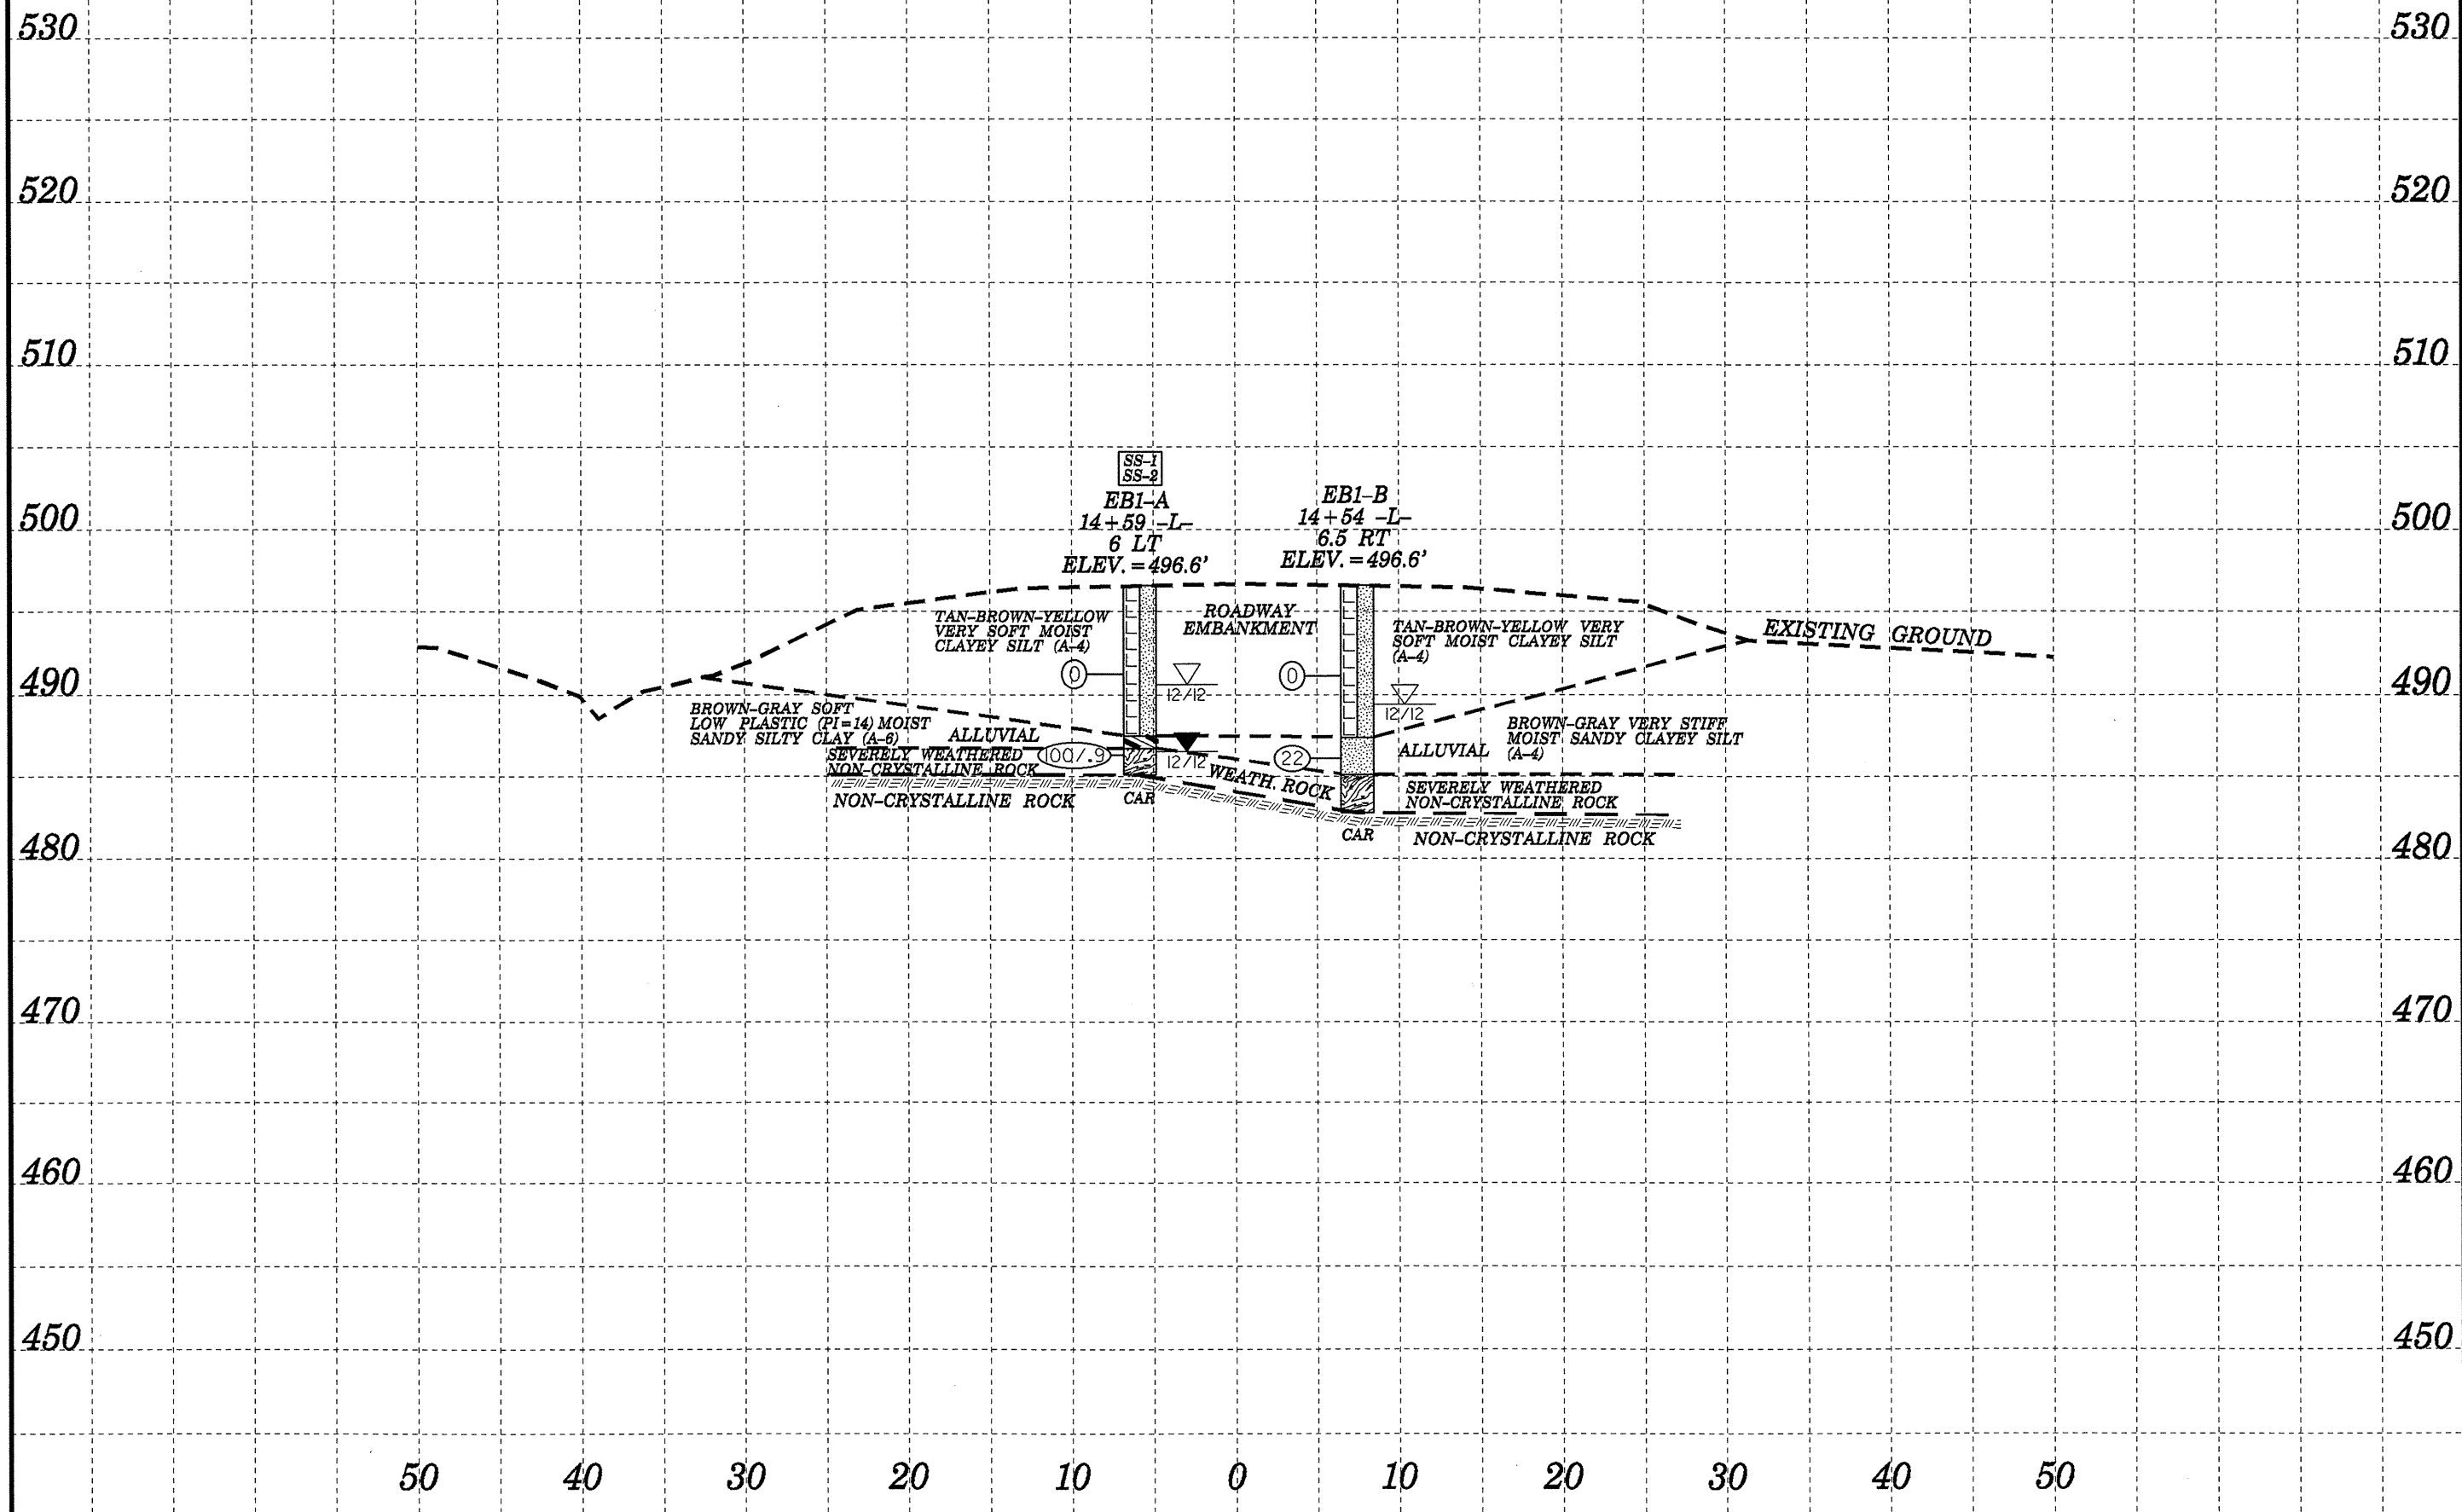

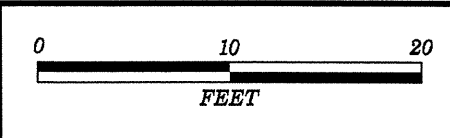

PROJECT REFERENCE NO.	SHEET
42293.1.1 (B-5134)	6
SECTION THROUGH EB-2	
STA. 15+60.30 -L-	
SKEW = 120° 00' 00"	

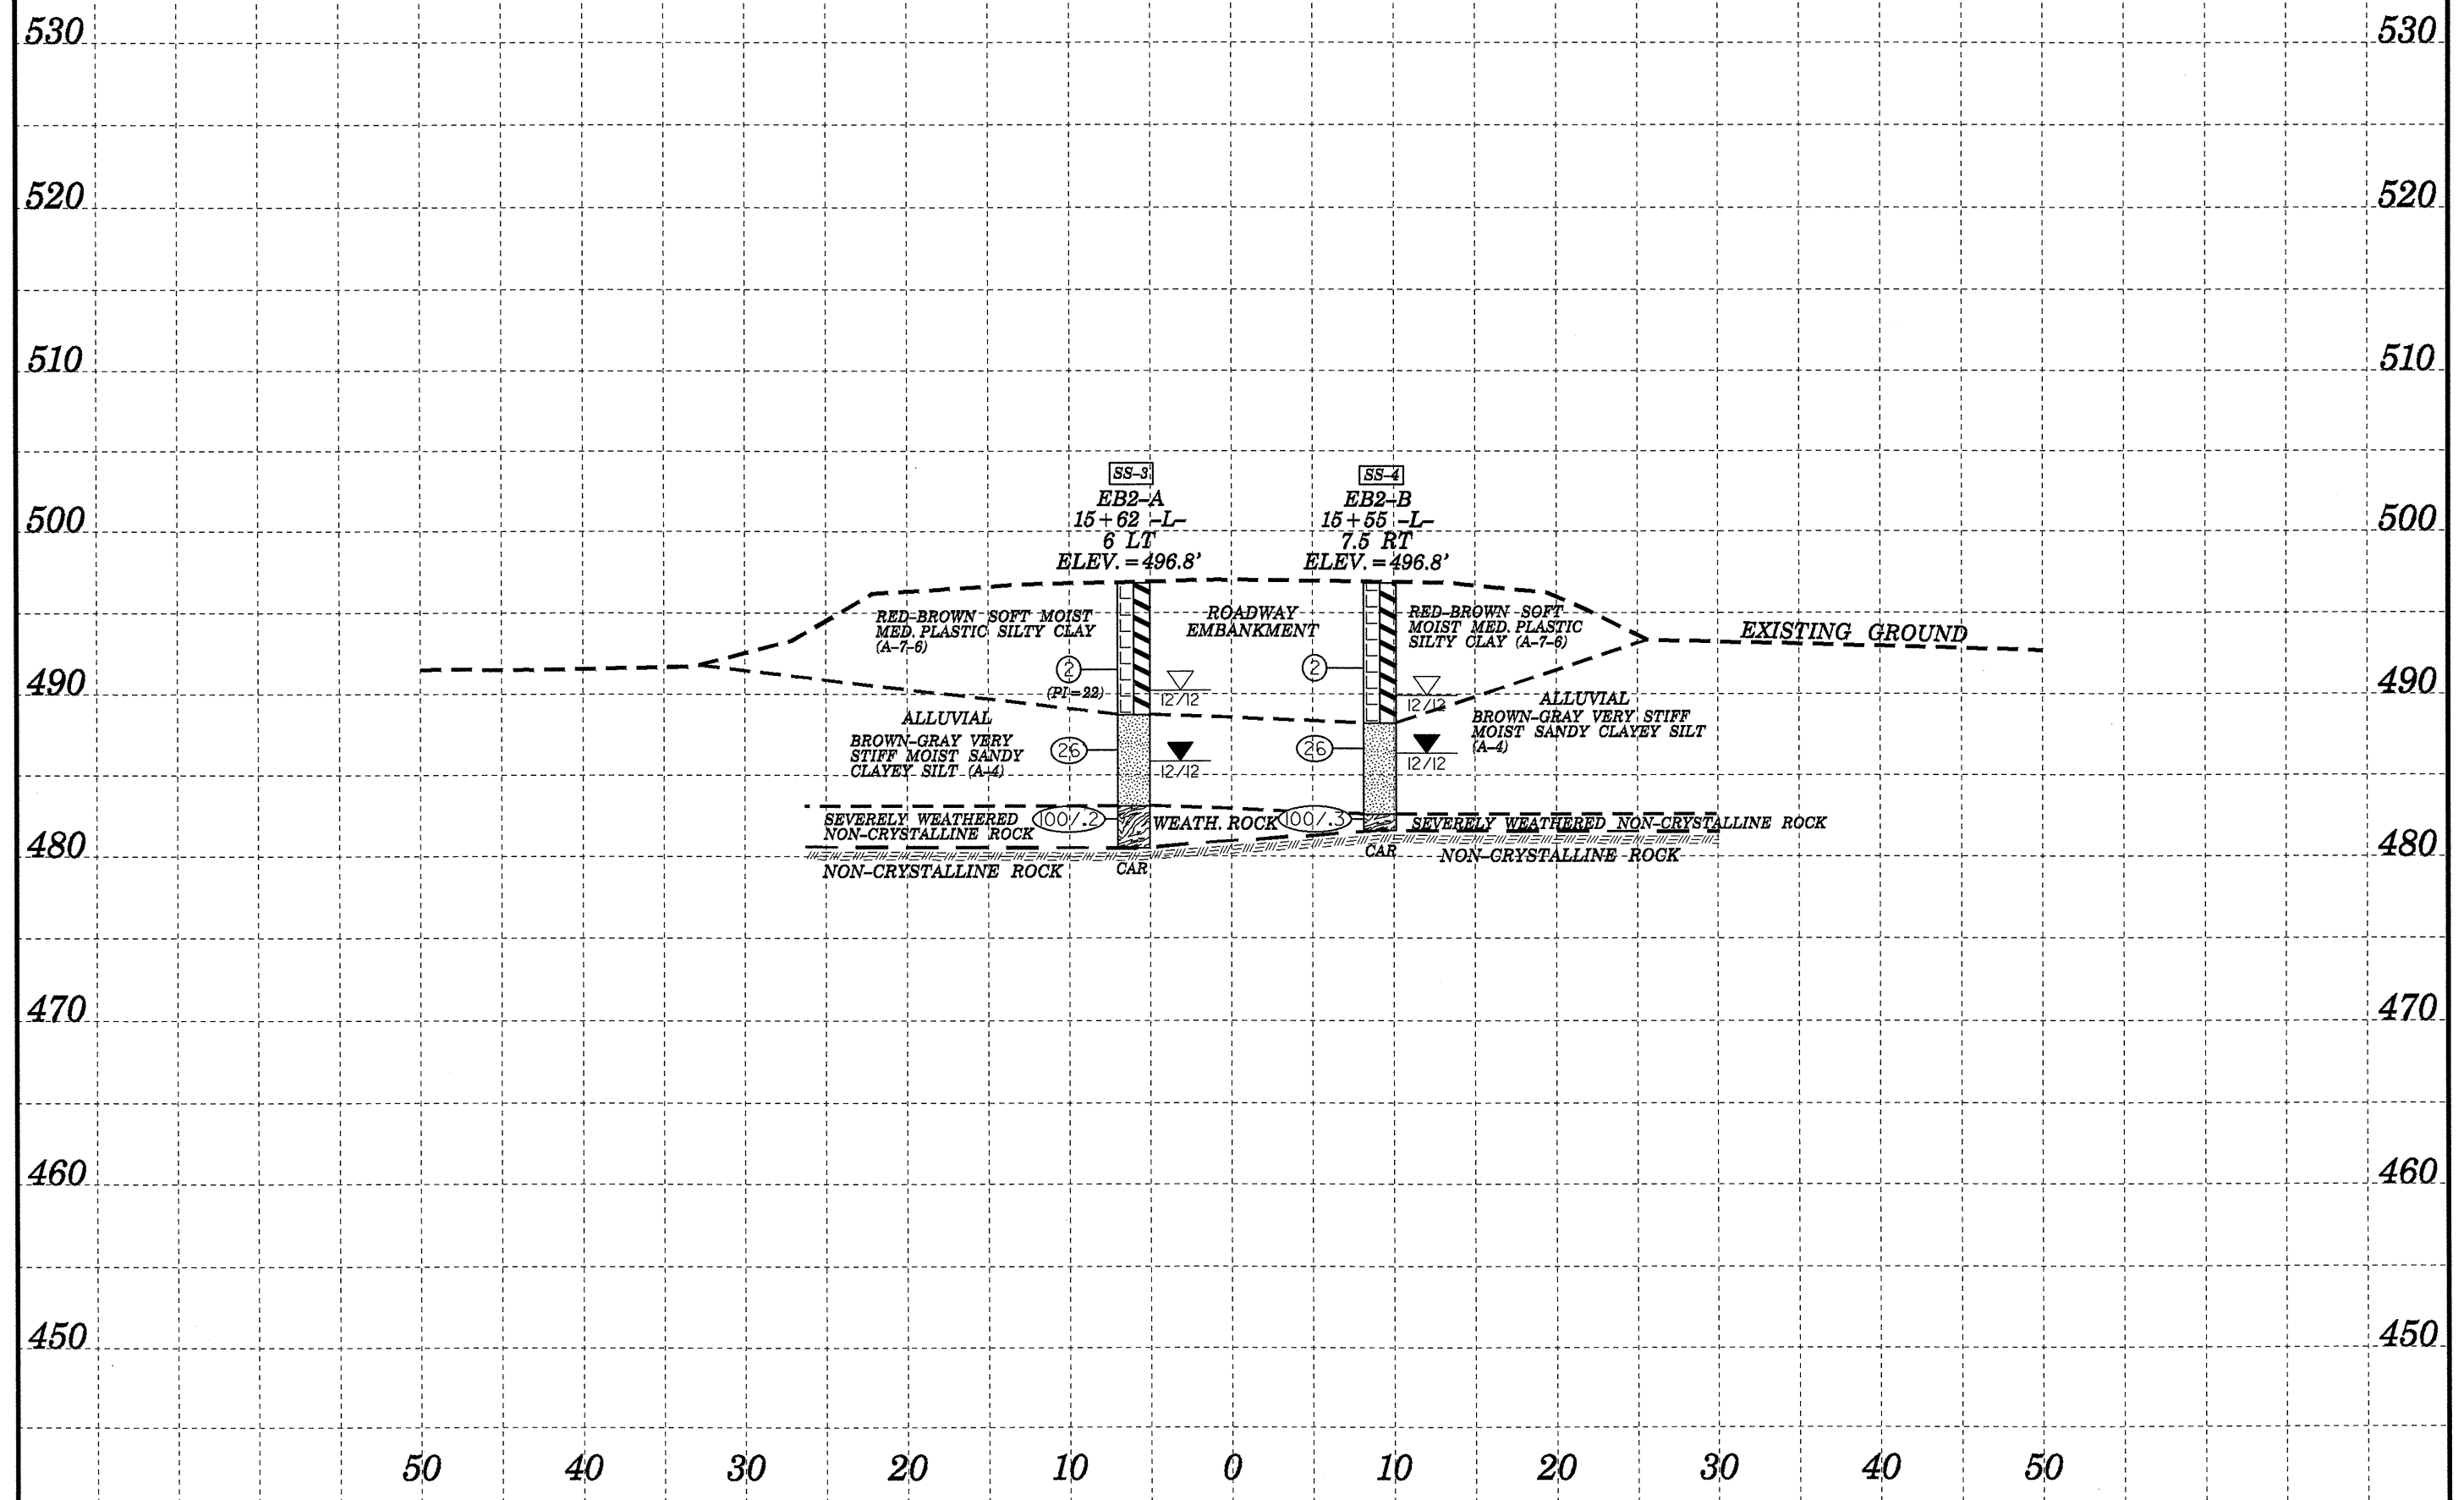

WBS 42293.1.1		TIP B5134		COUNTY UNION		GEOLOGIST Stickney, J. K.										
SITE DESCRIPTION Bridge #72 on NC 200 over Chinkapin Creek							GROUND WTR (ft)									
BORING NO. EB1-A		STATION 14+59		OFFSET 6 ft LT		ALIGNMENT -L-										
COLLAR ELEV. 496.6 ft		TOTAL DEPTH 11.5 ft		NORTHING 477,178		EASTING 1,552,227										
DRILL RIG/HAMMER EFF./DATE HFO0064 CME-550 88% 09/02/2009		DRILL METHOD NW Casing w/ Advancer		HAMMER TYPE Automatic												
DRILLER Smith, C. L.		START DATE 12/06/12		COMP. DATE 12/06/12		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)	
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
500																
495																
490	492.2	4.4	0	0	0							SS-1	W		496.6	0.0
	487.2	9.4	4	96/4								SS-2	M		487.5	9.1
															486.7	9.9
															485.1	11.5
<p>ROADWAY EMBANKMENT TAN-BROWN-YELLOW VERY SOFT MOIST CLAYEY SILT (A-4)</p> <p>ALLUVIAL BROWN-GRAY SOFT LOW PLASTIC (PI=14) MOIST SANDY SILTY CLAY (A-6)</p> <p>WEATHERED ROCK SEVERELY WEATHERED NON-CRYSTALLINE ROCK</p> <p>Boring Terminated with Casing Advancer Refusal at Elevation 485.1 ft on non-crystalline rock</p>																

NCDOT BORE SINGLE B5134_GEO_BH_BRD0072_UNION.GPJ NC_DOT_GDT_17713

WBS 42293.1.1		TIP B5134		COUNTY UNION		GEOLOGIST Stickney, J. K.										
SITE DESCRIPTION Bridge #72 on NC 200 over Chinkapin Creek							GROUND WTR (ft)									
BORING NO. EB1-B		STATION 14+54		OFFSET 7 ft RT		ALIGNMENT -L-										
COLLAR ELEV. 496.6 ft		TOTAL DEPTH 13.8 ft		NORTHING 477,167		EASTING 1,552,235										
DRILL RIG/HAMMER EFF./DATE HFO0064 CME-550 88% 09/02/2009		DRILL METHOD NW Casing w/ Advancer		HAMMER TYPE Automatic												
DRILLER Smith, C. L.		START DATE 12/07/12		COMP. DATE 12/07/12		SURFACE WATER DEPTH N/A										
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)	
			0.5ft	0.5ft	0.5ft	0	25	50	75	100						
500																
495																
490	492.1	4.5	0	0	0										496.6	0.0
	487.1	9.5	4	10	12										487.4	9.2
															485.1	11.5
															482.8	13.8
<p>ROADWAY EMBANKMENT TAN-BROWN-YELLOW VERY SOFT MOIST CLAYEY SILT (A-4)</p> <p>ALLUVIAL BROWN-GRAY VERY STIFF MOIST SANDY CLAYEY SILT (A-4)</p> <p>WEATHERED ROCK SEVERELY WEATHERED NON-CRYSTALLINE ROCK</p> <p>Boring Terminated with Casing Advancer Refusal at Elevation 482.8 ft on non-crystalline rock</p>																

NCDOT BORE SINGLE B5134_GEO_BH_BRD0072_UNION.GPJ NC_DOT_GDT_17713

WBS 42293.1.1		TIP B5134		COUNTY UNION		GEOLOGIST Stickney, J. K.											
SITE DESCRIPTION Bridge #72 on NC 200 over Chinkapin Creek							GROUND WTR (ft)										
BORING NO. EB2-A		STATION 15+62		OFFSET 6 ft LT		ALIGNMENT -L-											
COLLAR ELEV. 496.8 ft		TOTAL DEPTH 16.3 ft		NORTHING 477,266		EASTING 1,552,280											
DRILL RIG/HAMMER EFF./DATE HFO0064 CME-550 88% 09/02/2009		DRILL METHOD NW Casing w/ Advancer		HAMMER TYPE Automatic													
DRILLER Smith, C. L.		START DATE 12/06/12		COMP. DATE 12/06/12		SURFACE WATER DEPTH N/A											
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100							
500															496.8	GROUND SURFACE	0.0
495	492.5	4.3	0	1	1						SS-3	M		ROADWAY EMBANKMENT RED-BROWN SOFT MOIST MED. PLASTIC (PI=22) SILTY CLAY (A-7-6)			
490	487.5	9.3	8	13	13									ALLUVIAL BROWN-GRAY VERY STIFF MOIST SANDY CLAYEY SILT (A-4)	8.1		
485	482.5	14.3	100/2											WEATHERED ROCK SEVERELY WEATHERED NON-CRYSTALLINE ROCK	13.7		
														Boring Terminated with Casing Advancer Refusal at Elevation 480.5 ft on non-crystalline rock			

NCDOT BORE SINGLE B5134_GEO_BH_BRD0072_UNION.GPJ NC_DOT.GDT 1/7/13

WBS 42293.1.1		TIP B5134		COUNTY UNION		GEOLOGIST Stickney, J. K.											
SITE DESCRIPTION Bridge #72 on NC 200 over Chinkapin Creek							GROUND WTR (ft)										
BORING NO. EB2-B		STATION 15+55		OFFSET 8 ft RT		ALIGNMENT -L-											
COLLAR ELEV. 496.8 ft		TOTAL DEPTH 15.2 ft		NORTHING 477,253		EASTING 1,552,288											
DRILL RIG/HAMMER EFF./DATE HFO0064 CME-550 88% 09/02/2009		DRILL METHOD NW Casing w/ Advancer		HAMMER TYPE Automatic													
DRILLER Smith, C. L.		START DATE 12/07/12		COMP. DATE 12/07/12		SURFACE WATER DEPTH N/A											
ELEV (ft)	DRIVE ELEV (ft)	DEPTH (ft)	BLOW COUNT			BLOWS PER FOOT					SAMP. NO.	MOI	LOG	SOIL AND ROCK DESCRIPTION	DEPTH (ft)		
			0.5ft	0.5ft	0.5ft	0	25	50	75	100							
500															496.8	GROUND SURFACE	0.0
495	492.6	4.2	0	1	1							M		ROADWAY EMBANKMENT RED-BROWN SOFT MOIST MED. PLASTIC SILTY CLAY (A-7-6)			
490	487.6	9.2	6	13	13									ALLUVIAL BROWN-GRAY VERY STIFF MOIST SANDY CLAYEY SILT (A-4)	8.6		
485	482.6	14.2	100/3											WEATHERED ROCK SEVERELY WEATHERED NON-CRYSTALLINE ROCK	14.2		
														Boring Terminated with Casing Advancer Refusal at Elevation 481.6 ft on non-crystalline rock			

NCDOT BORE SINGLE B5134_GEO_BH_BRD0072_UNION.GPJ NC_DOT.GDT 1/8/13

TEST RESULTS

PROJECT: 42293.1.1 (B-5134)

COUNTY: FORSYTH

SITE DESCRIPTION: BRIDGE #72 ON NC 200 OVER CHINKAPIN CREEK

SHEET

9

SOIL SAMPLE RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS	N	LL.	P.I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC	UNIT WT. (d)	VOID RATIO
								C. SAND	F. SAND	SILT	CLAY	10	40	200				
EB1-A																		
SS-1	6.0 LT	14+59 -L-	4.90-5.90	(A-4(7))	0	31	8	4.7	4.7	54.3	36.4	97	94	90				
SS-2	6.0 LT	14+59 -L-	9.40-9.90	A-6(11)	4	38	14	9.9	4.7	44.9	40.5	92	85	81				
EB2-A																		
SS-3	6.0 LT	15+62 -L-	4.80-5.80	A-7-6(24)	2	51	22	2.8	4.9	37.7	54.7	99	97	93				
EB2-B																		
SS-4	7.5 RT	15+55	9.70-10.70	A-4(4)	26	27	7	6.3	13.0	50.4	30.4	95	92	81				

-L- Sta. 13+00.00
Begin TIP Project B-5134

-L-
PI Sta. 18+42.73
Δ = 6° 04' 41.5" (LT)
D = 2' 14" 48.8"
L = 270.52'
T = 135.38'
R = 2550.00'

-L- Sta. 18+00.00
End TIP Project B-5134

NO. 82/1555 2007
N.C. GRID

BM#1
497.23
BR SPIKE IN TEL POLE

TO MONROE ← N 31° 20' 31.3" E N 26° 37' 42.4" E N 36° 45' 09.4" E → TO SR 1681

NC 200 MORGAN MILL ROAD 24' BST

EB1-A *072 EB2-A
EB1-B EB2-B

B5134-1

CHINKAPIN CREEK

CHINKAPIN CREEK

BL-3

15

435.77

606.52