PROJECT REFERENCE NO.	SHEET NO.
U-3465	23
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER

INCOMPLETE PLANS
DO NOT USE FOR R/W ACQUISITION

PRELIMINARY PLANS
DO NOT USE FOR CONSTRUCTION

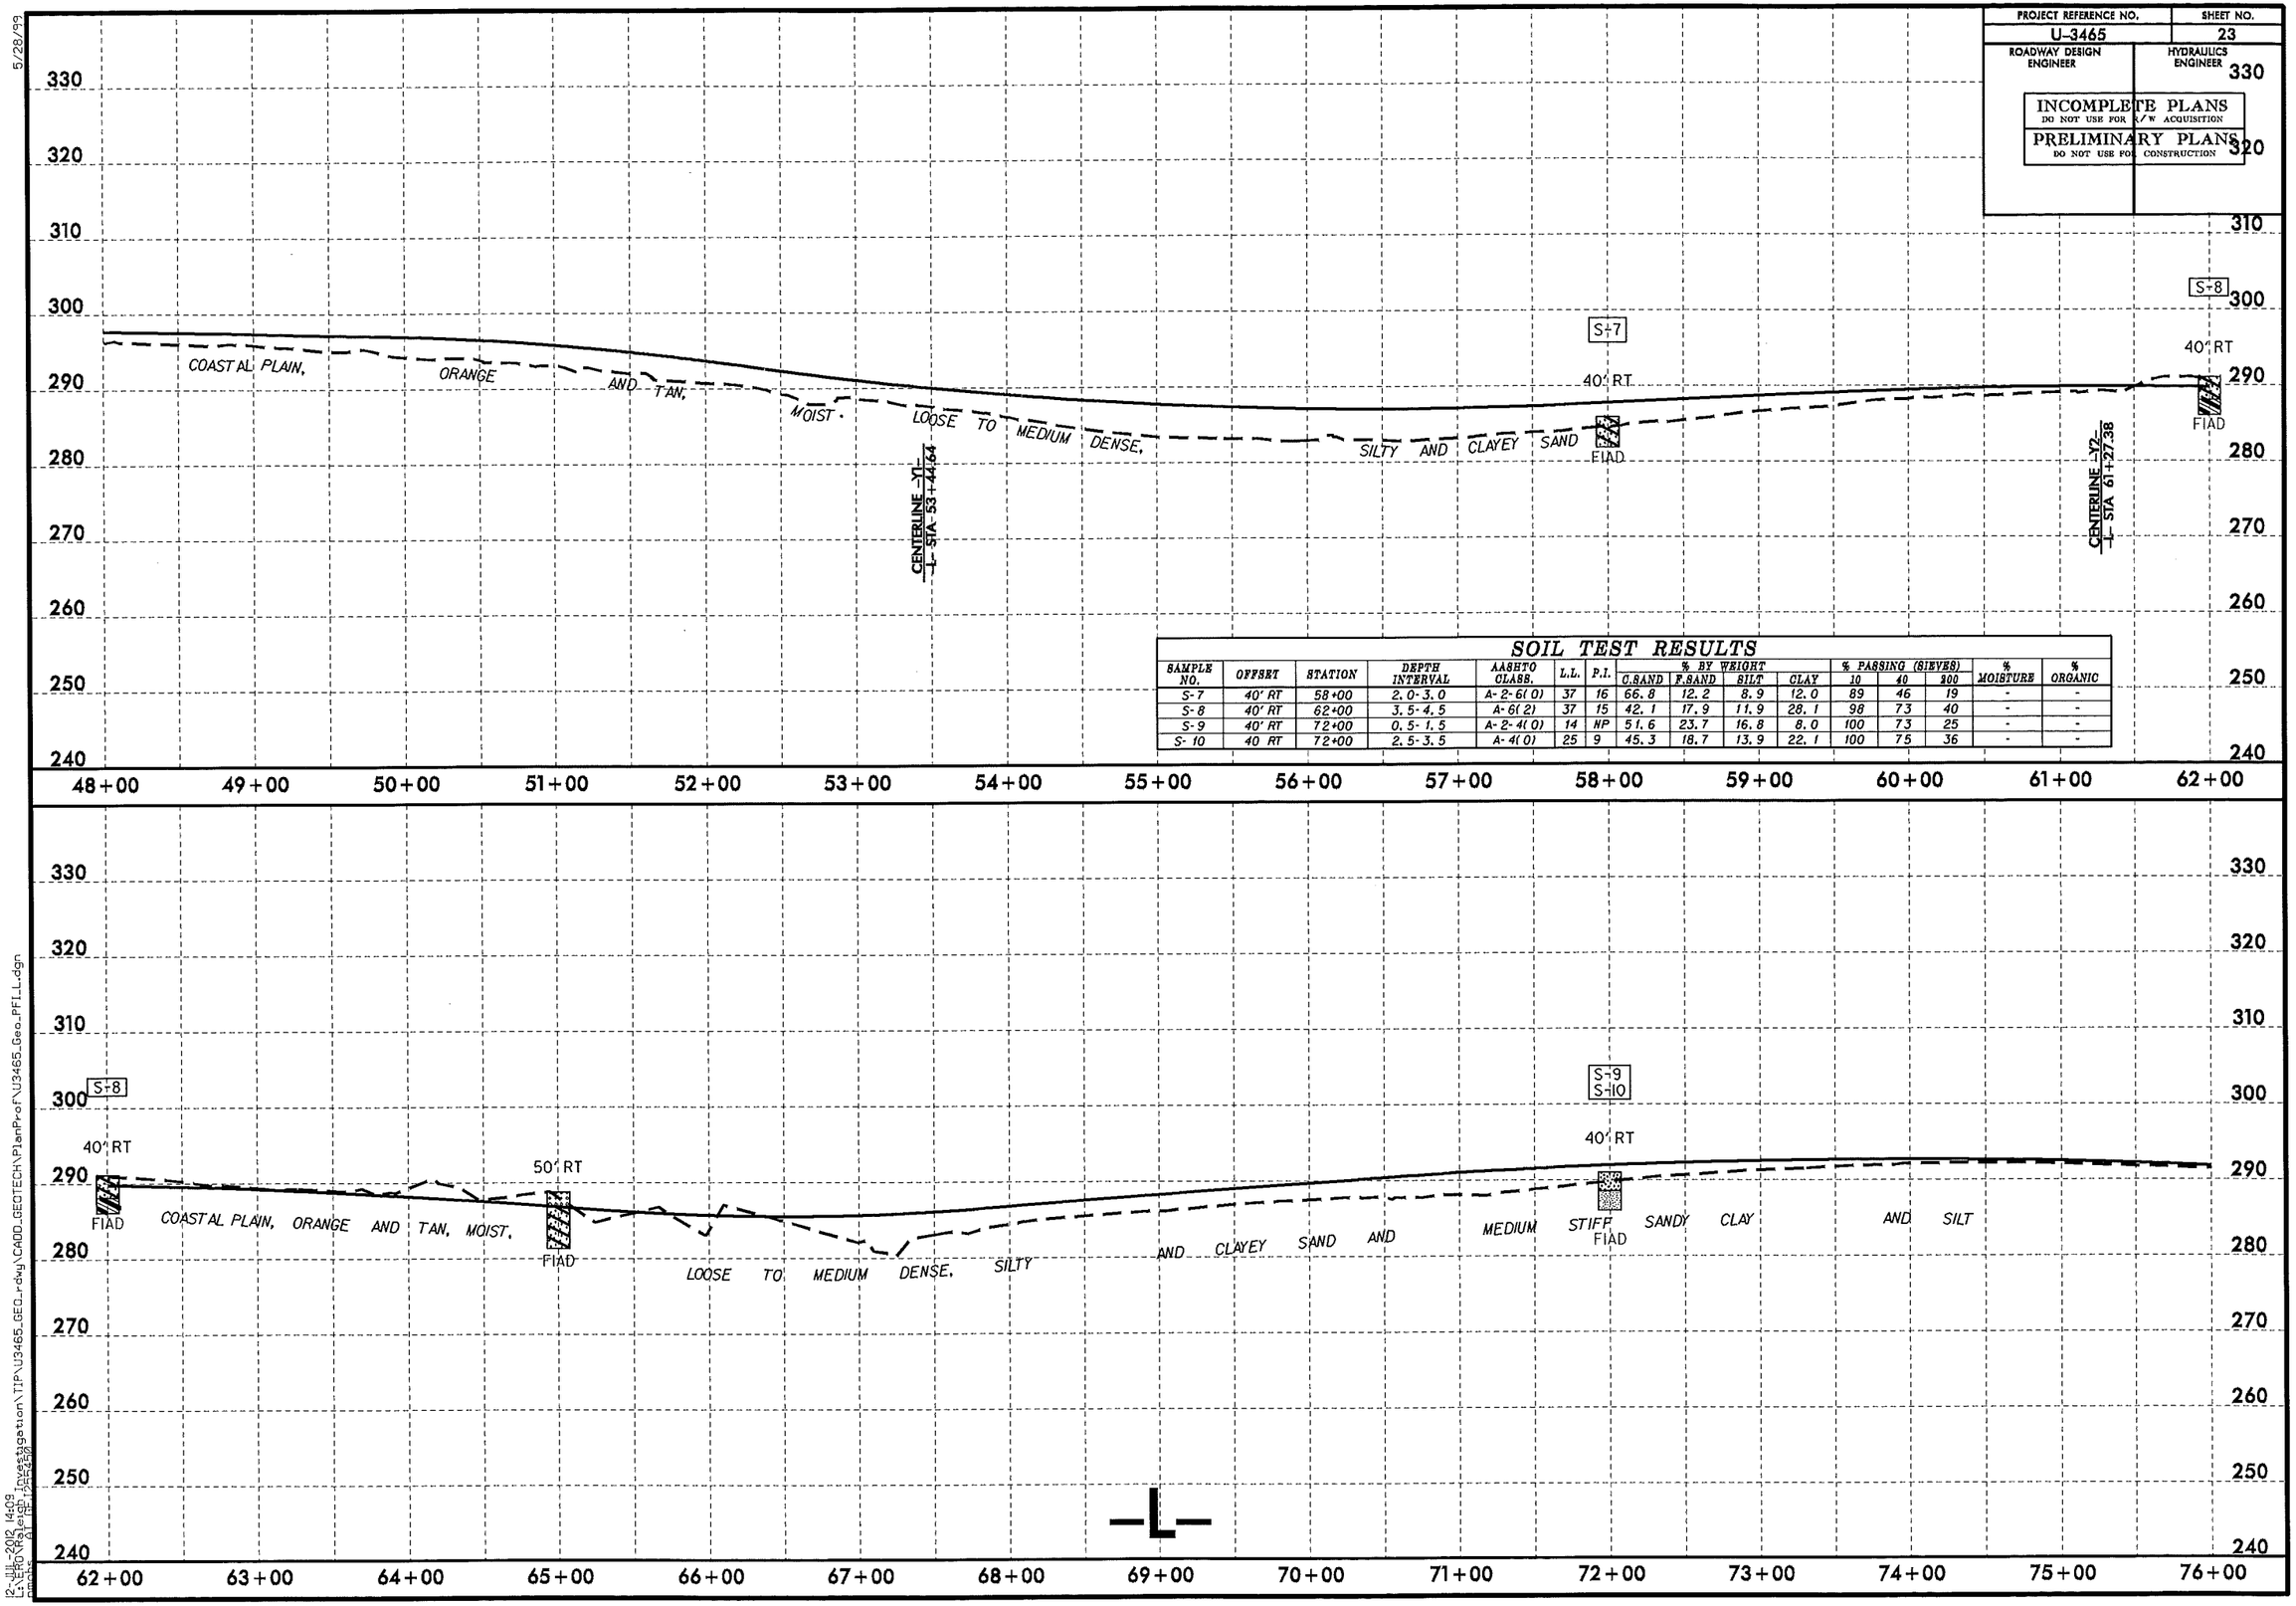

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT C.SAND	F.SAND	SILT	CLAY	% PASSING (SIEVES) 10	40	200	% MOISTURE	% ORGANIC
S-7	40' RT	58+00	2.0-3.0	A-2-6(0)	37	16	66.8	12.2	8.9	12.0	89	46	19	-	-
S-8	40' RT	62+00	3.5-4.5	A-6(2)	37	15	42.1	17.9	11.9	28.1	98	73	40	-	-
S-9	40' RT	72+00	0.5-1.5	A-2-4(0)	14	NP	51.6	23.7	16.8	8.0	100	73	25	-	-
S-10	40 RT	72+00	2.5-3.5	A-4(0)	25	9	45.3	18.7	13.9	22.1	100	75	36	-	-

5/28/99

12-JUL-2012 14:09
L:\ERO\Raleigh\Investigation\TIP\U3465_GEO_rdwy\CADD_GEOTECH\PlanProf\U3465_Geo_PFIL.dgn