DocuSign Envelope ID: 231E7C46-AD88-41FF-954F-EDE23514B88B

PROJECT REFERENCE NO.	SHEET NO.
B-5119	ITS-4

DRAWING 1

NEW EQUIPMENT CABINET DISCONNECT

INSTALL 15 AMP CIRCUIT BREAKER FOR CCTV

INSTALL ONE 1½" CONDUIT FROM EXISTING ELECTRICAL JUNCTION BOX. TERMINATE THE EXISTING #8 COOPER FEEDER CONDUCTORS INTO THE DISCONNECT.

INSTALL ONE ¾" CONDUIT WITH THREE #12 COPPER FEEDER CONDUCTORS TO POLE MOUNTED CCTV CABINET

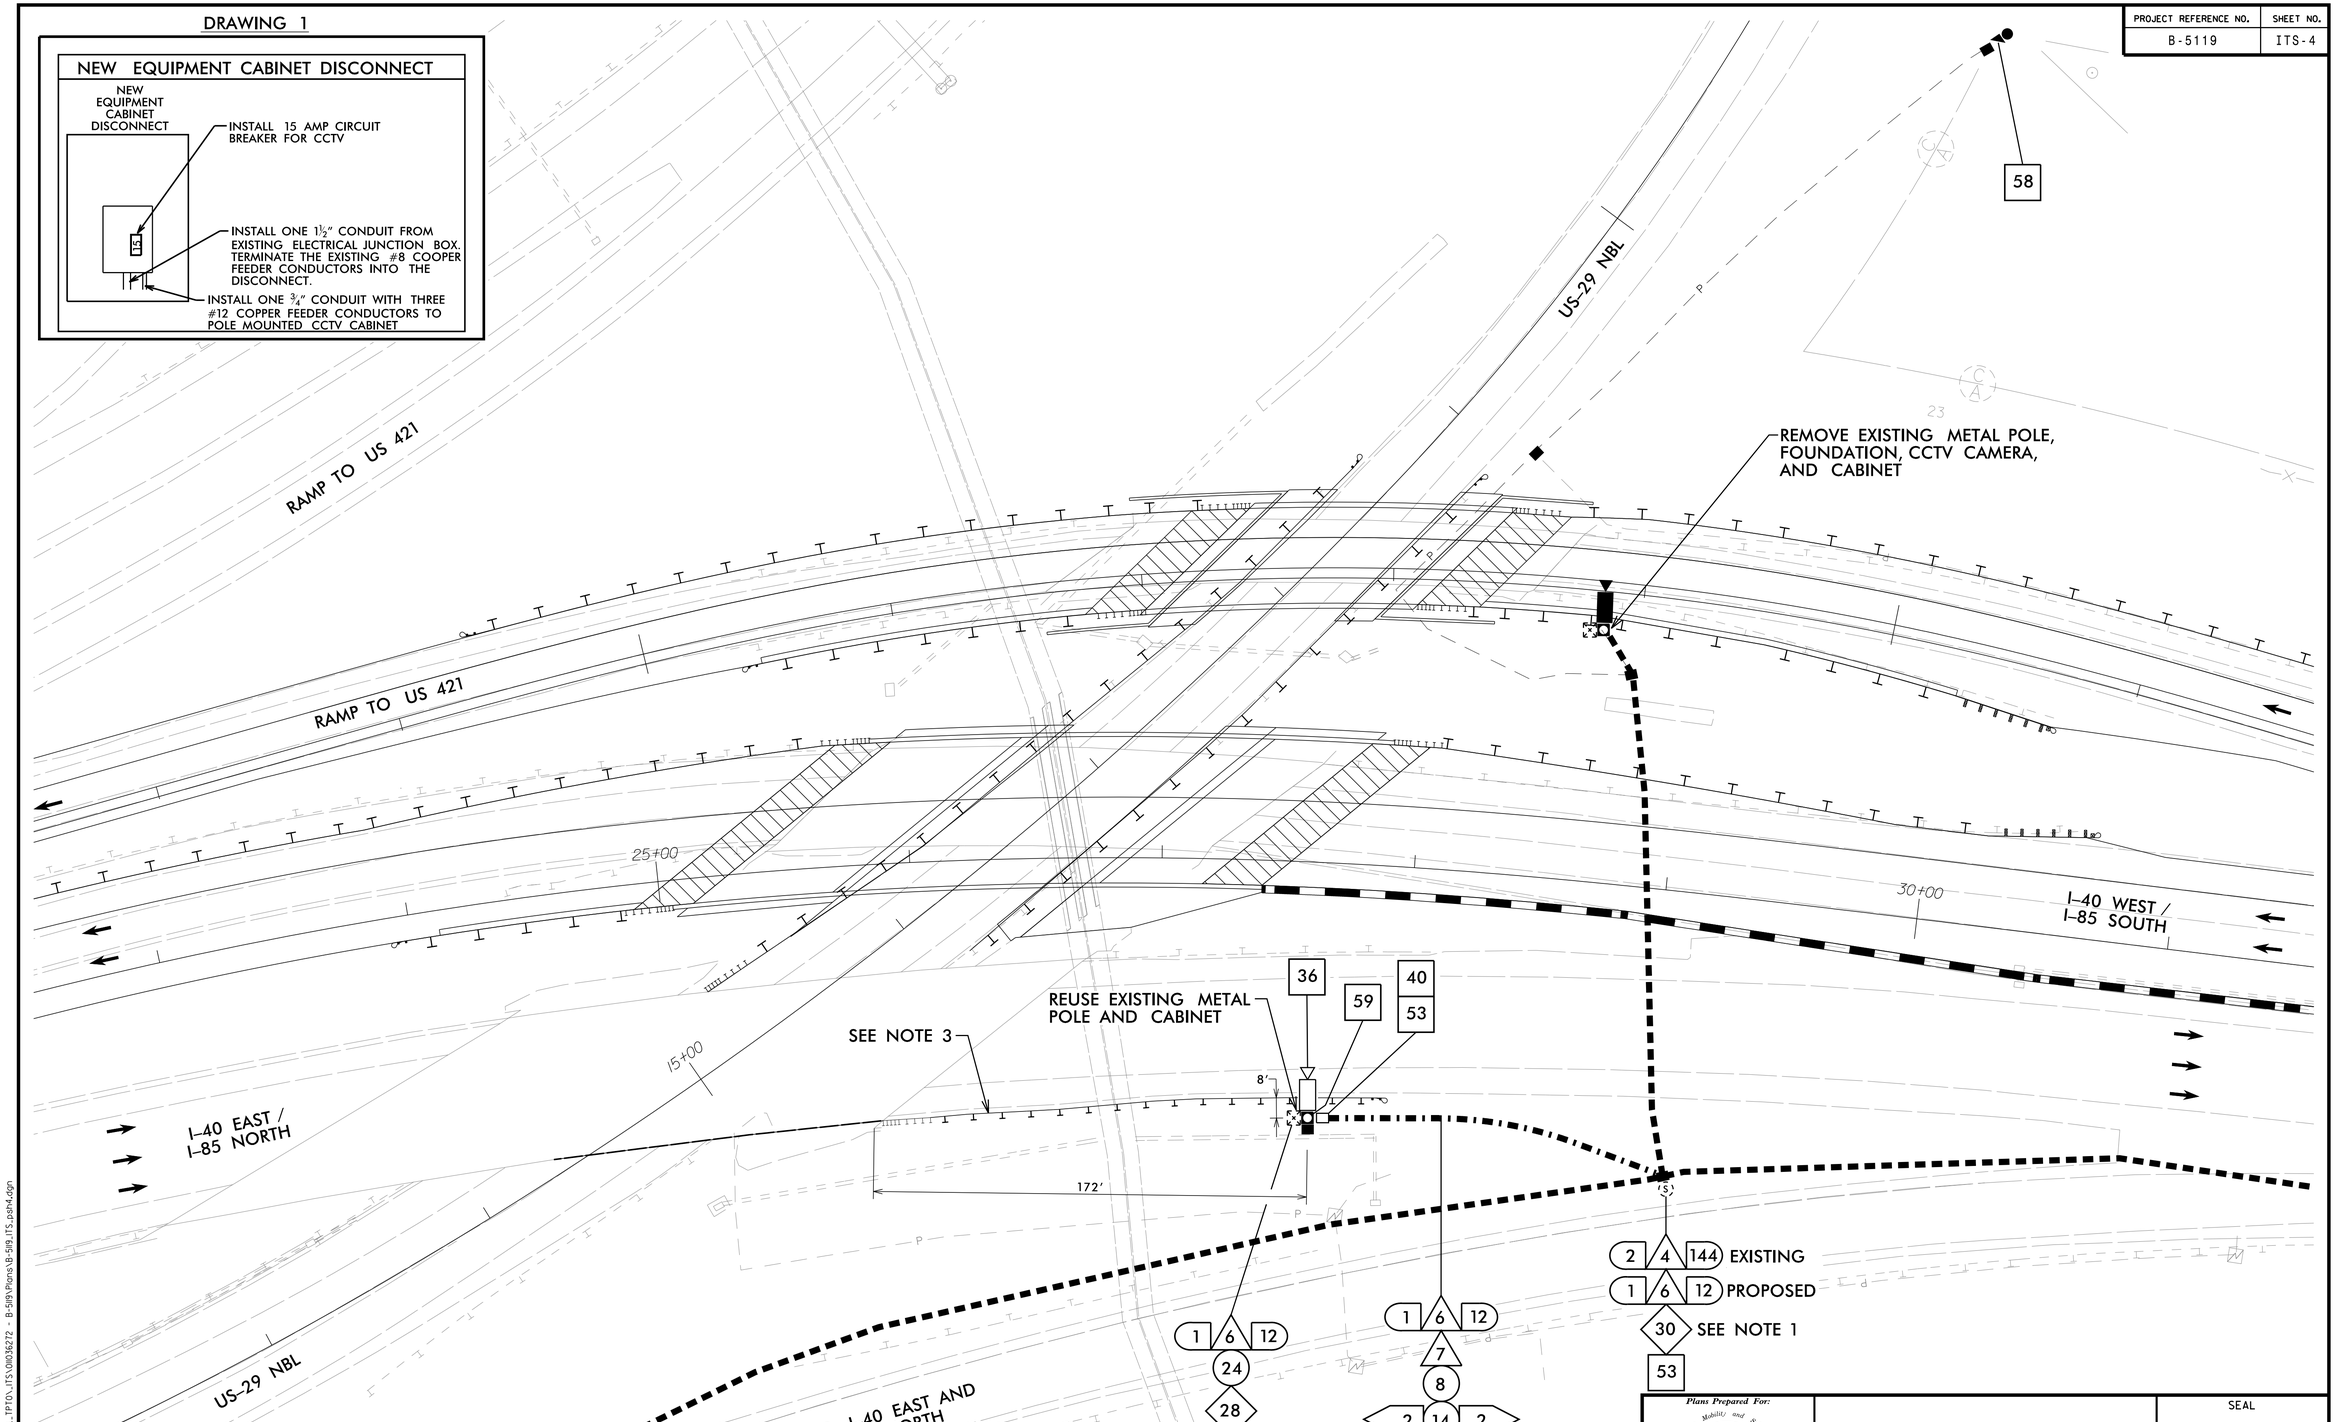

NOTES:
1. CONTRACTOR TO NOTE CURRENT SPLICING AND MAINTAIN CONFIGURATION WHEN REMOVING EXISTING DROP CABLE AND INSTALLING NEW DROP CABLE.
2. REFER TO LIGHTING PLANS FOR INSTALLATION DETAILS.
3. REFER TO ROADWAY PLANS FOR GUARDRAIL DETAILS.

Kimley»Horn
NC License #F-0102
P.O. Box 33068
Raleigh, NC 27636
Tel: (919) 677-2000
Fax: (919) 677-2050

Plans Prepared For:
Transportation Mobility and Safety Division
STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
Intermodal Transportation Section
750 N. Greenfield Pkwy., Garner, NC 27529

SCALE 0 30 1"=30'

CCTV RELOCATION PLAN

DIVISION 07 GUILFORD COUNTY

PLAN DATE: OCTOBER 2014 REVIEWED BY: _____

PREPARED BY: J. CROSS REVIEWED BY: K. SMITH

REVISIONS	INIT.	DATE

SEAL
NORTH CAROLINA PROFESSIONAL SEAL 030472 ENGINEER KEVIN W. SMITH

DocuSigned by:
Kevin W. Smith, P.E. 12/12/2014
DocuSigned by: SIGNATURE DATE

CADD Filename: _____

K:\RAL_TPTO_ITS\0W036272 - B-5119\Plans\B-5119_ITS_psh4.dgn
10:05:58 AM
11/3/2014