


**ELEVATION VIEW**  
REAR SIDE

**TYPE 3**

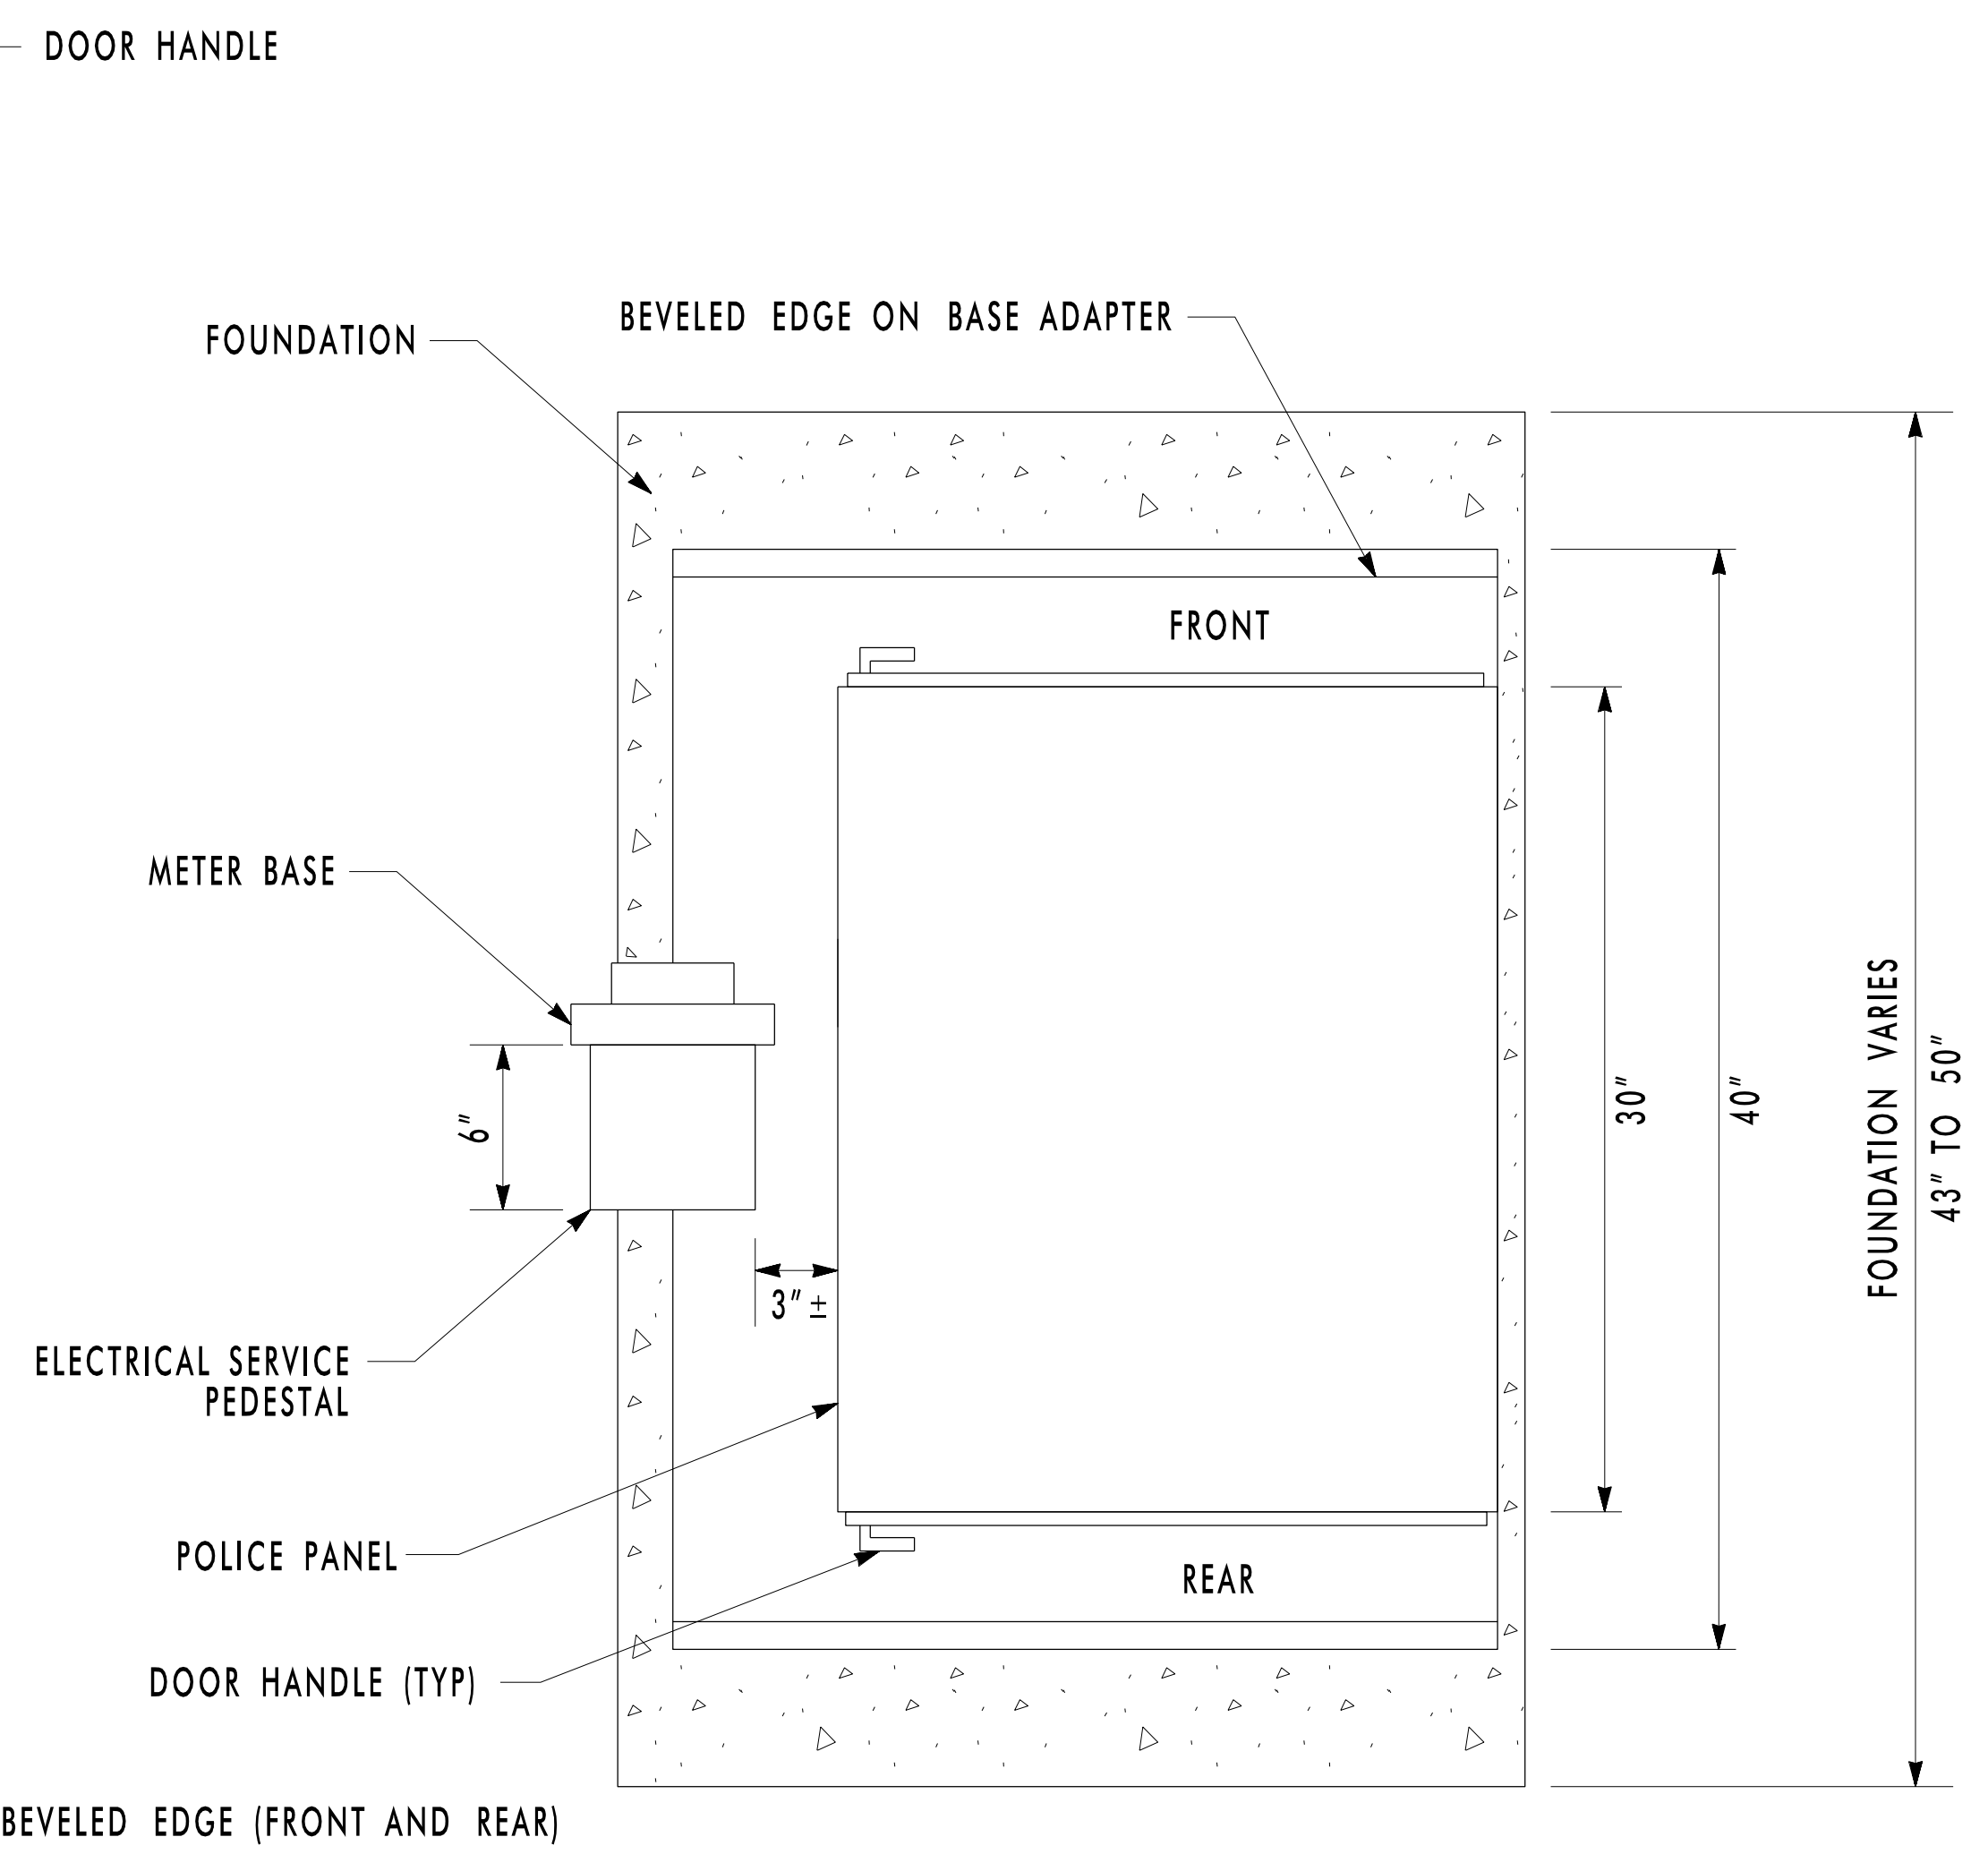

**TOP VIEW**

**NOTES:**

1. DETAIL SHOWN IS FOR SITUATION WHERE ELECTRICAL SERVICE CONDUCTORS RESIDE IN AN EXCLUSIVE CONDUIT. IF CONDUCTORS ARE FOUND TO SHARE CONDUIT WITH OTHER CABLES/WIRES OR IF EXISTING CONDUIT IS LARGER THAN 1", USE 3/4" LFNC INSTEAD OF 1.25" LFNC AND INSERT 3/4" LFNC A MINIMUM OF 12" INTO EXISTING CONDUIT.

04-JUN-2015 16:49  
 T:\Product\ITSS\NC\DOT\100037777 - High Point Sig Sys\Special Detail\ITS-5.10.dgn  
 SLOC3653 AT LUS291201

**ATKINS** 1616 EAST MILLBROOK ROAD, SUITE 310  
 RALEIGH, NORTH CAROLINA 27609  
 (919) 876-6888 NCBEES #F-0326

	<b>High Point Signal System</b> <b>Integrated</b> <b>Base Adapter Detail</b>		SEAL NORTH CAROLINA PROFESSIONAL ENGINEER FRED BADGETT 019962
	Division 7 PLAN DATE: June 2015 PREPARED BY: BJ Slocum	Guilford County REVIEWED BY: HA Badgett REVIEWED BY: SG Haynie	High Point REVISIONS INIT. DATE