

**NOTES:**

MORTAR JOINTS 1/2" TO 1/4" THICK.

USE CLASS "B" CONCRETE THROUGHOUT.

USE TYPE "E", "F" AND "G" GRATES UNLESS OTHERWISE INDICATED.


USE BRICK OR CONCRETE BLOCK WHICH COMPLIES WITH THE REQUIREMENTS OF SECTION 840 OF THE STANDARD SPECIFICATIONS.

CHAMFER ALL EXPOSED CORNERS 1".

DRAWING NOT TO SCALE.

PROVIDE ALL CATCH BASINS OVER 3'-6" IN DEPTH WITH STEPS 12" ON CENTER. USE STEPS WHICH COMPLY WITH STD. DRAWING 840.66

8/14/2015

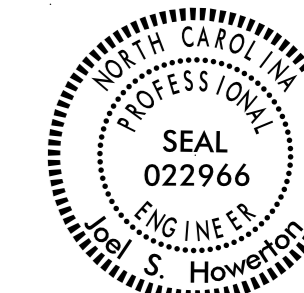

DocuSigned by:  
Joel Howerton  
873F3D170C0C45F...

**CONTRACT STANDARDS AND DEVELOPMENT UNIT**  
Office 919-707-6950 FAX 919-250-4119

**PROPOSED OFFSET CATCH BASIN**

ORIGINAL BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
 MODIFIED BY: K. KEMPF DATE: 2/22/13  
 CHECKED BY: \_\_\_\_\_ DATE: \_\_\_\_\_  
 FILE SPEC.: nbritt/english/hydro/840d06 offset\_boxes.dgn

PLANNING AND DESIGN GROUP  
 1515 W. HICKORY STREET  
 SUITE 200  
 WARRIOR, NC 27888  
 919-707-6950  
 FAX 919-707-6951  
 WWW.P&DGROUP.COM