



# -Y16-

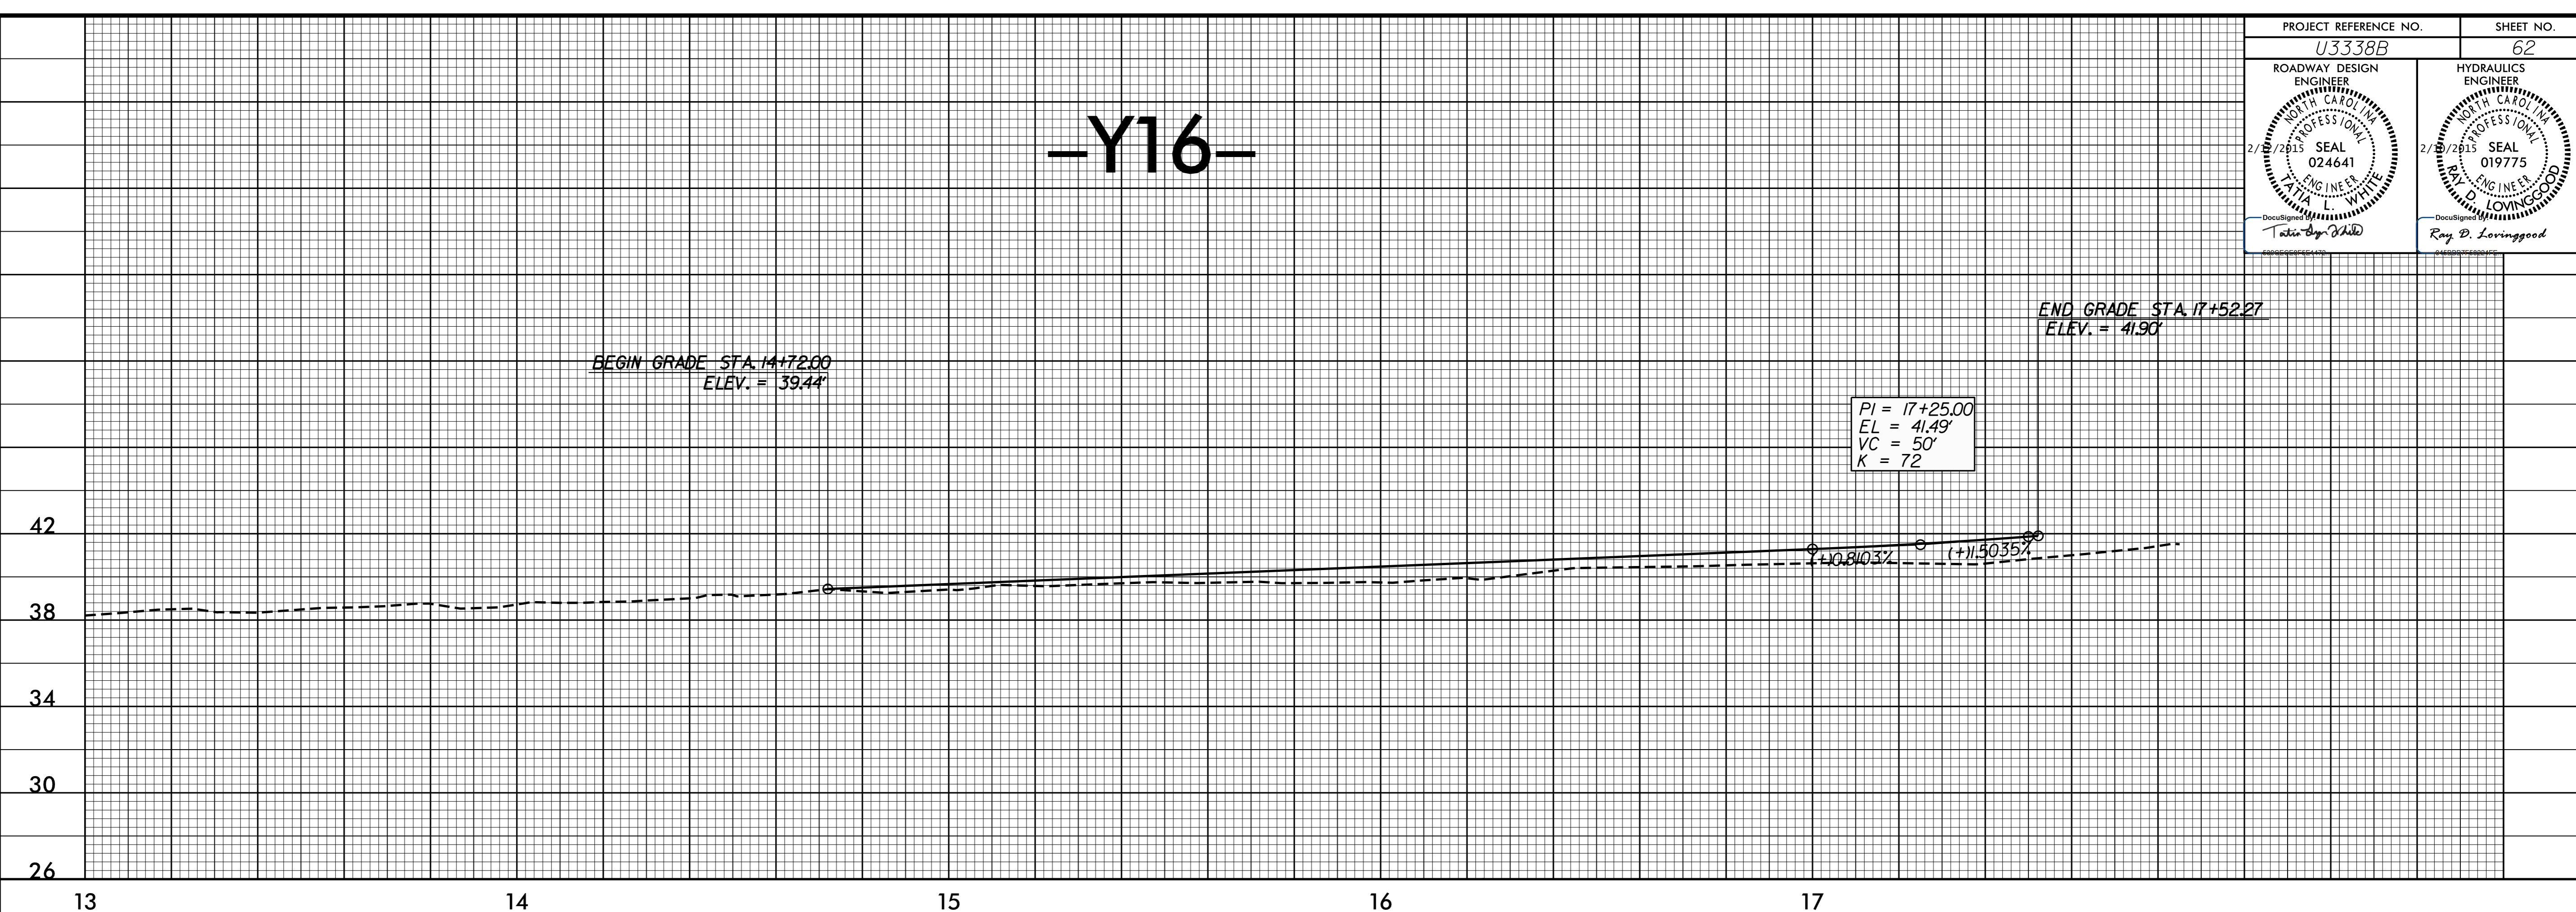

# -Y17-

# -Y15-

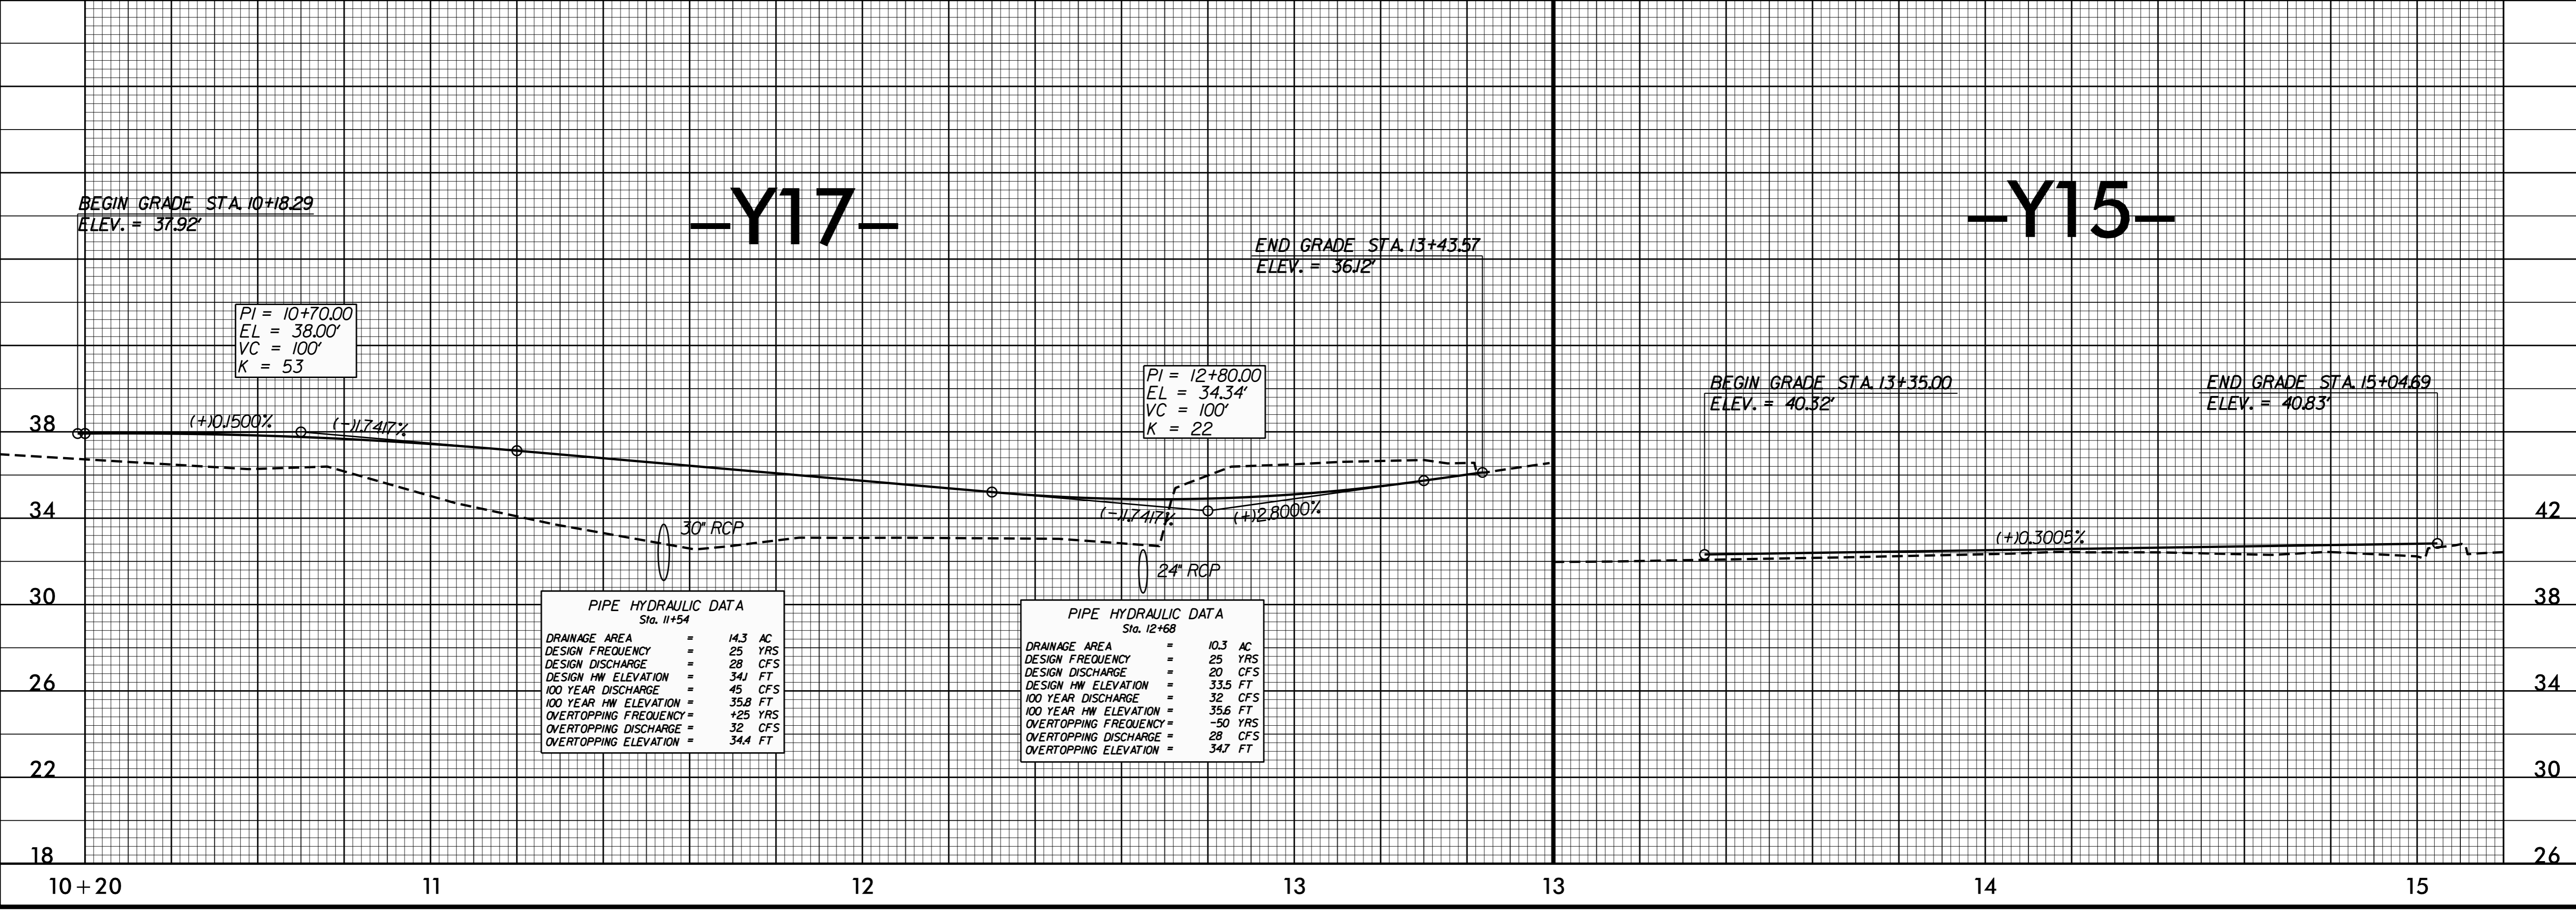

DRAINAGE AREA	=	14.3 AC
DESIGN FREQUENCY	=	25 YRS
DESIGN DISCHARGE	=	28 CFS
DESIGN HW ELEVATION	=	34.1 FT
100 YEAR DISCHARGE	=	45 CFS
100 YEAR HW ELEVATION	=	35.8 FT
OVERTOPPING FREQUENCY	=	+25 YRS
OVERTOPPING DISCHARGE	=	32 CFS
OVERTOPPING ELEVATION	=	34.4 FT

DRAINAGE AREA	=	10.3 AC
DESIGN FREQUENCY	=	25 YRS
DESIGN DISCHARGE	=	20 CFS
DESIGN HW ELEVATION	=	33.5 FT
100 YEAR DISCHARGE	=	32 CFS
100 YEAR HW ELEVATION	=	35.6 FT
OVERTOPPING FREQUENCY	=	+50 YRS
OVERTOPPING DISCHARGE	=	28 CFS
OVERTOPPING ELEVATION	=	34.7 FT

5/28/99  
 13 JAN 2015 14:16 \\s3338b-rdu-p1.dgn  
 4483075281416