



END ELEVATION
SHOWING PLACEMENT OF #5 & #4 "A" BARS AND LOCATION OF DOWEL HOLES. (INTERIOR BOX BEAM SECTION SHOWN-EXTERIOR SECTION SIMILAR EXCEPT SHEAR KEY LOCATION, STRAND LAYOUT NOT SHOWN.)

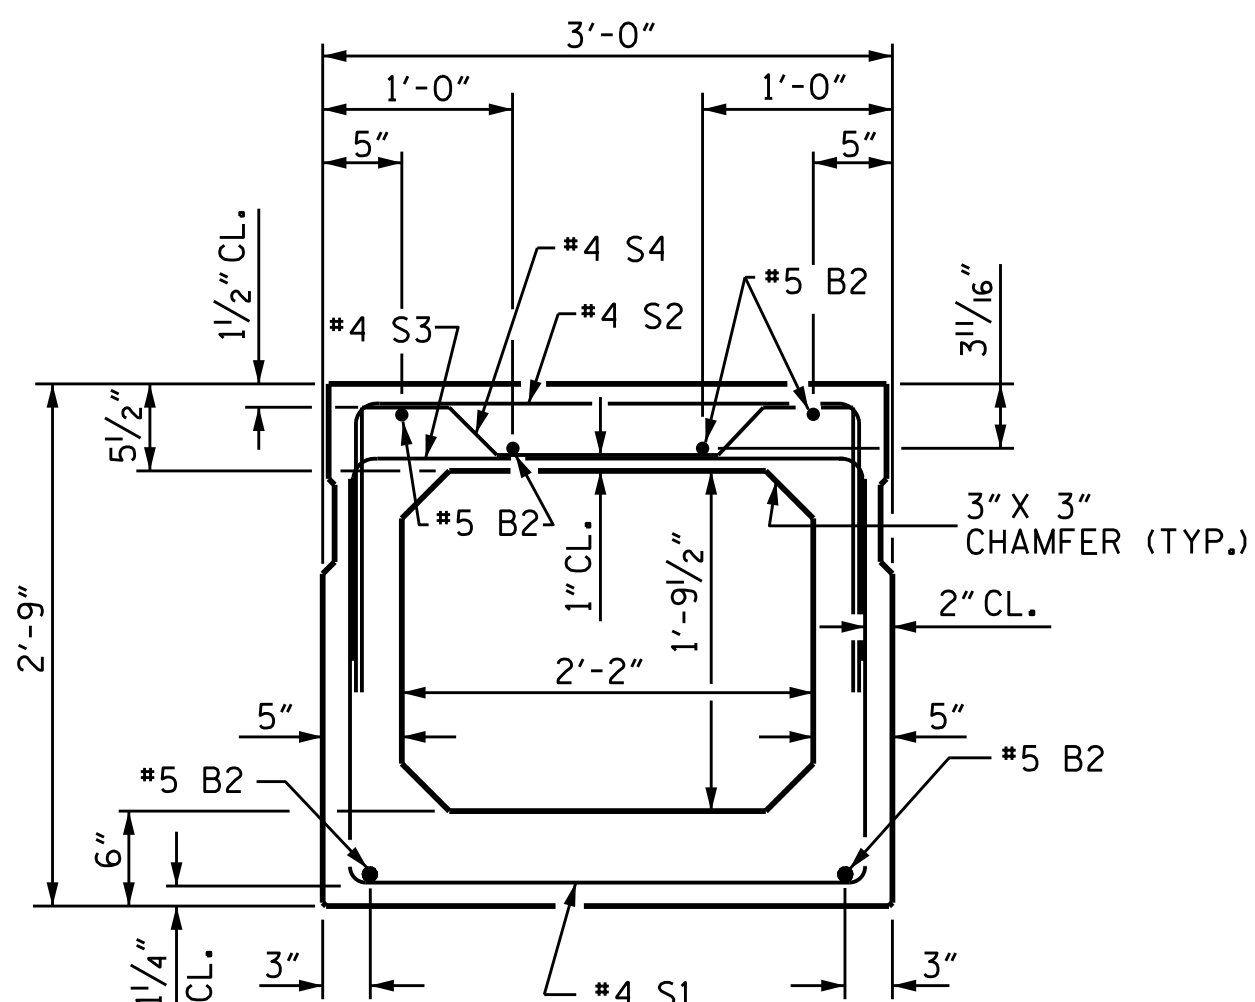


INTERIOR BOX BEAM SECTION
(STRAND LAYOUT NOT SHOWN)

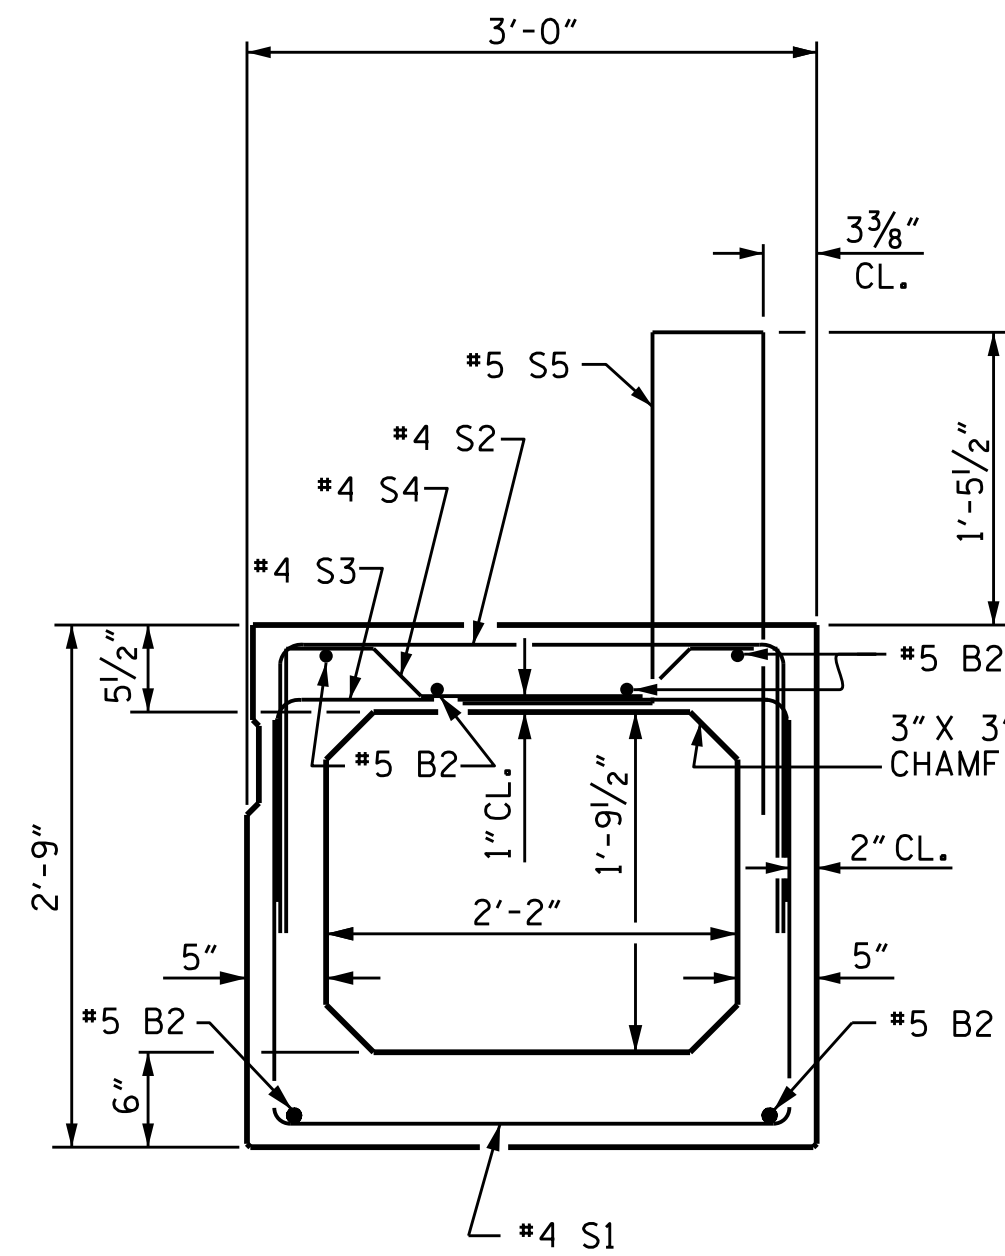

EXTERIOR BOX BEAM SECTION
(STRAND LAYOUT NOT SHOWN)


0.6" Ø LOW RELAXATION STRAND LAYOUT

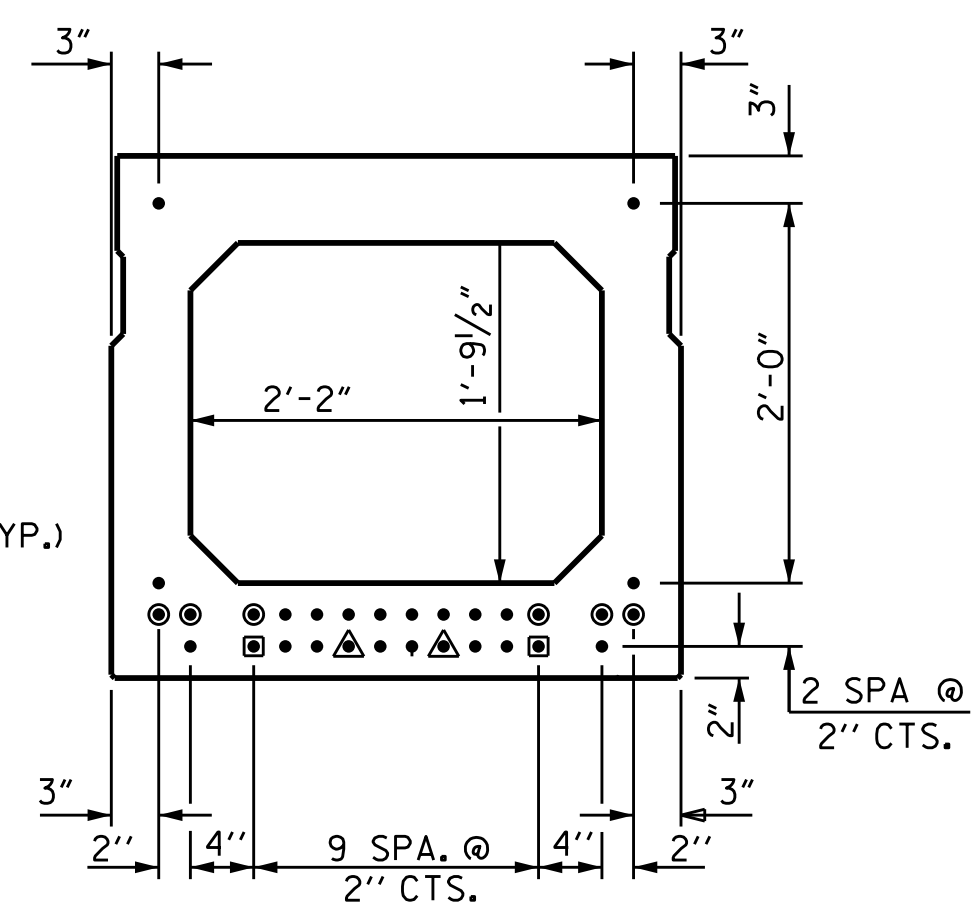


TYPICAL STRAND LOCATION
(24 STRANDS REQUIRED)
DEBONDING LEGEND

- FULLY BONDED STRANDS
- ◐ STRANDS DEBONDED FOR 4'-0" FROM END OF GIRDER
- ◑ STRANDS DEBONDED FOR 10'-0" FROM END OF GIRDER
- OPTIONAL FULL LENGTH DEBONDED STRANDS. THESE STRANDS ARE NOT REQUIRED. IF THE FABRICATOR CHOOSES TO INCLUDE THESE STRANDS IN THE BOX BEAM UNIT, THE STRANDS SHALL BE DEBONDED FOR THE FULL LENGTH OF THE UNIT AT NO ADDITIONAL COST.


BOND SHALL BE BROKEN ON STRANDS AS SHOWN FOR THE SPECIFIED LENGTH FROM EACH END OF THE BOX BEAM. SEE STANDARD SPECIFICATIONS ARTICLE 1078-7.

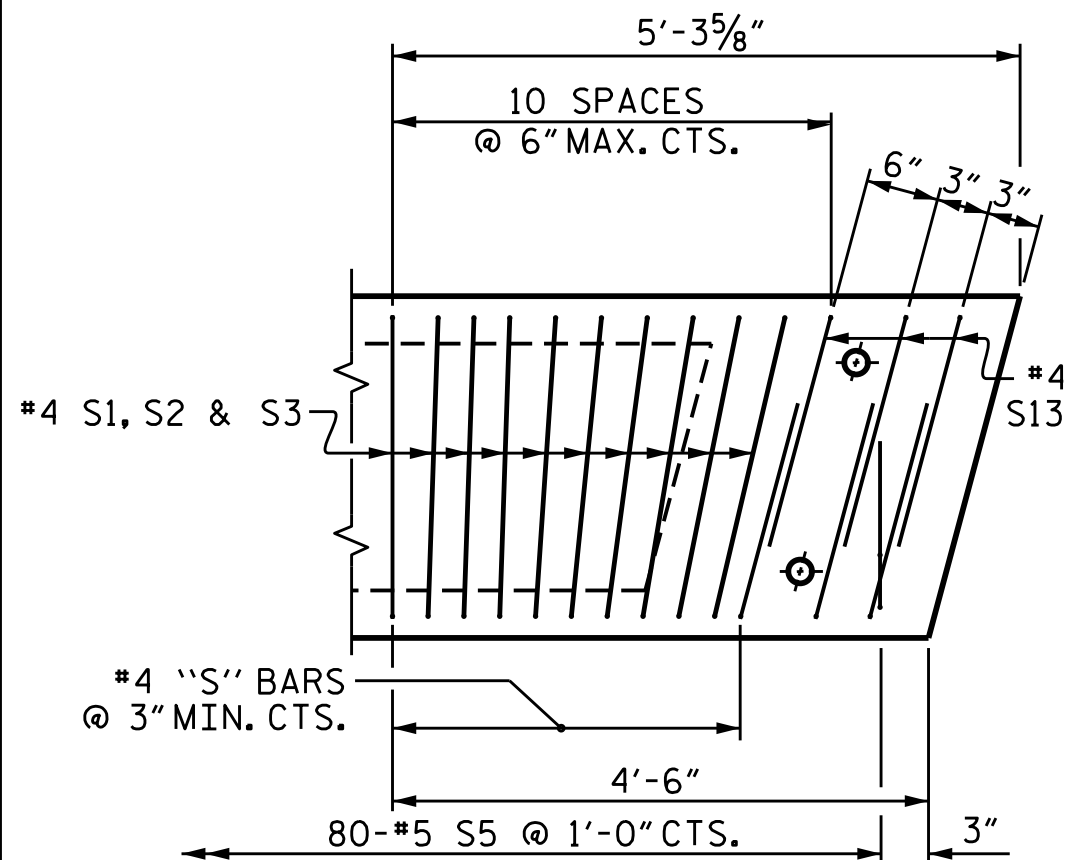

DETAIL "B"
EXTERIOR UNIT SHOWN, INTERIOR UNIT SIMILAR EXCEPT OMIT #5 S5 BARS. "B" BARS AND "A" BARS NOT SHOWN.

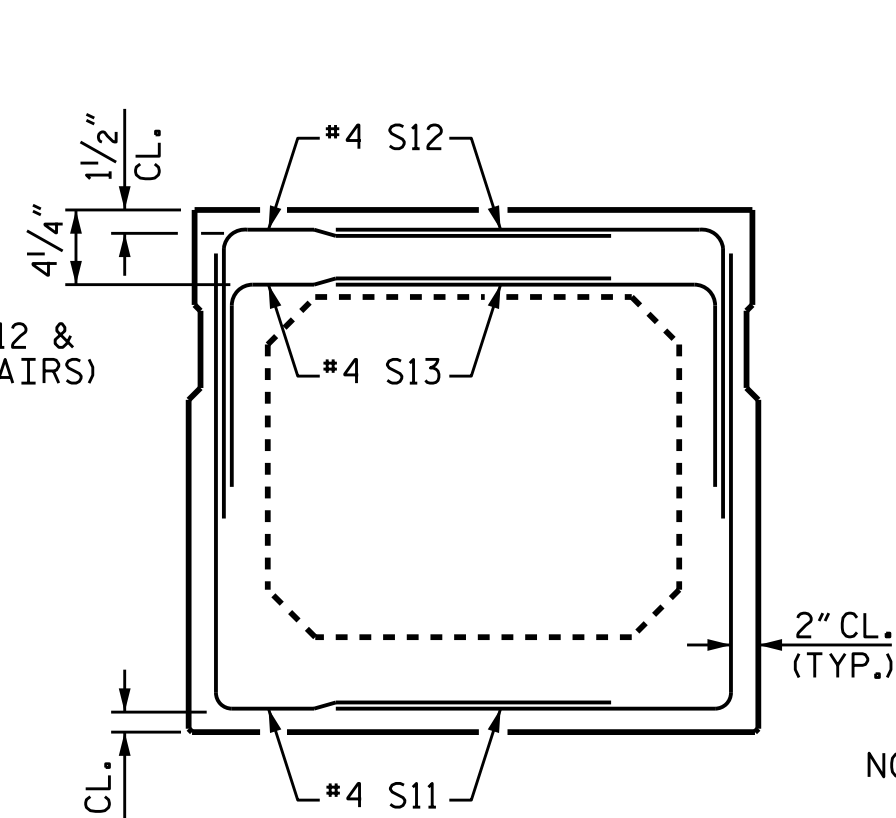


END VIEW
(SHOWING #4 "S" BARS IN END OF BEAM)

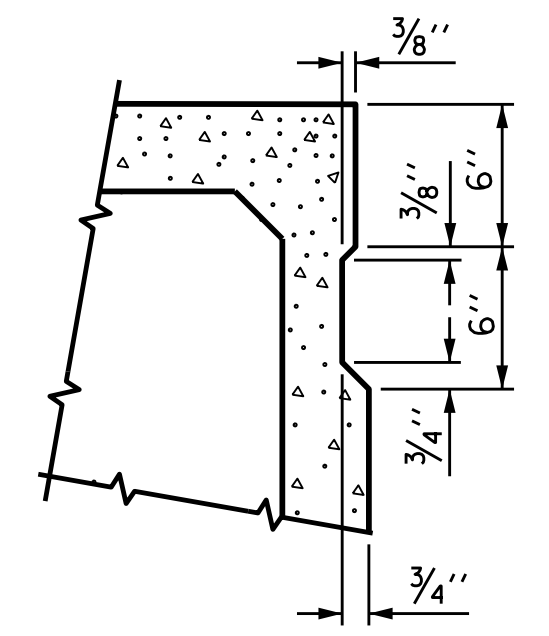


SHEAR KEY DETAIL
NOTE: OMIT SHEAR KEY ON OUTSIDE FACE OF EXTERIOR BOX BEAMS.

GRADE 270 STRANDS	
	0.6" Ø L.R.
AREA (SQUARE INCHES)	0.217
ULTIMATE STRENGTH (LBS. PER STRAND)	58,600
APPLIED PRESTRESS (LBS. PER STRAND)	43,950

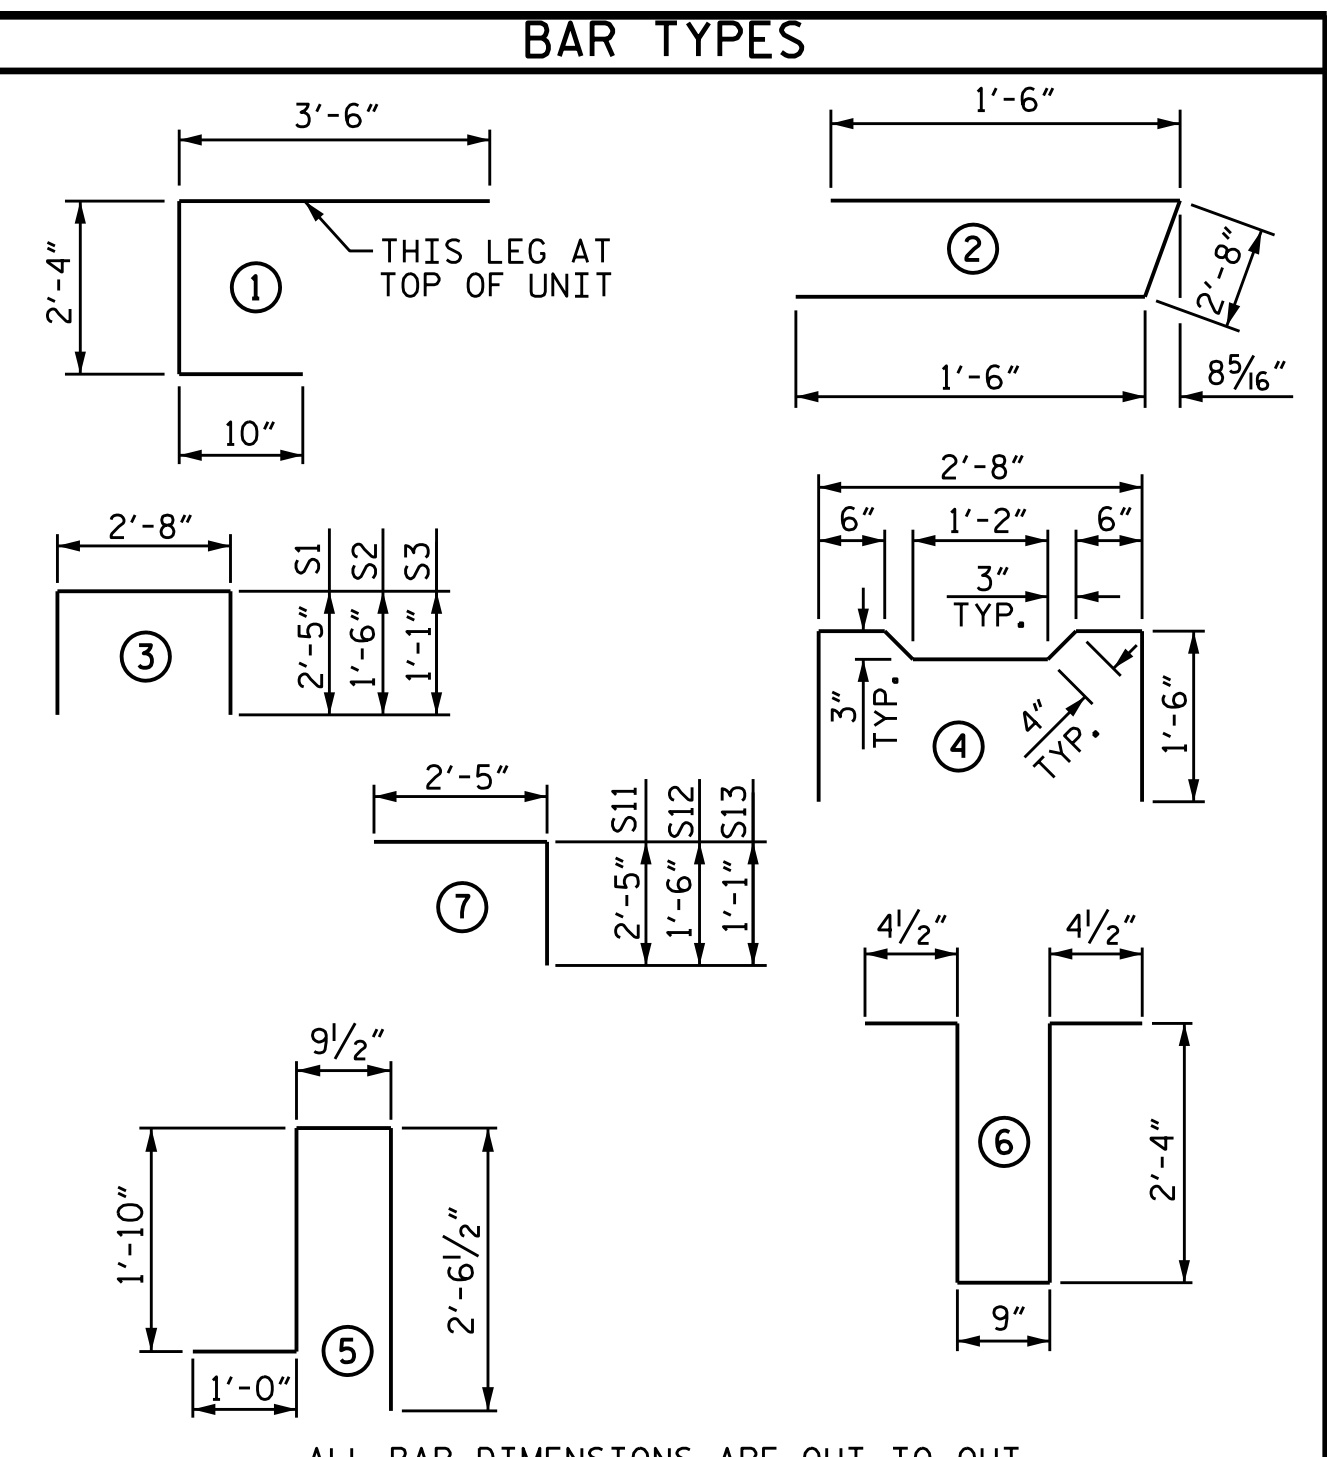

BILL OF MATERIAL FOR ONE BOX BEAM SECTION


BAR	NUMBER	SIZE	TYPE	EXTERIOR UNIT		INTERIOR UNIT	
				LENGTH	WEIGHT	LENGTH	WEIGHT
A1	10	#5	1	6'-8"	70	6'-8"	70
A2	34	#5	2	5'-8"	129	5'-8"	129
B2	12	#5	STR	40'-11"	512	40'-11"	512
K1	12	#4	6	6'-2"	49	6'-2"	49
K2	8	#4	STR	2'-7"	14	2'-7"	14
S1	67	#4	3	7'-6"	336	7'-6"	336
S2	67	#4	3	5'-8"	254	5'-8"	254
S3	113	#4	3	4'-10"	365	4'-10"	365
S4	46	#4	4	5'-10"	179	5'-10"	179
S11	12	#4	7	4'-10"	39	4'-10"	39
S12	12	#4	7	3'-11"	31	3'-11"	31
S13	12	#4	7	3'-6"	28	3'-6"	28
*S5	80	#5	5	6'-2"	515	--	--
REINFORCING STEEL				2006	LBS.	2006	LBS.
*EPOXY COATED REINF. STEEL				515	LBS.		
8000 P.S.I. CONCRETE				14.3	CU. YDS.	14.1	CU. YDS.
0.6" Ø L.R. STRANDS				No.	24	No.	24

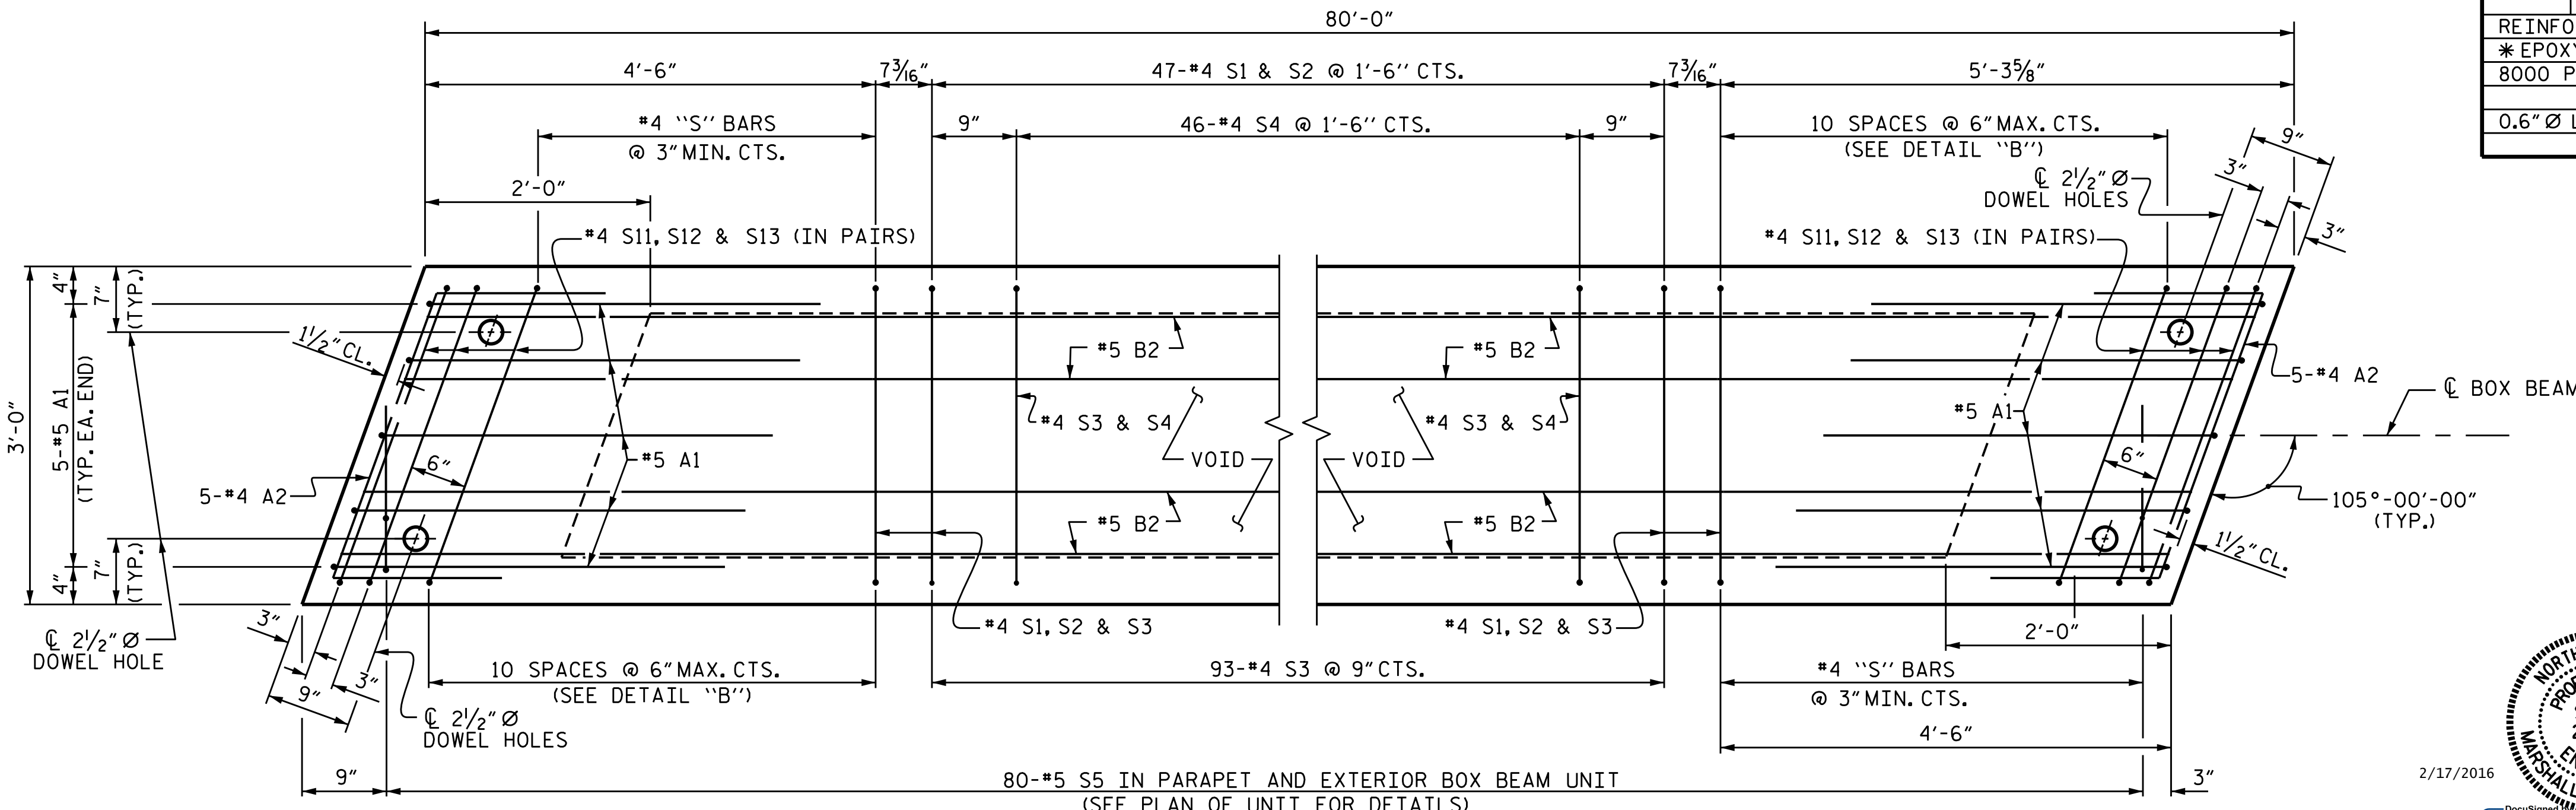

PLAN OF BOX BEAM

EXTERIOR UNIT SHOWN, INTERIOR UNIT SIMILAR EXCEPT OMIT #5 S5 BARS. FOR LOCATION OF DIAPHRAGMS, SEE "PLAN OF UNIT". FOR THREADED INSERTS, SEE "THREADED INSERT DETAIL". FOR REINFORCING STEEL IN DIAPHRAGMS, SEE "DOUBLE DIAPHRAGM DETAILS".

PROJECT NO. B-5396
BUNCOMBE COUNTY
STATION: 17+00.00 -L-
SHEET 3 OF 5

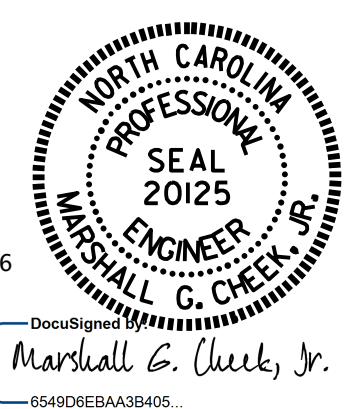

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
3'-0" X 2'-9"
PRESTRESSED CONCRETE
BOX BEAM UNIT

DRAWN BY: M. POOLE DATE: 10-15
CHECKED BY: B. N. GRADY DATE: 12-15

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

REVISIONS				SHEET NO.	
NO.	BY:	DATE:	NO.	BY:	DATE:
1			3		
2			4		