
This electronic collection of documents is provided for the convenience of the user and is Not a Certified Document –

The documents contained herein were originally issued and sealed by the individuals whose names and license numbers appear on each page, on the dates appearing with their signature on that page.

This file or an individual page shall not be considered a certified document.

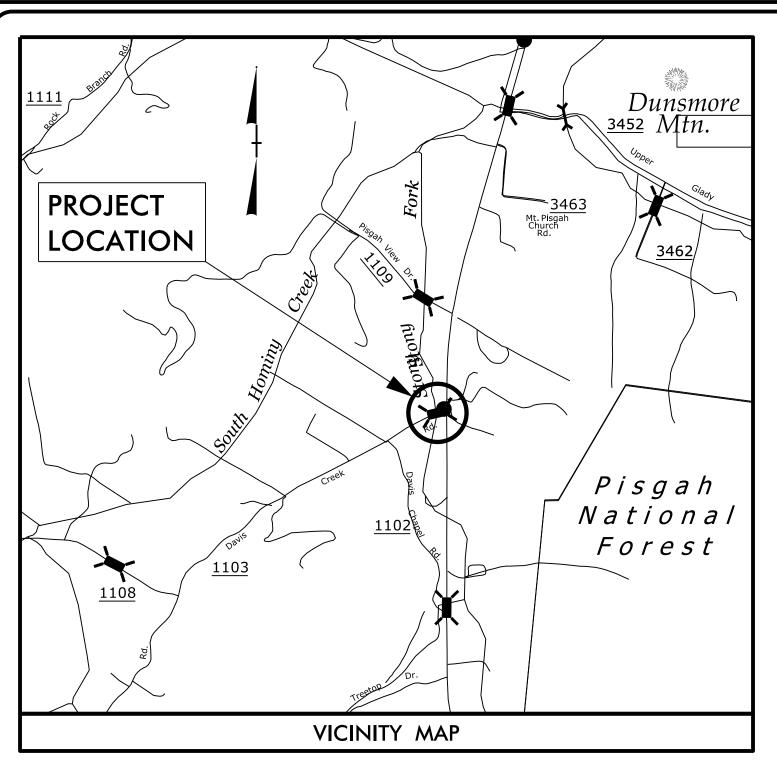

STATE OF NORTH CAROLINA DIVISION OF HIGHWAYS

BUNCOMBE COUNTY


LOCATION: BRIDGE No. 416 OVER STONY FORK CREEK

ON SR 1103


TYPE OF WORK: GRADING, DRAINAGE, PAVING AND STRUCTURE

STATE STA	STATE PROJECT REFERENCE NO.				
N.C.	B-5396				
STATE PROJ. NO.	F. A. PROJ. NO.	DESCRIP	rion		
46111.1.1	BRZ-1103(24)	P.E	•		
46111.2.FD1	BRZ-1103(24)	ROW & I	JTILITY		
46111.3.FD1	BRZ-1103(24)	CONS	ST.		



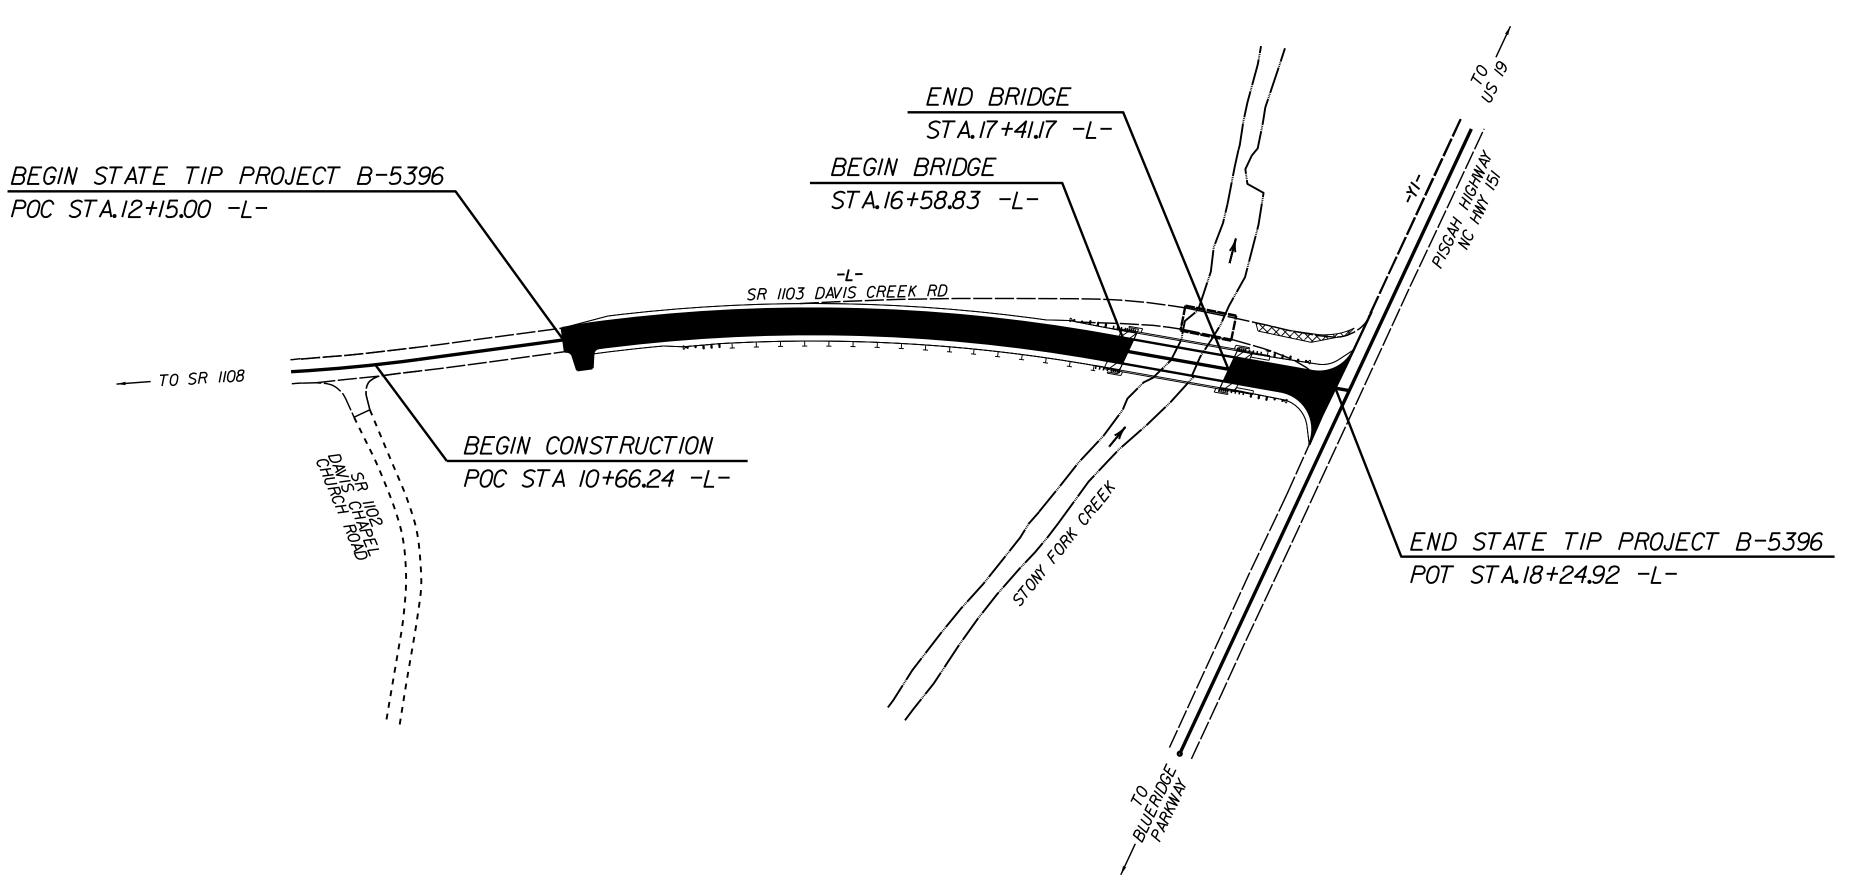

STRUCTURE

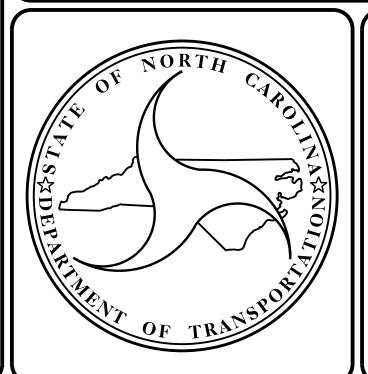

DESIGN DATA

ADT 2016 = 1370 ADT 2036 = 1645 K = 11 % D = 75 % T = 7 % *

> V = 30 MPH * TTST 1 %, DUAL 6 %

FUNC. CLASS. = RURAL LOCAL SUBREGIONAL TIER

PROJECT LENGTH

LENGTH ROADWAY TIP PROJECT B-5396 = 0.100 MILES LENGTH STRUCTURE TIP PROJECT B-5396 = 0.016 MILES

TOTAL LENGTH TIP PROJECT B-5396 = 0.116 MILES

Prepared in the Office of:

DIVISION OF HIGHWAYS

STRUCTURES MANAGEMENT UNIT

1000 BIRCH RIDGE DR.


RALEIGH, N.C. 27610


LETTING DATE : APRIL 19, 2016

2012 STANDARD SPECIFICATIONS

D. R. CALHOUN, PE PROJECT ENGINEER

MARC G. CHEEK, PE
PROJECT DESIGN ENGINEER

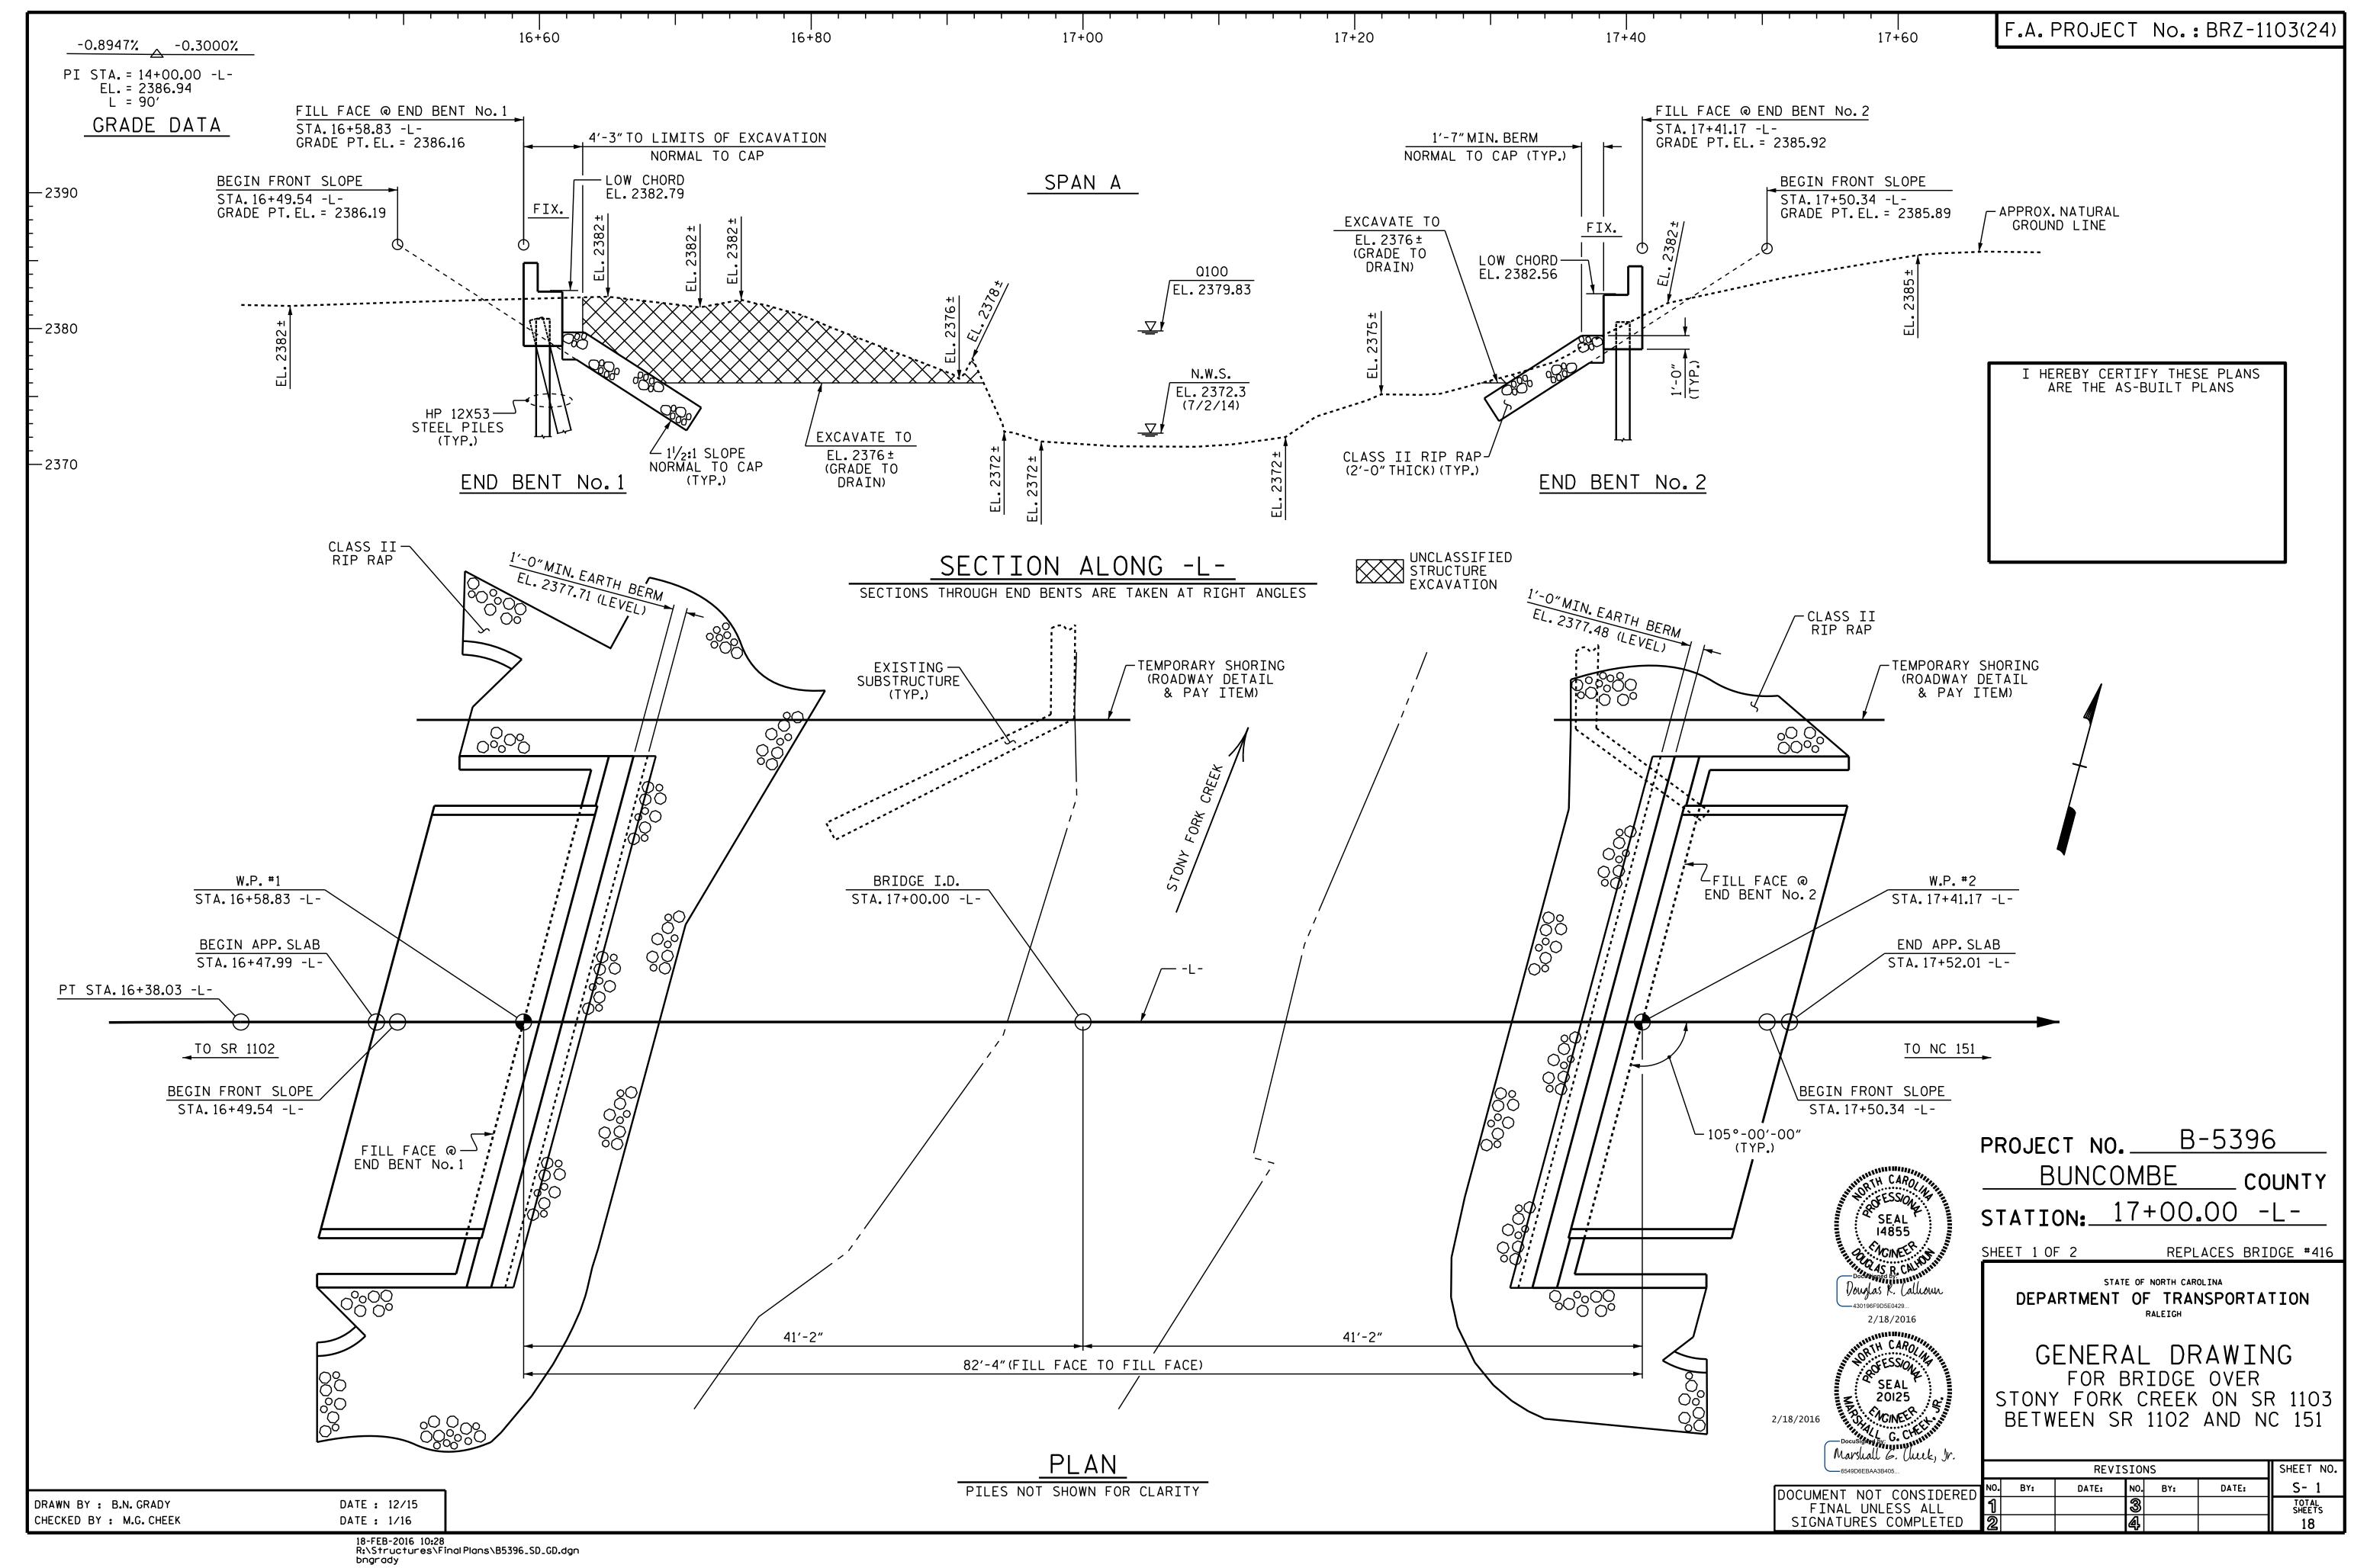

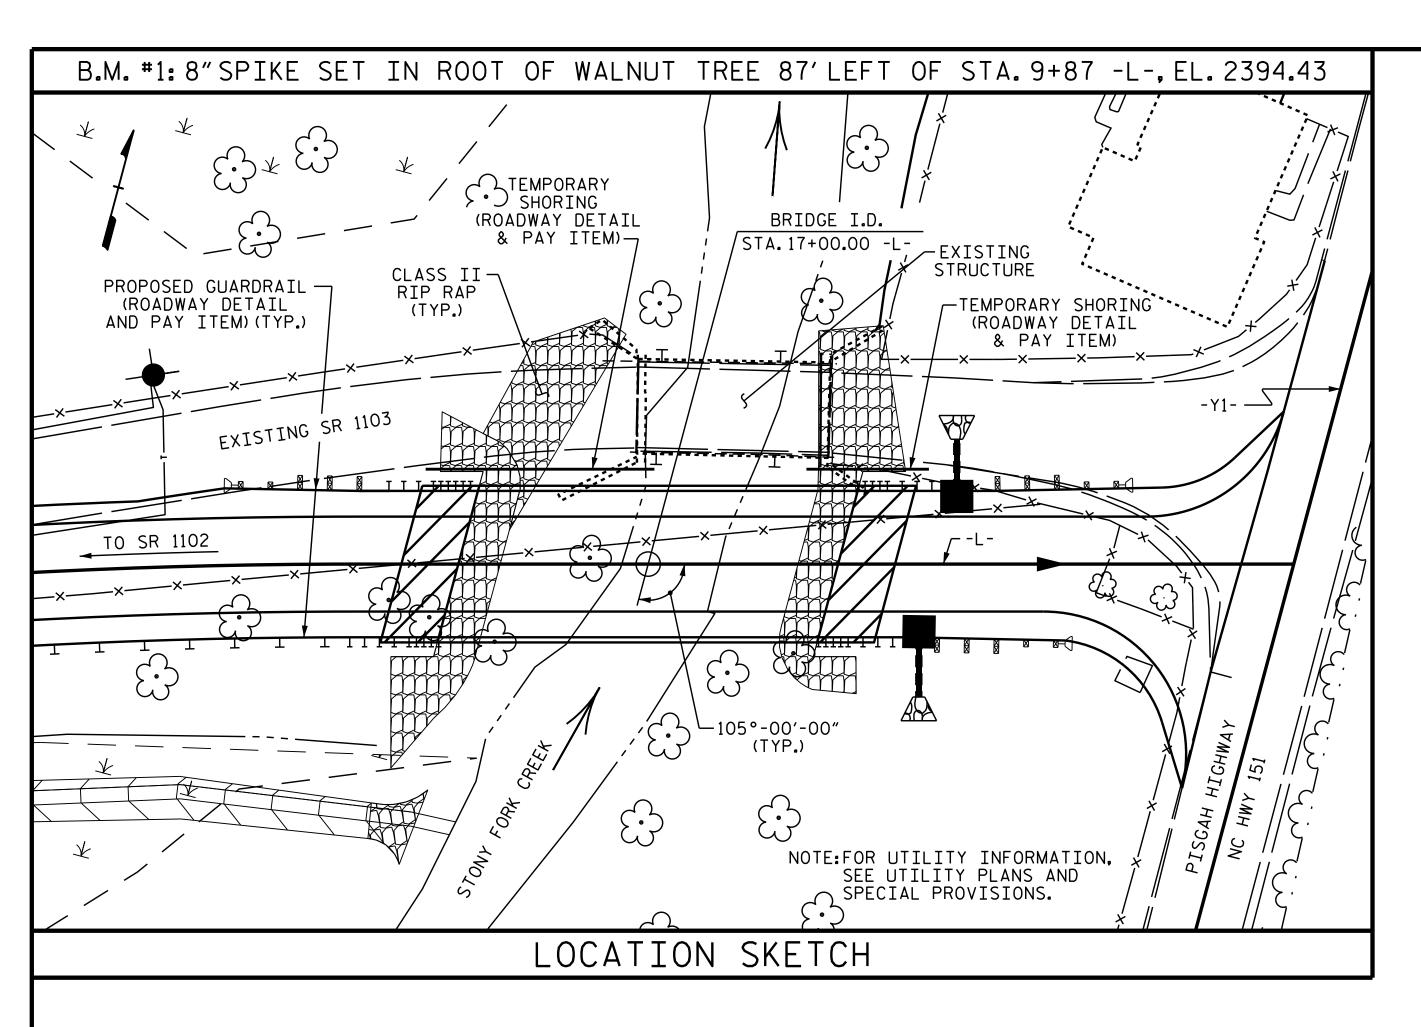

FOUNDATION NOTES

FOR PILES, SEE GEOTECHNICAL SPECIAL PROVISIONS AND SECTION 450 OF THE STANDARD SPECIFICATIONS.

PILES AT END BENT No.1 AND END BENT No.2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 100 TONS PER PILE.

DRIVE PILES AT END BENT No.1 TO A REQUIRED DRIVING RESISTANCE OF 167 TONS PER PILE.

PILE EXCAVATION IS REQUIRED TO INSTALL PILES AT END BENT No. 2. EXCAVATE HOLES AT PILE LOCATIONS TO EL. 2368.5. FOR PILE EXCAVATION, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

LE 2500:5: FOR THE EXCAVATION, SEE SECTION 450 OF THE STANDARD STECTIONS.

CONCRETE OR GROUT IS REQUIRED TO FILL HOLES FOR PILE EXCAVATION AT END BENT No. 2.

NOTES

ASSUMED LIVE LOAD = HL-93 OR ALTERNATE LOADING.

THIS BRIDGE HAS BEEN DESIGNED IN ACCORDANCE WITH THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS.

THIS BRIDGE IS LOCATED IN SEISMIC ZONE 1.

FOR OTHER DESIGN DATA AND GENERAL NOTES, SEE SHEET SN.

FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.

FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.

FOR CRANE SAFETY, SEE SPECIAL PROVISIONS.

FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

THE CONTRACTOR SHALL PROVIDE INDEPENDENT ASSURANCE SAMPLES OF REINFORCING STEEL AS FOLLOWS: FOR PROJECTS REQUIRING UP TO 400 TONS OF REINFORCING STEEL, ONE 30 INCH SAMPLE OF EACH SIZE BAR USED, AND FOR PROJECTS REQUIRING OVER 400 TONS OF REINFORCING STEEL, TWO 30 INCH SAMPLES OF EACH SIZE BAR USED. THE BARS FROM WHICH THE SAMPLES ARE TAKEN MUST THEN BE SPLICED WITH REPLACEMENT BARS OF THE SIZE AND LENGTH OF THE SAMPLE, PLUS A MINIMUM LAP SPLICE OF THIRTY BAR DIAMETERS. PAYMENT FOR THE SAMPLES OF REINFORCING STEEL SHALL BE CONSIDERED INCIDENTAL TO VARIOUS PAY ITEMS.

THE MATERIAL SHOWN IN THE CROSS-HATCHED AREA SHALL BE EXCAVATED FOR A DISTANCE OF 50 FT (LT) AND 40 FT (RT) EACH SIDE OF CENTERLINE ROADWAY AS DIRECTED BY THE ENGINEER. THIS WORK WILL BE PAID FOR AT THE CONTRACT LUMP SUM PRICE FOR UNCLASSIFIED STRUCTURE EXCAVATION. SEE SECTION 412 OF THE STANDARD SPECIFICATIONS.

AFTER SERVING AS A TEMPORARY STRUCTURE, THE EXISTING 40'-6" SINGLE SPAN STRUCTURE WITH A CLEAR ROADWAY WIDTH OF 18'-7" AND A 2" ASPHALT WEARING SURFACE ON A TIMBER FLOOR ON STEEL I-BEAMS, WITH A SUBSTRUCTURE CONSISTING OF TIMBER CAPS ON TIMBER POSTS AND SILLS ON CONCRETE FOOTINGS AT THE END BENTS AND LOCATED DOWNSTREAM FROM THE PROPOSED STRUCTURE SHALL BE REMOVED. THE EXISTING BRIDGE IS PRESENTLY NOT POSTED FOR LOAD LIMIT. SHOULD THE STRUCTURAL INTEGRITY OF THE BRIDGE DETERIORATE DURING CONSTRUCTION OF THE PROPOSED BRIDGE, A LOAD LIMIT MAY BE POSTED AND MAY BE REDUCED AS FOUND NECESSARY DURING THE LIFE OF THE PROJECT. FOR REMOVAL OF EXISTING STRUCTURE, SEE SPECIAL PROVISIONS.

FOR ASBESTOS ASSESSMENT FOR BRIDGE DEMOLITION AND RENOVATION ACTIVITIES, SEE SPECIAL PROVISIONS.

THE SUBSTRUCTURE OF THE EXISTING BRIDGE INDICATED ON THE PLANS IS FROM THE BEST INFORMATION AVAILABLE. SINCE THIS INFORMATION IS SHOWN FOR THE CONVENIENCE OF THE CONTRACTOR, THE CONTRACTOR SHALL HAVE NO CLAIM WHATSOEVER AGAINST THE DEPARTMENT OF TRANSPORTATION FOR ANY DELAYS OR ADDITIONAL COST INCURRED BASED ON DIFFERENCES BETWEEN THE EXISTING BRIDGE SUBSTRUCTURE SHOWN ON THE PLANS AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

REMOVAL OF THE EXISTING BRIDGE SHALL BE PERFORMED IN A MANNER THAT PREVENTS DEBRIS FROM FALLING INTO THE WATER. THE CONTRACTOR SHALL SUBMIT DEMOLITION PLANS FOR REVIEW AND REMOVE THE BRIDGE IN ACCORDANCE WITH ARTICLE 402-2 OF THE STANDARD SPECIFICATIONS.

THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH "HEC 18-EVALUATING SCOUR AT BRIDGES".

FOR EROSION CONTROL MEASURES, SEE EROSION CONTROL PLANS.

ASPHALT WEARING SURFACE IS INCLUDED IN ROADWAY QUANTITY ON ROADWAY PLANS.

STEEL SHEET PILING REQUIRED FOR SHORING SHALL BE HOT ROLLED.

FOR LIMITS OF TEMPORARY SHORING FOR MAINTENANCE OF TRAFFIC, SEE TRAFFIC CONTROL PLANS. FOR PAY ITEM FOR TEMPORARY SHORING FOR MAINTENANCE OF TRAFFIC, SEE ROADWAY PLANS.

HYDRAULIC DATA

DESIGN DISCHARGE	-1400 C.F.S.
FREQUENCY OF DESIGN FLOOD	_25 YEARS
DESIGN HIGH WATER ELEVATION	_ 2378.5
DRAINAGE AREA	
BASE DISCHARGE (Q100)	_2050 C.F.S.*
BASE HIGH WATER ELEVATION	2379.83

OVERTOPPING DATA

OVERTOPPING DISCHARGE	. 5270	C.F.S.
FREQUENCY OF OVERTOPPING FLOOD		
OVERTOPPING FLOOD ELEVATION	2385.	8 * *
* FEMA		

**OVERTOPPING ELEVATION AT STATION 17+86 -L-

	TOTAL BILL OF MATERIAL																
	REMOVAL OF EXISTING STRUCTURE	PILE EXCAVATION IN SOIL	PILE EXCAVATION NOT IN SOIL	UNCLASSIFIED STRUCTURE EXCAVATION	CLASS A CONCRETE	BRIDGE APPROACH SLABS	REINFORCING STEEL	HP STE	2 12 X 53 EEL PILES	TWO BAR METAIL RAIL	1'-2" × 2'-9 ^l / ₂ " CONCRETE PARAPET	RIP RAP CLASS II (2'-0" THICK)	GEOTEXTILE FOR DRAINAGE	ELASTOMERIC BEARINGS	3'-(PRE C(BC)'' X 2'-9'' STRESSED ONCRETE X BEAMS	ASBESTOS ASSESSMENT
	LUMP SUM	LIN.FT.	LIN.FT.	LUMP SUM	CU. YDS.	LUMP SUM	LBS.	NO.	LIN.FT.	LIN.FT.	LIN.FT.	TONS	SQ. YDS.	LUMP SUM	NO.	LIN.FT.	LUMP SUM
SUPERSTRUCTURE						LUMP SUM				144.37	160.00			LUMP SUM	11	880.00	
END BENT NO. 1					26.2		3670	7	180			130	140				
END BENT NO. 2		25	46		26.2		3670	7	105			125	135				
TOTAL	LUMP SUM	25	46	LUMP SUM	52.4	LUMP SUM	7340	14	285	144.37	160.00	255	275	LUMP SUM	11	880.00	LUMP SUM

PROJECT NO. B-5396

BUNCOMBE COUNTY

STATION: 17+00.00 -L-

SHEET 2 OF 2

20125

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

GENERAL DRAWING
FOR BRIDGE OVER
STONY FORK CREEK ON SR 1103
BETWEEN SR 1102 AND NC 151

REVISIONS

SHEET NO.

DOCUMENT NOT CONSIDERED
FINAL UNLESS ALL
SIGNATURES COMPLETED

REVISIONS

SHEET NO.

BY:
DATE:
NO.
BY:
DATE:
S-2

TOTAL
SHEETS
18

DRAWN BY: B.N. GRADY

CHECKED BY: M.G. CHEEK

DATE: 1/16

LOAD AND RESISTANCE FACTOR RATING (LRFD) SUMMARY FOR PRESTRESSED CONCRETE GIRDERS STRENGTH I LIMIT STATE SERVICE III LIMIT STATE MOMENT SHEAR MOMENT DISTRIBUTION FACTORS (DF) ROLLING RATING GIRDER GIRDER CONT DIST/ LEFT SPAN DIST LEFT SPAN STI CT(DI: FA($\langle 1 \rangle$ 1.179 1.75 0.268 39.224 0.584 1.27 7.845 0.268 1.18 39.224 N/A 1.75 EL HL-93(Inv)0.80 Α 0.584 1.64 1.644 39.224 HL-93(0pr) 1.35 0.268 2.27 EL 7.845 N/A EL DESIGN $\langle 2 \rangle$ LOAD 36.000 1.564 56.305 1.75 2.33 39.224 0.584 39.224 1.6 1.56 HS-20(Inv) 0.268 EL 7.845 0.80 0.268 RATING 36.000 39.224 0.584 HS-20(0pr) 2.077 74.771 1.35 0.268 3.02 EL 2.08 7.845 N/A EL 4.81 13.500 3.58 48.335 0.268 39.224 0.584 0.268 3.58 39.224 6.66 EL SNSH EL 7.845 0.80 0.584 4.92 3.41 20.000 2.647 52.933 EL 39.224 0.268 2.65 39.224 SNGARBS2 0.268 EL 7.845 0.80 0.584 3.16 39.224 22.000 2.498 0.268 39.224 7.845 0.268 2.50 SNAGRIS2 54.946 4.64 EL 0.80 EL 0.584 27.250 39.224 1.781 48.534 0.268 3.31 EL 39.224 2.4 0.268 1.78 SNCOTTS3 7.845 0.80 1.4 EL 34.925 51.695 0.268 2.75 EL 39.224 0.584 1.98 0.268 1.48 39.224 SNAGGRS4 1.48 7.845 0.80 EL 35.550 51.477 0.268 2.69 0.584 39.224 EL 2 1.45 SNS5A 1.448 39.224 EL 7.845 0.80 0.268 39.224 1.325 52.939 0.268 39.224 0.584 1.82 0.268 SNS6A 39.950 2.46 EL 7.845 1.33 EL 0.80 1.79 39.224 SNS7B 42.000 1.262 52.996 0.268 2.35 EL 39.224 0.584 7.845 0.80 0.268 1.26 EL LEGAL LOAD 39.224 0.584 33.000 53.292 0.268 2.17 0.268 39.224 TNAGRIT3 1.615 EL EL 7.845 0.80 1.61 RATING 39.224 0.584 2.12 39.224 TNT4A 33.075 1.621 53.618 0.268 3.01 EL EL 7.845 0.80 0.268 1.62 EL 0.584 1.89 TNT6A 41.600 1.322 55.003 0.268 2.46 EL 39.224 7.845 0.80 0.268 1.32 39.224 EL 39.224 42.000 1.327 55.736 0.268 2.47 EL 39.224 0.584 1.86 7.845 0.268 1.33 TNT7A EL 0.80 57.481 0.268 2.54 39.224 0.584 1.75 7.845 0.268 1.37 39.224 42.000 1.369 EL 0.80 TNT7B 1.4 EL 0.584 1.69 43.000 1.305 56.12 0.268 2.43 39.224 7.845 0.80 0.268 39.224 TNAGRIT4 EL 1.31 1.4 EL 1.232 55.443 0.268 2.29 0.584 1.68 0.268 1.23 39.224 TNAGT5A 45.000 EL 39.224 7.845 0.80 1.4 EL 45.000 **(3)** 1.218 54.832 1.4 0.268 2.27 EL 39.224 EL 39.224 0.584 1.22 TNAGT5B 1.61 0.80 0.268

LOAD FACTORS:

DESIGN LOAD STRENGTH I 1.25 1.50 SERVICE III 1.00 1.00

NOTES:

MINIMUM RATING FACTORS ARE BASED ON THE STRENGTH I AND SERVICE III LIMIT STATES.

ALLOWABLE STRESSES FOR SERVICE III LIMIT STATE ARE AS REQUIRED FOR DESIGN.

COMMENTS:

-

7

4.

(#) CONTROLLING LOAD RATING

1 DESIGN LOAD RATING (HL-93)

2 DESIGN LOAD RATING (HS-20)

(3) LEGAL LOAD RATING **

** SEE CHART FOR VEHICLE TYPE

GIRDER LOCATION

I - INTERIOR GIRDER

EL - EXTERIOR LEFT GIRDER

ER - EXTERIOR RIGHT GIRDER

PROJECT NO. B-5396

BUNCOMBE COUNTY

STATION: 17+00.00 -L-

DEPARTMENT OF TRANSPORTATION
RALEIGH

STANDARD

LRFR SUMMARY FOR 80'BOX BEAM UNIT 105° SKEW (NON-INTERSTATE TRAFFIC)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED 2 A SHEET NO. BY: DATE: NO. BY: DATE: STOTAL SHEETS 18

LRFR SUMMARY


ASSEMBLED BY: M. POOLE DATE: 10-15 CHECKED BY: B. N. GRADY DATE: 11-15

DRAWN BY: TMG II/II

CHECKED BY : AAC II/II

06-JAN-2016 13:39 R:\Structures\FinalPlans\B5396_SD_LRFR.dgn

STD. NO. 33LRFR1_75&105S_80L

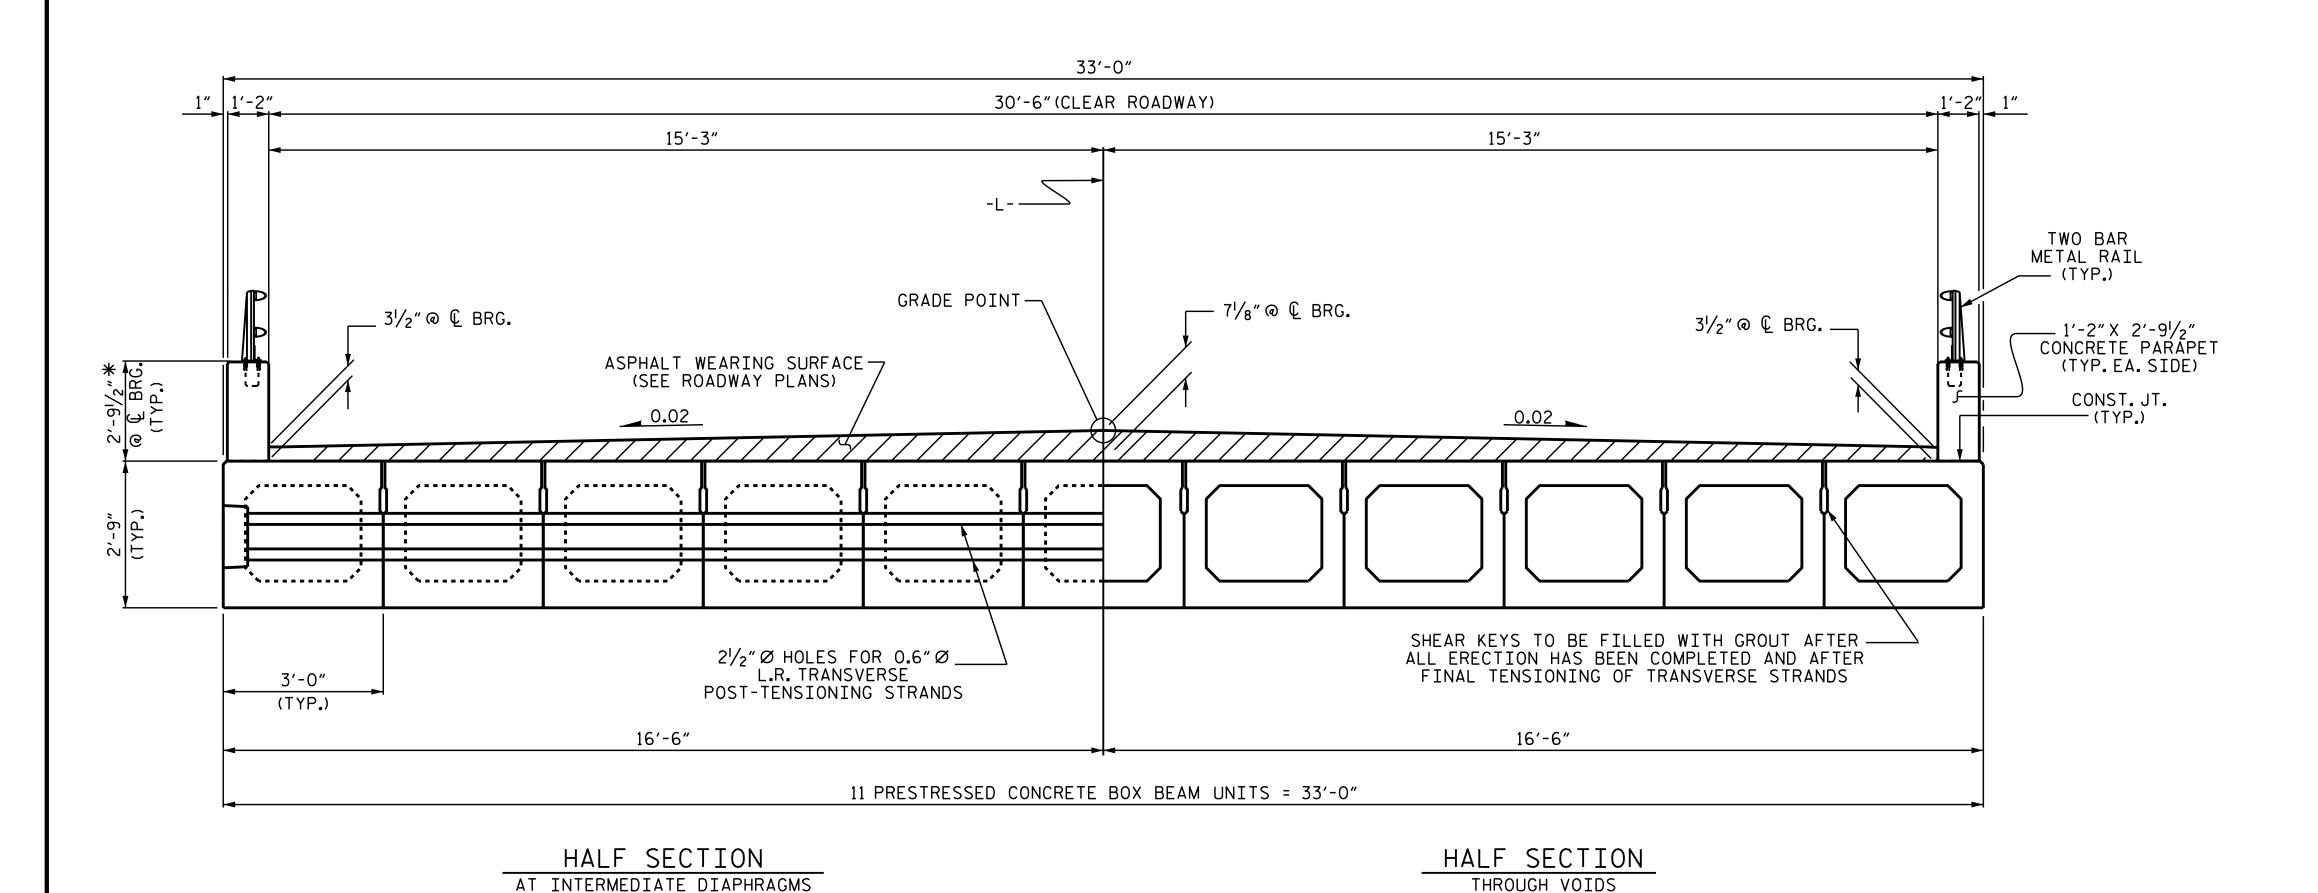


TYPICAL SECTION

* THE MAXIMUM PARAPET HEIGHT AND ASPHALT THICKNESS IS SHOWN. THE HEIGHT OF THE PARAPET AND ASPHALT THICKNESS VARIES WHILE THE TOP OF THE PARAPET FOLLOWS

THE PROFILE OF THE GUTTERLINE. FOR CONCRETE PARAPET HEIGHT DETAILS AND ASPHALT THICKNESS, SEE SHEET 5 OF 5.

FIXED END

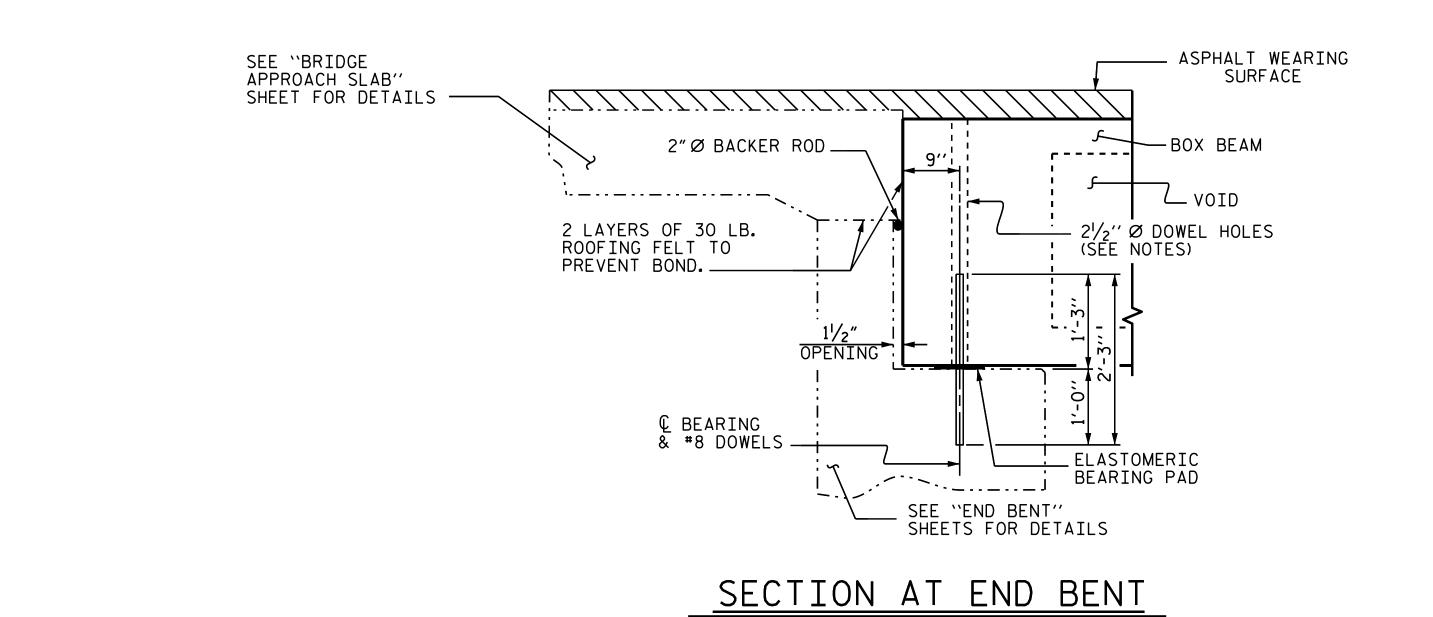

PERMITTED THREADED INSERT
CAST IN OUTSIDE FACE OF
EXTERIOR UNIT AND
RECESSED % SIZE TO BE
DETERMINED BY CONTRACTOR.

THREADED INSERT DETAIL

NOTES

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL REINFORCING STEEL CAST WITH THE BOX BEAM SECTIONS SHALL BE GRADE 60 AND SHALL BE INCLUDED IN THE UNIT PRICE BID FOR PRESTRESSED CONCRETE BOX BEAMS.

FLAME CUTTING OF THE TRANSVERSE POST-TENSIONING STRAND IS NOT ALLOWED.

RECESSES FOR TRANSVERSE STRANDS SHALL BE GROUTED AFTER THE TENSIONING OF THE STRANDS.

THE 21/2" Ø DOWEL HOLES AT FIXED ENDS OF BOX BEAM SECTIONS SHALL BE FILLED WITH NON-SHRINK GROUT.

THE BACKER RODS SHALL CONFORM TO THE REQUIREMENTS OF TYPE M BOND BREAKER. SEE SECTION 1028 OF THE STANDARD SPECIFICATIONS.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE BOX BEAM UNIT SHALL BE DONE WHEN THE CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN 6000 PSI.

ALL REINFORCING STEEL IN CONCRETE PARAPETS SHALL BE EPOXY COATED.

PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE BOX BEAM UNIT ENDS.

APPLY EPOXY PROTECTIVE COATING TO BOX BEAM UNIT ENDS.

VERTICAL GROOVED CONTRACTION JOINTS, 1/2" IN DEPTH, SHALL BE TOOLED IN ALL EXPOSED FACES OF THE CONCRETE PARAPET AND IN ACCORDANCE WITH ARTICLE 825-10(B) OF THE STANDARD SPECIFICATIONS. A VERTICAL CONTRACTION JOINT SHALL BE LOCATED AT EACH THIRD POINT BETWEEN CONCRETE PARAPET EXPANSION JOINTS. ONLY ONE CONTRACTION JOINT IS REQUIRED AT MIDPOINT OF CONCRETE PARAPET SEGMENTS LESS THAN 20 FEET IN LENGTH AND NO CONTRACTION JOINTS ARE REQUIRED FOR THOSE SEGMENTS LESS THAN 10 FEET IN LENGTH.

THE LOCATION OF THE VOID DRAINS MAY BE SHIFTED SLIGHTLY WHERE NECESSARY TO CLEAR PRESTRESSING STRANDS OR TRANSVERSE REINFORCING STEEL.

FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

THE PERMITTED THREADED INSERTS ARE DETAILED AS AN OPTION FOR THE CONTRACTOR TO ATTACH FALSEWORK AND FORMWORK DURING CONSTRUCTION.

THE PERMITTED THREADED INSERTS IN THE EXTERIOR UNITS SHALL BE SIZED BY THE CONTRACTOR, SPACED AT 4'-O"CENTERS AND GALVANIZED IN ACCORDANCE WITH SECTION 1076 OF THE STANDARD SPECIFICATIONS. STAINLESS STEEL THREADED INSERTS MAY BE USED AS AN ALTERNATE.

THE PERMITTED THREADED INSERTS SHALL BE GROUTED BY THE CONTRACTOR IMMEDIATELY FOLLOWING REMOVAL OF THE FALSEWORK.

THE COST OF THE PERMITTED THREADED INSERTS SHALL BE INCLUDED IN THE PRICE BID FOR THE PRECAST UNITS.

PROJECT NO. B-5396

BUNCOMBE COUNTY

STATION: 17+00.00 -L-

SHEET 1 OF 5

20125

2/18/2016

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

3'-0" X 2'-9"
PRESTRESSED CONCRETE
BOX BEAM UNIT

REVISIONS

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

REVISIONS

No. BY: DATE: No. BY: DATE: S-4

SHEET NO. BY: DATE: SHEET NO

18-FEB-2016 10:29
R:\Structures\FinalPlans\B5396_SD_BX.dgn

DATE : <u>10-15</u>


DATE : 12-15


M. POOLE


B. N. GRADY


DRAWN BY

CHECKED BY:

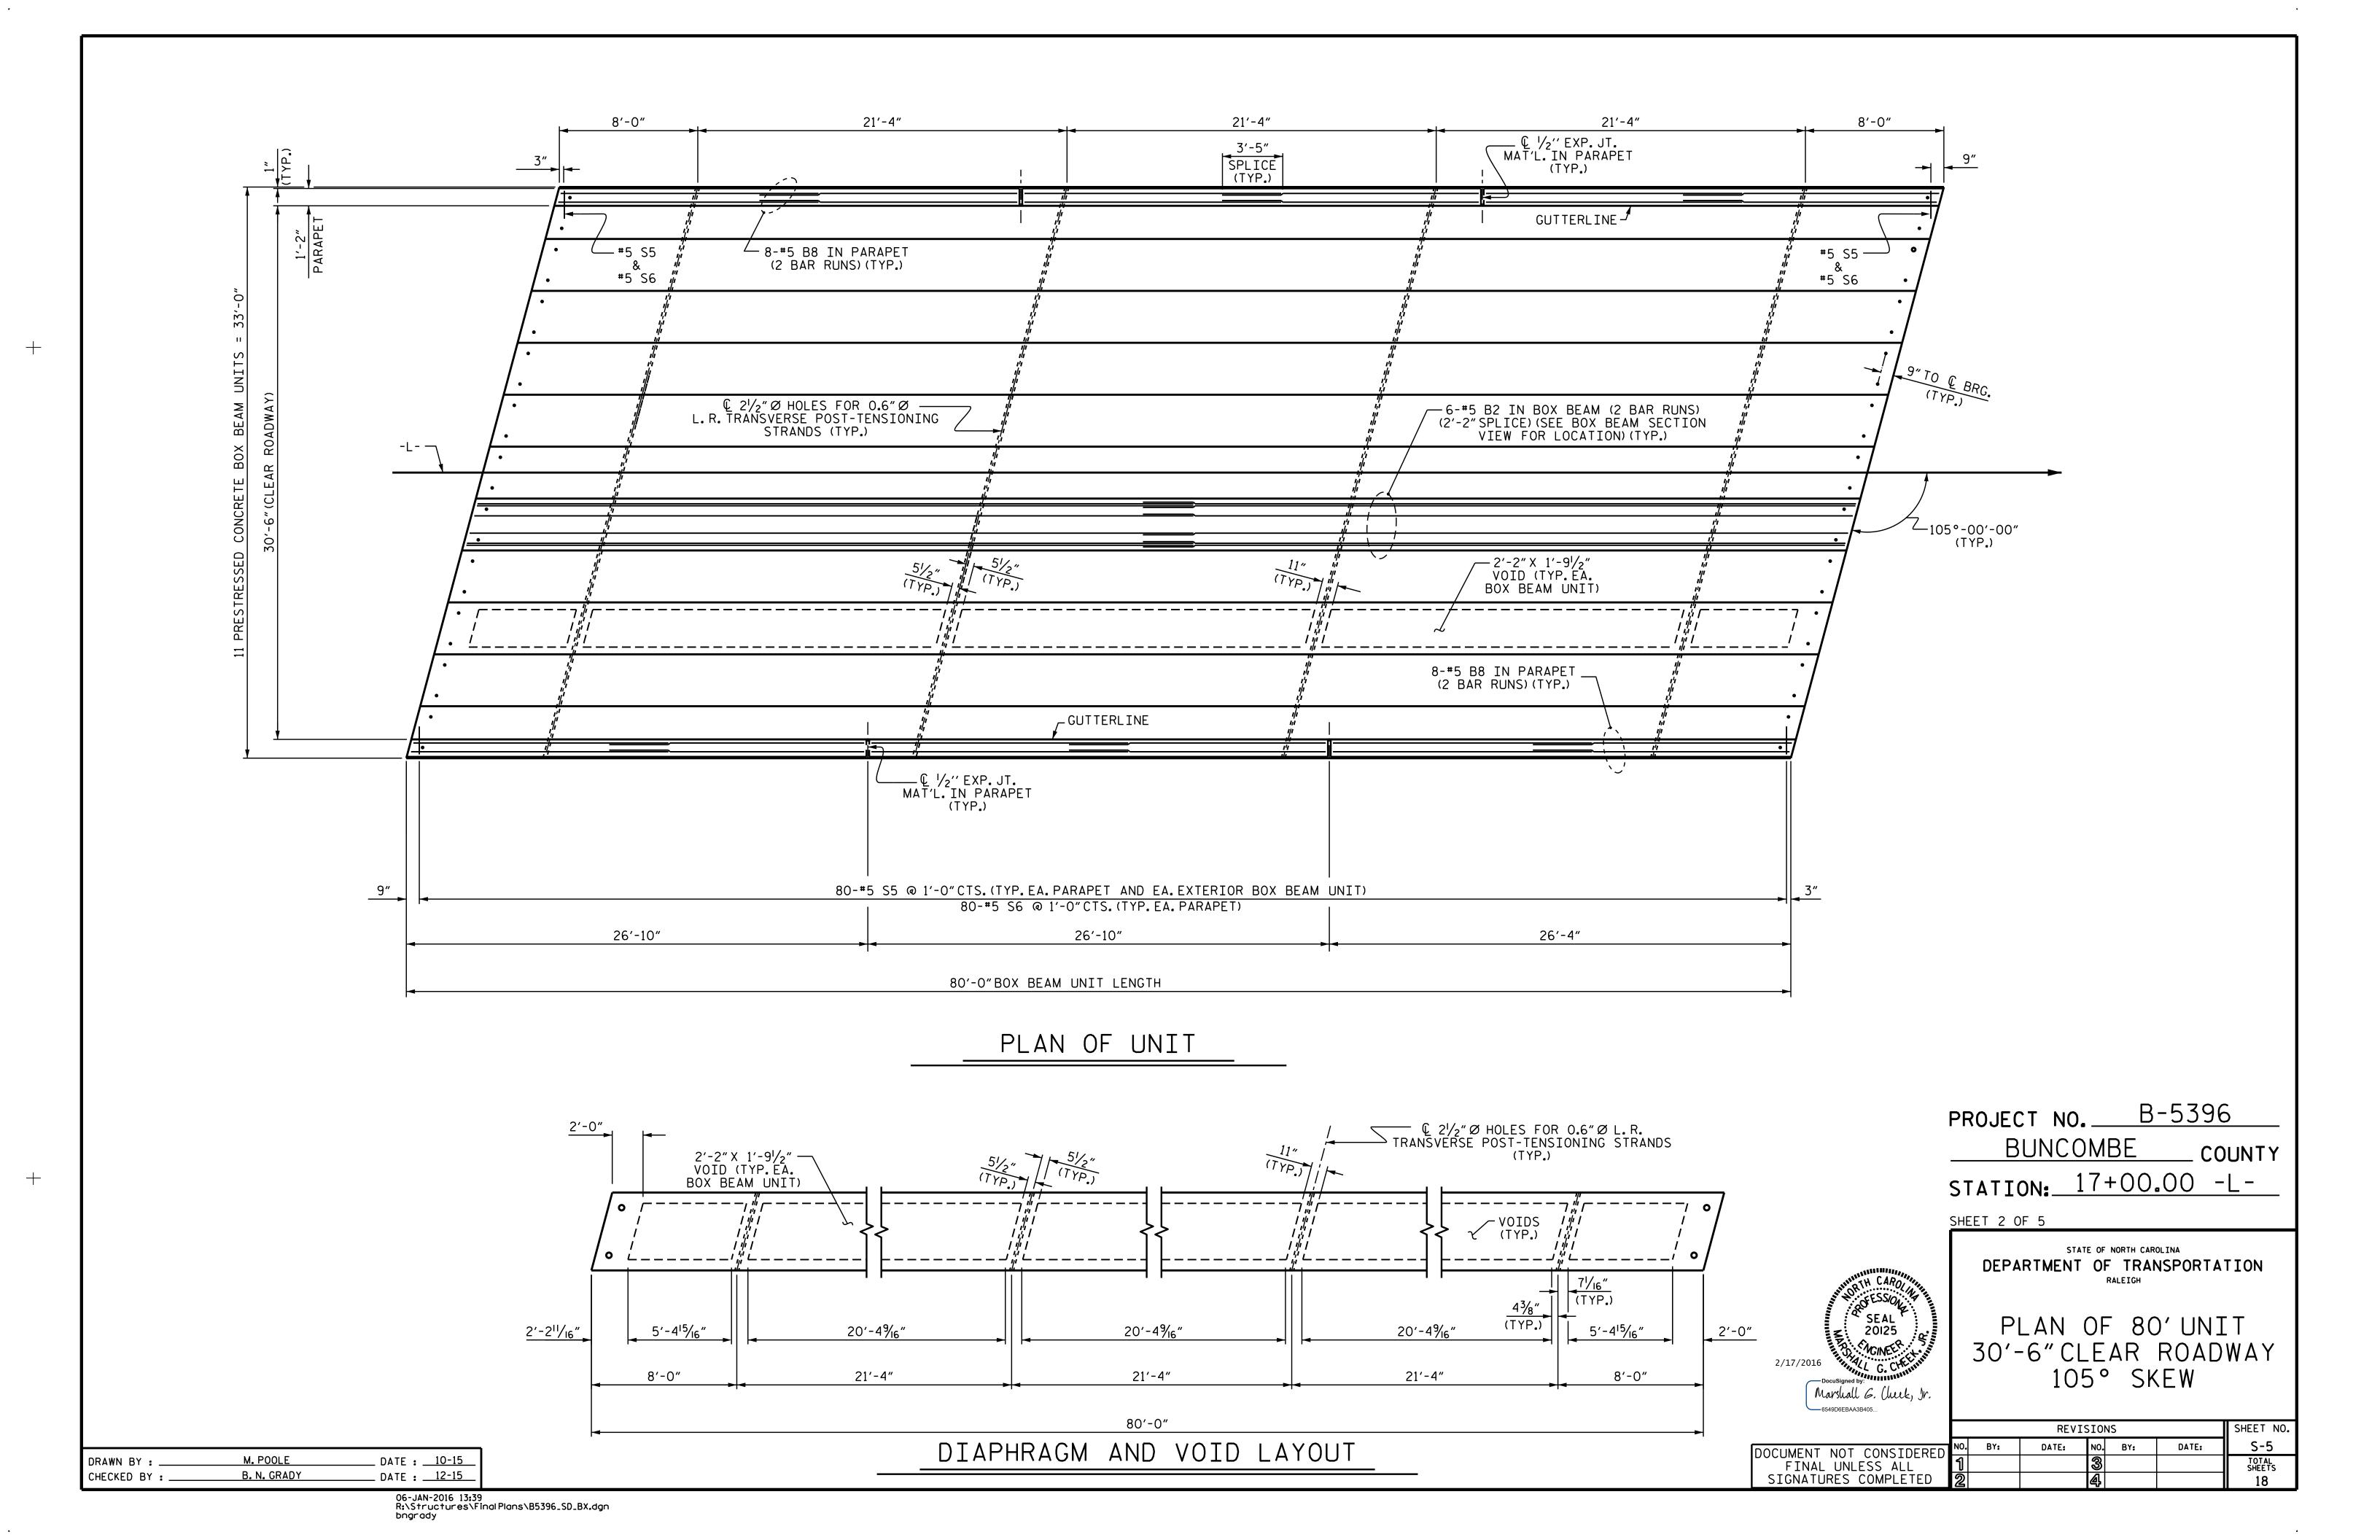

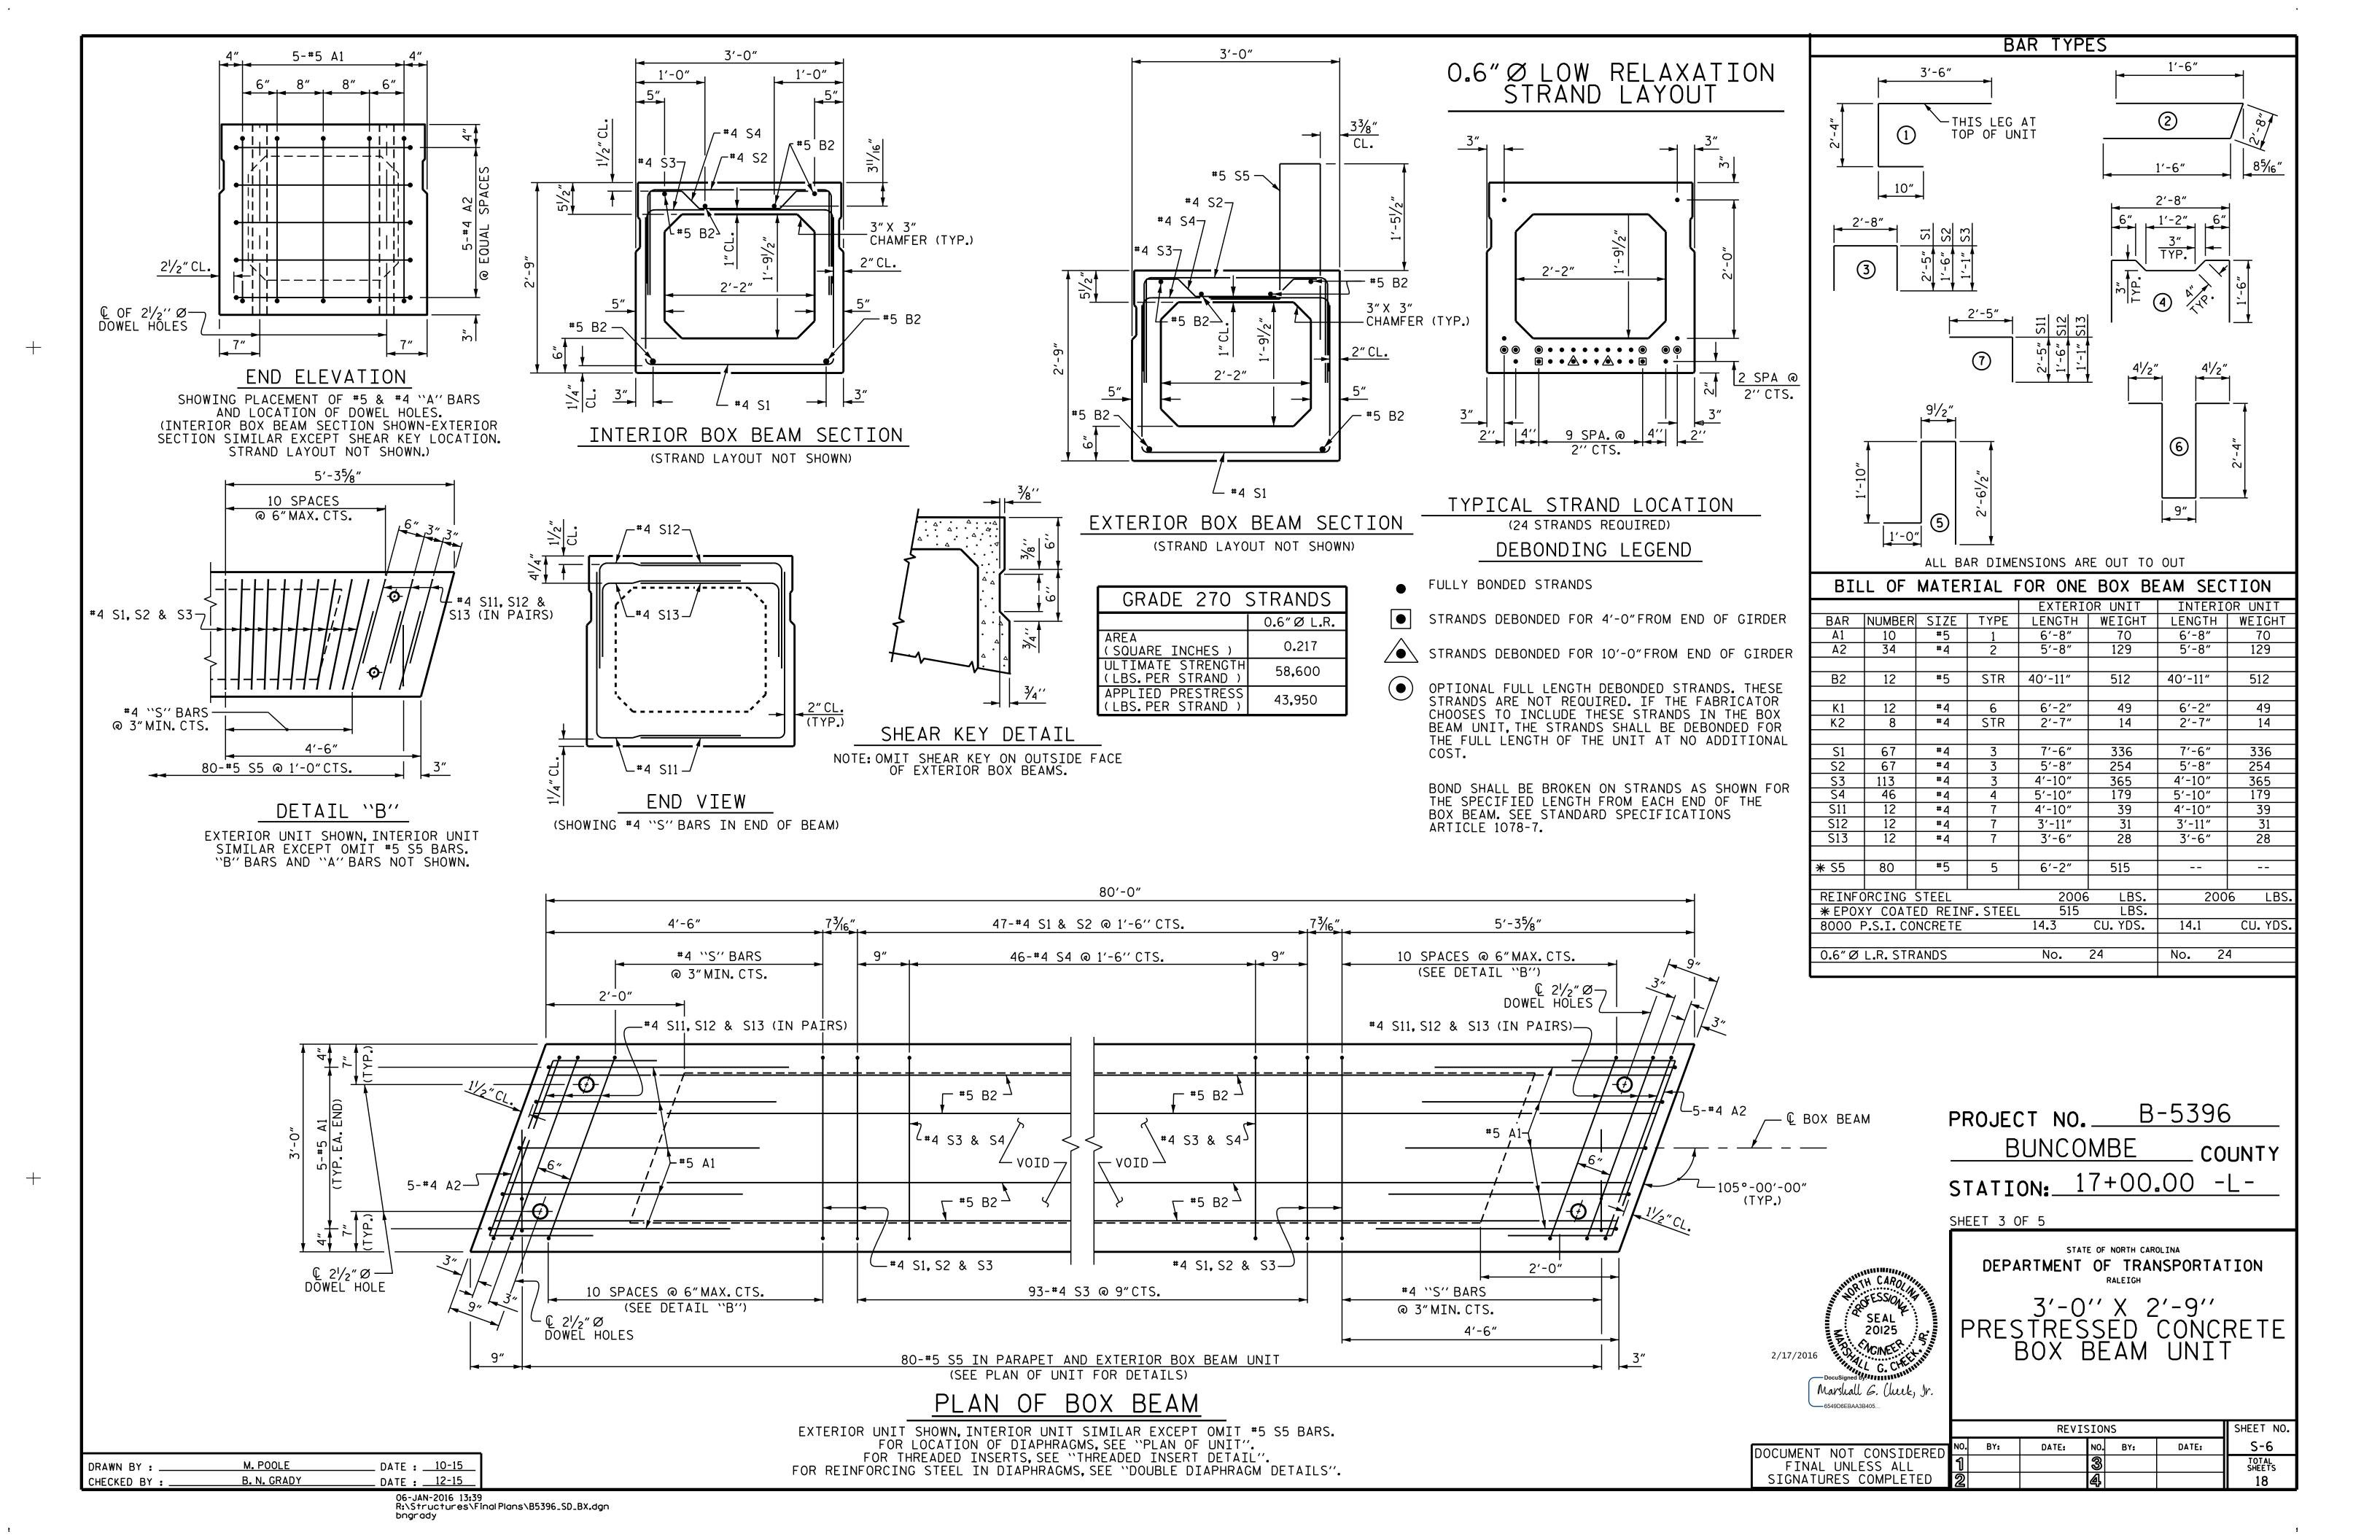


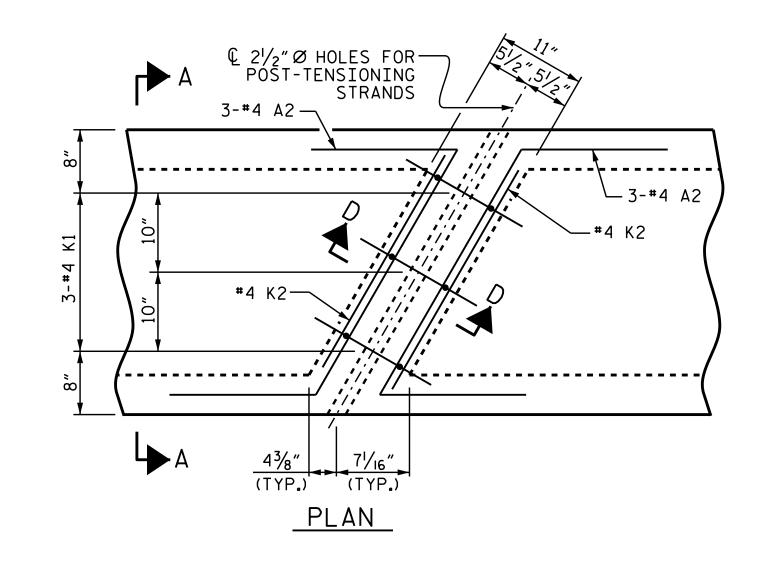

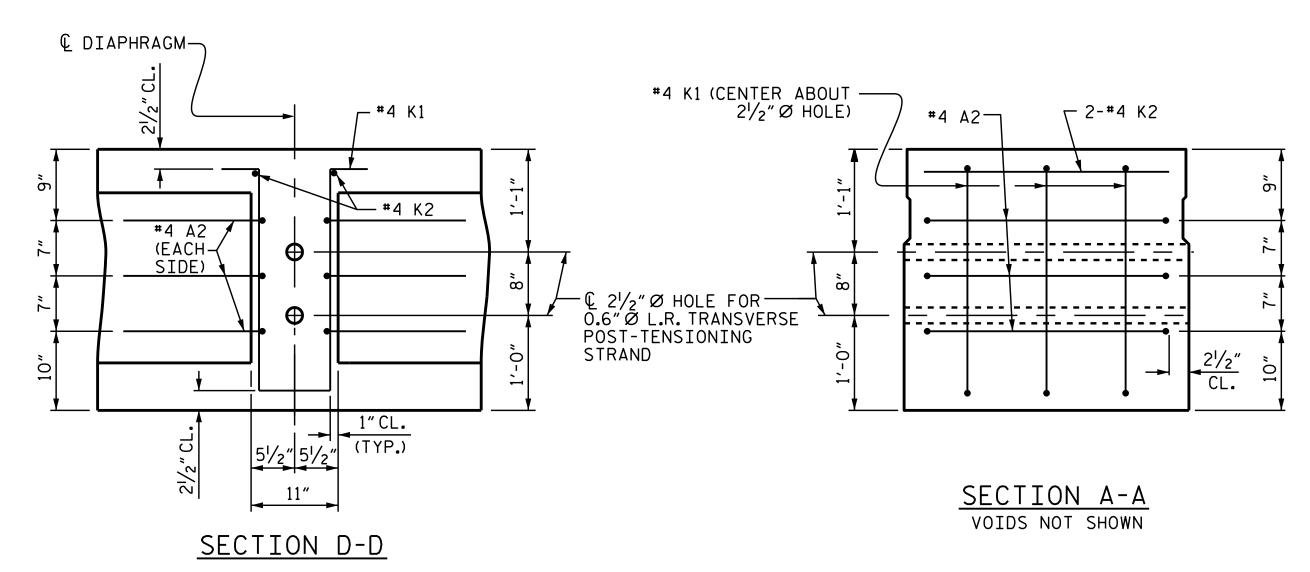

DOUBLE DIAPHRAGM DETAILS


#4 "S" BARS NOT SHOWN. #4 "S" BARS MAY BE SHIFTED SLIGHTLY TO CLEAR $2\frac{1}{2}$ " Ø HOLE.

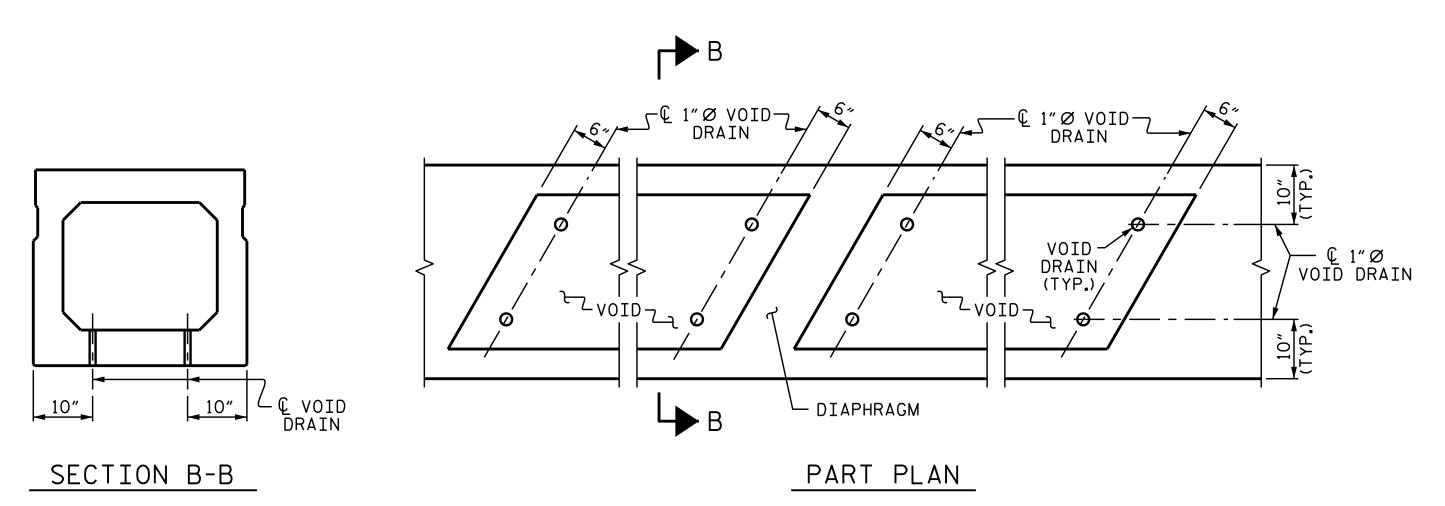



VOID DRAIN DETAILS


(DIMENSIONS SHOWN ARE TYPICAL FOR EACH VOID)

ASSEMBLED BY : M. POOLE CHECKED BY : B. N. GRADY DATE: 10-15 DATE: 11-15 REV. 8/14 MAA/TMG DRAWN BY : DGE II/II CHECKED BY : TMG II/II

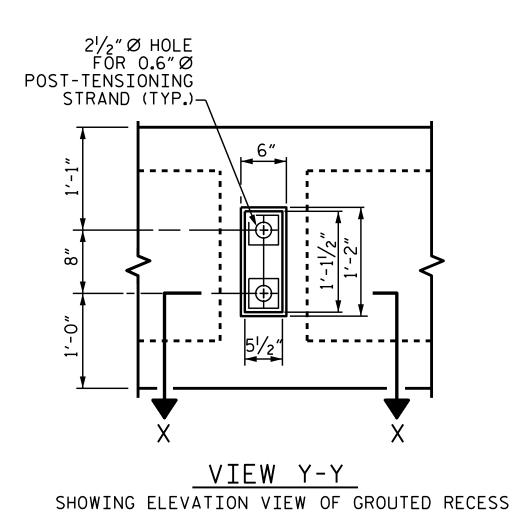

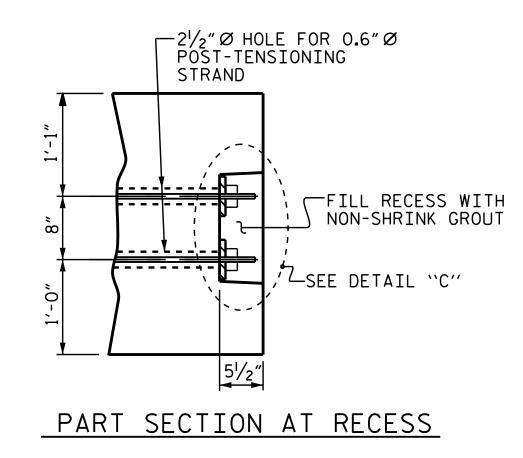

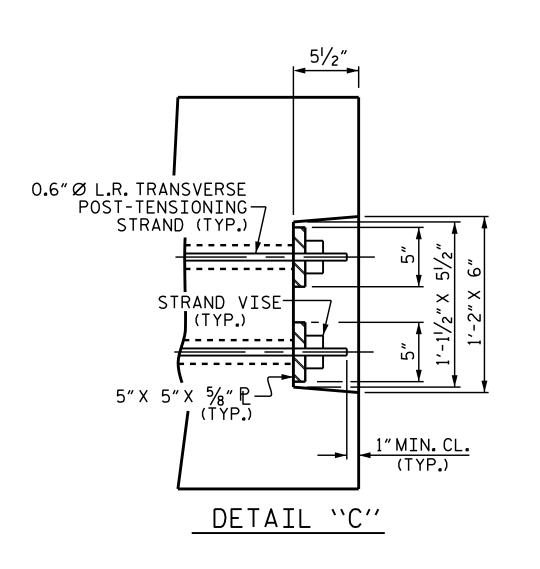

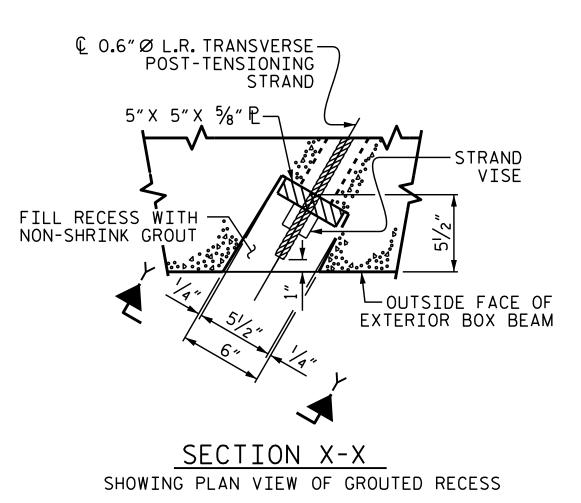

GROUTED RECESS DETAIL AT END OF POST-TENSIONED STRANDS OF EXTERIOR BOX BEAM

DEAD LOAD DEFLECTION AN	ND CAMBER
	3'-0" × 2'-9'
80' BOX BEAM UNIT	0.6″Ø L.R. STRAND
CAMBER (SLAB ALONE IN PLACE)	1³⁄₄″ ∤
DEFLECTION DUE TO SUPERIMPOSED DEAD LOAD**	½″ †
FINAL CAMBER	11/4" ♦
	80' BOX BEAM UNIT CAMBER (SLAB ALONE IN PLACE) DEFLECTION DUE TO SUPERIMPOSED DEAD LOAD**

** INCLUDES FUTURE WEARING SURFACE

B-5396 PROJECT NO._ BUNCOMBE _ COUNTY STATION: 17+00.00 -L-

SHEET 4 OF 5

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION SEAL 3 20125


STANDARD

3'-0" X 2'-9" PRESTRESSED CONCRETE BOX BEAM UNIT

	DOCUMENT 1	TOP	CON	SIDER	ΞD	
	FINAL					NO.
l	SIGNATUR	E2 .	COMP	<u>'LETED</u>		ন

Marshall G. Check, Ir.

		SHEET NO.				
0.	BY:	DATE:	NO.	BY:	DATE:	S-7
0			3			TOTAL SHEETS
2			4			18

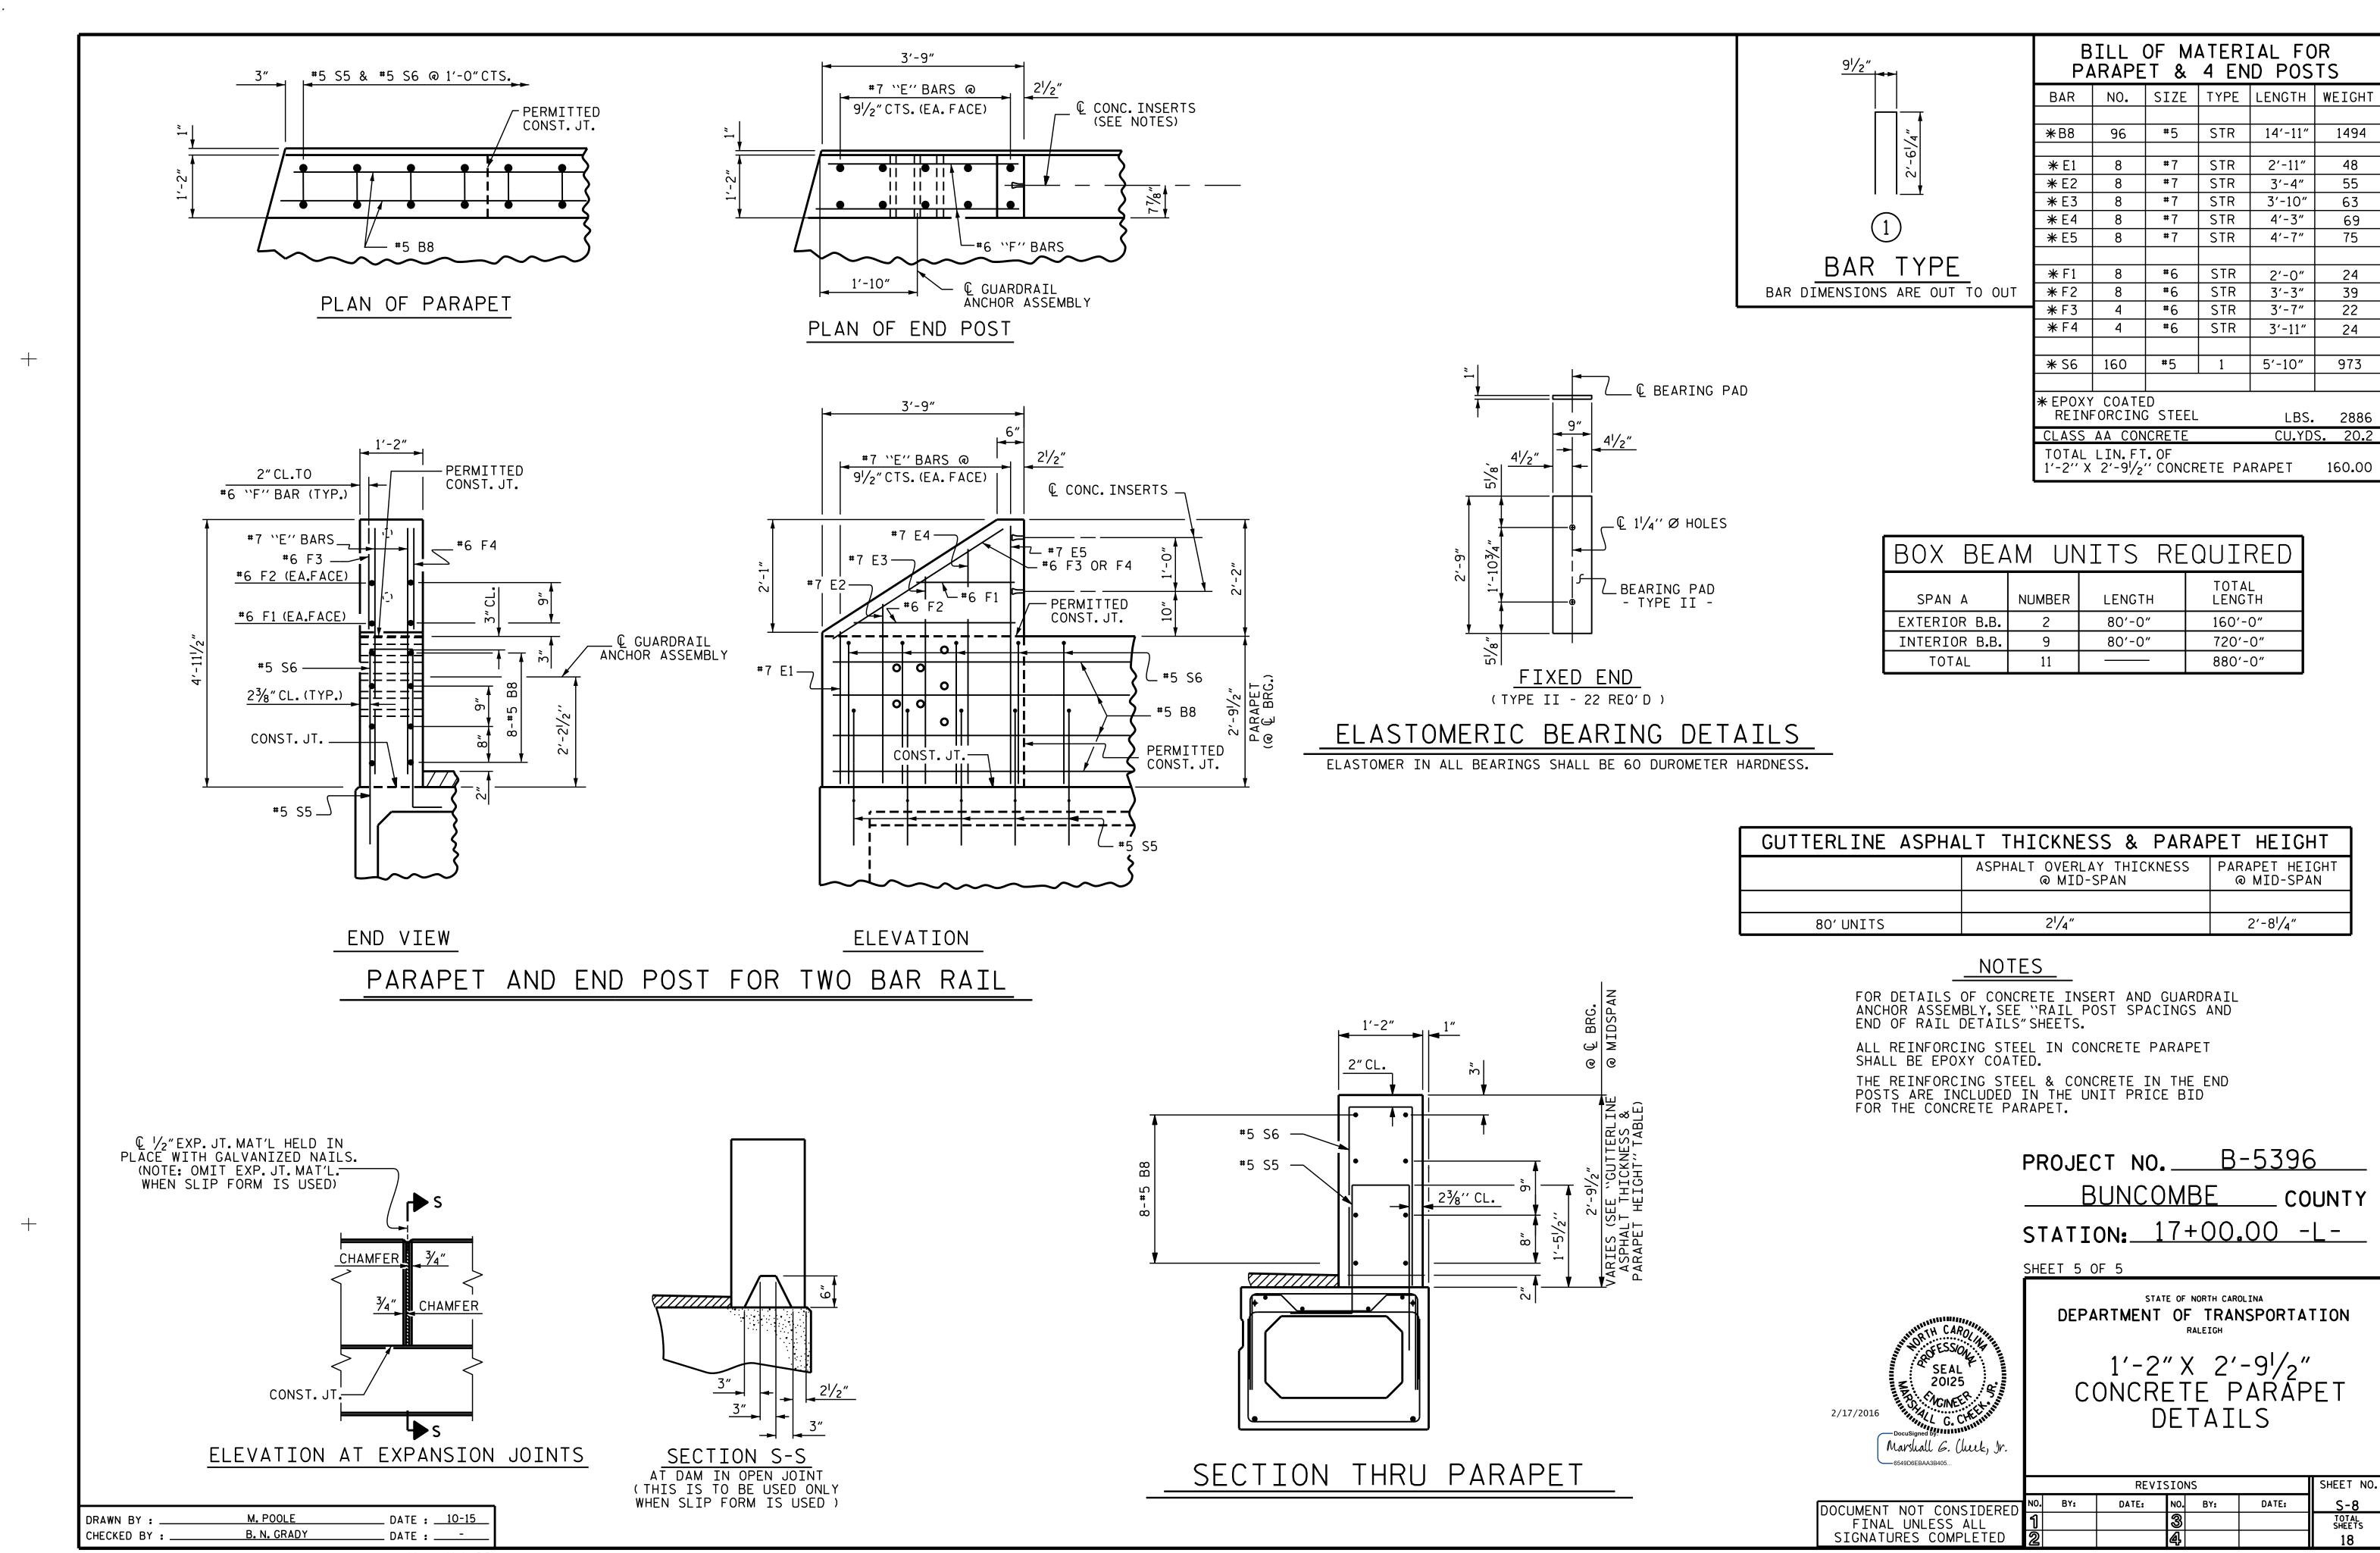



160.00


SHEET NO.


S-8

06-JAN-2016 13:39 R:\Structures\FinalPlans\B5396_SD_BX.dgn

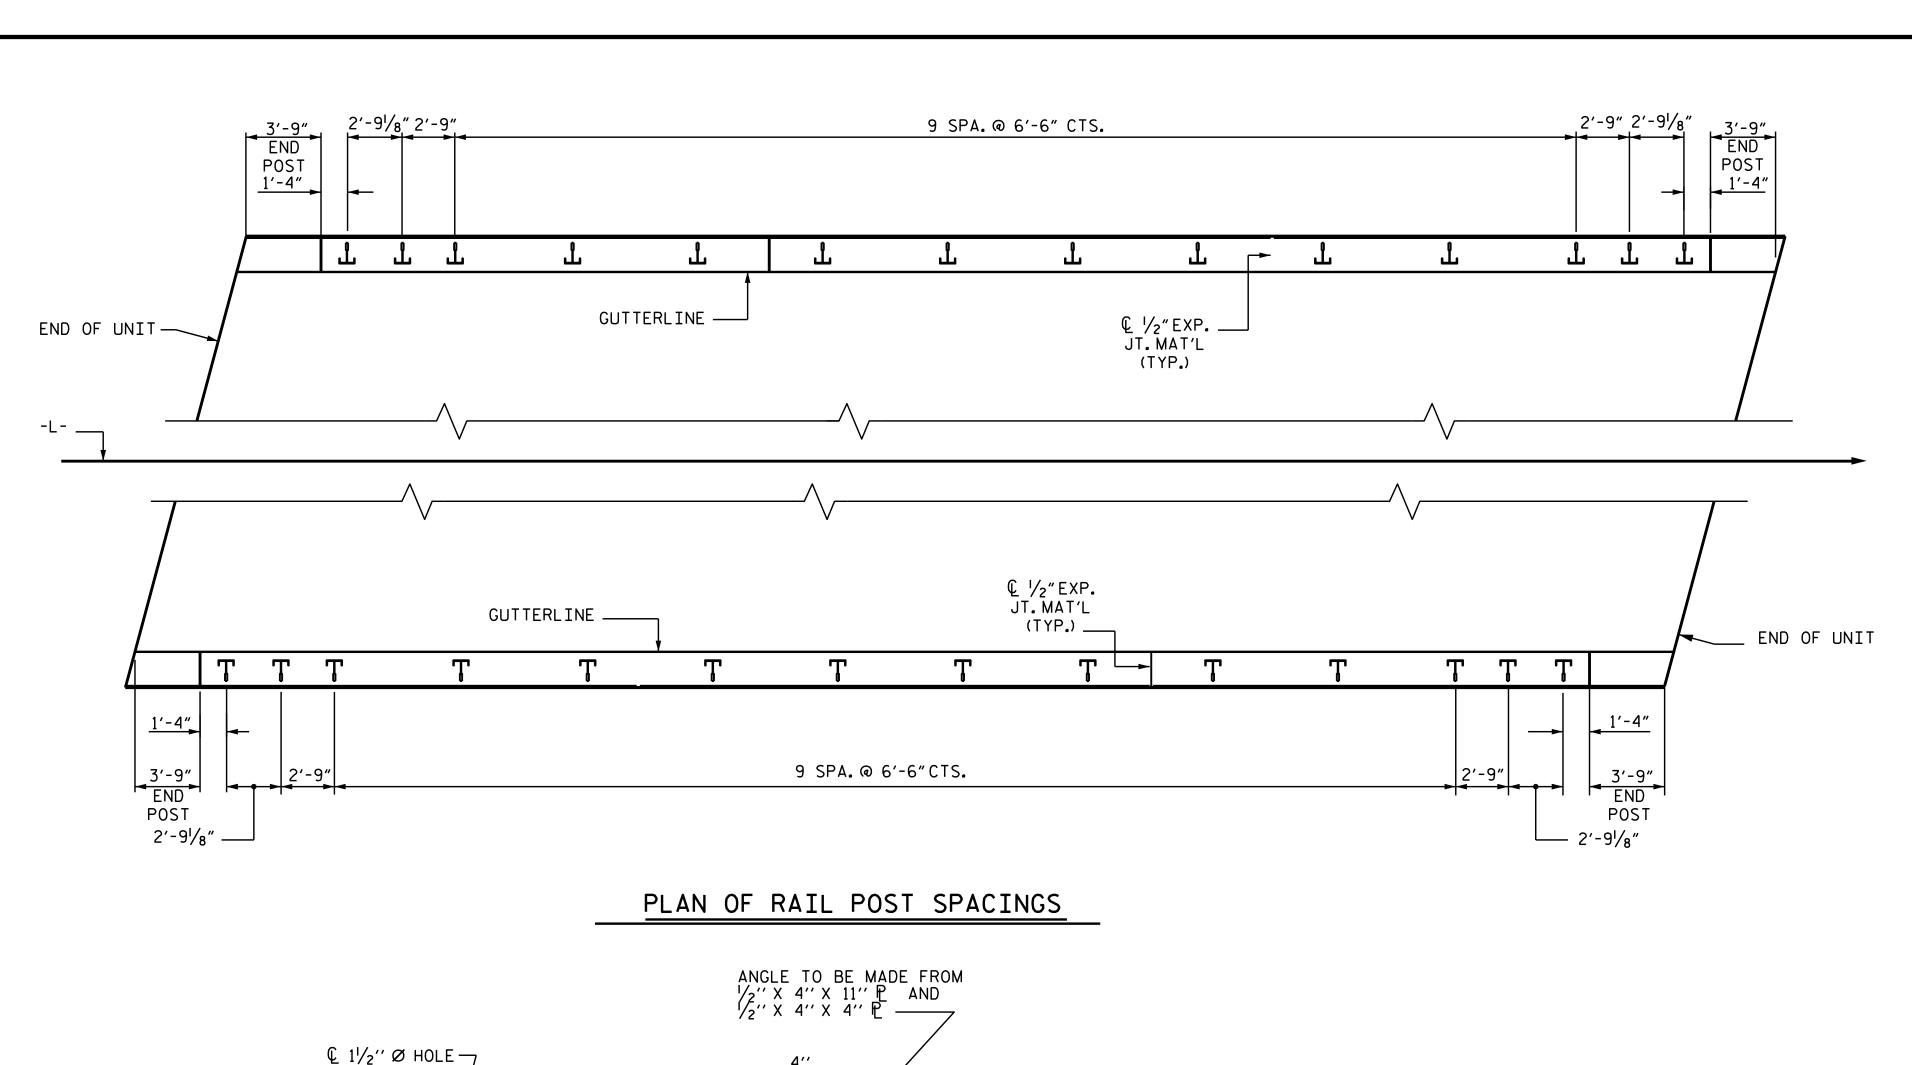

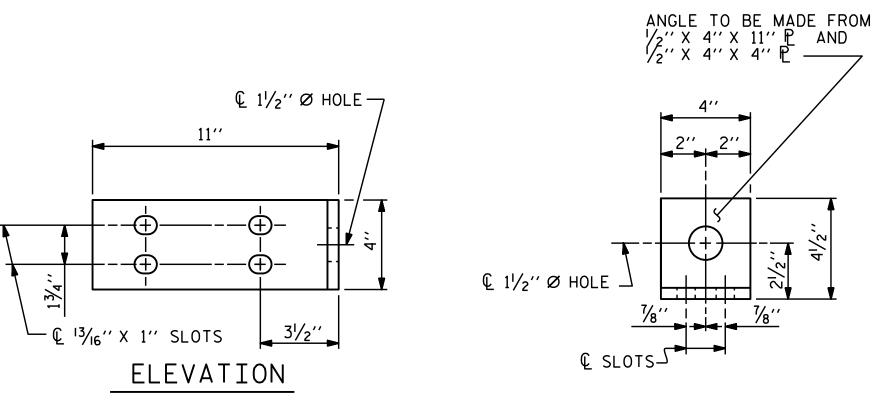

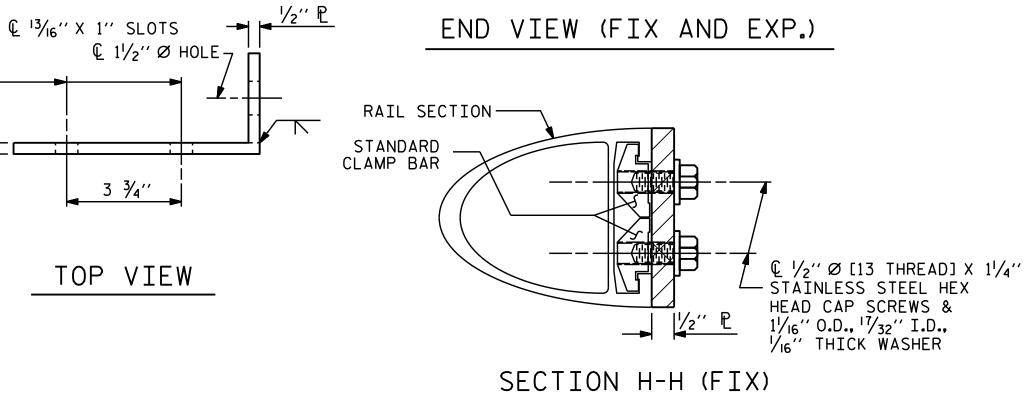

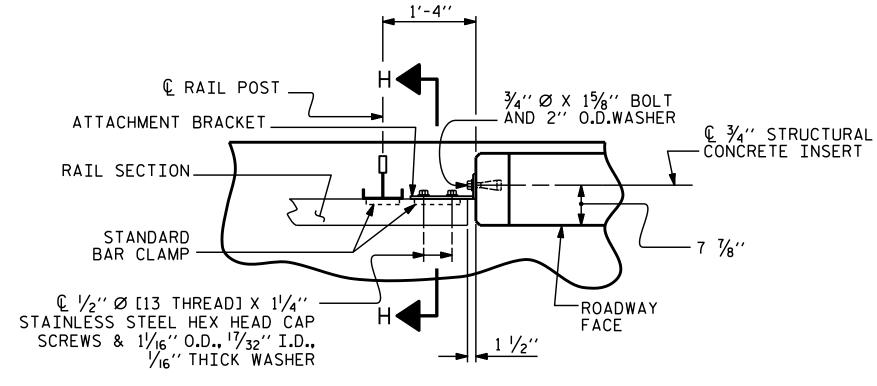

PLAN - RAIL AND END POST

FIXED

<u>DETAILS FOR ATTACHING METAL RAIL TO END POST</u>

ASSEMBLED BY: M. POOLE
CHECKED BY: B. N. GRADY

DRAWN BY: FCJ I/88
CHECKED BY: CRK 3/89

REV. 5/7/03
REV. 5/1/06
REV. 10/1/II

RWW/JTE
TLA/GM
MAA/GM

½′′ ₽

NOTES

STRUCTURAL CONCRETE INSERT

THE STRUCTURAL CONCRETE INSERT ASSEMBLY SHALL CONSIST OF THE FOLLOWING COMPONENTS:

- A. FERRULES SHALL BE MADE FROM STEEL MEETING THE REQUIREMENTS OF AASHTO M169, GRADE 12L14 AND SHALL HAVE A MINIMUM LENGTH OF THREADS OF $1\frac{1}{2}$ ".
- B. 1 ¾''Ø X 15%'' BOLT WITH WASHER.BOLT SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307.BOLT AND WASHER SHALL BE GALVANIZED. (AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLT AND WASHER MAY BE USED AS AN ALTERNATE FOR THE ¾''Ø X 15%'' GALVANIZED BOLT AND WASHER.THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.)
- C. WIRE STRUT SHOWN IN THE CONCRETE INSERT ASSEMBLY DETAIL IS THE MINIMUM ALLOWABLE SIZE AND SHALL HAVE A MINIMUM TENSILE STRENGTH OF 100,000 PSI. AS AN OPTION, A $\frac{7}{16}$ " Ø WIRE STRUT WITH A MINIMUM TENSILE STRENGTH OF 90,000 PSI IS ACCEPTABLE.

NOTES

METAL RAIL TO END POST CONNECTION

THE METAL RAIL TO END POST CONNECTION SHALL CONSIST OF THE FOLLOWING COMPONENTS:


- A. 1/2" PLATES SHALL CONFORM TO AASHTO M270 GRADE 36 AND SHALL BE GALVANIZED AFTER FABRICATION.
- B. $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT SHALL HAVE A WORKING LOAD SHEAR CAPACITY OF 4800 LBS. THE FERRULES SHALL ENGAGE A $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH 2" O.D. WASHER IN PLACE. THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT SHALL HAVE N. C. THREADS.
- C. CAP SCREWS FOR RAIL ATTACHMENT TO ANGLE SHALL CONFORM TO THE REQUIREMENTS OF ASTM F593 ALLOY 305 STAINLESS STEEL. CAP SCREWS TO BE CENTERED IN SLOTS AT 60°F.
- D. STANDARD CLAMP BARS (SEE 2 BAR METAL RAIL SHEET 2 OF 2).
- E. 1/2" Ø PIPE SLEEVES (IF REQUIRED) TO BE GALVANIZED.

THE COST OF THE STANDARD CLAMP BARS AND CAP SCREWS USED IN THE METAL RAIL TO END POST CONNECTION SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR LINEAR FEET OF 1 OR 2 BAR METAL RAILS.

THE $\frac{1}{2}$ " STRUCTURAL CONCRETE INSERT WITH BOLT SHALL BE ASSEMBLED IN THE SHOP.

THE COST OF THE $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT ASSEMBLY, AND THE $\frac{1}{2}$ " PLATES COMPLETE IN PLACE SHALL BE INCLUDED IN THE VARIOUS PAY ITEMS.

THE CONTRACTOR, AT HIS OPTION, MAY USE AN ADHESIVE BONDING SYSTEM IN LIEU OF THE STRUCTURAL CONCRETE INSERT EMBEDDED IN THE END POST. IF THE ADHESIVE BONDING SYSTEM IS USED, THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH WASHER SHALL BE REPLACED WITH A $\frac{3}{4}$ " Ø X $6\frac{1}{2}$ " BOLT AND 2" O.D. WASHER. ALL SPECIFICATIONS THAT APPLY TO THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT SHALL APPLY TO THE $\frac{3}{4}$ " Ø X $6\frac{1}{2}$ " BOLT. FIELD TESTING OF THE ADHESIVE BONDING SYSTEM IS NOT REQUIRED.

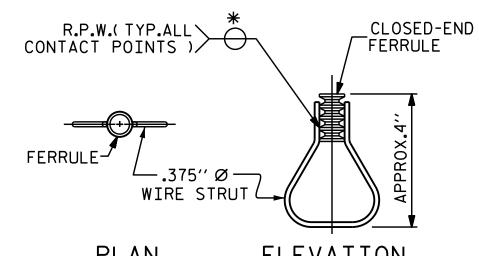

PLAN ELEVATION

STRUCTURAL CONCRETE

* EACH WELDED ATTACHMENT OF WIRE TO FERRULE SHALL DEVELOP THE TENSILE STRENGTH OF THE WIRE.

PROJECT NO. B-5396

BUNCOMBE COUNTY

STATION: 17+00.00 -L-




STATE OF NORTH CAROLINA


DEPARTMENT OF TRANSPORTATION


RALEIGH

STANDARD

			REVIS	OIS	IS		SHEET NO.
CUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S-9
FINAL UNLESS ALL	1			3			TOTAL SHEETS
IGNATURES COMPLETED	2			4			18

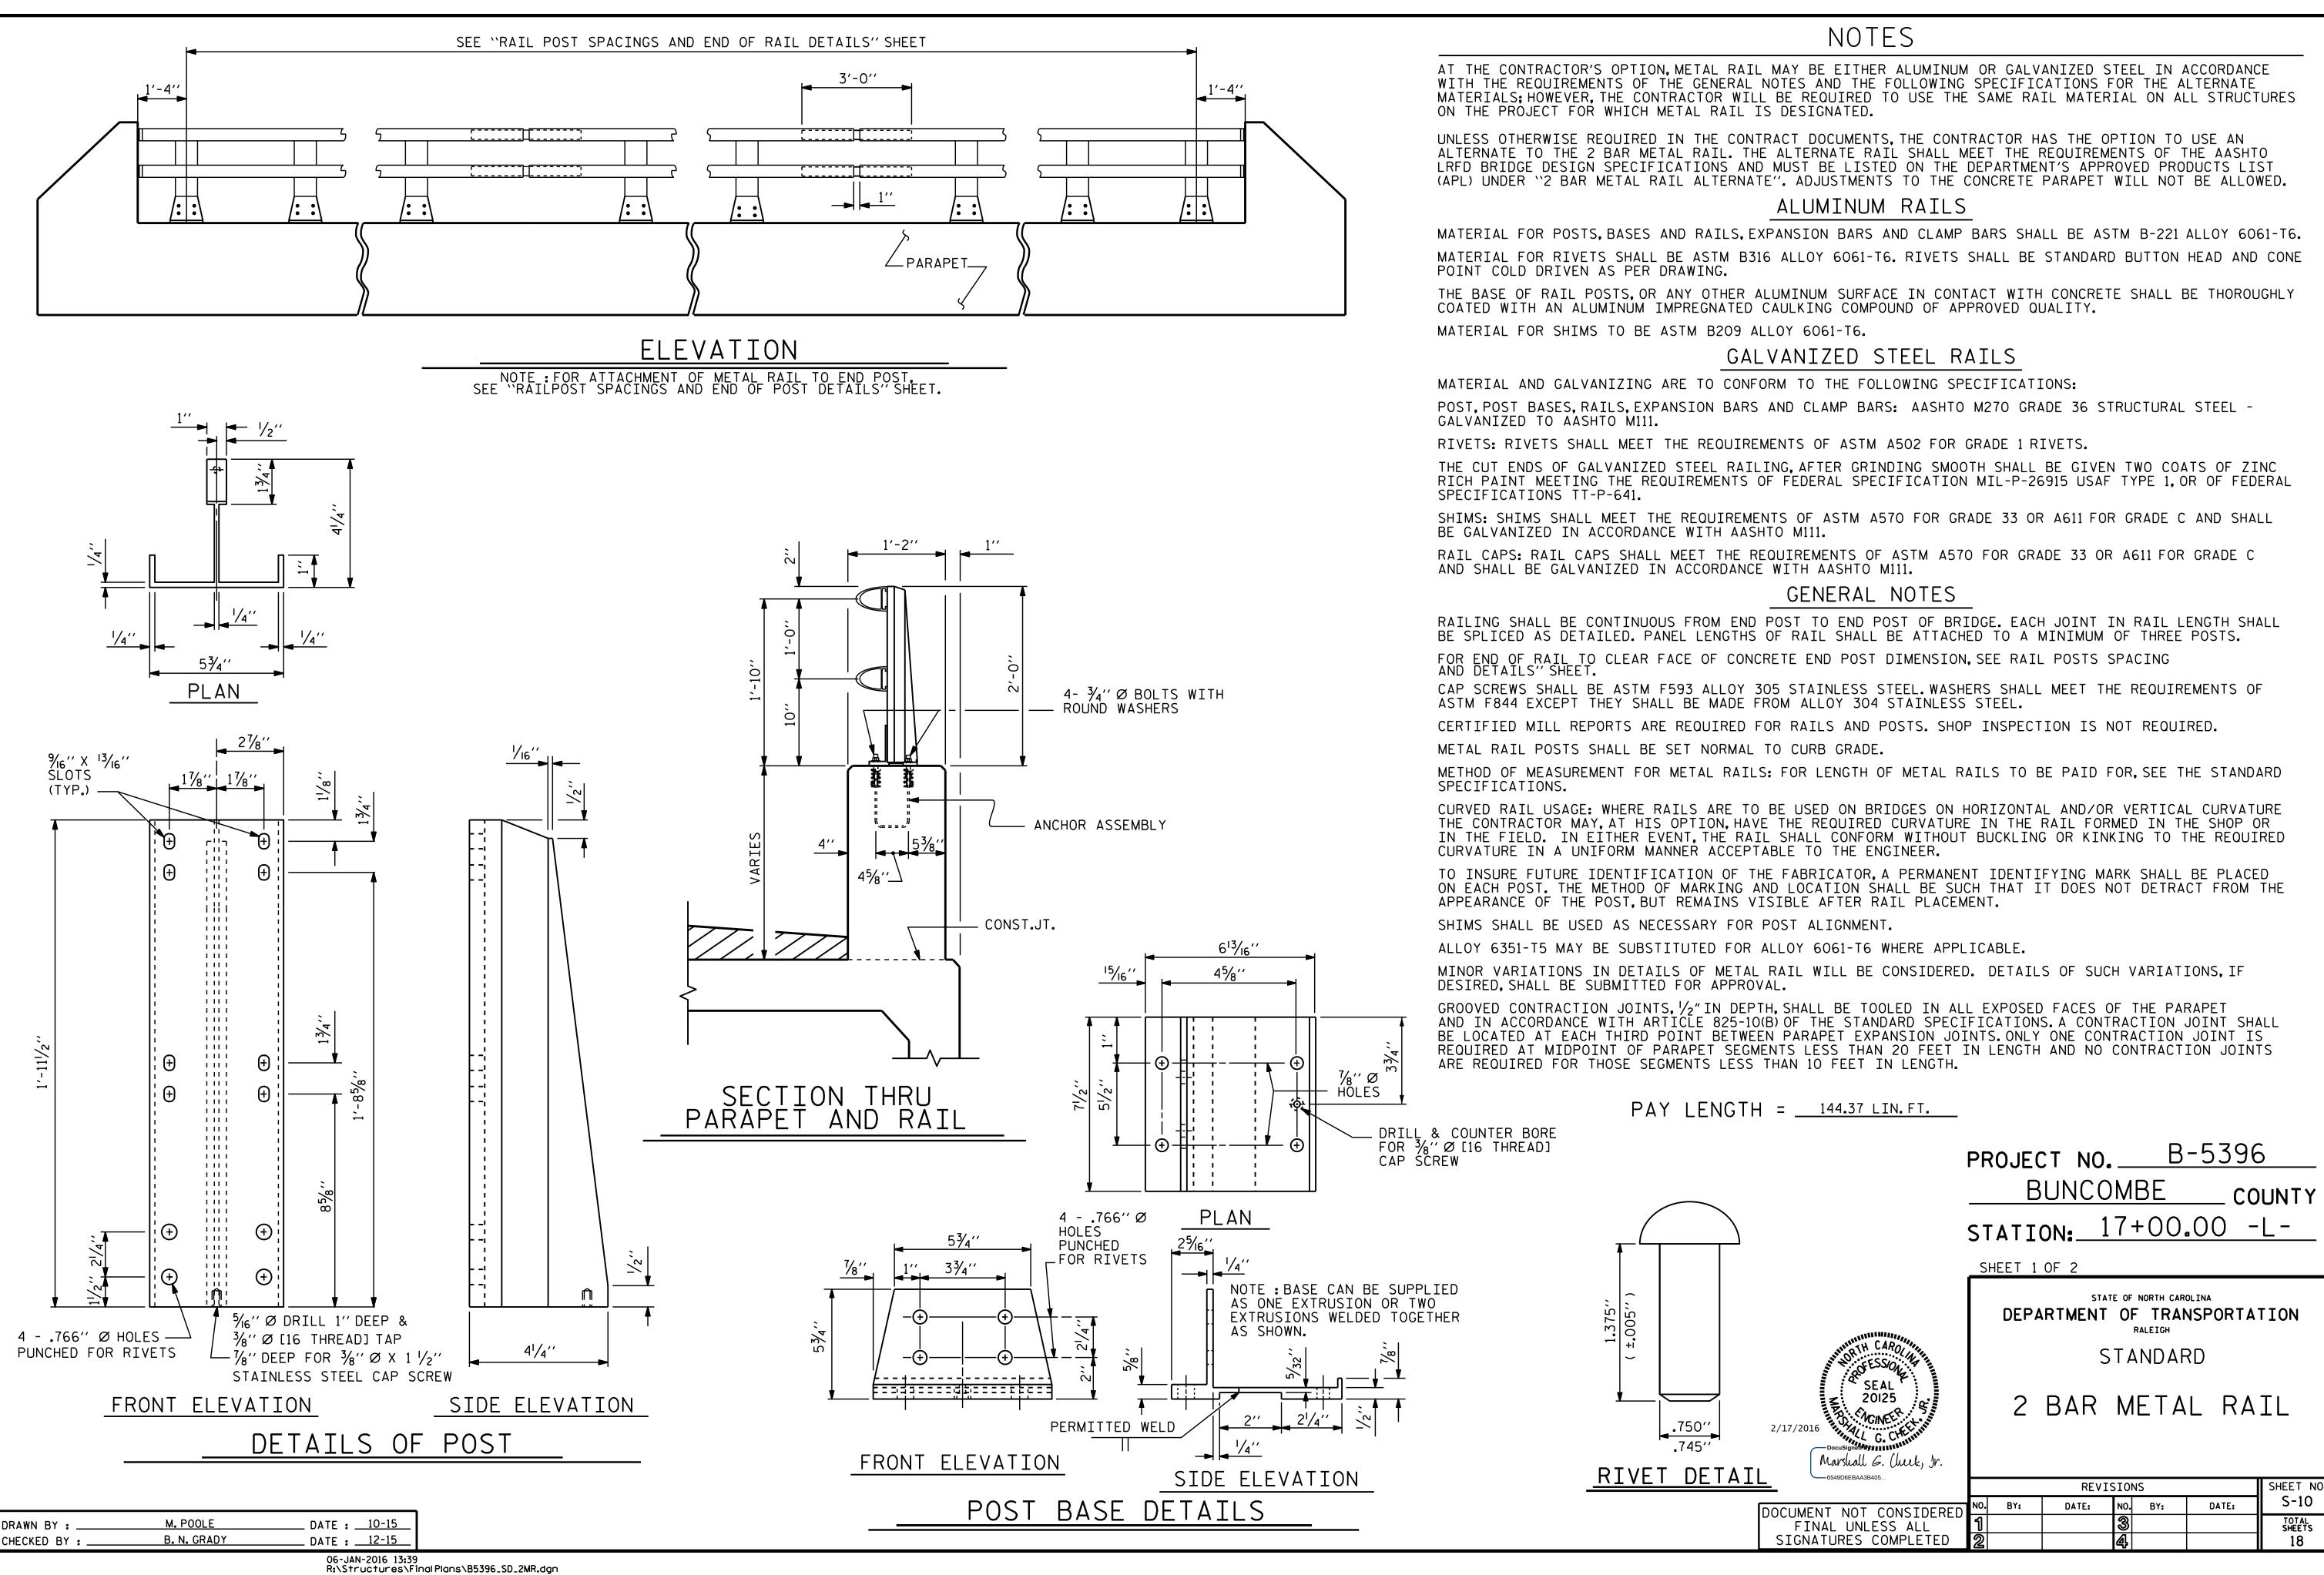

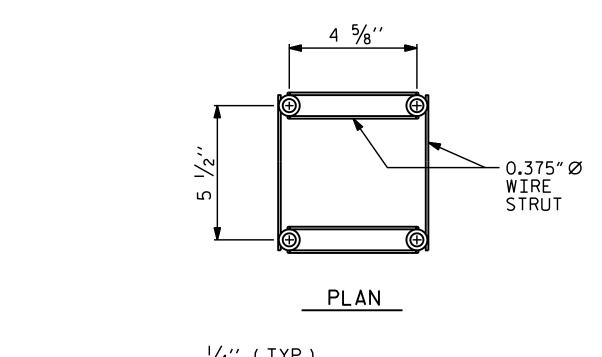

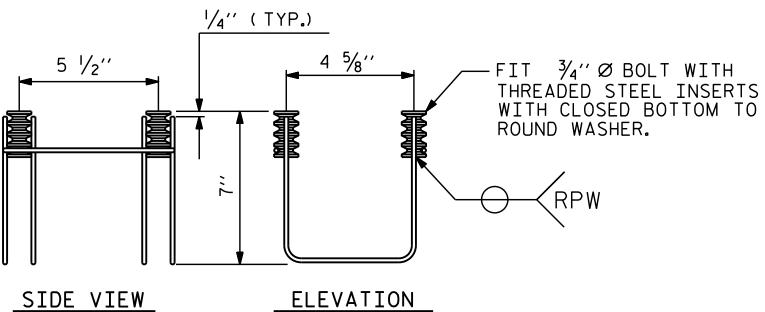

METAL RAIL ANCHOR ASSEMBLY

(28 ASSEMBLIES REQUIRED)

NOTES


STRUCTURAL CONCRETE ANCHOR ASSEMBLY

THE STRUCTURAL CONCRETE ANCHOR ASSEMBLY SHALL CONSIST OF THE FOLLOWING COMPONENTS:

- A. FERRULES SHALL BE MADE FROM STEEL MEETING THE REQUIREMENTS OF AASHTO M169, GRADE 12L14 AND SHALL HAVE A MINIMUM LENGTH OF THREADS OF 2" FOR 3/4" FERRULES.
- B. 4 3/4" Ø X 21/2" BOLTS WITH WASHERS.BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307. BOLTS AND WASHERS SHALL BE GALVANIZED. AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE 3/4" Ø X 21/2" GALVANIZED BOLTS AND WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.
- C. WIRE STRUT SHOWN IN THE CONCRETE ANCHOR ASSEMBLY DETAIL IS THE MINIMUM ALLOWABLE SIZE AND SHALL HAVE A MINIMUM TENSILE STRENGTH OF 100,000 PSI. AS AN OPTION, A $7_{16}^{\prime\prime}$ Ø WIRE STRUT WITH A MINIMUM TENSILE STRENGTH OF 90,000 PSI IS ACCEPTABLE.
- D. THE METAL RAIL ANCHOR ASSEMBLIES TO BE HOT DIPPED GALVANIZED TO CONFORM TO REQUIREMENTS OF AASHTO M111.
- E. THE COST OF THE METAL RAIL ANCHOR ASSEMBLY WITH BOLTS AND WASHERS COMPLETE IN PLACE SHALL BE INCLUDED IN THE PRICE BID FOR LINEAR FEET OF METAL RAIL.
- F. BOLTS TO BE TIGHTENED ONE-HALF TURN WITH A WRENCH FROM A FINGER-TIGHT POSITION.


THE CONTRACTOR MAY USE ADHESIVELY ANCHORED ANCHOR BOLTS IN PLACE OF THE METAL RAIL ANCHOR ASSEMBLY. LEVEL ONE FIELD TESTING IS REQUIRED, AND THE YIELD LOAD OF THE 3/4" Ø BOLT IS 10 KIPS. FOR ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS, SEE THE STANDARD SPECIFICATIONS.


WHEN ADHESIVELY ANCHORED ANCHOR BOLTS ARE USED, BOLTS SHALL MEET THE REQUIREMENTS OF ASTM F593 ALLOY 304 STAINLESS STEEL WITH MINIMUM 75,000 PSI ULTIMATE STRENGTH. NUTS SHALL MEET THE REQUIREMENTS OF ASTM F594 ALLOY 304 STAINLESS STEEL AND WASHERS SHALL MEET THE REQUIREMENTS OF ASTM F844 EXCEPT THEY SHALL BE MADE FROM ALLOY 304 STAINLESS STEEL.

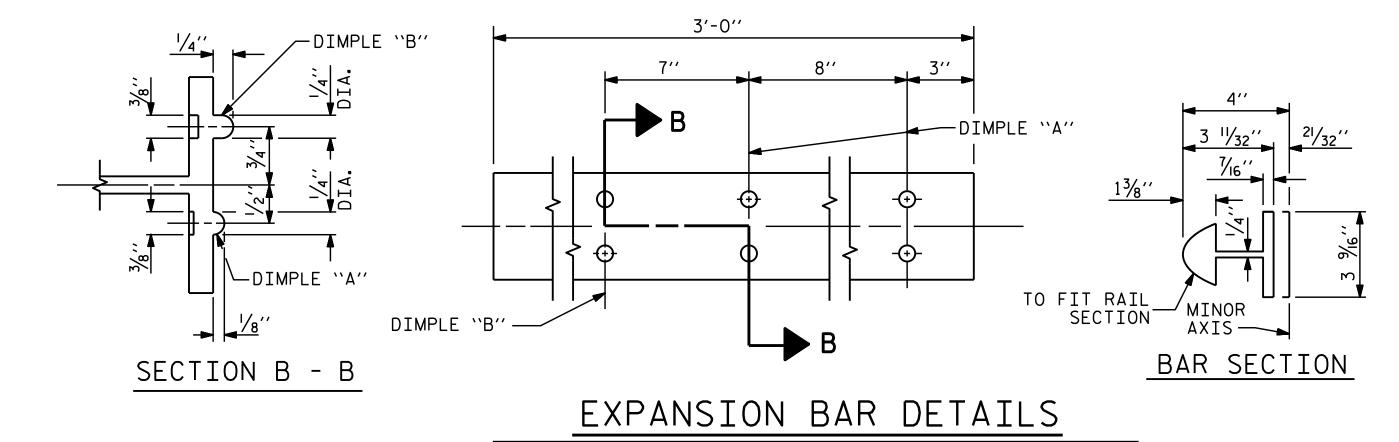

3¾′′


5¾′′

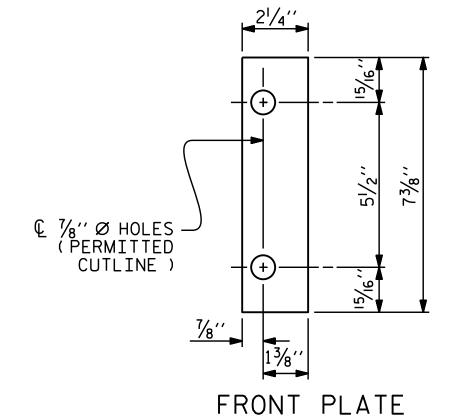

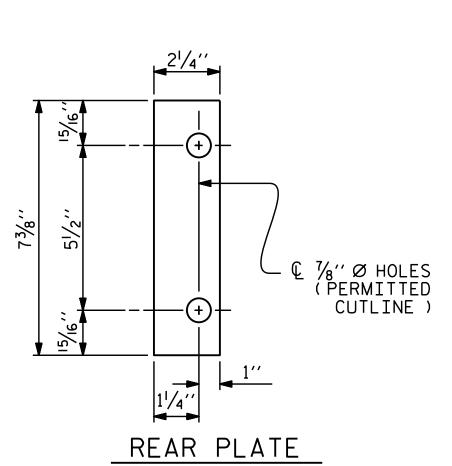


SHIM DETAILS


SHIMS MAY BE CUT ALONG PERMITTED CUTLINE OR SLOTTED TO EDGE OF PLATE TO FACILITATE PLACEMENT.

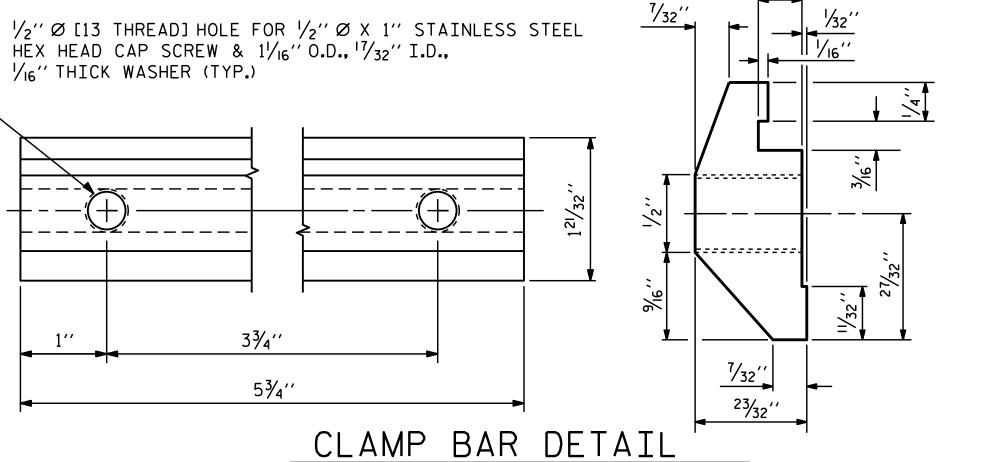

CLAMP ASSEMBLY



PROJECT NO._ BUNCOMBE STATION: 17+00.00 -L-SHEET 2 OF 2 RAIL CAP STATE OF NORTH CAROLINA



DEPARTMENT OF TRANSPORTATION RALEIGH STANDARD

─ MINOR ├ AXIS

RAIL SECTION

← SEMI-ELLIPSE

MAJOR

AXIS

B-5396


COUNTY

2 BAR METAL RAIL

1990 Thomas The state of the st							
Marshall Built, Jr.			REVI	SION	S		SHEET NO
OCUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S-11
FINAL UNLESS ALL	1			3			TOTAL SHEETS
SIGNATURES COMPLETED	2			4			23

ASSEMBLED BY : M. POOLE CHECKED BY : B. N. GRADY DATE : II/I5 DATE : 12/15 DRAWN BY: EEM 6/94 REV. 8/16/99 MAB/LES REV. 5/1/06R KMM/GM REV. 10/1/11 MAA/GM (4 REQUIRED PER POST

06-JAN-2016 13:39
R:\Structures\FinalPlans\B5396_SD_2MR.dgn

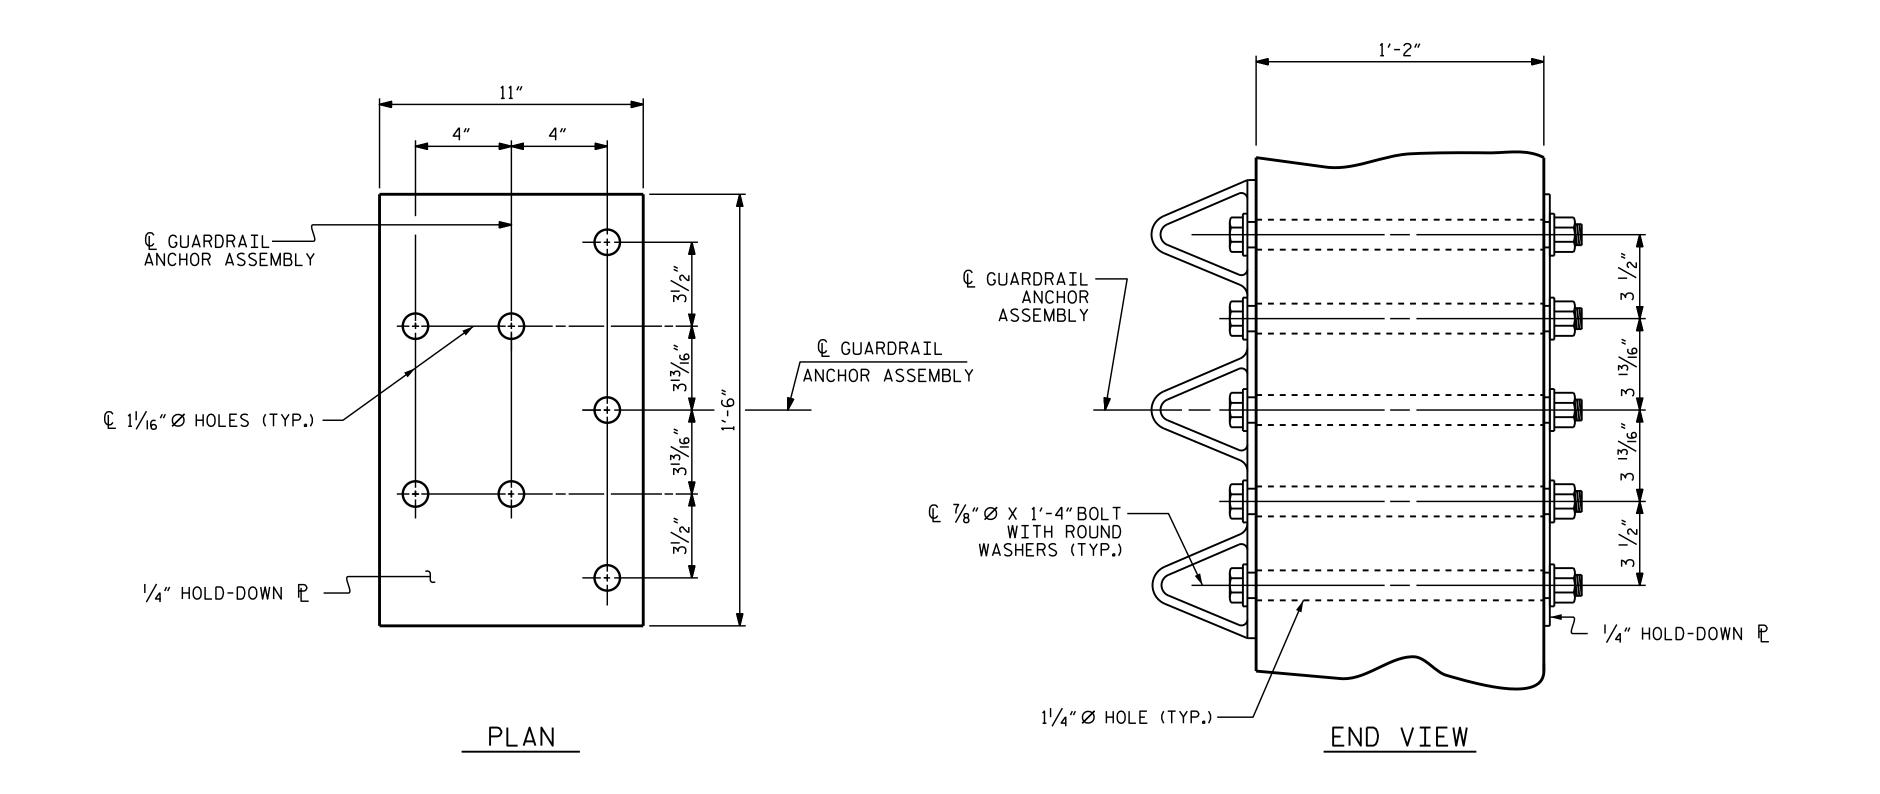

GUARDRAIL ANCHOR ASSEMBLY DETAILS

NOTES

THE GUARDRAIL ANCHOR ASSEMBLY SHALL CONSIST OF A $1/\!\!/_4$ "HOLD DOWN PLATE AND 7 - $1/\!\!/_8$ " Ø BOLTS WITH NUTS AND WASHERS.

THE HOLD-DOWN PLATE SHALL CONFORM TO AASHTO M270 GRADE 36.AFTER FABRICATION, THE HOLD-DOWN PLATE SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH AASHTO M111.

BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307 AND NUTS SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M291. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED. AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS, NUTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE 1/8" Ø GALVANIZED BOLTS, NUTS AND WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.


THE GUARDRAIL ANCHOR ASSEMBLY IS REQUIRED AT ALL POINTS WHERE APPROACH GUARDRAIL IS TO BE ATTACHED TO THE END OF THE PARAPET. FOR POINTS OF ATTACHMENT, SEE SKETCH.

AFTER INSTALLATION, THE EXPOSED THREAD OF THE BOLT SHALL BE BURRED WITH A SHARP POINTED TOOL.

THE COST OF THE GUARDRAIL ANCHOR ASSEMBLIES WITH BOLTS, NUTS AND WASHERS COMPLETE IN PLACE, SHALL BE INCLUDED IN THE VARIOUS PAY ITEMS.

THE VERTICAL REINFORCING BARS MAY BE SHIFTED SLIGHTLY IN THE END POST TO CLEAR ASSEMBLY BOLTS.


THE 1 $\frac{1}{4}$ " Ø HOLES SHALL BE FORMED OR DRILLED WITH A CORE BIT. IMPACT TOOLS WILL NOT BE PERMITTED. ANY CONCRETE DAMAGED BY THIS WORK SHALL BE REPAIRED TO THE SATISFACTION OF THE ENGINEER.

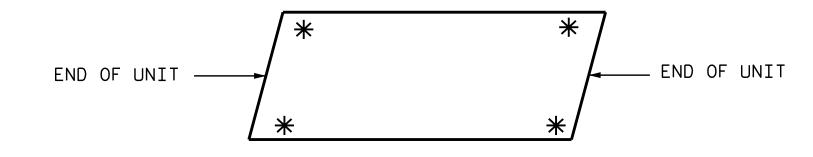

SKETCH SHOWING POINTS OF ATTACHMENT


* LUCATION OF GUARDRAIL ATTACHMENT

B-5396 PROJECT NO. BUNCOMBE COUNTY STATION: 17+00.00 -L-



STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION STANDARD GUARDRAIL ANCHORAGE DETAILS FOR METAL RAILS


Marsuau 6. (ucce, jr.							
			REVI	SION	NS		SHEET NO.
DCUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S-12
FINAL UNLESS ALL	1			3			TOTAL SHEETS
SIGNATURES COMPLETED	2			4			18

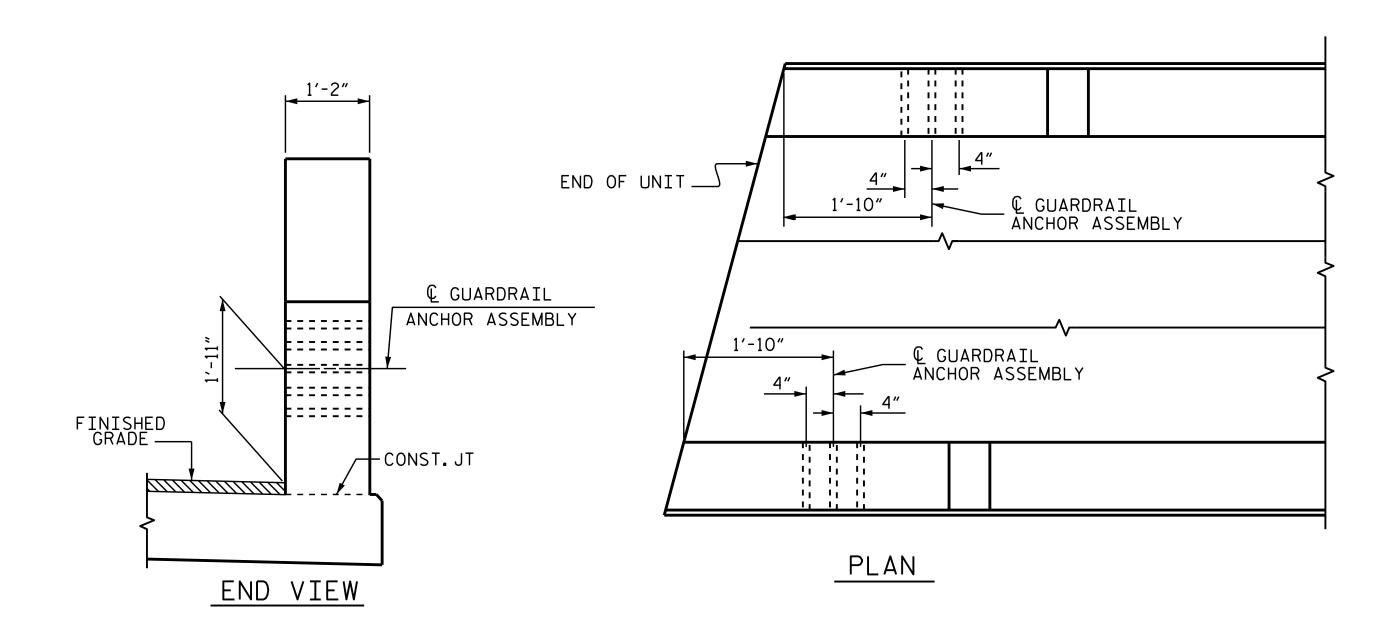

ASSEMBLED BY : M. POOLE CHECKED BY : B. N. GRADY DATE : 10-15

DATE : 12-15 DRAWN BY: MAA 5/10 CHECKED BY: GM 5/10 REV. 12/5/II MAA/GM MAA/GM MAA/TMG REV. 6/13 REV. 1/15

LOCATION OF GUARDRAIL ANCHOR AT END POST

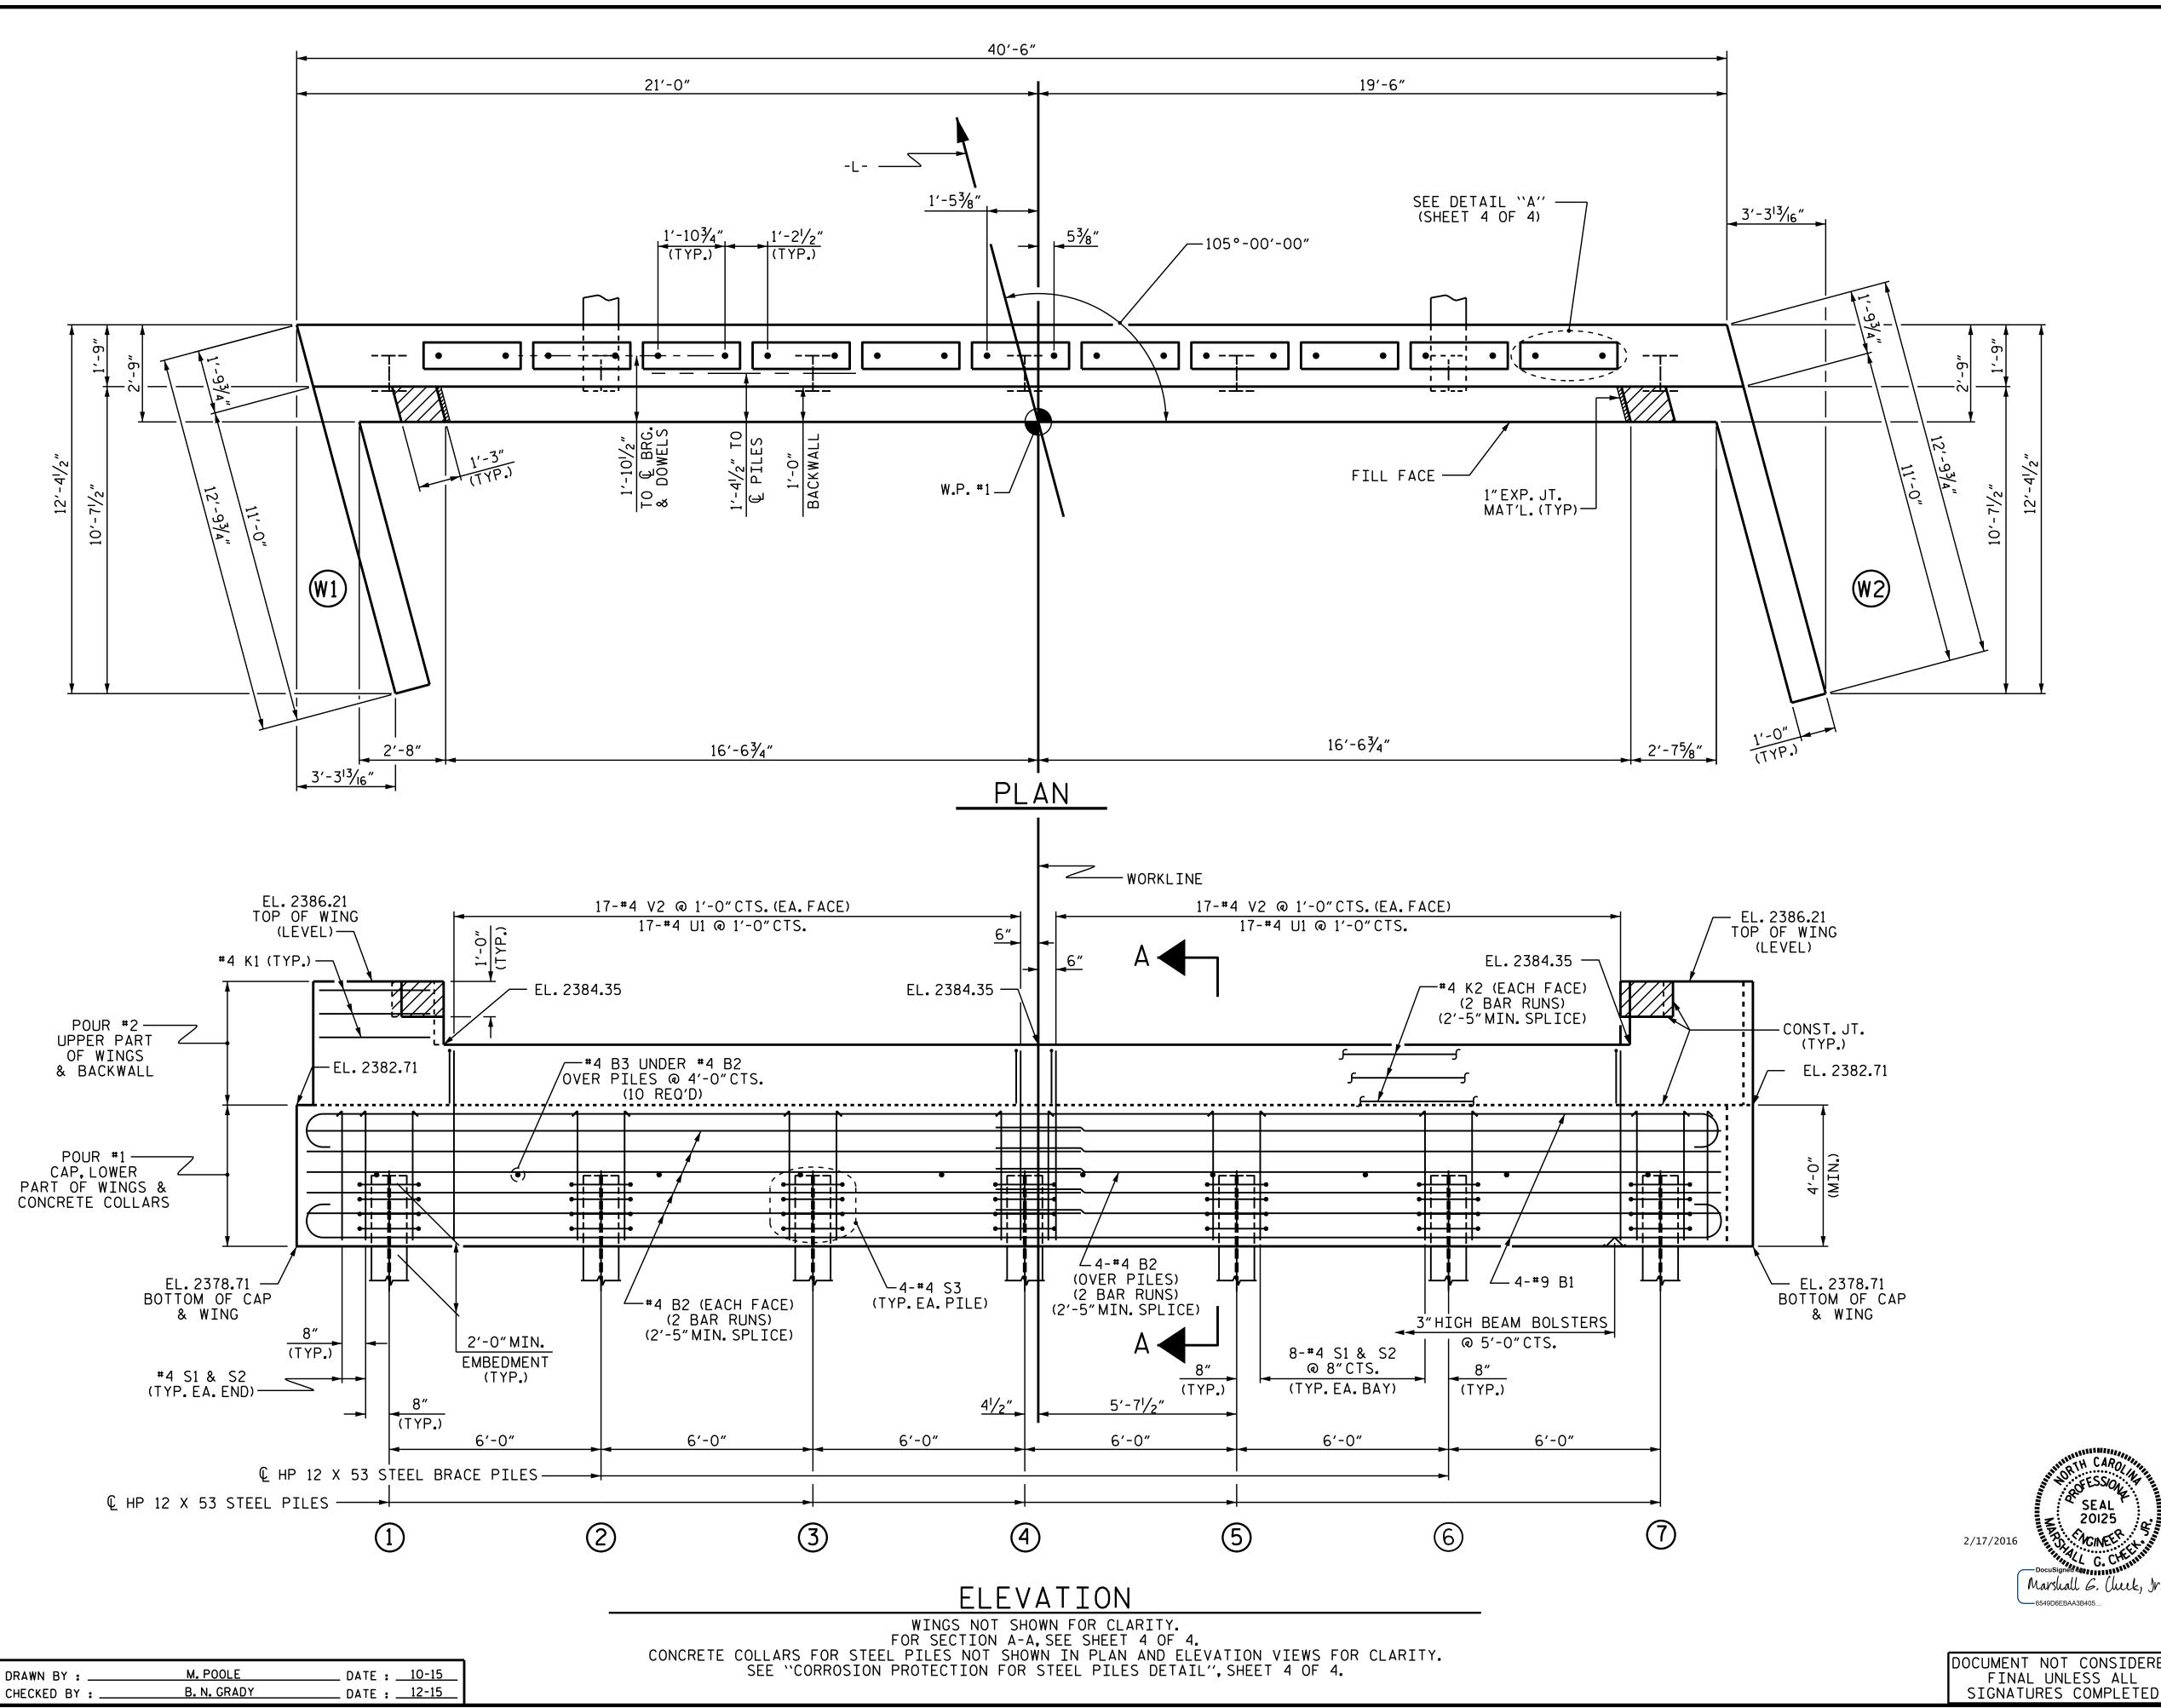

NOTES

STIRRUPS IN CAP MAY BE SHIFTED AS NECESSARY TO CLEAR DOWELS.

THE CONCRETE IN THE SHADED AREA OF THE WING SHALL BE POURED AFTER THE PARAPET IS CAST IF SLIP FORMING IS USED.

FOR PILE SPLICE DETAILS, SEE SHEET 4 OF 4.

FOR WING DETAILS, SEE SHEET 3 OF 4.

PROJECT NO. B-5396

BUNCOMBE COUNTY

STATION: 17+00.00 -L-

SHEET 1 OF 4


DEPARTMENT OF TRANSPORTATION
RALEIGH

SUBSTRUCTURE

END BENT No. 1

REVISIONS SHEET NO.

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED 2 4 18

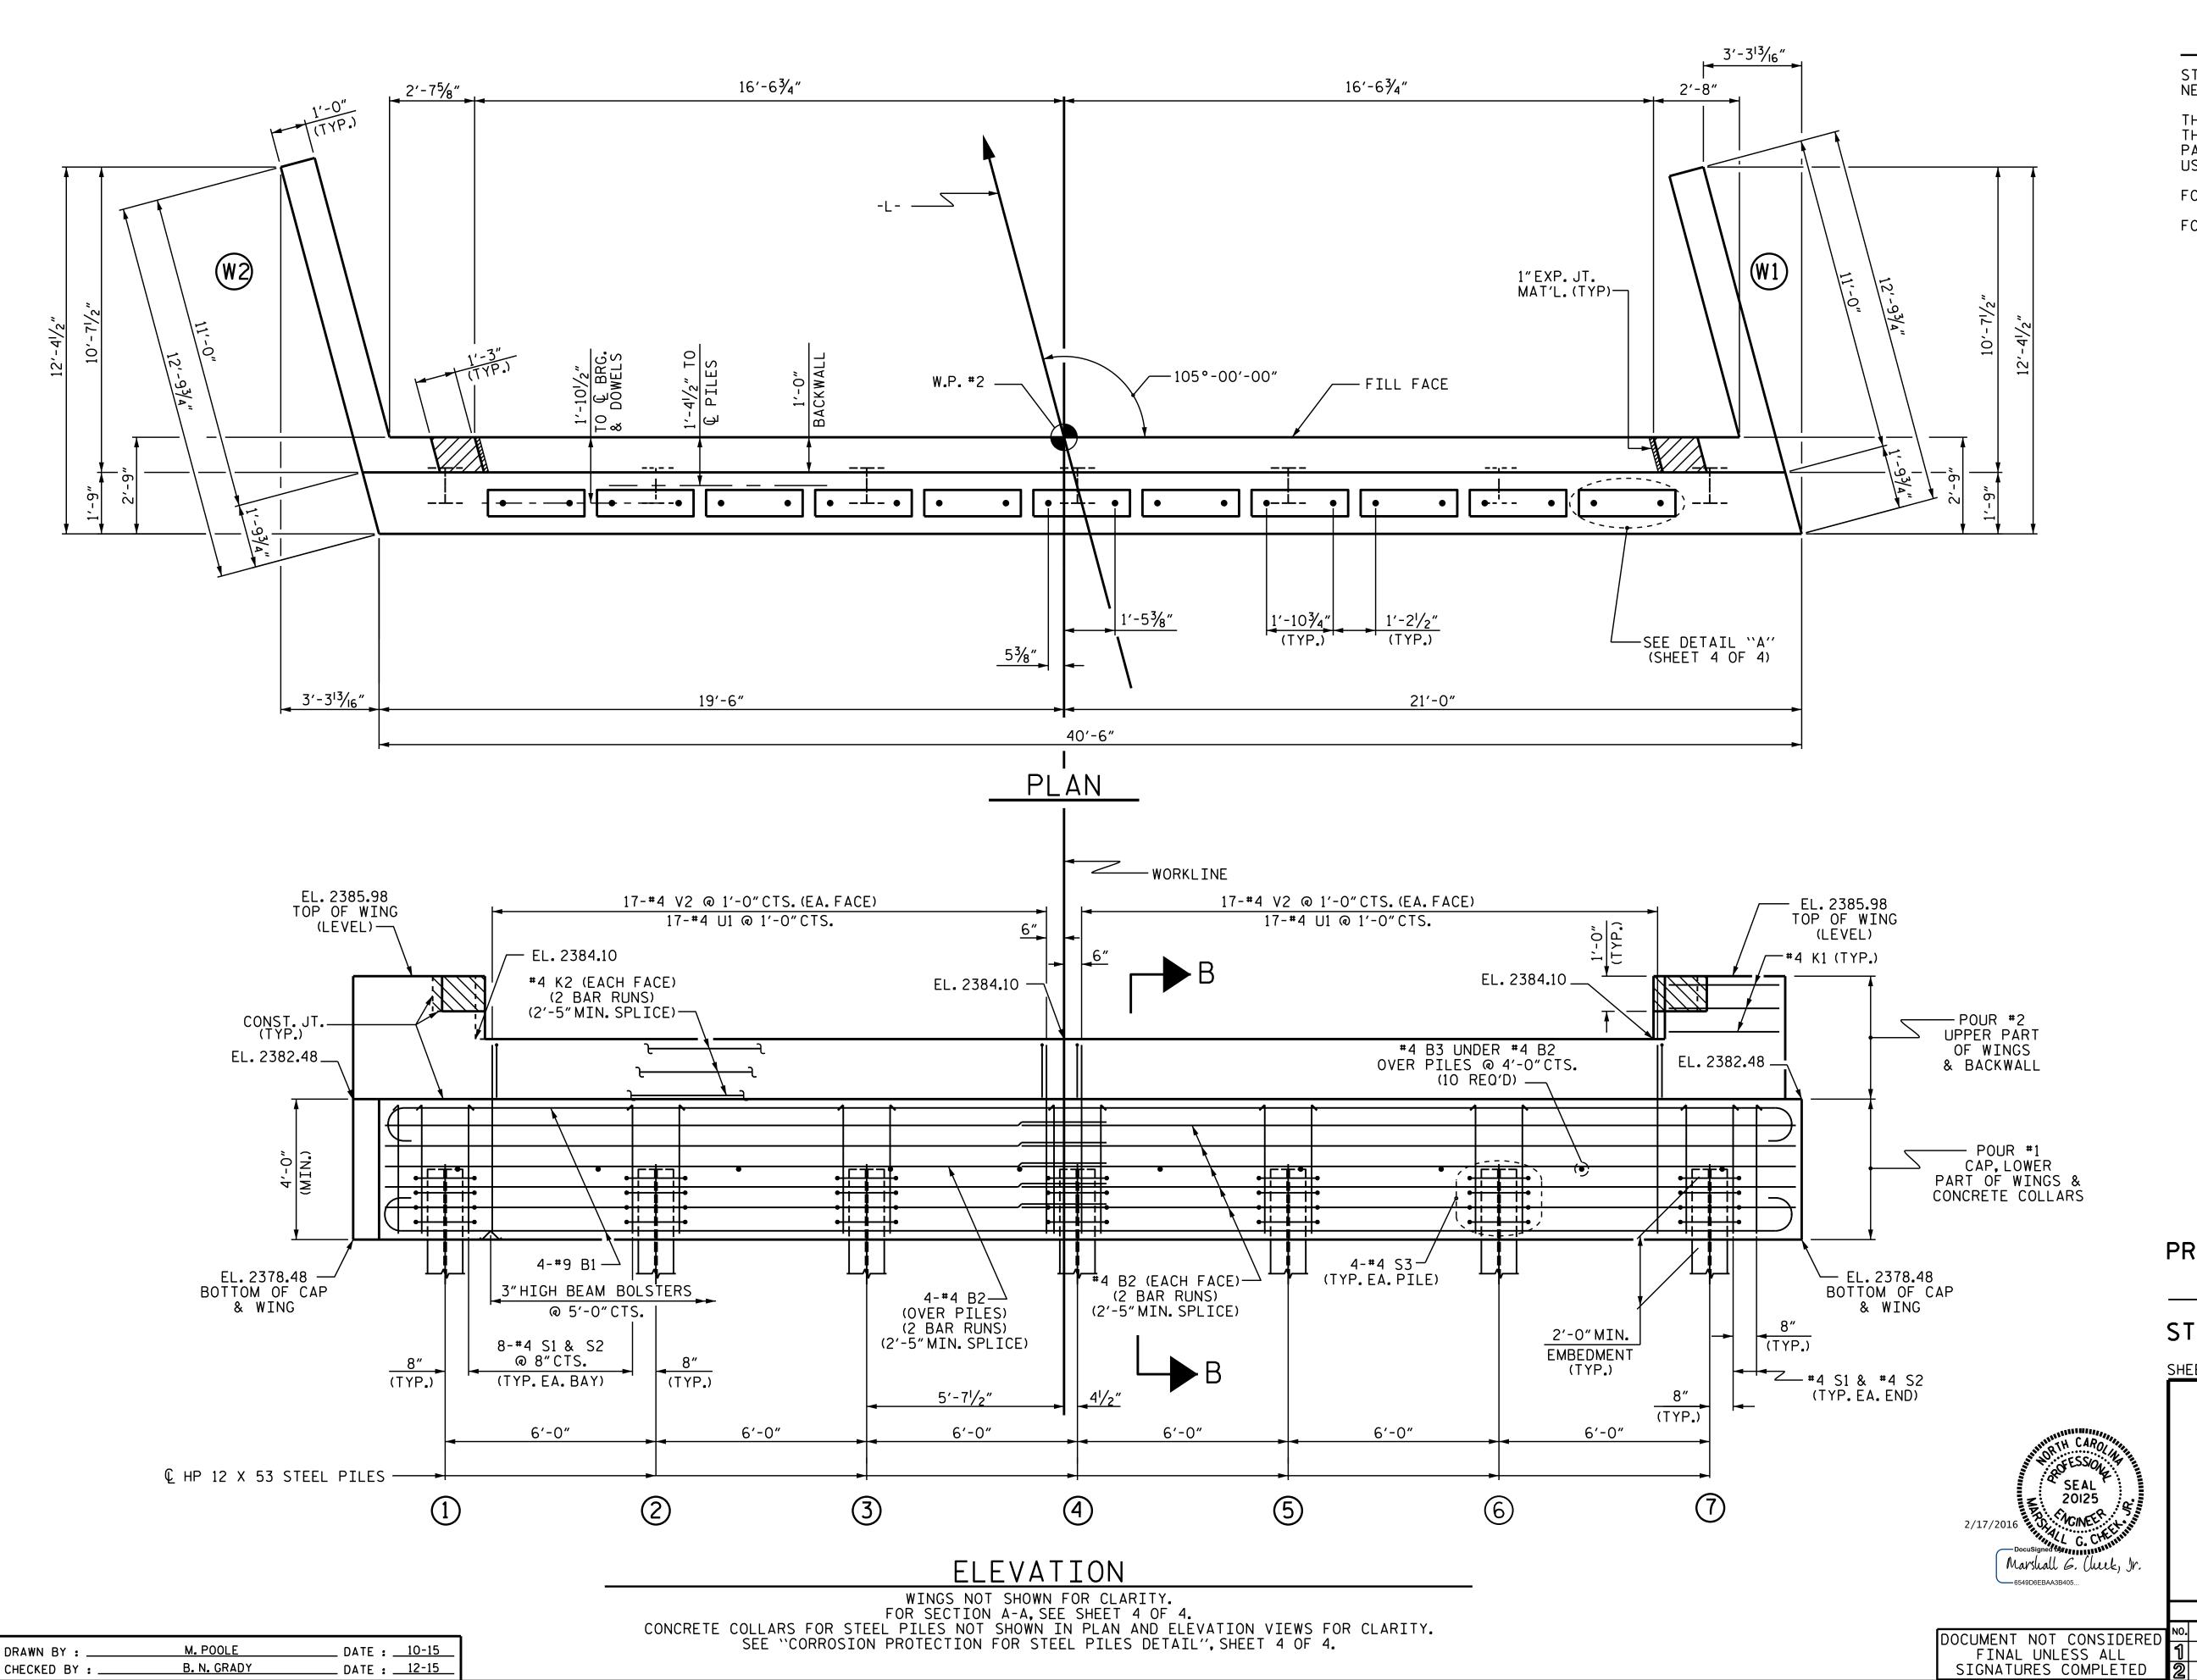

NOTES

STIRRUPS IN CAP MAY BE SHIFTED AS NECESSARY TO CLEAR DOWELS.

THE CONCRETE IN THE SHADED AREA OF THE WING SHALL BE POURED AFTER THE PARAPET IS CAST IF SLIP FORMING IS

FOR PILE SPLICE DETAILS, SEE SHEET 4 OF 4.

FOR WING DETAILS, SEE SHEET 3 OF 4.

B-5396 PROJECT NO. BUNCOMBE COUNTY STATION: 17+00.00 -L-

SHEET 2 OF 4

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

SUBSTRUCTURE


END BENT No. 2

SHEET NO. REVISIONS S-14 DATE: DATE: BY: TOTAL SHEETS


DATE : <u>12-15</u>

CHECKED BY : .

B. N. GRADY

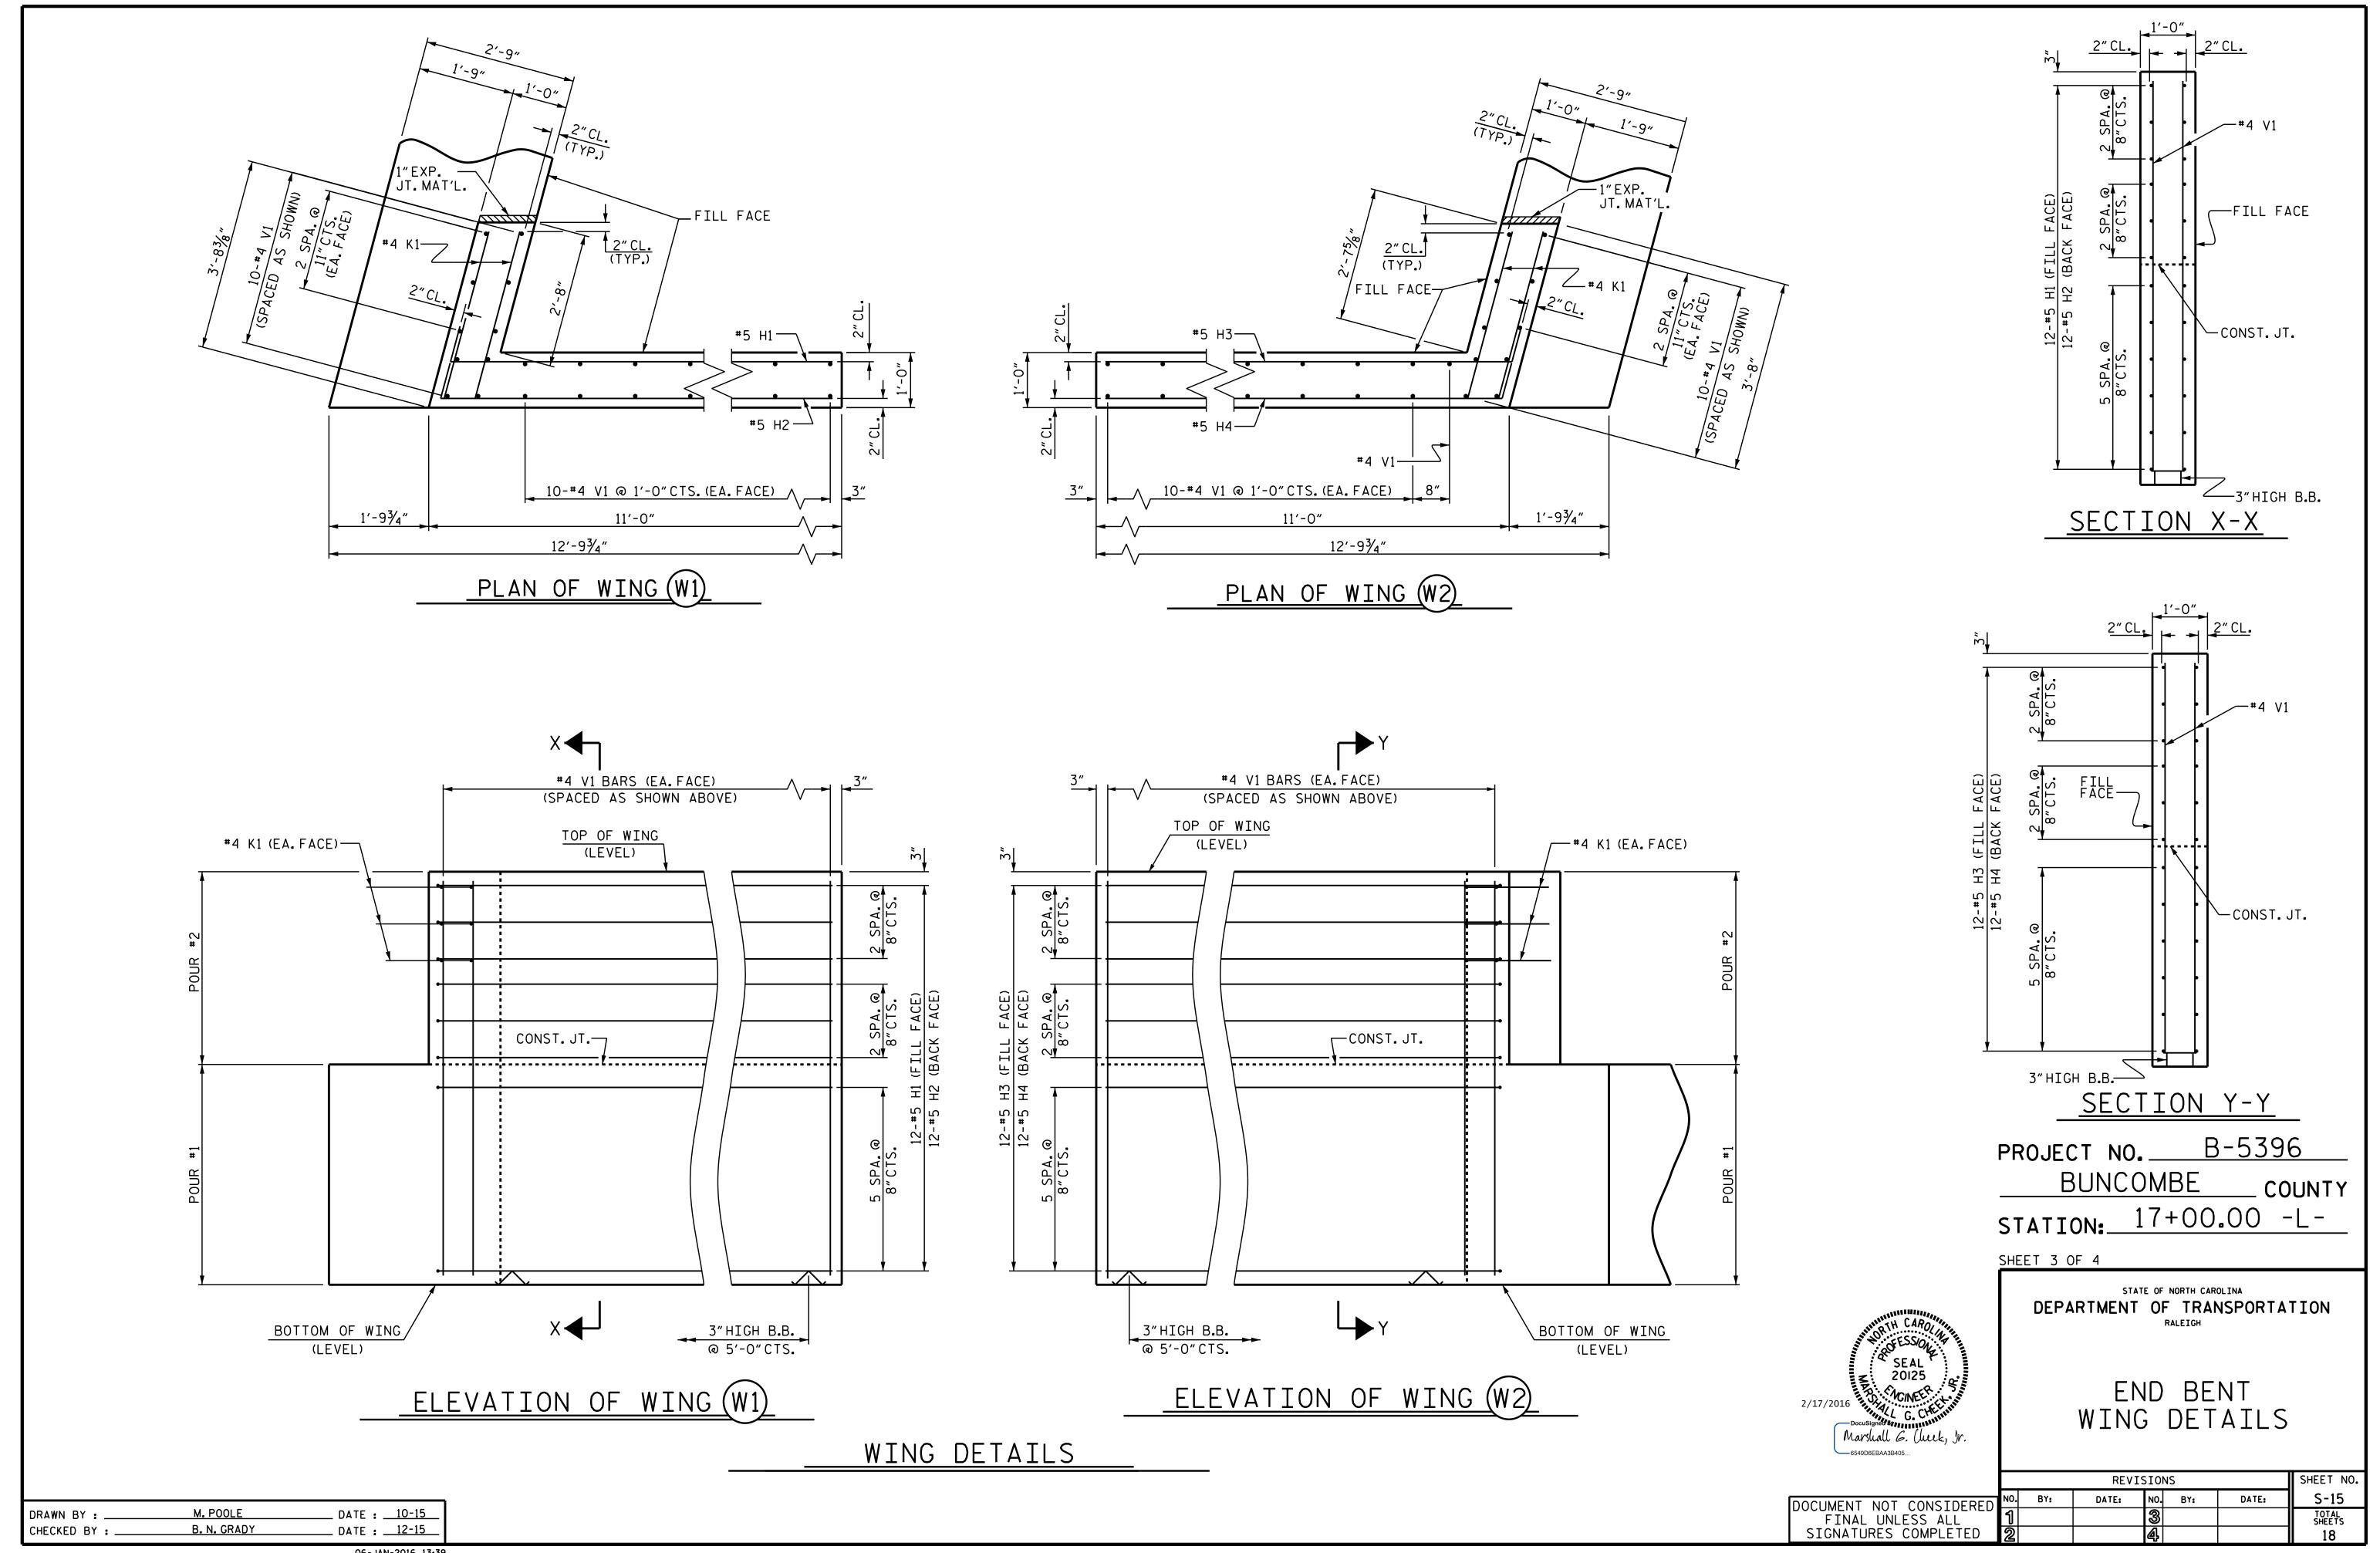

06-JAN-2016 13:39 R:\Structures\FinalPlans\B5396_SD_E.dgn bngrady

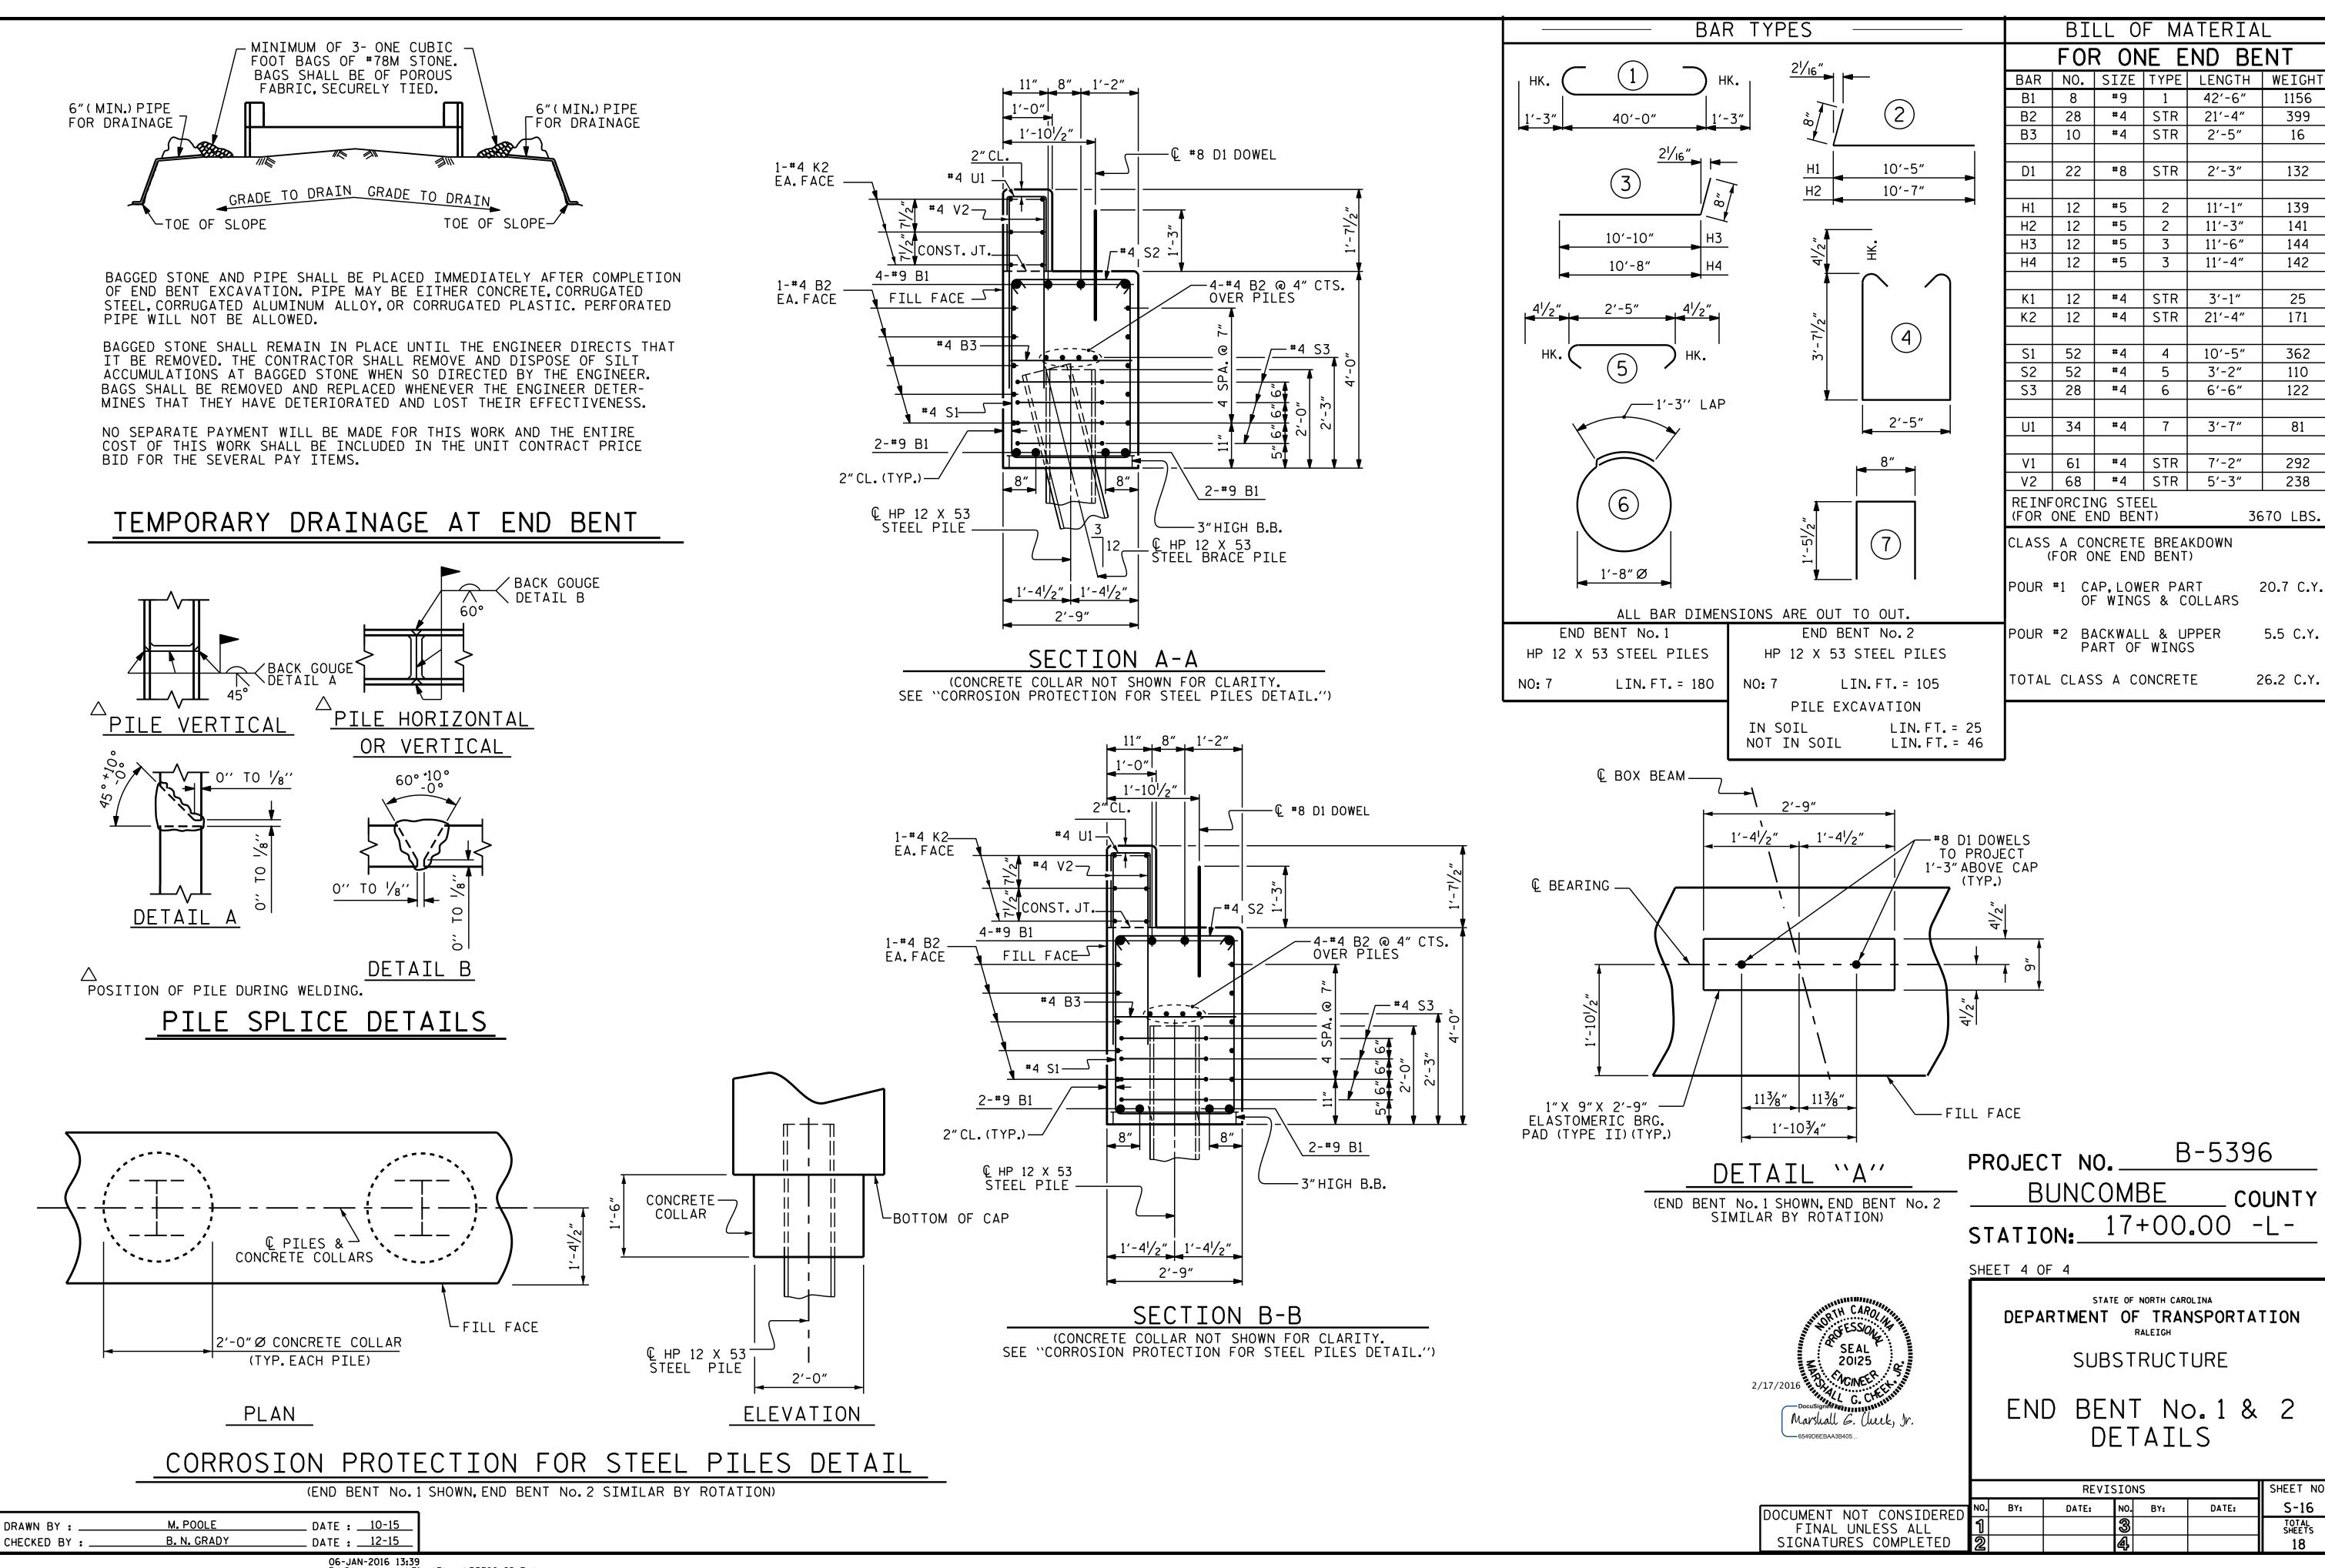

1156

399

16

132

139

141

144

142

25

171

362

110

122

81

292

238

3670 LBS.

20.7 C.Y.

5.5 C.Y.

26.2 C.Y.

11'-3"

10′-5″

3′-2″

6′-6″

3′-7"

B-5396

DATE:

COUNTY

SHEET NO

S-16

TOTAL SHEETS

4 I


5 l

6 l


06-JAN-2016 13:39 R:\Structures\FinalPlans\B5396_SD_E.dgn



FOR BERM WIDTH DIMENSIONS, SEE GENERAL DRAWING.

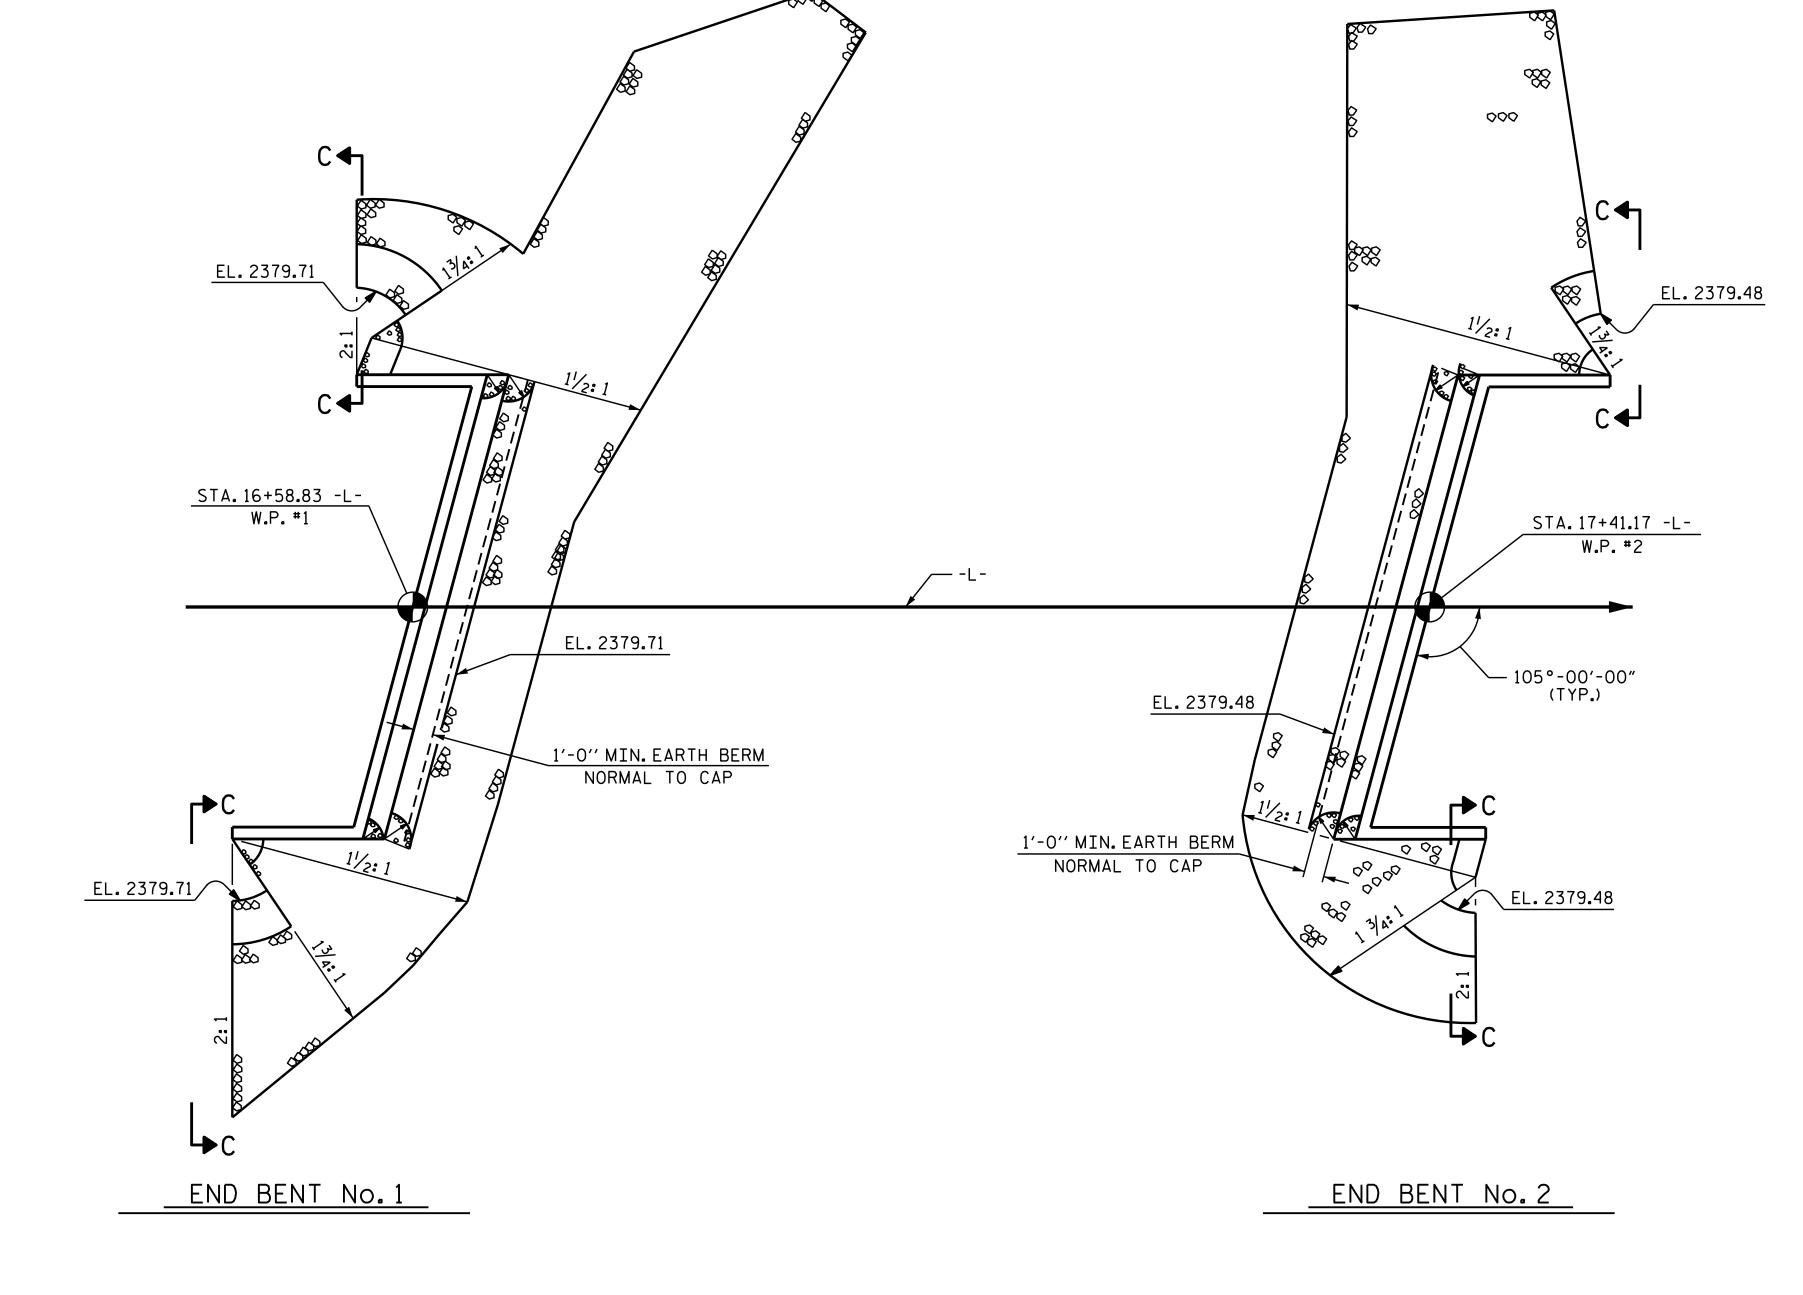

ESTIMATED QUANTITIES							
BRIDGE @ STA.17+00.00 -L-	RIP RAP CLASS II (2'-0" THICK)	GEOTEXTILE FOR DRAINAGE					
	TONS	SQUARE YARDS					
END BENT No.1	130	140					
END BENT No. 2	125	135					

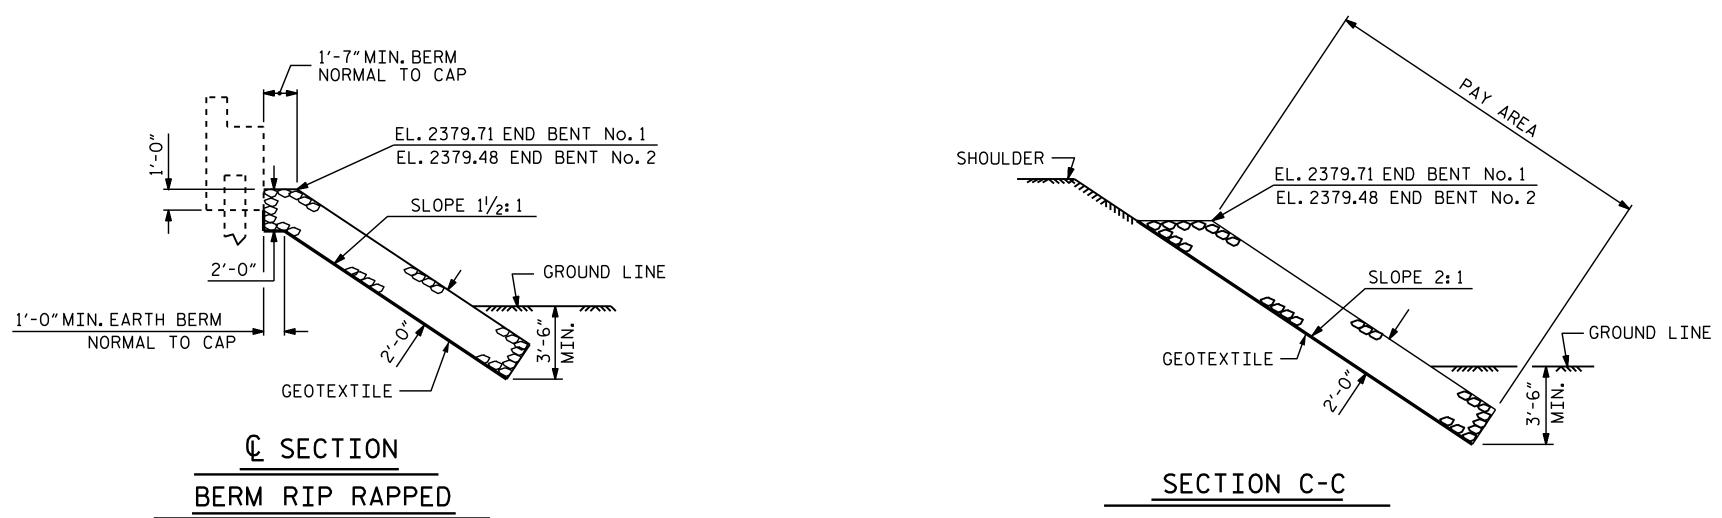

PROJECT NO. B-5396 BUNCOMBE _ COUNTY STATION: 17+00.00 -L-

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
RALEIGH


STANDARD

-RIP RAP DETAILS-

SHEET NO. REVISIONS S-17 DATE: DATE: BY: DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

ASSEMBLED BY : D. HODGE CHECKED BY : B.N. GRADY DATE: 11/15 DATE: 12/15 REV. 5/I/06R REV. IO/I/II REV. I2/2I/II TLA/GM MAA/GM MAA/GM DRAWN BY: REK 1/84 CHECKED BY: RDU 1/84

2/17/2016

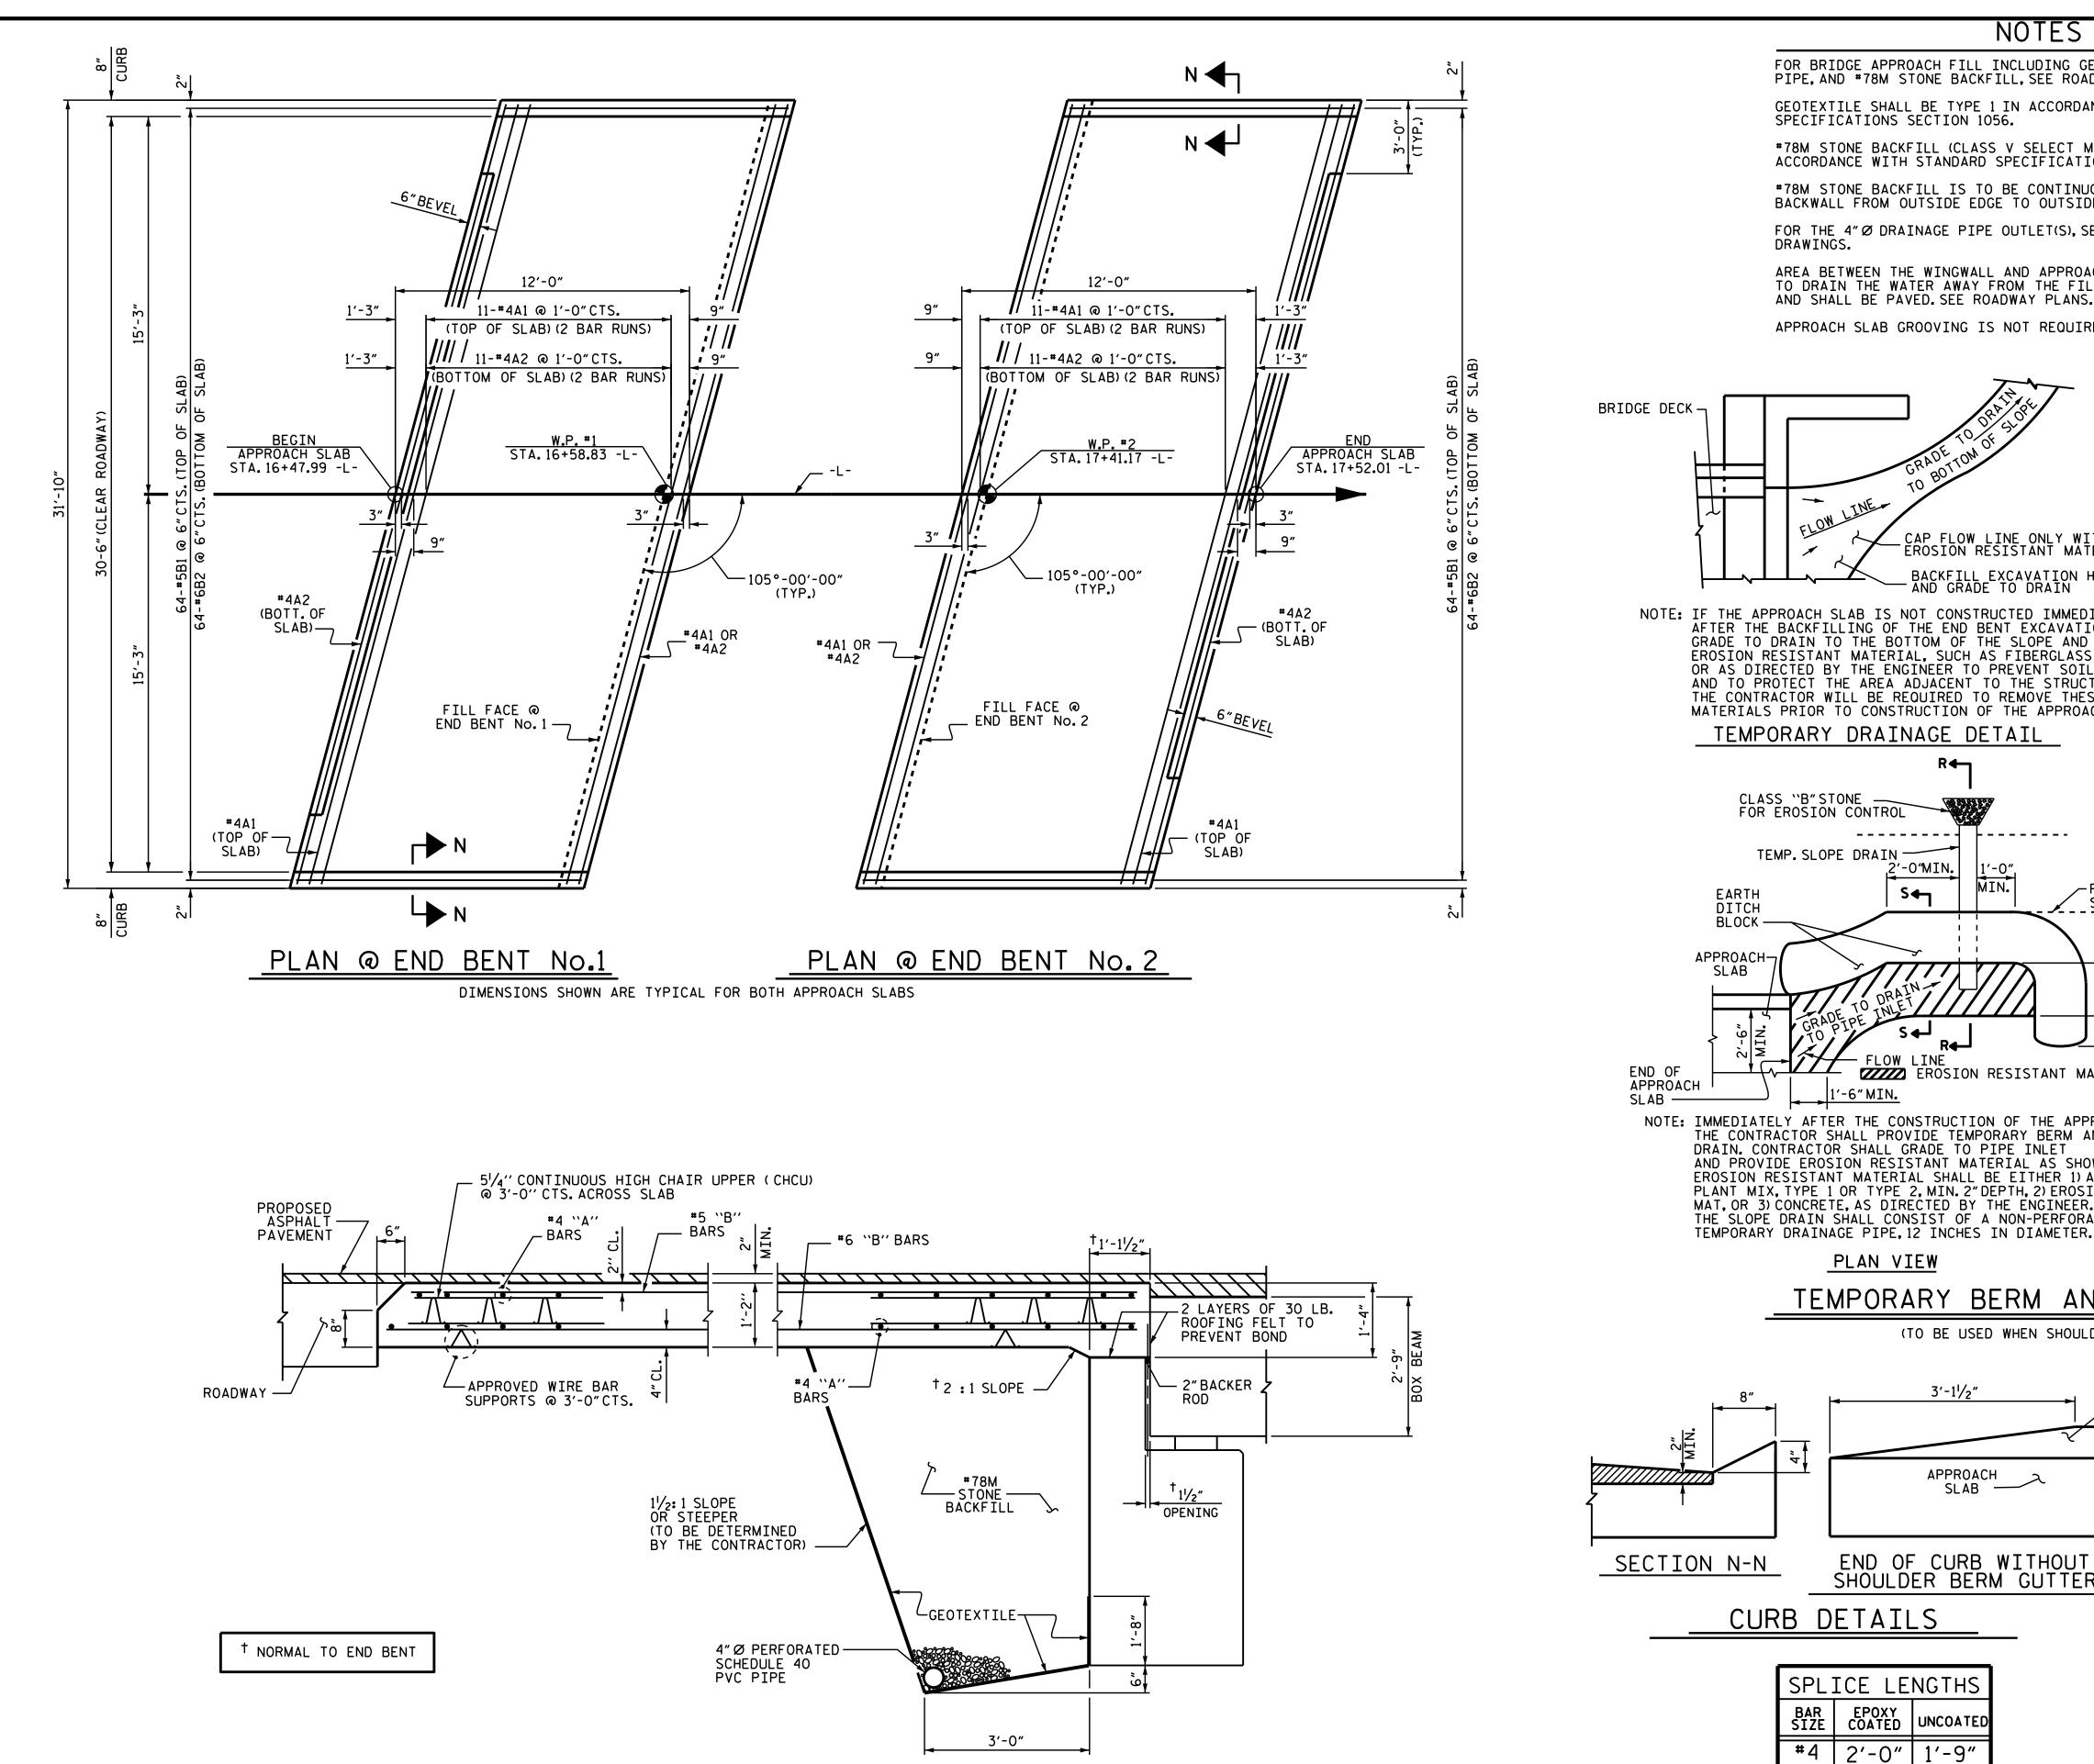

NOTES

FOR BRIDGE APPROACH FILL INCLUDING GEOTEXTILE, 4" Ø DRAINAGE PIPE, AND #78M STONE BACKFILL, SEE ROADWAY PLANS.

GEOTEXTILE SHALL BE TYPE 1 IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS SECTION 1056.


#78M STONE BACKFILL (CLASS V SELECT MATERIAL) SHALL BE IN ACCORDANCE WITH STANDARD SPECIFICATIONS SECTION 1016.

#78M STONE BACKFILL IS TO BE CONTINUOUS ALONG FILL FACE OF BACKWALL FROM OUTSIDE EDGE TO OUTSIDE EDGE OF APPROACH SLAB.

FOR THE 4" Ø DRAINAGE PIPE OUTLET(S), SEE ROADWAY STANDARD DRAWINGS.


AREA BETWEEN THE WINGWALL AND APPROACH SLAB SHALL BE GRADED TO DRAIN THE WATER AWAY FROM THE FILL FACE OF THE BRIDGE AND SHALL BE PAVED. SEE ROADWAY PLANS.

APPROACH SLAB GROOVING IS NOT REQUIRED.

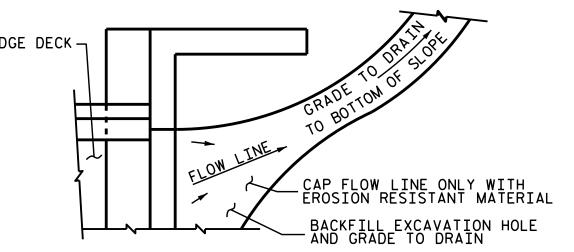

NOTE: IF THE APPROACH SLAB IS NOT CONSTRUCTED IMMEDIATELY AFTER THE BACKFILLING OF THE END BENT EXCAVATION, GRADE TO DRAIN TO THE BOTTOM OF THE SLOPE AND PROVIDE EROSION RESISTANT MATERIAL, SUCH AS FIBERGLASS ROVING OR AS DIRECTED BY THE ENGINEER TO PREVENT SOIL EROSION AND TO PROTECT THE AREA ADJACENT TO THE STRUCTURE.
THE CONTRACTOR WILL BE REQUIRED TO REMOVE THESE
MATERIALS PRIOR TO CONSTRUCTION OF THE APPROACH SLAB.


TEMPORARY DRAINAGE DETAIL

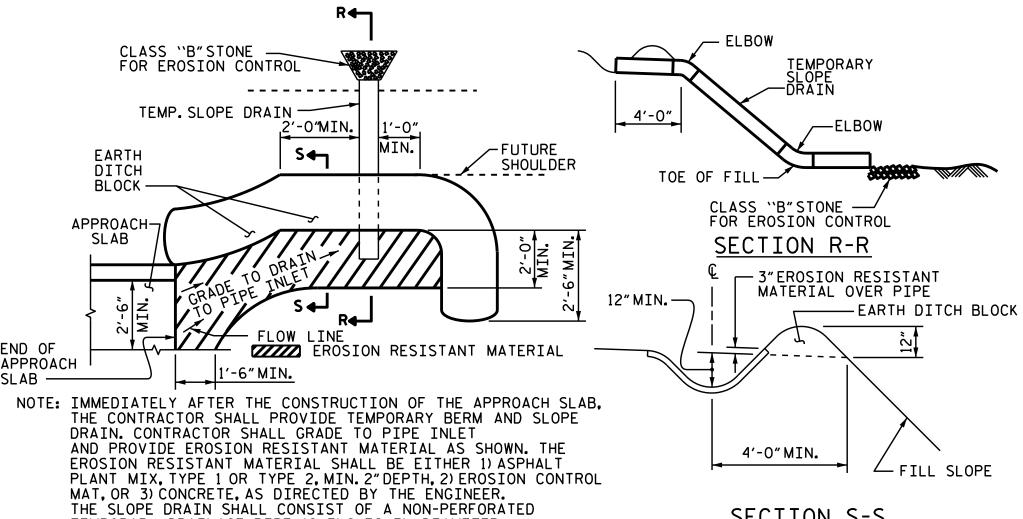

PLAN VIEW

TEMPORARY BERM AND SLOPE DRAIN DETAILS

(TO BE USED WHEN SHOULDER BERM GUTTER IS REQUIRED)

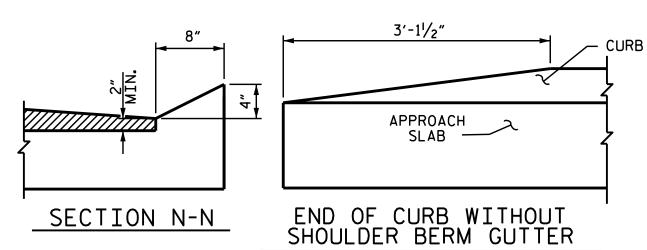

CURB DETAILS

ICE LE	NGTHS	
EPOXY COATED	UNCOATED	
2'-0"	1'-9"	
2′-6″	2'-2"	
3′-10″	2'-7"	
	EPOXY COATED 2'-0" 2'-6"	2'-0" 1'-9" 2'-6" 2'-2"

SEAL 20125

FINAL UNLESS ALL SIGNATURES COMPLETED

STATION: 17+00.00 -L-STATE OF NORTH CAROLINA

BUNCOMBE

B-5396

COUNTY

SHEET NO

S-18

TOTAL SHEETS

BILL OF MATERIAL

APPROACH SLAB AT EB No. 1

* A1 | 26 | #4 | STR | 17'-6"

A2 | 26 | #4 | STR | 17'-5"

*B1 | 64 | #5 | STR | 11'-1"

B2 | 64 | #6 | STR | 11'-7"

* A1 26 #4 | STR | 17'-6"

A2 | 26 | #4 | STR | 17'-5"

*B1 | 64 | *5 | STR | 11'-1"

B2 | 64 | #6 | STR | 11'-7"

REINFORCING STEEL

CLASS AA CONCRETE

REINFORCING STEEL

REINFORCING STEEL

CLASS AA CONCRETE

* EPOXY COATED

REINFORCING STEEL

* EPOXY COATED

BAR | NO. | SIZE | TYPE | LENGTH | WEIGHT

APPROACH SLAB AT EB No. 2

BAR | NO. | SIZE | TYPE | LENGTH | WEIGHT

304

302

740

1113

1415

1044

16.7

304

302

740

1113

1415

1044

16.7

LBS.

LBS.

C.Y.

LBS.

LBS.

C. Y.

DEPARTMENT OF TRANSPORTATION RALEIGH

BRIDGE APPROACH SLAB FOR PRESTRESSED CONCRETE BOX BEAM UNIT (SUB-REGIONAL TIER)

Marshall G. (heck, Ir 105° SKEW **REVISIONS** DATE: BY: DOCUMENT NOT CONSIDERED

SECTION S-S

PROJECT NO.

06-JAN-2016 13:39 R:\Structures\FinalPlans\B5396_SD_AS.dgn

_ DATE : <u>10-15</u>

DATE : 12-15

M. POOLE

B. N. GRADY

DRAWN BY

CHECKED BY :

SECTION THRU SLAB

STANDARD NOTES

DESIGN DATA:

SPECIFICATIONS ---- A.A.S.H.T.O. (CURRENT) LIVE LOAD ---- SEE PLANS IMPACT ALLOWANCE STRESS IN EXTREME FIBER OF STRUCTURAL STEEL - AASHTO M270 GRADE 36 20,000 LBS. PER SQ. IN. - AASHTO M270 GRADE 50W -27,000 LBS. PER SQ. IN. - AASHTO M270 GRADE 50 - 27,000 LBS. PER SQ. IN. REINFORCING STEEL IN TENSION GRADE 60 - - 24,000 LBS. PER SQ. IN. CONCRETE IN COMPRESSION ---- 1,200 LBS. PER SQ. IN. CONCRETE IN SHEAR ---- SEE A.A.S.H.T.O. STRUCTURAL TIMBER - TREATED OR UNTREATED - EXTREME FIBER STRESS - - - - - 1,800 LBS. PER SQ. IN. COMPRESSION PERPENDICULAR TO GRAIN OF TIMBER - - - -375 LBS. PER SQ. IN.

MATERIAL AND WORKMANSHIP:

EQUIVALENT FLUID PRESSURE OF EARTH

EXCEPT AS MAY OTHERWISE BE SPECIFIED ON PLANS OR IN THE SPECIAL PROVISIONS, ALL MATERIAL AND WORKMANSHIP SHALL BE IN ACCORDANCE WITH THE 2012 "STANDARD SPECIFICATIONS FOR ROADS AND STRUCTURES" OF THE N. C. DEPARTMENT OF TRANSPORTATION.

30 LBS. PER CU. FT.

(MINIMUM)

STEEL SHEET PILING FOR PERMANENT OR TEMPORARY APPLICATIONS SHALL BE HOT ROLLED.

CONCRETE:

UNLESS OTHERWISE REQUIRED ON PLANS, CLASS A CONCRETE SHALL BE USED FOR ALL PORTIONS OF ALL STRUCTURES WITH THE EXCEPTION THAT: CLASS AA CONCRETE SHALL BE USED IN BRIDGE SUPERSTRUCTURES, ABUTMENT BACKWALLS, AND APPROACH SLABS; AND CLASS B CONCRETE SHALL BE USED FOR SLOPE PROTECTION AND RIP RAP.

CONCRETE CHAMFERS:

UNLESS OTHERWISE NOTED ON THE PLANS, ALL EXPOSED CORNERS ON STRUCTURES SHALL BE CHAMFERED 3/4" WITH THE FOLLOWING EXCEPTIONS: TOP CORNERS OF CURBS MAY BE ROUNDED TO 1-1/2" RADIUS WHICH IS BUILT INTO CURB FORMS; CORNERS OF TRANSVERSE FLOOR EXPANSION JOINTS SHALL BE ROUNDED WITH A 1/4" FINISHING TOOL UNLESS OTHERWISE REQUIRED ON PLANS; AND CORNERS OF EXPANSION JOINTS IN THE ROADWAY FACES AND TOPS OF CURBS AND SIDEWALKS SHALL BE ROUNDED TO A 1/4" RADIUS WITH A FINISHING STONE OR TOOL UNLESS OTHERWISE REQUIRED ON PLANS.

DOWELS:

DOWELS WHEN INDICATED ON PLANS AS FOR CULVERT EXTENSIONS, SHALL BE EMBEDDED AT LEAST 12" INTO THE OLD CONCRETE AND GROUTED INTO PLACE WITH 1:2 CEMENT MORTAR.

ALLOWANCE FOR DEAD LOAD DEFLECTION, SETTLEMENT, ETC. IN CASTING SUPERSTRUCTURES:

BRIDGES SHALL BE BUILT ON THE GRADE OR VERTICAL CURVE SHOWN ON PLANS.
SLABS, CURBS AND PARAPETS SHALL CONFORM TO THE GRADE OR CURVE.

ALL DIMENSIONS WHICH ARE GIVEN IN SECTION AND ARE AFFECTED BY DEAD LOAD DEFLECTIONS ARE DIMENSIONS AT CENTER LINE OF BEARING UNLESS OTHERWISE NOTED ON PLANS. IN SETTING FORMS FOR STEEL BEAM BRIDGES AND PRESTRESSED CONCRETE GIRDER BRIDGES, ADJUSTMENTS SHALL BE MADE DUE TO THE DEAD LOAD DEFLECTIONS FOR THE ELEVATIONS SHOWN. WHERE BLOCKS ARE SHOWN OVER BEAMS FOR BUILDING UP TO THE SLAB, THE VERTICAL DIMENSIONS OF THE BLOCKS SHALL BE ADJUSTED BETWEEN BEARINGS TO COMPENSATE FOR DEAD LOAD DEFLECTIONS, VERTICAL CURVE ORDINATE, AND ACTUAL BEAM CAMBER. WHERE BOTTOM OF SLAB IS IN LINE WITH BOTTOM OF TOP FLANGES, DEPTH OF SLAB BETWEEN BEARINGS SHALL BE ADJUSTED TO COMPENSATE FOR DEAD LOAD DEFLECTION, VERTICAL CURVE ORDINATE, AND ACTUAL BEAM CAMBER.

IN SETTING FALSEWORK AND FORMS FOR REINFORCED CONCRETE SPANS, AN ALLOWANCE SHALL BE MADE FOR DEAD LOAD DEFLECTIONS, SETTLEMENT OF FALSEWORK, AND PERMANENT CAMBER WHICH SHALL BE PROVIDED FOR IN ADDITION TO THE ELEVATIONS SHOWN. AFTER REMOVAL OF THE FALSEWORK, THE FINISHED STRUCTURES SHALL CONFORM TO THE PROFILE AND ELEVATIONS SHOWN ON THE PLANS AND CONSTRUCTION ELEVATIONS FURNISHED BY THE ENGINEER.

DETAILED DRAWINGS FOR FALSEWORK OR FORMS FOR BRIDGE SUPERSTRUCTURE AND ANY STRUCTURE OR PARTS OF A STRUCTURE AS NOTED ON THE PLANS SHALL BE SUBMITTED TO THE ENGINEER FOR APPROVAL BEFORE CONSTRUCTION OF THE FALSEWORK OR FORMS IS STARTED.

REINFORCING STEEL:

ALL REINFORCING STEEL SHALL BE DEFORMED. DIMENSIONS RELATIVE TO PLACEMENT OF REINFORCING ARE TO CENTERS OF BARS UNLESS OTHERWISE INDICATED IN THE PLANS. DIMENSIONS ON BAR DETAILS ARE TO CENTERS OF BARS OR ARE OUT TO OUT AS INDICATED ON PLANS.

WIRE BAR SUPPORTS SHALL BE PROVIDED FOR REINFORCING STEEL WHERE INDICATED ON THE PLANS. WHEN BAR SUPPORT PIECES ARE PLACED IN CONTINUOUS LINES, THEY SHALL BE SO PLACED THAT THE ENDS OF THE SUPPORTING WIRES SHALL BE LAPPED TO LOCK LEGS ON ADJOINING PIECES.

STRUCTURAL STEEL:

AT THE CONTRACTOR'S OPTION, HE MAY SUBSTITUTE 7/8" Ø SHEAR STUDS FOR THE 3/4" Ø STUDS SPECIFIED ON THE PLANS. THIS SUBSTITUTION SHALL BE MADE AT THE RATE OF 3 - 7/8" Ø STUDS FOR 4 - 3/4" Ø STUDS, AND STUD SPACING CHANGES SHALL BE MADE AS NECESSARY TO PROVIDE THE SAME EQUIVALENT NUMBER OF 7/8" Ø STUDS ALONG THE BEAM AS SHOWN FOR 3/4" Ø STUDS BASED ON THE RATIO OF 3 - 7/8" Ø STUDS FOR 4 - 3/4" Ø STUDS. STUDS OF THE LENGTH SPECIFIED ON THE PLANS MUST BE PROVIDED. THE MAXIMUM SPACING SHALL BE 2'-0".

EXCEPT AT THE INTERIOR SUPPORTS OF CONTINUOUS BEAMS WHERE THE COVER PLATE IS IN CONTACT WITH BEARING PLATE, THE CONTRACTOR MAY, AT HIS OPTION, SUBSTITUTE FOR THE COVER PLATES DESIGNATED ON THE PLANS COVER PLATES OF THE EQUIVALENT AREA PROVIDED THESE PLATES ARE AT LEAST 5/16" IN THICKNESS AND DO NOT EXCEED A WIDTH EQUAL TO THE FLANGE WIDTH LESS 2"OR A THICKNESS EQUAL TO 2 TIMES THE FLANGE THICKNESS. THE SIZE OF FILLET WELDS SHALL CONFORM TO THE REQUIREMENTS OF THE CURRENT ANSI/AASHTO/AWS "BRIDGE WELDING CODE". ELECTROSLAG WELDING WILL NOT BE PERMITTED.

WITH THE SOLE EXCEPTION OF EDGES AT SURFACES WHICH BEAR ON OTHER SURFACES, ALL SHARP EDGES AND ENDS OF SHAPES AND PLATES SHALL BE SLIGHTLY ROUNDED BY SUITABLE MEANS TO A RADIUS OF APPROXIMATELY 1/16 INCH OR EQUIVALENT FLAT SURFACE AT A SUITABLE ANGLE PRIOR TO PAINTING, GALVANIZING, OR METALLIZING.

HANDRAILS AND POSTS:

METAL STANDARDS AND FACES OF THE CONCRETE END POSTS FOR THE METAL RAIL SHALL BE SET NORMAL TO THE GRADE OF THE CURB, UNLESS OTHERWISE SHOWN ON PLANS. THE METAL RAIL AND TOPS OF CONCRETE POSTS USED WITH THE ALUMINUM RAIL SHALL BE BUILT PARALLEL TO THE GRADE OF THE CURB.

METAL HANDRAILS SHALL BE IN ACCORDANCE WITH THE PLANS. RAILS SHALL BE AS MANUFACTURED FOR BRIDGE RAILING. CASTINGS SHALL BE OF A UNIFORM APPEARANCE. FINS AND OTHER DEFORMATIONS RESULTING FROM CASTING OR OTHERWISE SHALL BE REMOVED IN A MANNER SO THAT A UNIFORM COLORING OF THE COMPLETED CASTING SHALL BE OBTAINED. CASTINGS WITH DISCOLORATIONS OR OF NON-UNIFORM COLORING WILL NOT BE ACCEPTED. CERTIFIED MILL REPORTS ARE REQUIRED FOR METAL RAILS AND POSTS.

SPECIAL NOTES:

GENERALLY, IN CASE OF DISCREPANCY, THIS STANDARD SHEET OF NOTES SHALL GOVERN OVER THE SPECIFICATIONS, BUT THE REMAINDER OF THE PLANS SHALL GOVERN OVER NOTES HEREON, AND SPECIAL PROVISIONS SHALL GOVERN OVER ALL. SEE SPECIFICATIONS ARTICLE 105-4.

ENGLISH