

STA.15+07.92 -SRVRD-

EL.567.30

RIGHT LANE

11/2:1

-O" BERM

FL.

579.63

EVEL '

- 4" CONCRETE

SLOPE PROTECTION -L-


27'-0"


STA. 21+44.11 -L-

STA.15+24.77

-SRVRD-

STA.15+93.09 -SRVRD-EL.566.47

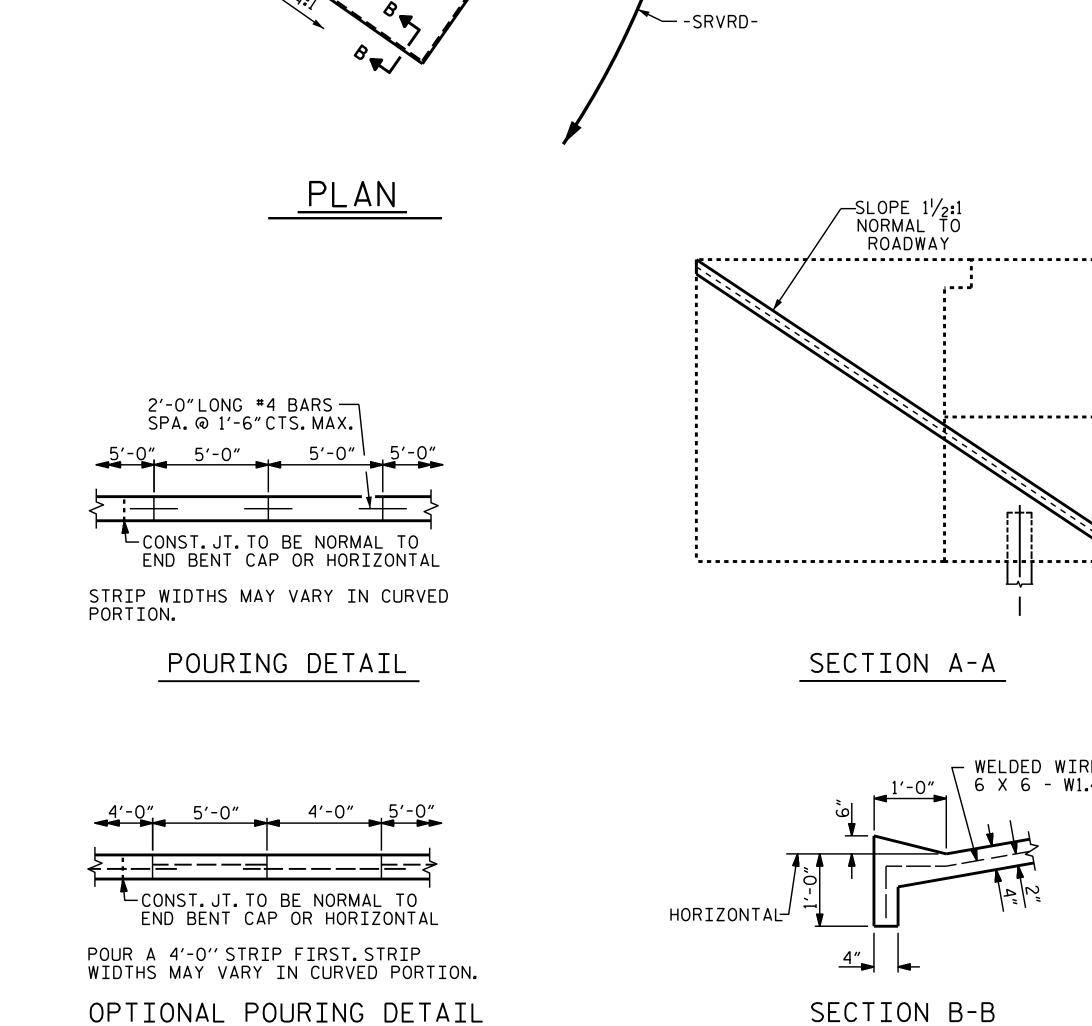


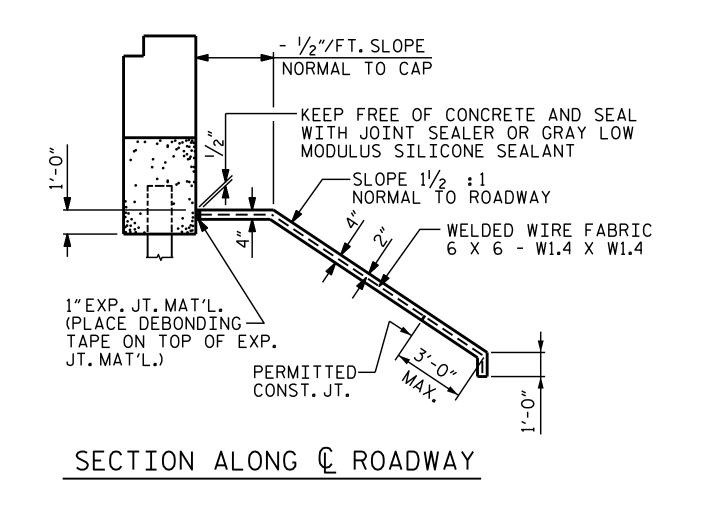

ASSEMBLED BY : K.D.LAYNE CHECKED BY : H.LOCKLEAR	DATE : 11/9/15 DATE : 11/18/15	
	REV. 5/1/06 TLA/GN   REV. 10/1/11 MAA/GI   REV. 12/21/11 MAA/GI	Ň

+

+



## GENERAL NOTES

SLOPE PROTECTION SHALL BE PLACED UNDER THE END OF THE BRIDGE AS SHOWN IN THE DETAILS. STRAIGHT EDGING WILL NOT BE REQUIRED UNLESS, IN THE OPINION OF THE ENGINEER, VISUAL INSPECTION INDICATEDS NEED FOR IT. MEASUREMENT AND PAYMENT SHALL BE AS PRESCRIBED IN SECTION 462 OF THE STANDARD SPECIFICATIONS.FOR BERM WIDTH, SEE GENERAL DRAWING.

SLOPE PROTECTION SHALL CONSIST OF 4" POURED-IN PLACE CONCRETE PAVING AS SHOWN IN THE DETAILS ON THIS SHEET. CONCRETE SHALL BE CLASS ``B''. THE CONCRETE SURFACE SHALL BE FLOATED WITH A WOODEN FLOAT AND FINISHED. WELDED WIRE FABRIC REINFORCING SHALL BE 6 X 6 -W1.4 X W1.4, 60" WIDE. SLOPE PROTECTION SHALL BE POURED IN 5' STRIPS AS SHOWN IN THE "POURING DETAIL" WITH 2'-O"LONG #4 BARS PLACED ALONG THE SLOPE BETWEEN STRIPS AT 1'-6" MAXIMUM SPACING. SLOPE PROTECTION MAY BE POURED IN ALTERNATE 4' AND 5' STRIPS AS SHOWN IN THE "OPTIONAL POURING DETAIL" WITH ADJACENT RUNS OF WELDED WIRE FABRIC LAPPING AT LEAST 6". THE COST OF THE WELDED WIRE FABRIC AND #4 BARS, IF USED, SHALL BE INCLUDED IN THE CONTRACT UNIT PRICE BID PER SQUARE YARD FOR SLOPE PROTECTION.

BRIDGE @ STA.21+44.10 -L-	4 INCH SLOPE PROTECTION	* WELDED WIRE FABRIC 60 INCHES WIDE
	SQUARE YARDS	APPROX.L.F.
END BENT 1	410	820
* QUANTITY SHOWN IS BASED ON 5' POURS.		

---- 4" CONCRETE SLOPE PROTECTION 6 X 6 - W1.4 X W1.4

