

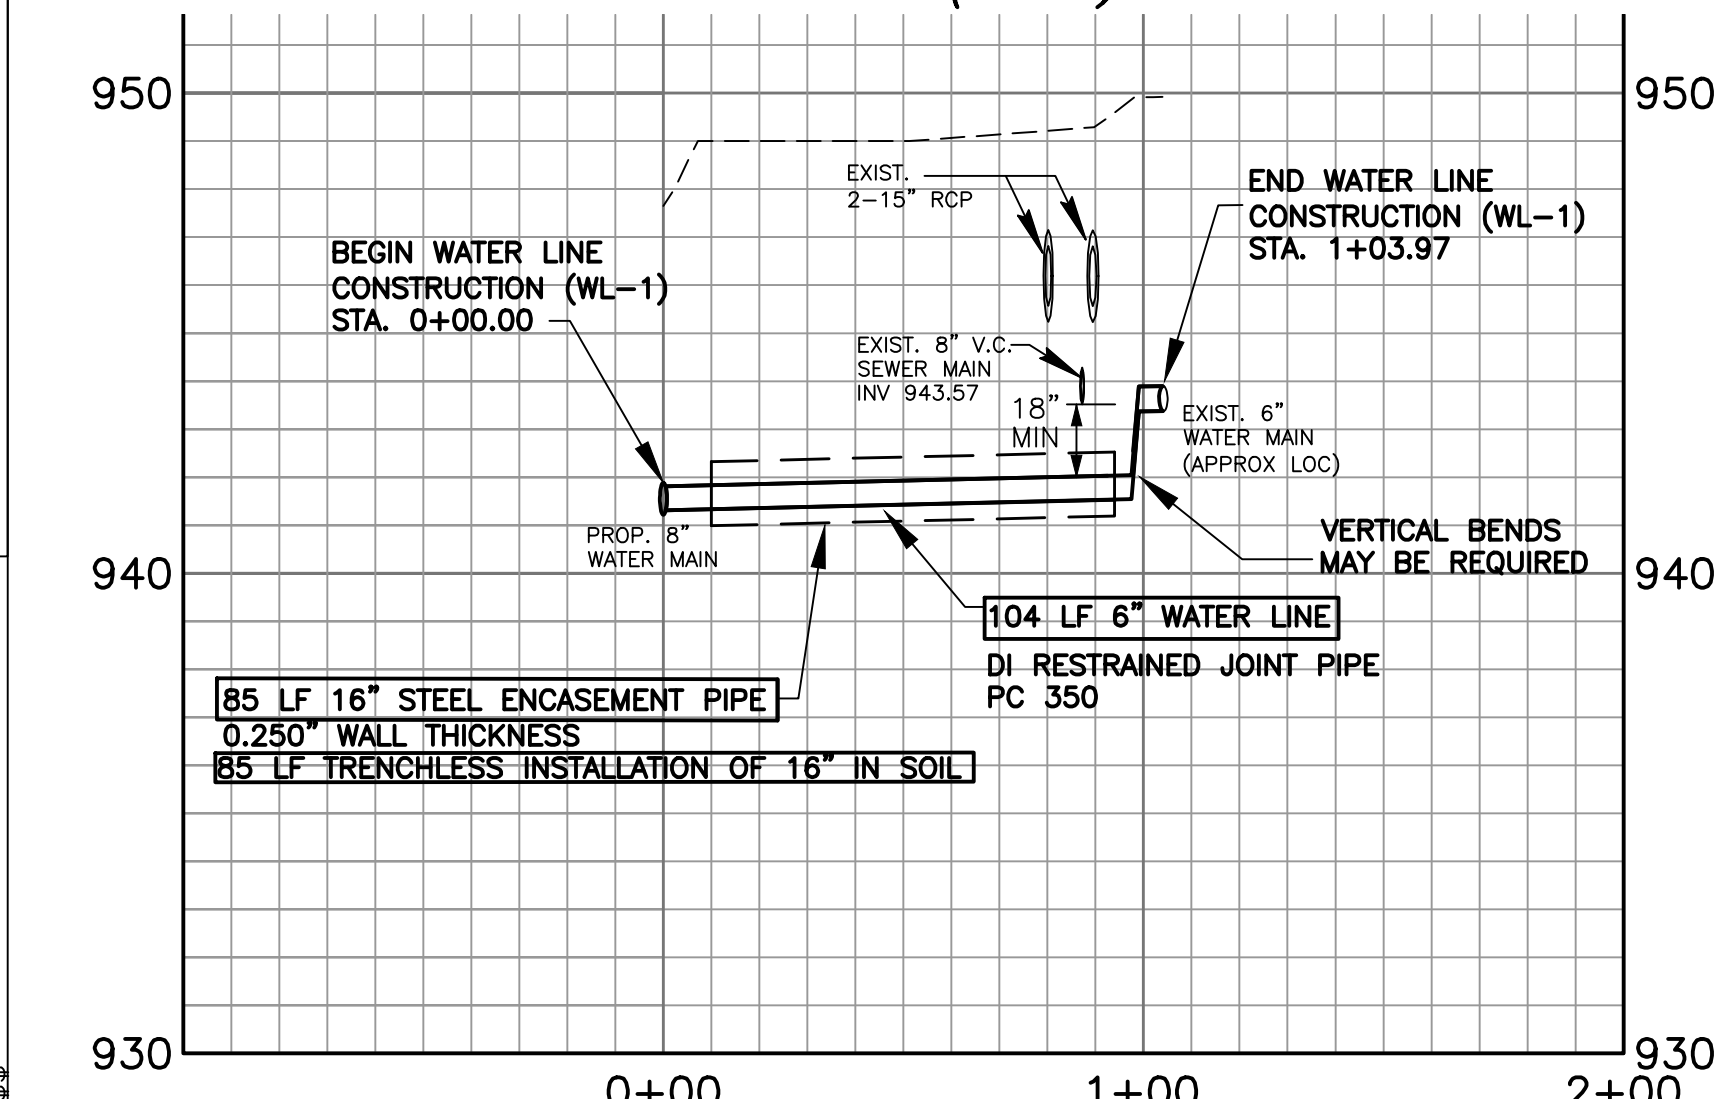


NOTE: EXISTING FIRE HYDRANT TO REMAIN IN SERVICE DURING CONSTRUCTION. CONTRACTOR TO CLOSE 6" HYDRANT VALVE AND PROPERLY RESTRAIN HYDRANT BEFORE EXCAVATING BEHIND HYDRANT. UPON COMPLETION OF PROP. WATER MAIN, REMOVE EXIST. FH.

CHARLESTOWNE SQUARE ENTRANCE (WL-1)

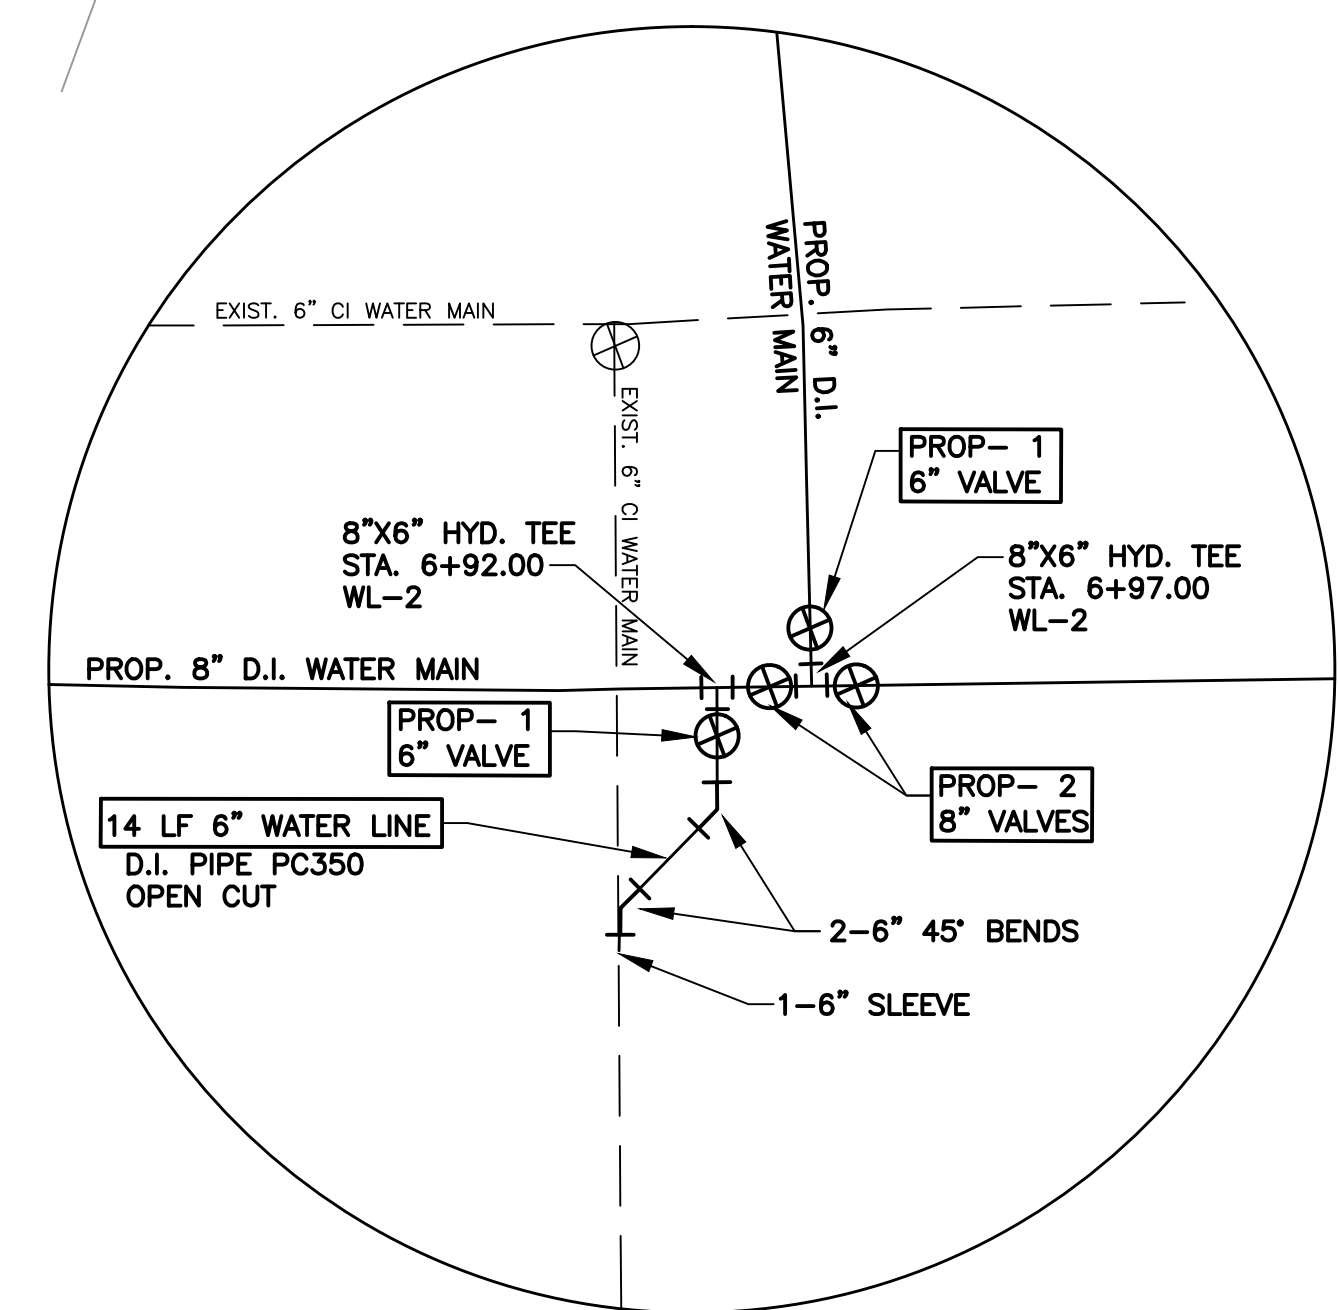

HYDRANT LEG @ STA. 4+09

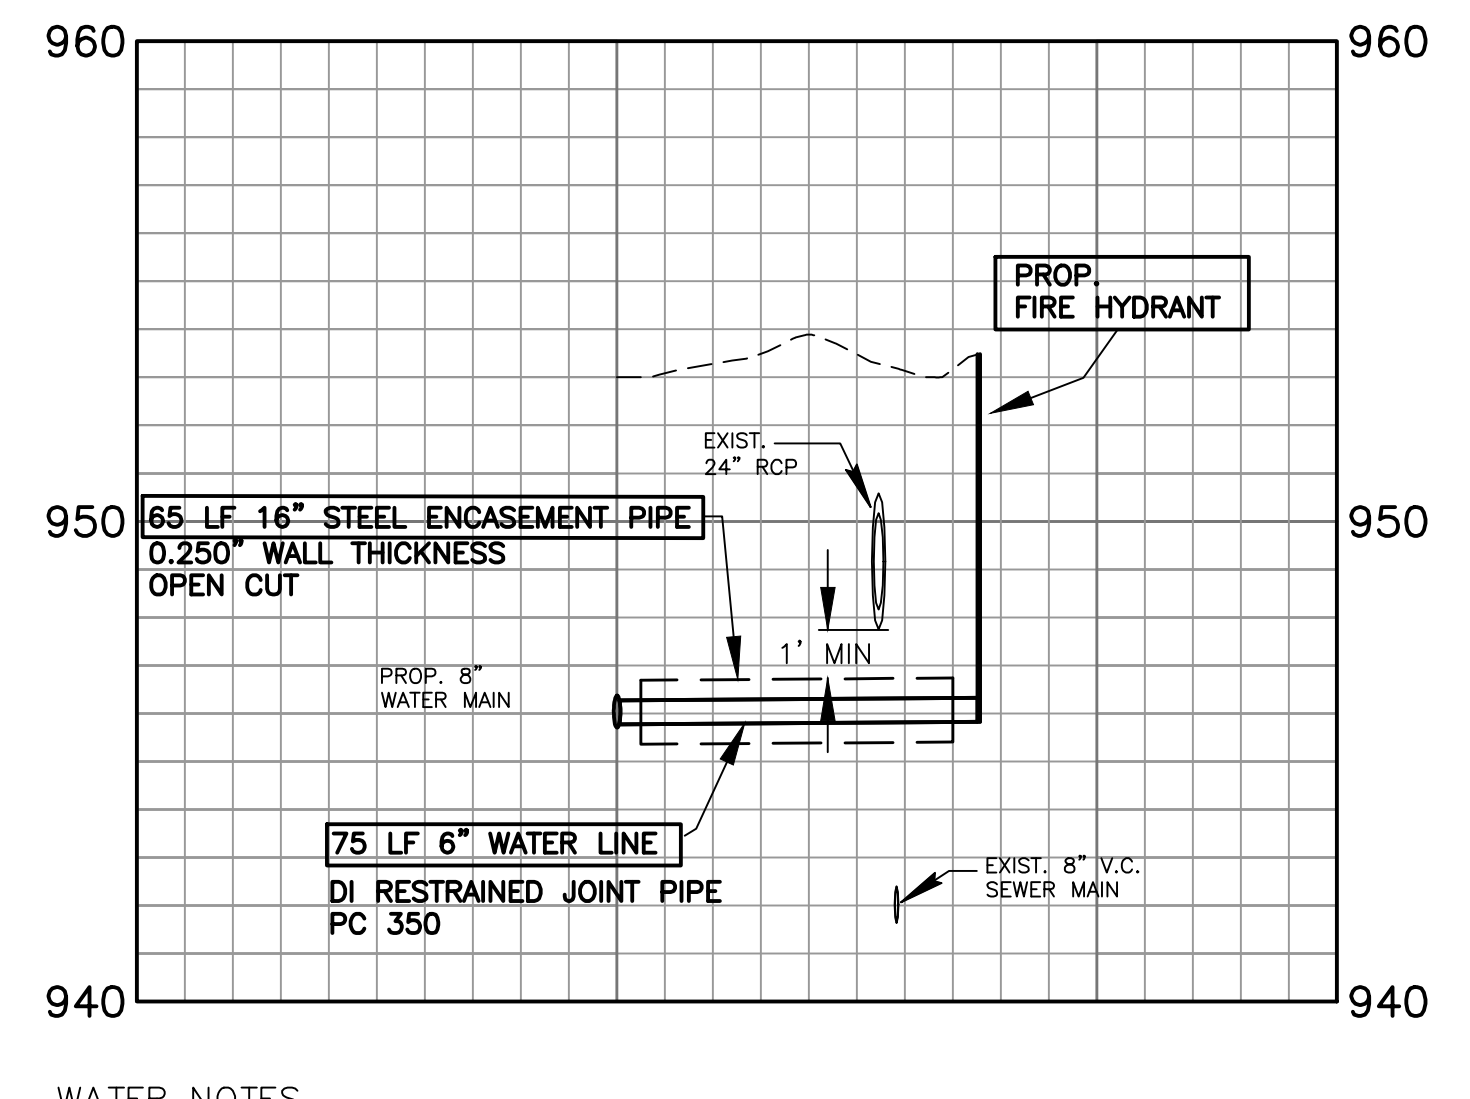

NOTE: FOR WL-2 PROFILE, SEE SHEET UC-7 FOR WL-3 PROFILE, SEE SHEET UC-8

WATER NOTES

- 1. WATER MAINS WILL HAVE A MINIMUM OF 3 FEET OF COVER.
2. IF POSSIBLE, FIRE HYDRANTS WILL BE LOCATED ON THE RIGHT-OF-WAY LINE. HYDRANTS SHALL BE LOCATED AS SHOWN ON PLAN VIEW.
3. WATER MAINS WILL BE LOCATED 5 FEET FROM THE EDGE OF PAVEMENT OR AS SHOWN ON PLAN VIEW.
4. EXISTING PAVEMENT TO BE REPAIRED OR REPLACED AS REQUIRED (OR BORED AND JACKED AS SHOWN).
5. LONG SIDE WATER CONNECTIONS WILL BE BORED UNLESS DIRECTED OTHERWISE BY THE ENGINEER.
6. ALL PROPOSED VALVES SHALL BE PLACED OUTSIDE THE EXISTING PAVEMENT UNLESS OTHERWISE SHOWN ON THE PLANS.

6" D.I. WATER MAIN RELOCATION PROJECT 74339 9339

CITY OF WINSTON-SALEM PERMIT NUMBER WATER 2732 SEWER DATE 12-16-15

REVISIONS

Vertical text on the left margin containing revision details.