


Prepared by:




AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607
919-854-8200 919-854-8259 (fax)
F - 0342

PROJECT REFERENCE NO.	SHEET NO.
B-4490	UC-7
DESIGNED BY:	
DRAWN BY:	
CHECKED BY:	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
2/1/2016	

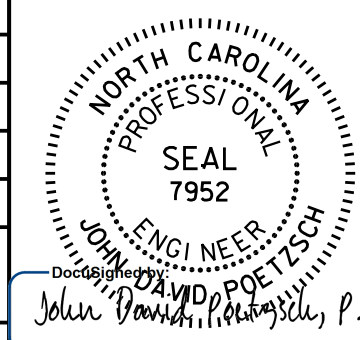

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

UTILITY CONSTRUCTION

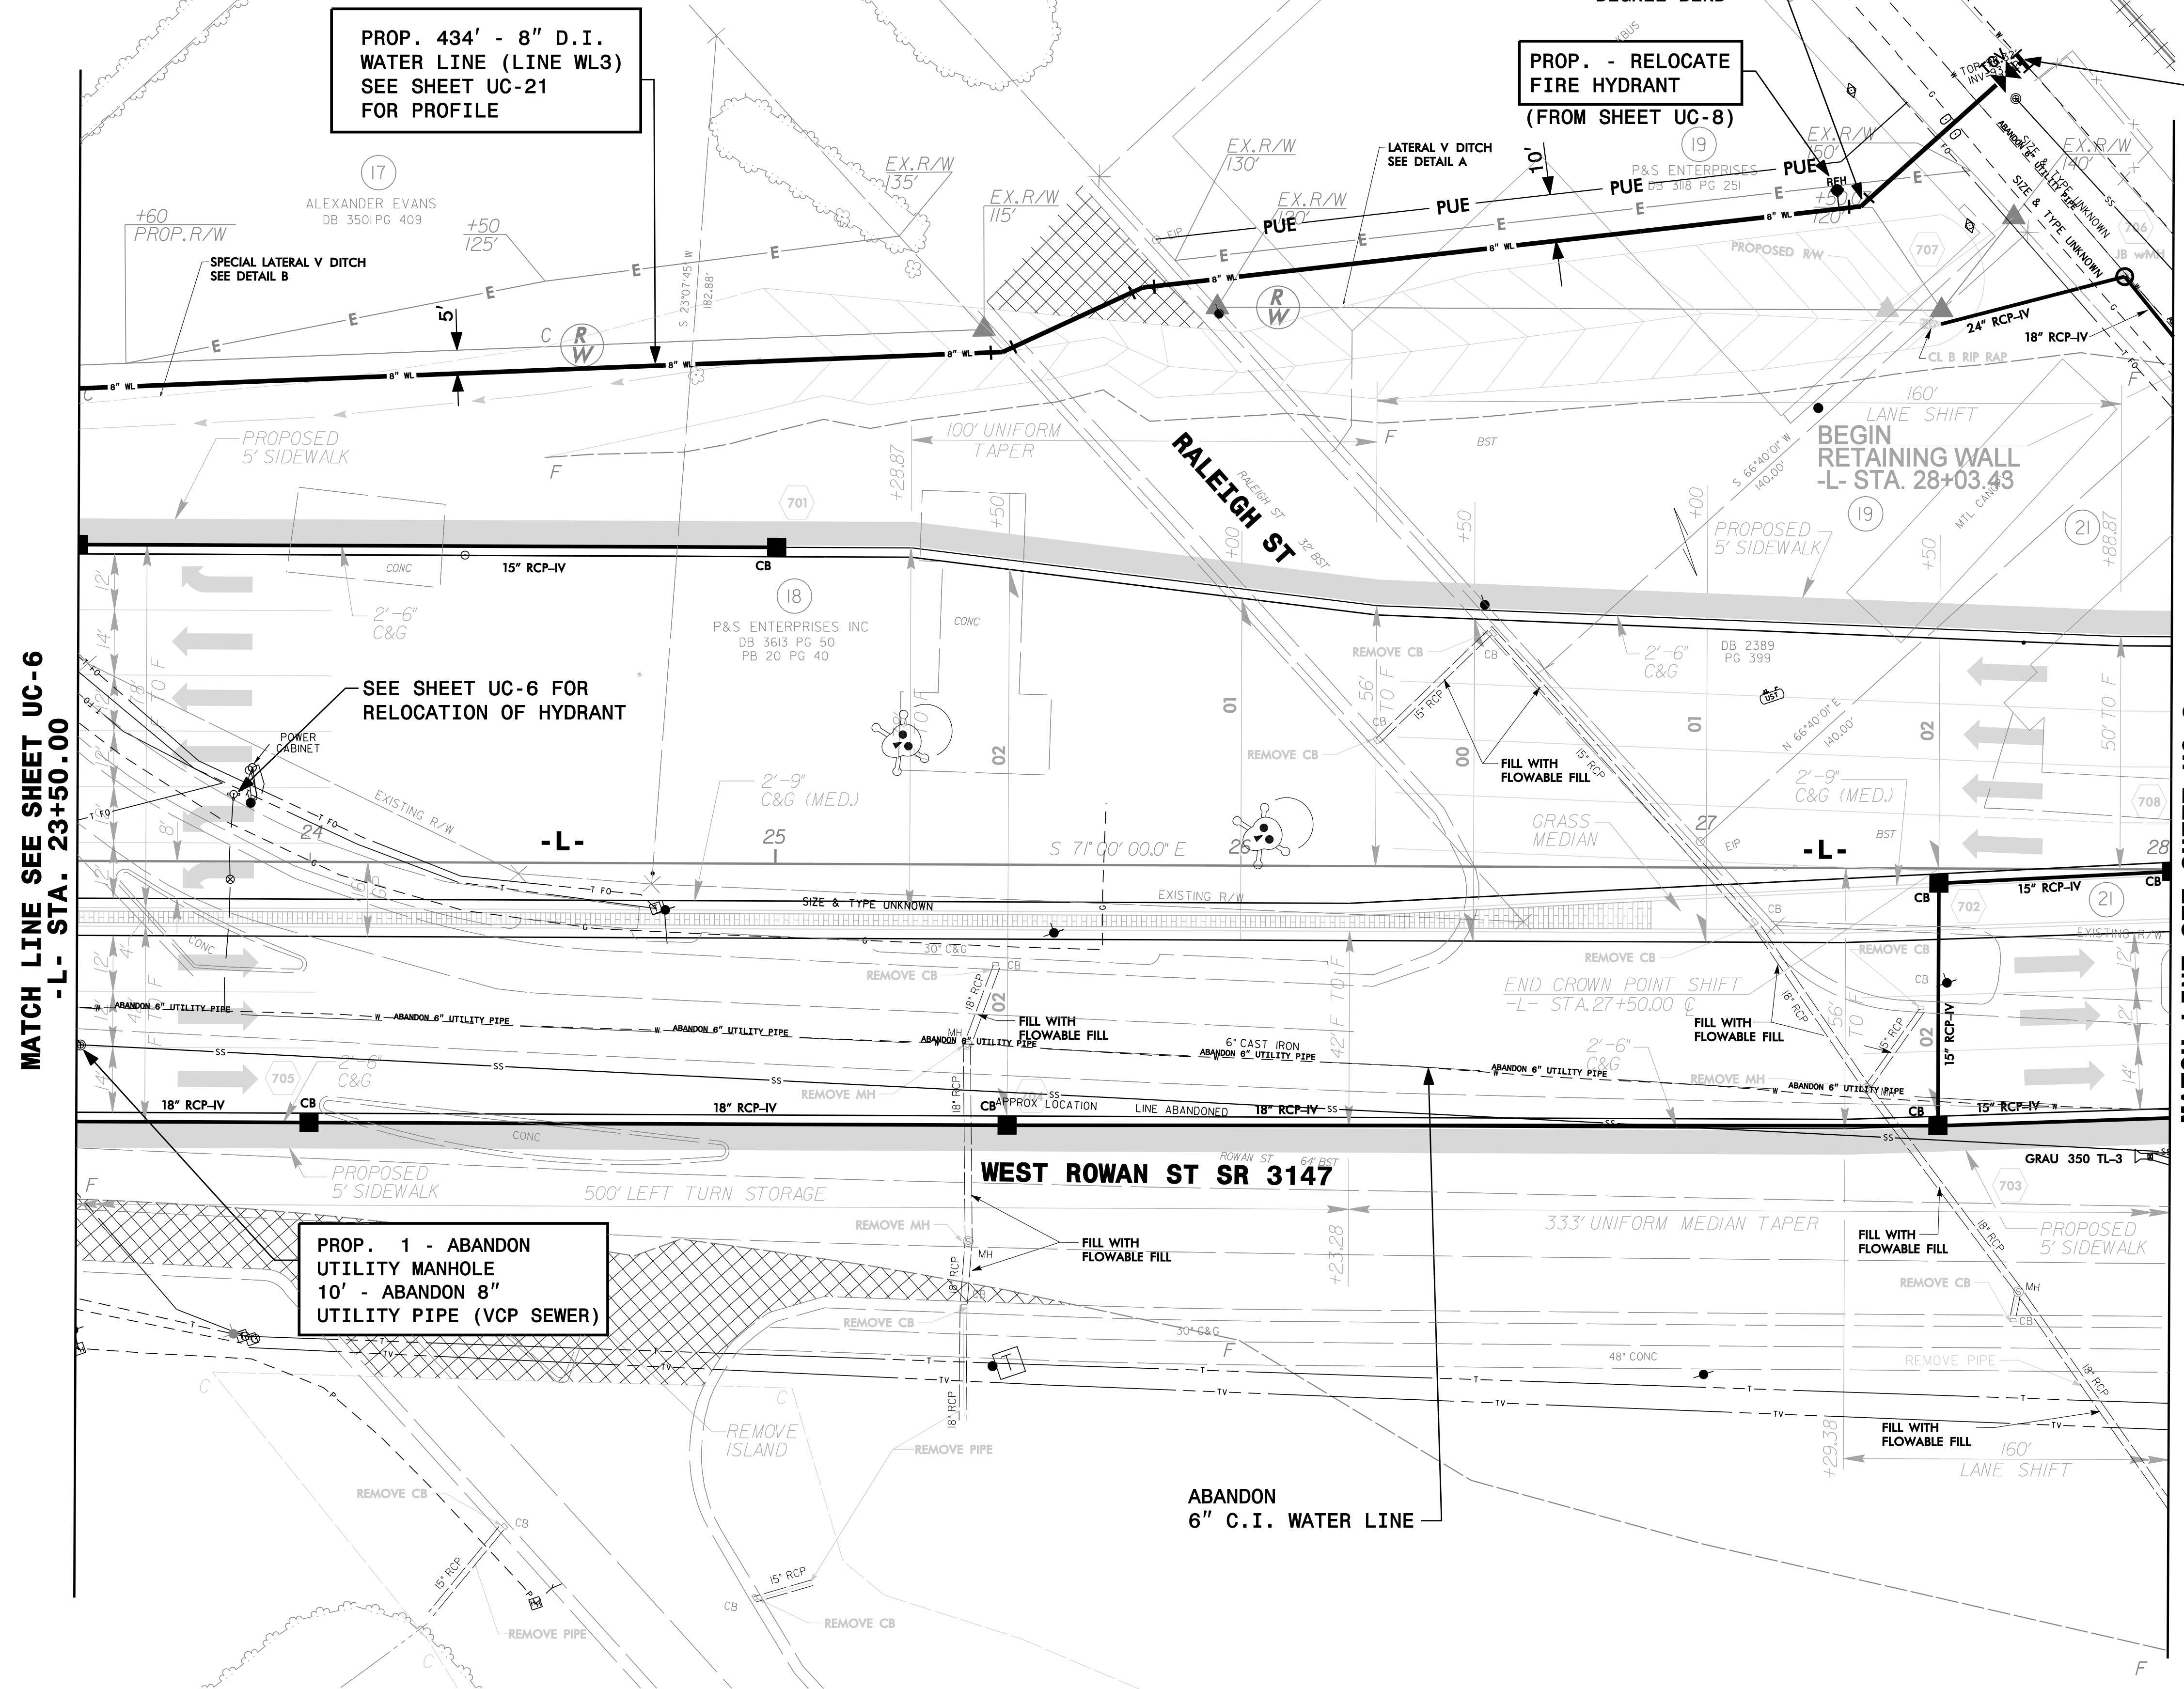

PROP. 434' - 8" D.I. WATER LINE (LINE WL3) SEE SHEET UC-21 FOR PROFILE

PROP. - RELOCATE FIRE HYDRANT (FROM SHEET UC-8)

PROP. 16" x 8" TAPPING VALVE

SEE SHEET UC-6 FOR RELOCATION OF HYDRANT

PROP. 1 - ABANDON UTILITY MANHOLE
10' - ABANDON 8" UTILITY PIPE (VCP SEWER)

MATCH LINE SEE SHEET UC-6
-L- STA. 23+50.00

MATCH LINE SEE SHEET UC-8
-L- STA. 28+00.00

