




TO KANNAPOLIS ←

TO GASTONIA →

SOFT DIG # 728
DUCT BANK
WIDTH/SIZE: 12"x14" VCP
TOP DEPTH: 35"
OWNER: AT&T

SOFT DIG # 730
DUCT BANK
WIDTH/SIZE: 12"x14" VCP
TOP DEPTH: 35"
OWNER: AT&T

CONVENTIONAL SIGNS	
Existing Gas Line	-----
Existing Water Line	-----
Existing Sanitary Sewer	-----
Existing Underground Telecommunications	-----
Existing Underground Electric	-----
Existing Joint Use Power Pole	-----
Existing Power Pole	-----
Existing Power Hand Hole	-----
Existing Power Transformer	-----
Existing Sanitary Sewer Manhole	-----
Existing Water Valve	-----
Existing Fire Hydrant	-----
Existing Water Manhole	-----
Existing Telephone Handhole	-----
Existing Telephone Pedestal	-----
Existing Telephone Manhole	-----

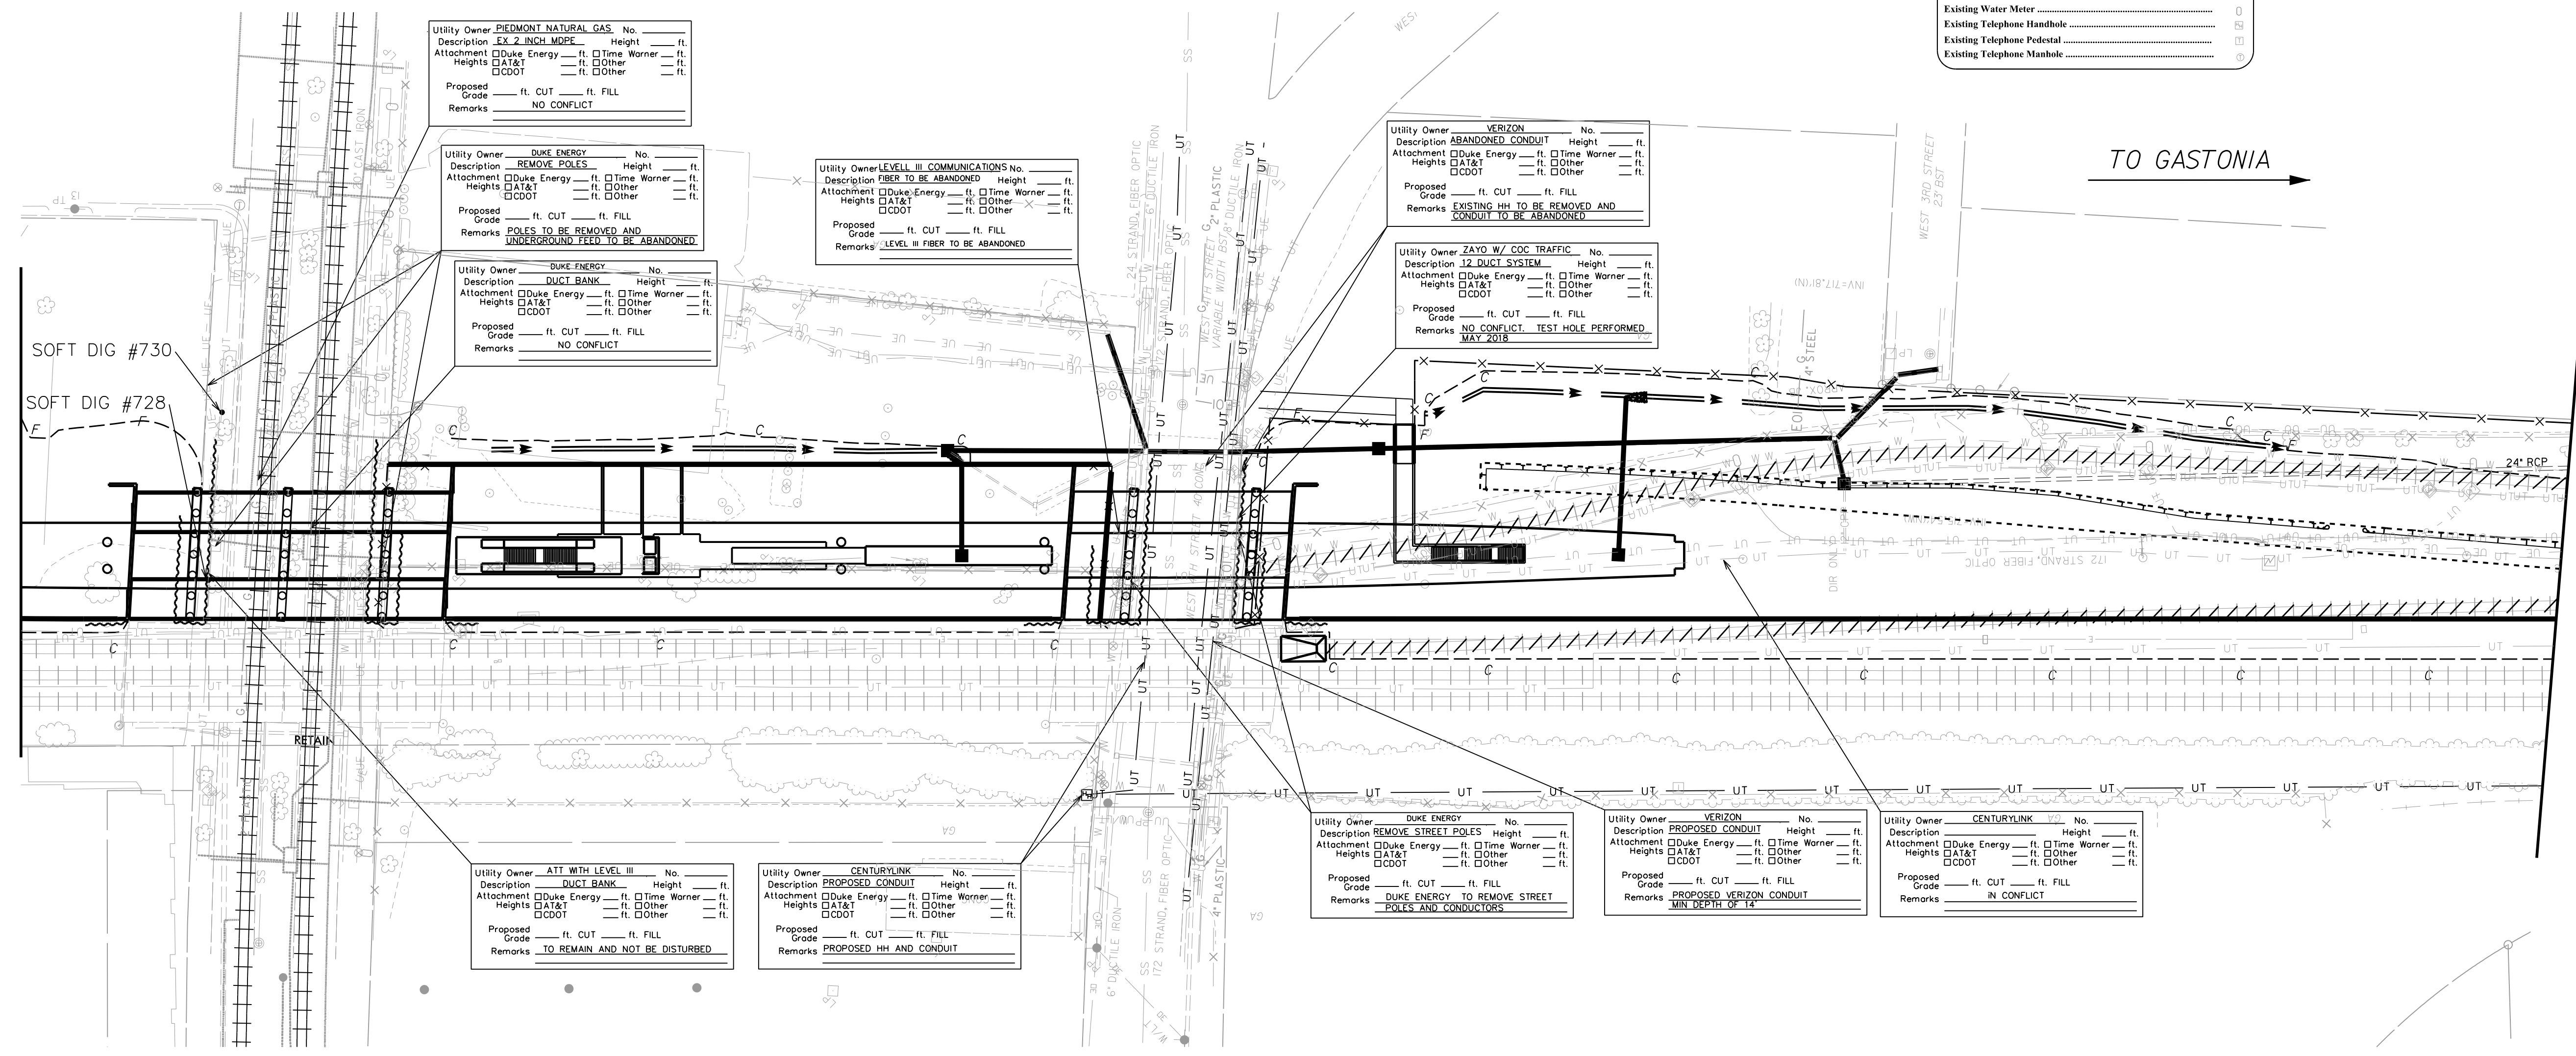

Utility Owner: PEDMONT NATURAL GAS No. _____
Description: EX 2 INCH HDPE Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: NO CONFLICT

Utility Owner: DUKE ENERGY No. _____
Description: REMOVE POLES Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: POLES TO BE REMOVED AND UNDERGROUND FEED TO BE ABANDONED

Utility Owner: DUKE ENERGY No. _____
Description: DUCT BANK Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: NO CONFLICT

Utility Owner: LEVEL III COMMUNICATIONS No. _____
Description: FIBER TO BE ABANDONED Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: LEVEL III FIBER TO BE ABANDONED

Utility Owner: VERIZON No. _____
Description: ABANDONED CONDUIT Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: EXISTING HH TO BE REMOVED AND CONDUIT TO BE ABANDONED

Utility Owner: ZAYO W/ COC TRAFFIC No. _____
Description: 12 DUCT SYSTEM Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: NO CONFLICT. TEST HOLE PERFORMED MAY 2018

Utility Owner: ATT WITH LEVEL III No. _____
Description: DUCT BANK Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: TO REMAIN AND NOT BE DISTURBED


Utility Owner: CENTURYLINK No. _____
Description: PROPOSED CONDUIT Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: PROPOSED HH AND CONDUIT

Utility Owner: DUKE ENERGY No. _____
Description: REMOVE STREET POLES Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: DUKE ENERGY TO REMOVE STREET POLES AND CONDUCTORS

Utility Owner: VERIZON No. _____
Description: PROPOSED CONDUIT Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: PROPOSED VERIZON CONDUIT MIN DEPTH OF 14"

Utility Owner: CENTURYLINK No. _____
Description: _____ Height _____ ft.
Attachment: Duke Energy _____ ft. Time Warner _____ ft.
Heights: AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
Proposed Grade: _____ ft. CUT _____ ft. FILL _____ ft.
Remarks: IN CONFLICT


SHEET UO-02	P-5705BA	JOB NO. 696.027	SCALE 1" = 20'			Plans Prepared By: M A A Engineering Consultants, Inc.
				OF UO-03	SI STA 22+00 TO SI STA 35+50	
FINAL SET DO NOT USE FOR CONSTRUCTION MARCH 13, 2018		DESCRIPTION NO. DATE BY				

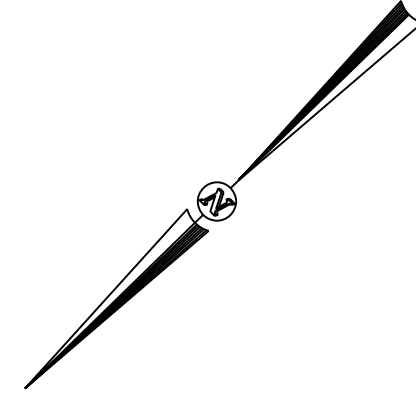

← TO KANNAPOLIS

→ TO GASTONIA

CONVENTIONAL SIGNS	
Existing Gas Line	— G — G — G — G — G —
Existing Water Line	— W — W — W — W — W —
Existing Sanitary Sewer	— SS — SS — SS — SS — SS —
Existing Underground Telecommunications	— UT — UT — UT — UT — UT —
Existing Underground Electric	— UE — UE — UE — UE — UE —
Existing Transmission Tower.....	⊠
Existing Joint Use Power Pole.....	●
Existing Power Pole	○
Existing Power Hand Hole	⊕
Existing Power Transformer	⊞
Existing Sanitary Sewer Manhole	⊗
Existing Water Valve	⊙
Existing Fire Hydrant.....	⊚
Existing Water Manhole	⊛
Existing Water Meter	⊜
Existing Telephone Handhole	⊝
Existing Telephone Pedestal	⊞
Existing Telephone Manhole	⊟

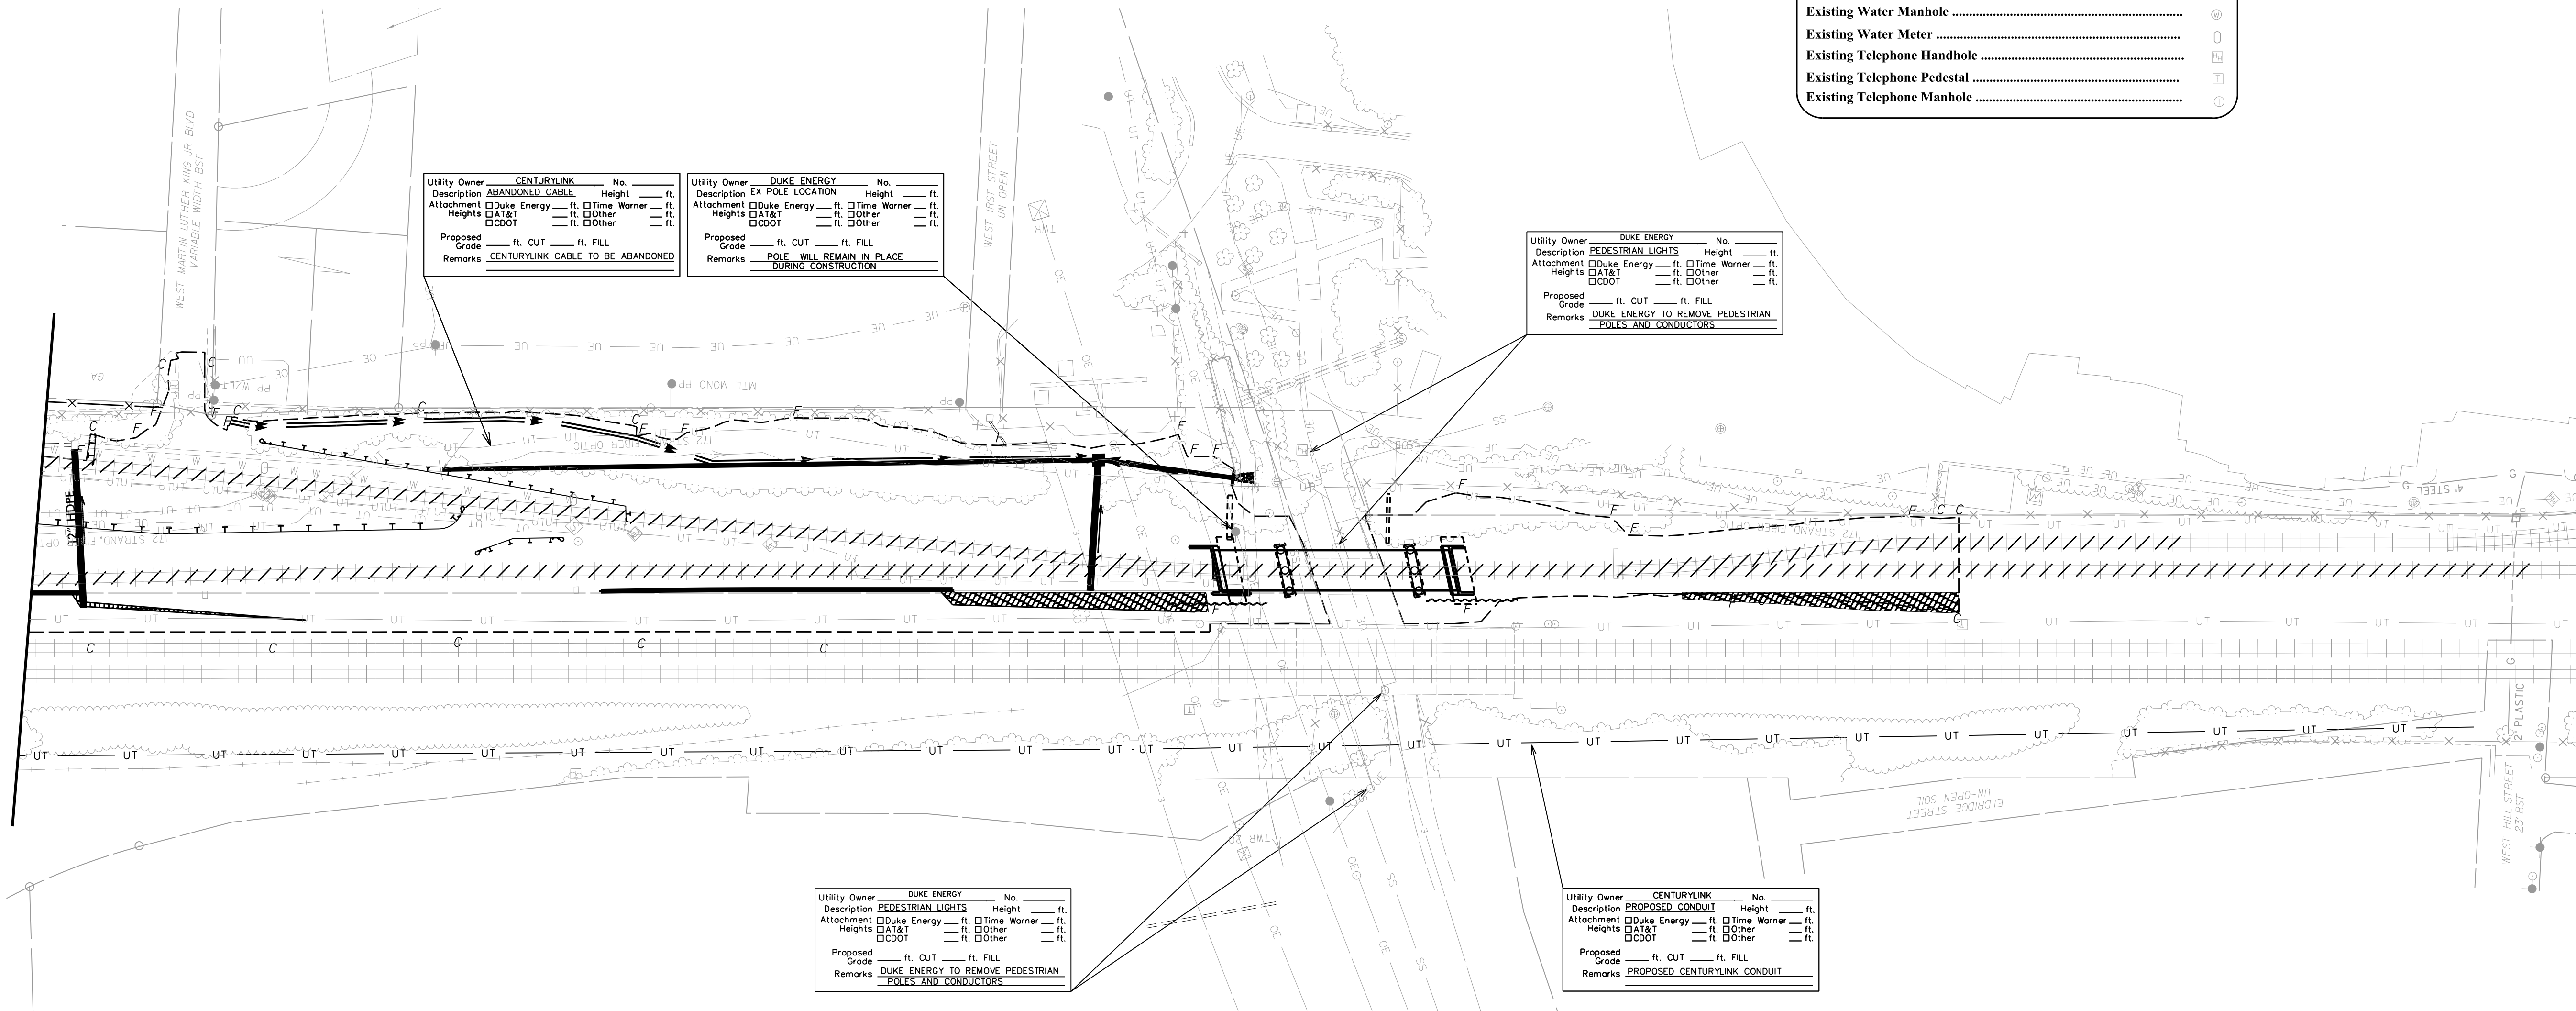

Utility Owner CENTURYLINK No. _____
 Description ABANDONED CABLE Height _____ ft.
 Attachment Duke Energy _____ ft. Time Warner _____ ft.
 Heights AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
 Proposed _____ ft. CUT _____ ft. FILL _____ ft.
 Remarks CENTURYLINK CABLE TO BE ABANDONED

Utility Owner DUKE ENERGY No. _____
 Description EX POLE LOCATION Height _____ ft.
 Attachment Duke Energy _____ ft. Time Warner _____ ft.
 Heights AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
 Proposed _____ ft. CUT _____ ft. FILL _____ ft.
 Remarks POLE WILL REMAIN IN PLACE DURING CONSTRUCTION

Utility Owner DUKE ENERGY No. _____
 Description PEDESTRIAN LIGHTS Height _____ ft.
 Attachment Duke Energy _____ ft. Time Warner _____ ft.
 Heights AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
 Proposed _____ ft. CUT _____ ft. FILL _____ ft.
 Remarks DUKE ENERGY TO REMOVE PEDESTRIAN POLES AND CONDUCTORS

Utility Owner DUKE ENERGY No. _____
 Description PEDESTRIAN LIGHTS Height _____ ft.
 Attachment Duke Energy _____ ft. Time Warner _____ ft.
 Heights AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
 Proposed _____ ft. CUT _____ ft. FILL _____ ft.
 Remarks DUKE ENERGY TO REMOVE PEDESTRIAN POLES AND CONDUCTORS

Utility Owner CENTURYLINK No. _____
 Description PROPOSED CONDUIT Height _____ ft.
 Attachment Duke Energy _____ ft. Time Warner _____ ft.
 Heights AT&T _____ ft. Other _____ ft.
 CDOT _____ ft. Other _____ ft.
 Proposed _____ ft. CUT _____ ft. FILL _____ ft.
 Remarks PROPOSED CENTURYLINK CONDUIT

SHEET UO-03	OF UO-03	PROJECT STA 35+50 TO END OF PROJECT	JOB NO. P-5705BA	SCALE 1" = 50'	DATE 09-18-2017	CHECKED BY WW	DATE 09-18-2017	APPROVED BY	PREPARED BY GJB	DATE 09-18-2017	CHECKED BY WW	DATE 09-18-2017	APPROVED BY	DATE MARCH 13, 2018	NO.	DATE	BY	DESCRIPTION	Plans Prepared By:	 HNTB HNTB M A A Engineering Consultants, Inc. 198 West Charlotte Street, Suite 117 Charlotte, NC 28202 Phone: 704.375.2020 Fax: 704.375.2021 www.hntb.com	 CHARLOTTE
																			FINAL SET DO NOT USE FOR CONSTRUCTION		