

Prepared In the Office of:




AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607
919-854-6200 919-854-6259 (fax)
F - 0342

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

PROJECT REFERENCE NO.	SHEET NO.
R-3825B	UC-21
DESIGNED BY:	8/9/2018
DRAWN BY:	
CHECKED BY:	
APPROVED BY:	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
D. Stephen Scruggs PROFESSIONAL SEAL 10666 ENGINEER STATE OF NORTH CAROLINA	

UTILITY CONSTRUCTION

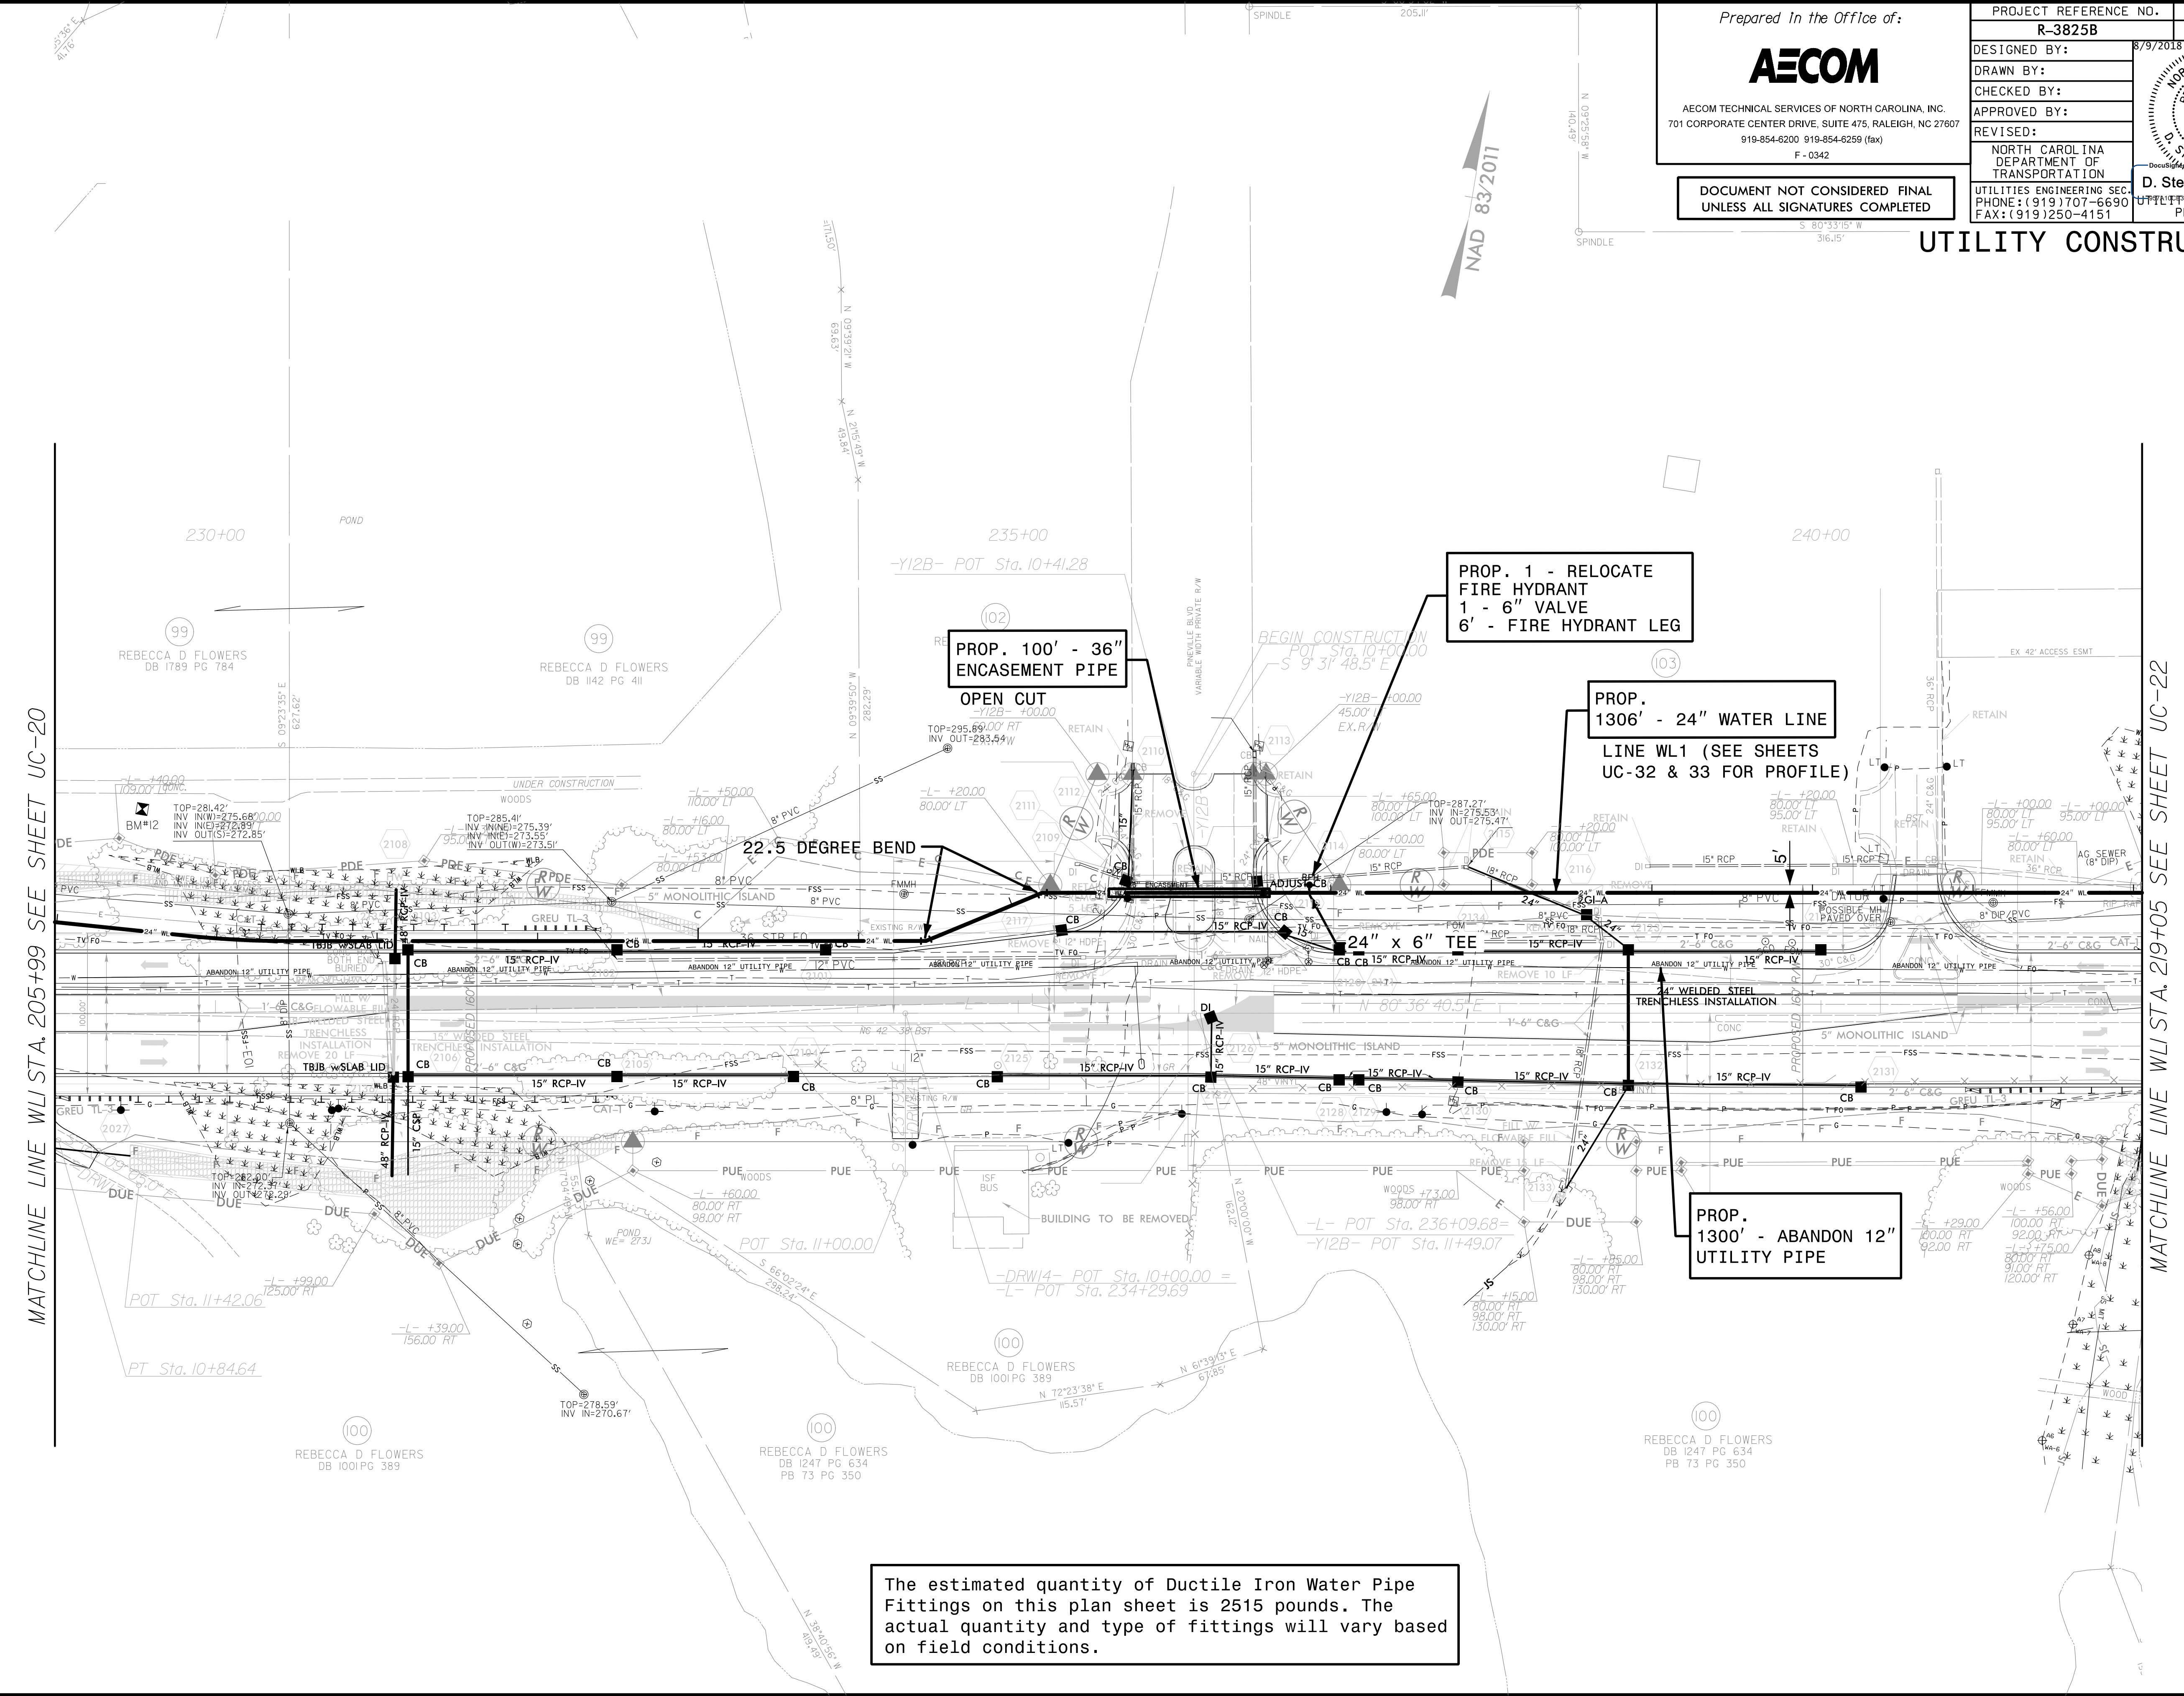

PROP. 100' - 36" ENCASEMENT PIPE
OPEN CUT

PROP. 1 - RELOCATE FIRE HYDRANT
1 - 6" VALVE
6' - FIRE HYDRANT LEG

PROP. 1306' - 24" WATER LINE
LINE WL1 (SEE SHEETS UC-32 & 33 FOR PROFILE)

PROP. 1300' - ABANDON 12" UTILITY PIPE

The estimated quantity of Ductile Iron Water Pipe Fittings on this plan sheet is 2515 pounds. The actual quantity and type of fittings will vary based on field conditions.

MATCHLINE LINE WL1 STA. 205+99 SEE SHEET UC-20

MATCHLINE LINE WL1 STA. 219+05 SEE SHEET UC-22

DATE: 8/9/2018
TIME: 3:46:08 PM
DGN: R3825B_UC_Plan.dgn