



02/03/98

PROJECT REFERENCE NO. U-5604	SHEET NO. E10
Documented By: Matt West 7/25/2018 NCPEA 1000066420	
DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED	

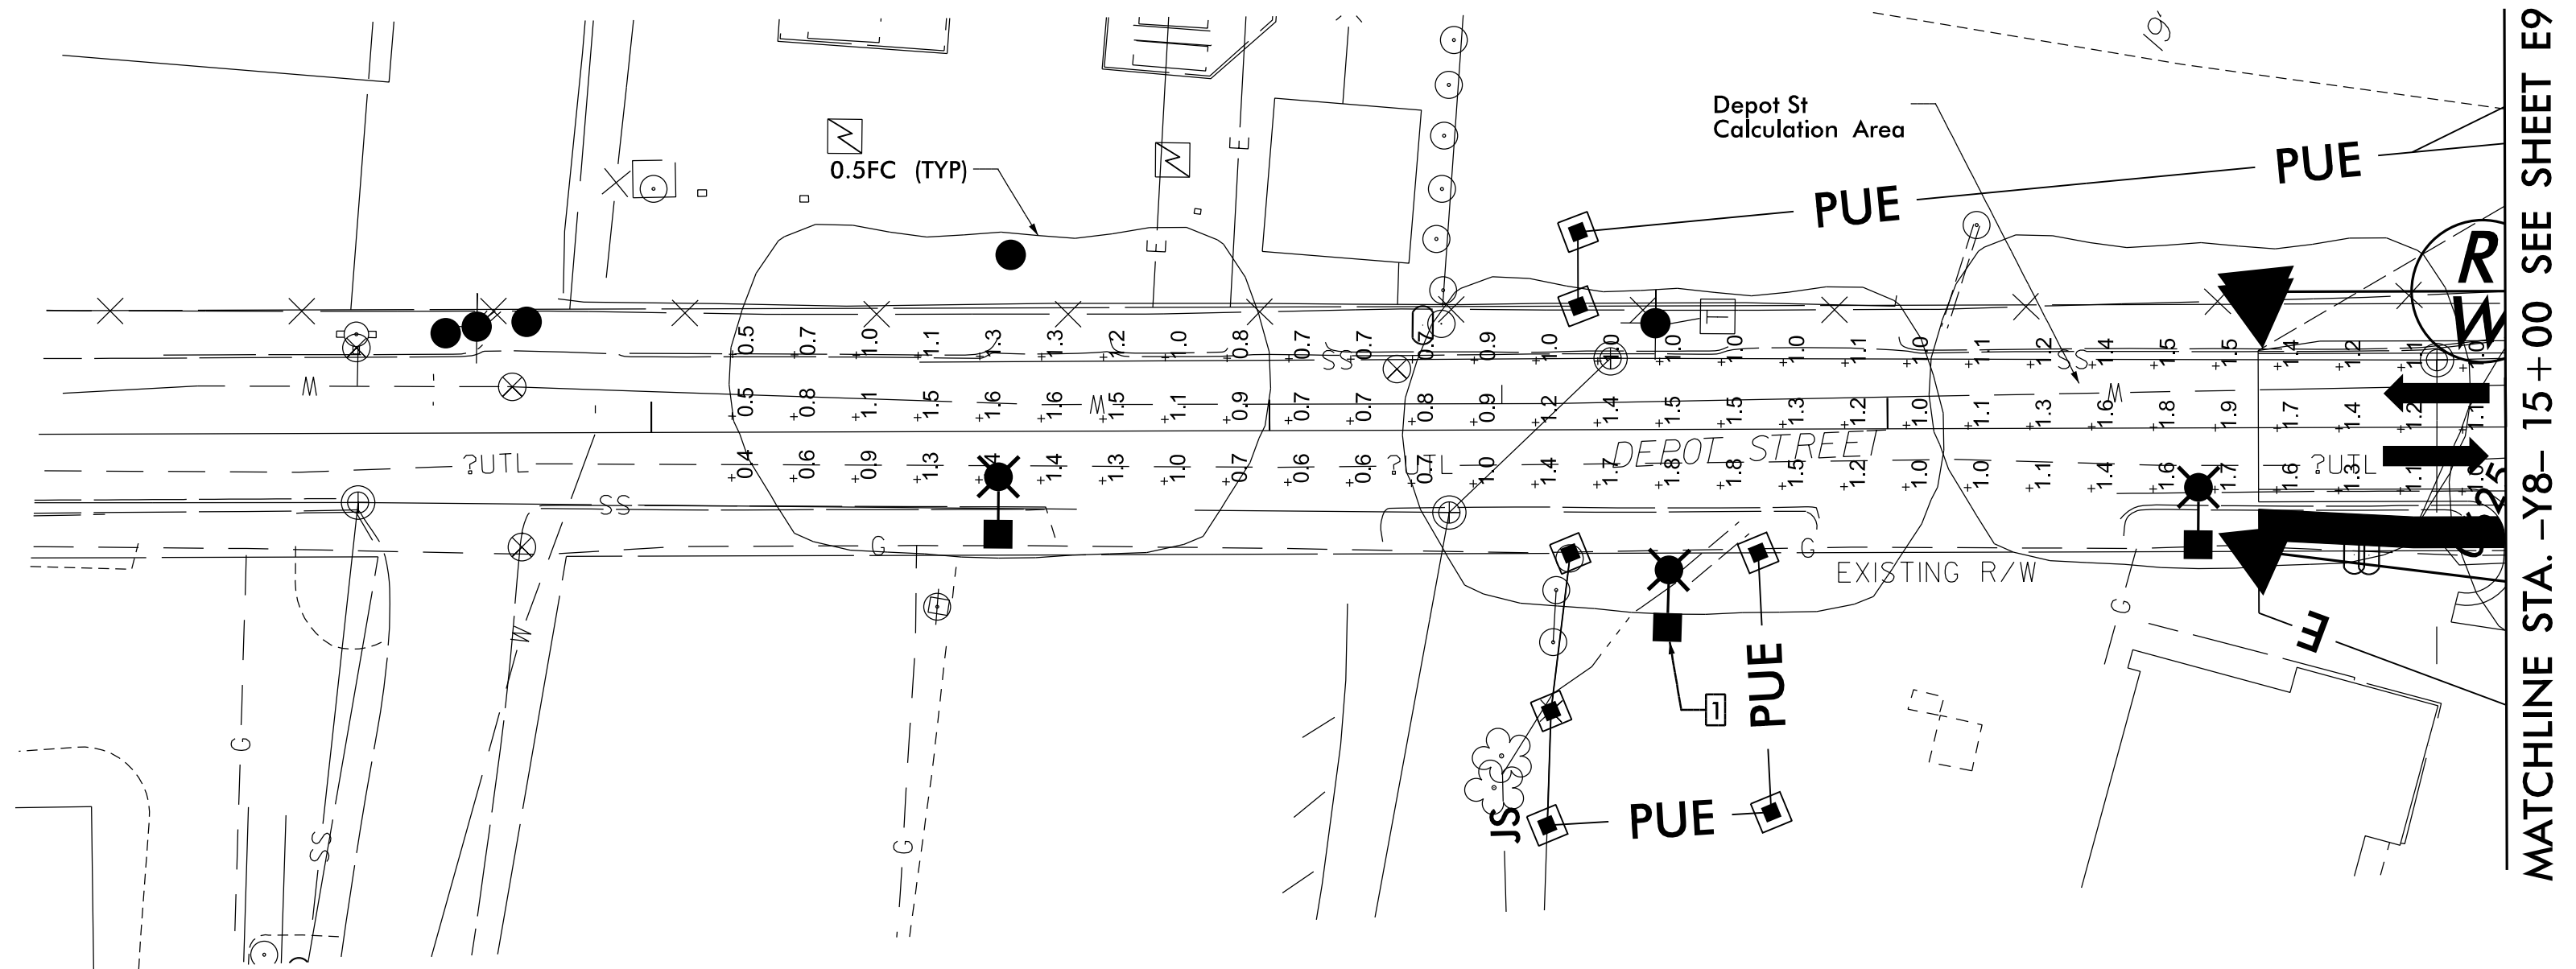

GENERAL NOTES:

- CONTRACTOR TO INSTALL CONDUITS UNDER ROADWAYS AS SHOWN IN PLANS FOR FUTURE USE BY DUKE ENERGY.
- DUKE ENERGY TO INSTALL ELECTRICAL SERVICE AND LIGHTING FIXTURES AT LOCATIONS SHOWN IN PLANS.
- DUKE ENERGY TO DESIGN AND INSTALL LIGHTING BRANCH CIRCUITS TO PROPOSED LIGHTS.

SHEET NOTES:

- LUMINAIRE TO BE INSTALLED ON REPLACEMENT UTILITY POLE. SEE SHEET UO-4 FOR MORE INFORMATION.

LEGEND:

- PROPOSED ROADWAY FIXTURE (SEE LUMINAIRE SUMMARY)
- EXISTING ROADWAY FIXTURE (SEE LUMINAIRE SUMMARY)
- PROPOSED ELECTRICAL SERVICE (BY OTHERS)
- PROPOSED ELECTRICAL JUNCTION BOXES
- PROPOSED (2") 2" CONDUITS FOR FUTURE USE

Photometric Calculation Summary Table

Label	Calculation Type	Units	Target Avg	Avg	Max	Min	Target Avg/Min	Avg/Min
Wayah St West of Depot	Illuminance	Fc	1.1	1.3	2.9	0.4	4.0	3.3
Depot St	Illuminance	Fc	1.1	1.3	3.1	0.4	4.0	3.2
Wayah St East of Depot	Illuminance	Fc	1.1	1.1	2.1	0.4	4.0	2.7
Depot Roundabout	Illuminance	Fc	2.2	2.4	3.9	1.0	3.0	2.4

Luminaire Summary

Quantity	Symbol	Description	Luminaire Lumens	Total Light Loss Factor	Luminaire Watts	Arrangement	Arm Length
21		Proposed 110W LED Duke Roadway Fixture Mounted at 30ft on a 12ft Arm and a Direct Bury (Type A) Pole (unless otherwise noted)	9337	0.85	108	SINGLE	12
2		Proposed 150W LED Duke Roadway Fixture Mounted at 30ft on a 12ft Arm and a Direct Bury (Type A) Pole (unless otherwise noted)	12641	0.85	146	SINGLE	12
11		Proposed 220W LED Duke Roadway Fixture Mounted at 20ft on a 12ft Arm and a Direct Bury (Type A) Pole (unless otherwise noted)	18641	0.85	216	SINGLE	12
21		Proposed 110W LED Duke Roadway Fixture Mounted at 30ft on a 6ft Arm and a Direct Bury (Type A) Pole (unless otherwise noted)	9337	0.85	108	SINGLE	6
3		Proposed 150W LED Duke Roadway Fixture Mounted at 30ft on a 20ft Arm and a Direct Bury (Type A) Pole (unless otherwise noted)	12641	0.85	146	SINGLE	20
6		Existing 150W HPS Flat Glass Duke Roadway Fixture	10721	0.69	193	SINGLE	6

2			
1			
Rev.	Date	Description	Approved
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION DESIGN SERVICES LIGHTING/ELECTRICAL SECTION			
Drawn By:	Approved By:	Dwg No.:	

\$\$\$SYTIME\$\$\$\$\$
 \$\$\$DOWN\$\$\$\$\$
 \$\$\$USE R/W\$\$\$\$\$