


PROJECT: 15B.13.12

CONTRACT NO: C202787

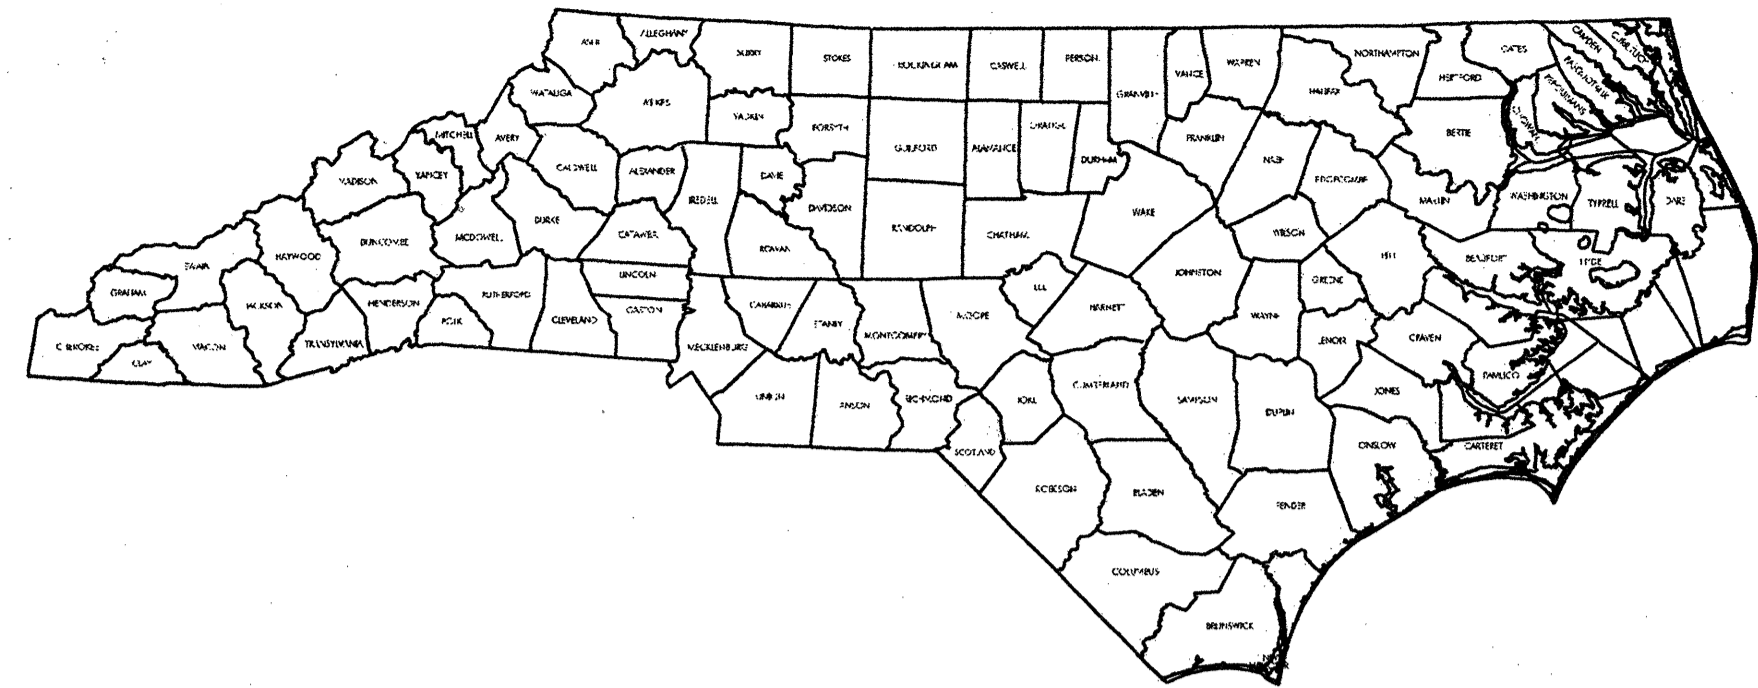




STATE OF NORTH CAROLINA
DIVISION OF HIGHWAYS

**NEW HANOVER
COUNTY**

LOCATION: BRIDGE #11 US 117 ACROSS NORTH
EAST CAPE FEAR RIVER, BRIDGE #13
US 17, 74, 76, 421 ACROSS CAPE FEAR RIVER

TYPE OF WORK: MECHANICAL AND ELECTRICAL
REPAIRS

STATE	STATE PROJECT REFERENCE NO.	SHEET NO.	TOTAL SHEETS
N.C.	15B.13.12	1	
STATE PROJECT NO.	F. A. PROJ. NO.	DESCRIPTION	
15B.13.10	N/A	PE	
15B.13.12	N/A	CONSTR	

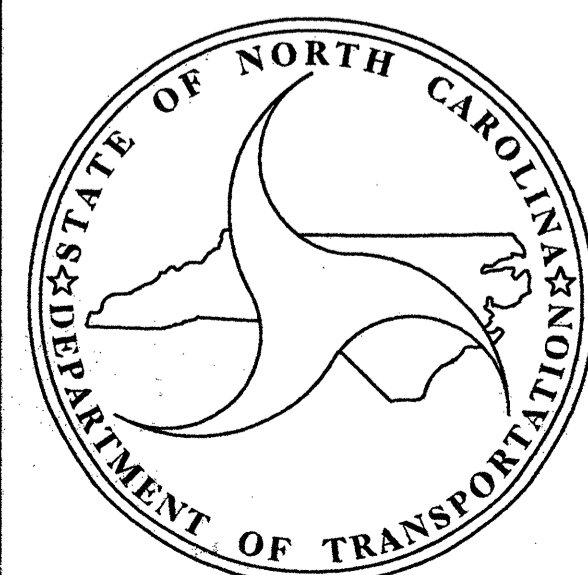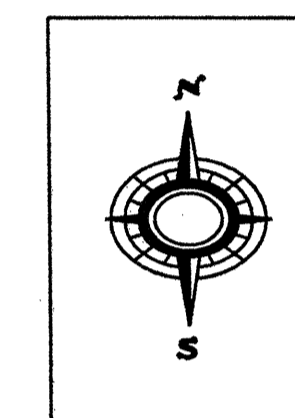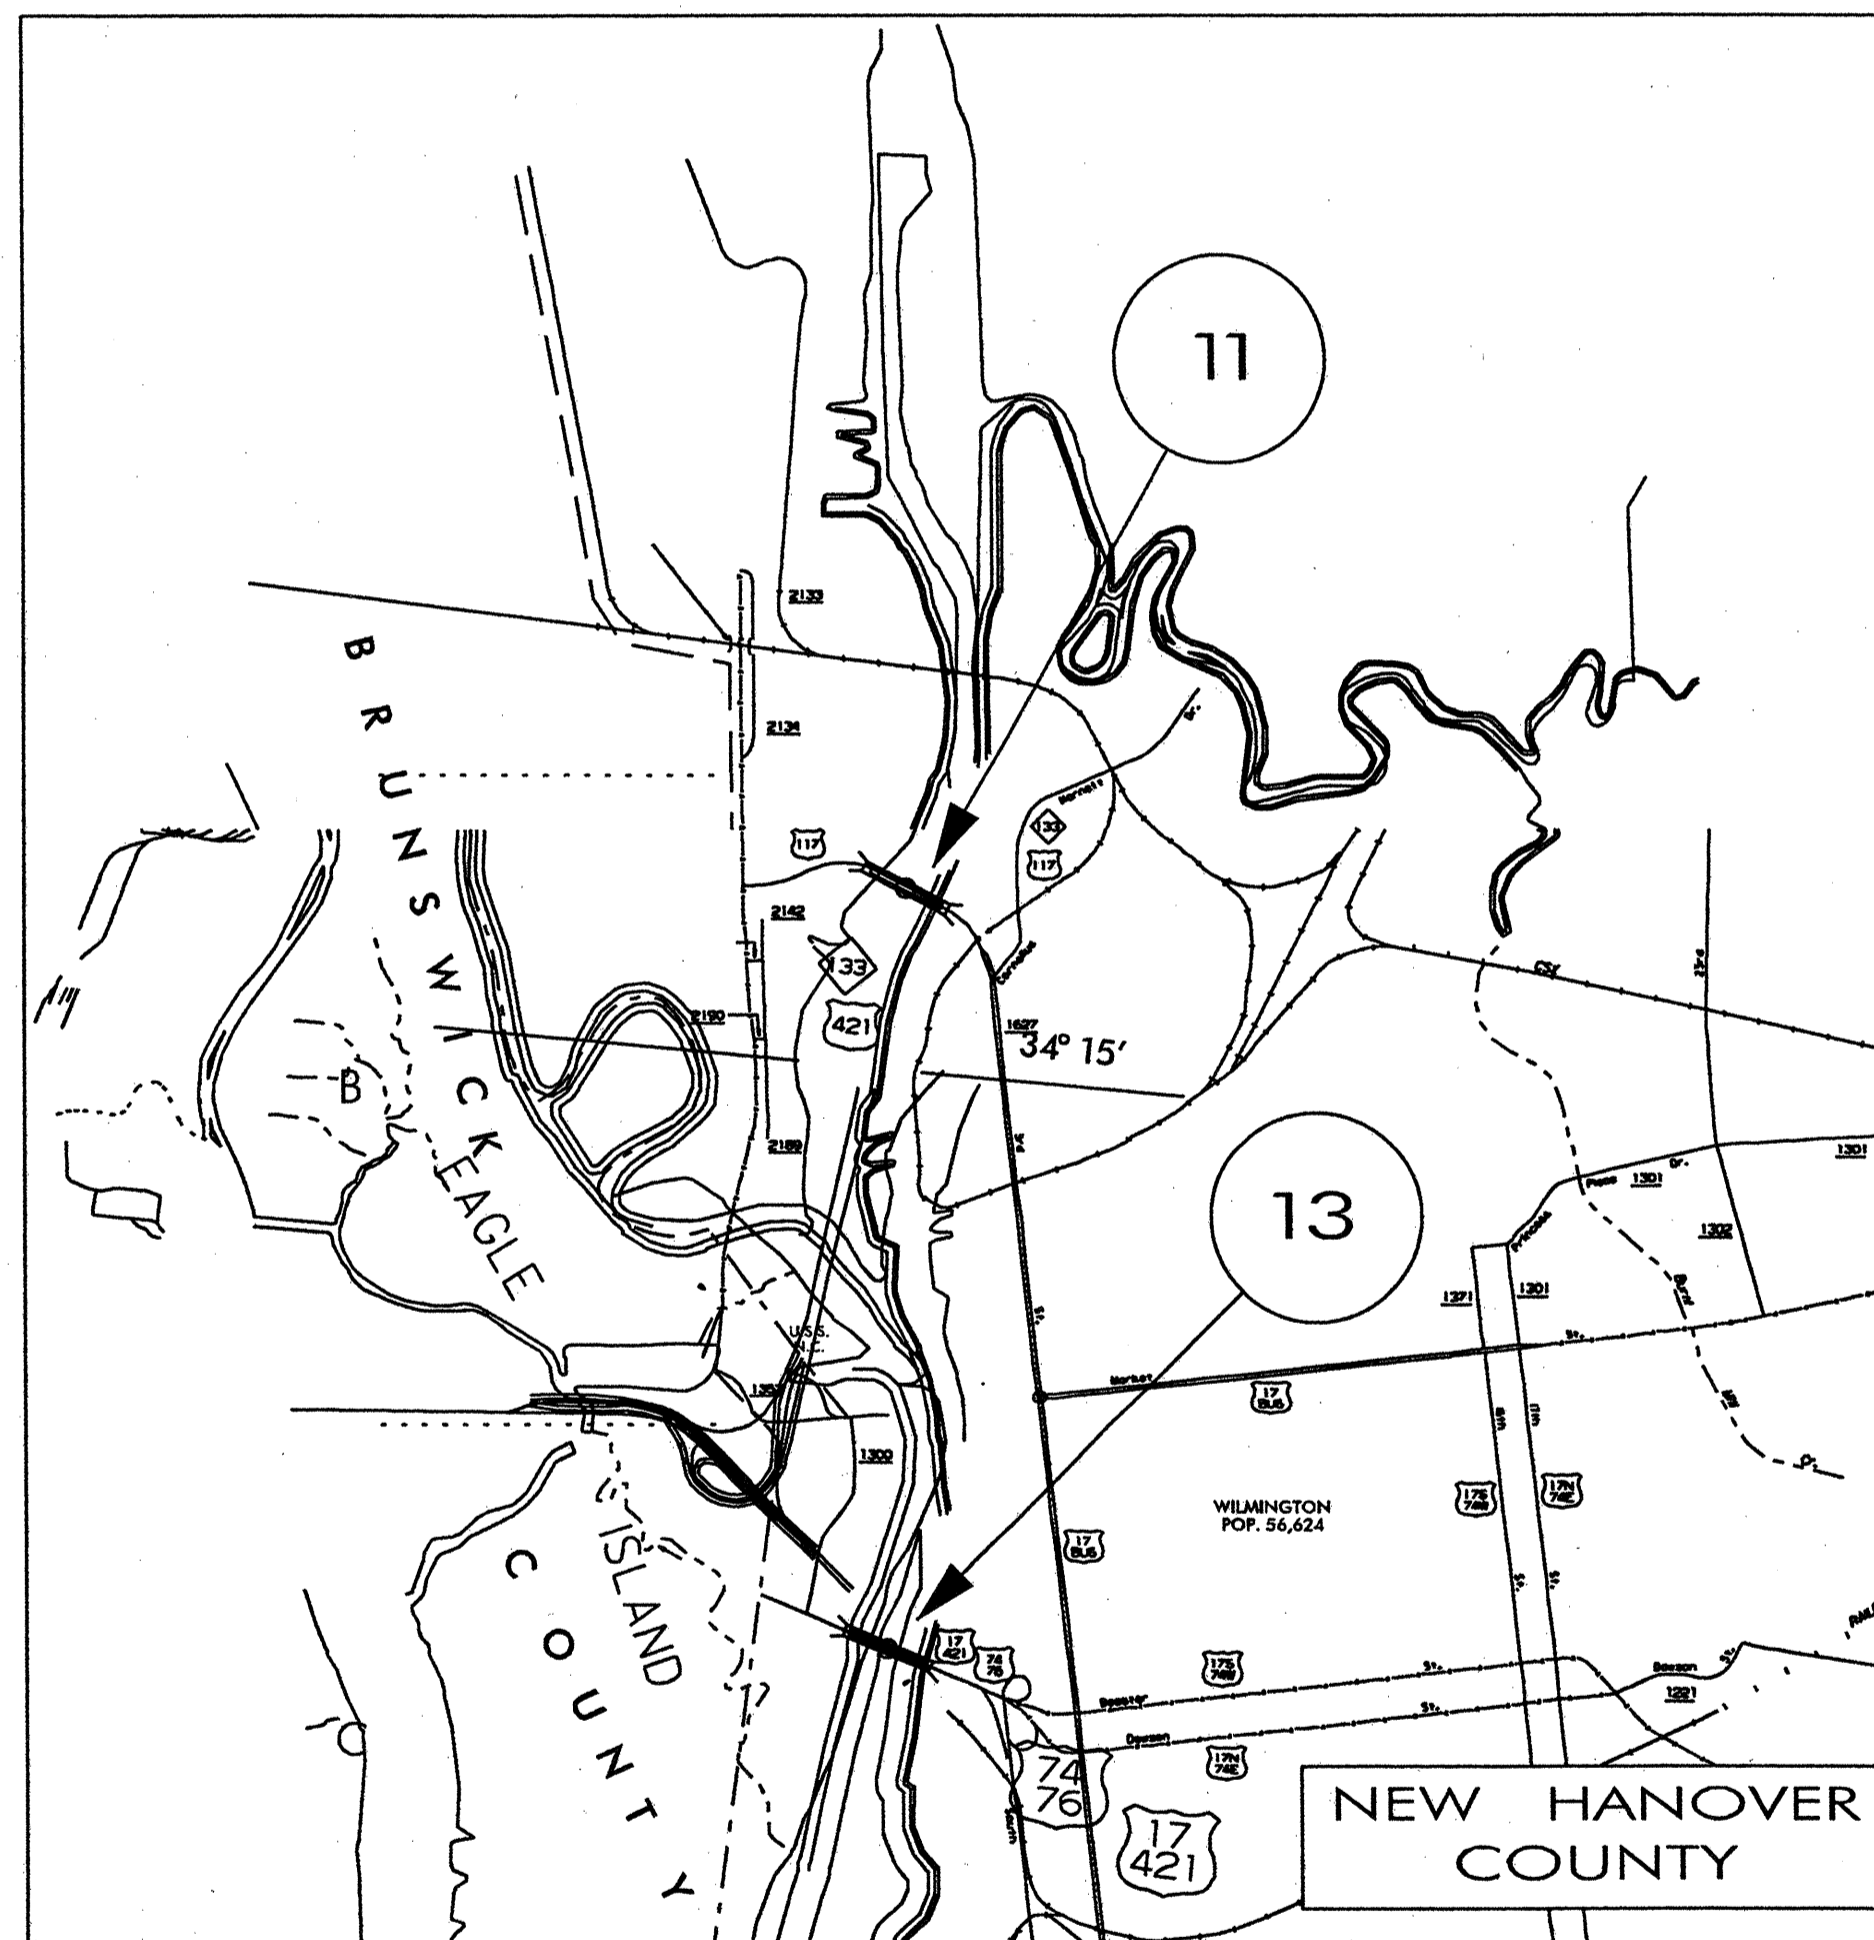

PROJECT LENGTH


Prepared in the Office of:
BRIDGE MANAGEMENT UNIT
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

2006 STANDARD SPECIFICATIONS

LETTING DATE:
JUNE 21, 2011

DAN HOLDERMAN, PE
STATE BRIDGE
MANAGEMENT ENGINEER

MIKE SUMMERS
BRIDGE MANAGEMENT
PROJECT MANAGER

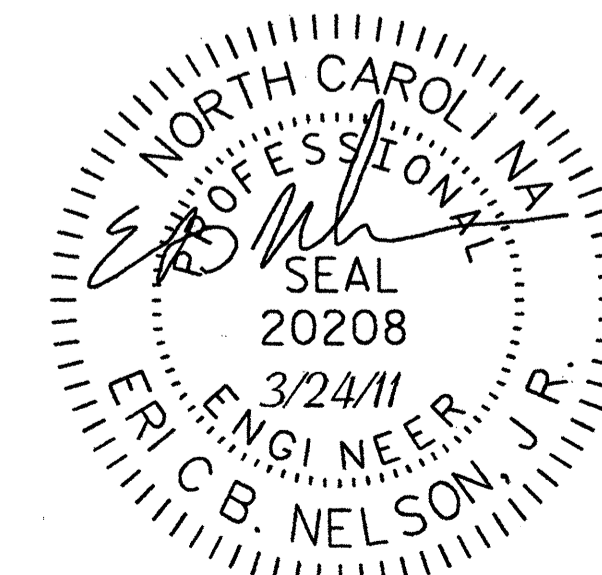

RICK NELSON, PE
DESIGN ENGINEER

STATE OF NORTH CAROLINA
DIVISION OF HIGHWAYS

SUMMARY OF QUANTITIES

STATE OF NORTH CAROLINA
DIVISION OF HIGHWAYS

ROADWAY SUMMARY OF QUANTITIES FOR CONTRACT - C202787

ItemNumber	Sec #	Quantity	Unit	Description
0000100000-N	800	Lump Sum		MOBILIZATION
4405000000-E	1110	2,006	SF	WORK ZONE SIGNS (PORTABLE)
4410000000-E	1110	84	SF	WORK ZONE SIGNS (BARRICADE MOUNTED)
4415000000-N	1115	5	EA	FLASHING ARROW PANELS, TYPE C
4420000000-N	1120	11	EA	CHANGEABLE MESSAGE SIGN
4430000000-N	1130	200	EA	DRUMS
4445000000-E	1145	176	LF	BARRICADES (TYPE III)
4480000000-N	1165	2	EA	TMIA
4510000000-N	SP	480	HR	LAW ENFORCEMENT
8860000000-N	SP	Lump Sum		GENERIC STRUCTURE ITEM MEMORIAL LIFT BRG MAIN & AUX- ILLARY COUNTERWEIGHT ROPE RE- PLACEMENT
8860000000-N	SP	Lump Sum		GENERIC STRUCTURE ITEM MEMORIAL LIFT BRIDGE LIVE LOAD BEARING REHABILITATION
8860000000-N	SP	Lump Sum		GENERIC STRUCTURE ITEM MISCELLANEOUS BASCULE BRIDGE ELECTRICAL WORK
8860000000-N	SP	Lump Sum		GENERIC STRUCTURE ITEM MISCELLANEOUS BASCULE BRIDGE MECHANICAL WORK
8889000000-E	SP	35,000	LB	GENERIC STRUCTURE ITEM ADDITIONAL BALANCE BARS (BASCULE SPAN)

5/28/99

SYSTEMS

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE

WILMINGTON, NORTH CAROLINA

MECHANICAL AND ELECTRICAL REPAIRS


MARCH 2011

INDEX OF SHEETS

SHEET NO.	SHEET NAME
1	TITLE SHEET
2	SUMMARY OF QUANTITIES
2A	INDEX OF SHEETS AND LIST OF DRAWINGS



LIST OF DRAWINGS

DRAWING NO.	SHEET NAME	DRAWING NO.	SHEET NAME	DRAWING NO.	SHEET NAME
1 (GPB)	GENERAL PLAN AND ELEVATION (BASCULE BRIDGE)	27 (EB1)	ELECTRICAL GENERAL NOTES BASCULE BRIDGE - 1	51 (GPBL)	GENERAL PLAN AND ELEVATION (MEMORIAL LIFT BRIDGE)
2 (MB1)	EXISTING MECHANICAL LAYOUT	28 (EB2)	ELECTRICAL GENERAL NOTES BASCULE BRIDGE - 2	52 (ML1)	LIVE LOAD BEARING REHABILITATION - 1
3 (MB2)	EXISTING CENTER LOCK REMOVAL	29 (EB3)	ELECTRICAL PLANS AND DETAILS - 1	53 (ML2)	LIVE LOAD BEARING REHABILITATION - 2
4 (MB3)	NEW CENTER LOCK - LAYOUT	30 (EB4)	ELECTRICAL PLANS AND DETAILS - 2	54 (ML3)	LIVE LOAD BEARING REHABILITATION - 3
5 (MB4)	NEW CENTER LOCK - COMPONENTS	31 (EB5)	ELECTRICAL PLANS AND DETAILS - 3	55 (ML4)	NEW MAIN AND AUXILIARY COUNTERWEIGHT ROPES
6 (MB5)	NEW CENTER LOCK - GUIDE AND RECEIVER DETAILS	32 (EB6)	ELECTRICAL PLANS AND DETAILS - 4	56 (ML5)	ROPE ATTACHMENTS AT MAIN COUNTERWEIGHT
7 (MB6)	NEW CENTER LOCK - SUPPORT DETAILS	33 (EB7)	ELECTRICAL PLANS AND DETAILS - 5	57 (ML6)	ROPE ATTACHMENTS AT SPAN LIFTING GIRDER
8 (MB7)	TEMPORARY CENTER LOCK	34 (EB8)	ELECTRICAL PLANS AND DETAILS - 6	58 (ML7)	JACKING OF LIFT SPAN
9 (MB8)	EXISTING LIVE LOAD SPAN LOCK REMOVAL	35 (EB9)	ELECTRICAL PLANS AND DETAILS - 7	59 (ML8)	ROPE ATTACHMENTS FOR AUXILIARY COUNTERWEIGHT
10 (MB9)	NEW LIVE LOAD SPAN LOCK - LAYOUT	36 (EB10)	ELECTRICAL SCHEMATICS - 1	60 (ML9)	AUXILIARY COUNTERWEIGHT ASSEMBLY
11 (MB10)	NEW LIVE LOAD SPAN LOCK - DETAILS 1	37 (EB11)	ELECTRICAL SCHEMATICS - 2	61 (ML10)	REFERENCE DRAWING - SHEAVES AND SHAFTS
12 (MB11)	NEW LIVE LOAD SPAN LOCK - DETAILS 2	38 (EB12)	ELECTRICAL SCHEMATICS - 3	62 (ML11)	REFERENCE DRAWING - ROPE CONNECTIONS
13 (MB12)	NEW LIVE LOAD SPAN LOCK - DETAILS 3	39 (EB13)	ELECTRICAL SCHEMATICS - 4	63 (ML12)	REFERENCE DRAWING - AUXILIARY COUNTERWEIGHT
14 (MB13)	NEW LIVE LOAD SPAN LOCK - DETAILS 4	40 (EB14)	ELECTRICAL SCHEMATICS - 5	64 (TCP-1)	TRAFFIC CONTROL PLAN - 1
15 (MB14)	NEW LIVE LOAD SPAN LOCK - DETAILS 5	41 (EB15)	ELECTRICAL SCHEMATICS - 6	65 (TCP-2)	TRAFFIC CONTROL PLAN - 2
16 (MB15)	NEW AUXILIARY DRIVE - LAYOUT	42 (EB16)	ELECTRICAL SCHEMATICS - 7	66 (TCP-3)	TRAFFIC CONTROL PLAN - 3
17 (MB16)	NEW AUXILIARY DRIVE - DETAILS	43 (EB17)	ELECTRICAL SCHEMATICS - 8	67 (TCP-4)	TRAFFIC CONTROL PLAN - 4
18 (MB17)	NEW AUXILIARY DRIVE - SHIFTER COUPLING	44 (EB18)	NEW AUXILIARY DRIVE CONTROLS	68 (TCP-5)	TRAFFIC CONTROL PLAN - 5
19 (MB18)	NEW AUXILIARY DRIVE - SUPPORTS	45 (EB19)	CONDUIT LAYOUT - 1	69 (TCP-6)	TRAFFIC CONTROL PLAN - 6
20 (MB19)	NEW OPEN GEARING COVER - DETAILS	46 (EB20)	CONDUIT LAYOUT - 2	70 (TCP-7)	TRAFFIC CONTROL PLAN - 7
21 (MB20)	EXISTING AIR BUFFER	47 (EB21)	CONDUIT AND WIRING TABULATION - 1	71 (TCP-8)	TRAFFIC CONTROL PLAN - 8
22 (MB21)	AIR BUFFER REHABILITATION	48 (EB22)	CONDUIT AND WIRING TABULATION - 2	72 (TCP-8A)	TRAFFIC CONTROL PLAN - 8A
23 (MB22)	OPEN GEARING FRAME ANCHOR BOLT REPLACEMENT - 1	49 (EB23)	TERMINAL CABINETS AND JUNCTION BOXES	73 (TCP-9)	TRAFFIC CONTROL PLAN - 9
24 (MB23)	OPEN GEARING FRAME ANCHOR BOLT REPLACEMENT - 2	50 (EB24)	ELECTRICAL EQUIPMENT SCHEDULE	74 (TCP-9A)	TRAFFIC CONTROL PLAN - 9A
25 (MB24)	OPEN GEARING FRAME ANCHOR BOLT REPLACEMENT - 3			75 (TCP-10)	TRAFFIC CONTROL PLAN - 10
26 (MB25)	SPAN DRIVE BRAKE REPLACEMENT				TRAFFIC CONTROL PLAN - 11

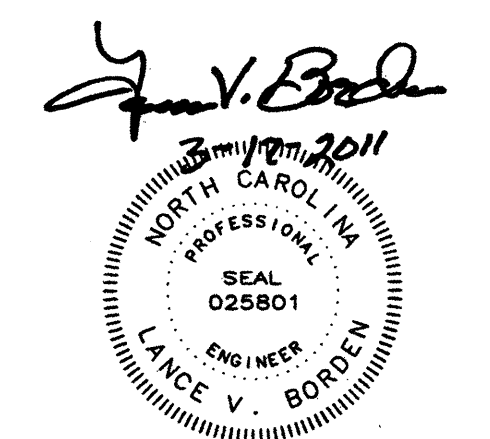


SCOPE OF MECHANICAL WORK

1. REPLACEMENT OF ALL EXISTING CENTER LOCK COMPONENTS WITH NEW AND INSTALLATION OF TEMPORARY LOCKS.
2. REPLACEMENT OF EXISTING LIVE LOAD SPAN LOCK COMPONENTS AS SHOWN ON PLANS WITH NEW.
3. REPLACEMENT OF EXISTING AUXILIARY DRIVE COMPONENTS WITH NEW.
4. REPLACEMENT OF EXISTING OPEN GEARING COVERS WITH NEW.
5. REPLACEMENT OF EXISTING AIR BUFFER BUSHINGS, FILTERS, GAGES, PIPING, AND FITTINGS.
6. REHABILITATION OF OPEN GEARING FRAME ANCHOR BOLTS.
7. MAINTAINING OF SPAN BALANCE WITHIN SPECIFIED BALANCE RANGE DURING CONSTRUCTION.
8. REPLACEMENT OF EXISTING SPAN DRIVE BRAKES AND WITH NEW.

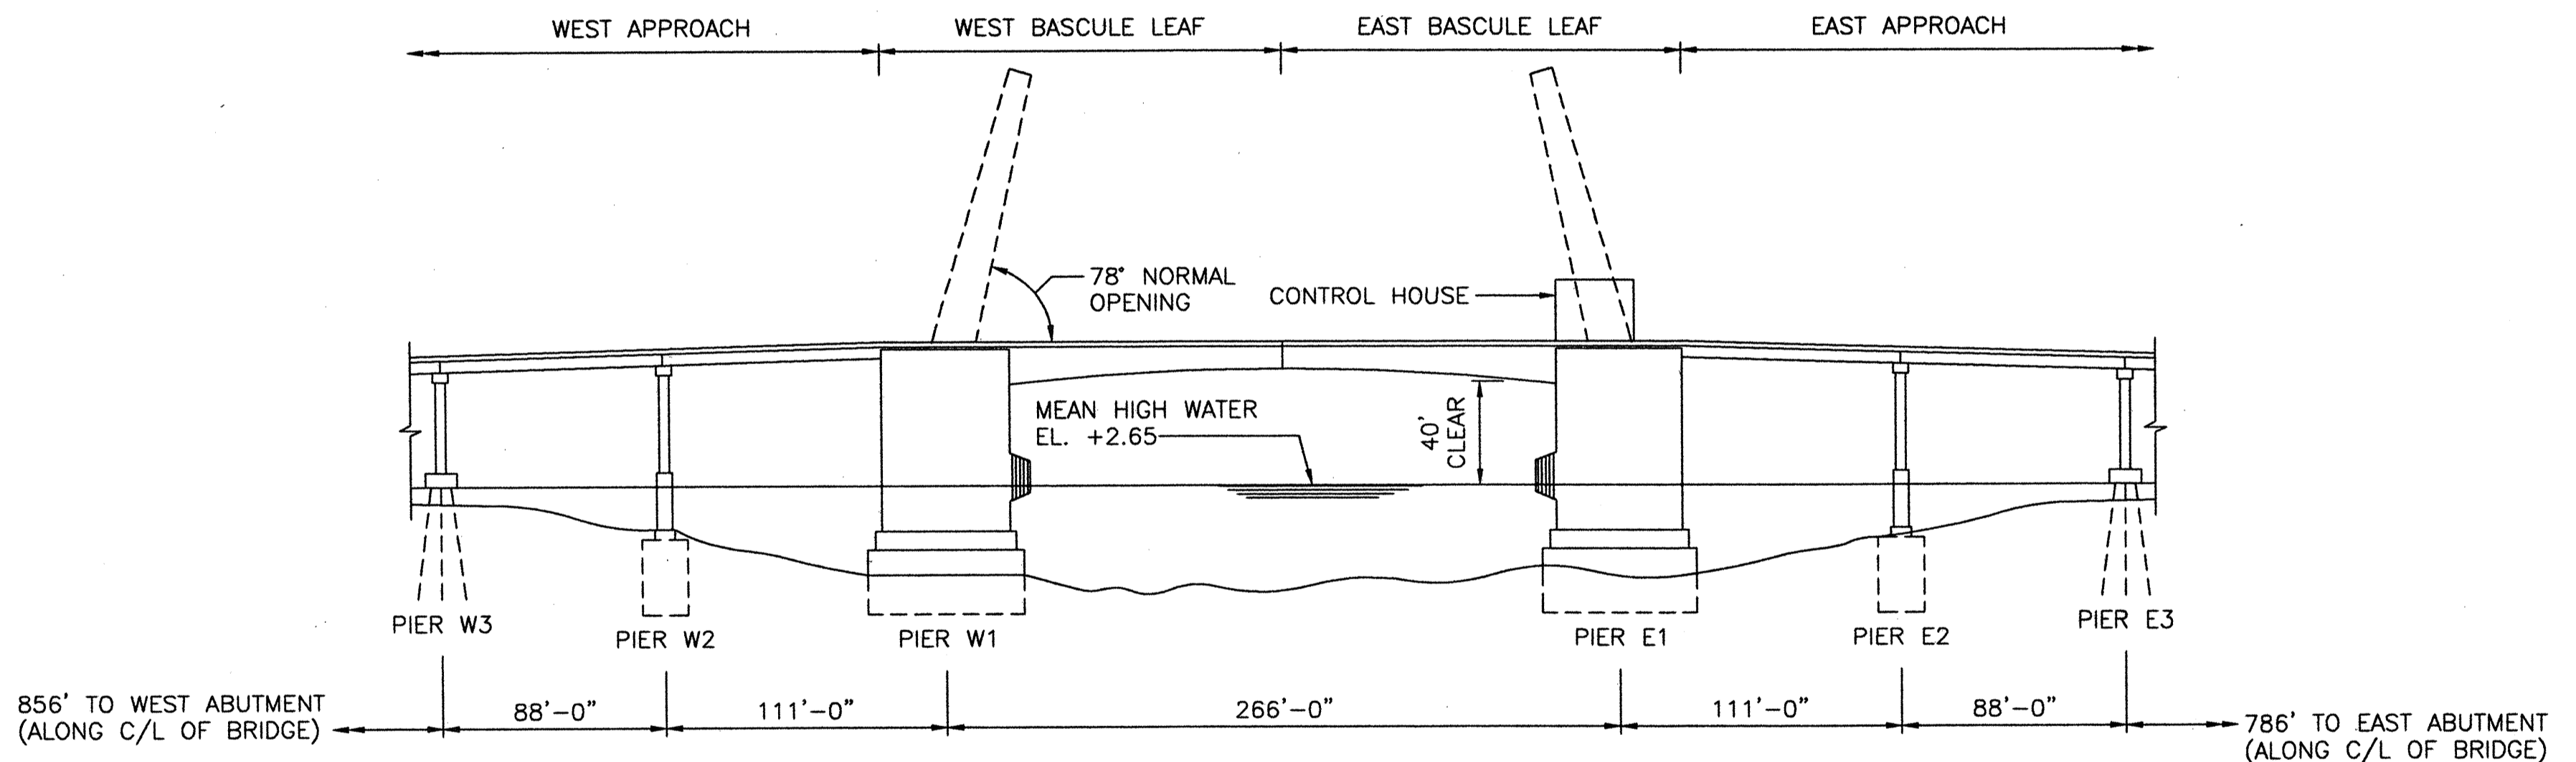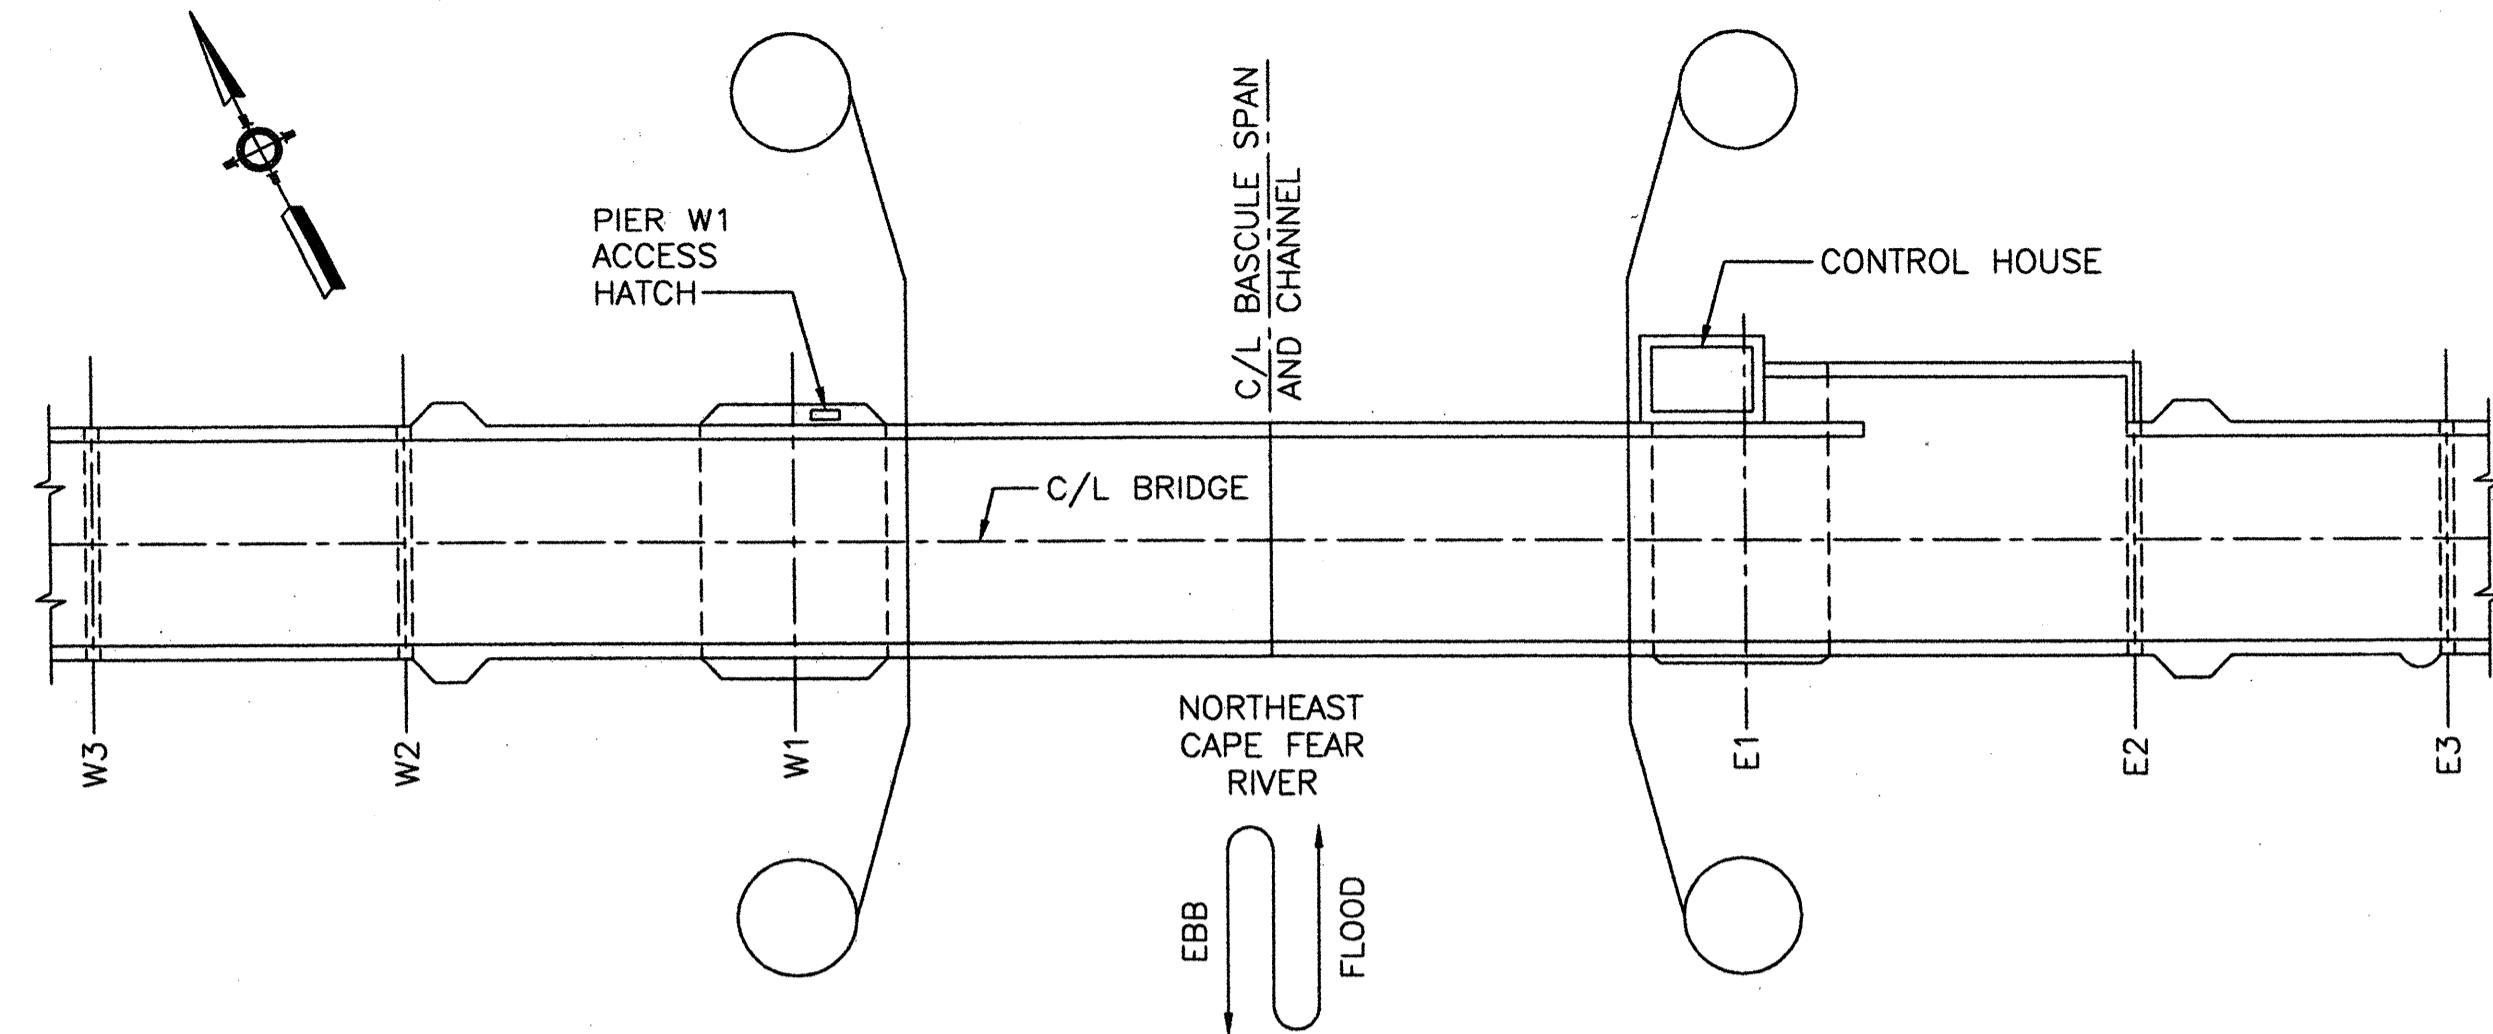


WARNING
THE PAINT SYSTEM OF THE EXISTING BRIDGE STRUCTURE MAY CONTAIN LEAD AND/OR OTHER HEAVY METALS. ANY CONTAINMENT, ABATEMENT, AND/OR OTHER MEASURES NECESSITATED BY THE CONTRACTOR'S ACTIVITIES SHALL BE THE FULL RESPONSIBILITY OF THE CONTRACTOR.


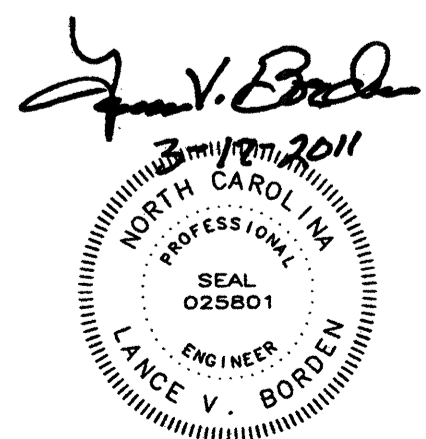


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
GENERAL PLAN AND ELEVATION
(BASCULE BRIDGE)



DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	D.M. BARRETT	DRAWING NO.	1 OF 63
DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	

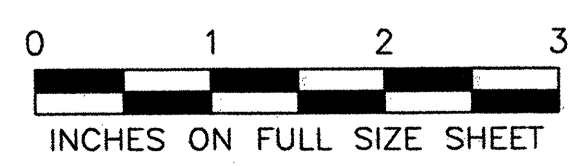

1-GPEB-GPEB.DWG

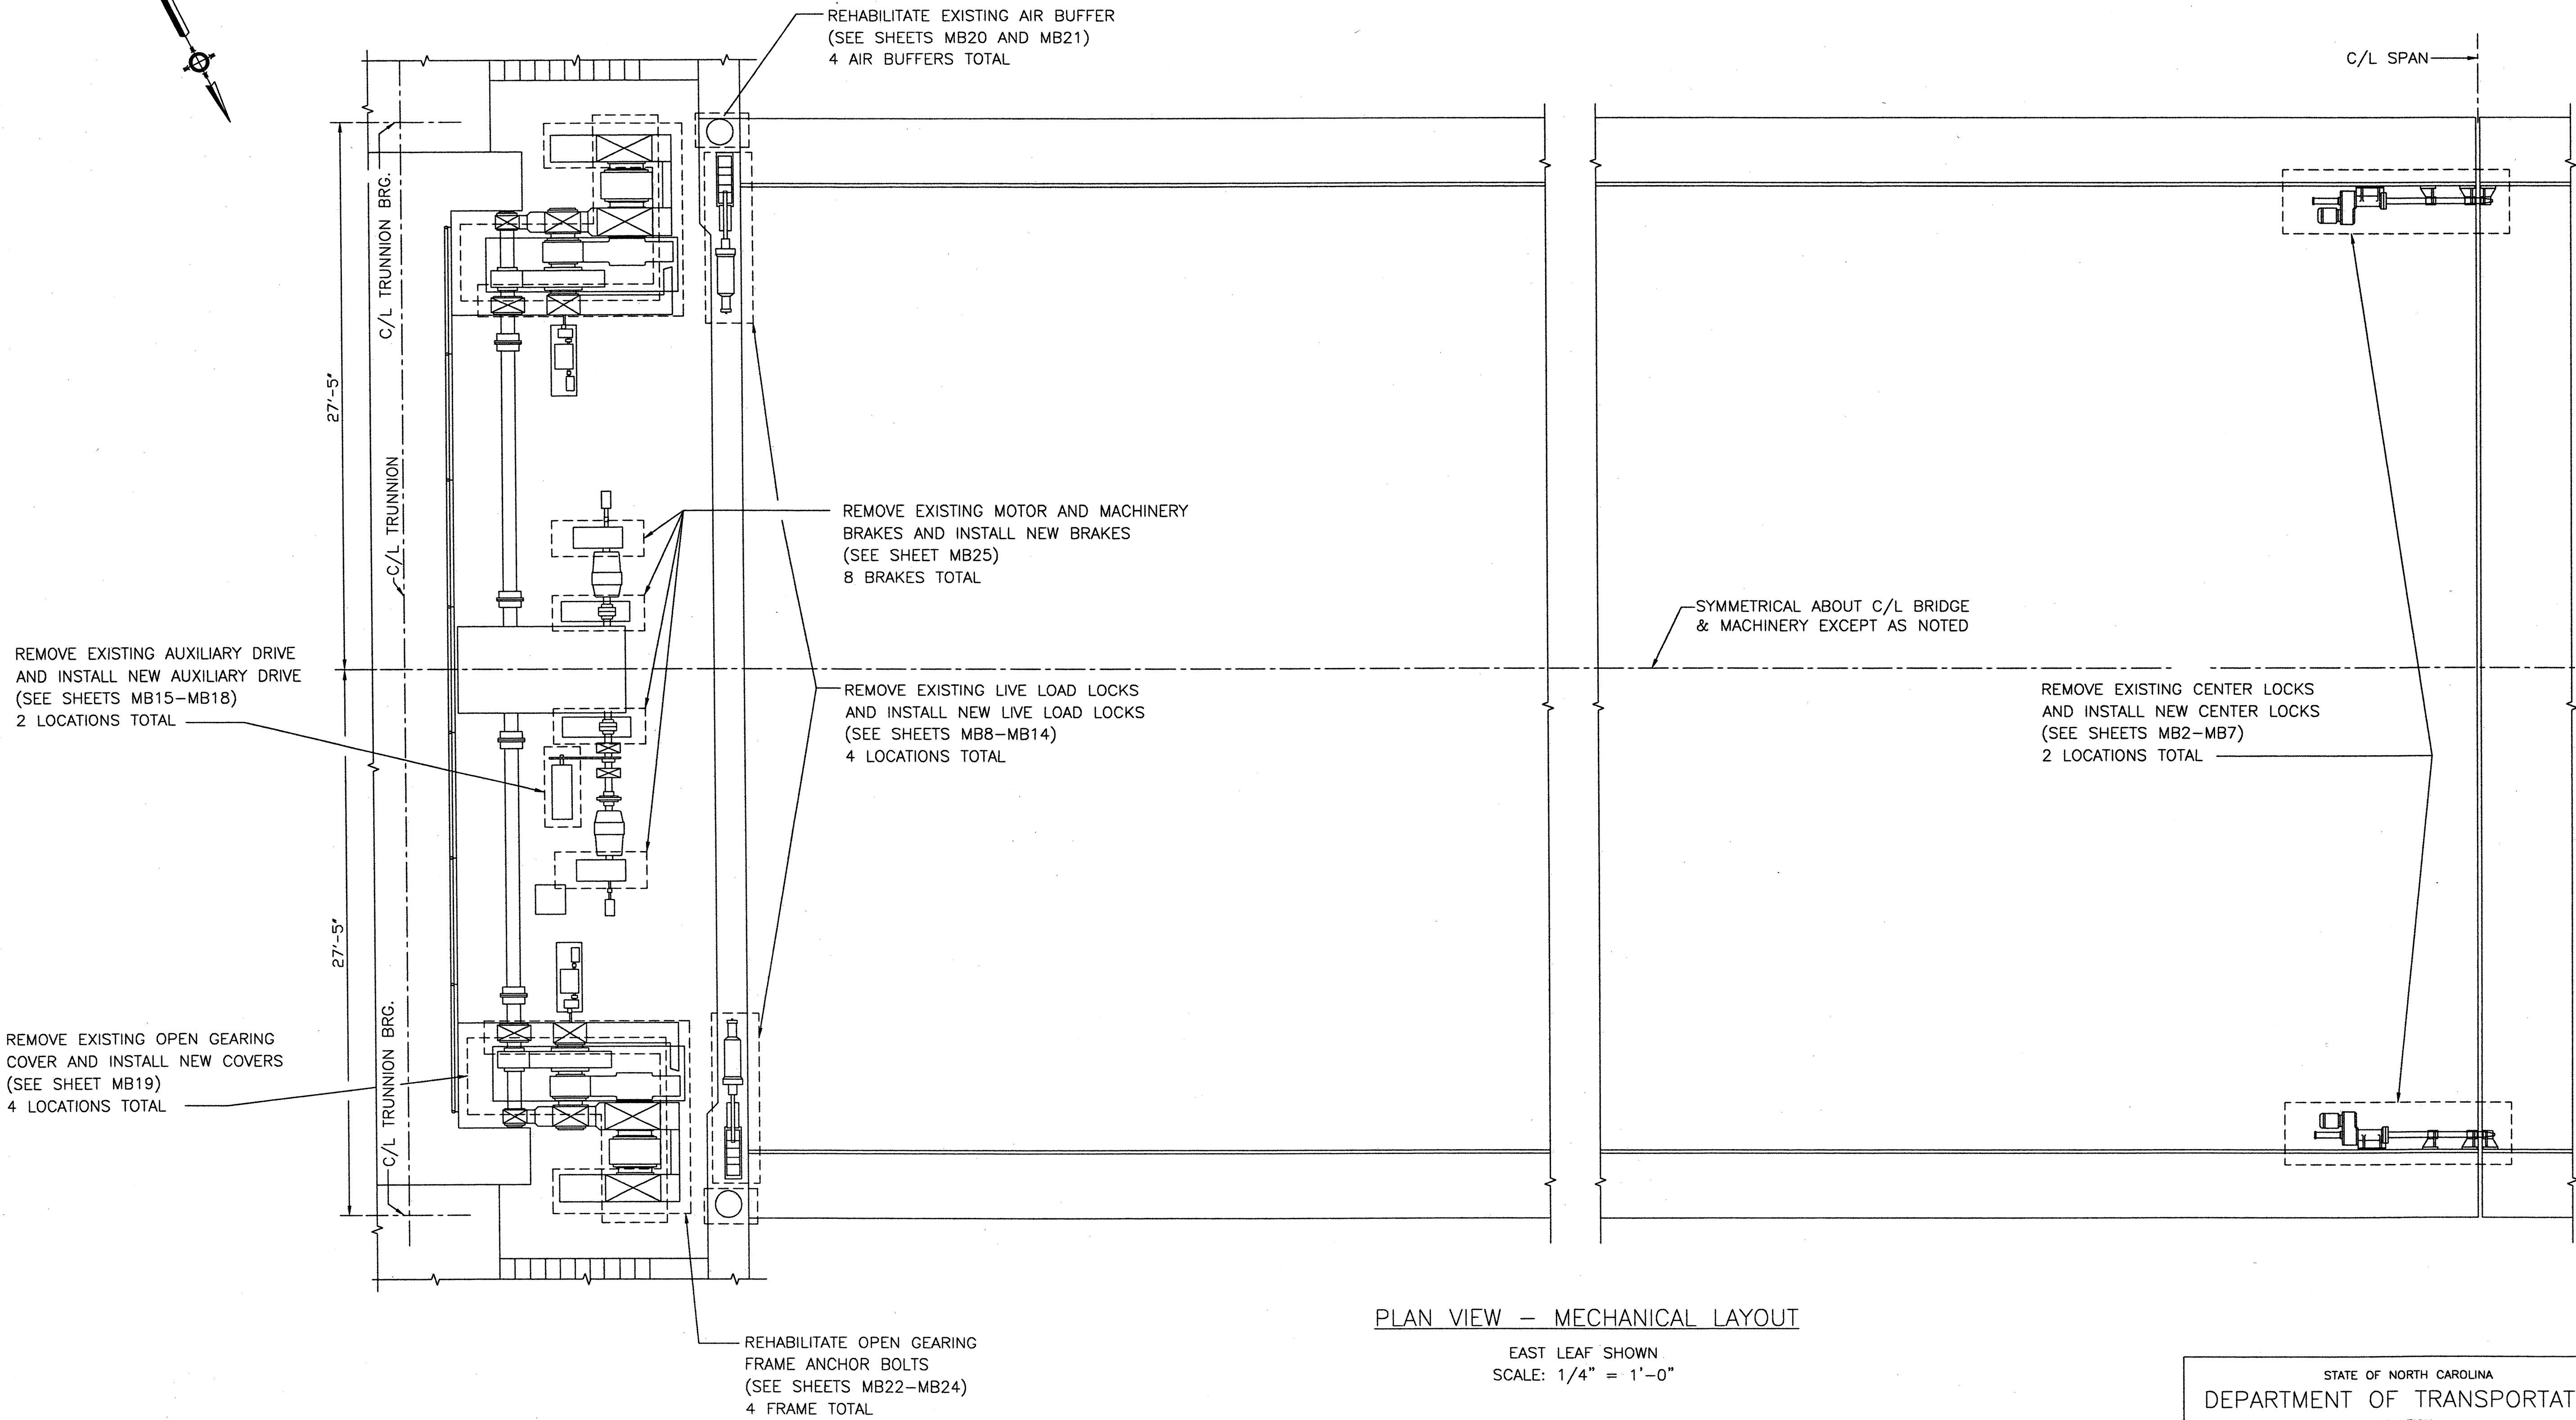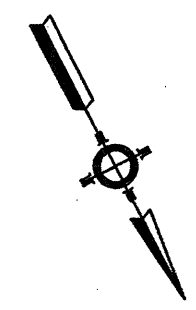


PLAN VIEW - MECHANICAL LAYOUT
EAST LEAF SHOWN
SCALE: 1/4" = 1'-0"

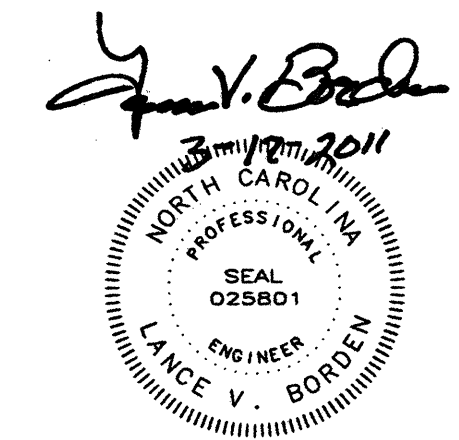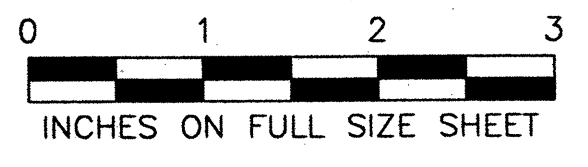

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
EXISTING MECHANICAL LAYOUT			
DESIGNED D.M. BARRETT		DRAWN BY E. A. RICKENBACH	
CHECKED J.W. NEWMAN		SCALE AS NOTED	
DETAILED D.M. BARRETT		DATE MARCH 2011	
CHECKED J.W. NEWMAN		DRAWING NO. 2 OF 63	



2-MB1-ENCL.DWG

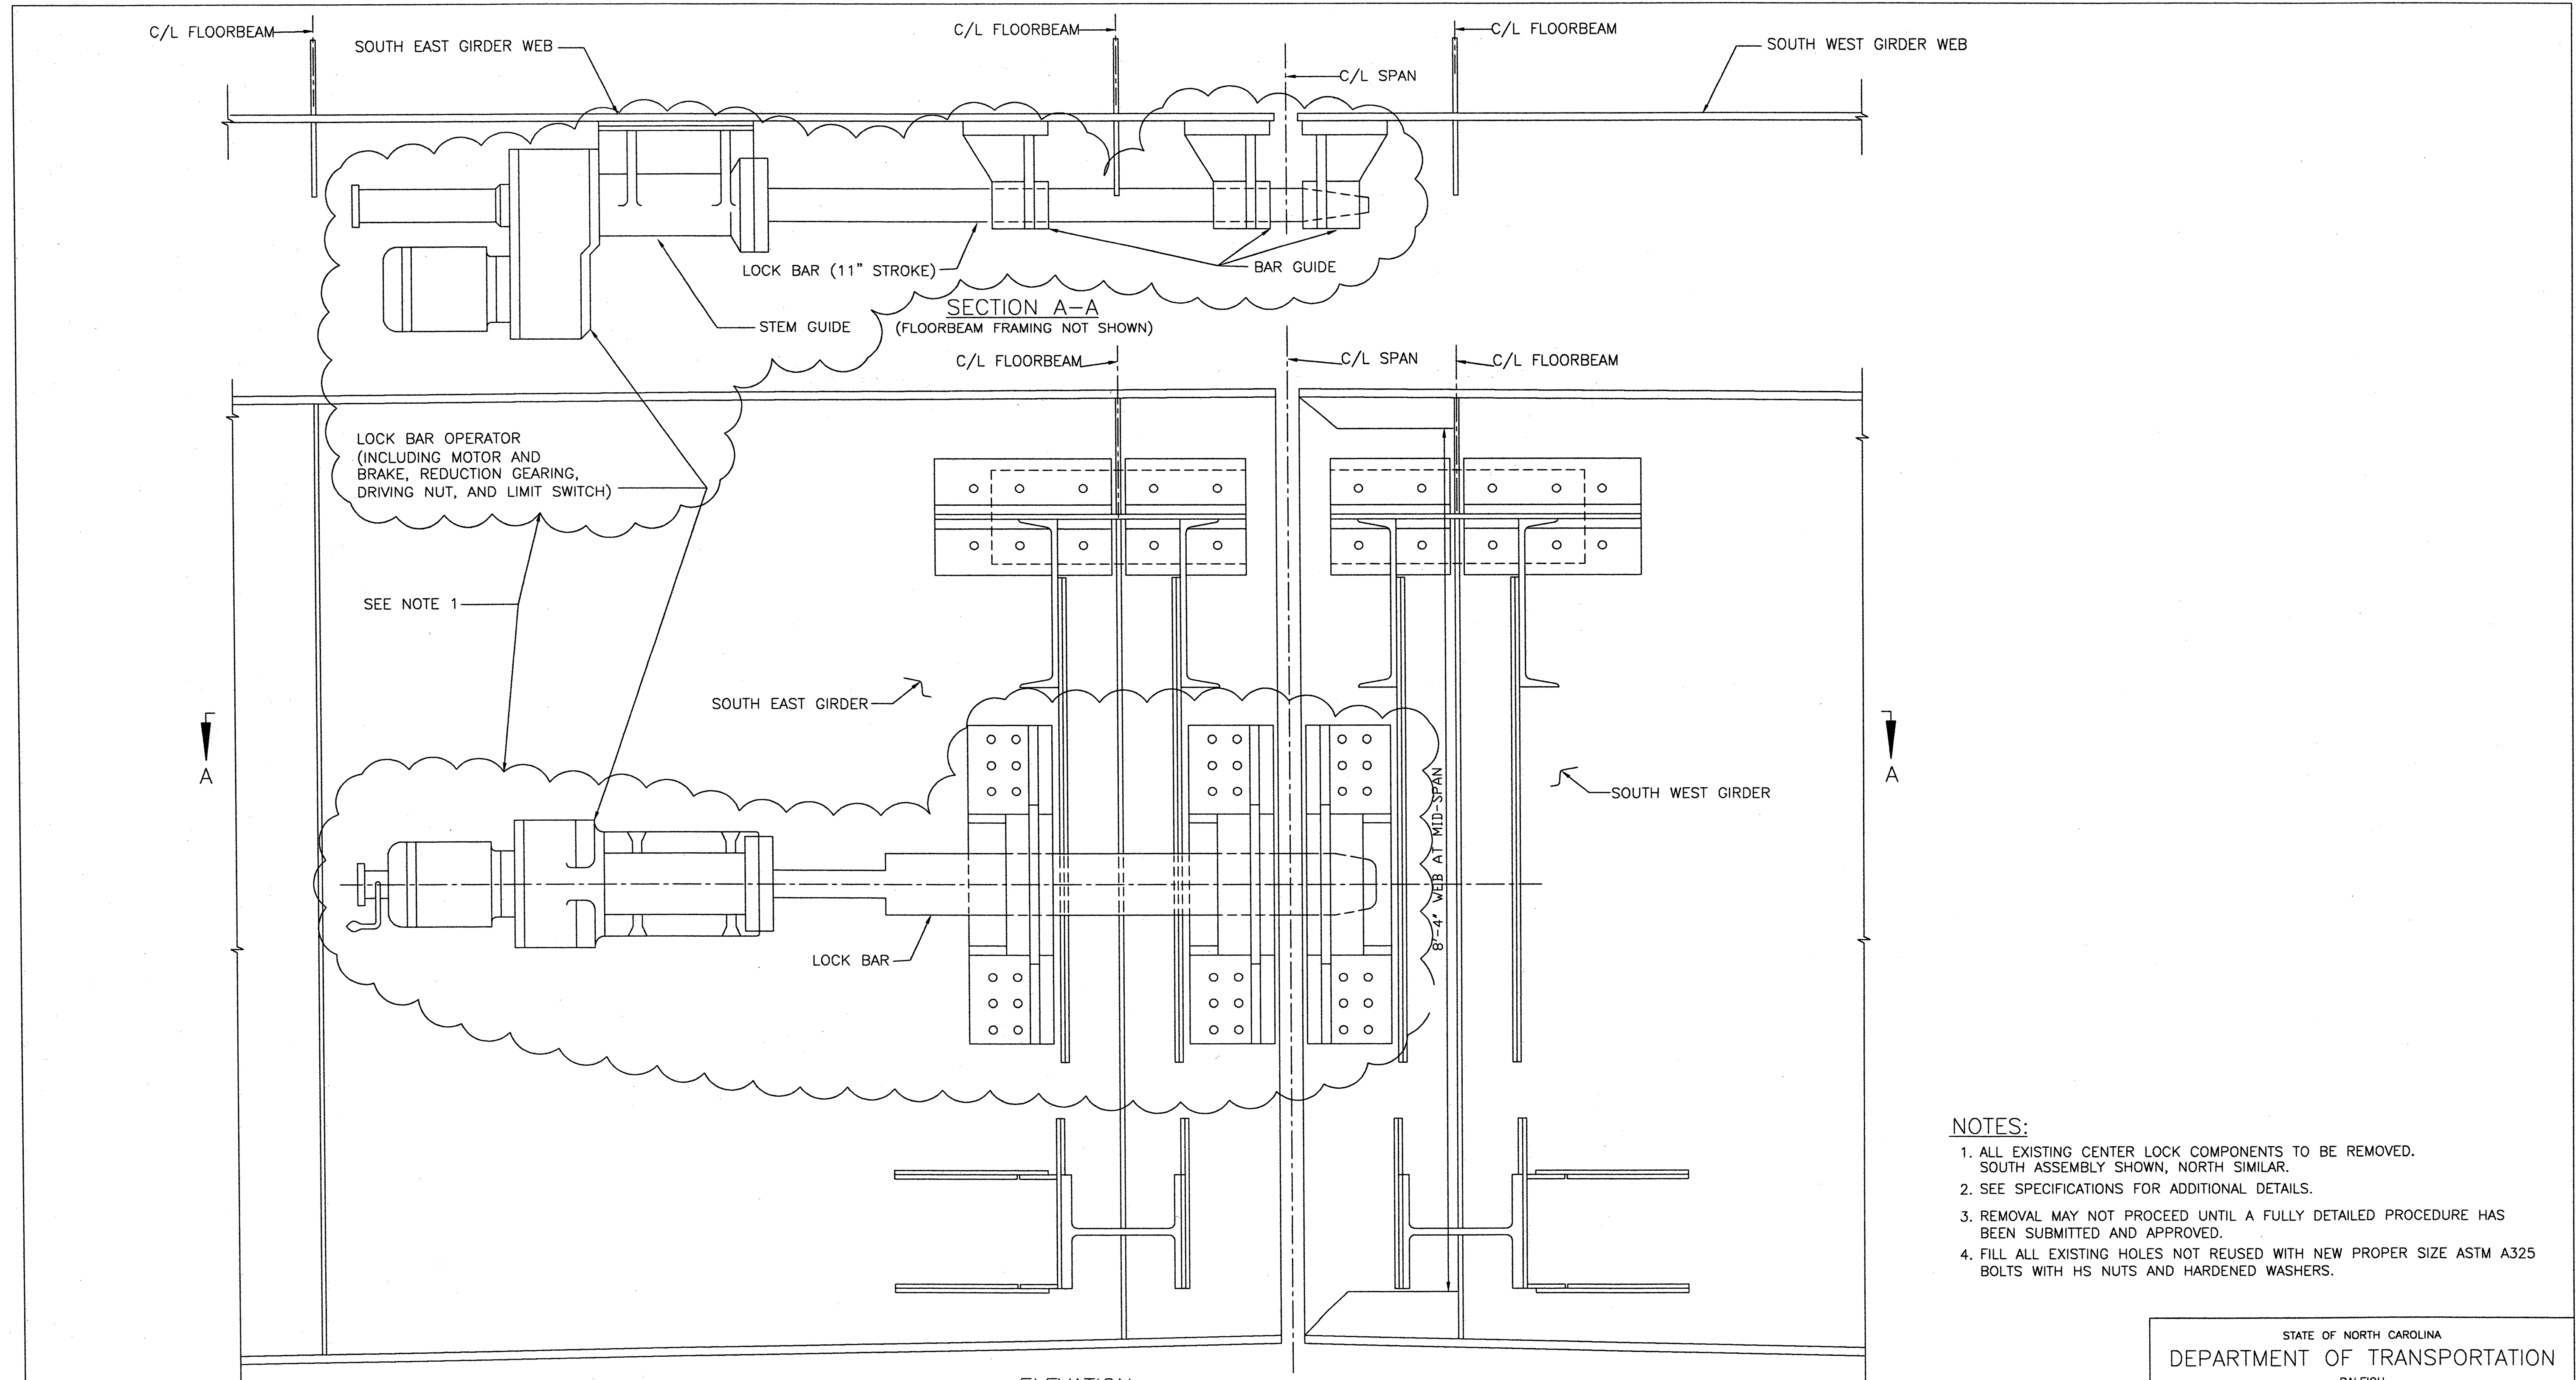

ELEVATION
 EXISTING CENTER LOCK ASSEMBLY
 (FLOORBEAM FRAMING NOT SHOWN)
 SCALE: 1 1/2" = 1'-0"


NOTES:

1. ALL EXISTING CENTER LOCK COMPONENTS TO BE REMOVED. SOUTH ASSEMBLY SHOWN, NORTH SIMILAR.
2. SEE SPECIFICATIONS FOR ADDITIONAL DETAILS.
3. REMOVAL MAY NOT PROCEED UNTIL A FULLY DETAILED PROCEDURE HAS BEEN SUBMITTED AND APPROVED.
4. FILL ALL EXISTING HOLES NOT REUSED WITH NEW PROPER SIZE ASTM A325 BOLTS WITH HS NUTS AND HARDENED WASHERS.

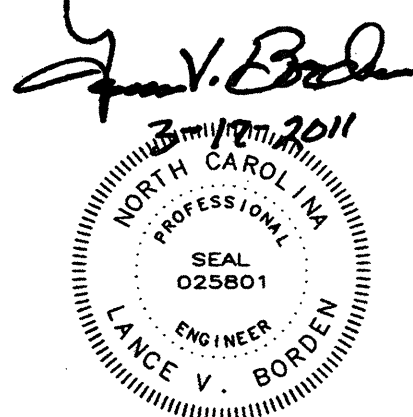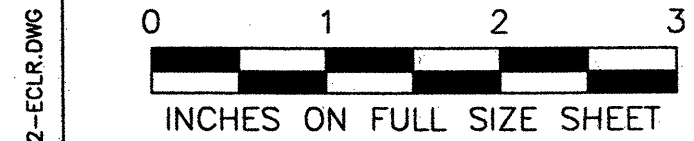


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
EXISTING CENTER LOCK REMOVAL			
DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	
DESIGNED D.M. BARRETT	DATE MARCH 2011	CHECKED J.W. NEWMAN	DRAWING NO. 3 OF 63

MB2

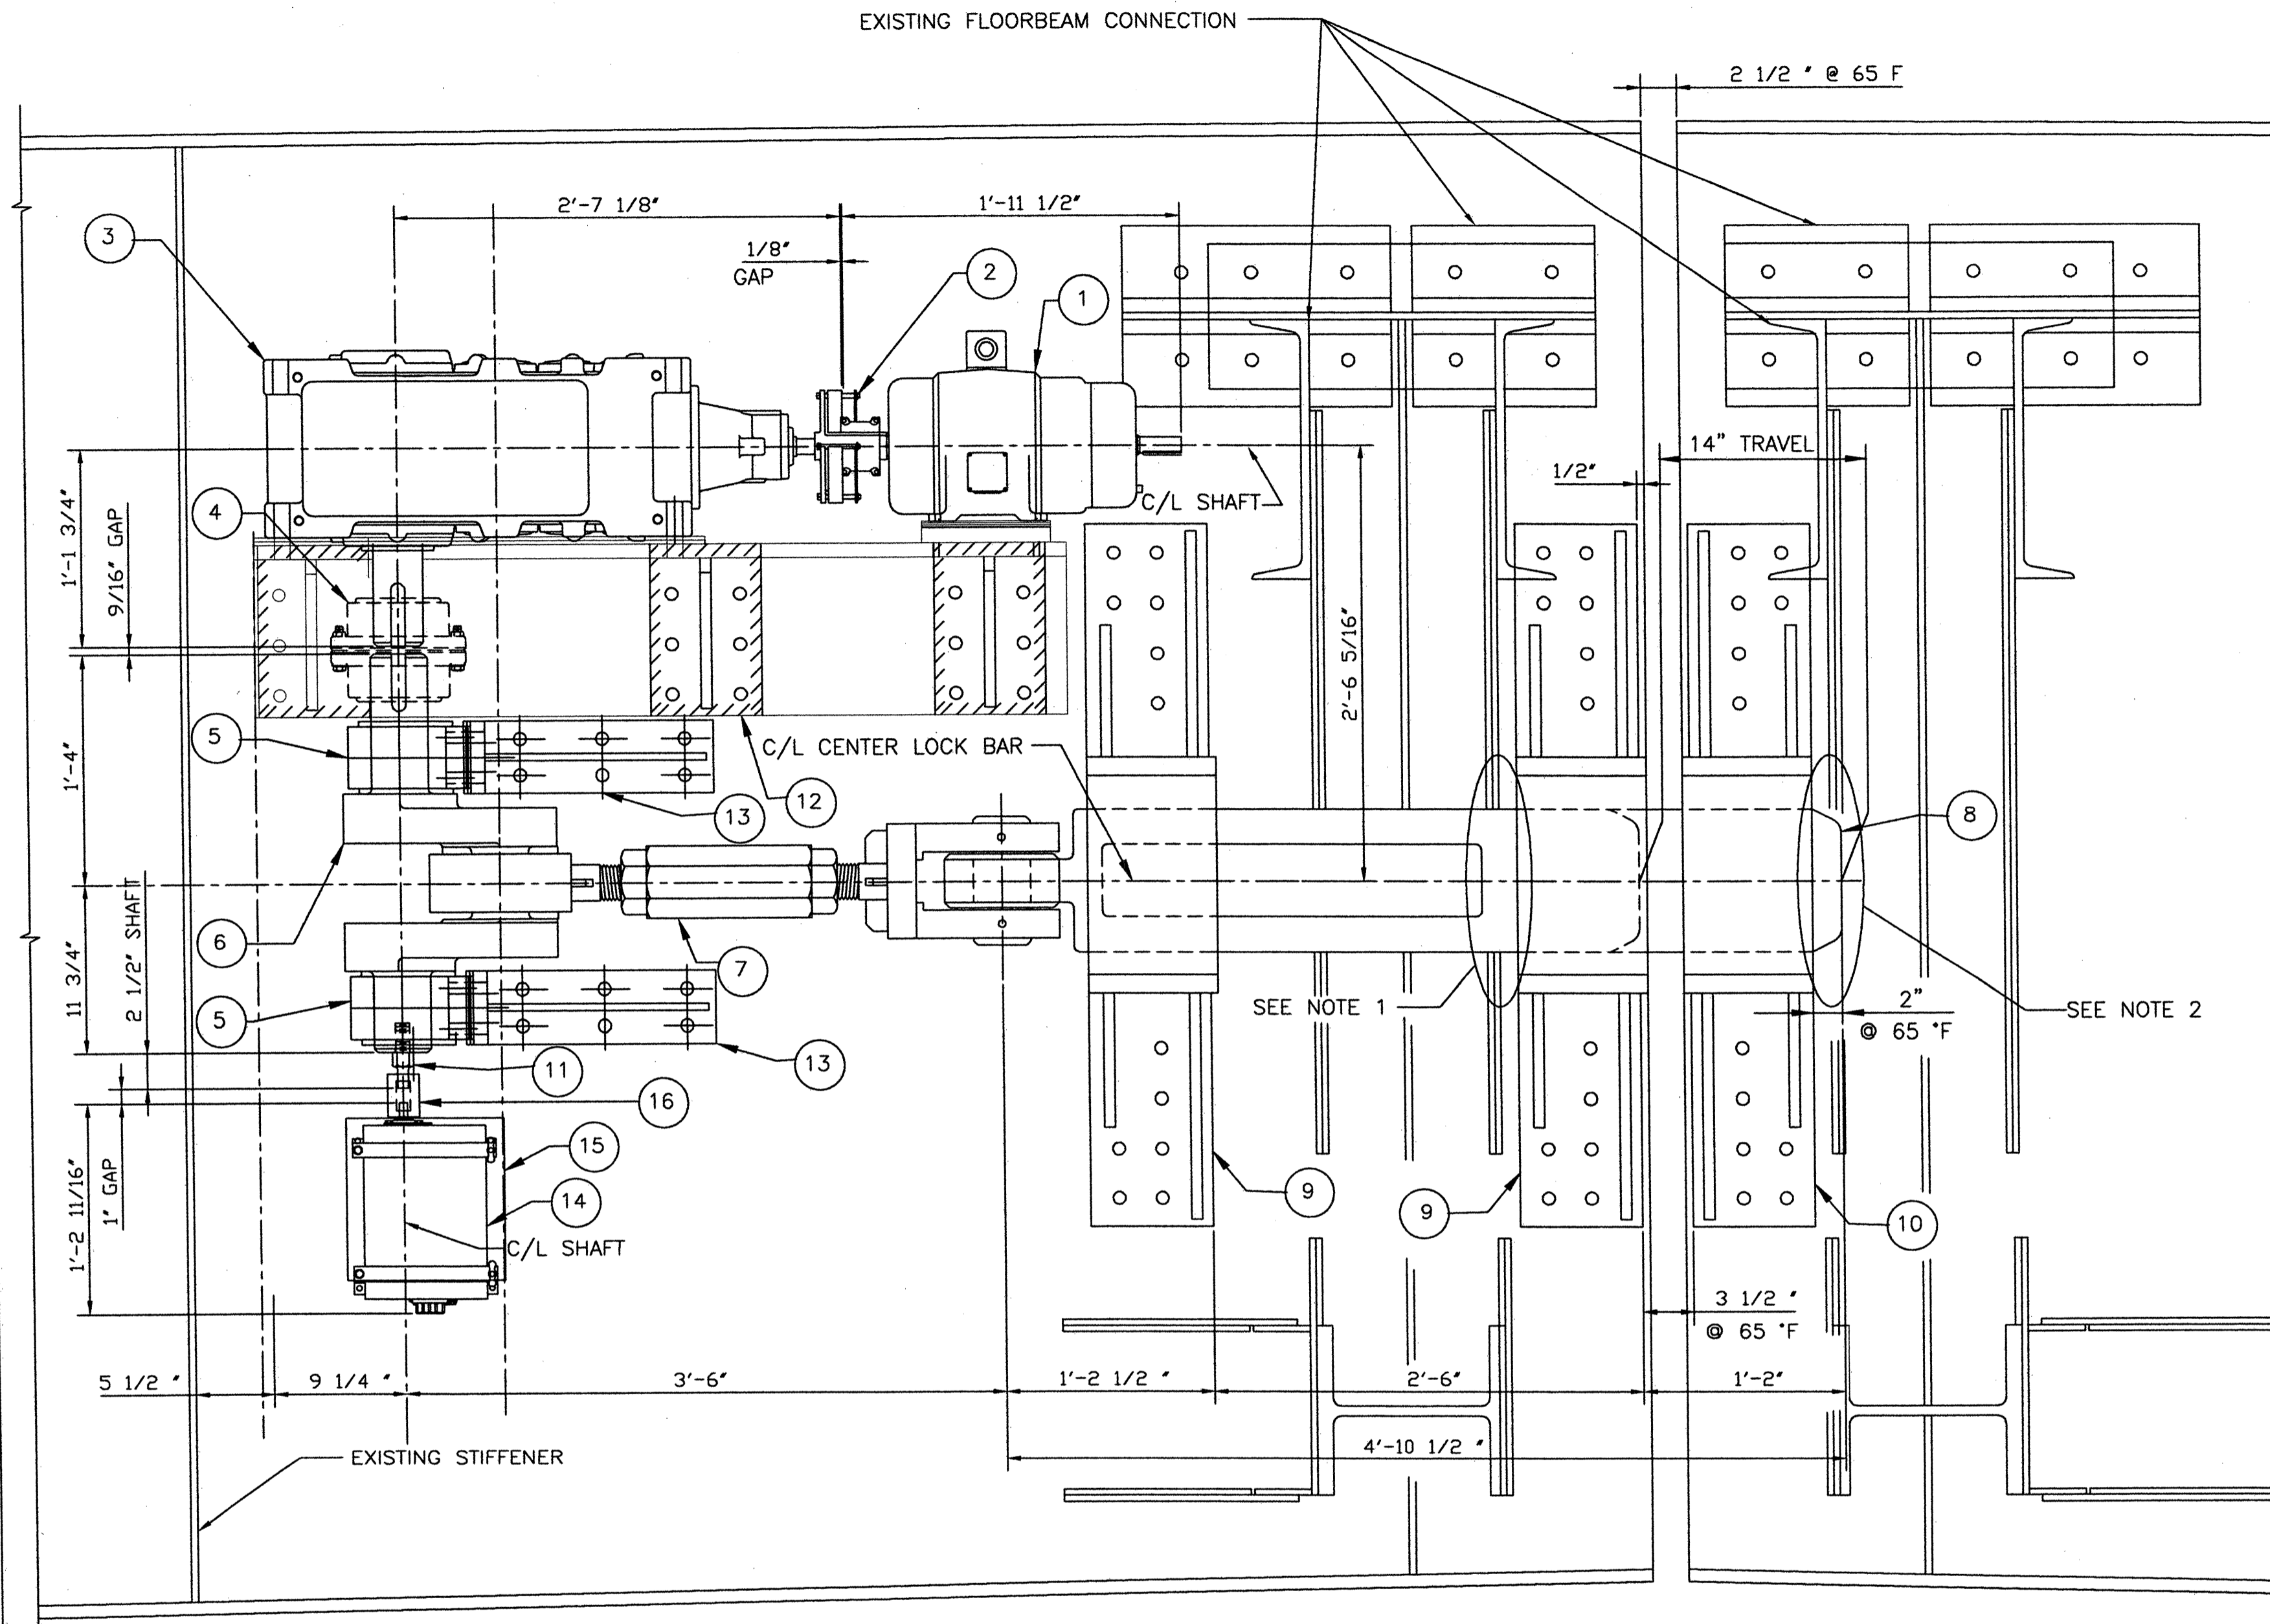

ELEVATION
NEW CENTER LOCK LAYOUT

SCALE: 1 1/2" = 1'-0"
ELEVATION VIEW - SOUTH SHOWN,
NORTH OPPOSITE HAND

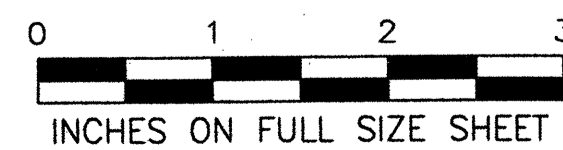

MACHINERY SCHEDULE			
MACH'Y NO.	NO. REQ'D.	UNIT DESCRIPTION	SHEET NO.
1	3 (1 SPARE)	NEW CENTER LOCK BRAKE MOTOR, BY REULAND ELECTRIC, 3 HP, 900 RPM, TENV, NEMA DESIGN D, HOIST DUTY AC, WITH REULAND ELECTRIC 25 FT-LBS BRAKE, 215X FRAME, EXTENDED SHAFT FOR HAND CRANK, AND MICROSWITCH ASSEMBLY.	-
2	2	NEW TORQUE LIMITING COUPLING, BY THE FALK CORPORATION, TYPE T41, SIZE 1030T, SET FOR 315 IN-LBS TORQUE. WITH ASTM A668, CLASS G KEYS TO MATCH STANDARD KEYWAYS ON BRAKE MOTOR AND GEAR REDUCER.	-
3	2	NEW RIGHT ANGLE GEAR REDUCER, BY SUMITOMO MACHINERY CORPORATION OF AMERICA, MODEL 9040, QUADRUPLE REDUCTION, RATIO 140:1 WITH OUTDOOR BREATHER AND HIGH BUILD EPOXY PAINT. FOR LUBRICATION PIPING, WHEN VIEWED FROM HIGH SPEED SHAFT SIDE AND THE VERTICAL SHAFT DOWN, ONE UNIT TO HAVE PIPING ON THE LEFT AND ONE UNIT TO HAVE PIPING ON THE RIGHT. BREATHER POSITIONED TO ALLOW FOR 80 DEGREES OF ROTATION WHEN MOUNTED ON BRIDGE.	-
4	2	NEW DOUBLE ENGAGEMENT COUPLING, BY THE FALK CORPORATION, GEAR TYPE GV10, SIZE 1030GV, 107,100 IN-LB TORQUE RATING, WITH SHROUDED BOLTS AND WITH AISI 1045 HEAT TREATED TO 250-300 BHN KEYS TO MATCH KEYWAYS ON GEAR REDUCER AND CRANK SHAFT.	-
5	4	NEW CRANK SHAFT BEARINGS, MODEL NUMBER SMCB-16 BY STEWARD MACHINE CO., WITH CUSTOM RADIUS AND GREASE GROOVES ON ONE SIDE.	MB4
6	2	NEW CRANK SHAFT.	MB4
7	2	NEW TURNBUCKLE AND CRANK SHAFT ASSEMBLY.	MB4
8	2	NEW CENTER LOCK BAR.	MB4
9	4	NEW CENTER LOCK GUIDES.	MB5
10	2	NEW CENTER LOCK RECEIVER.	MB5
11	2	NEW STUB SHAFT FOR ROTARY CAM LIMIT SWITCH.	MB5
12	2	NEW GEAR REDUCER AND BRAKE MOTOR SUPPORT.	MB6
13	4	NEW CRANK SHAFT BEARING SUPPORT.	MB6
14	2	NEW ROTARY CAM LIMIT SWITCH WITH 8 CAMS, BY GEMCO, SPDT SWITCHES, CONTACTS RATED 10A AT 120 VAC., NEMA 4/4X TYPE 316 STAINLESS STEEL HOUSING, CAMS ADJUSTABLE WITHOUT TOOLS, SETABLE FROM 4 TO 356 DEGREES.	-
15	2	NEW ROTARY CAM LIMIT SWITCH SUPPORT.	MB6
16	2	NEW STAINLESS STEEL COUPLING BY HELICAL MODEL MC7C-225-24-20 TO MATCH SHAFTS.	-


NOTES:

- EXISTING CUTOUTS IN GUSSET PLATES (AND GIRDER STIFFENER BETWEEN THE PLATES) MAY NEED TO BE ENLARGED TO PROVIDE MINIMUM 1/2" AND MAXIMUM 1" CLEARANCE WITH NEW LARGER LOCK BAR.
- ONE NEW CUTOUT (FOR EACH LOCK BAR) IN WEST LEAF GUSSET PLATES REQUIRED WITH MINIMUM 1/2" AND MAXIMUM 1" CLEARANCE WITH NEW LOCK BAR.
- CUTOUTS SHALL BE MADE BY MECHANICAL MEANS ONLY AFTER PROCEDURE IS SUBMITTED TO OWNER AND APPROVED.
- PROVIDE NEW STAINLESS STEEL DEBRIS COVERS TO COMPLETELY COVER THE TOP OF THE CENTER LOCK BARS BETWEEN GUIDES. CONCEPT TO BE SUBMITTED TO OWNER FOR APPROVAL. SEE SPECIFICATIONS FOR ADDITIONAL DETAILS.
- THE EXISTING LIVE LOAD SHOES SHALL BE ADJUSTED BY INSTALLING OR REMOVING SHIMS TO THE TOP SHOE TO ACHIEVE CONTACT ON BOTH SIDES OF EACH LIVE LOAD ASSEMBLY. THIS ADJUSTMENT SHALL BE COORDINATED WITH THE ROADWAY PROFILE AND ADJUSTMENT OF THE SHIMS FOR THE EXISTING CENTER LOCK RECEIVERS. EACH LIVE LOAD ADJUSTMENT SHALL BE SUBMITTED AND APPROVED BY THE NCDOT REPRESENTATIVE BEFORE THE ADJUSTMENT IS MADE.
- A TEMPORARY SPAN LOCK ASSEMBLY IS DETAILED ON SHEET MB7. INSTALLATION IS REQUIRED BEFORE REMOVAL OF ANY EXISTING CENTER LOCK GUIDES, RECEIVERS, OR LOCK BARS.

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA

NEW CENTER LOCK - LAYOUT

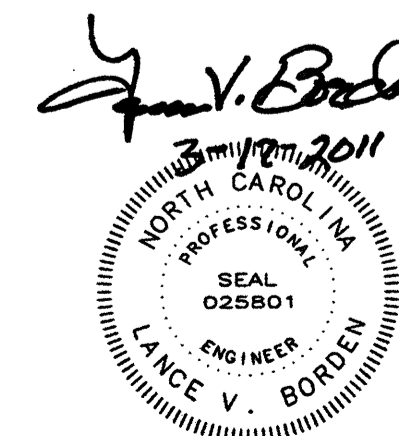











MB3

DRAWN BY E.A. RICKENBACH



SCALE AS NOTED

DESIGNED D.M. BARRETT DETAILED D.M. BARRETT DATE MARCH 2011

CHECKED E.A. SAMPLE CHECKED E.A. SAMPLE DRAWING NO. 4 OF 63

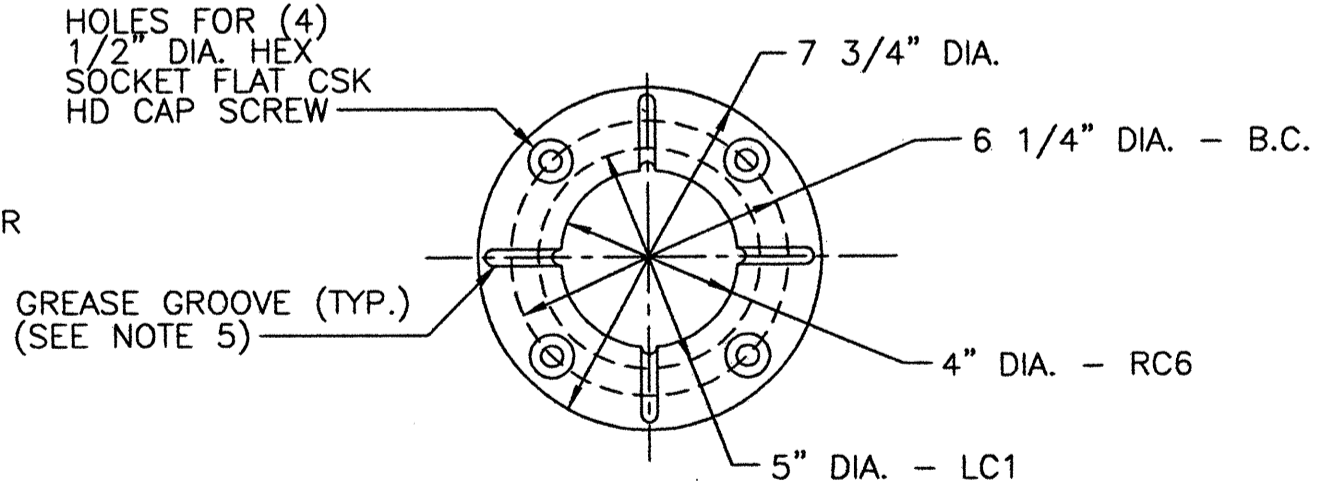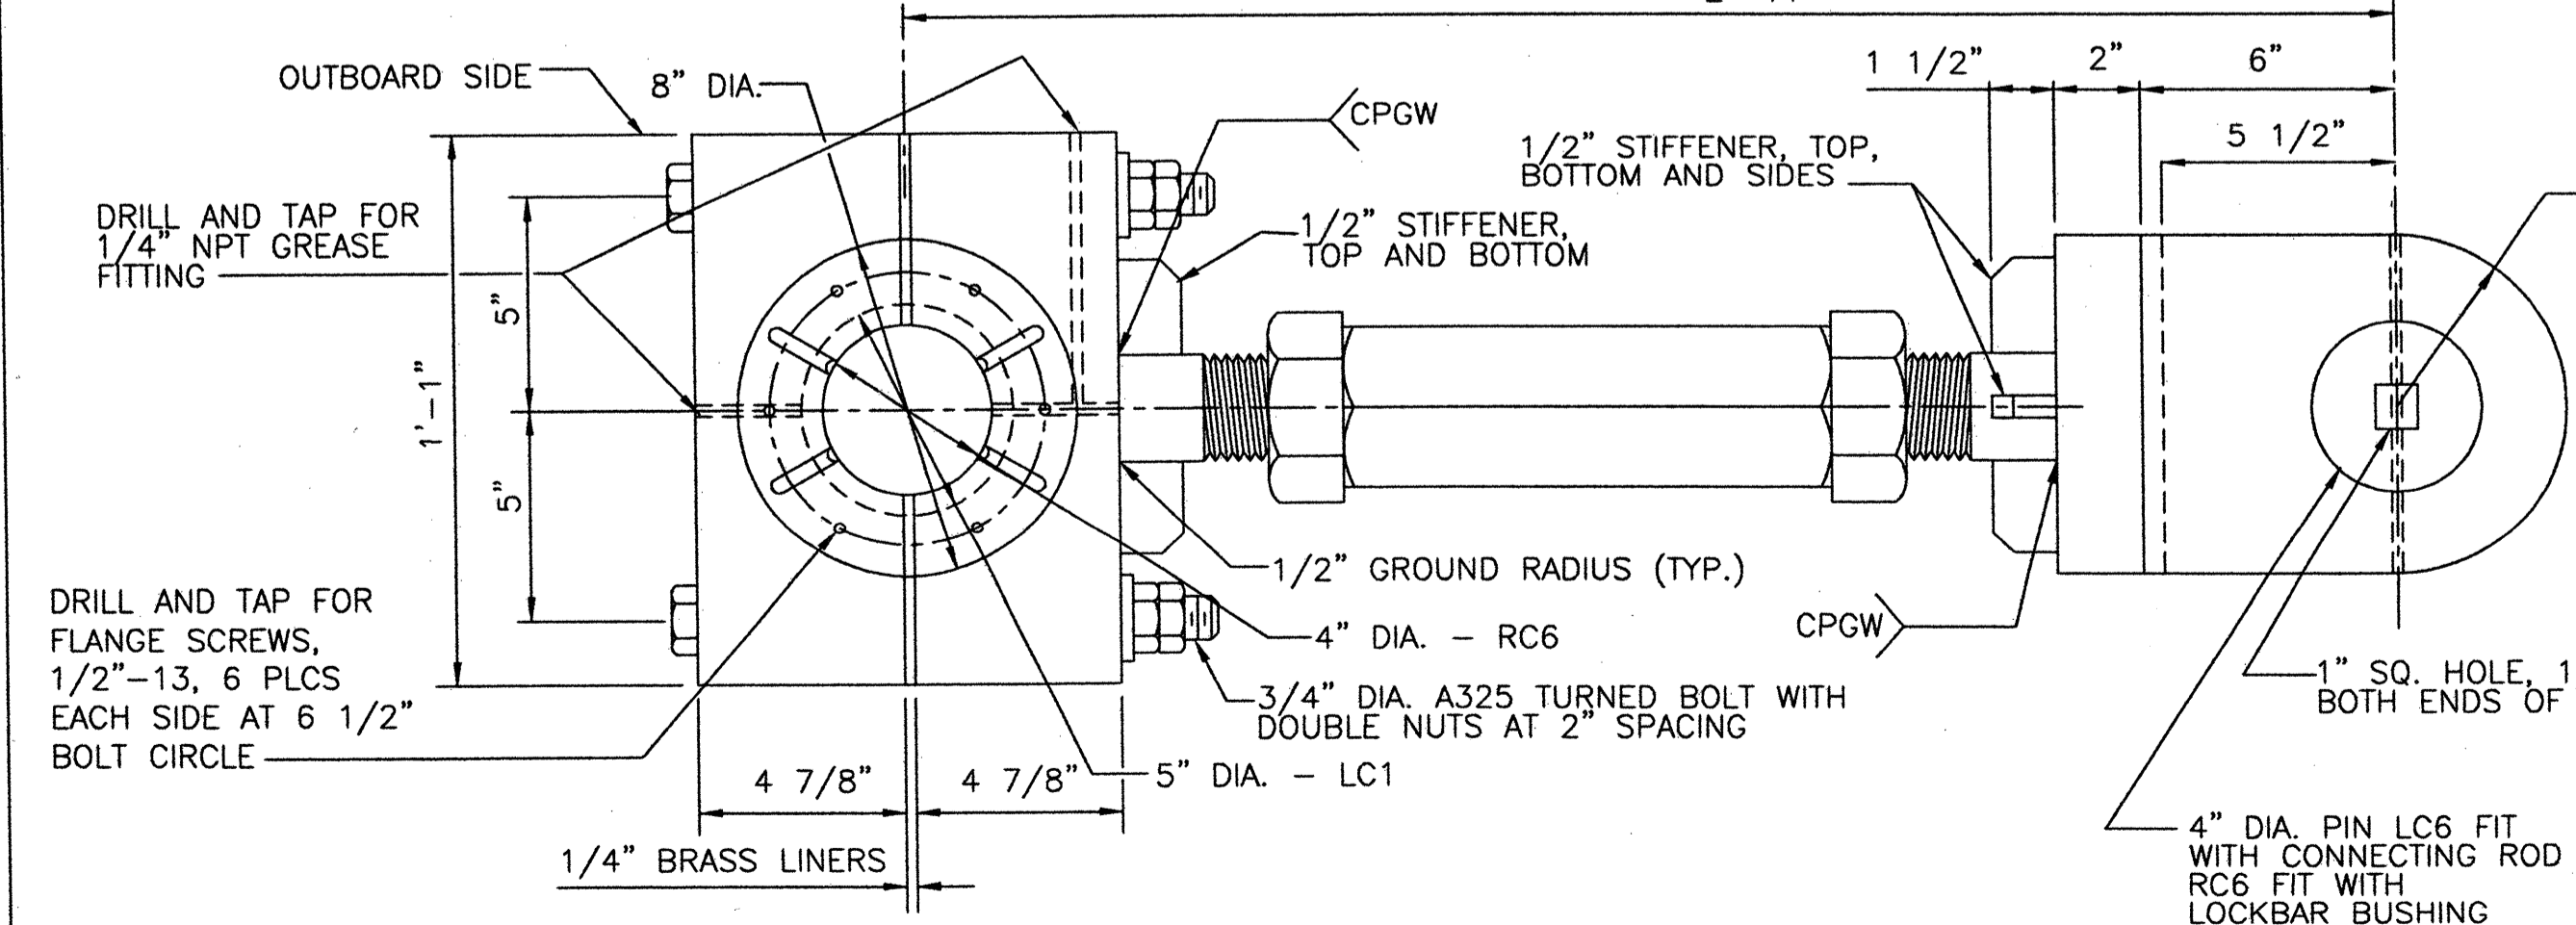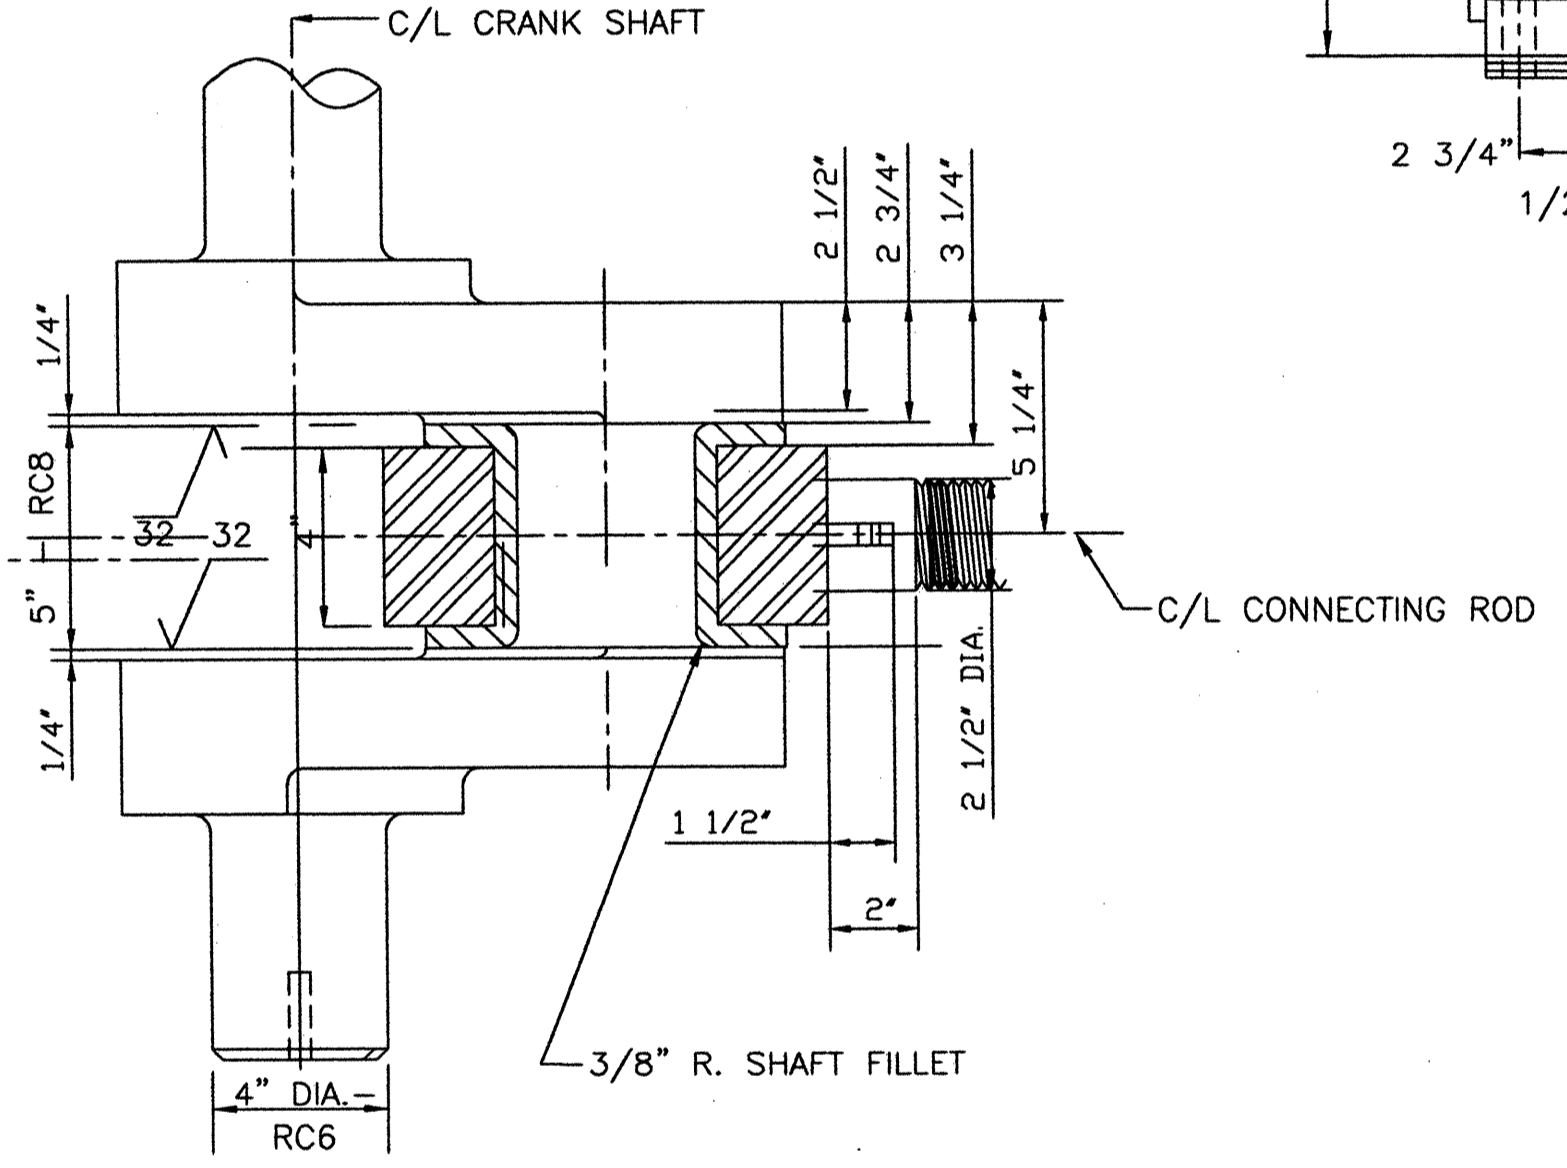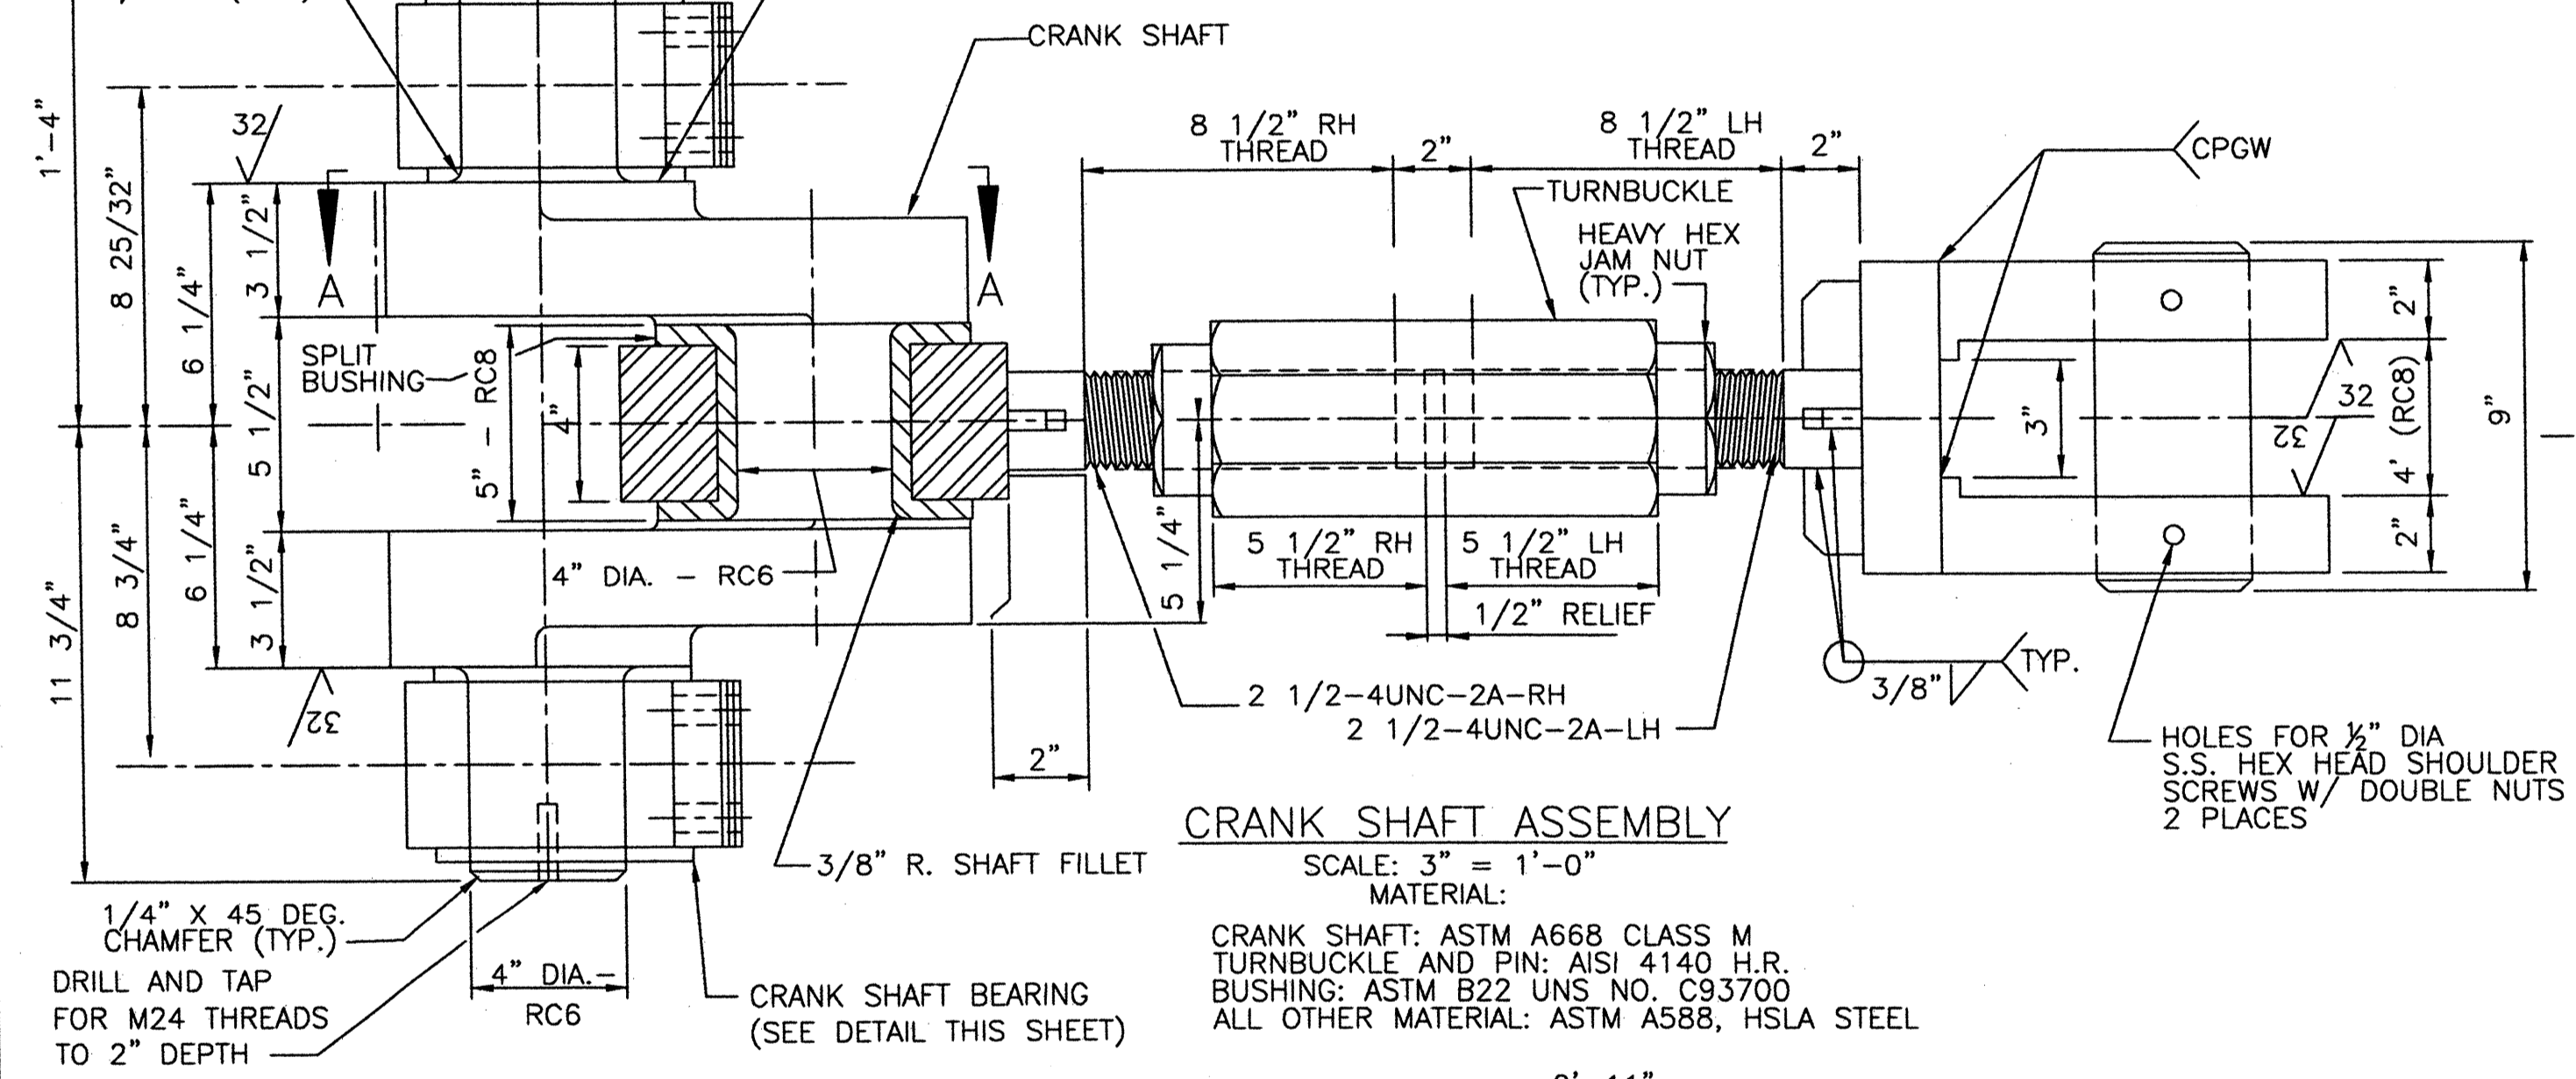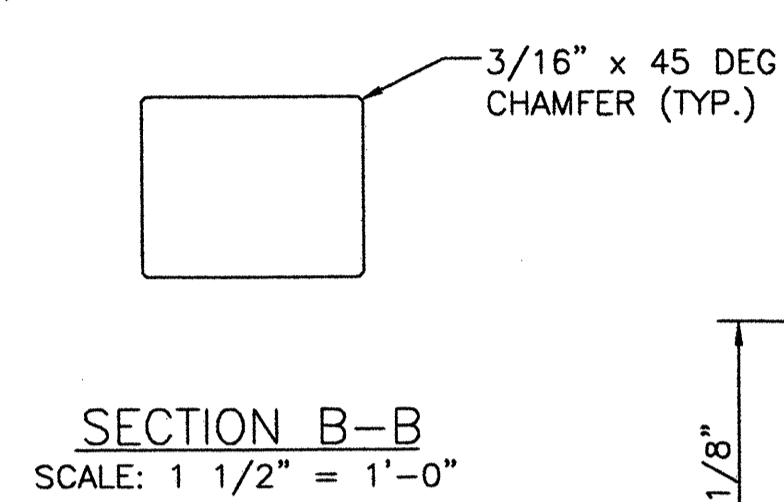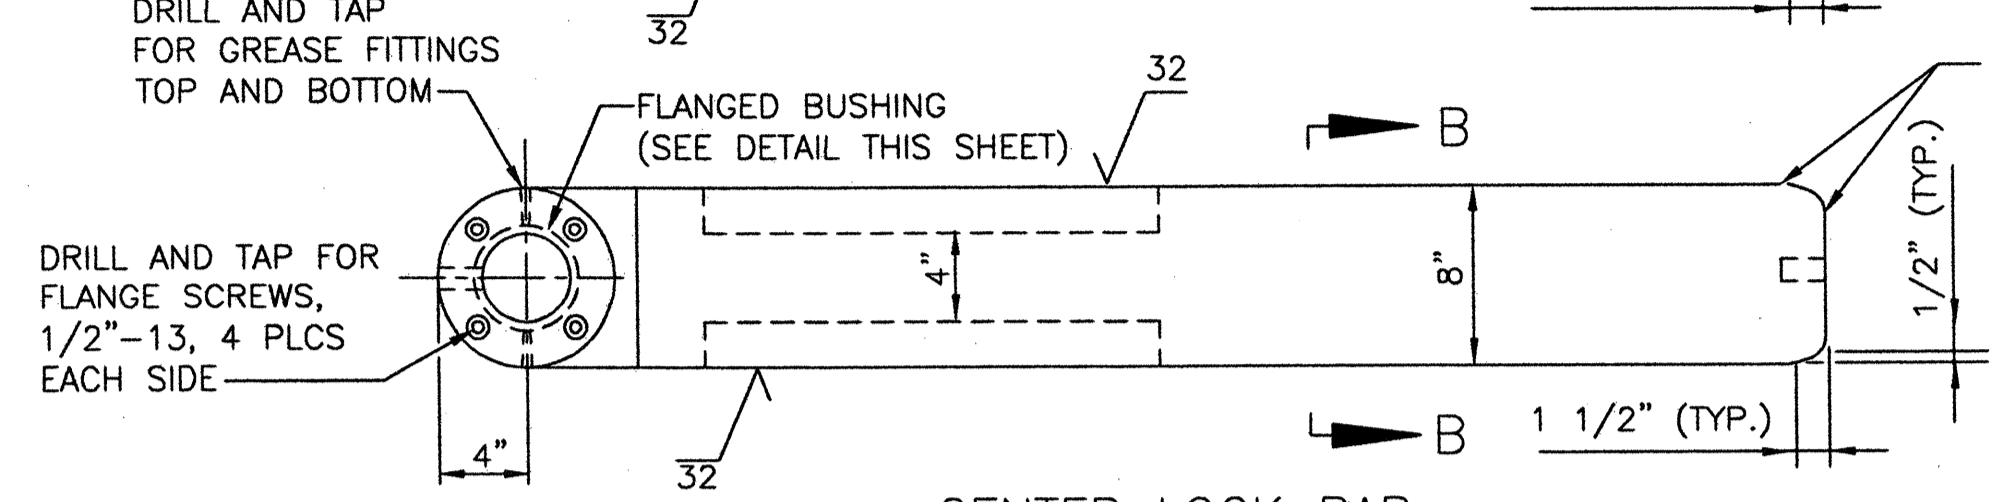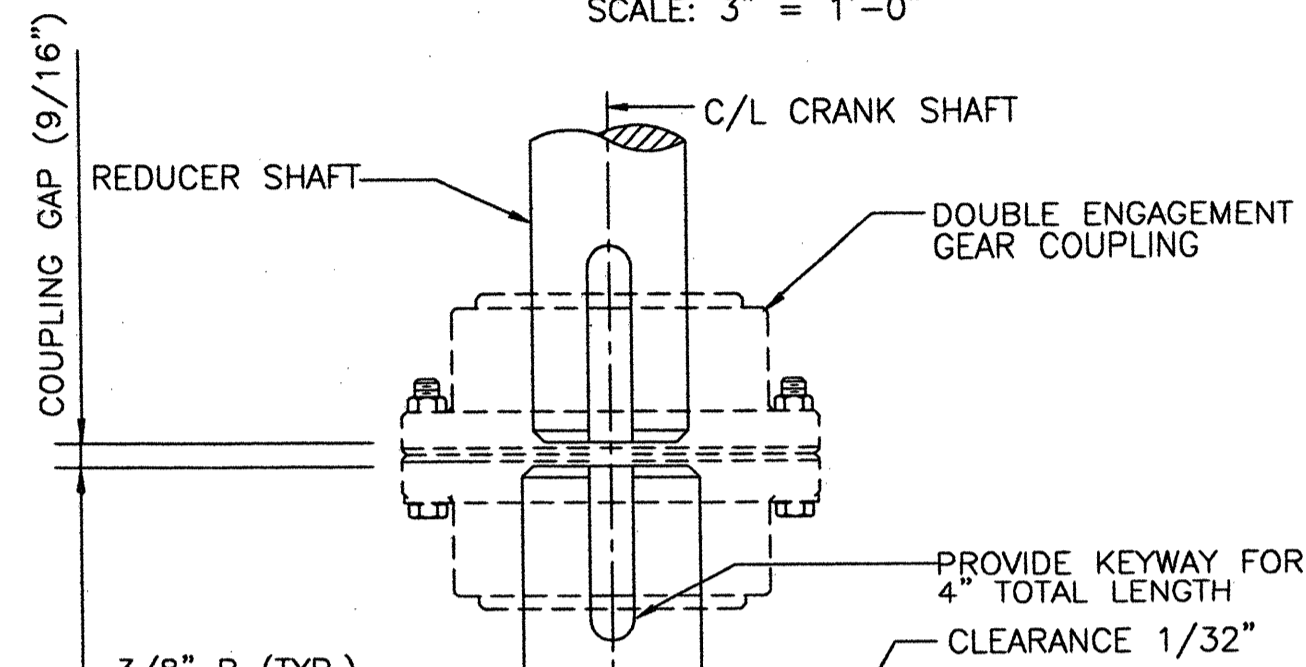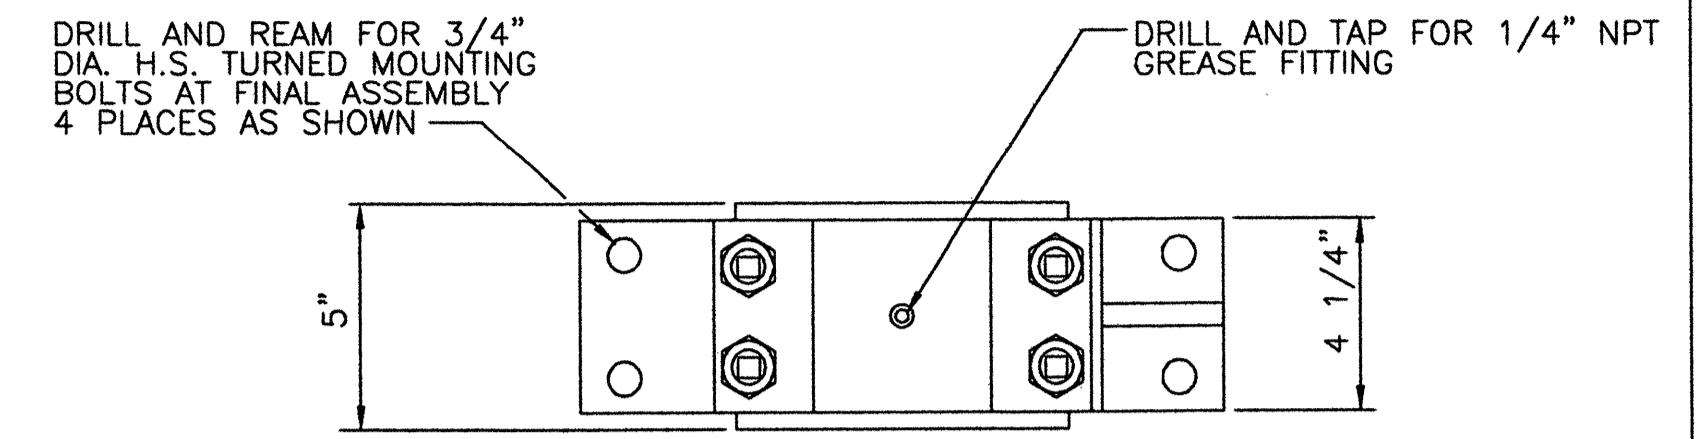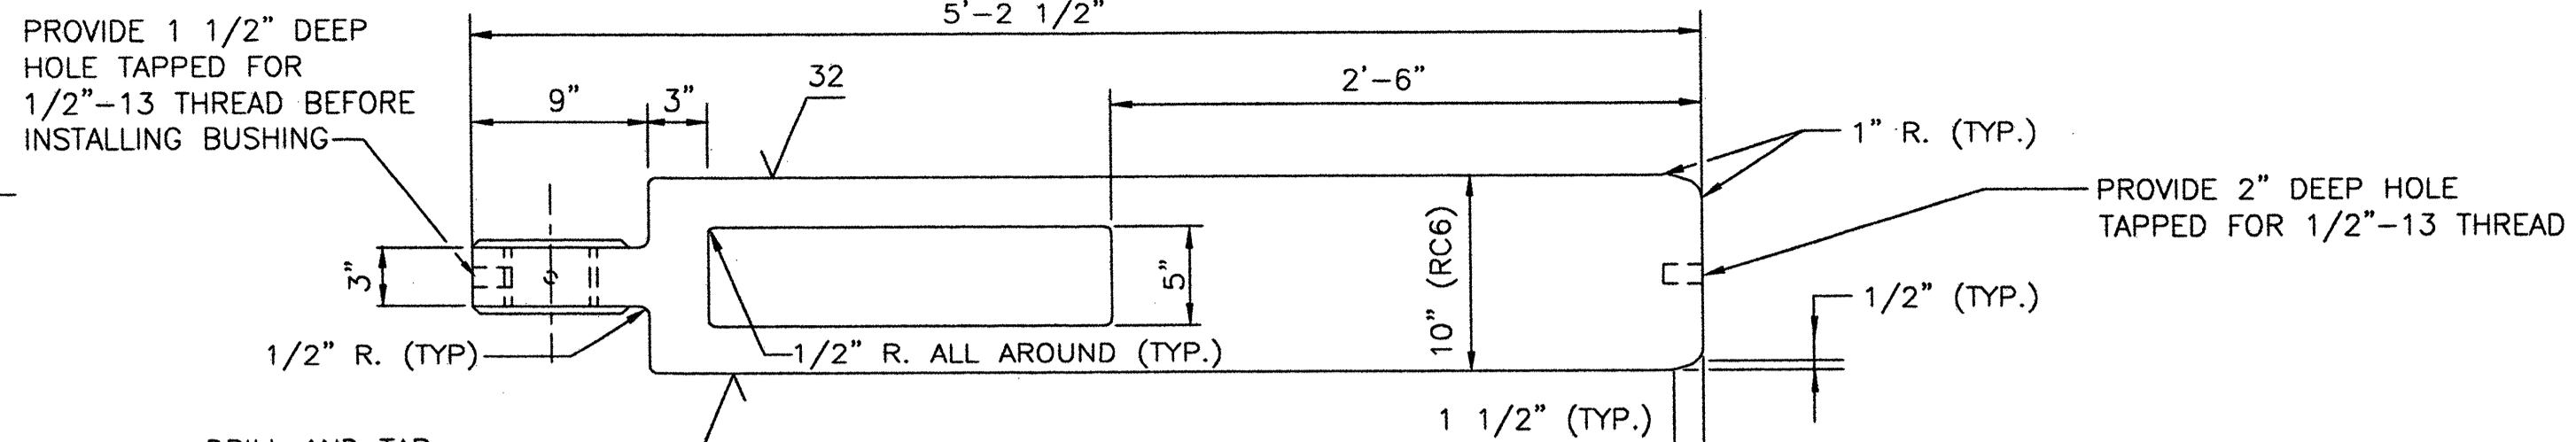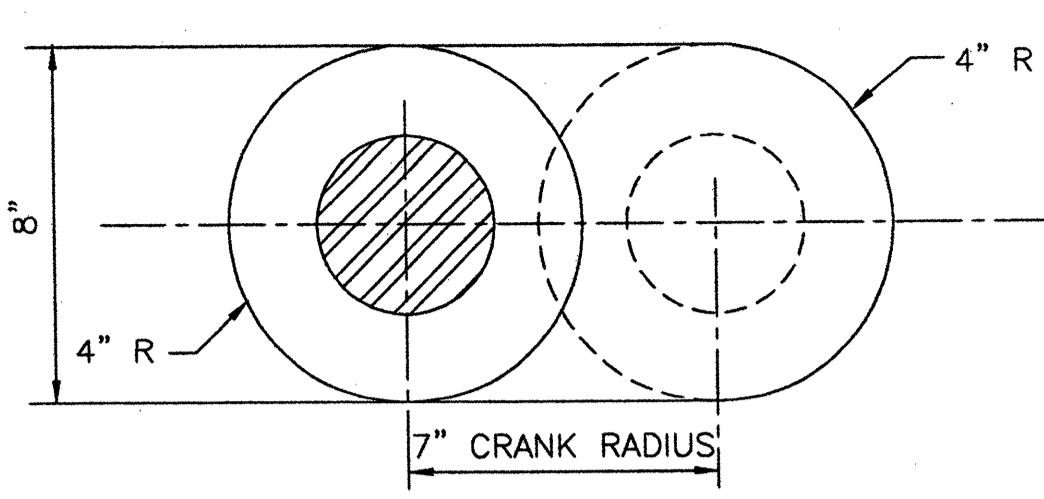











- NOTES:
- ALL SPLIT BEARING GREASE GROOVES SHALL BE 1/8" WIDE AND 1/16" DEEP WITH ALL CORNERS AND EDGES ROUNDED TO 1/16" R. THE GREASE GROOVE SHALL BE CUT 1/2" FROM THE ENDS OF THE BEARING AND FORM A FIGURE EIGHT OVER THE ENTIRE JOURNAL SURFACE WITH ONE INTERSECTION AT THE GREASE PORT. THE CORNER OF THE BEARING AT A FILLET SHALL BE ROUNDED THE FILLET RADIUS PLUS 1/8" AT THE SPLIT. THE SHIM PACK SHALL BE CUT 1/4" BACK FROM THE JOURNAL SURFACE BETWEEN THE GREASE GROOVES. EACH BEARING SHALL BE DRILLED AND TAPPED FOR 1/4" STEEL PIPE, ADAPTER AND GREASE FITTING.
 - ALL WELDMENTS SHALL BE STRESS RELIEVED BY HEAT PRIOR TO FINAL MACHINING.
 - MAXIMUM WIDTH ACROSS CORNERS FOR TURNBUCKLE 4 1/2", 3 7/8" ACROSS FLATS.
 - HEX SOCKET FLAT CSK HEAD CAP SCREWS TO BE RECESSED 1/8".
 - FLANGED BUSHINGS TO HAVE 1/8" WIDE AND 1/16" DEEP GROOVES WITH CORNERS AND EDGES ROUNDED TO 1/16" R. I.D. GROOVES TO BE DOUBLE SPIRAL. THRUST FACE GROOVES TO TIE INTO I.D. GROOVES.
 - ALL BUSHINGS TO HAVE 32 MICROINCH FINISH AT JOURNAL AND THRUST AREAS AND 125 MICROINCH FINISH AT NON-SLIDING AREAS.

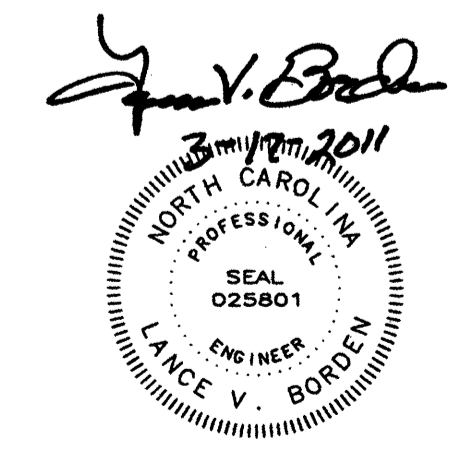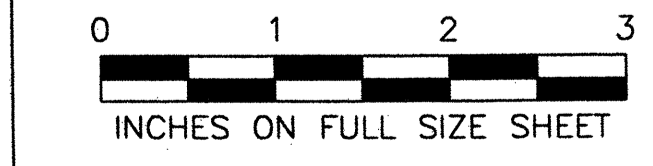


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW CENTER LOCK - COMPONENTS			
DESIGNED	D.M. BARRETT	DATE	MARCH 2011
CHECKED	E.A. SAMPLE	DRAWING NO.	5 OF 63




MB4

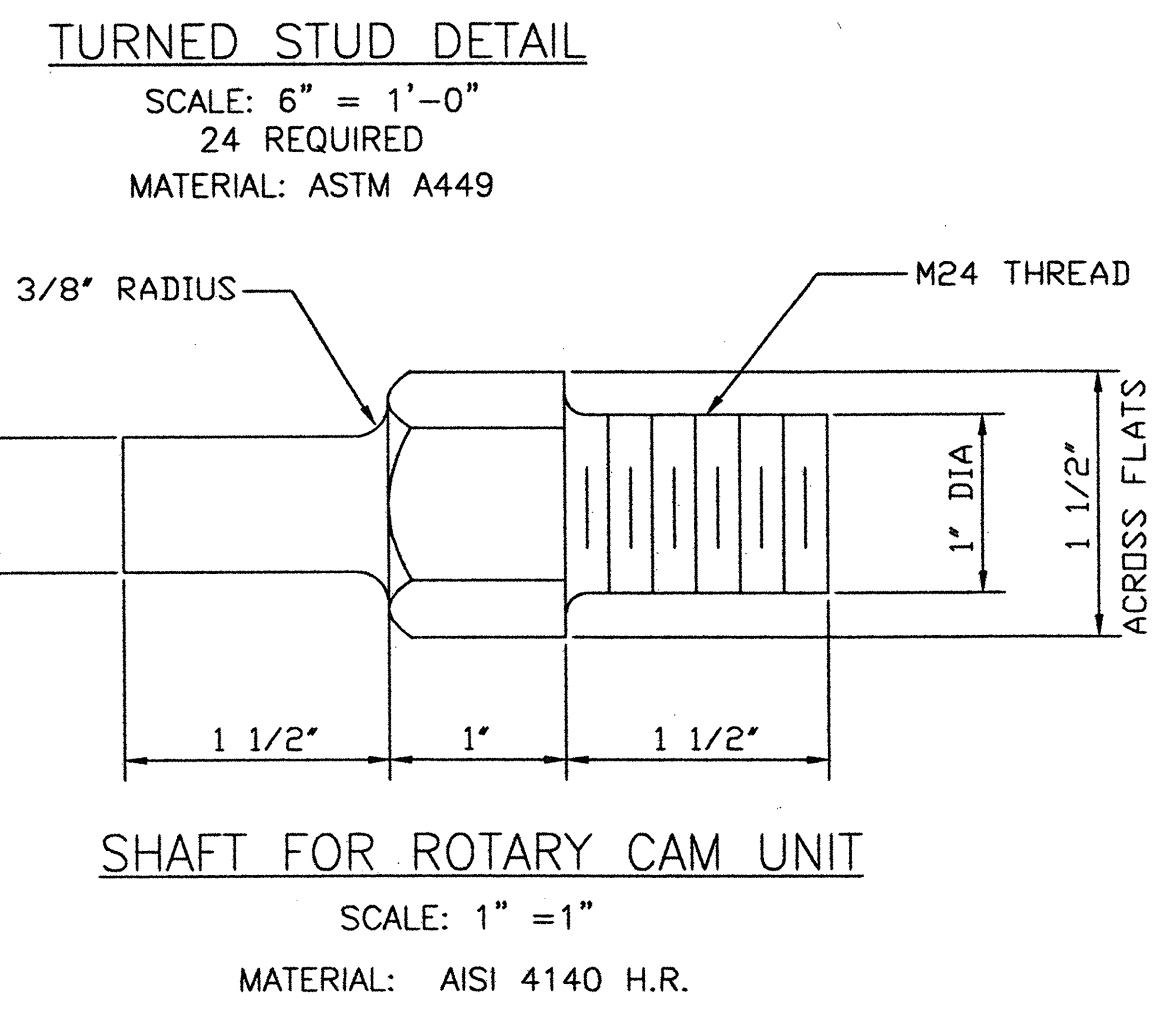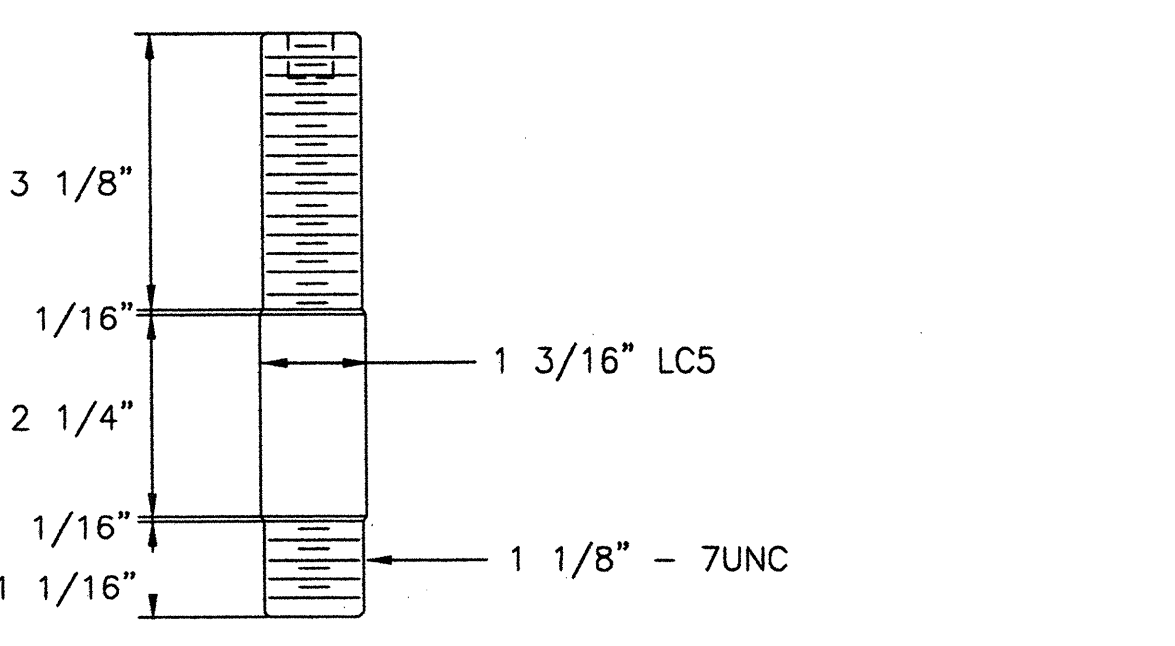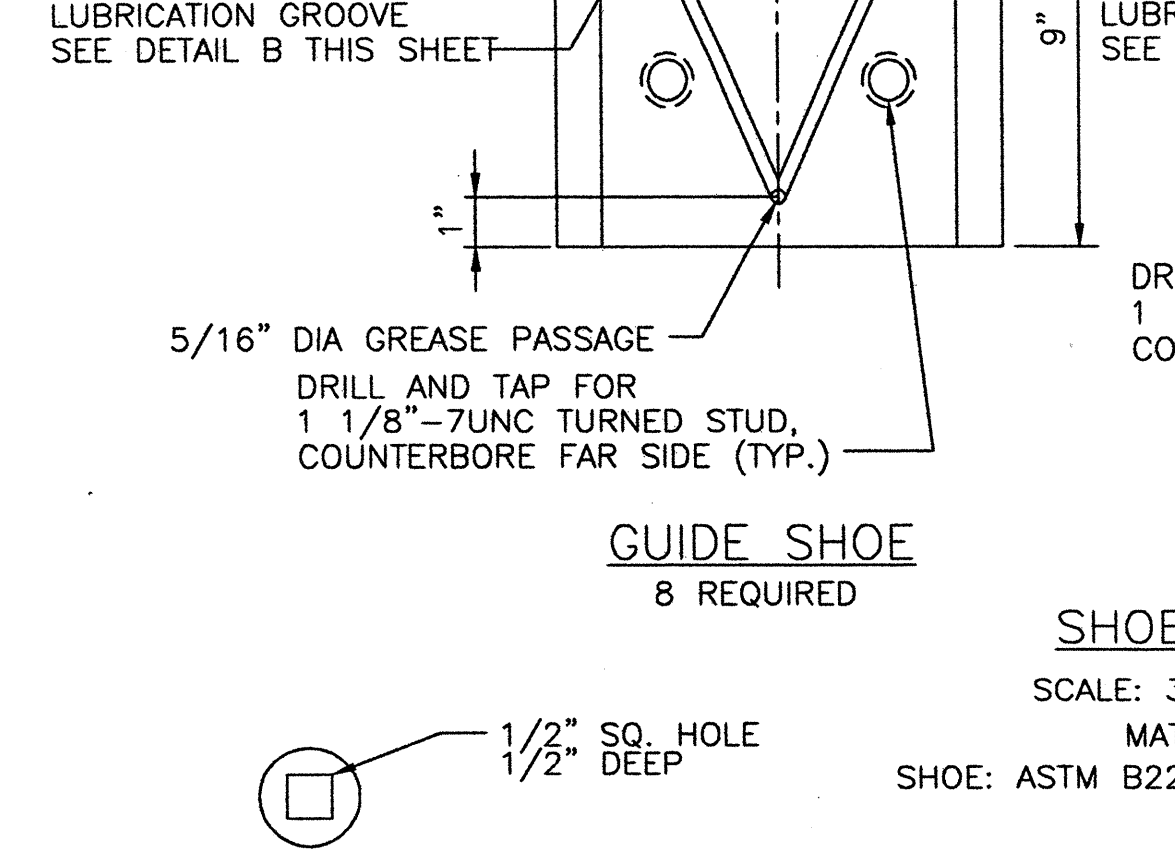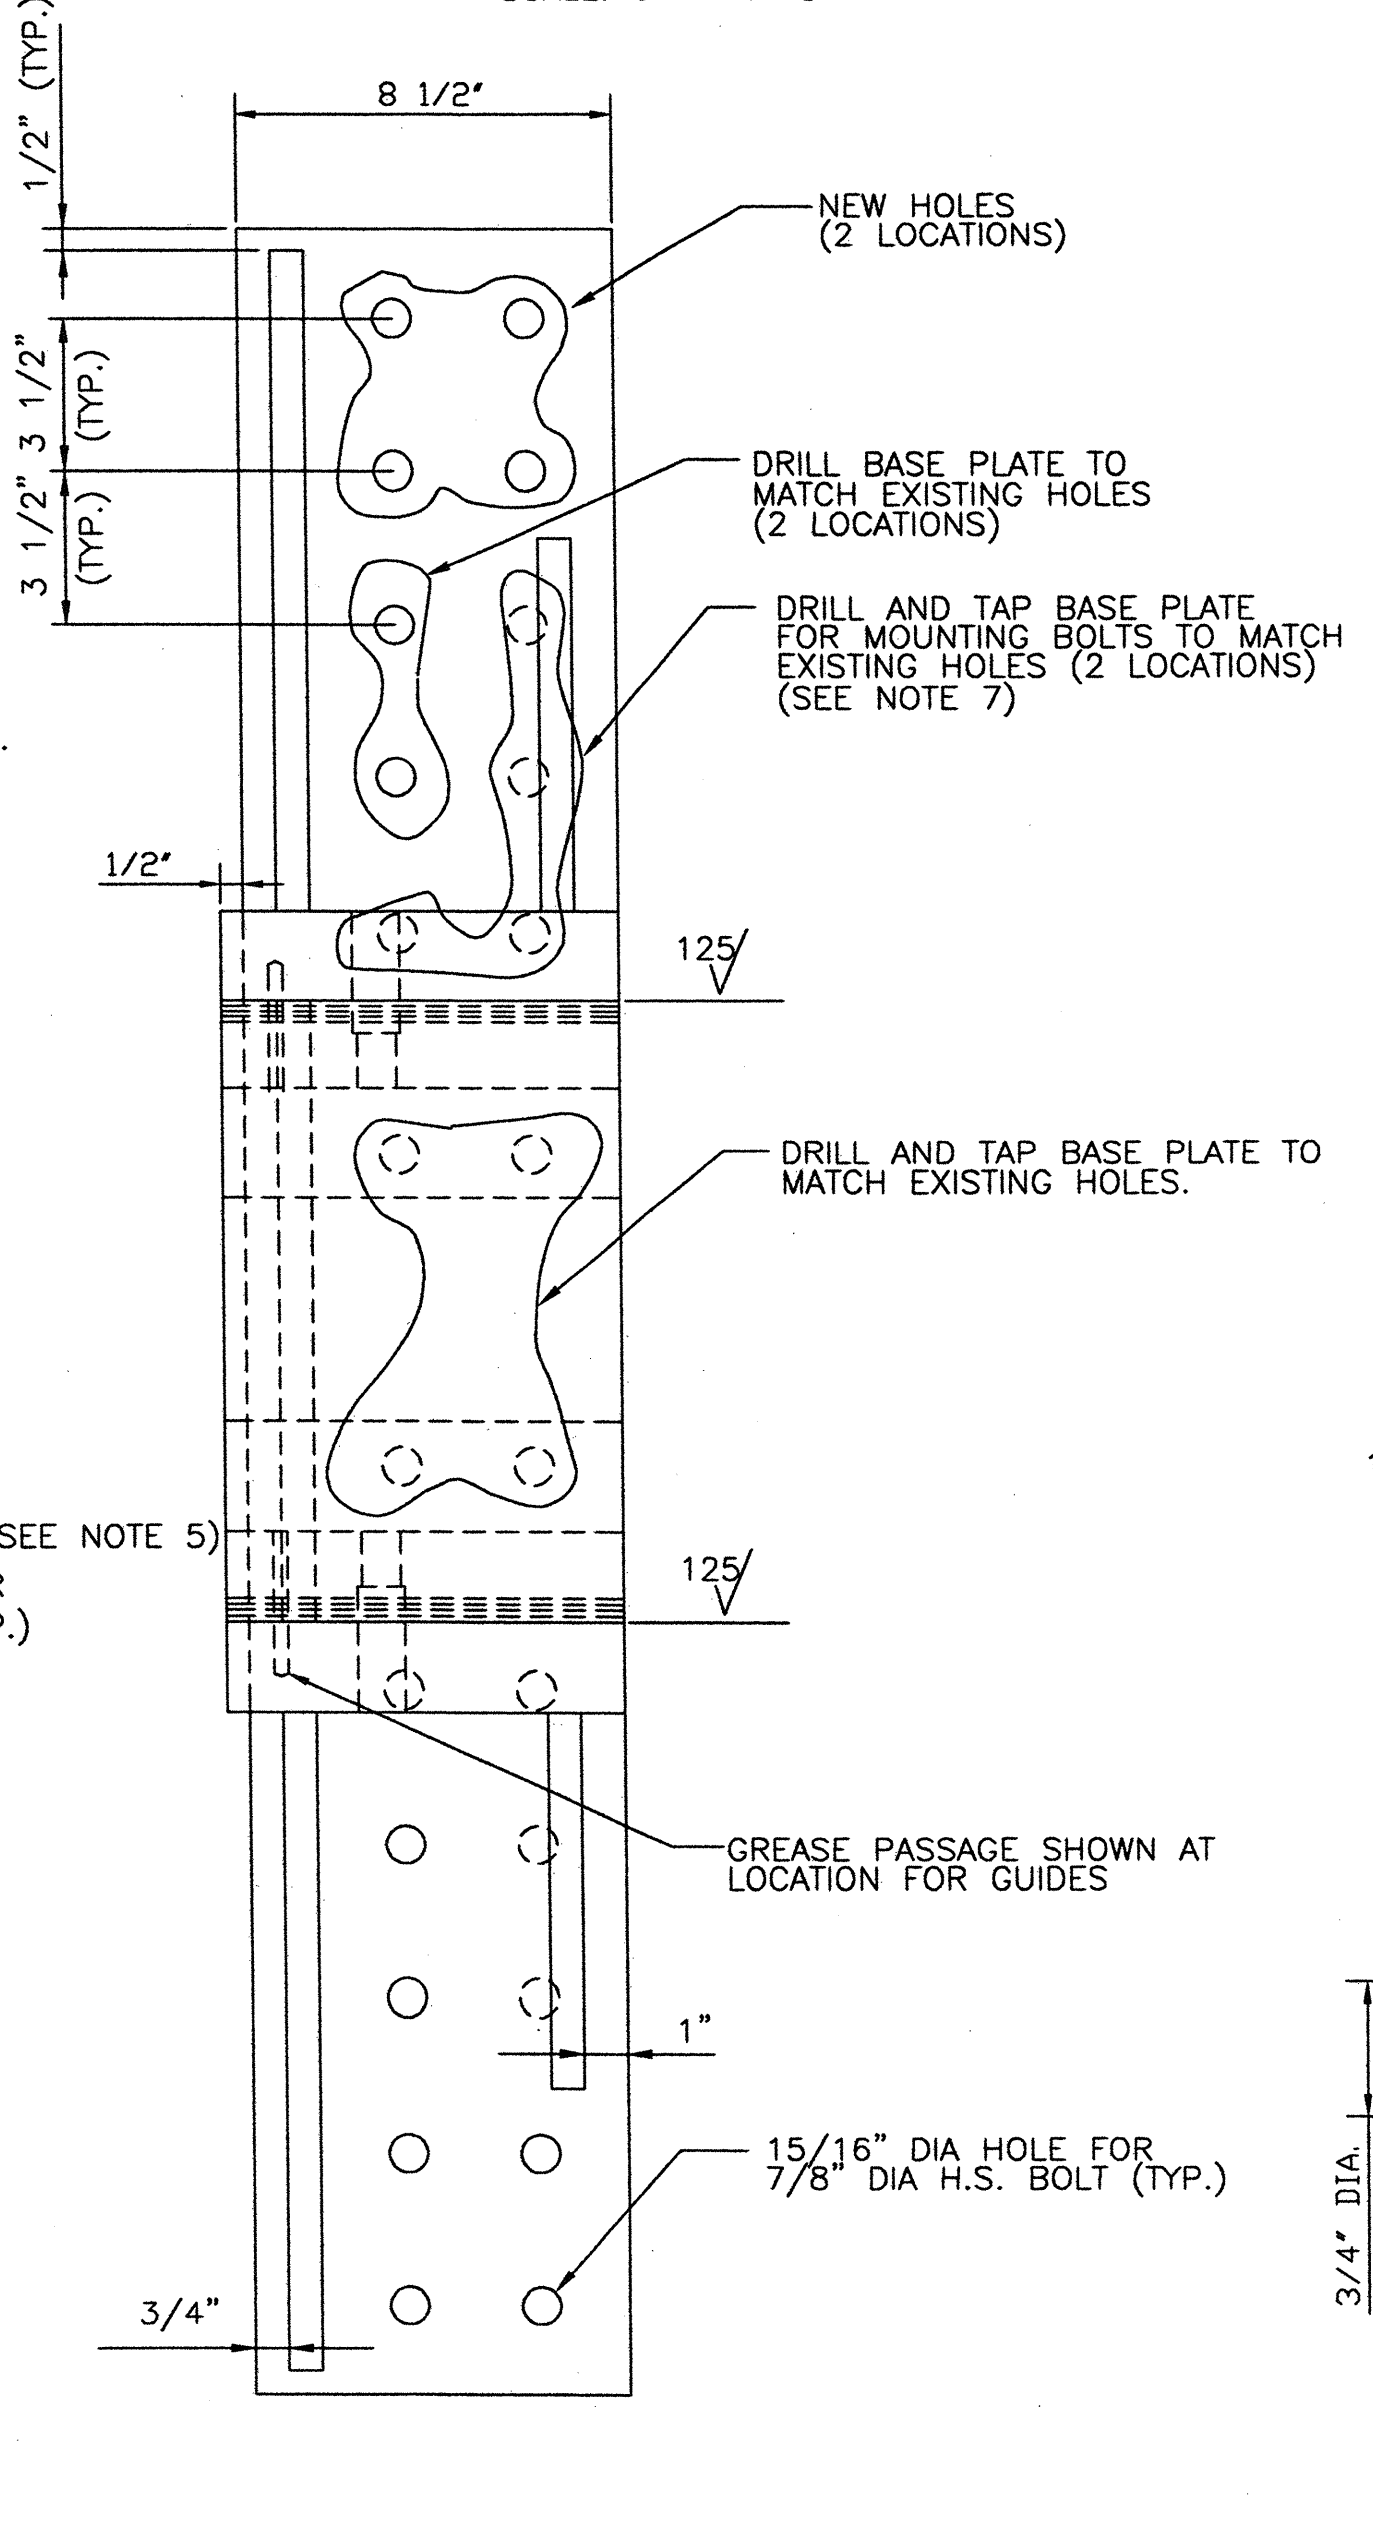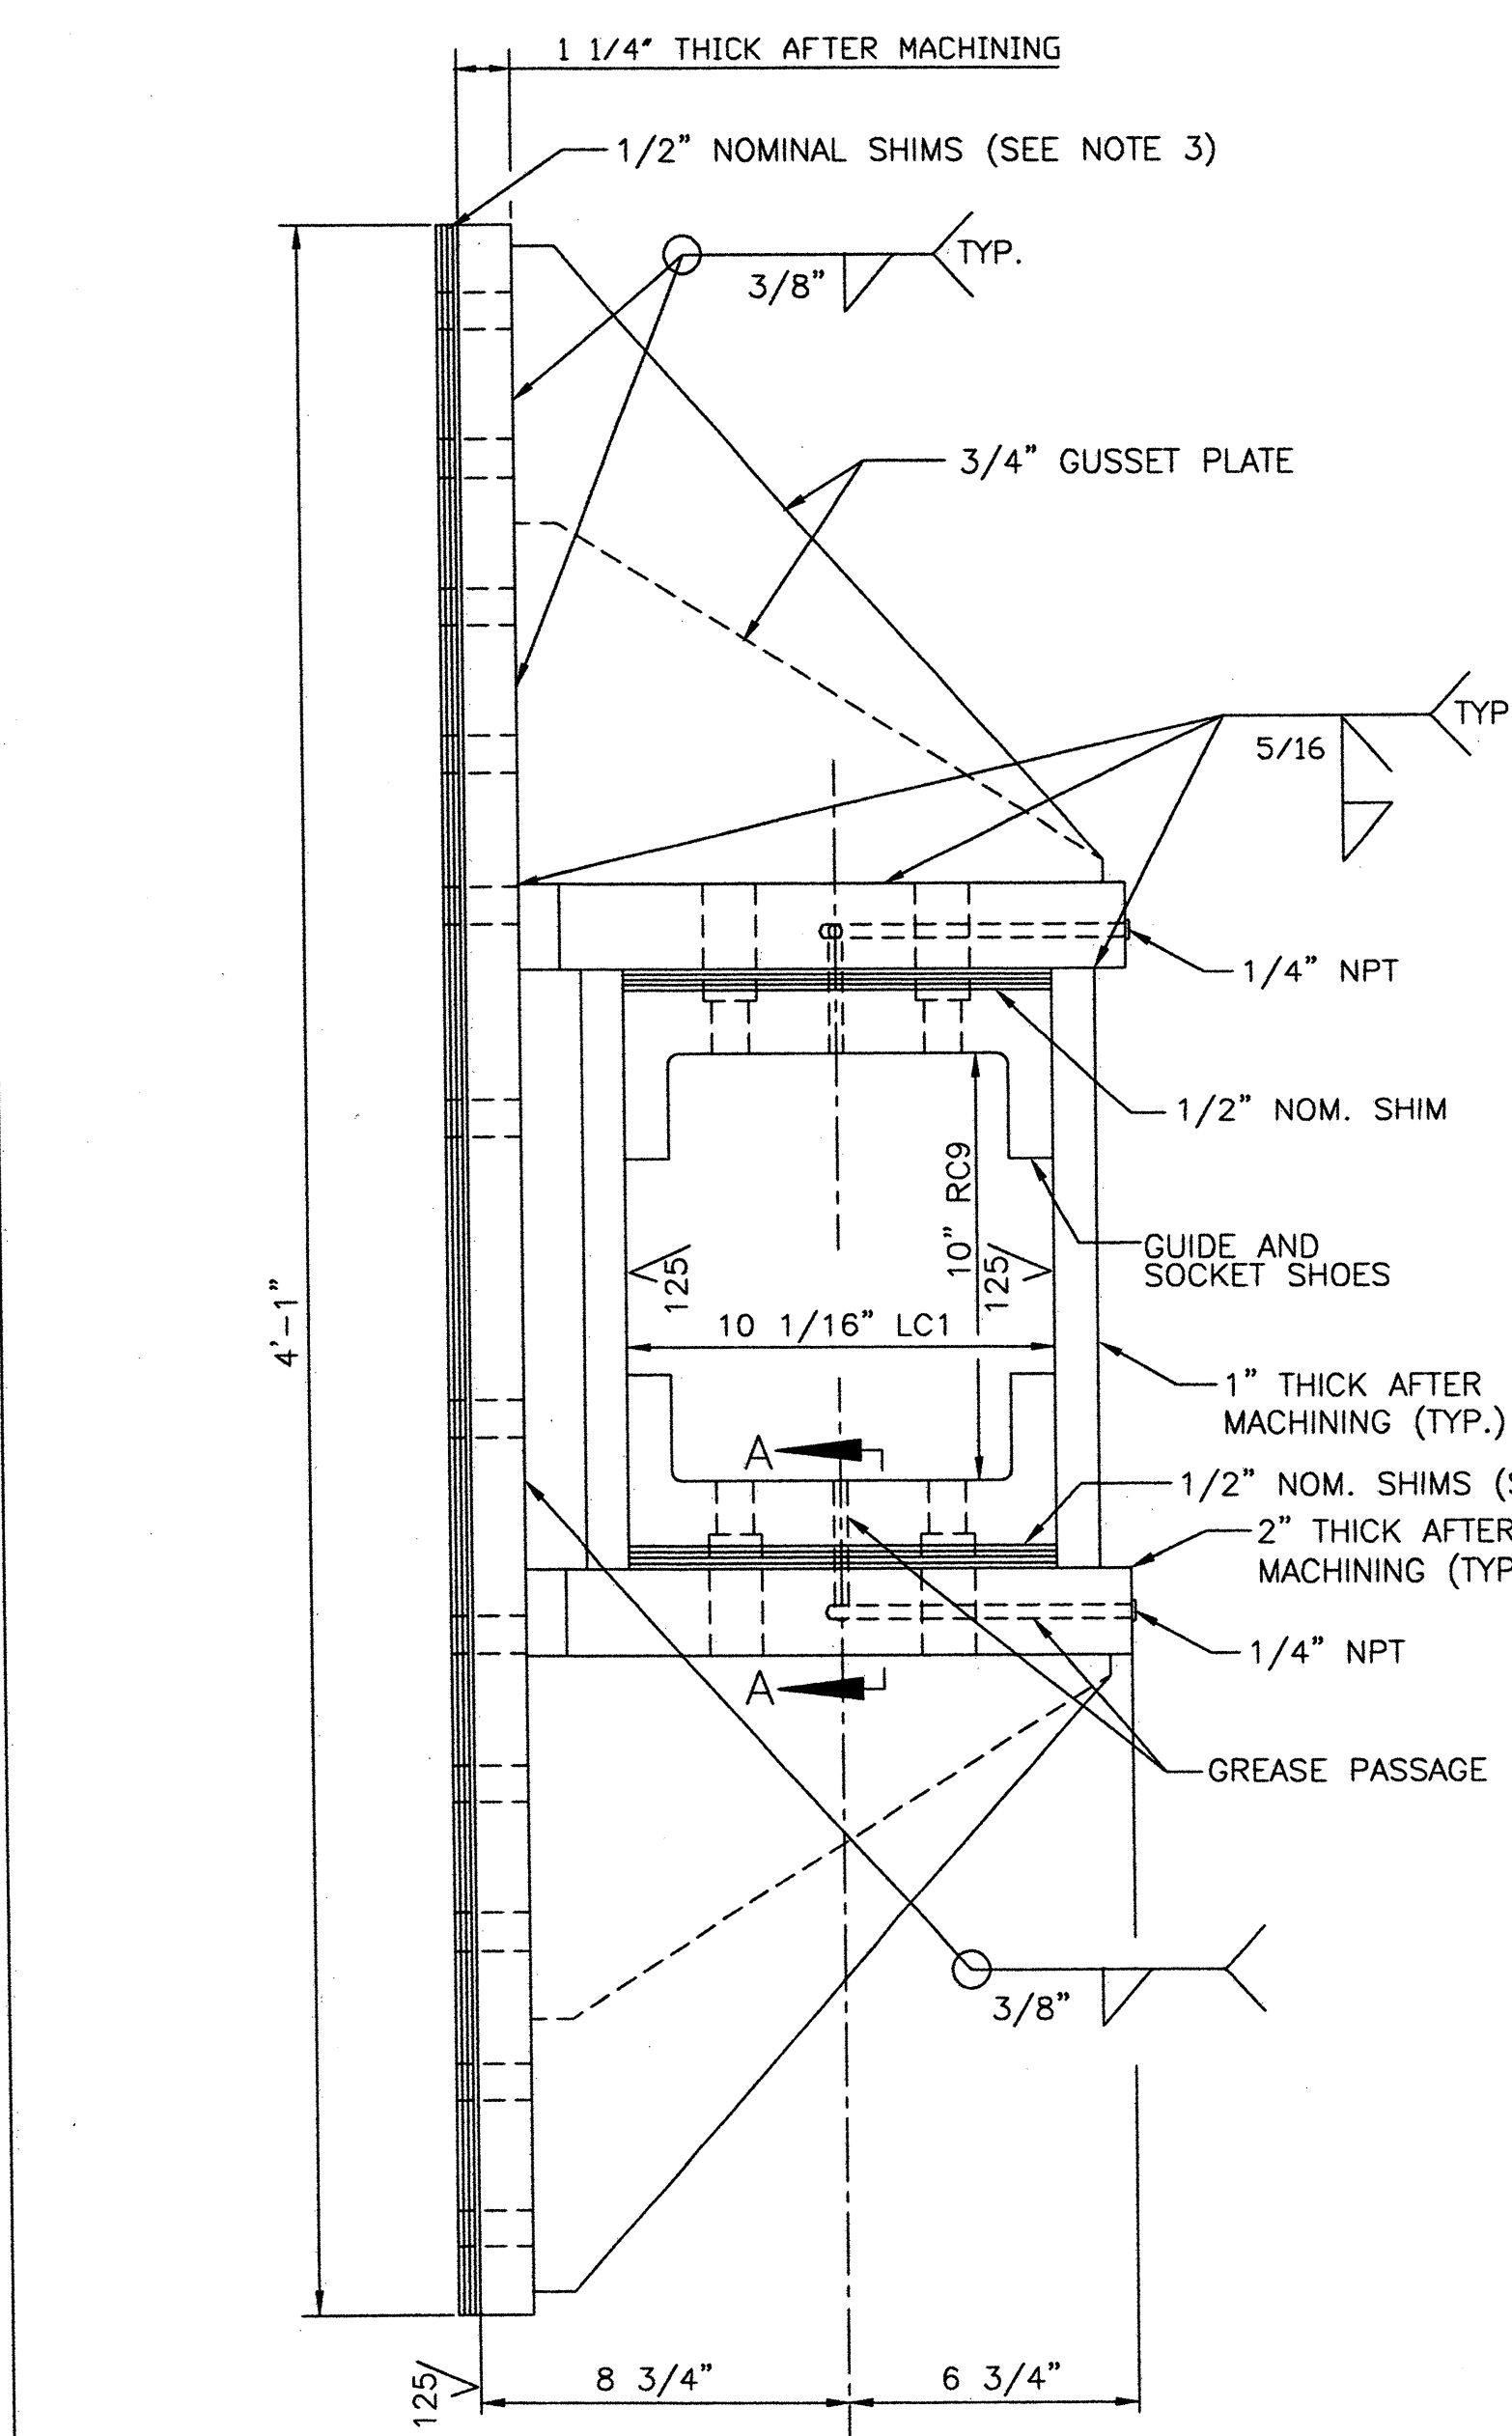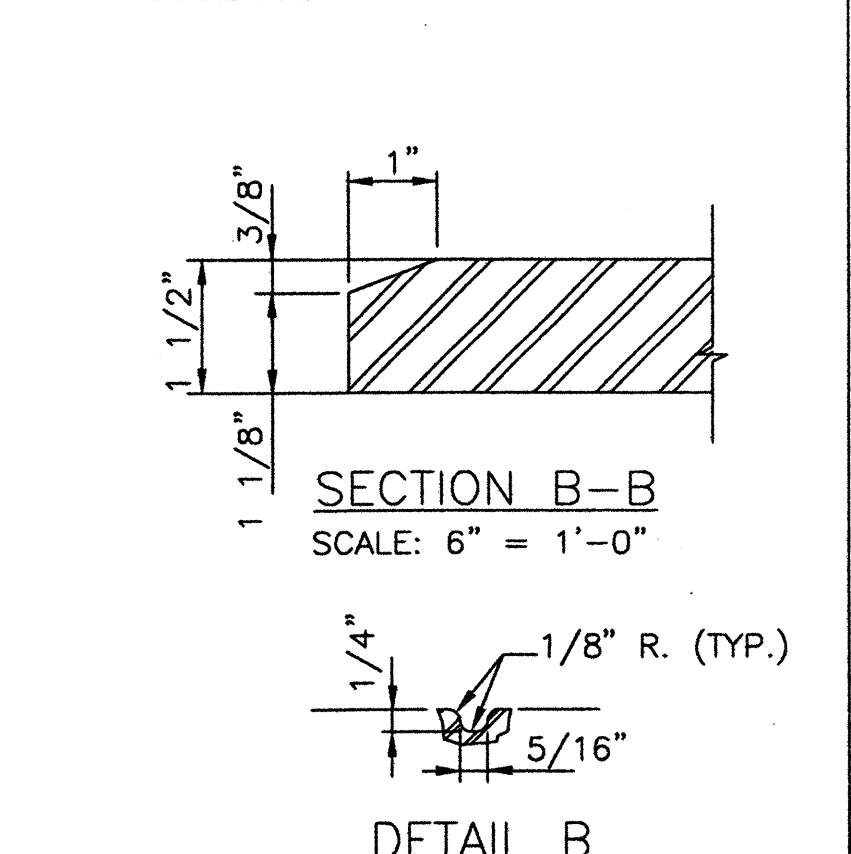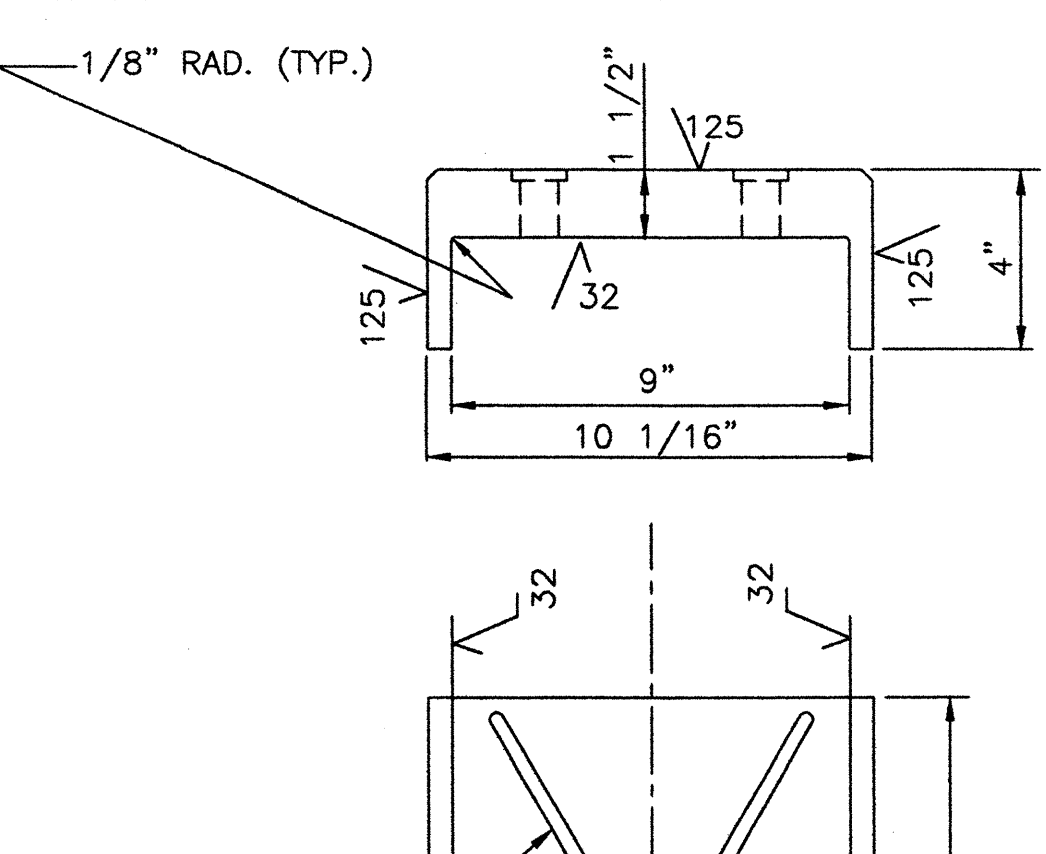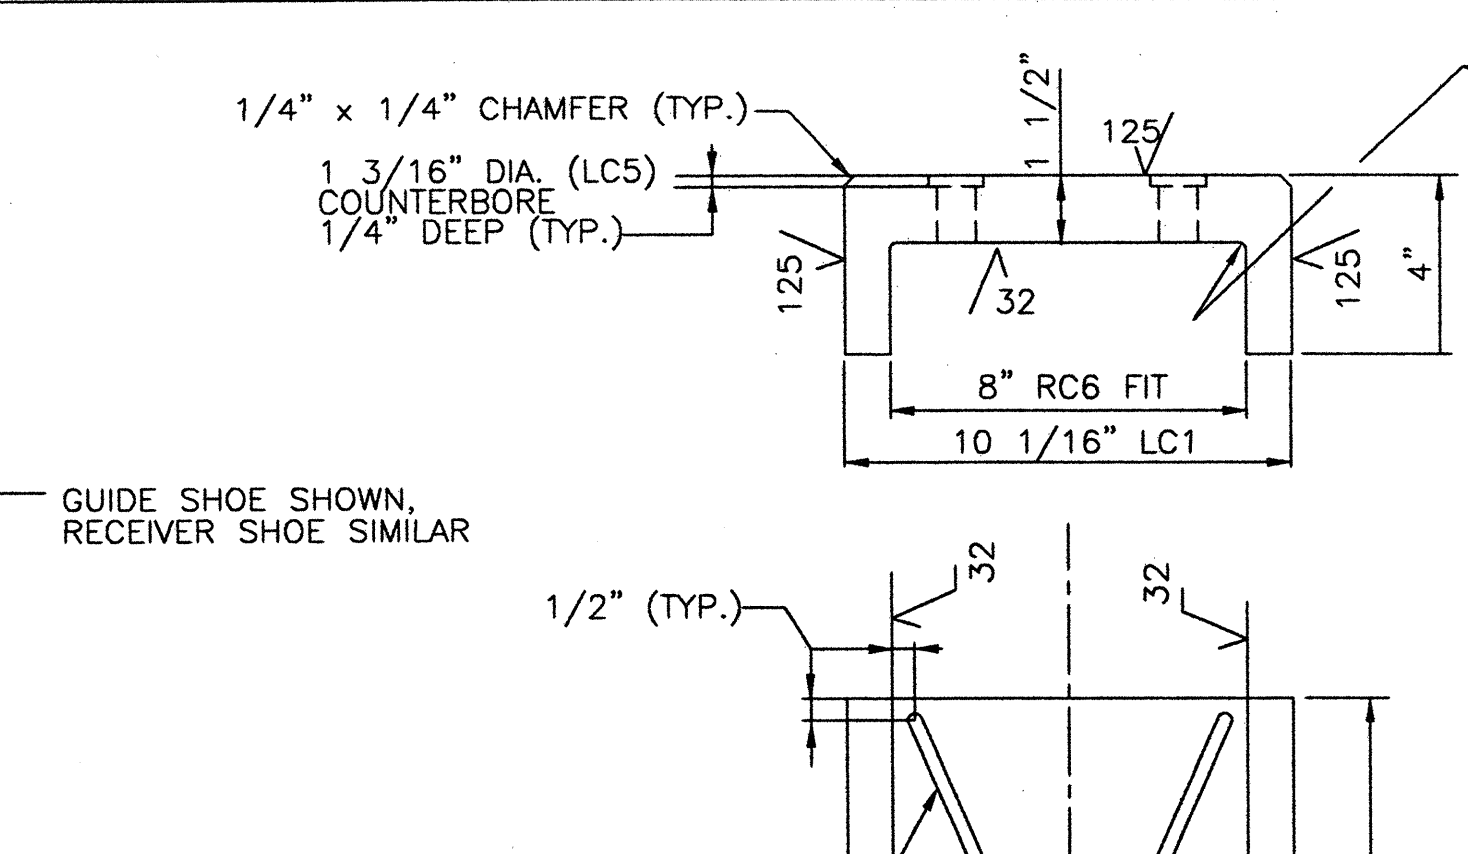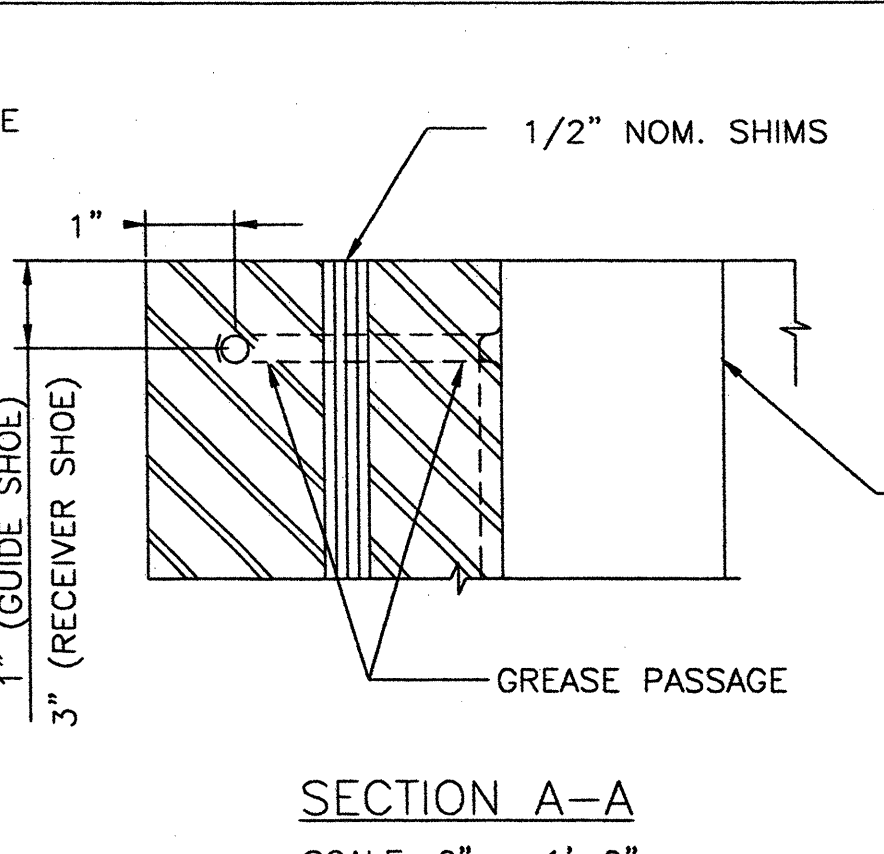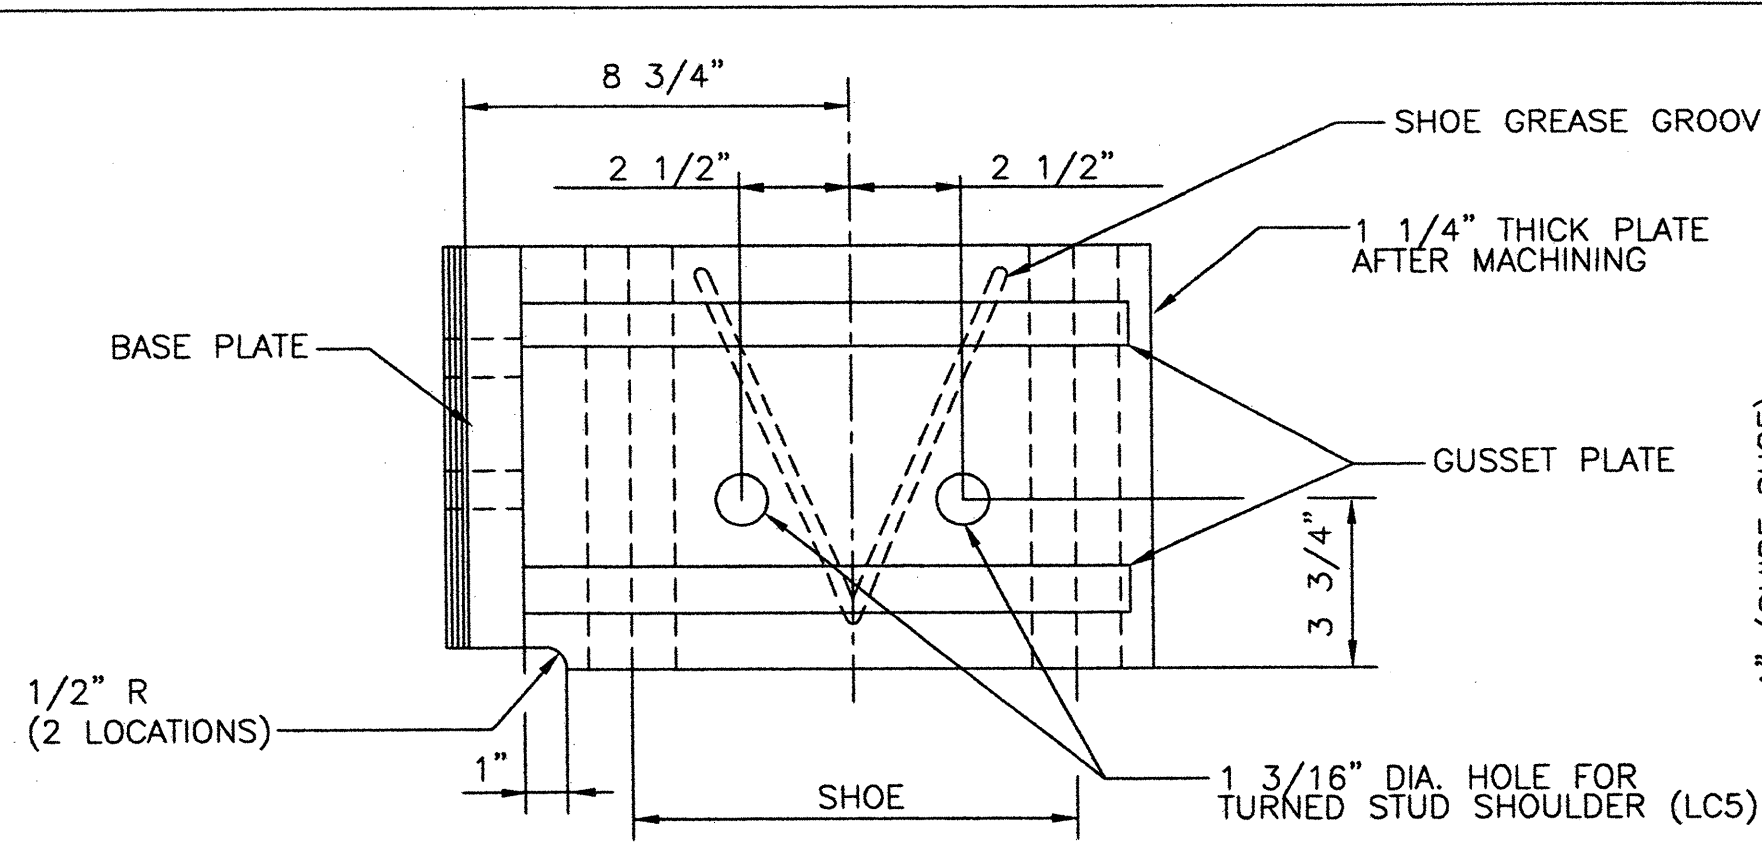

CENTER LOCK GUIDES AND RECEIVER
 SCALE: 3" = 1'-0"
 MATERIAL: ASTM A588, HSLA STEEL

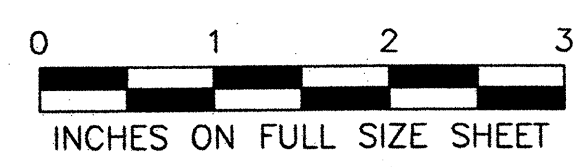


- NOTES:**
- ALL WELDMENTS SHALL BE STRESS RELIEVED BY HEAT PRIOR TO MACHINING.
 - GREASE PASSAGES MUST BE CONNECTED WITH RIGIDLY MOUNTED STAINLESS STEEL TUBING TO GREASE FITTINGS ADJACENT TO MAINTENANCE WALKWAYS AND SECURED AGAINST VIBRATION.
 - ADDITIONAL 1/2" SHIM PLATES MAY BE REQUIRED AT SEVERAL LOCATIONS SUCH AS SOUTH RECEIVER MOUNTING. LONGER MOUNTING BOLTS MAY BE REQUIRED.
 - LOCATION OF MOUNTING HOLES FOR GUIDES AND RECEIVERS SHALL CENTER ON FINAL CENTER LOCK BAR LOCATIONS. NOTE: THERE IS SIGNIFICANT VARIATION IN VERTICAL POSITION FOR EXISTING GUIDES AND RECEIVERS.
 - EIGHT ADDITIONAL 1/8" SHIMS TO BE SUPPLIED FOR EACH GUIDE AND RECEIVER FOR ADJUSTMENT OF THE BASE PLATE AND FUTURE WEAR OF GUIDE AND RECEIVER SHOES.
 - GUIDES AND RECEIVERS SHALL BE ASSEMBLED IN THE SHOP WITH NOMINAL SHIMS TO VERIFY FIT WITH NEW CENTER LOCK BAR.
 - DRILLED AND TAPPED HOLES IN 1 1/4" PLATE NOT TO PENETRATE THE PLATE.
 - PROVIDE DOUBLE NUTS AND HARDENED WASHERS FOR TURNED STUDS.

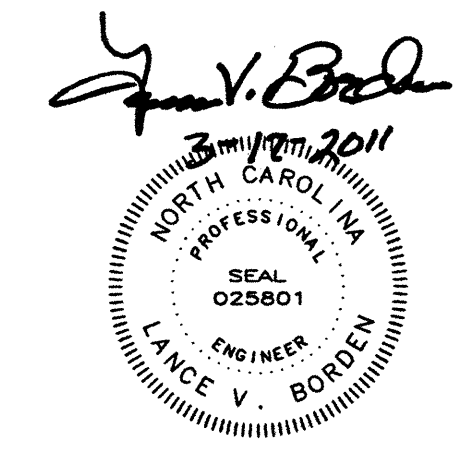


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA NEW CENTER LOCK - GUIDE AND RECEIVER DETAILS			
DESIGNED	D.M. BARRETT	DATE	MARCH 2011
CHECKED	E.A. SAMPLE	DRAWING NO.	6 OF 63


6-MB5-INCL0RD.DWG

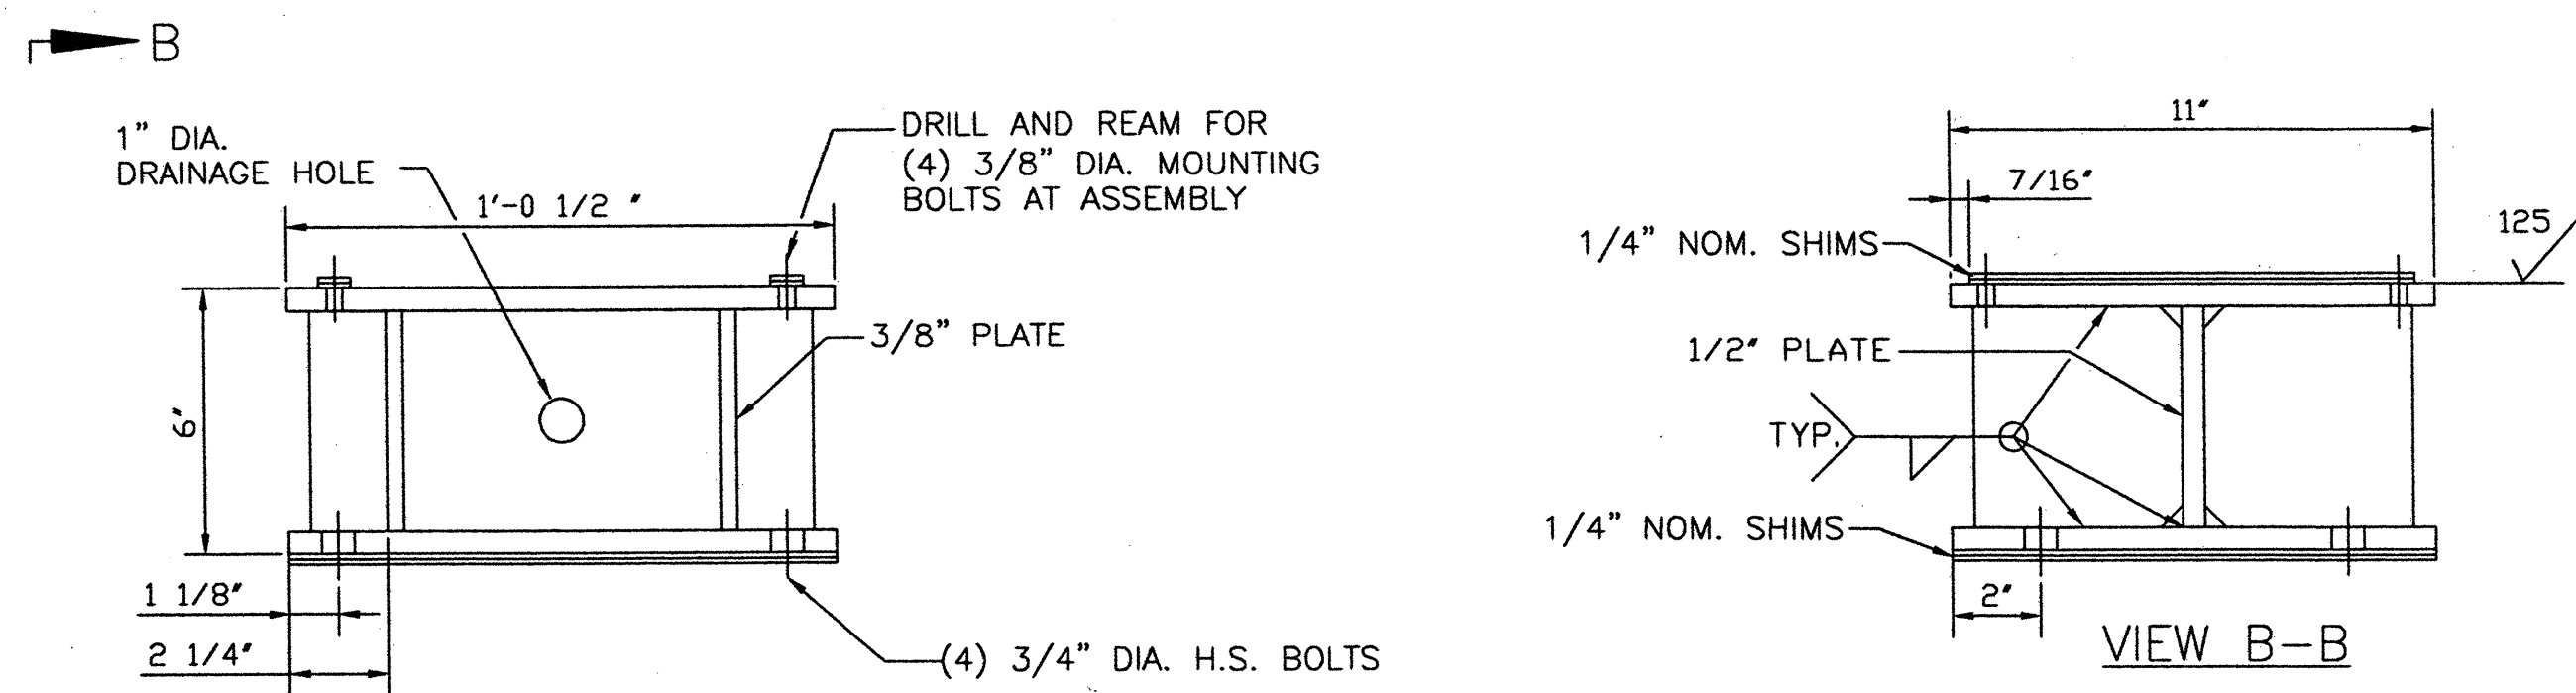


ROTARY CAM LIMIT SWITCH SUPPORT
 SCALE: 3' = 1'-0"
 MATERIAL: ASTM A36
 QUANTITY: 2 TOTAL

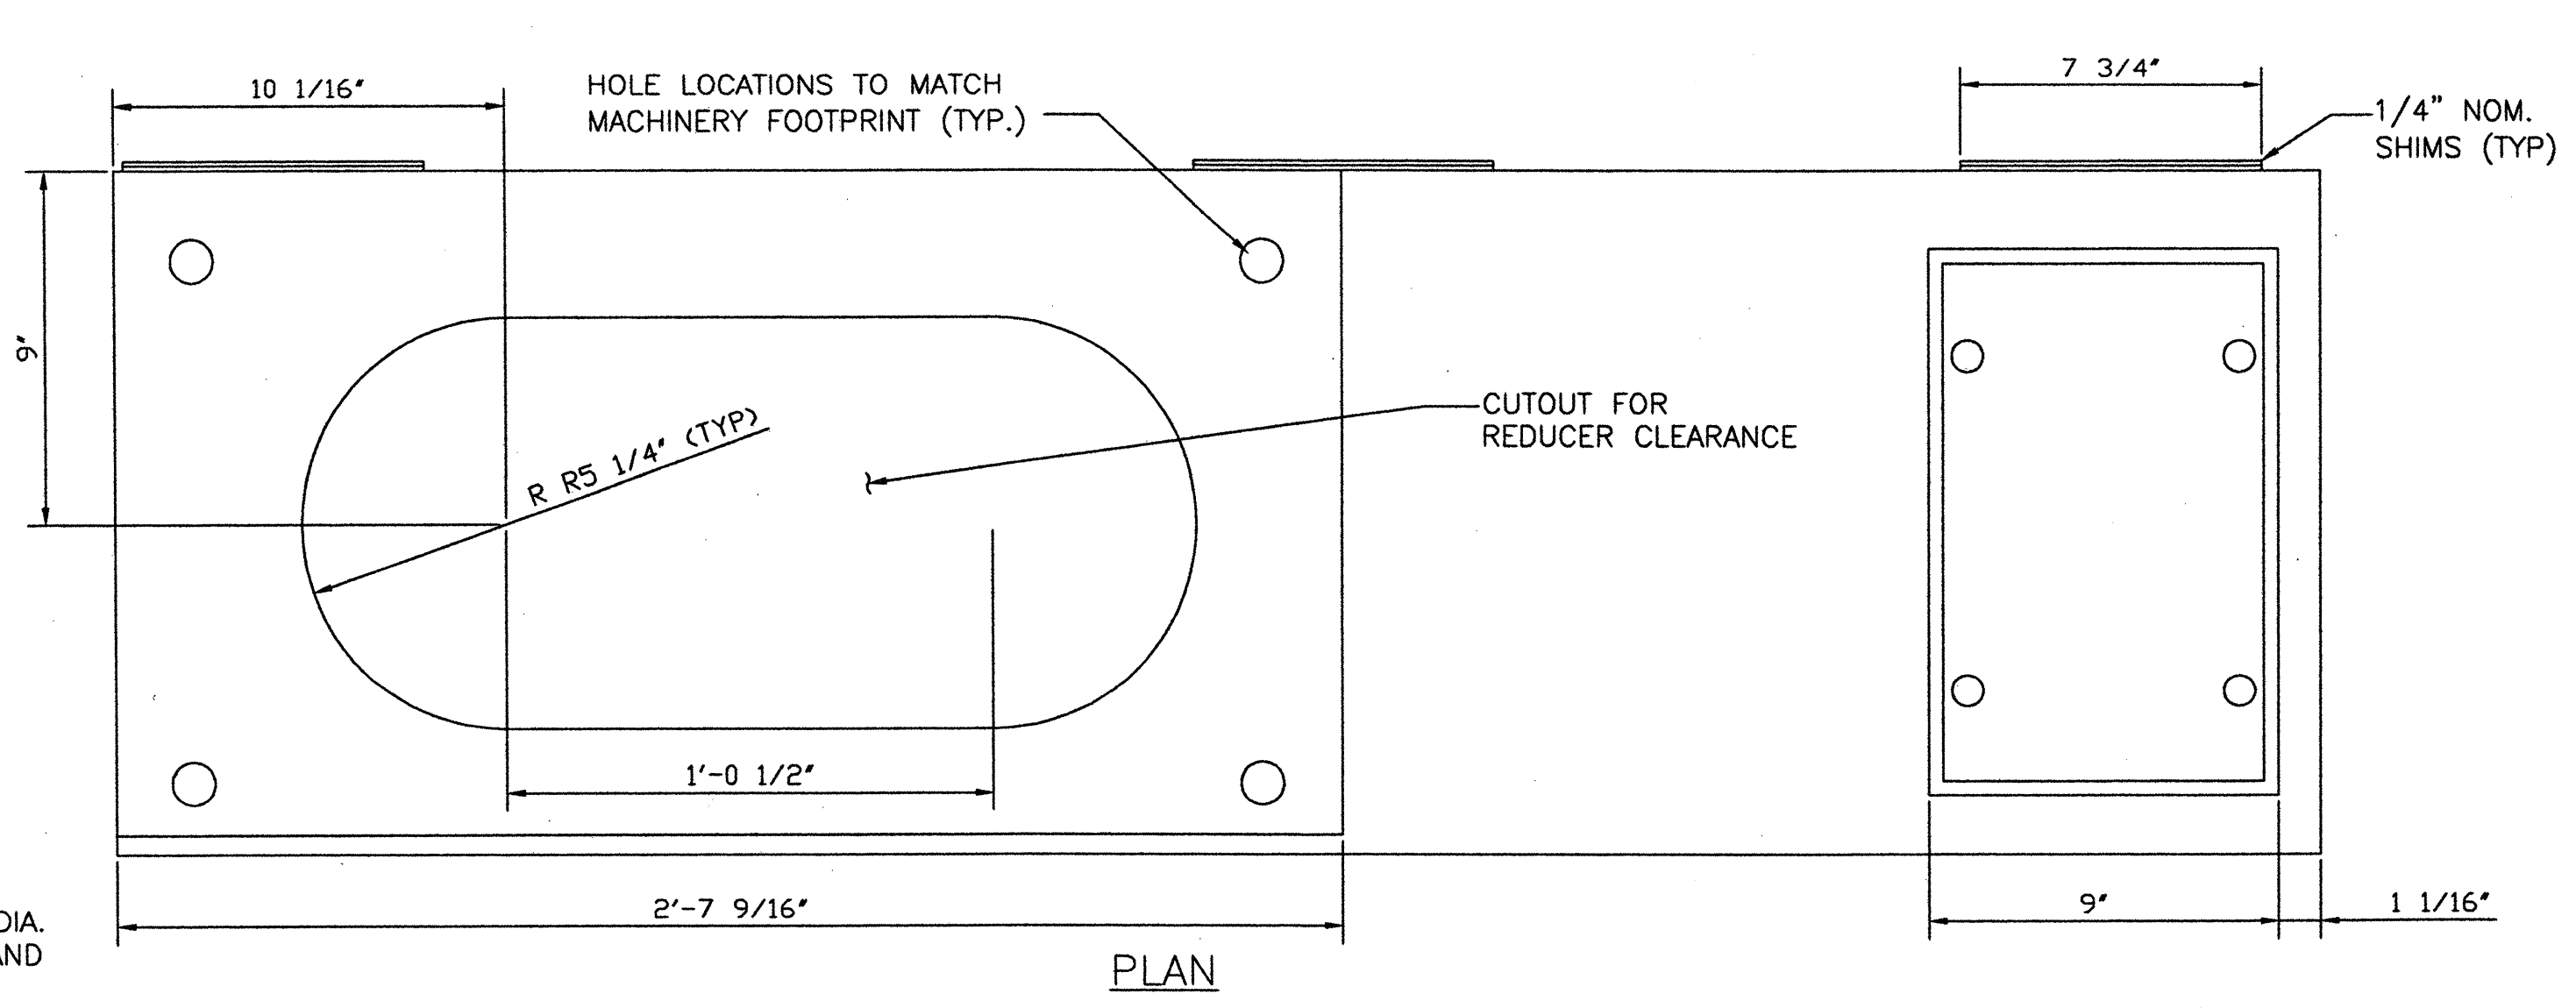

PLAN

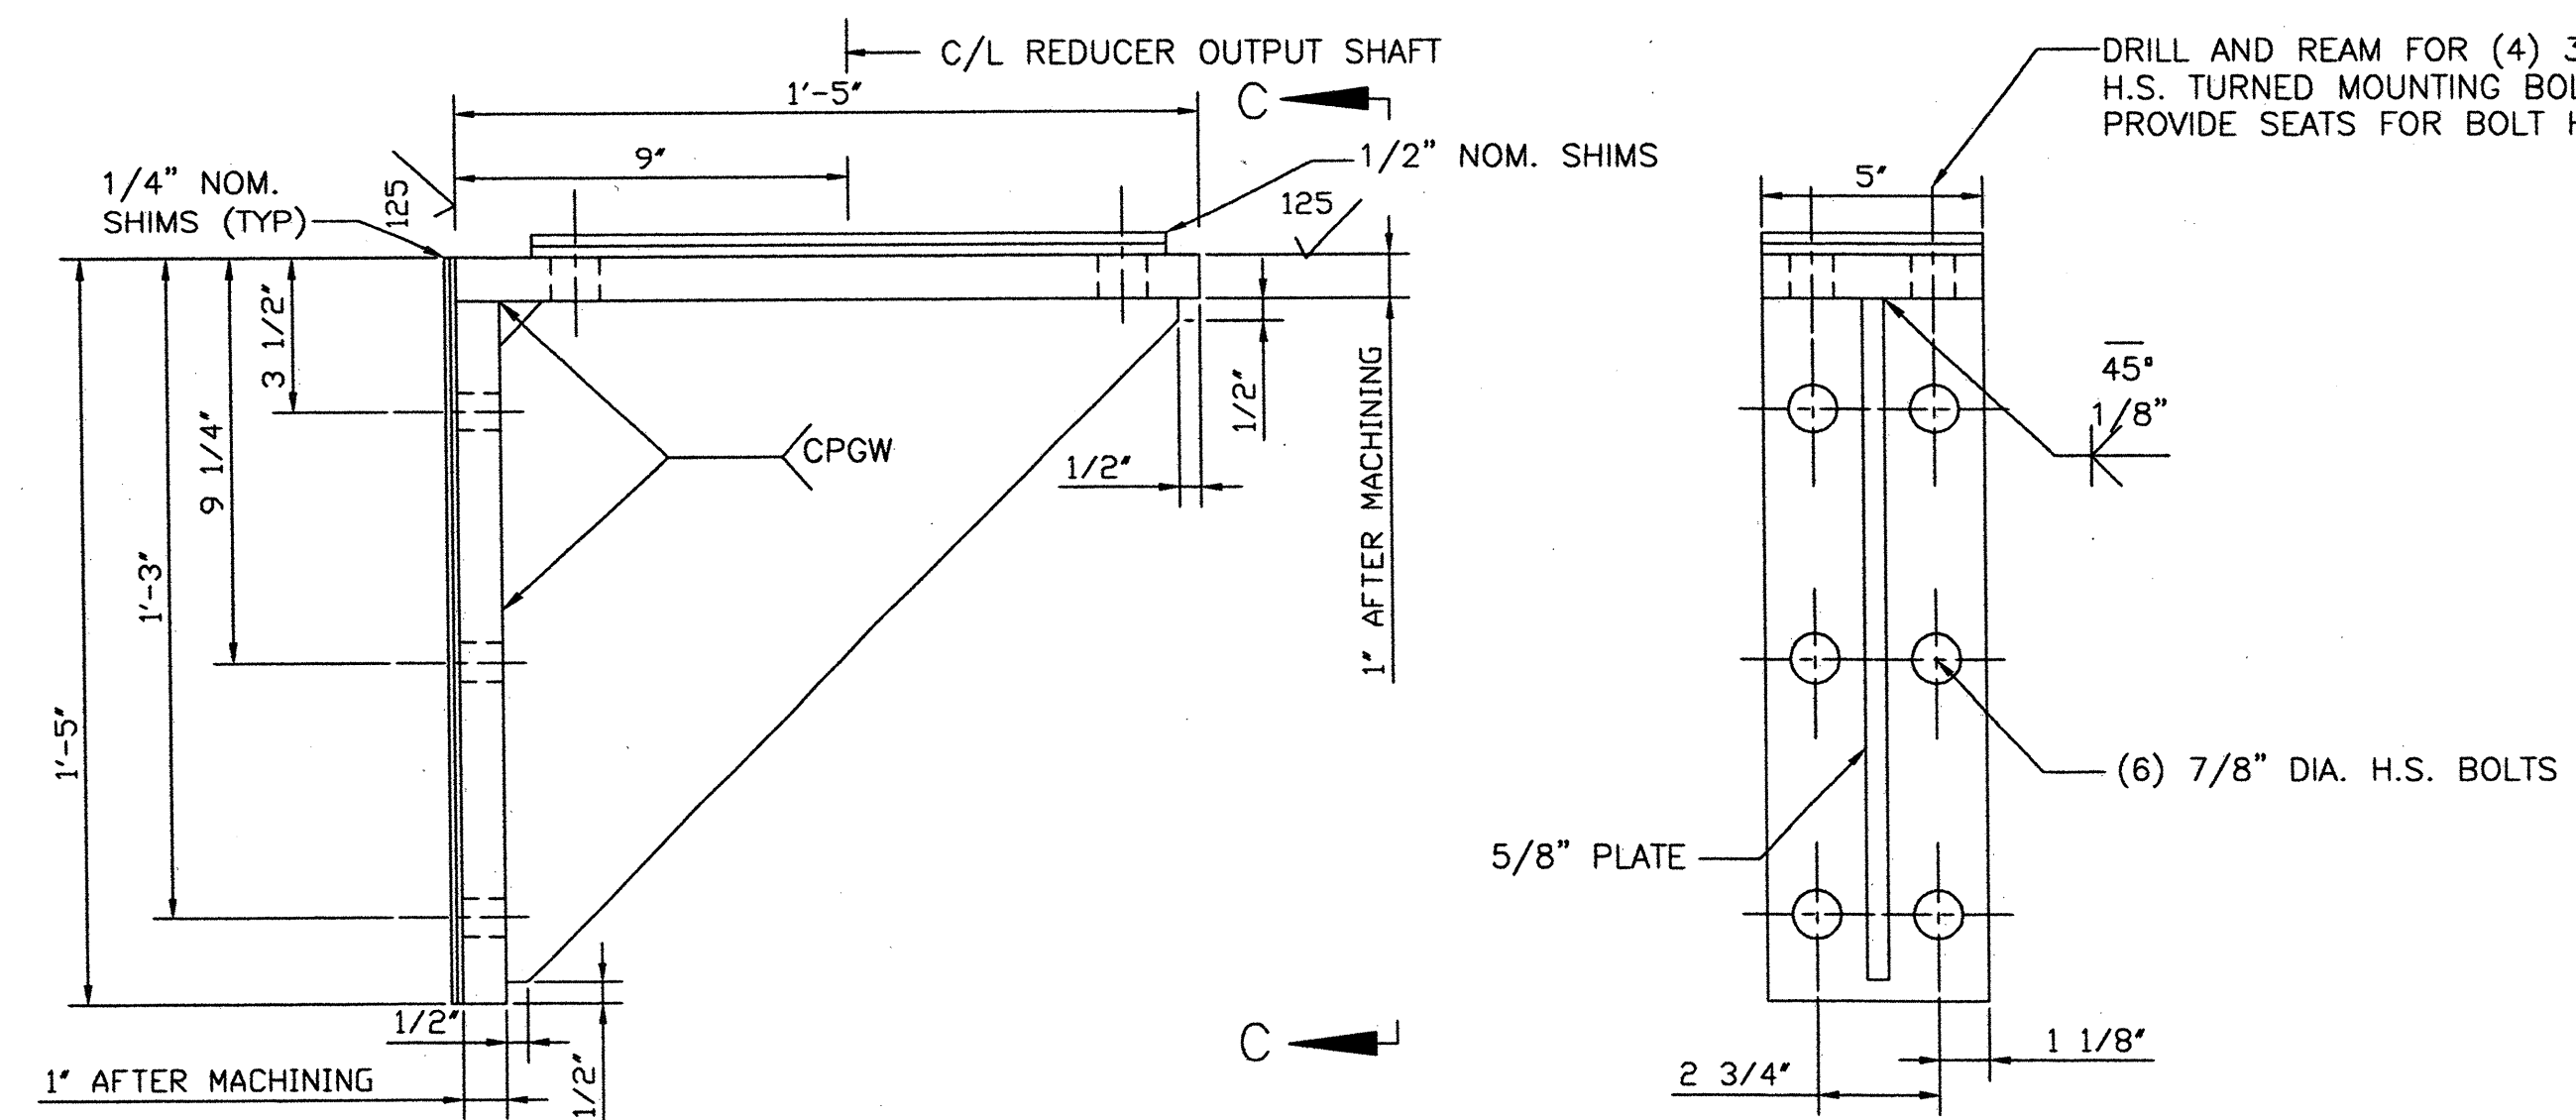


CRANK SHAFT BEARING SUPPORT
 SCALE: 3' = 1'-0"
 MATERIAL: ASTM A588, HSLA STEEL
 QUANTITY: 4 TOTAL

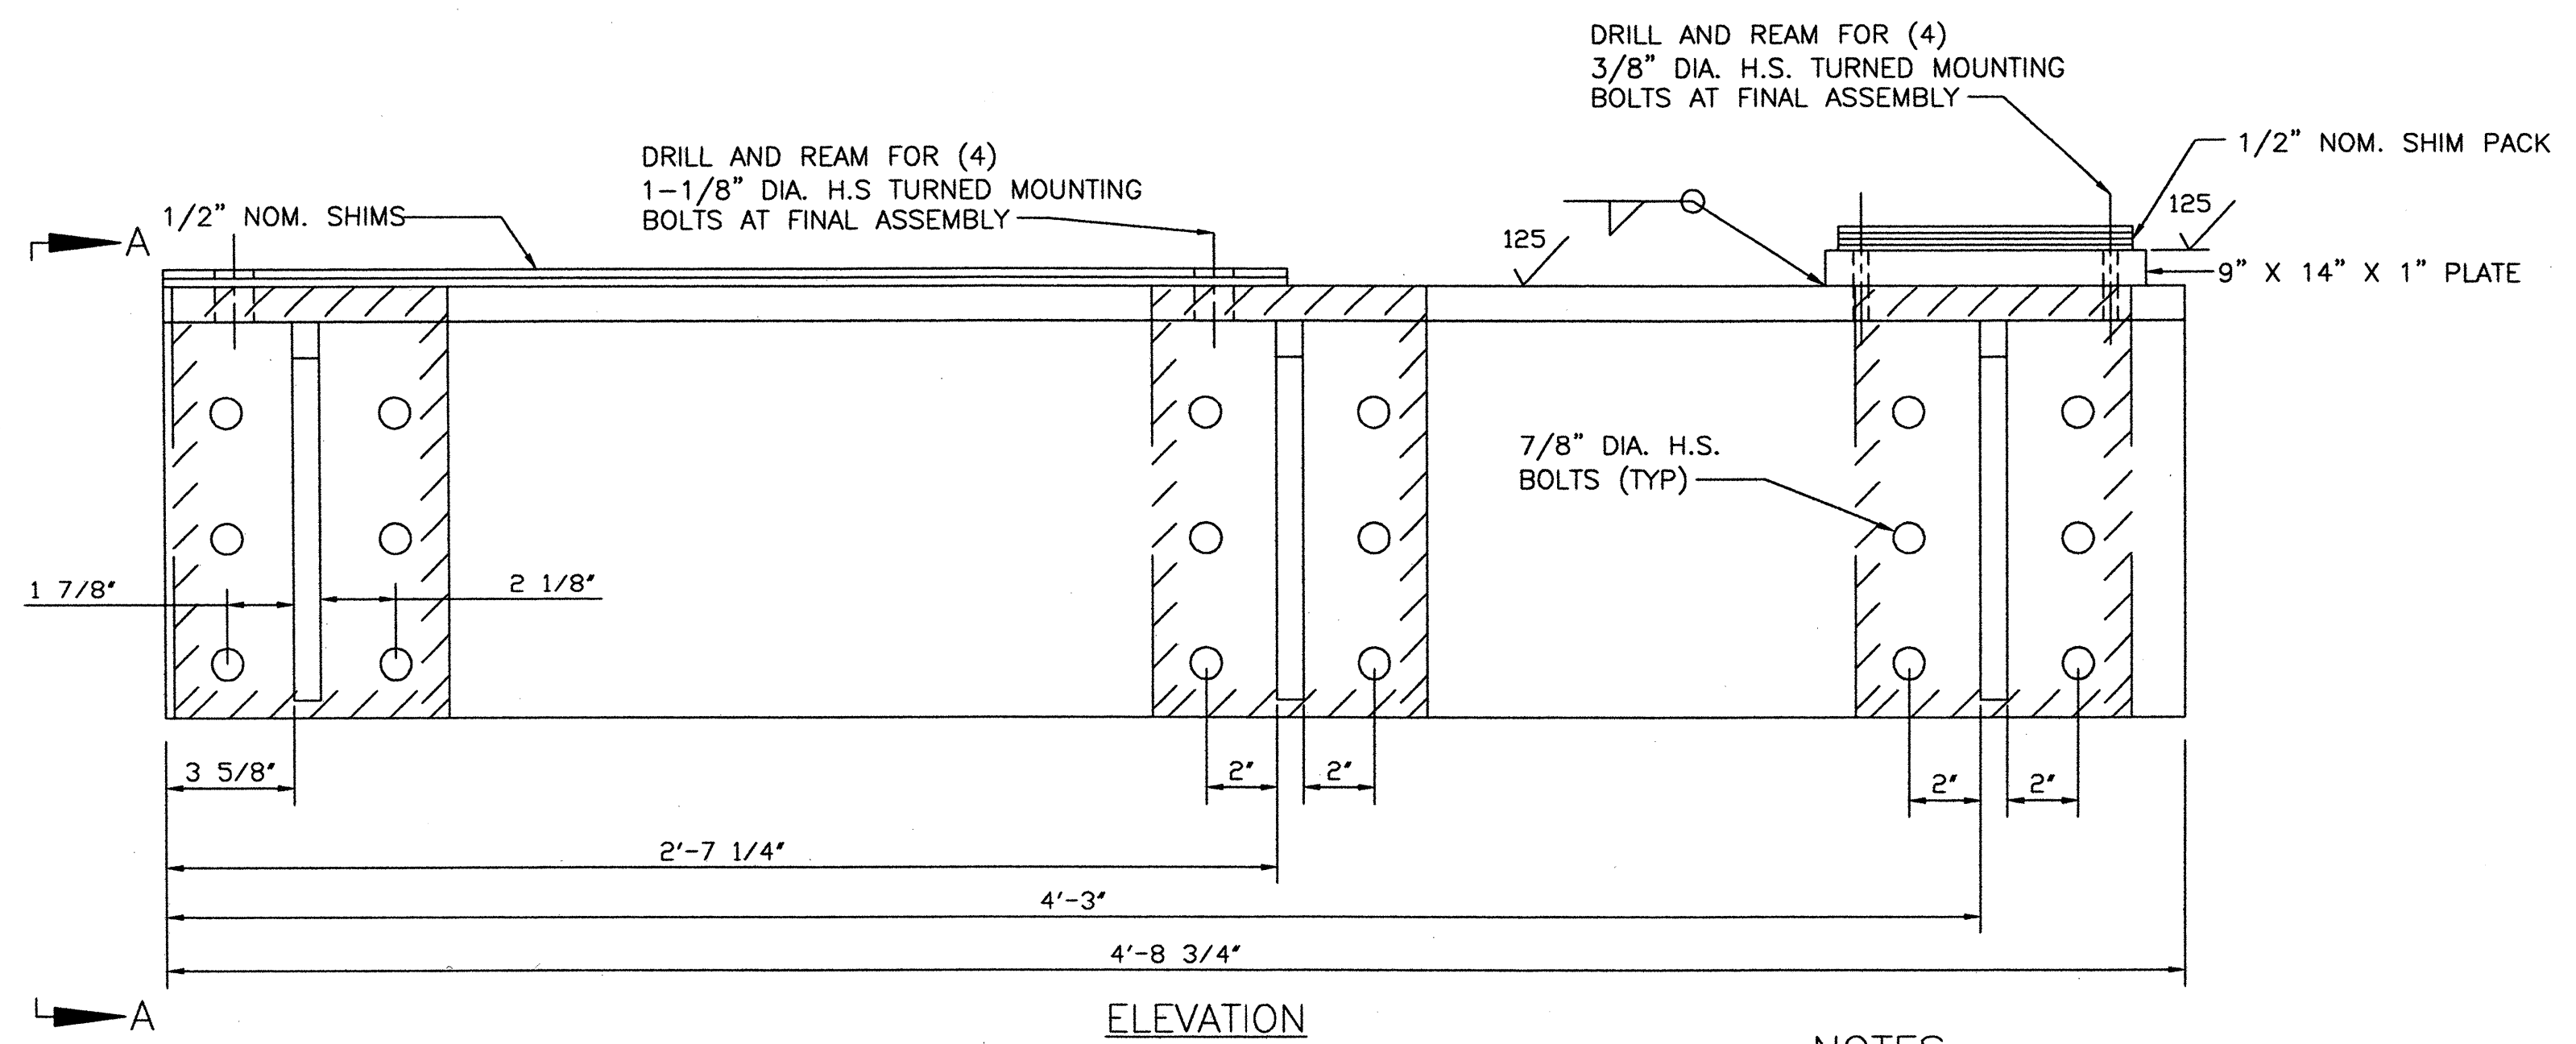



ELEVATION

REDUCER AND BRAKE MOTOR SUPPORT
 SCALE: 3' = 1'-0"
 MATERIAL: ASTM A36
 QUANTITY: 2 TOTAL

NOTES:
 1. ALL WELDMENTS SHALL BE STRESSED RELIEVED BY HEAT PRIOR TO MACHINING.

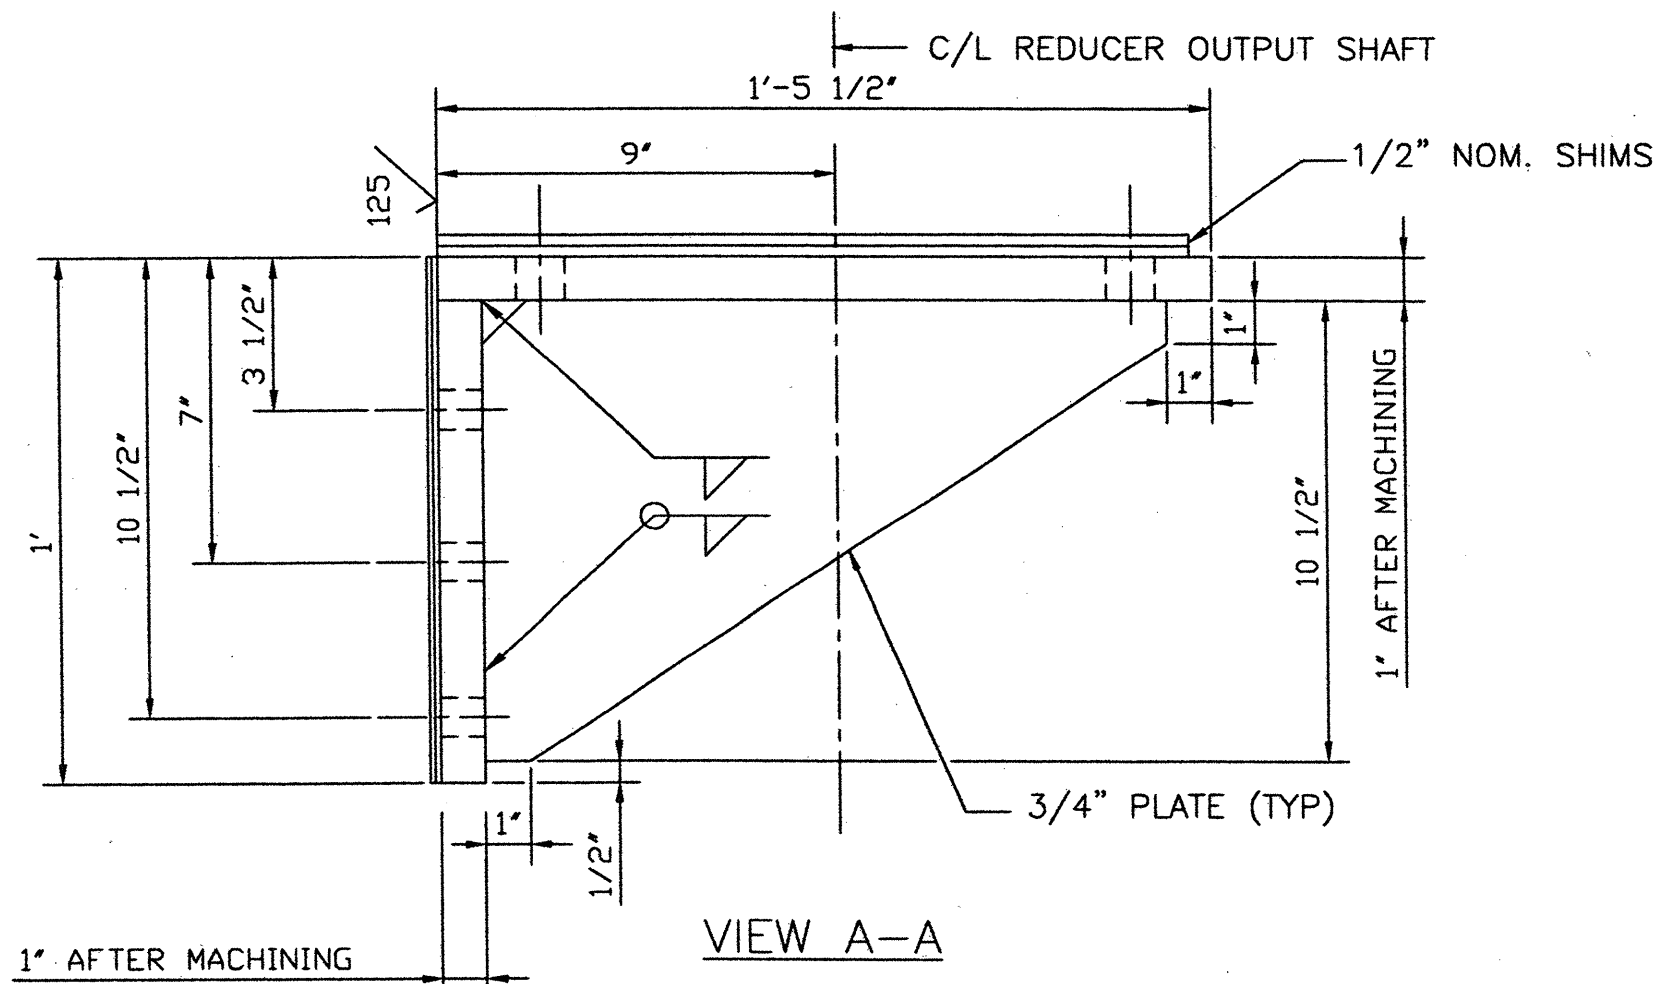


VIEW A-A

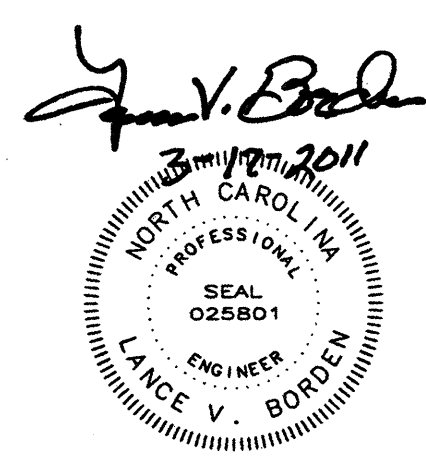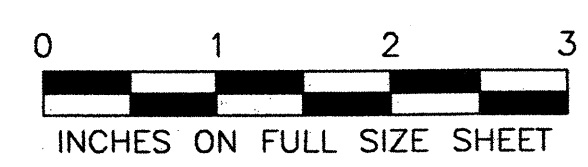

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW CENTER LOCK - SUPPORT DETAILS			
DESIGNED	D.M. BARRETT	DATE	MARCH 2011
CHECKED	E.A. SAMPLE	DRAWING NO.	7 OF 63
DRAWN BY		E.A. RICKENBACH	
SCALE		AS NOTED	
CHECKED		E.A. SAMPLE	

MB6

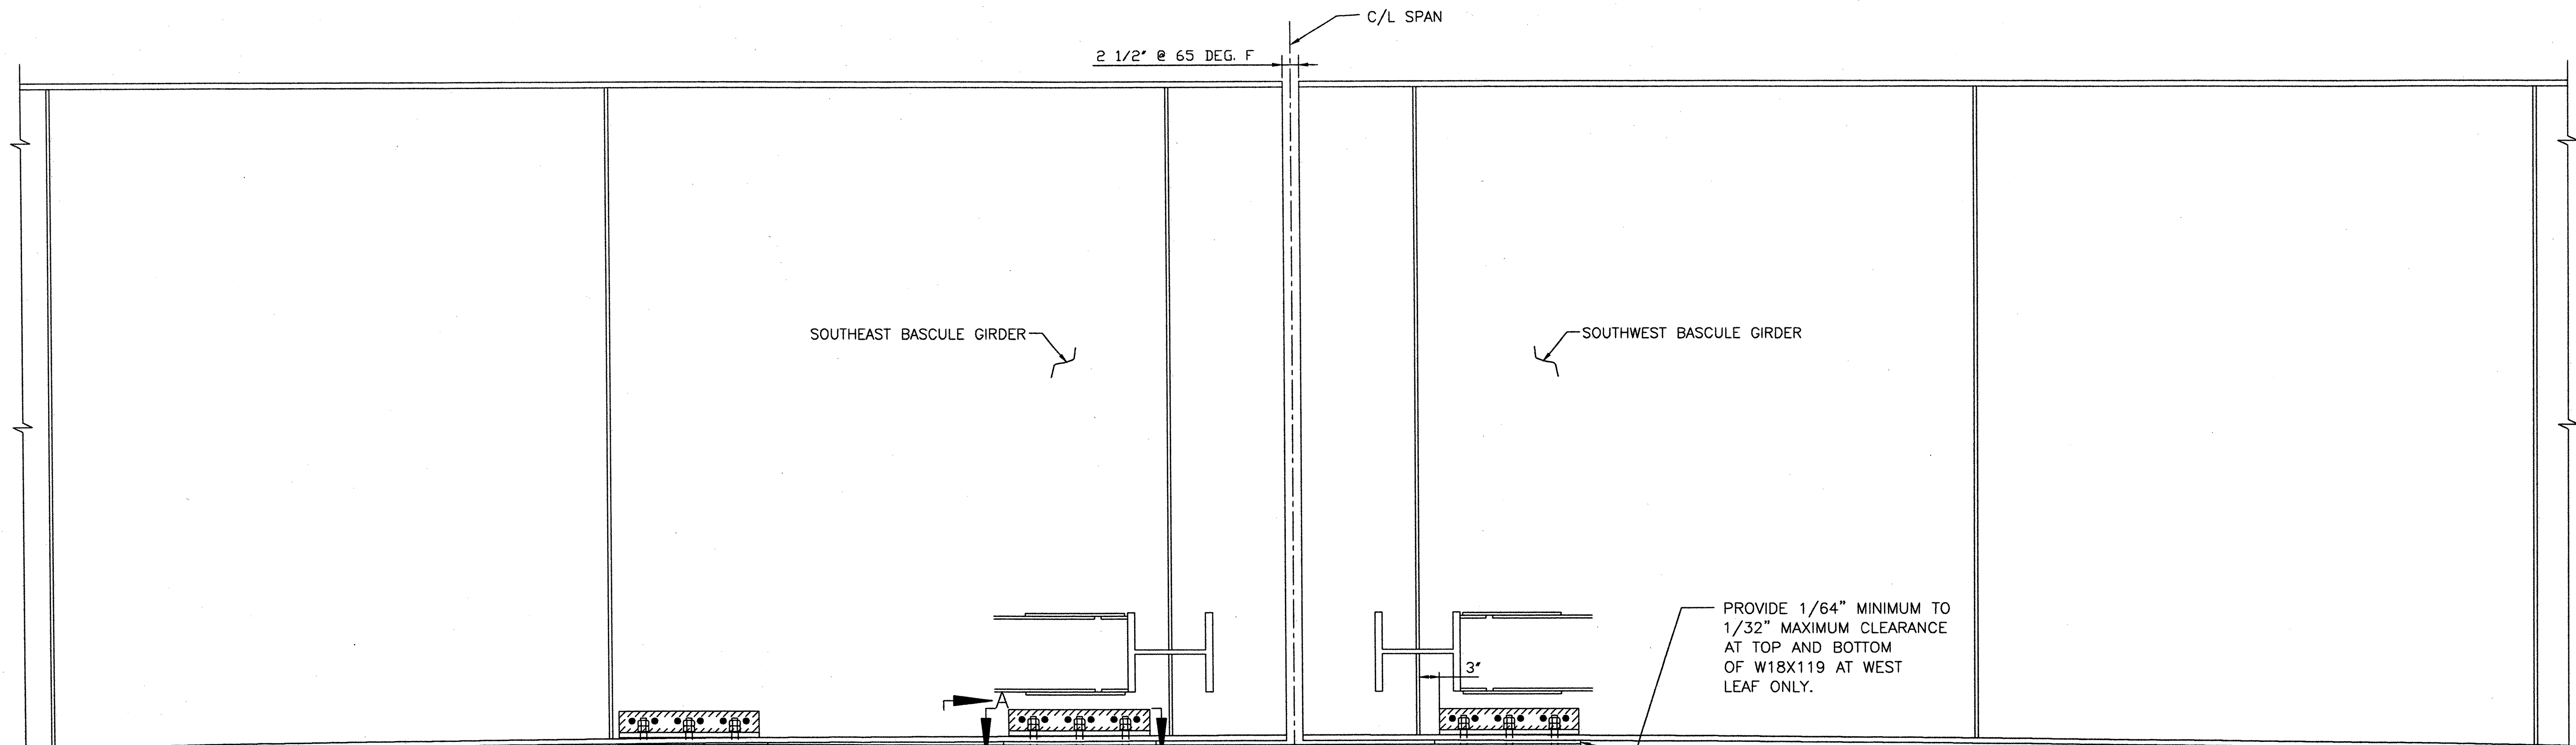

SOUTHEAST BASCULE GIRDER

SOUTHWEST BASCULE GIRDER

C/L SPAN
2 1/2' @ 65 DEG. F

PROVIDE 1/64" MINIMUM TO 1/32" MAXIMUM CLEARANCE AT TOP AND BOTTOM OF W18X119 AT WEST LEAF ONLY.


HOLES FOR 1" DIA. BOLT RODS TO BE LONG SLOTTED HOLES IN W18X119 TO ALLOW FOR THERMAL EXPANSION AT WEST LEAF ONLY.

NEW 1" DIA. BOLT ROD WITH DOUBLE HS NUTS AND HARDENED WASHERS (TYP.)


NEW 1'-10" X 11 1/4" X 1" THICK PLATE WITH HOLES FOR 1" DIA. BOLT RODS.

NOTES:


1. BOLT RODS SHALL BE ASTM F1554 GRADE 55 WITH HS NUTS AND HARDENED WASHERS.
2. ALL BOLTS SHALL BE ASTM A325 WITH HS NUTS AND HARDENED WASHERS.
3. ALL STEEL SHAPES AND PLATES SHALL BE ASTM A572 GRADE 50 OR ASTM A588.
4. THE CONTRACTOR SHALL BE RESPONSIBLE FOR PLACING TRAFFIC CONTROL RESTRICTING VEHICULAR TRAFFIC SPEED TO 30 MPH ON THE BASCULE SPAN WHILE TEMPORARY CENTER LOCKS ARE IN PLACE.
5. UPON COMPLETION OF WORK, REMOVE ALL STEEL SHAPES AND PLATES AND FILL ALL OPEN HOLES WITH NEW PROPER SIZE ASTM A325 BOLTS WITH HS NUTS AND HARDENED WASHERS. REUSING FASTENERS FROM TEMPORARY CENTER LOCK MATERIAL IS NOT PERMITTED.
6. POSITION SLOTS IN W18X119 TO ALLOW FOR THERMAL EXPANSION AND CONTRACTION.

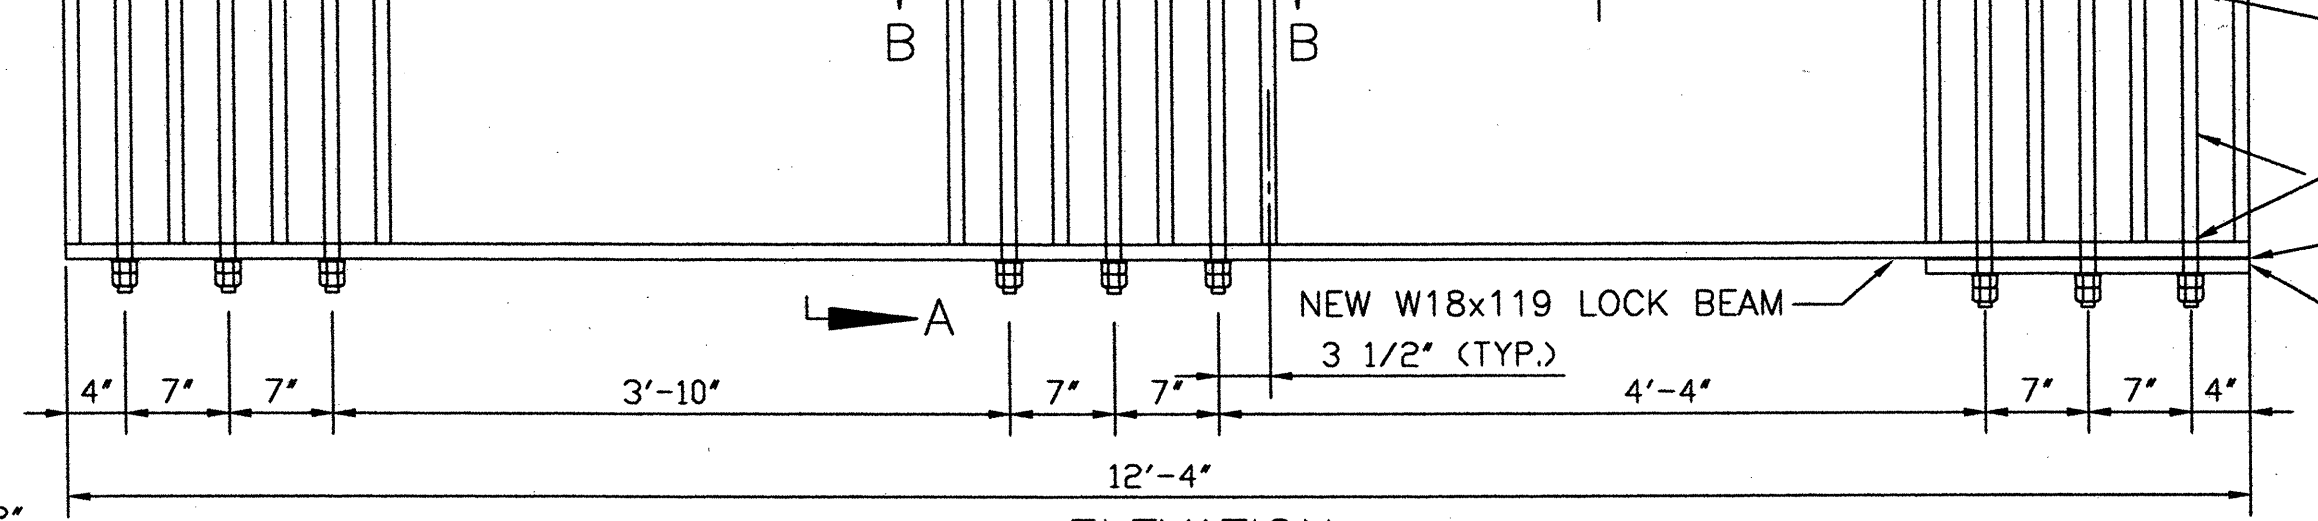



ELEVATION
SCALE 1" = 1'-0"
(FLOORBEAM AND FRAMING NOT SHOWN)
(SOUTH GIRDER SHOWN, NORTH GIRDER SIMILAR)

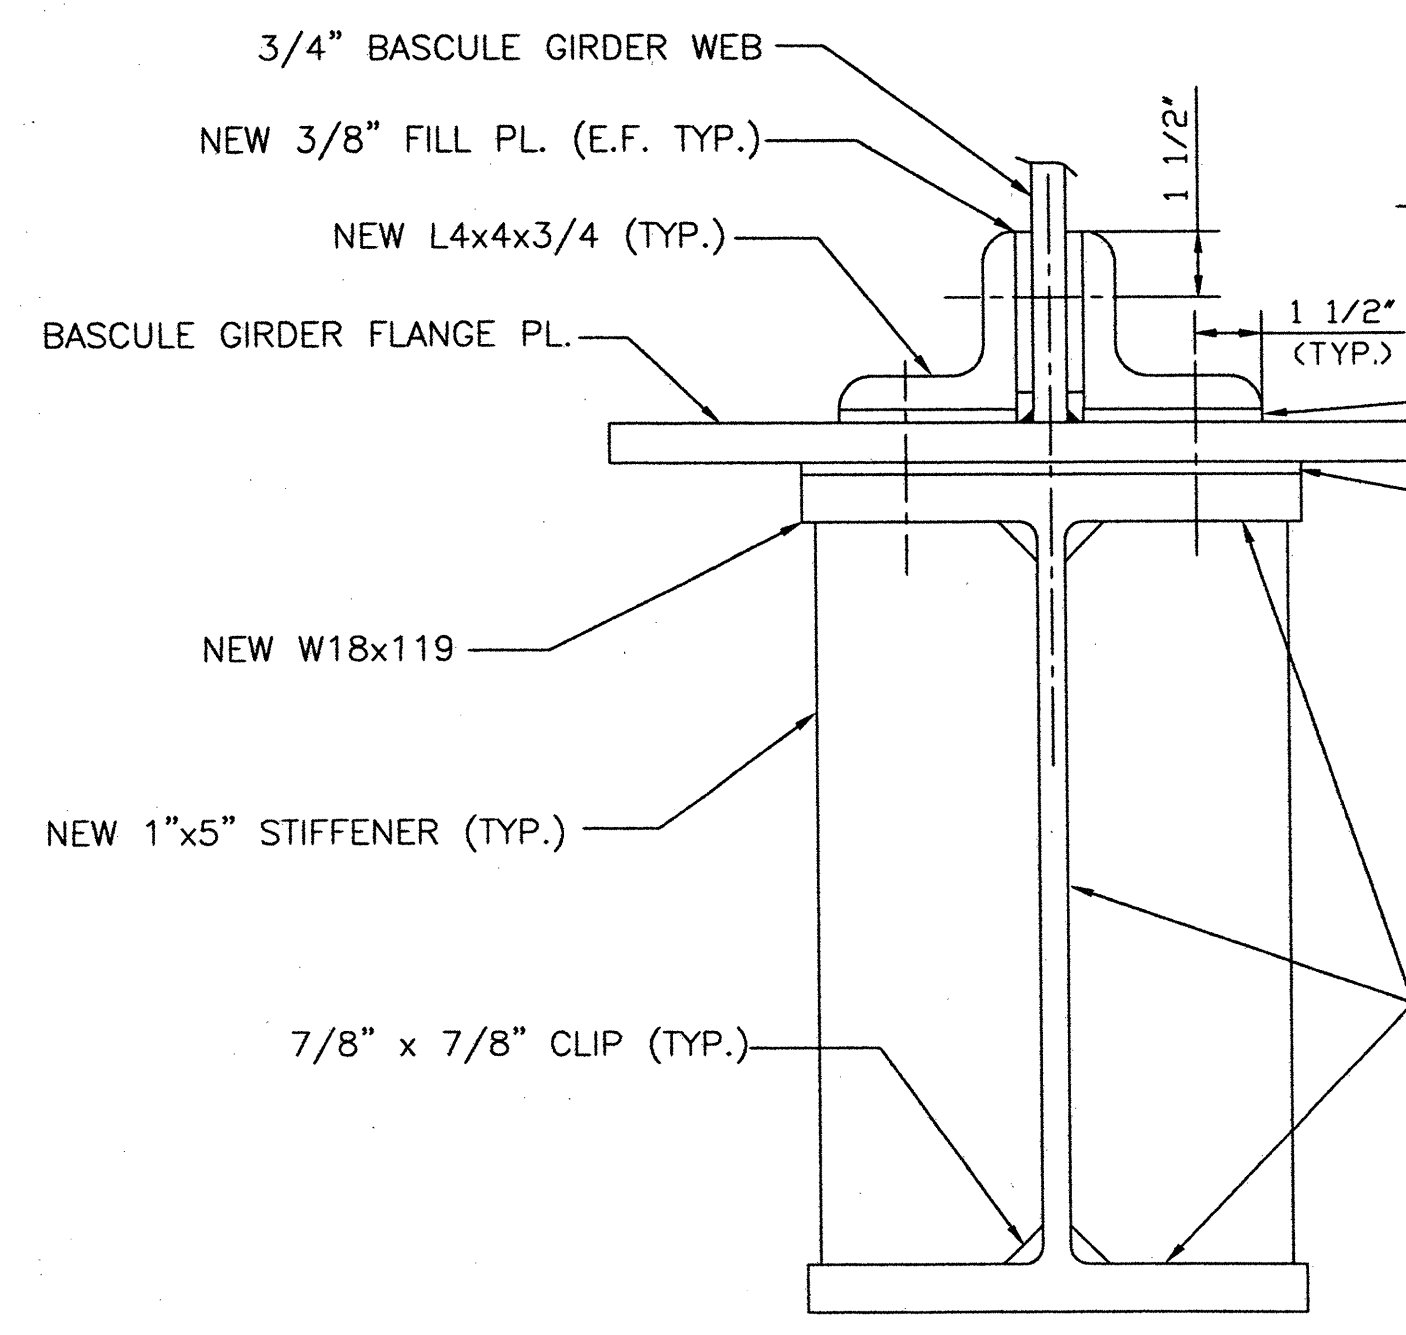

SECTION A-A
SCALE: 3" = 1'-0"

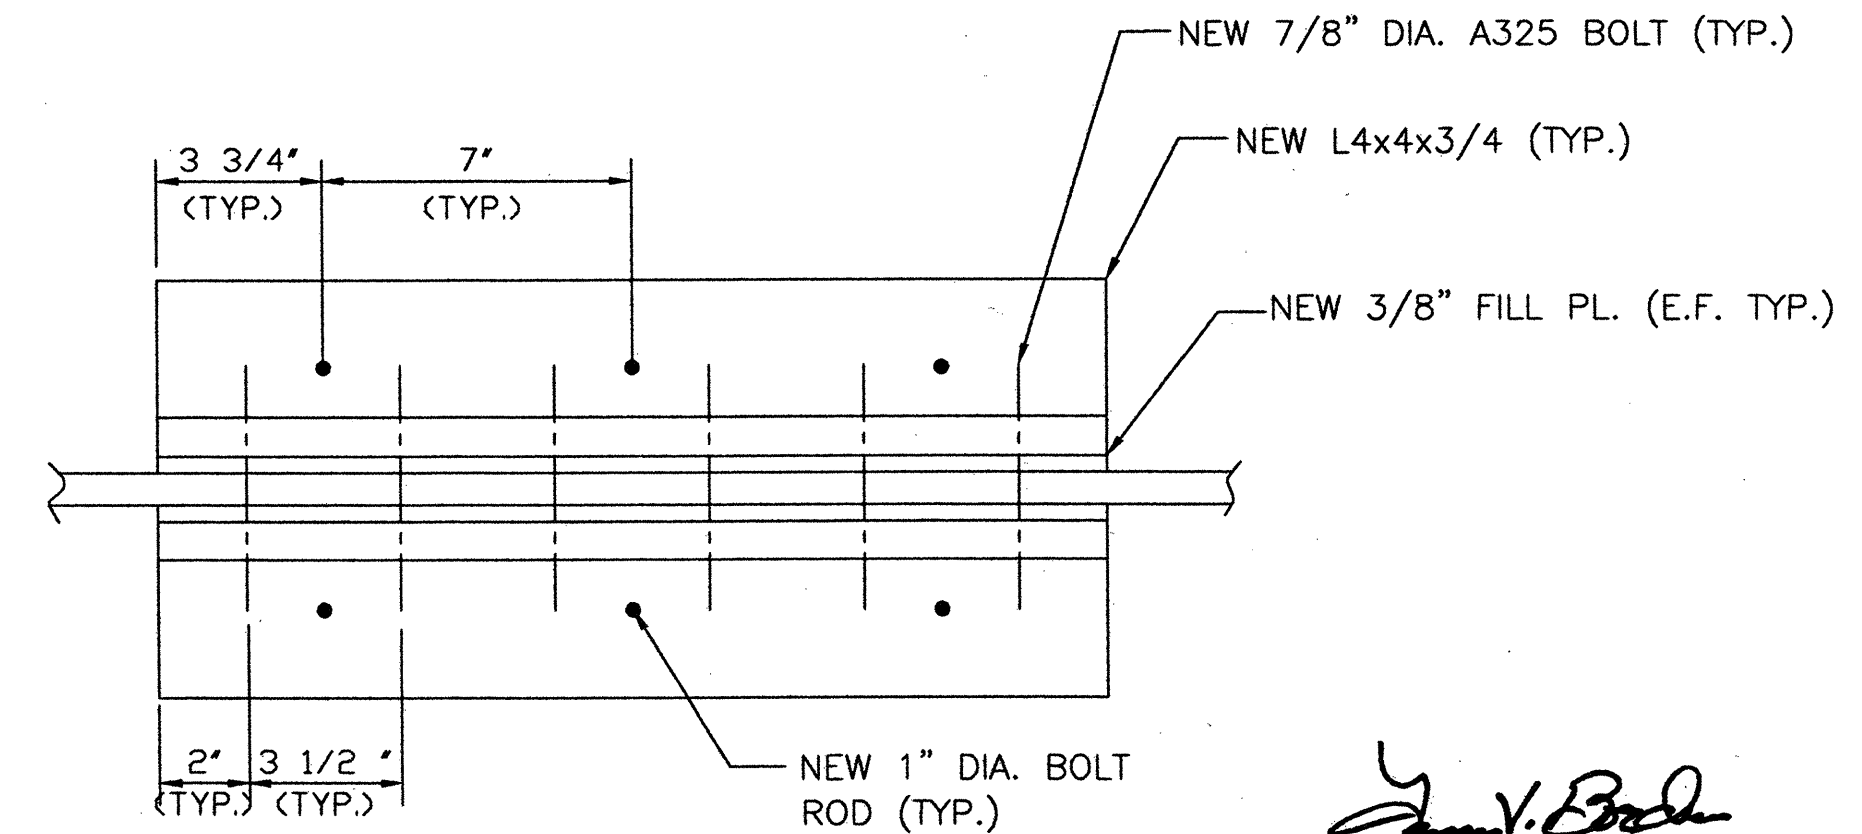


SECTION B-B
SCALE: 3" = 1'-0"

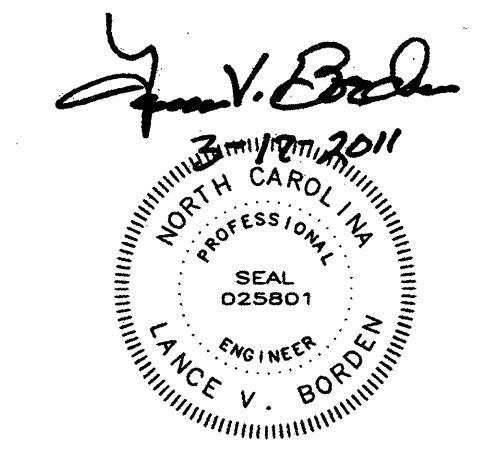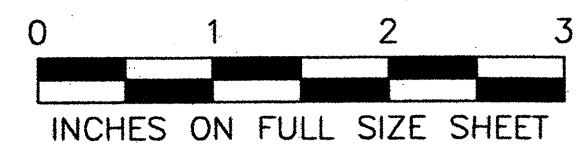

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
TEMPORARY CENTER LOCK			
DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	
DESIGNED D.B. IRWIN	DETAILED D.B. IRWIN	DATE	MARCH 2011
CHECKED A.M. BRODSKY	CHECKED A.M. BRODSKY	DRAWING NO.	B OF 63

B-MB7-TCL.DWG

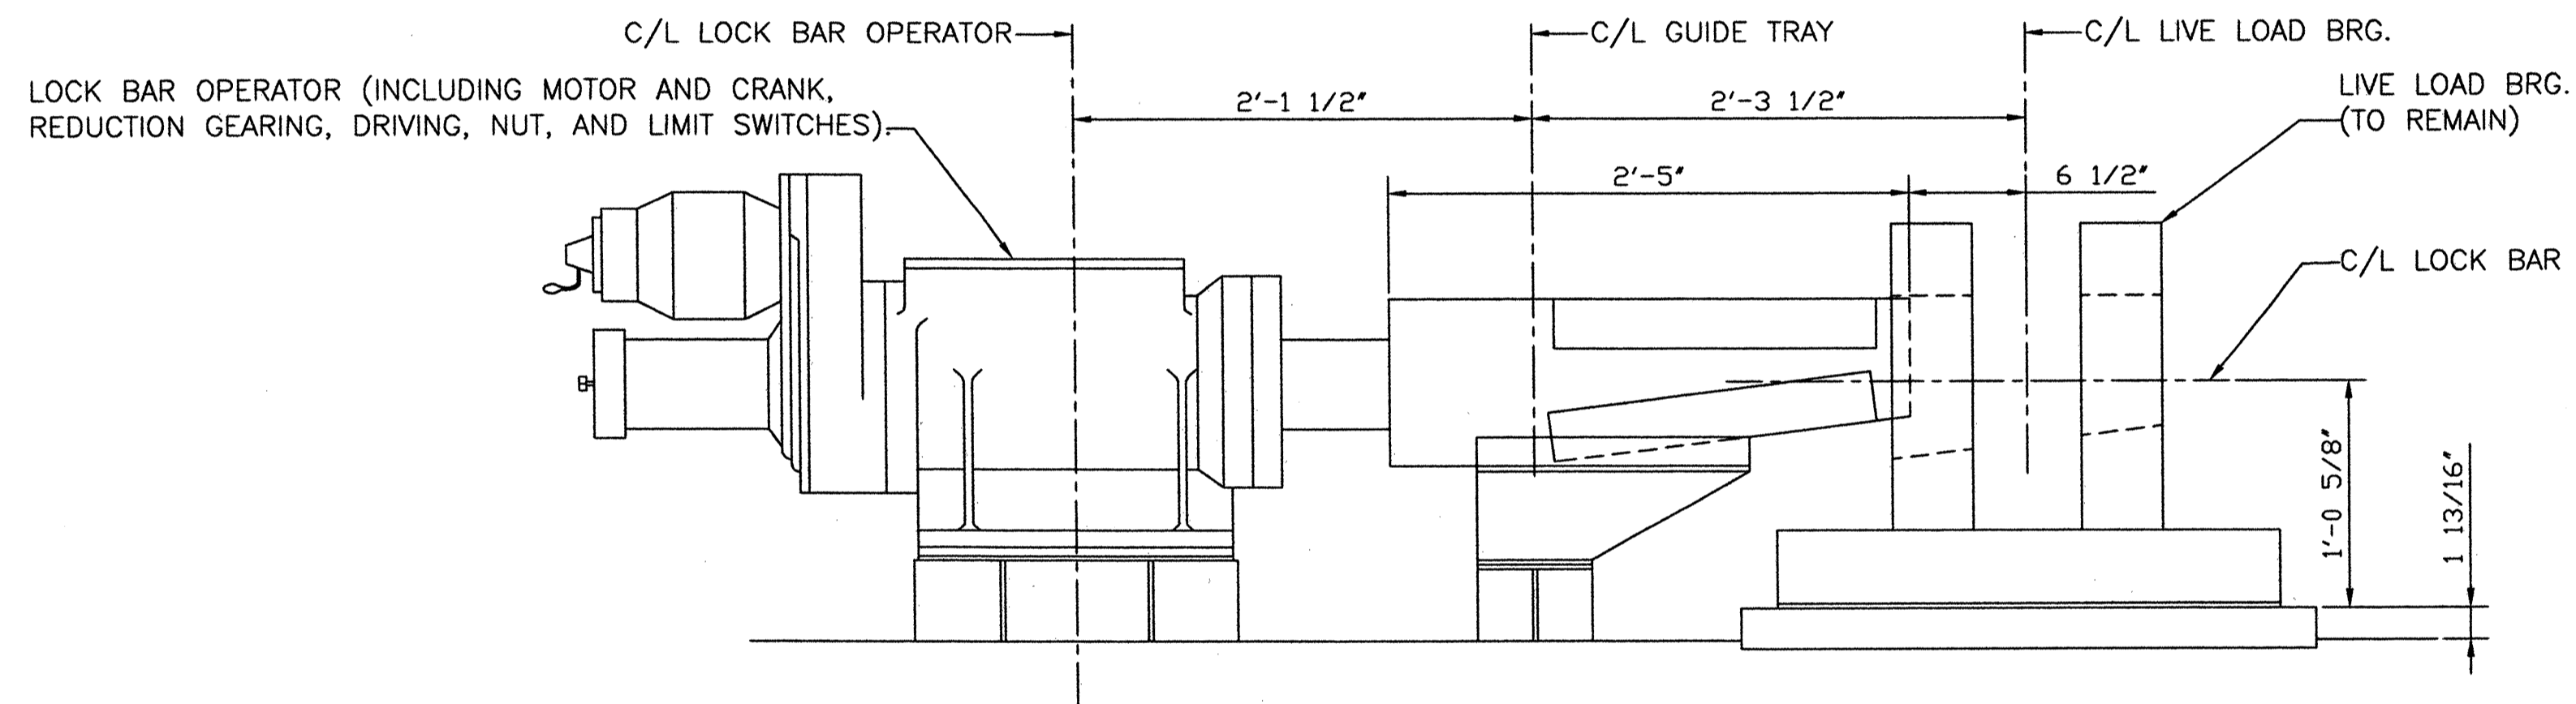


ELEVATION
EXISTING LIVE LOAD SPAN LOCK ASSEMBLY

SCALE: 1 1/2" = 1'-0"


NOTES:

1. ALL EXISTING LIVE LOAD SPAN LOCK COMPONENTS TO BE REMOVED (EXCEPT FOR THE LIVE LOAD BEARINGS).

9-MB-ELLSR.DWG

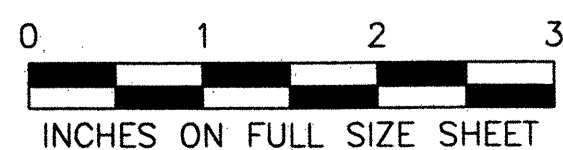

INCHES ON FULL SIZE SHEET

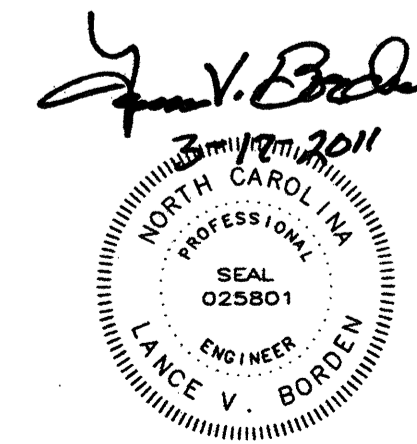

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH


CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
EXISTING LIVE LOAD SPAN LOCK
REMOVAL

DESIGNED	D.M. BARRETT	DETAILED	D.M. BARRETT	DATE	MARCH 2011
CHECKED	G.L. FOREST	CHECKED	G.L. FOREST	DRAWING NO.	9 OF 63

MB8

DRAWN BY E.A. RICKENBACH
SCALE AS NOTED



MACHINERY SCHEDULE			
MACH'Y NO.	NO. REQ'D.	UNIT DESCRIPTION	SHEET NO.
1	5 (1 SPARE)	NEW LIVE LOAD SPAN LOCK ACTUATOR, BY RACO INTERNATIONAL, SIZE 7, WITH 1800 RPM TENV GEARMOTOR, BRAKE, LATERAL ACCESSORY HOUSING D, STROKE OF 15.7 INCHES AT 1.9 IN/SEC. WITH 6750 LBS. NOMINAL THRUST, AND OVERSTROKE PROTECTION AND TWO PAIRS OF ADJUSTABLE STROKE LIMIT SWITCHES.	MB13
2	4	NEW TRUNNION BRACKETS BY RACO INTERNATIONAL	MB13
3	4	NEW PIN.	MB10
4	4	NEW TRUNNION BRACKET SUPPORT	MB14
5	8	NEW LIVE LOAD SPAN LOCK BAR.	MB10
6	4	NEW LIVE LOAD SPAN LOCK GUIDE AND SUPPORT.	MB12
7	4	REMACHINED LIVE LOAD BEARING.	MB11

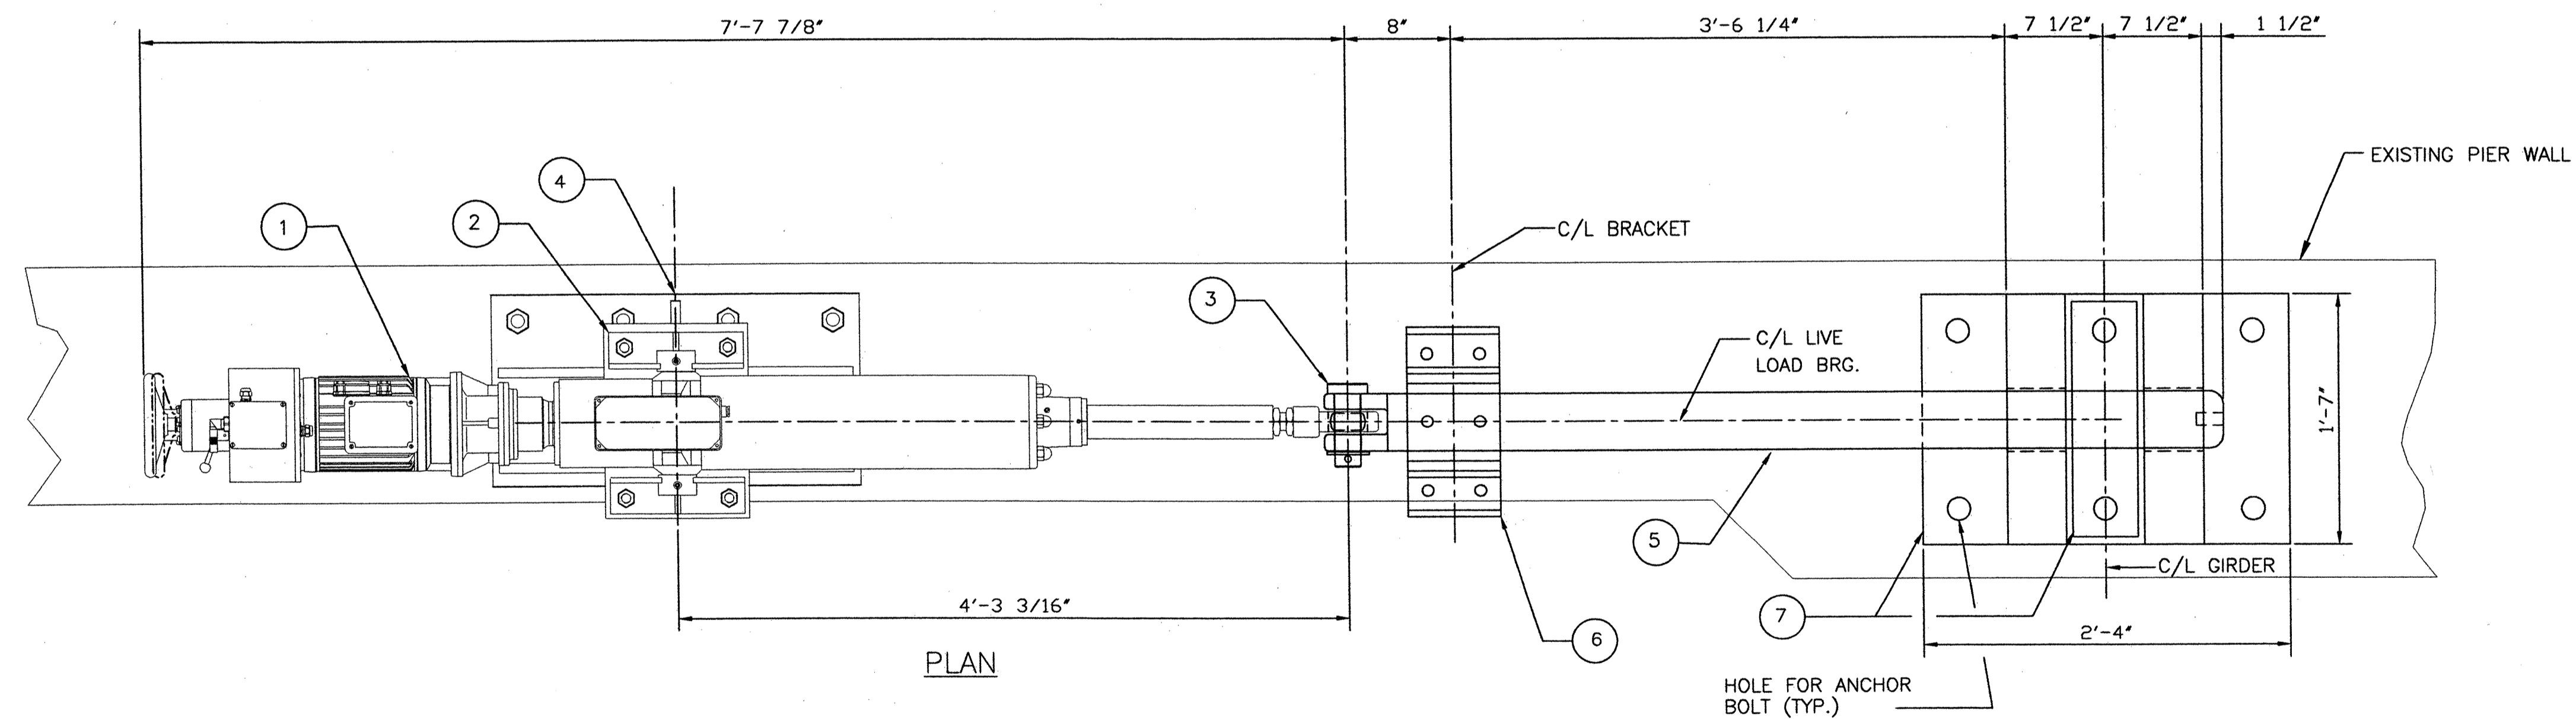

LIVE LOAD SPAN LOCK LAYOUT
 SCALE: 1 1/2" = 1'-0"
 PLAN VIEW - NE OR SW SHOWN,
 NW AND SE OPPOSITE HAND.



NOTES:

1. PROVIDE STAINLESS STEEL DEBRIS COVERS TO COMPLETELY COVER TOP OF NEW LIVE LOAD SPAN LOCK BAR, SIMILAR TO EXISTING COVERS.
2. THE LOCATION OF THE TRUNNION BRACKET POSITIONS THE REQUIRED STROKE IN THE CENTER OF THE AVAILABLE STROKE.
3. THE CONTRACTOR SHALL PROVIDE AN ACCESS LADDER FOR EACH LIVE LOAD SPAN LOCK ACTUATOR. THE LADDER SHALL BE INSTALLED ONLY AFTER THE LOCATION AND LADDER STYLE HAVE BEEN APPROVED BY NCDOT.
4. THE ACTUATOR LOCATION IS WITH 2" OF RESERVE STROKE. THE LOCK BAR IS SHOWN IN THE DRIVEN POSITION.

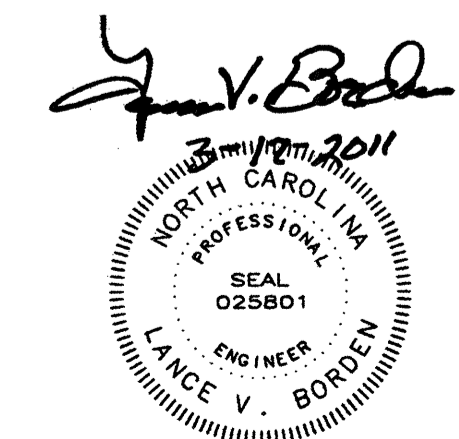
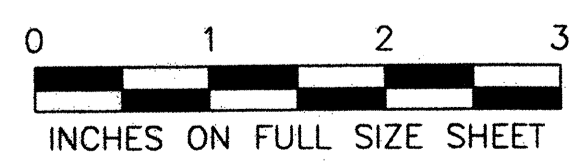


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW LIVE LOAD SPAN LOCK - LAYOUT			
DRAWN BY E.A.RICKENBACH		SCALE AS NOTED	
DESIGNED D.M. BARRETT	DETAILED D.M. BARRETT	DATE MARCH 2011	DRAWING NO. 10 OF 63
CHECKED L.V. BORDEN	CHECKED L.V. BORDEN		

10-MB9-NLSL.DWG

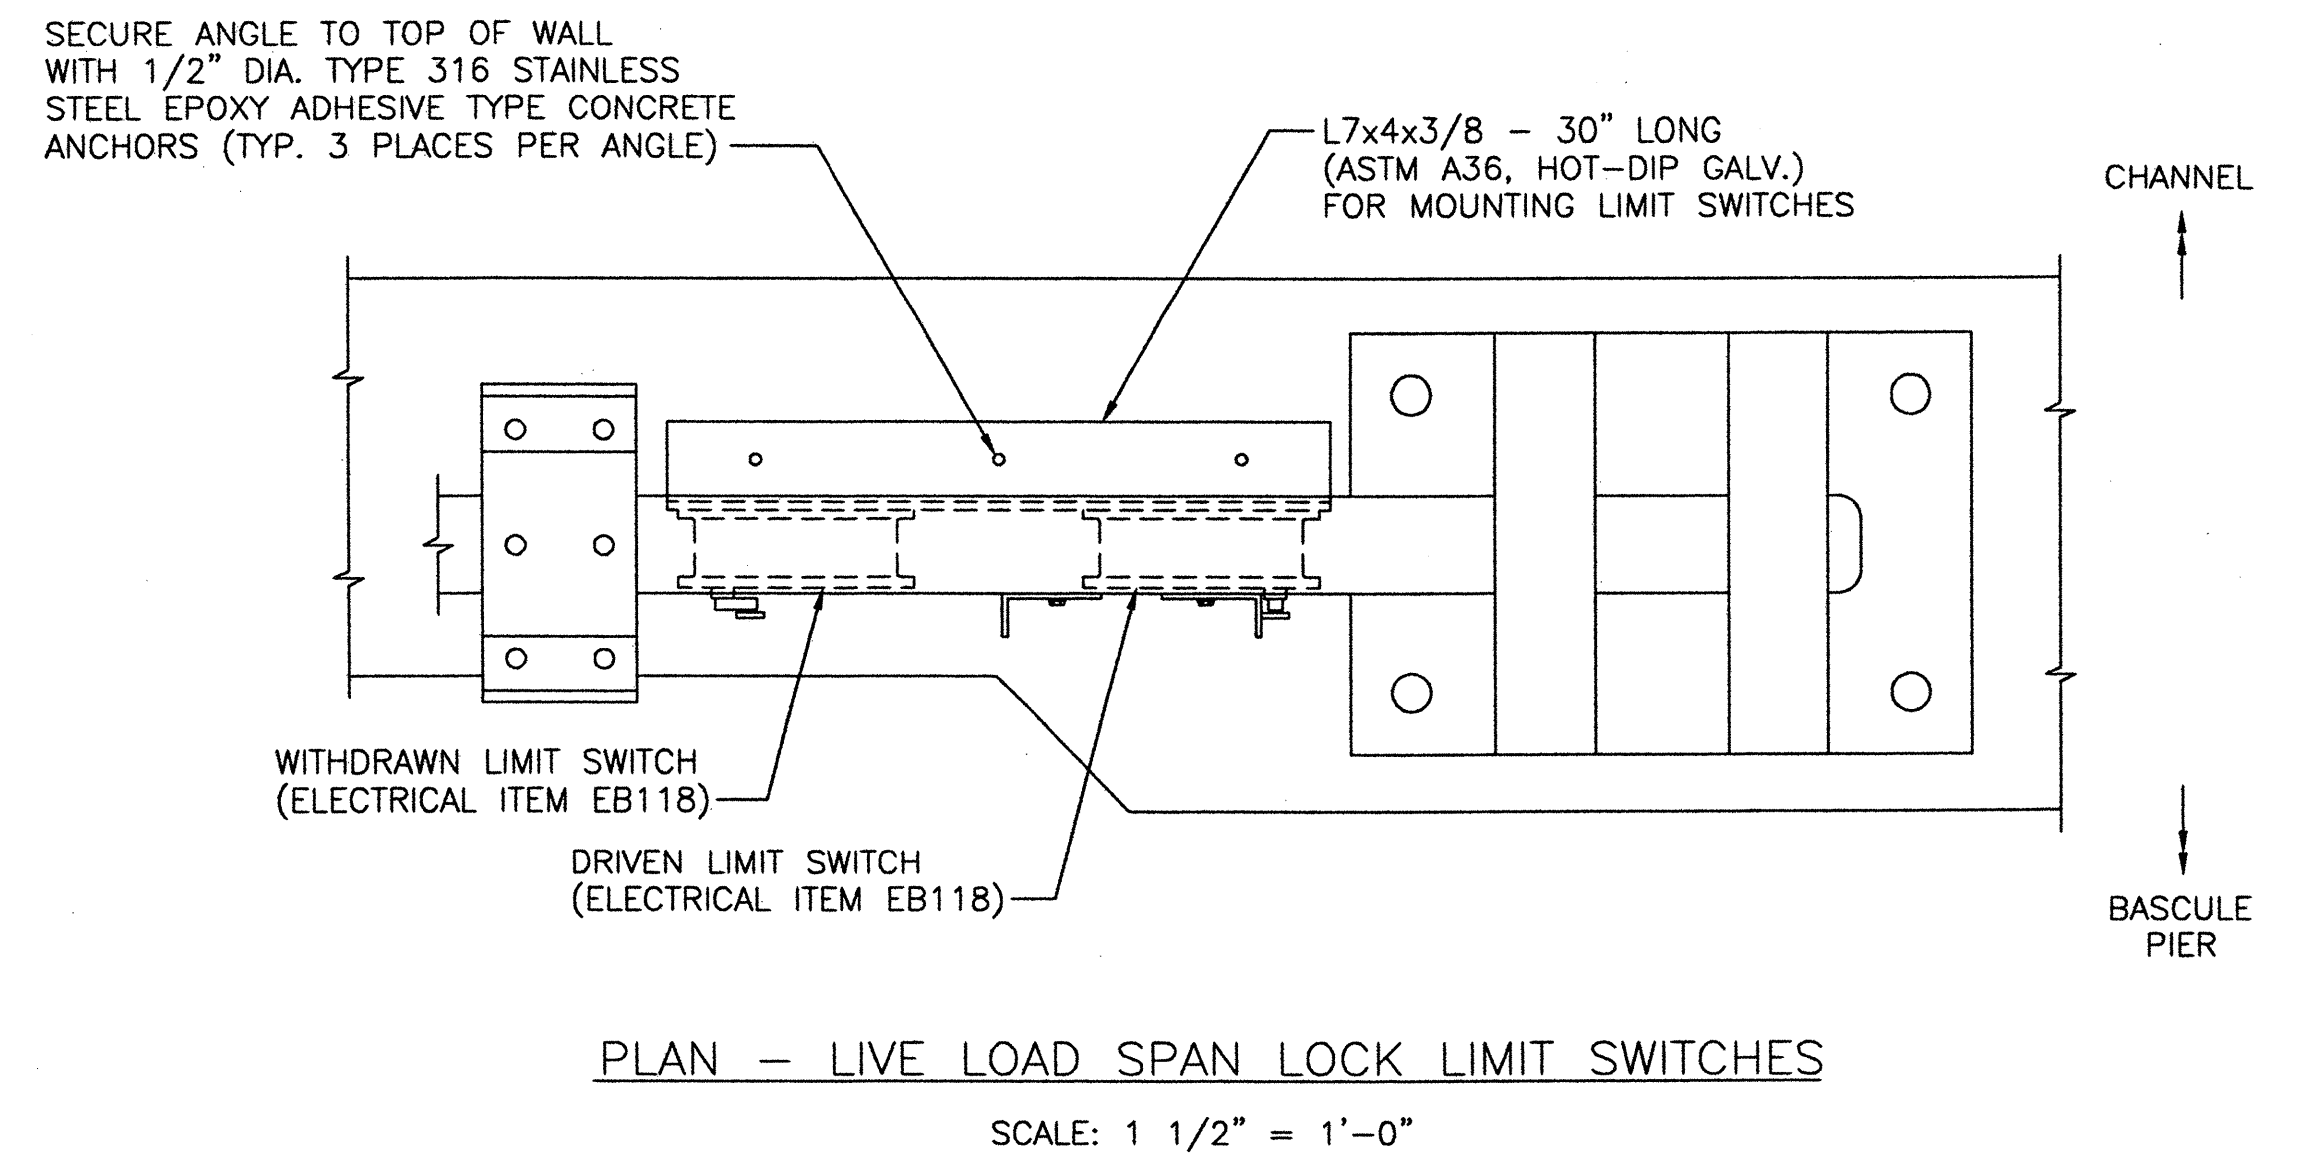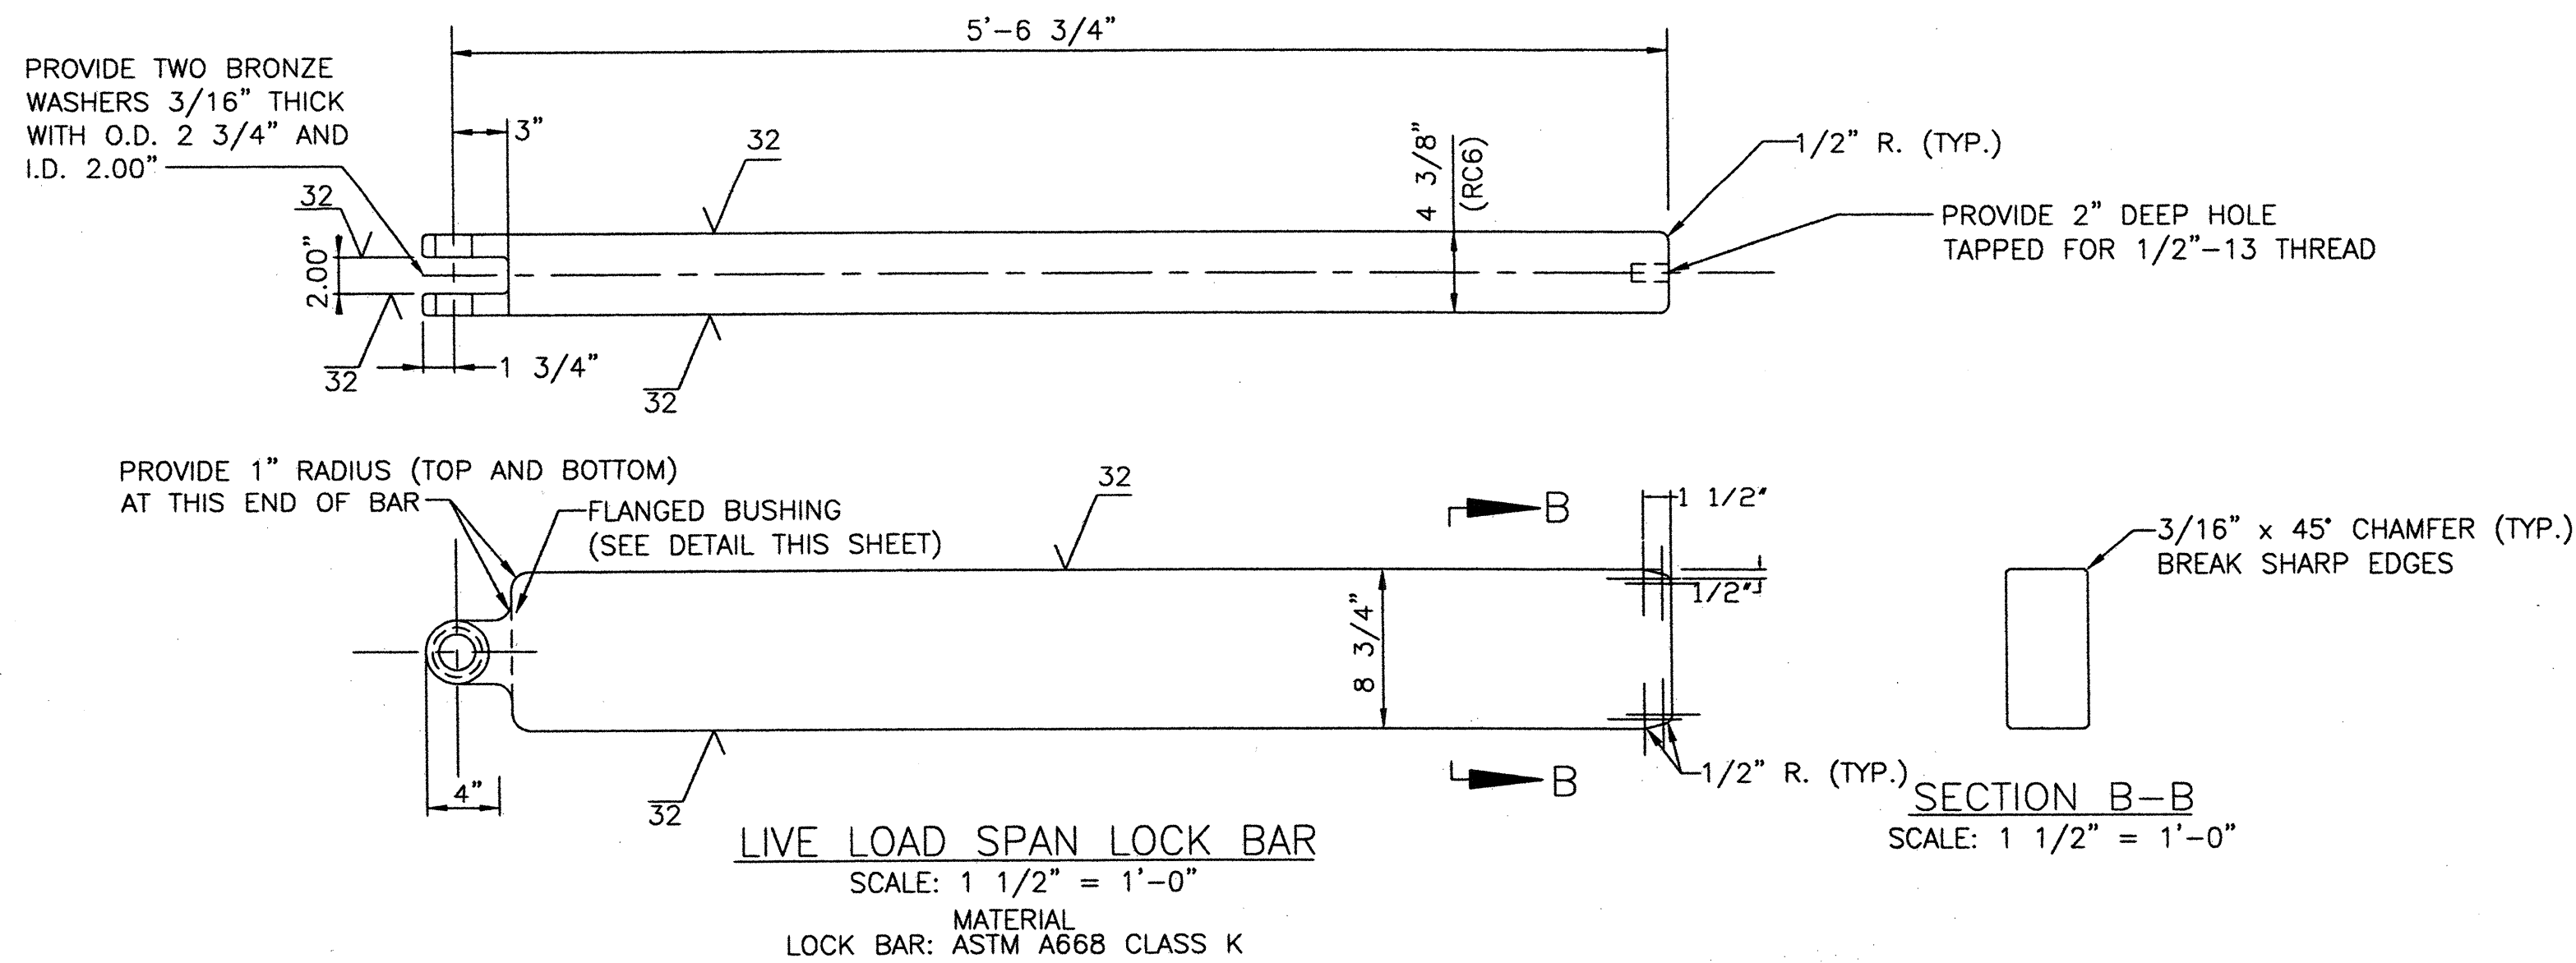

TYPICAL NORTHEAST AND SOUTHWEST LIVE LOAD SPAN LOCKS. NORTHWEST AND SOUTHEAST LIVE LOAD SPAN LOCKS OPPOSITE HAND. VIEW SHOWS LOCK BAR FULLY DRIVEN.

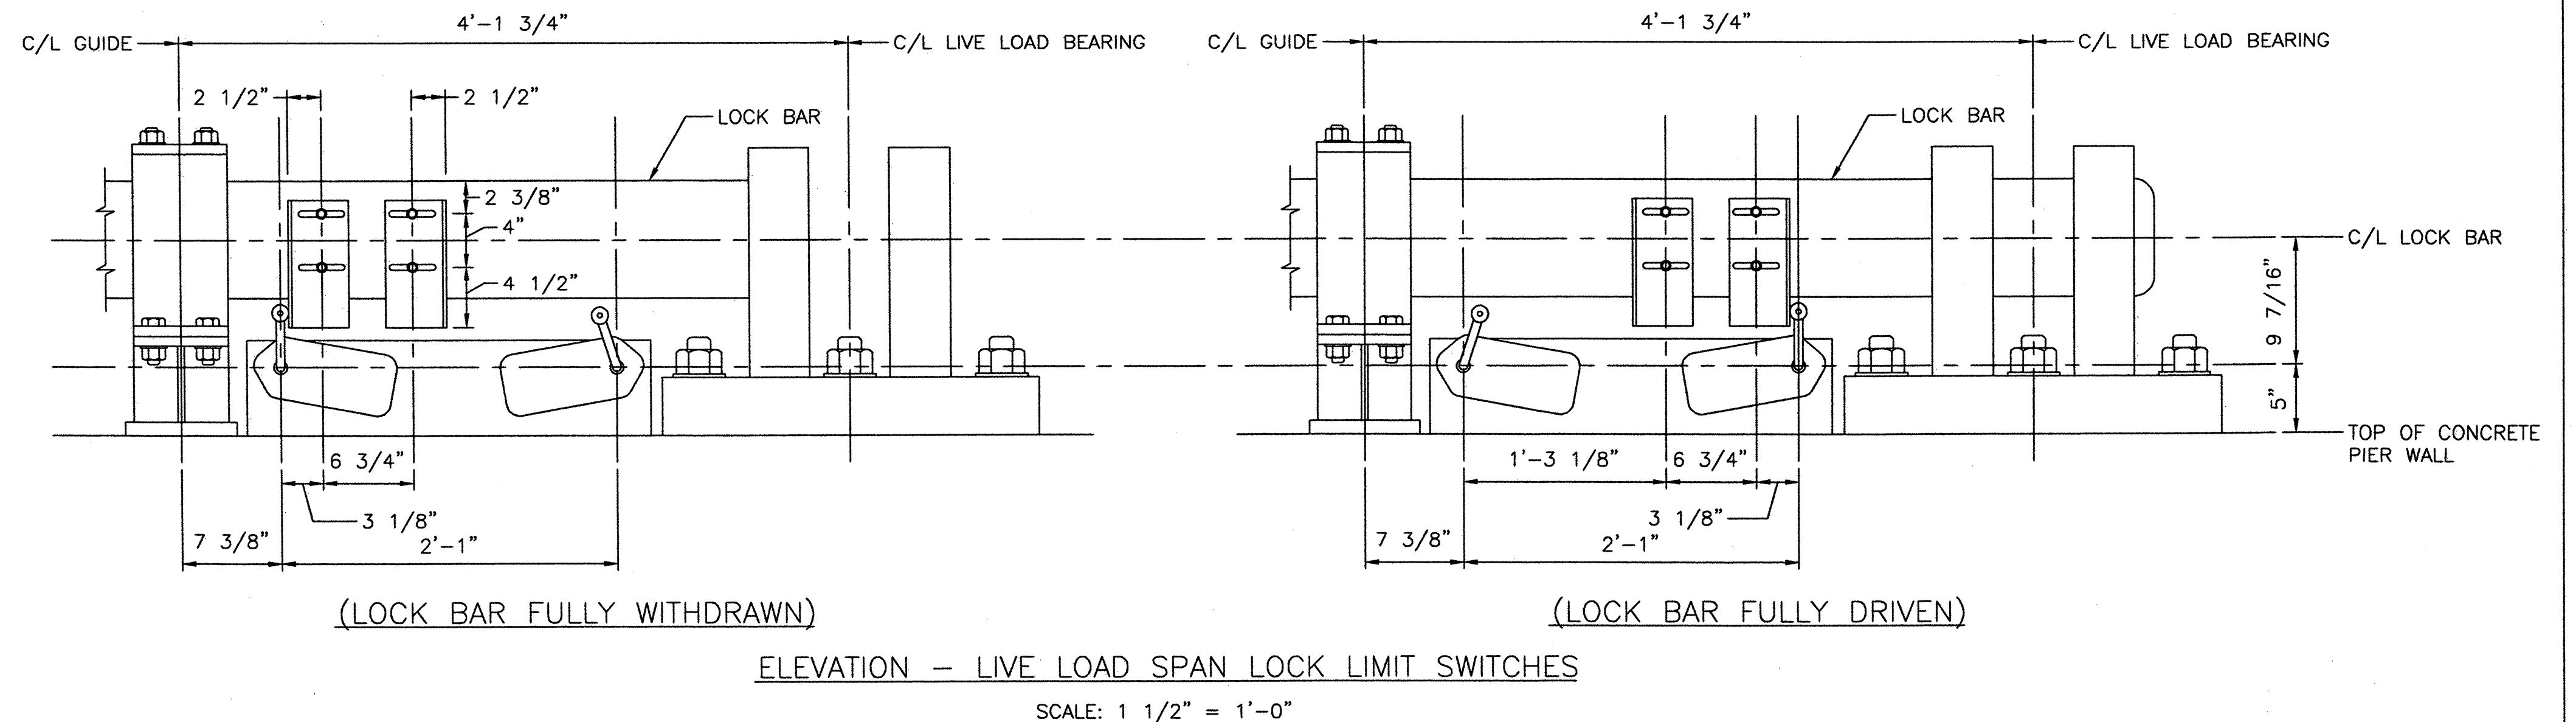
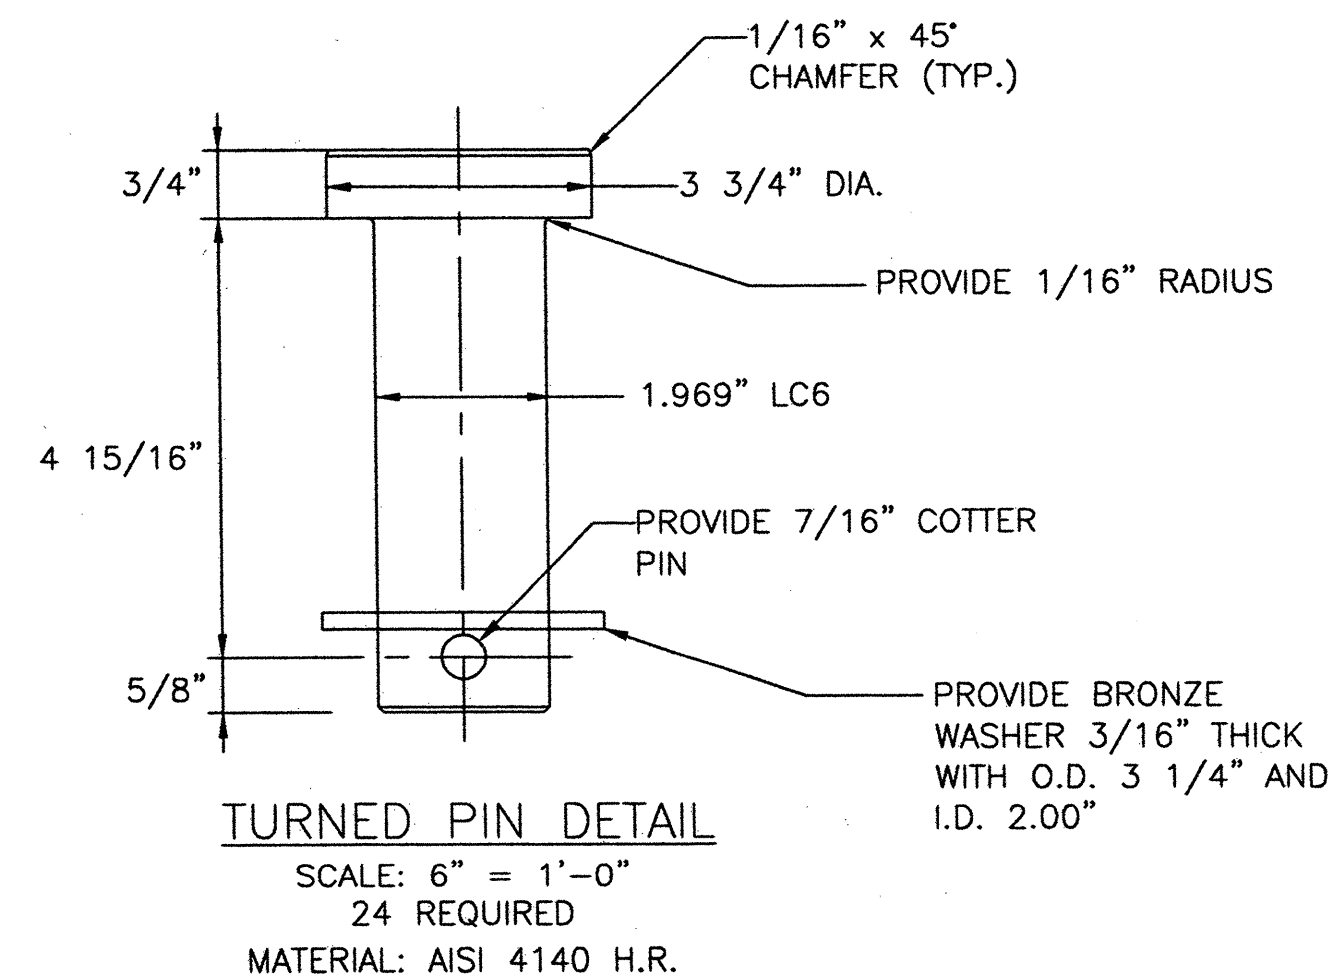


TYPICAL NORTHEAST AND SOUTHWEST LIVE LOAD SPAN LOCKS. NORTHWEST AND SOUTHEAST LIVE LOAD SPAN LOCKS OPPOSITE HAND.

LIMIT SWITCH BODIES SHALL BE INSTALLED AT 10 DEGREES FROM HORIZONTAL AS SHOWN.

TRIP PLATES ARE 4 1/2" x 2" x 1/4" BENT PLATES (TYPE 316 STAINLESS STEEL), WITH TWO 7/16" x 3" SLOTTED HOLES EACH AS SHOWN. HOLES TAPPED FOR 3/8"-16 BOLTS SHALL BE PROVIDED IN THE LOCK BAR AS SHOWN FOR MOUNTING THE TRIP PLATES. TRIP PLATE MOUNTING BOLTS SHALL BE TYPE 316 STAINLESS STEEL AND PROVIDED WITH LOCKWASHERS. TRIP PLATES ARE SHOWN SET AT THEIR NOMINAL POSITIONS, BUT SHALL BE FIELD ADJUSTED AS REQUIRED.


SEE ELECTRICAL ITEM EB118 FOR LIMIT SWITCHES. LIMIT SWITCHES SHALL BE MOUNTED WITH TYPE 316 STAINLESS STEEL HARDWARE.

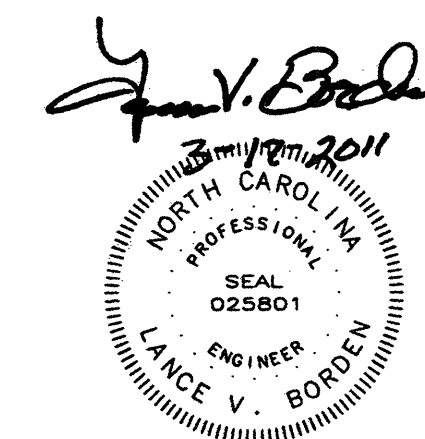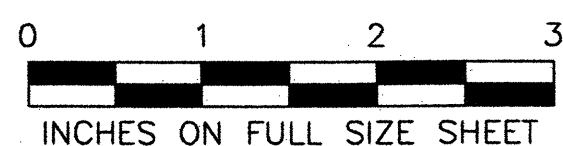


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
NEW LIVE LOAD SPAN LOCK -
DETAILS 1


DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	
DESIGNED D.M. BARRETT	DETAILED D.M. BARRETT	DATE MARCH 2011	
CHECKED L.V. BORDEN	CHECKED L.V. BORDEN	DRAWING NO. 11 OF 63	

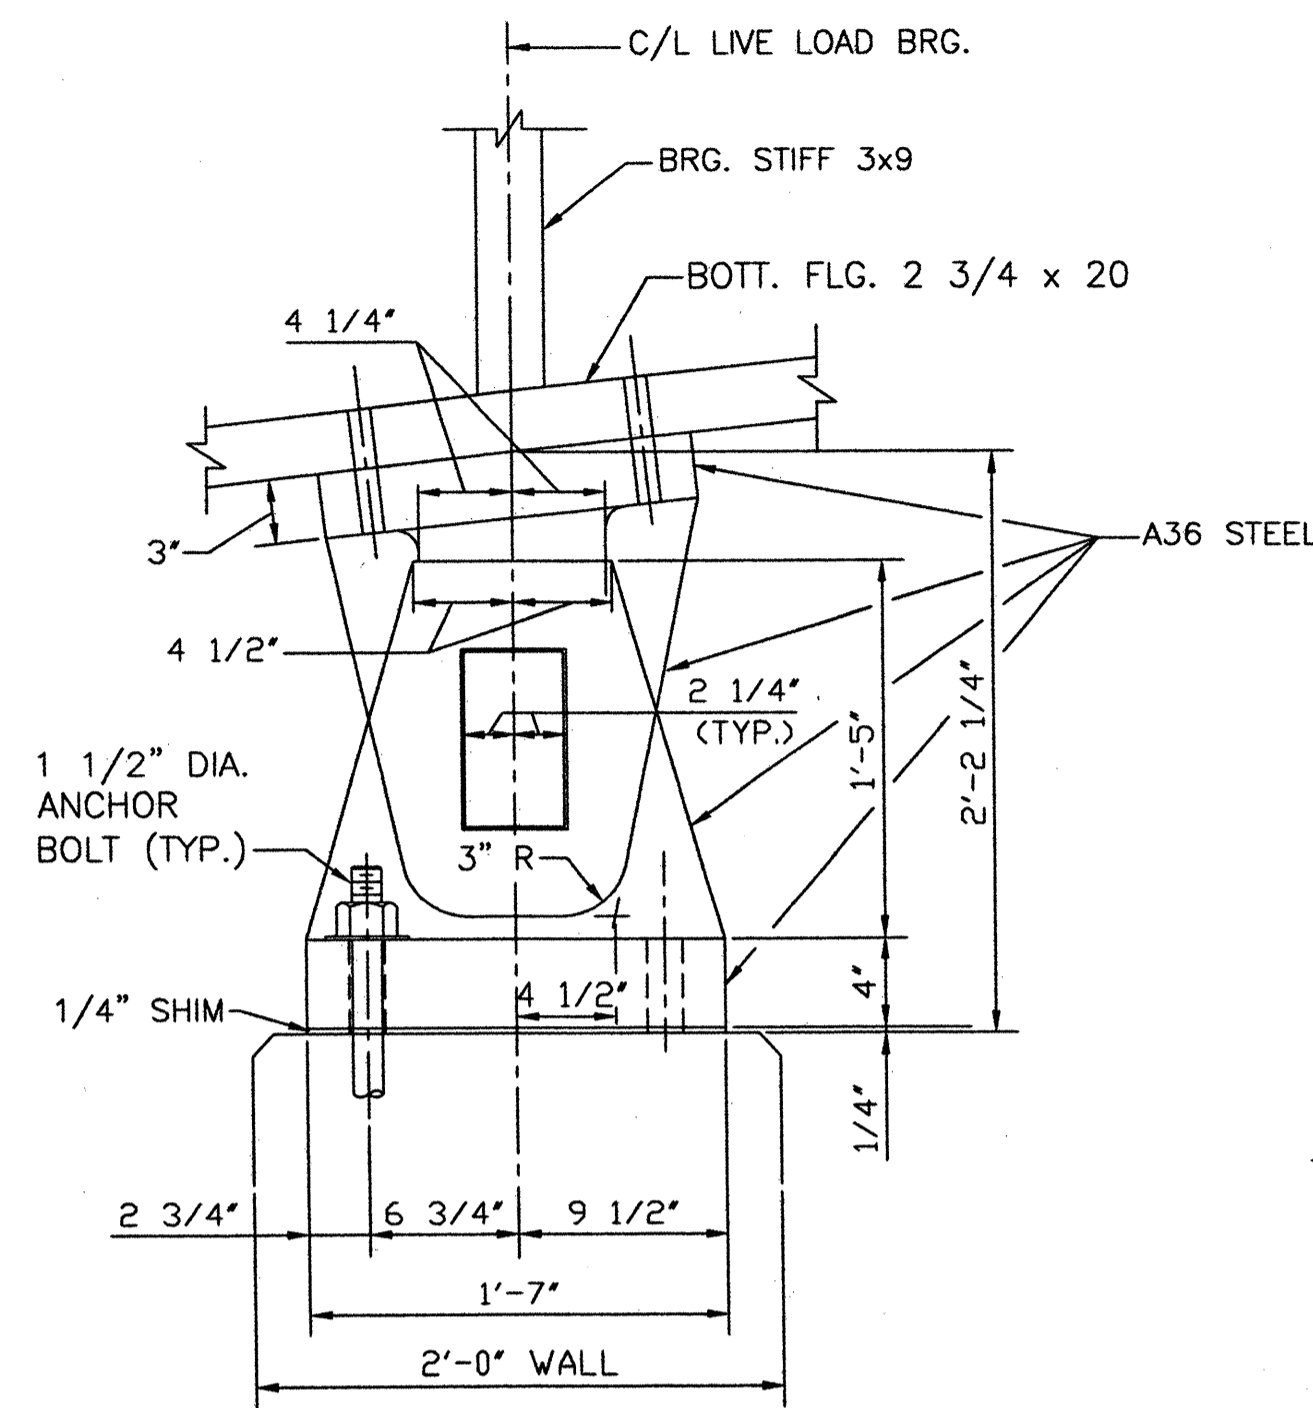


SECTION A-A
SCALE: 1 1/2" = 1'-0"

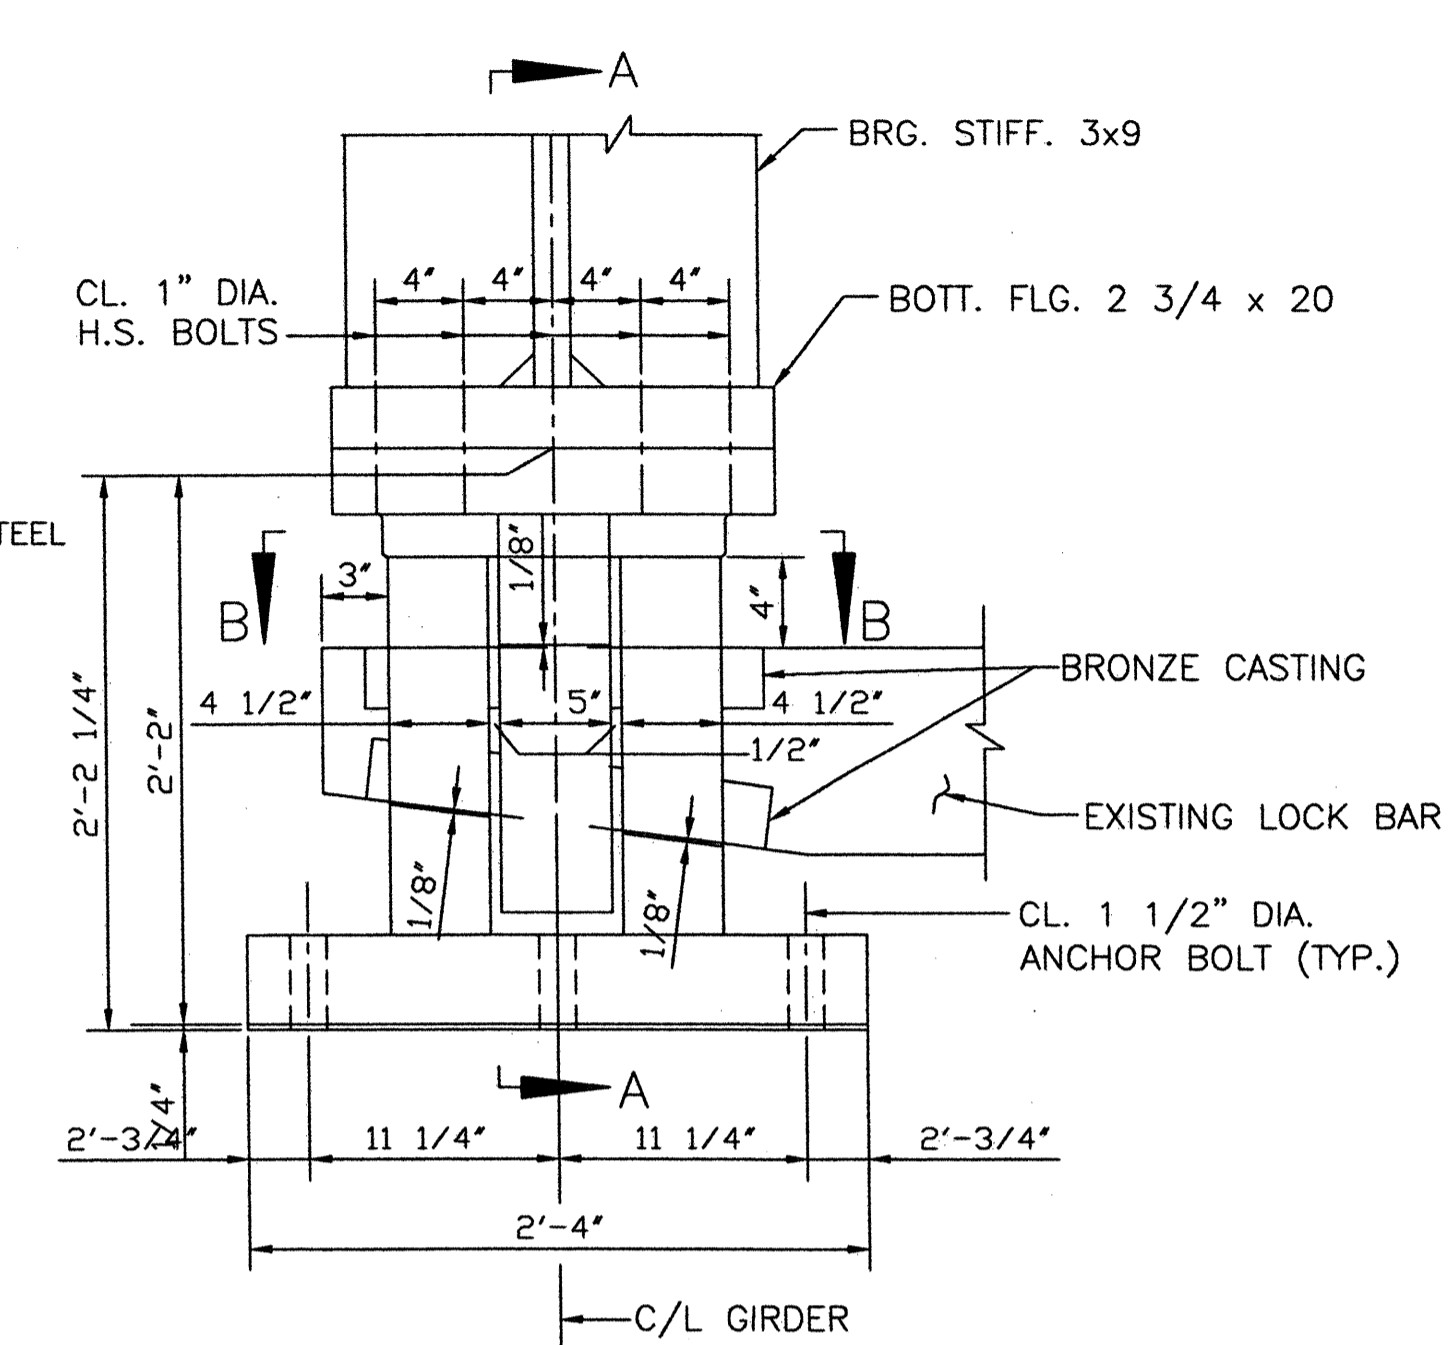


DETAIL OF EXISTING LIVE LOAD BEARING
SCALE: 1 1/2" = 1'-0"

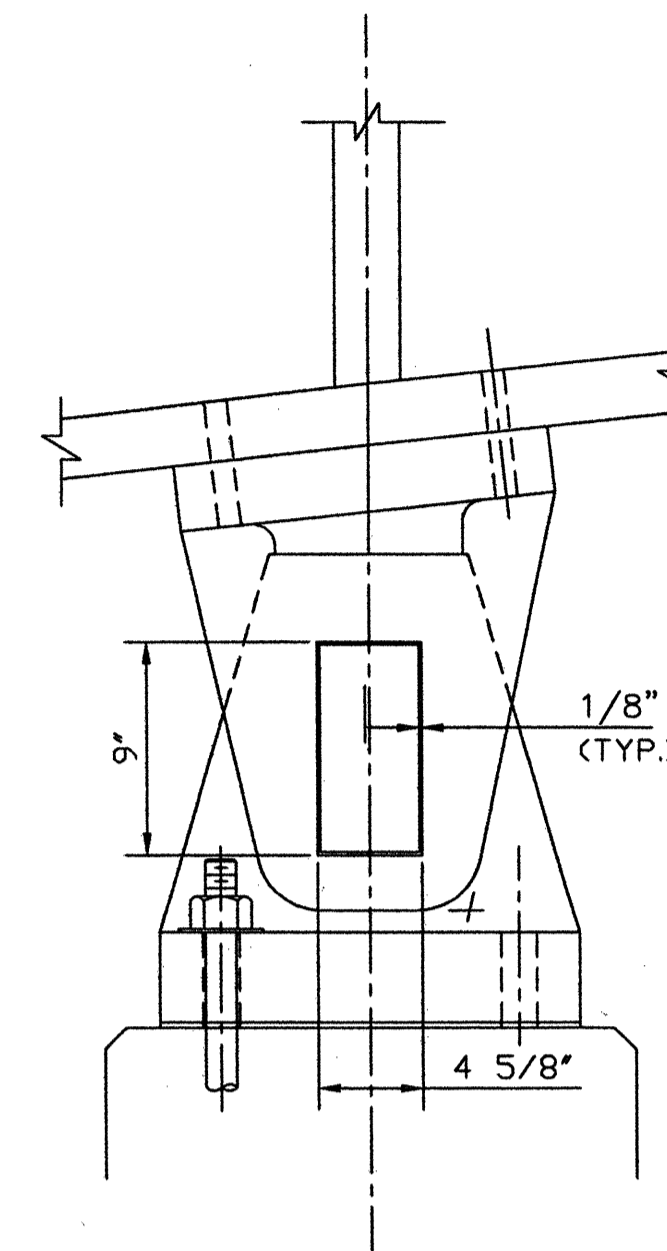


SECTION C-C
SCALE: 1 1/2" = 1'-0"

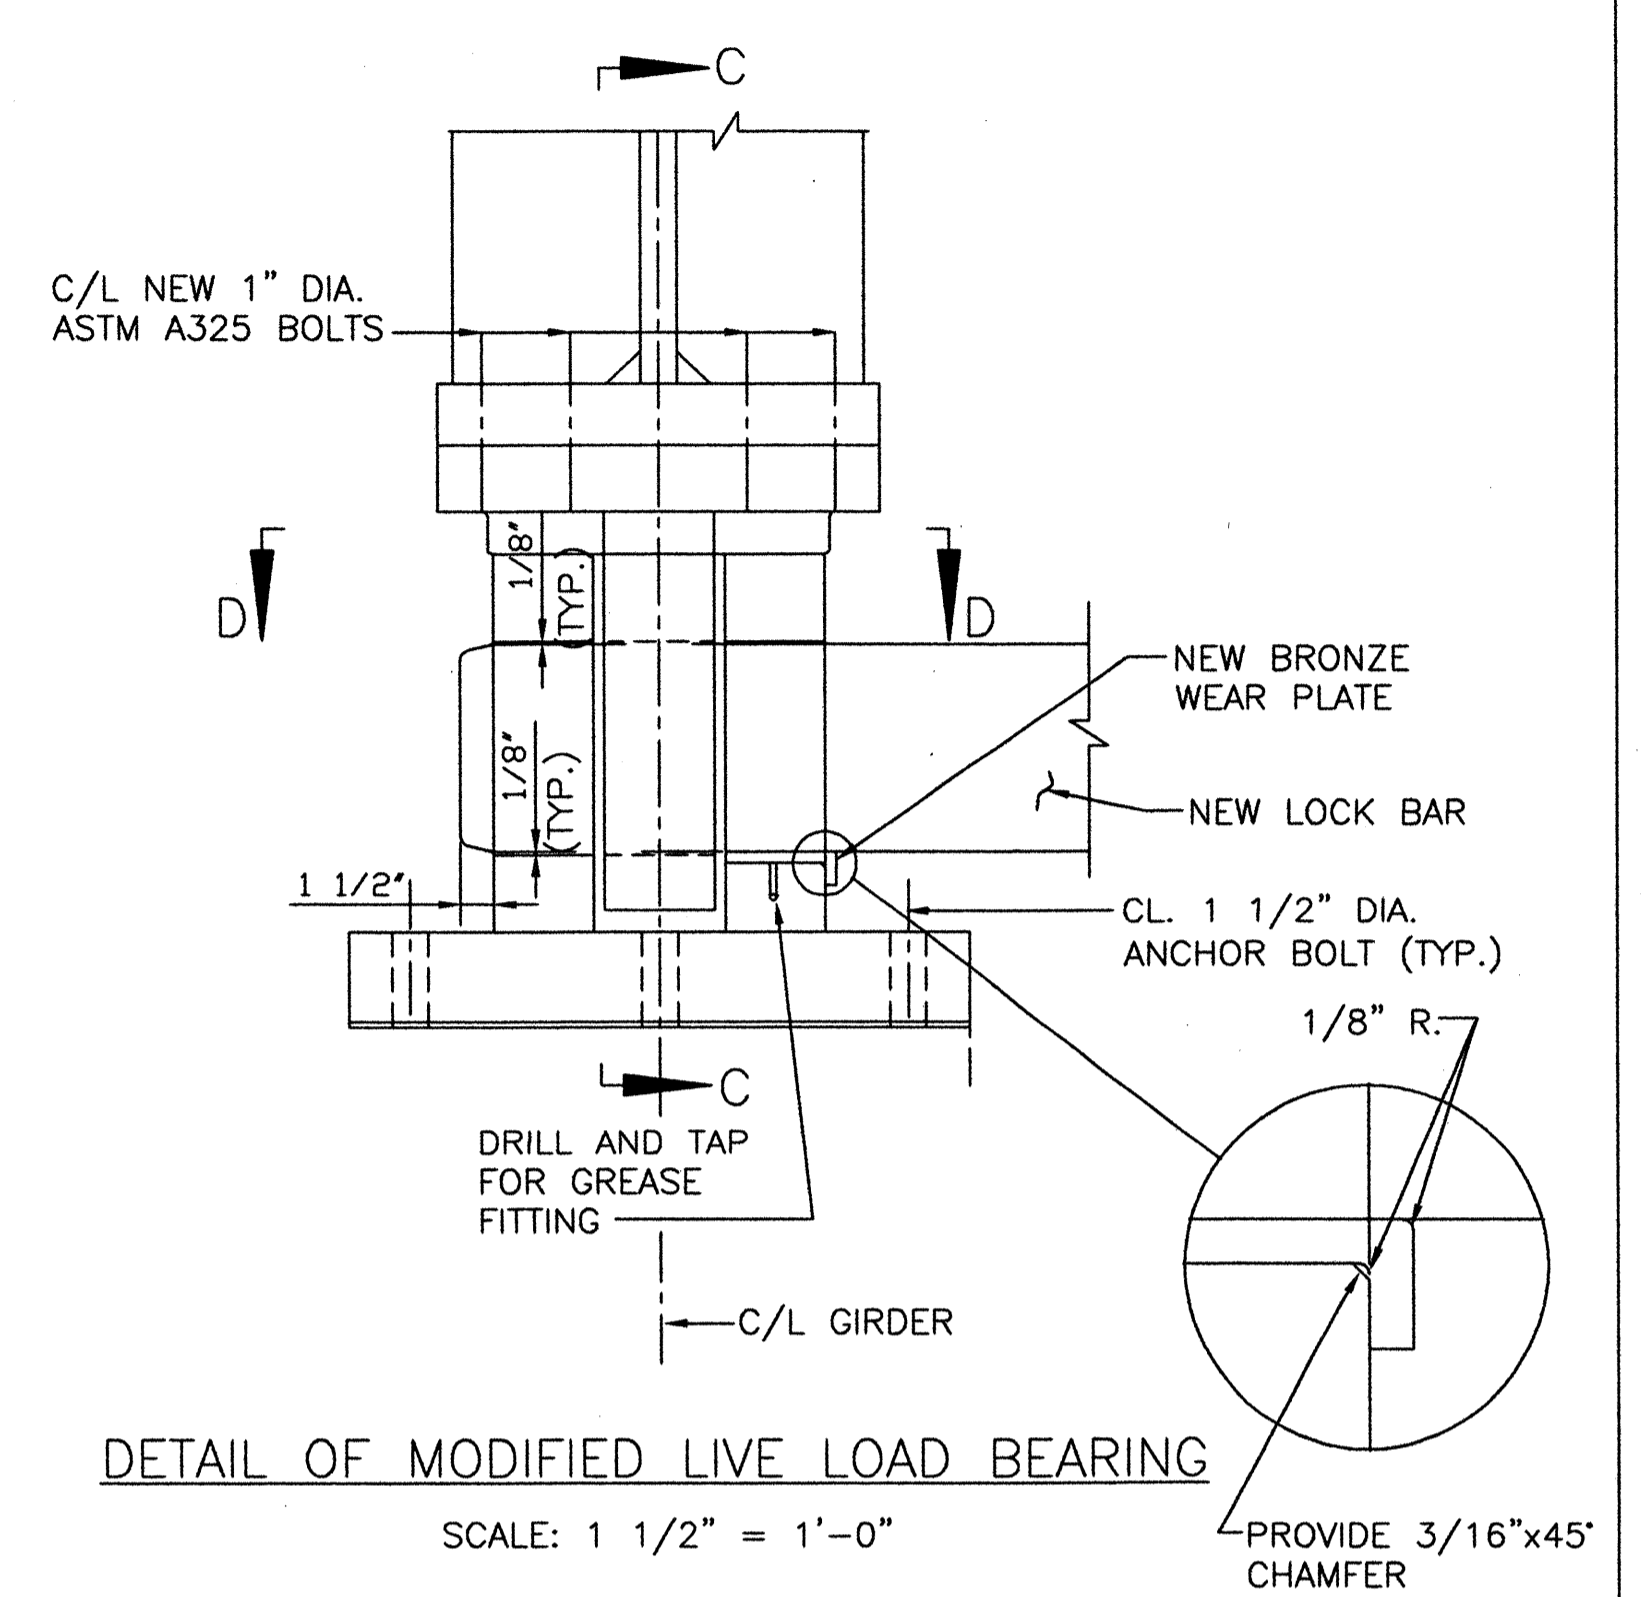


DETAIL OF MODIFIED LIVE LOAD BEARING
SCALE: 1 1/2" = 1'-0"

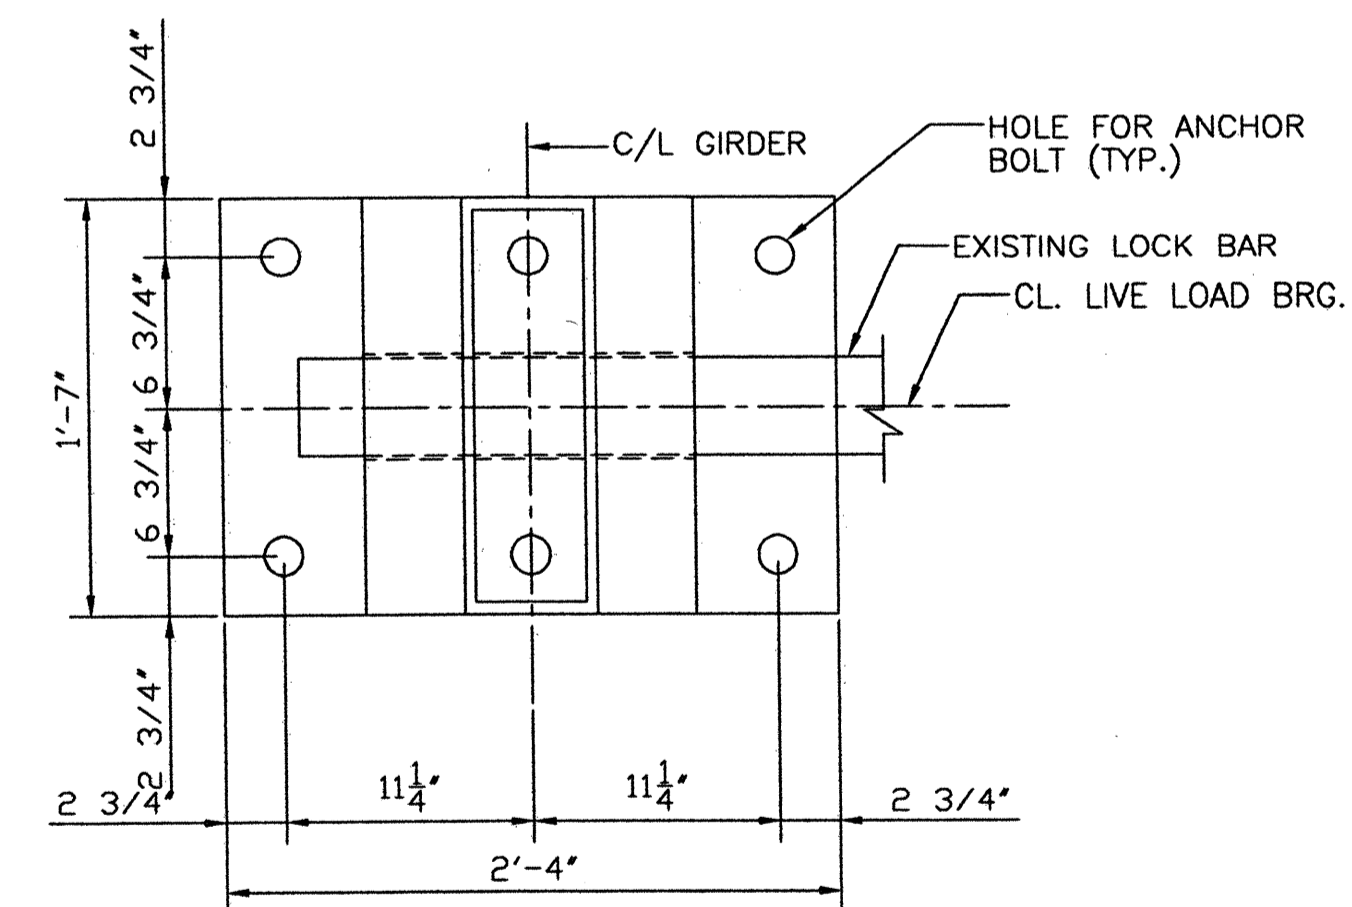

SECTION B-B
SCALE: 1 1/2" = 1'-0"

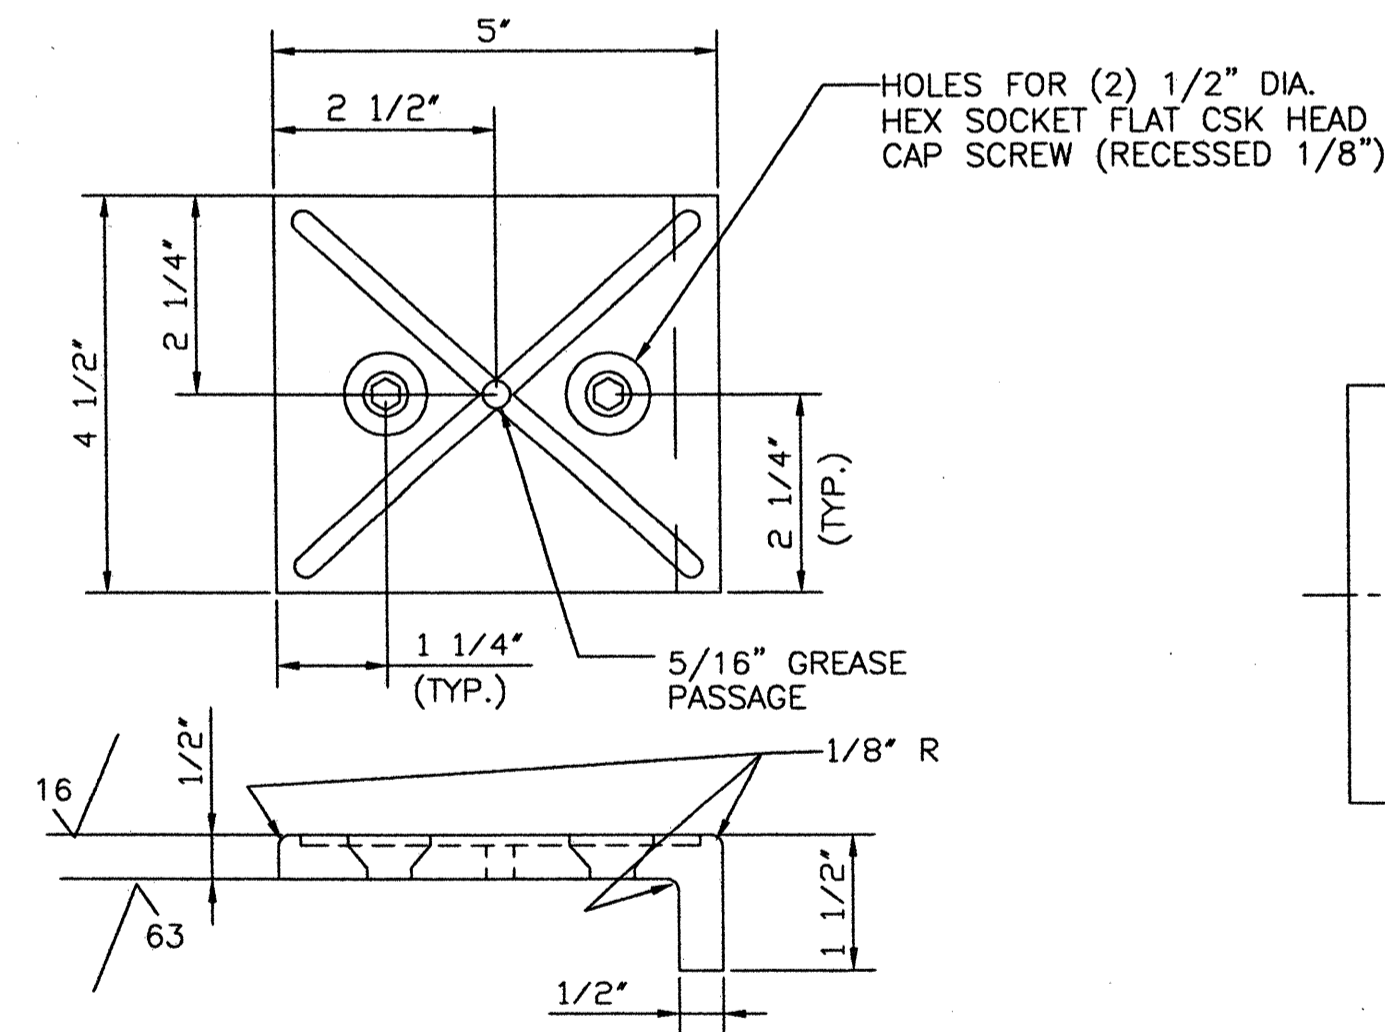


NEW BRONZE WEAR PLATE
SCALE: 6" = 1'-0"
MATERIAL: ASTM B22, UNS NO. C86300
FINISH ALL SURFACES TO 125 UNLESS NOTED OTHERWISE

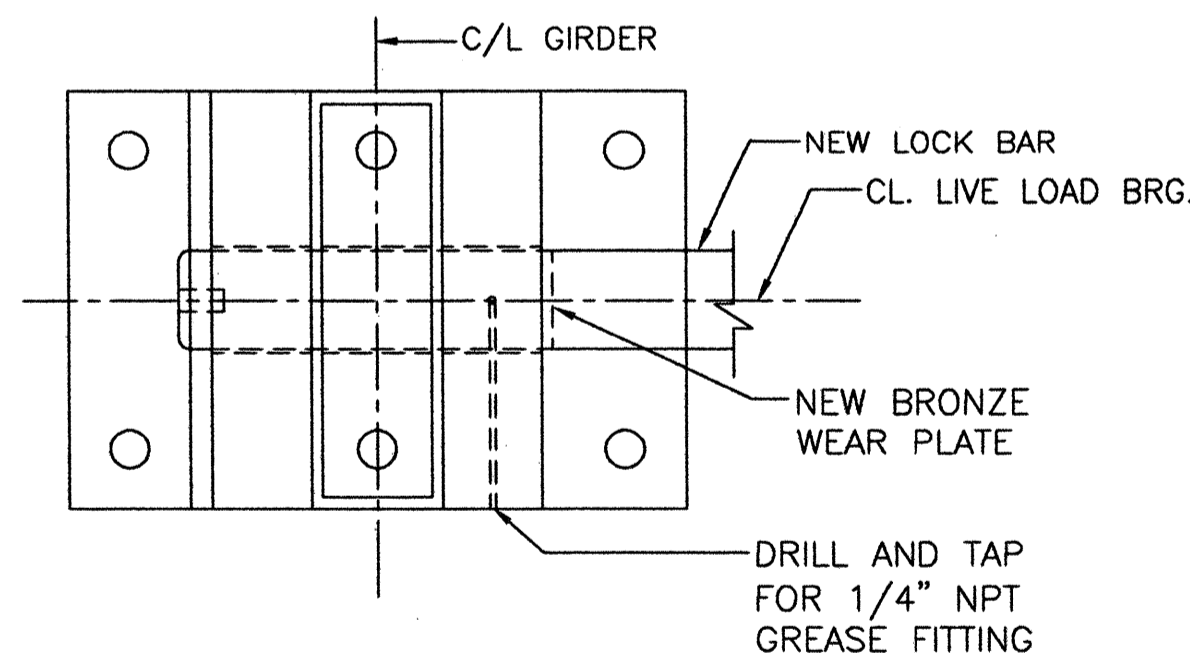


SECTION D-D
SCALE: 1 1/2" = 1'-0"

NOTES:









1. THE MACHINING OF THE LIVE LOAD BEARINGS IS TO BE CONDUCTED IN PLACE. ALL MACHINED SURFACES TO BE 125 MICROINCH OR BETTER UNLESS OTHERWISE NOTED.
2. THE 4 1/2" WIDTH OF SLOT SHOWN IS TO BE WIDENED TO THE FIRST CLEAN VERTICAL SURFACE ON EACH SIDE (3 LOCATIONS PER LIVE LOAD BEARING).
3. NEW BRONZE WEAR PLATE GREASE GROOVES TO BE 1/4" WIDE AND 1/8" DEEP WITH CORNERS AND EDGES ROUNDED TO 1/16" RADIUS.
4. NEW 1" DIAMETER ASTM A325 BOLTS AND NUTS (8 PER LIVE LOAD BEARING) AT THE BOTTOM FLANGE WILL BE REQUIRED AFTER SHIMMING OF LIVE LOAD BEARINGS IS COMPLETED AND APPROVED.
5. BOTH LIVE LOAD BEARINGS SHALL REMAIN IN SERVICE AT ALL TIMES.

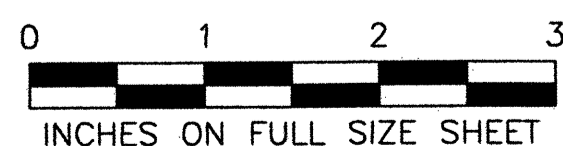

INCHES ON FULL SIZE SHEET

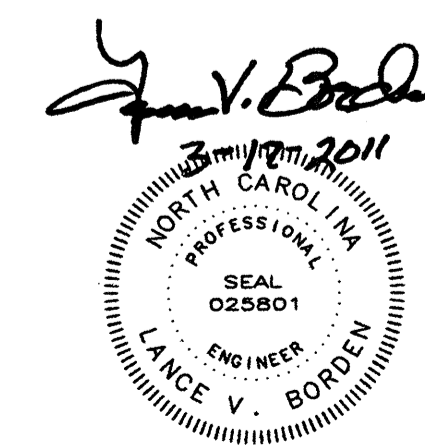


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW LIVE LOAD SPAN LOCK - DETAILS 2			
DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	
DESIGNED D.M. BARRETT	DETAILED D.M. BARRETT	DATE MARCH 2011	MB11
CHECKED G.L. FOREST	CHECKED G.L. FOREST	DRAWING NO. 12 OF 63	

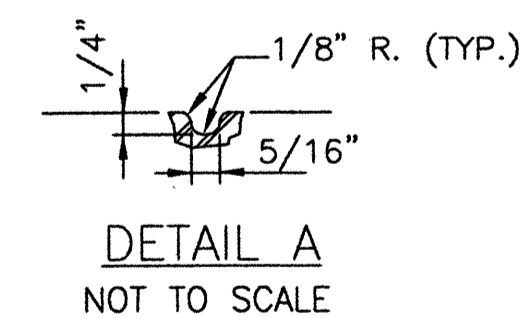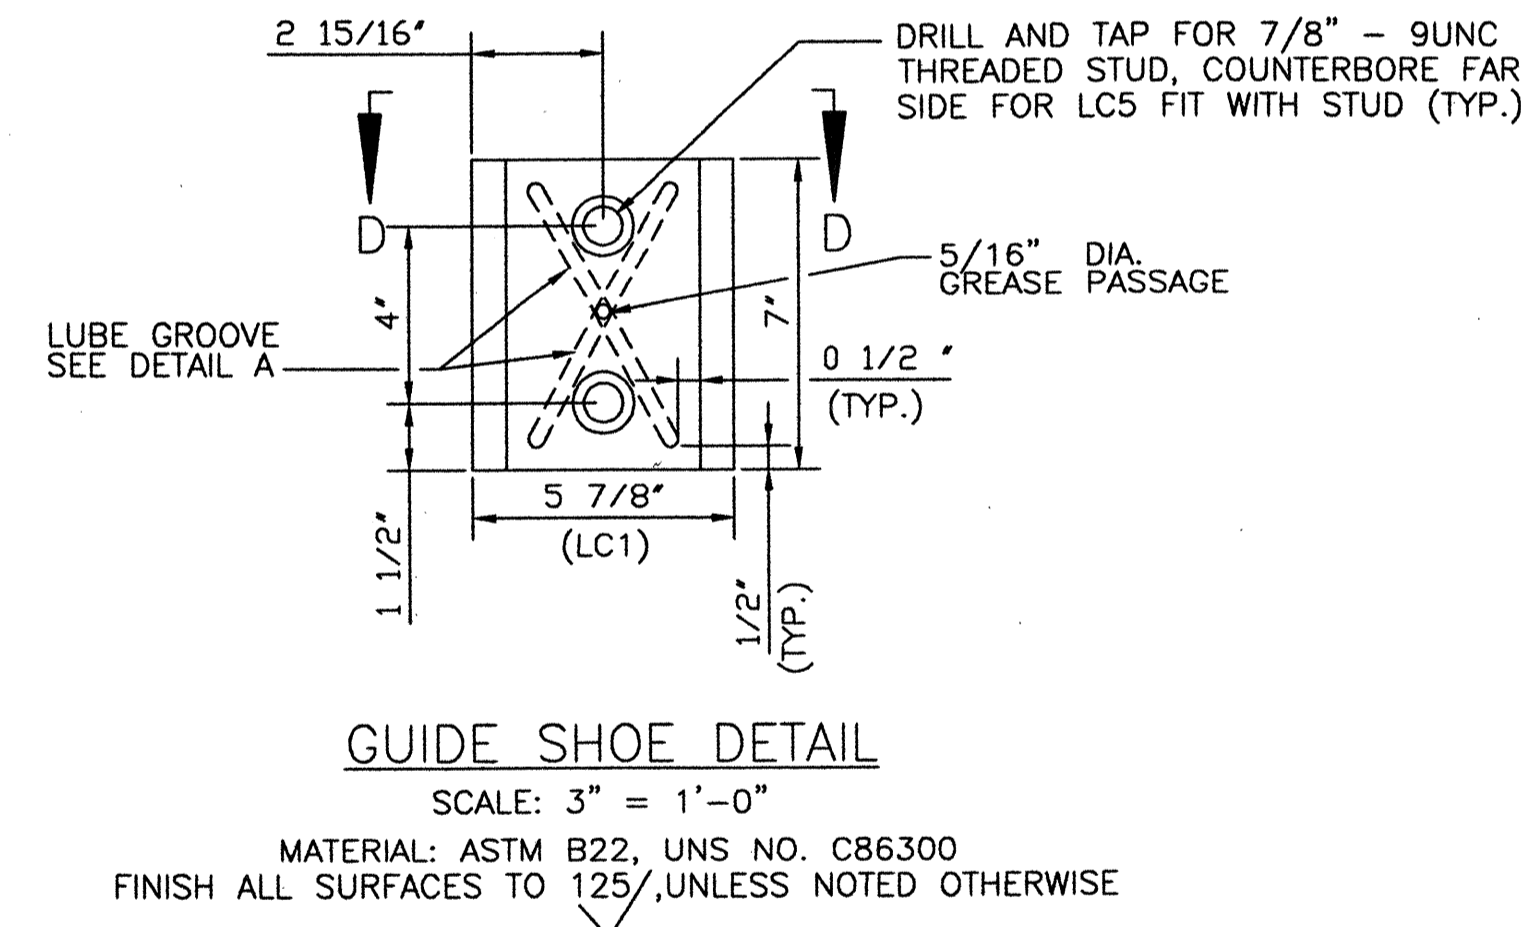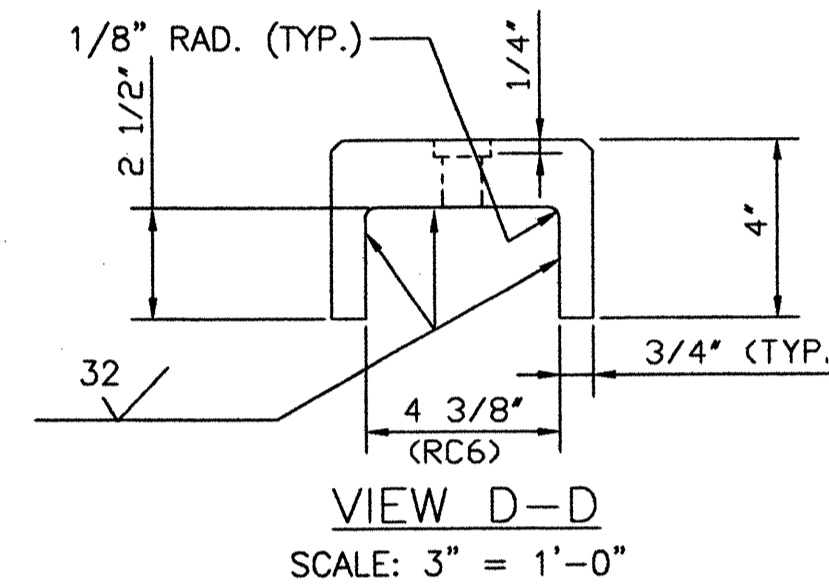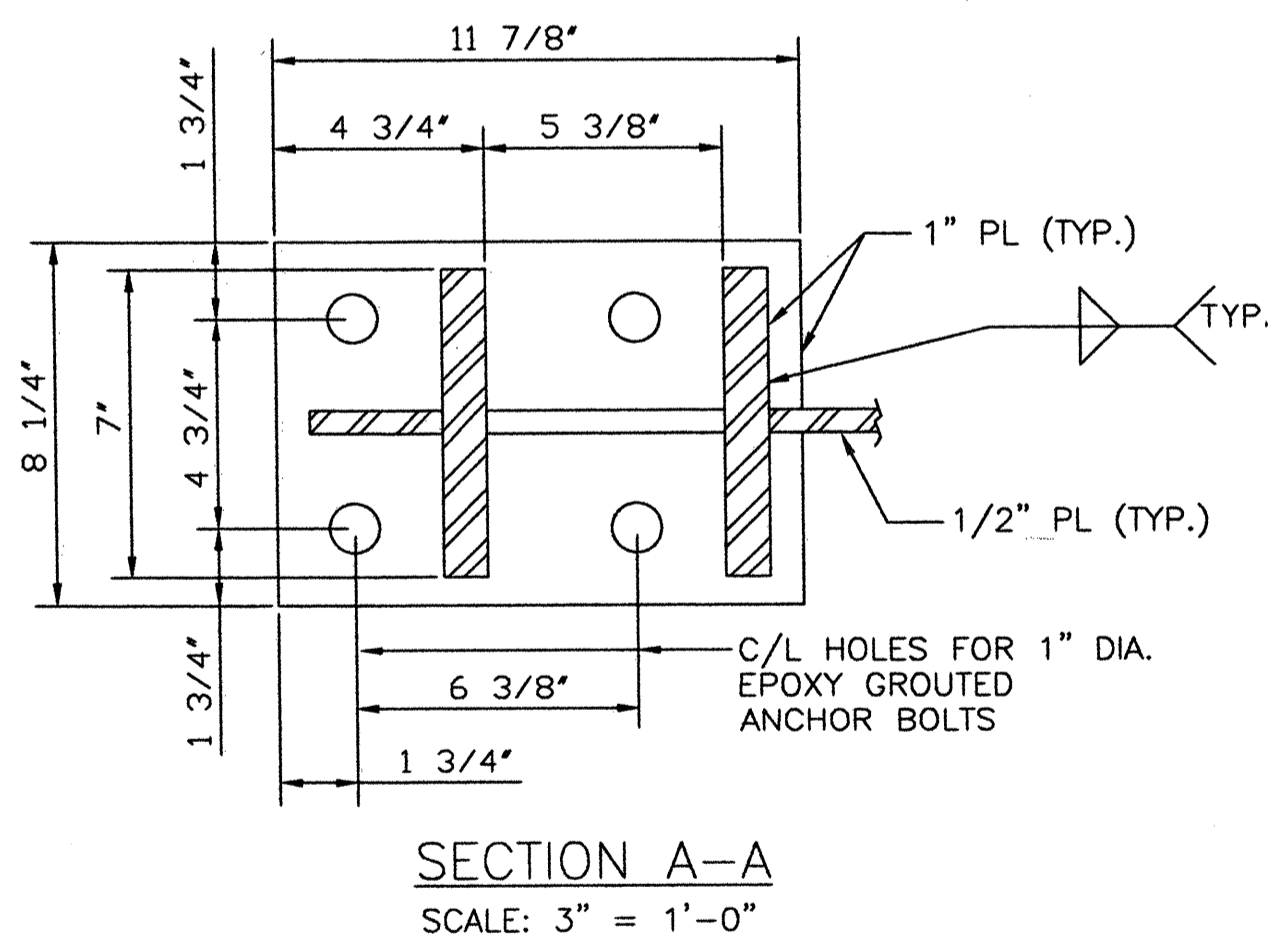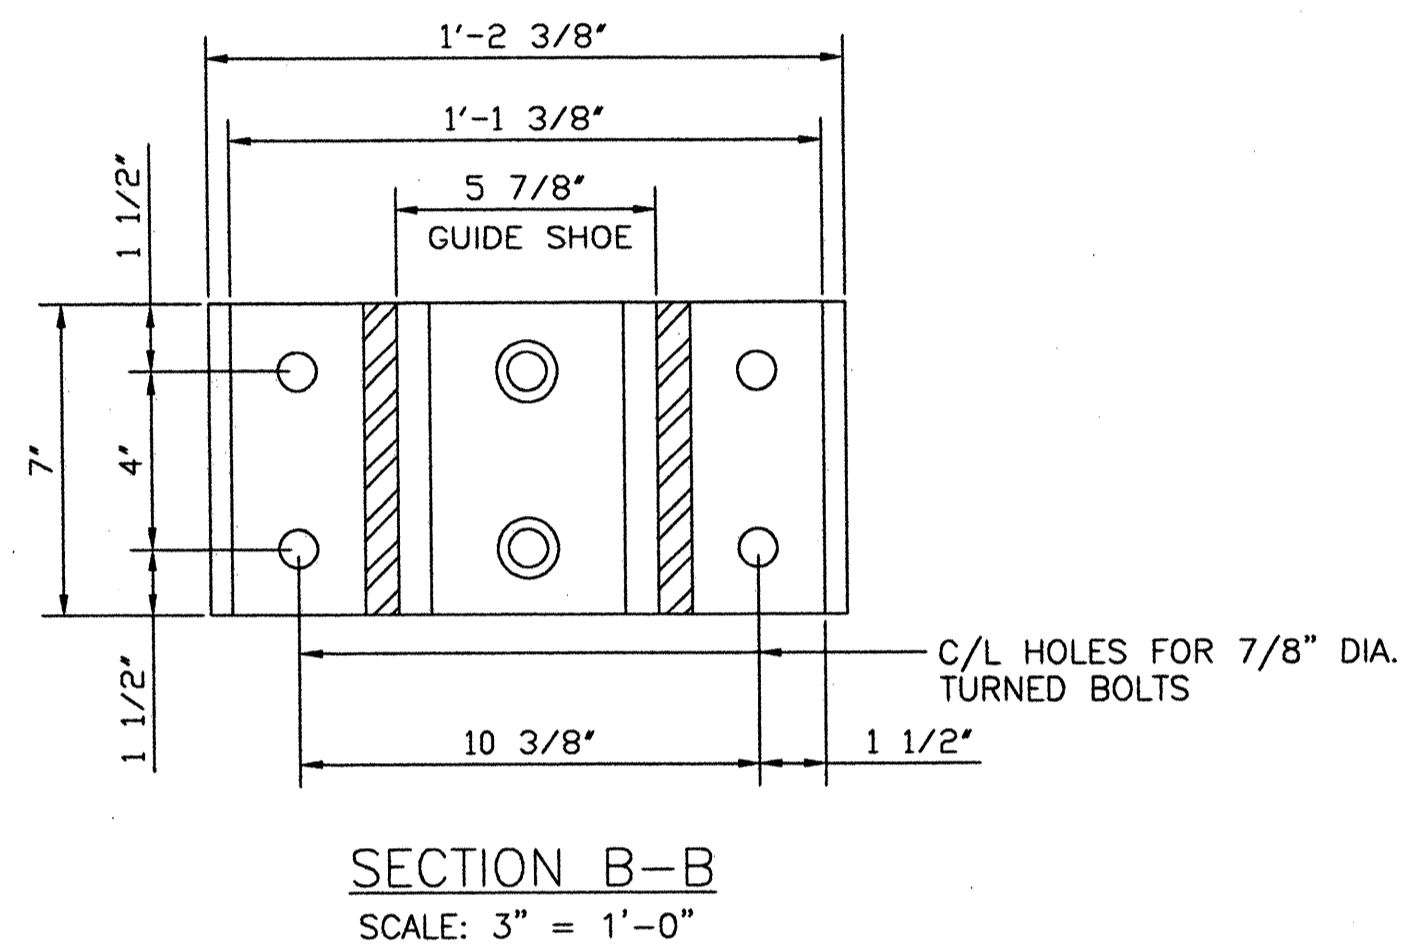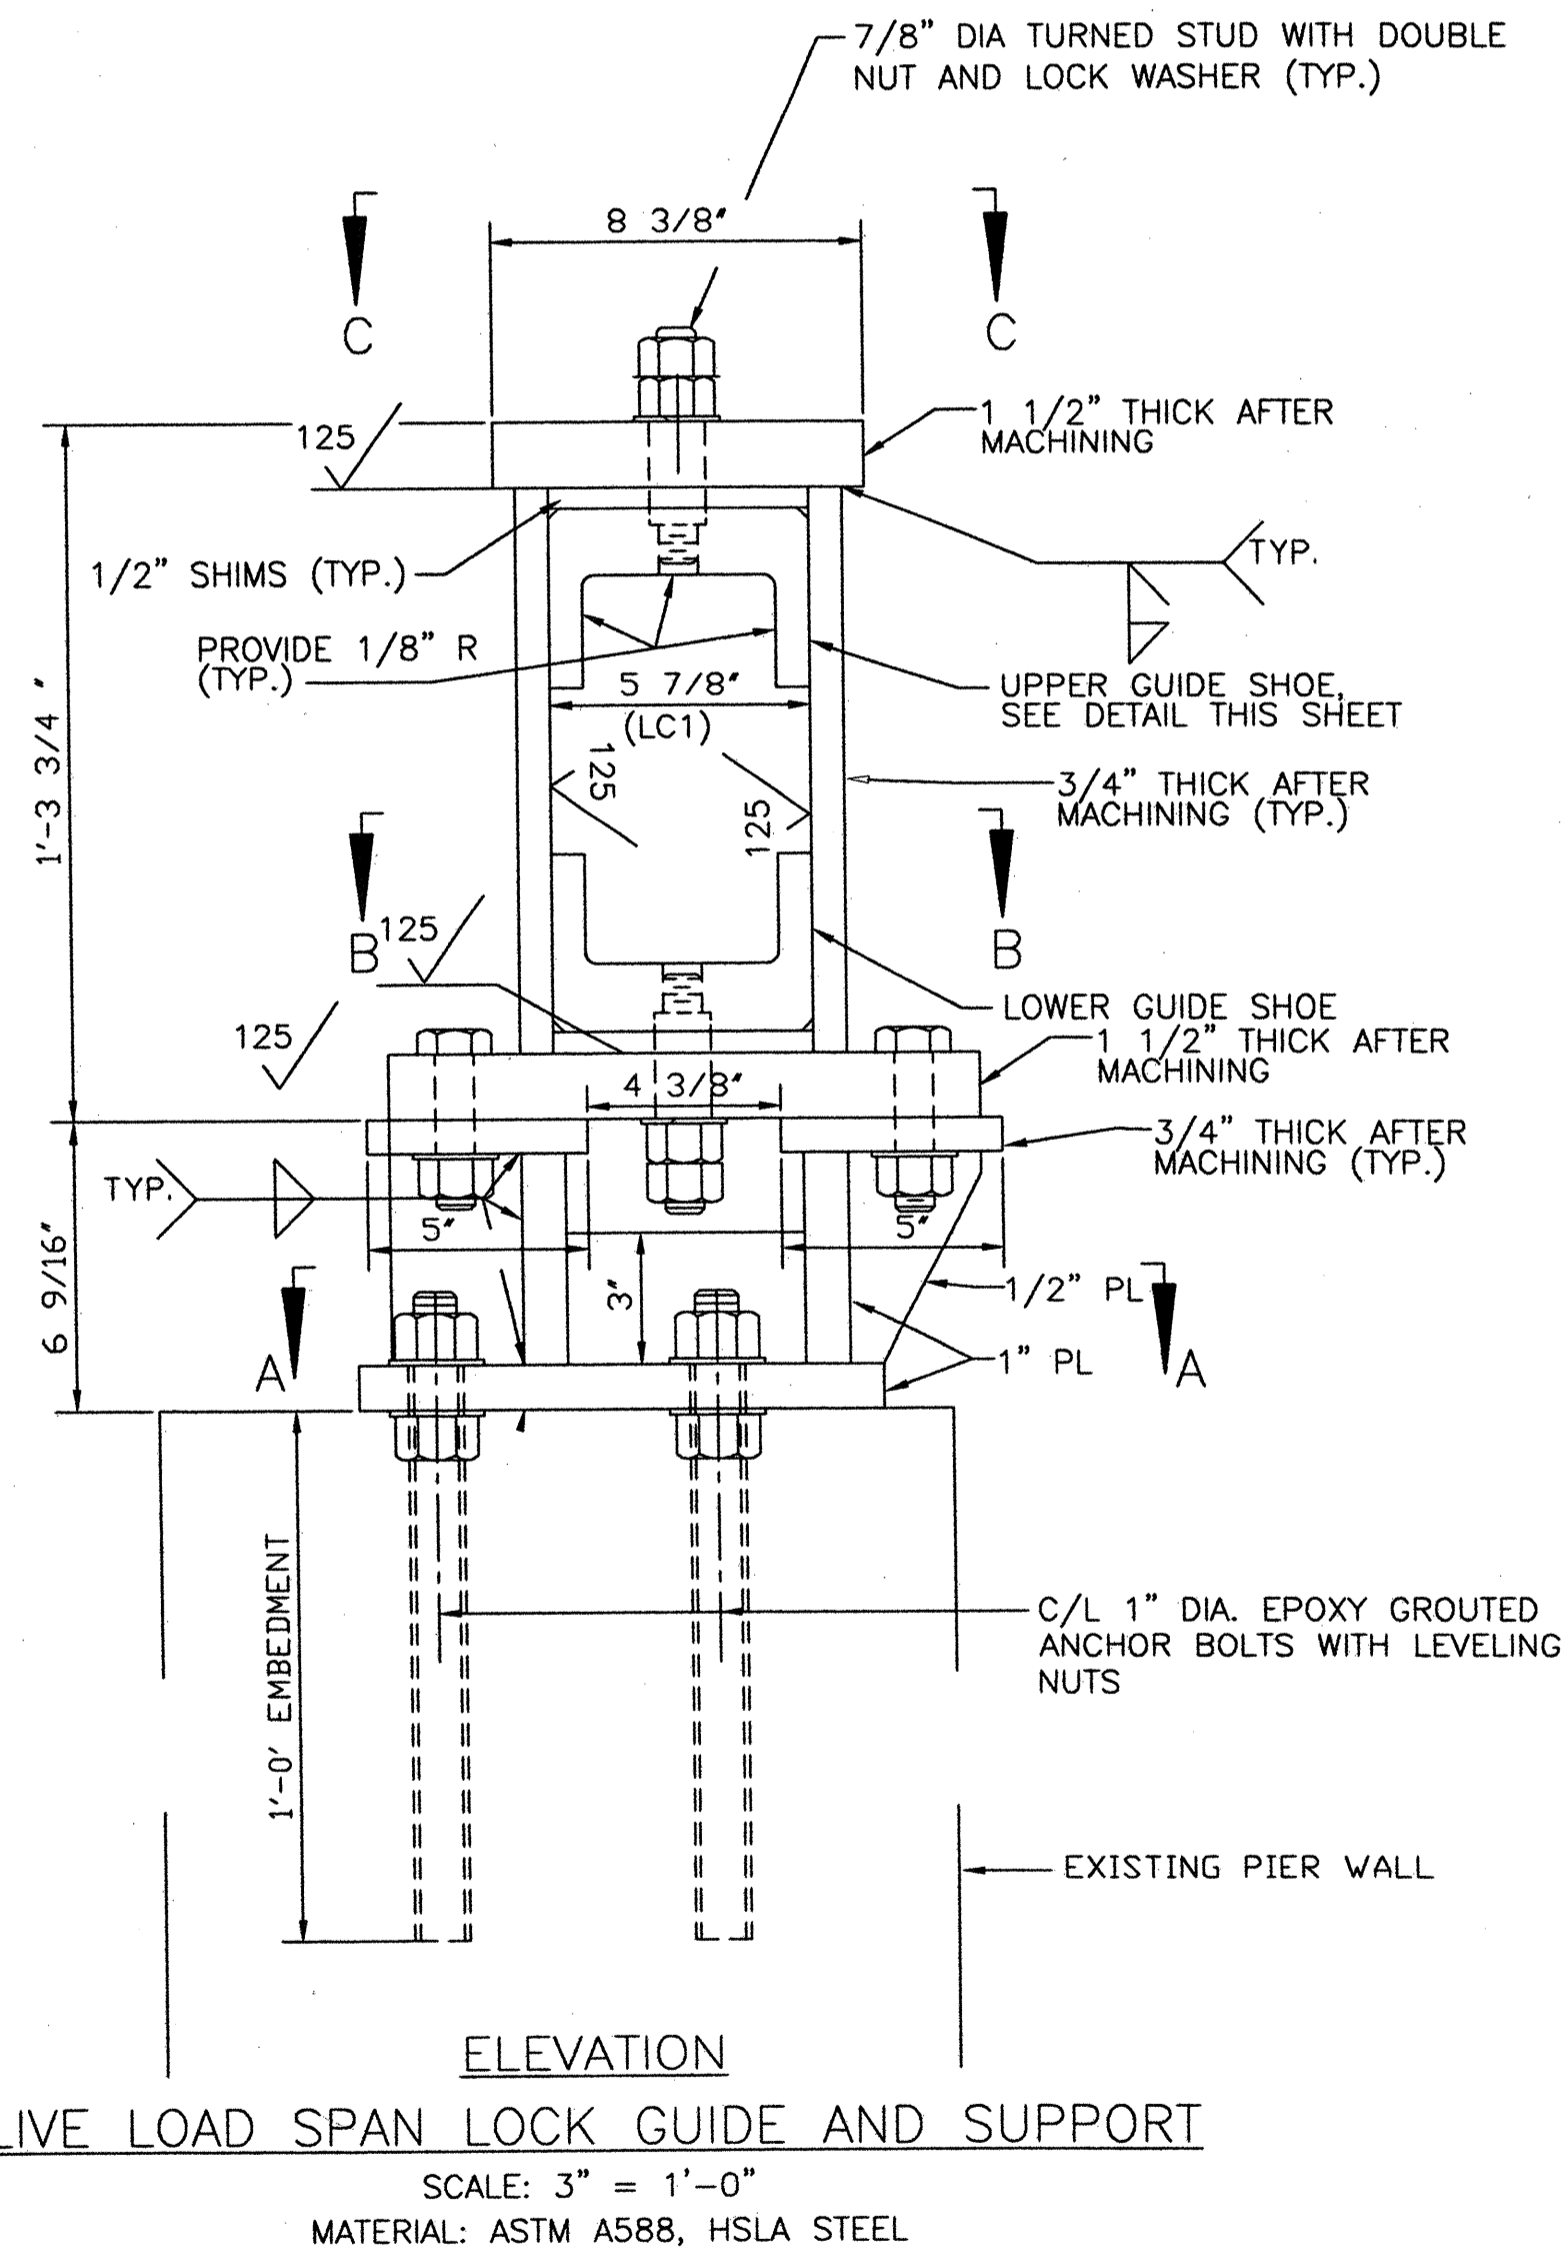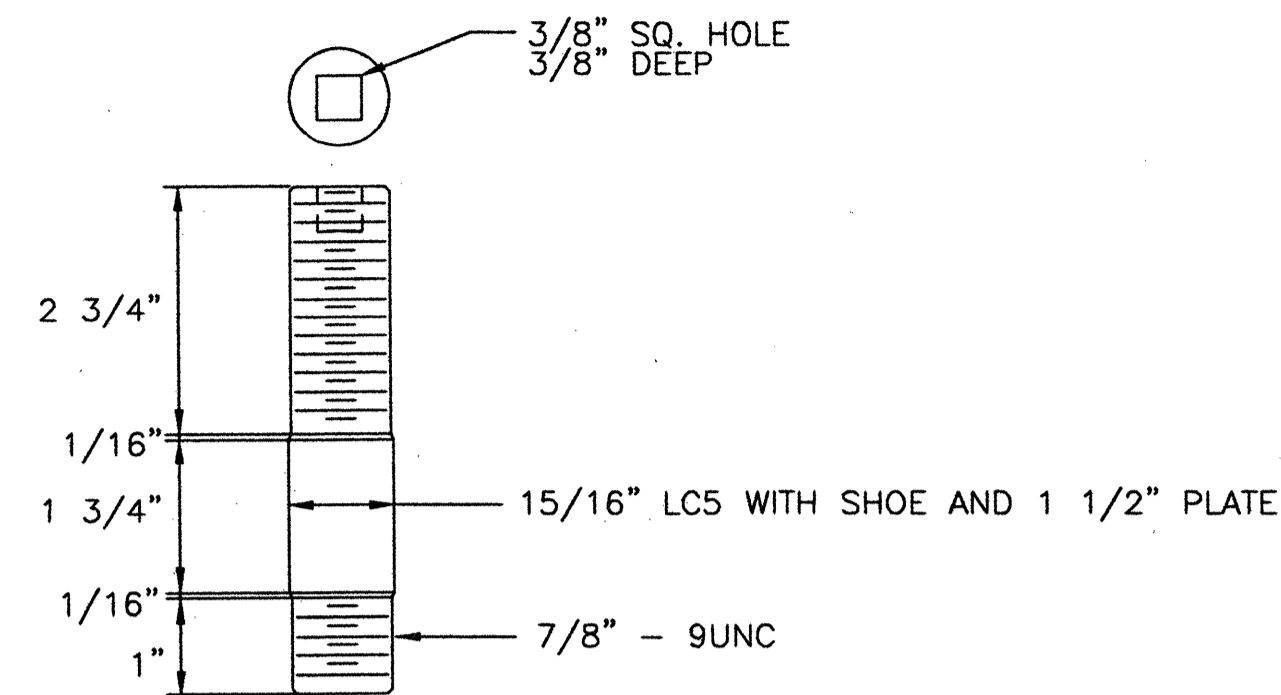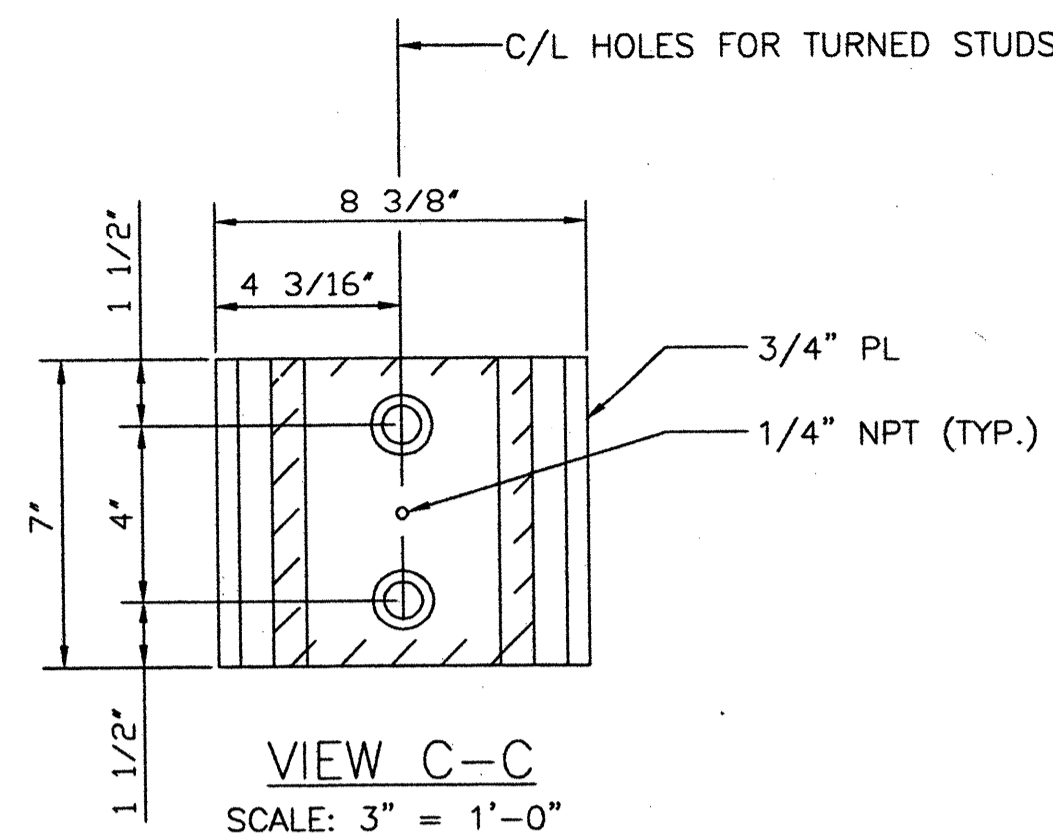

NOTES:


1. ALL ITEMS NEW UNLESS NOTED OTHERWISE.
2. ALL WELDMENTS SHALL BE STRESS RELIEVED BY HEAT PRIOR TO MACHINING.
3. VERTICAL FIT WITH NEW LOCK BAR TO BE $1/8" \pm 0.030$.
4. GREASE PASSAGES FOR TOP AND BOTTOM GUIDE SHOES TO BE RUN TO CONVENIENT LOCATION FOR MAINTENANCE PERSONNEL.
5. TURNED STUD THREAD LENGTH MUST BE OPTIMIZED AFTER FINAL ALIGNMENT TO PROVIDE CLEARANCE AT BOTTOM GUIDE SHOE.

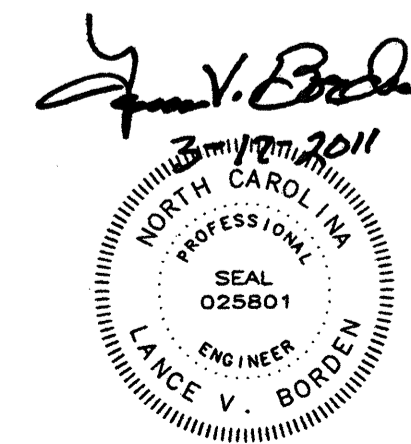


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
NEW LIVE LOAD SPAN LOCK -
DETAILS 3

DESIGNED	G.L. FOREST	DETAILED	G.L. FOREST	DATE	MARCH 2011
CHECKED	D.M. BARRETT	CHECKED	D.M. BARRETT	DRAWING NO.	13 OF 63



MB12

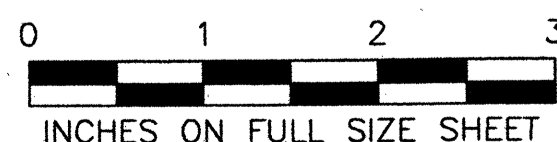

INCHES ON FULL SIZE SHEET

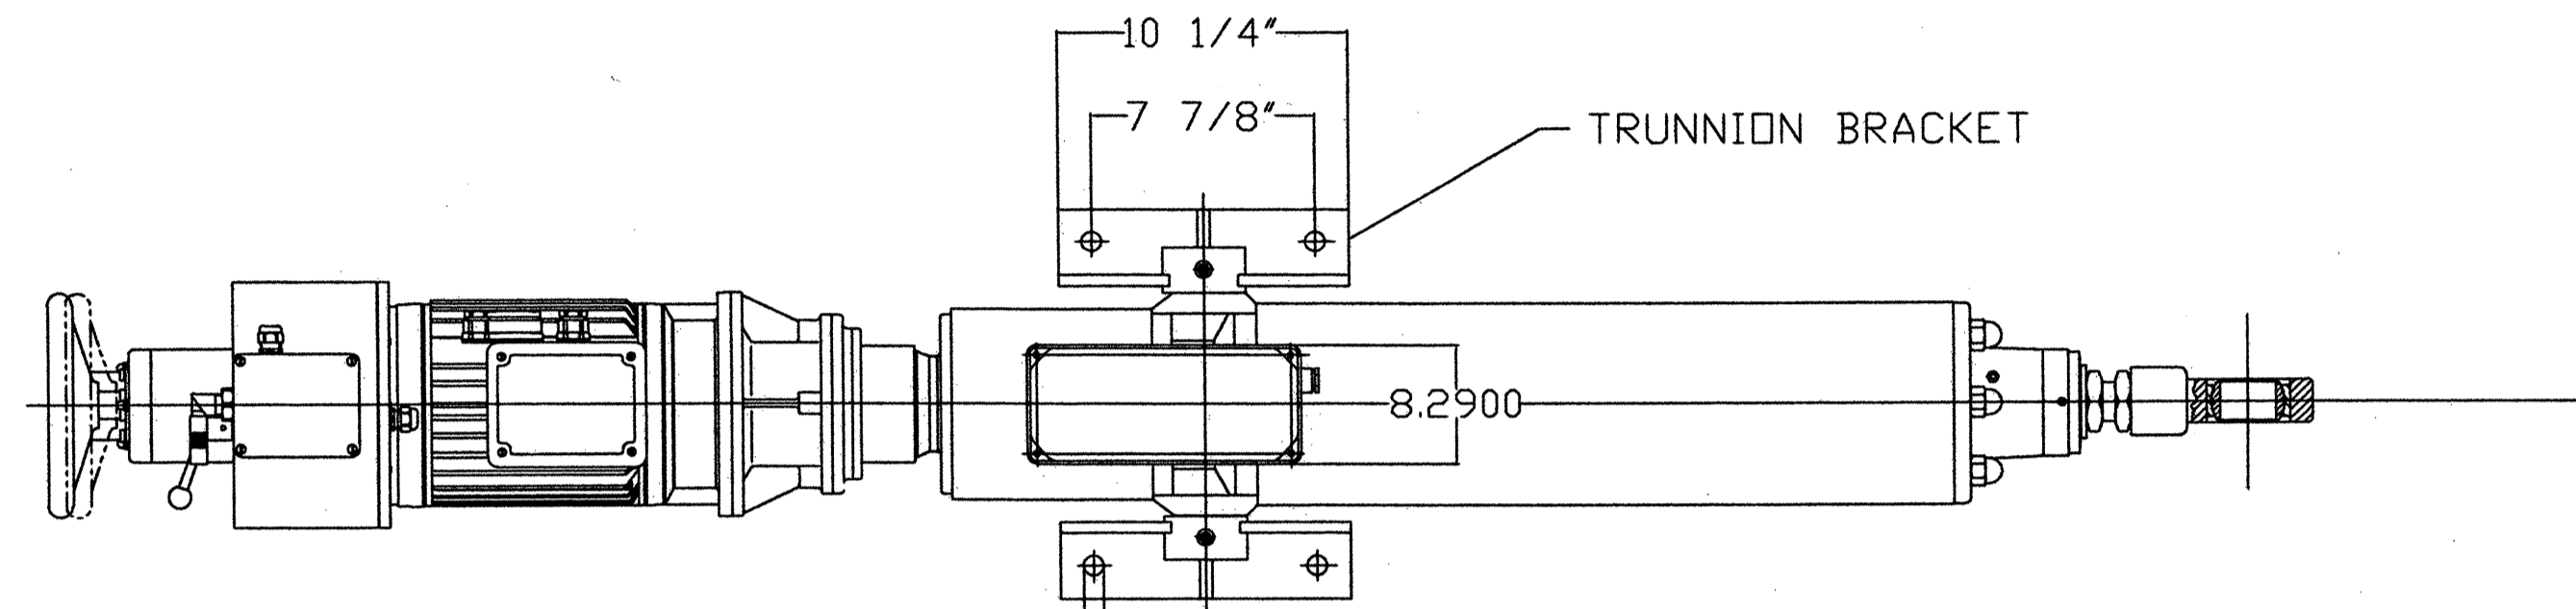

REAM FOR 3/4" A325 TURNED BOLTS AT FINAL ALIGNMENT

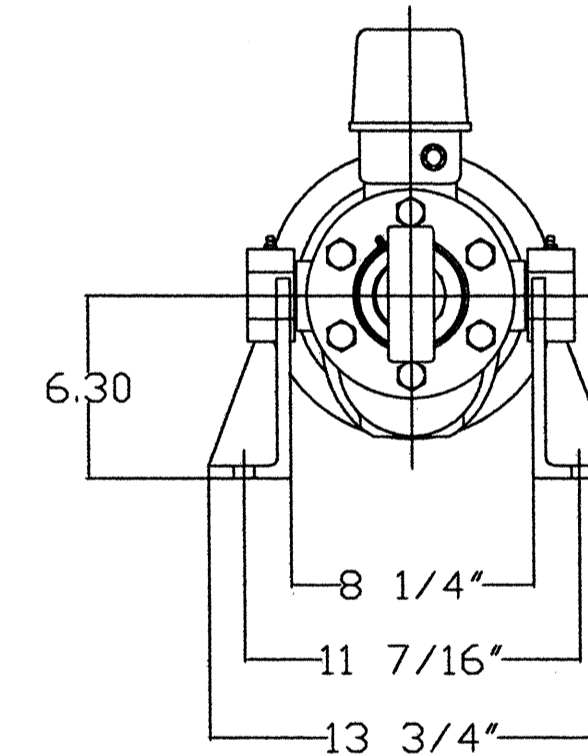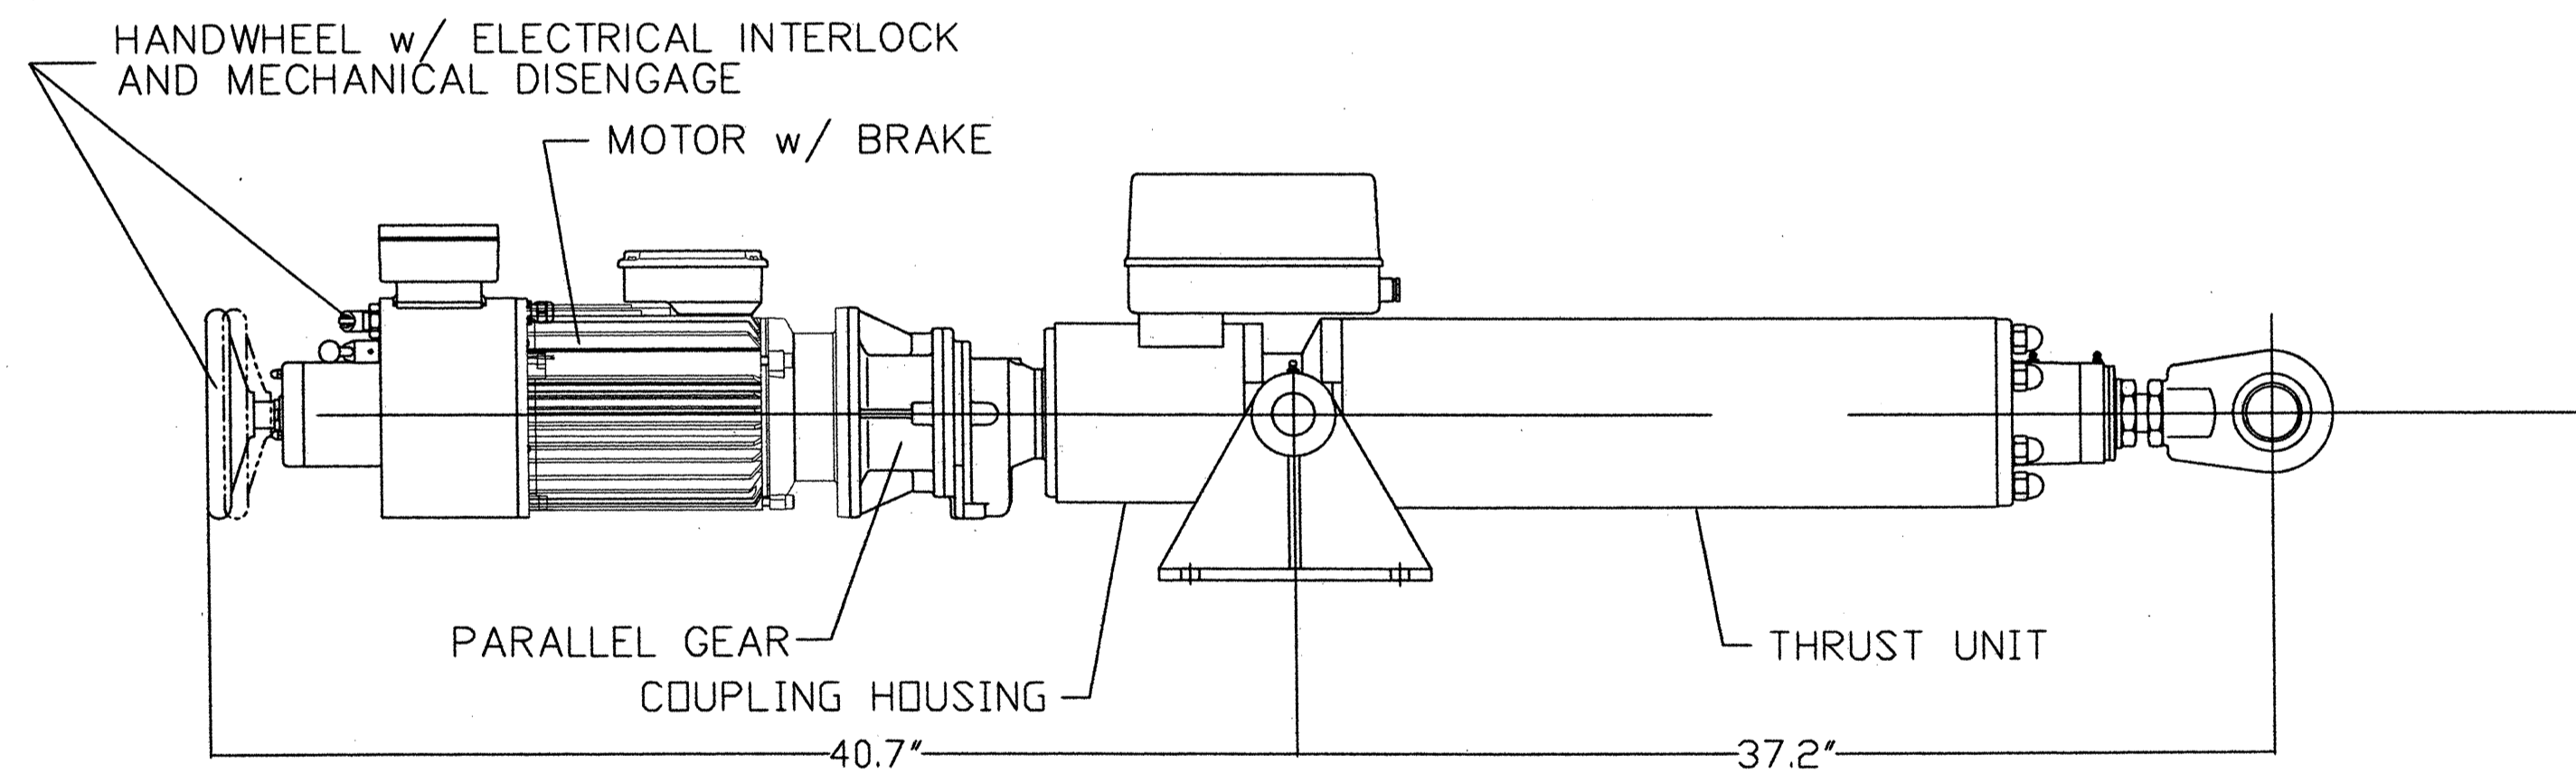


PLAN
LIVE LOAD SPAN LOCK ACTUATOR


SCALE: 1" = 1'-0"

NOTES:

1. THIS DRAWING IS PROVIDED FOR REFERENCE ONLY. ACTUATOR DIMENSIONS MUST BE VERIFIED BEFORE ORDERING. THE ACTUATOR IS SHOWN IN FULLY RETRACTED POSITION.
2. THE CONTRACTOR SHALL PROVIDE AN ACCESS LADDER FOR EACH LIVE LOAD SPAN LOCK SUPPORT. THE LADDER SHALL BE INSTALLED ONLY AFTER THE LOCATION AND LADDER STYLE HAVE BEEN APPROVED BY NCDOT.

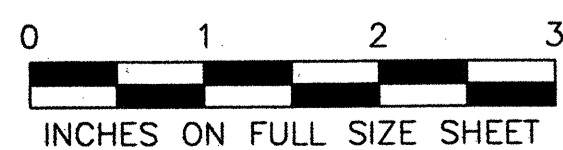

INCHES ON FULL SIZE SHEET

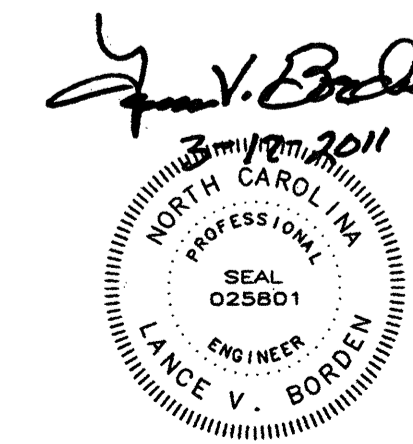

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
NEW LIVE LOAD SPAN LOCK -
DETAILS 4

DRAWN BY E.A. RICKENBACH

SCALE AS NOTED


DATE MARCH 2011

DRAWING NO. 14 OF 63


MB13

DESIGNED D.M. BARRETT
CHECKED L.V. BORDEN


DETAILED D.M. BARRETT
CHECKED L.V. BORDEN

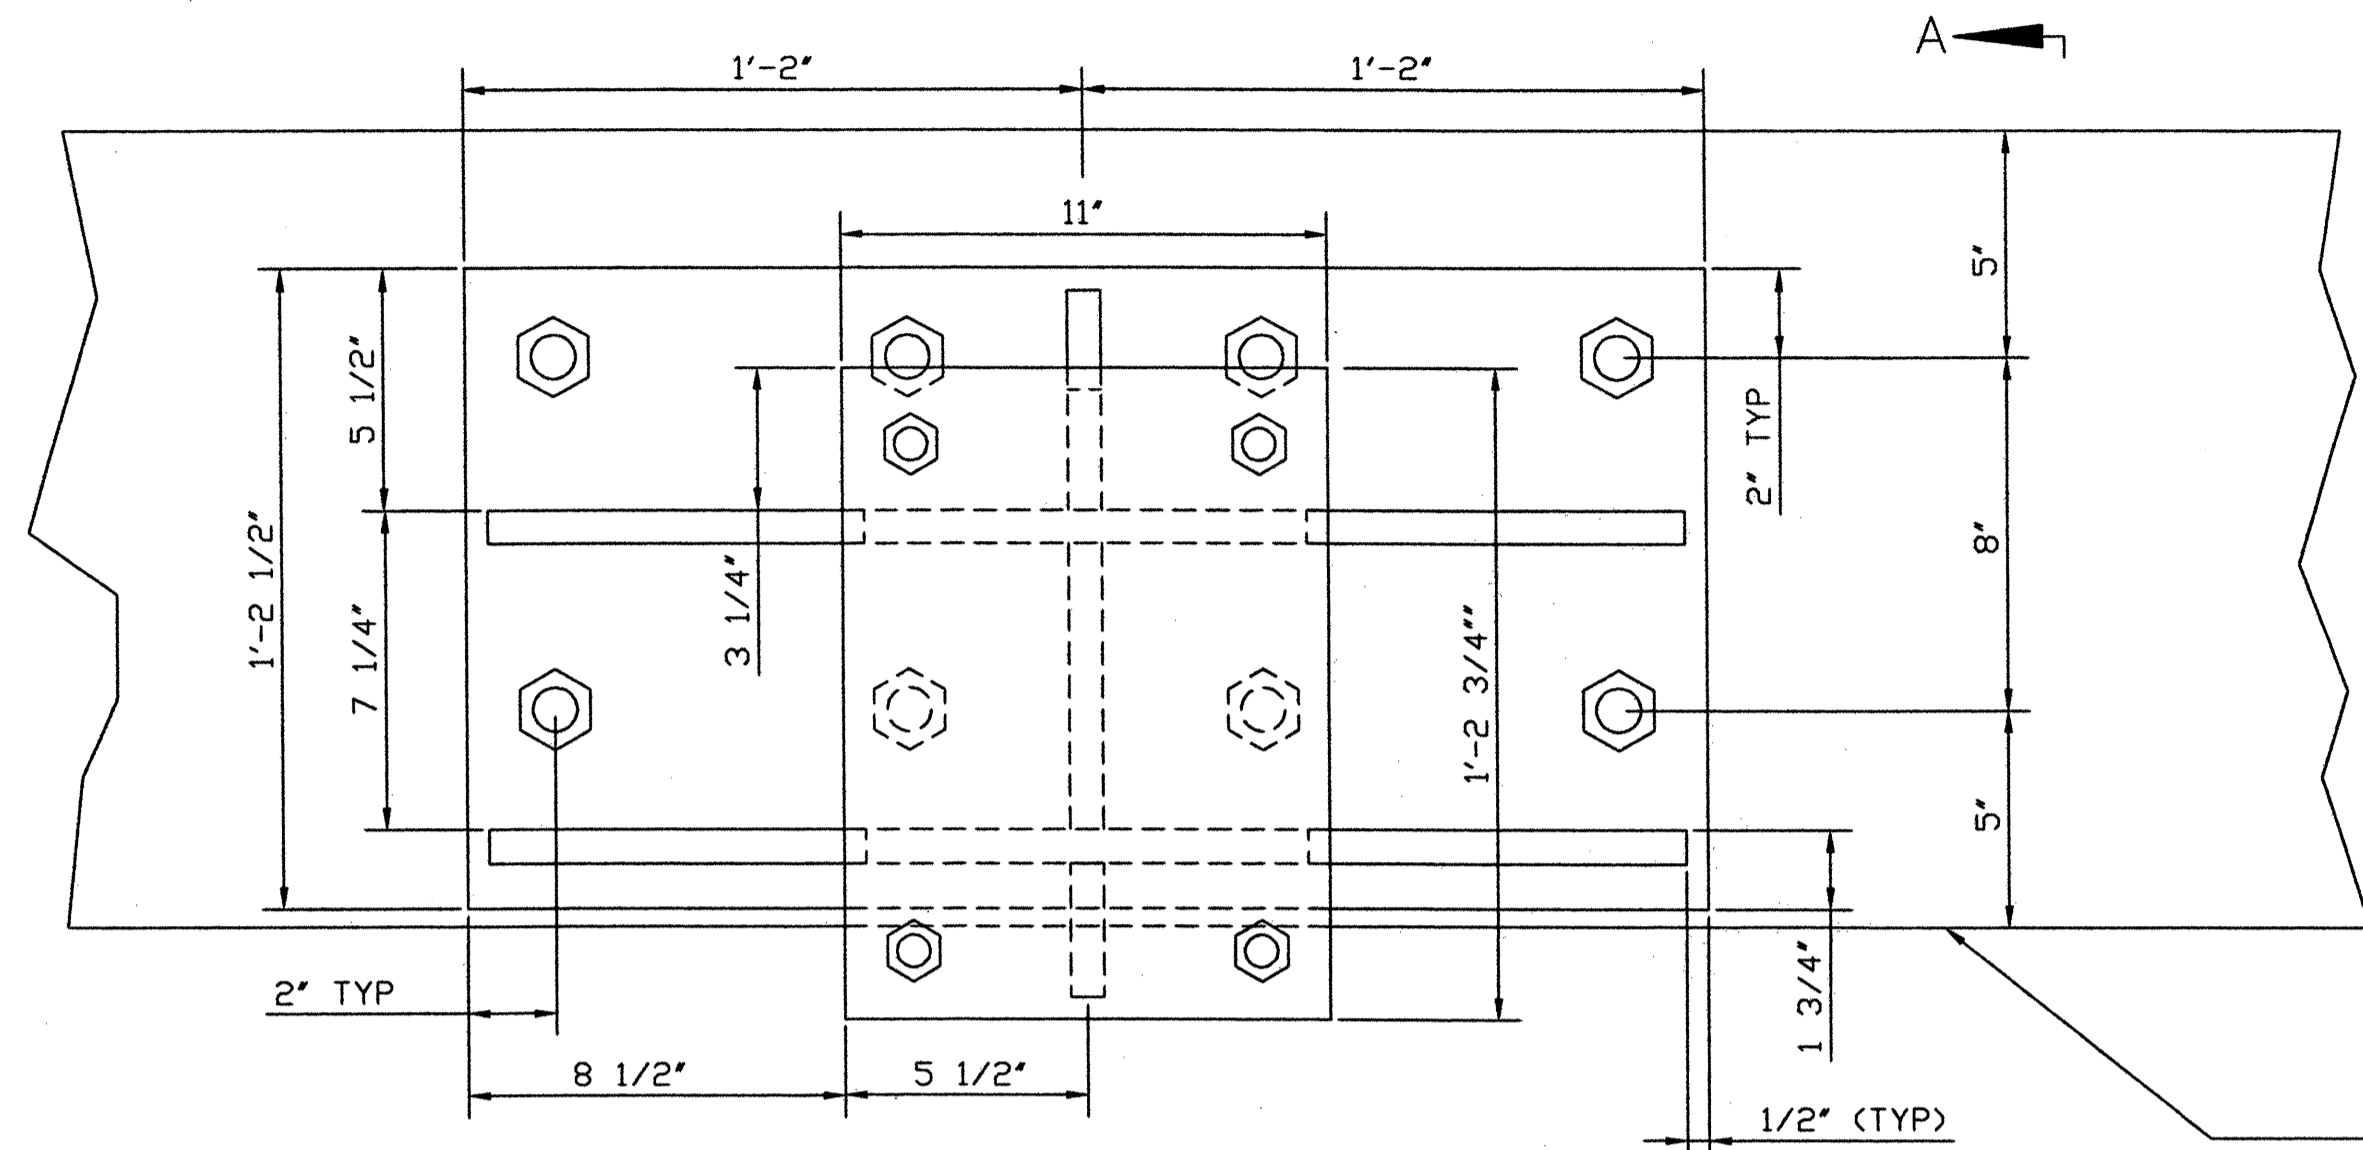

PLAN
NEW TRUNNION SUPPORT BRACKET
SCALE: 3" = 1'-0"

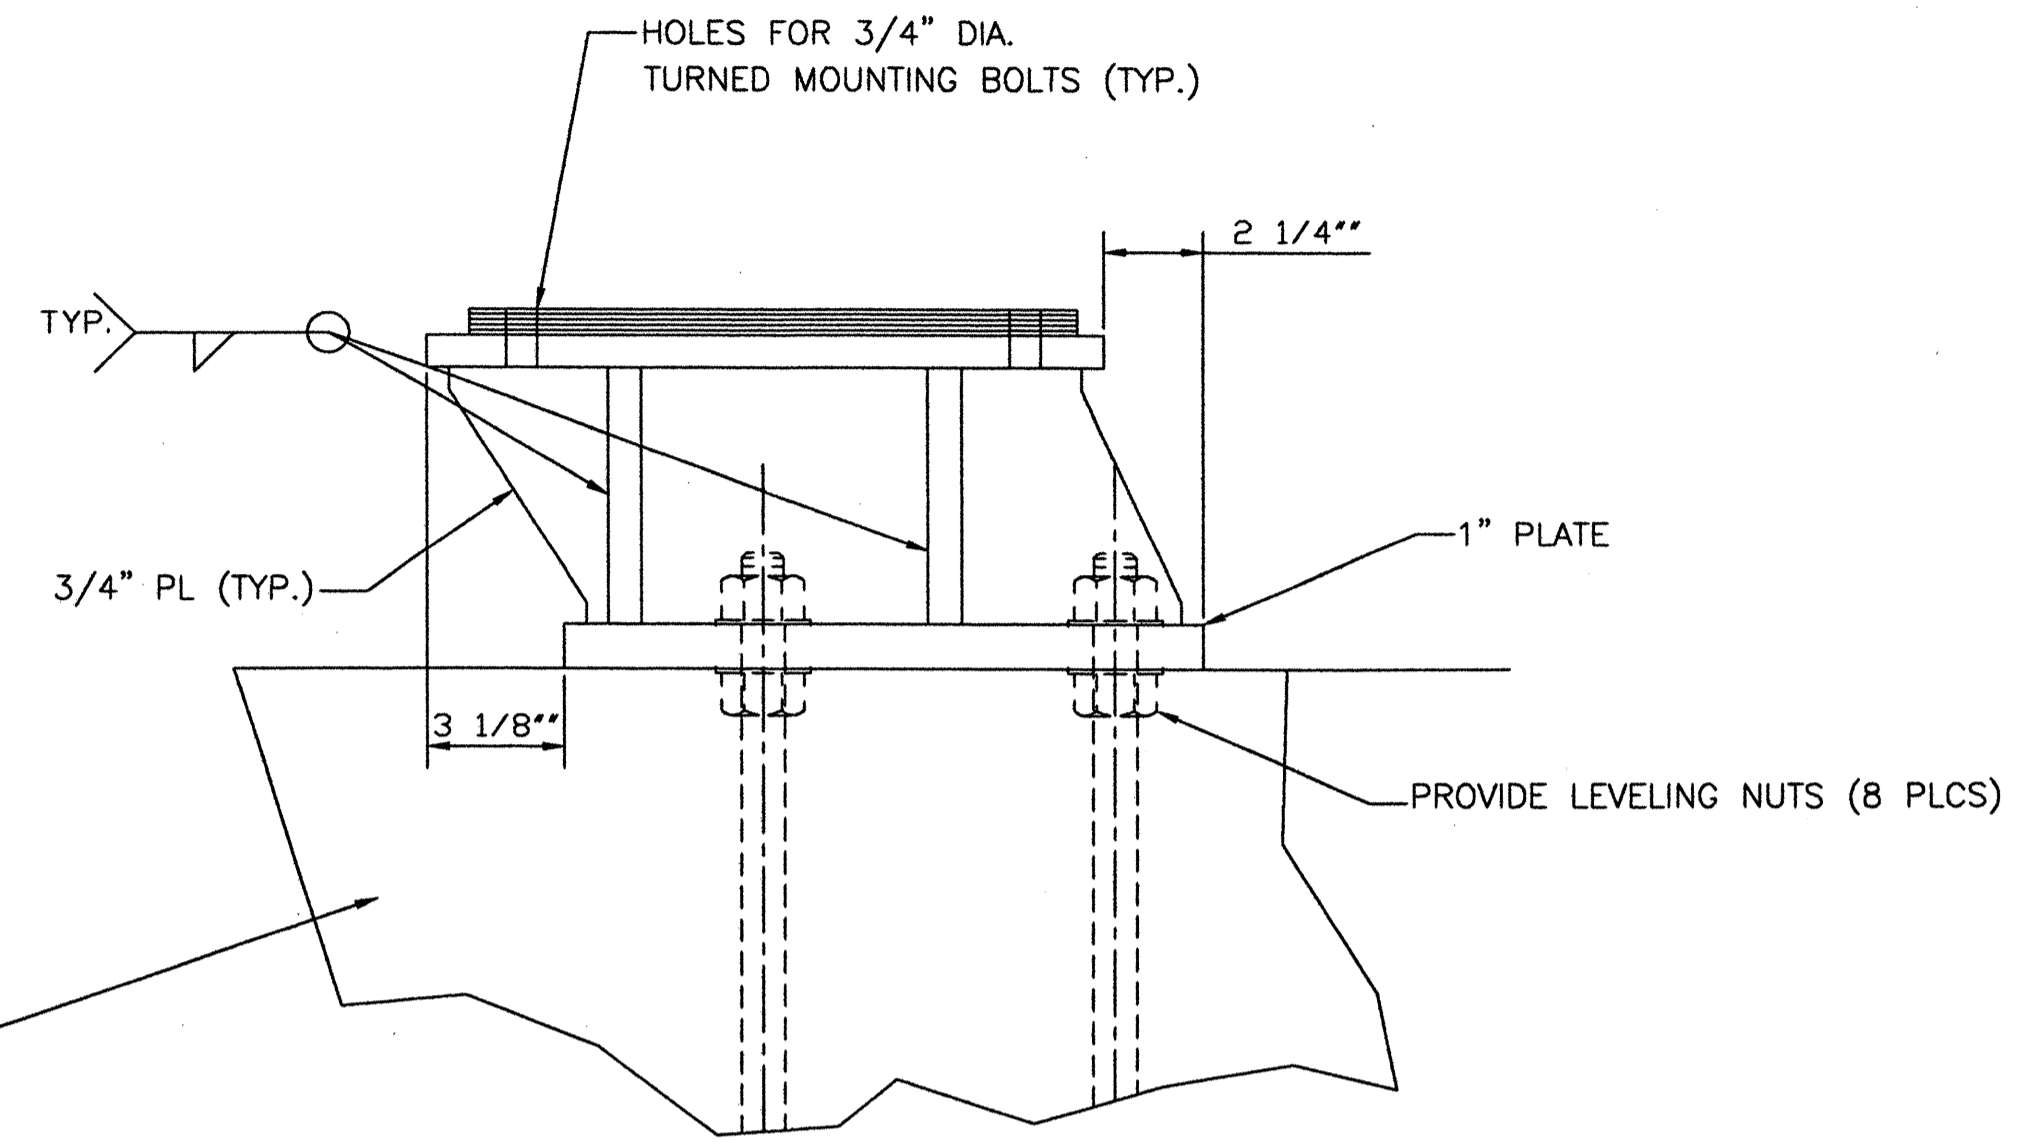



SECTION A-A
SCALE: 3" = 1'-0"

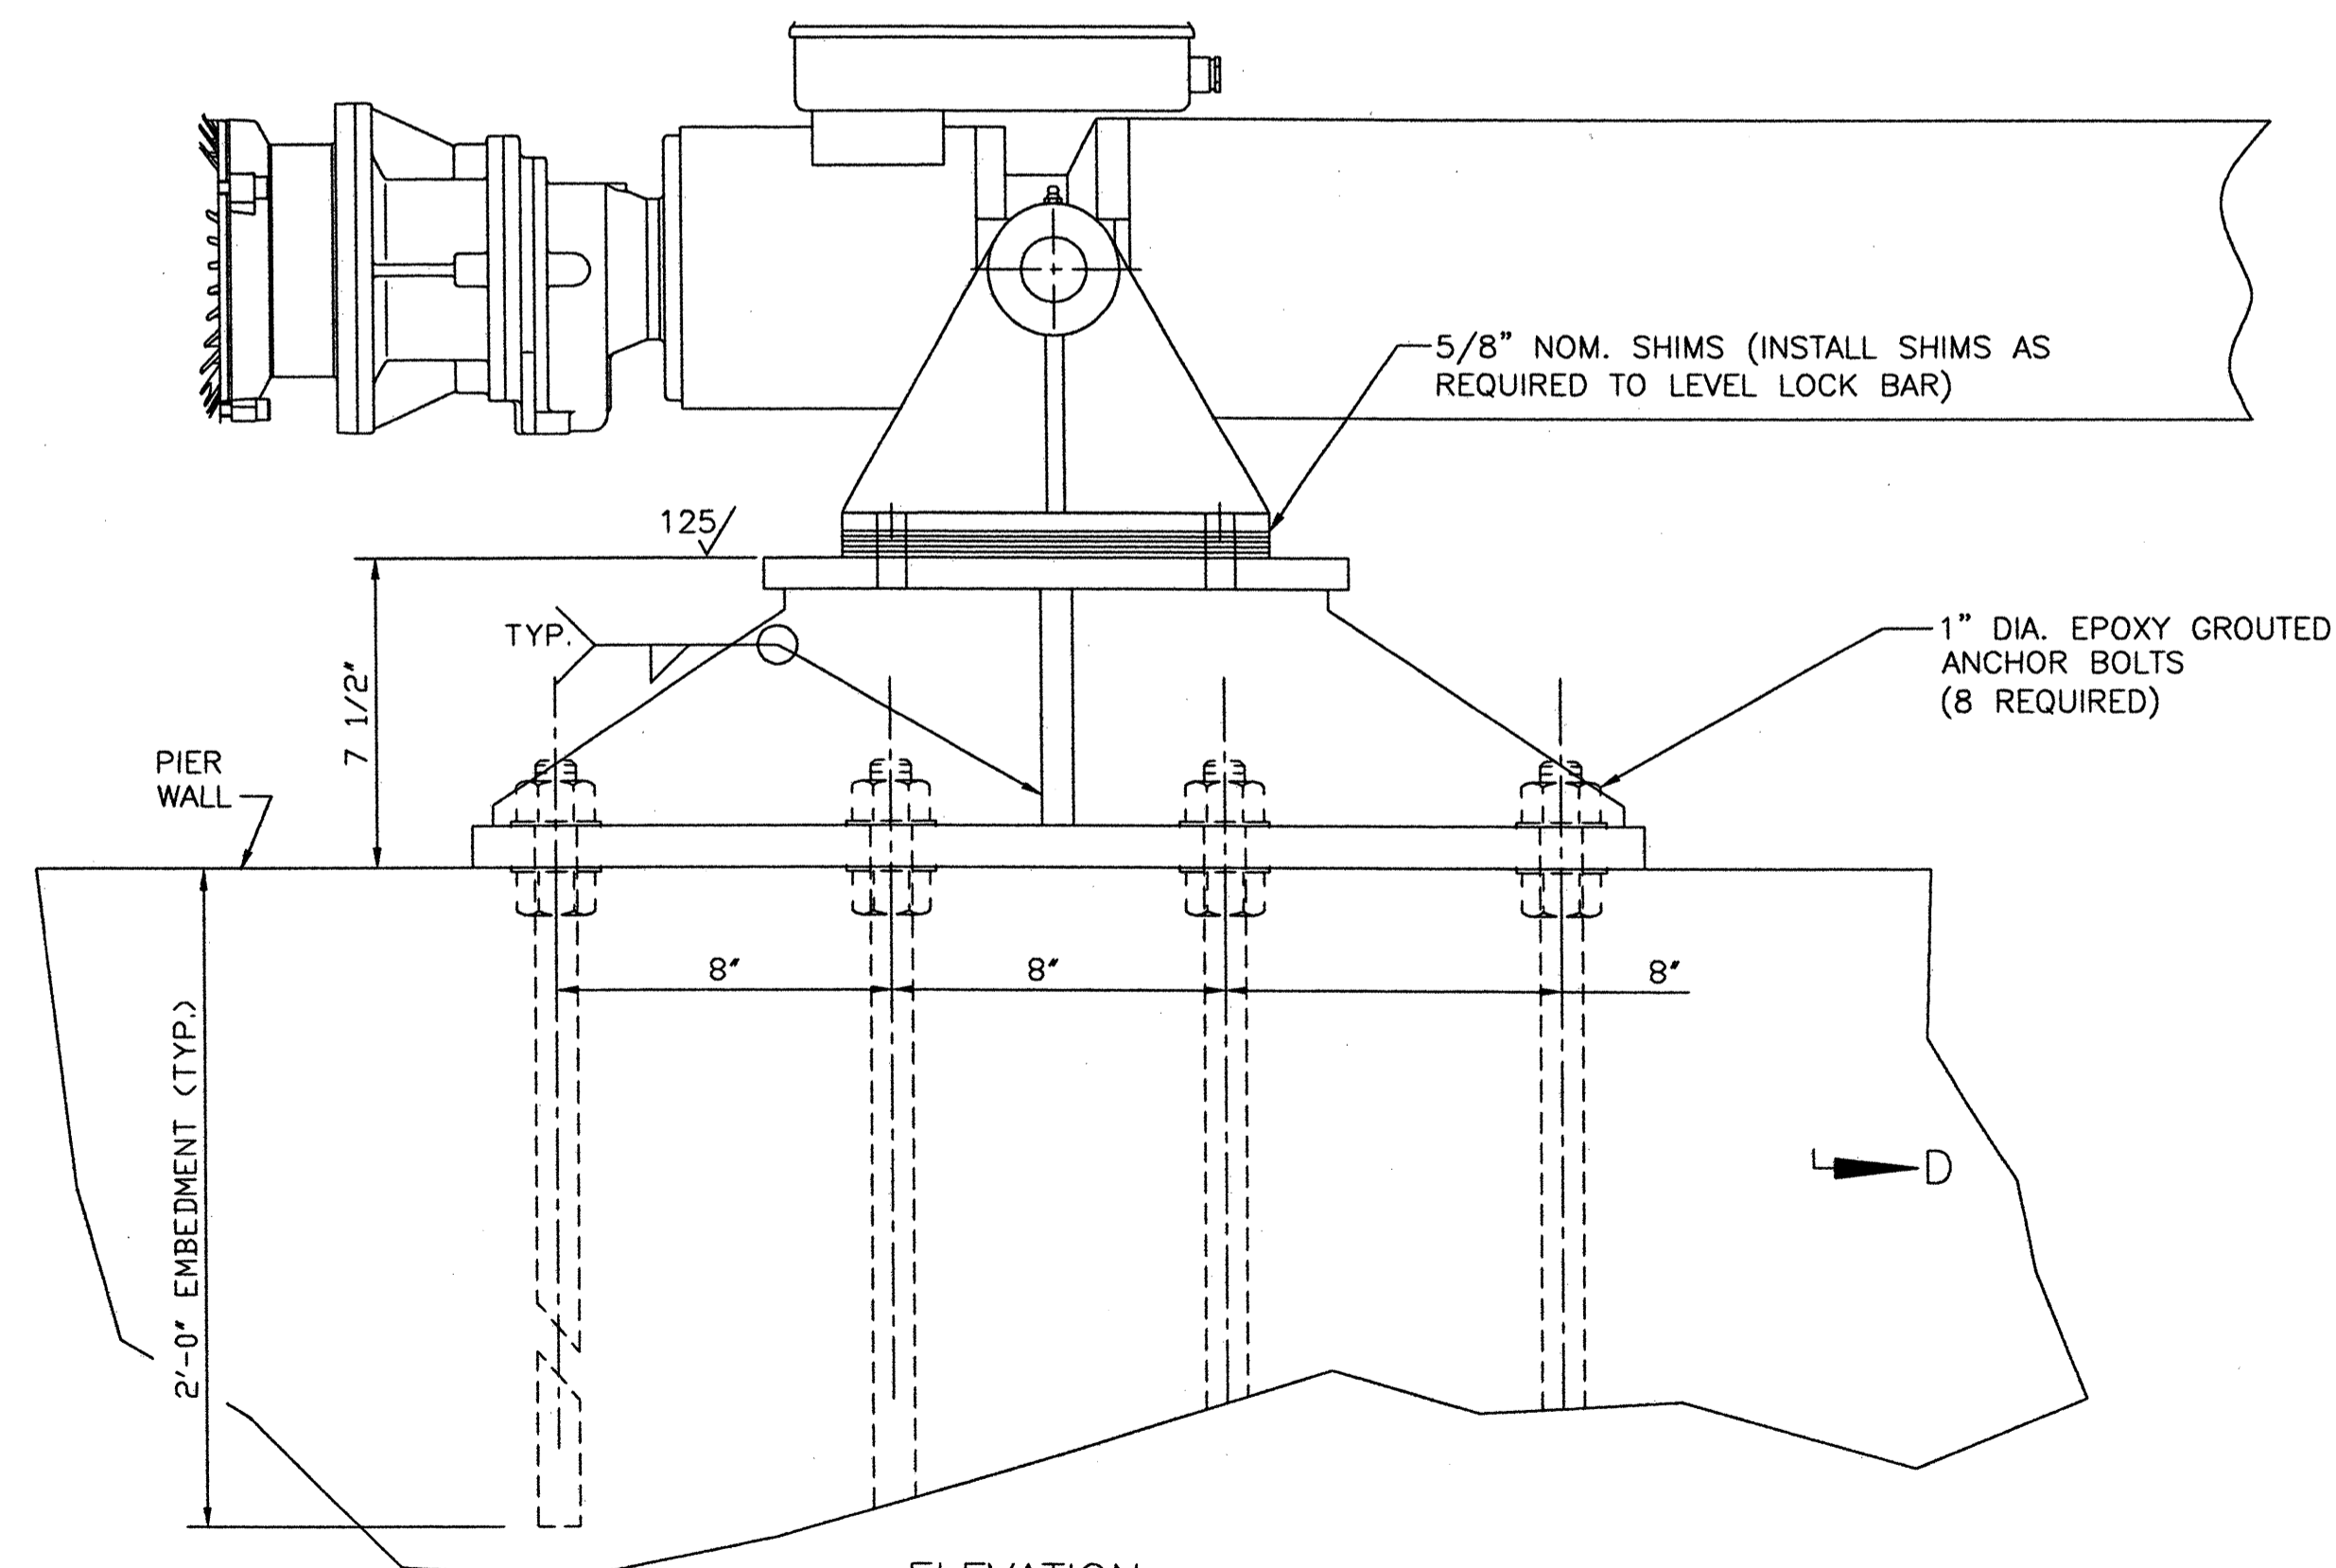

ELEVATION
NEW TRUNNION SUPPORT BRACKET
SCALE: 3" = 1'-0"

NOTES:


1. ALL STEEL PLATES AND SHAPES SHALL BE ASTM A36.
2. ALL GROUTED ANCHOR BOLTS AND ANCHOR RODS SHALL BE ASTM F1554 GRADE 55 WITH HS NUTS AND HARDENED WASHERS.
3. ALL OTHER FASTENERS SHALL BE ASTM A325 WITH HS NUTS AND HARDENED WASHERS.
4. ALL NEW STEEL SHALL BE PAINTED WITH A PAINT SYSTEM APPROVED BY NCDOT.
5. ALL WELDMENTS SHALL BE STRESS RELIEVED BY HEAT PRIOR TO MACHINING.
6. MOUNTING BOLTS FOR ACTUATOR TO BE DRILLED UNDERSIZED AND NOT REAMED UNTIL FINAL ALIGNMENT IS ACHIEVED.

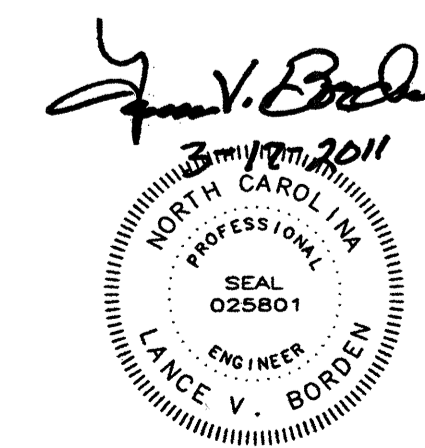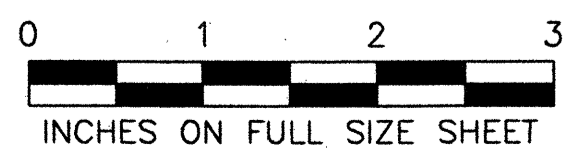


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
NEW LIVE LOAD SPAN LOCK -
DETAILS 5

DRAWN BY E.A. RICKENBACH	
SCALE AS NOTED	
DESIGNED D.M. BARRETT	DATE MARCH 2011
DETAILED D.M. BARRETT	CHECKED L.V. BORDEN
CHECKED L.V. BORDEN	DRAWING NO. 15 OF 63


15-MB14-NLSUSD5.DWG

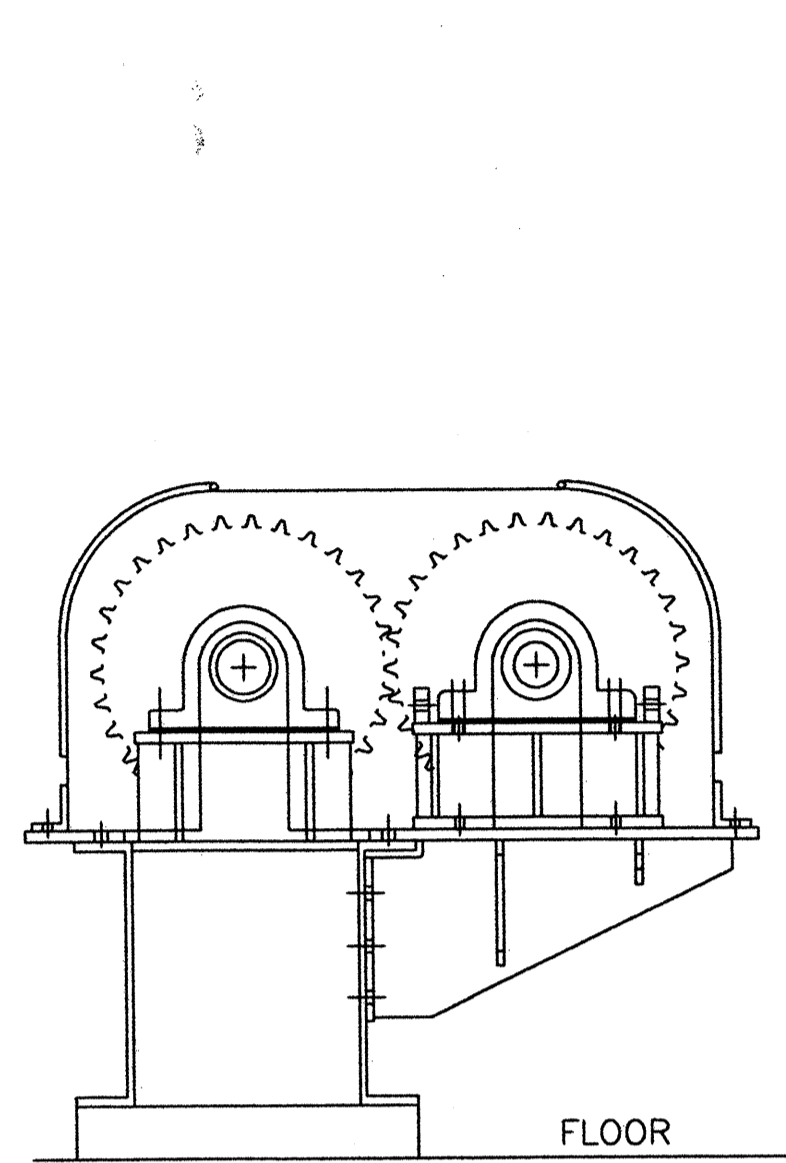


VIEW A-A
SCALE: 1" = 1'-0"

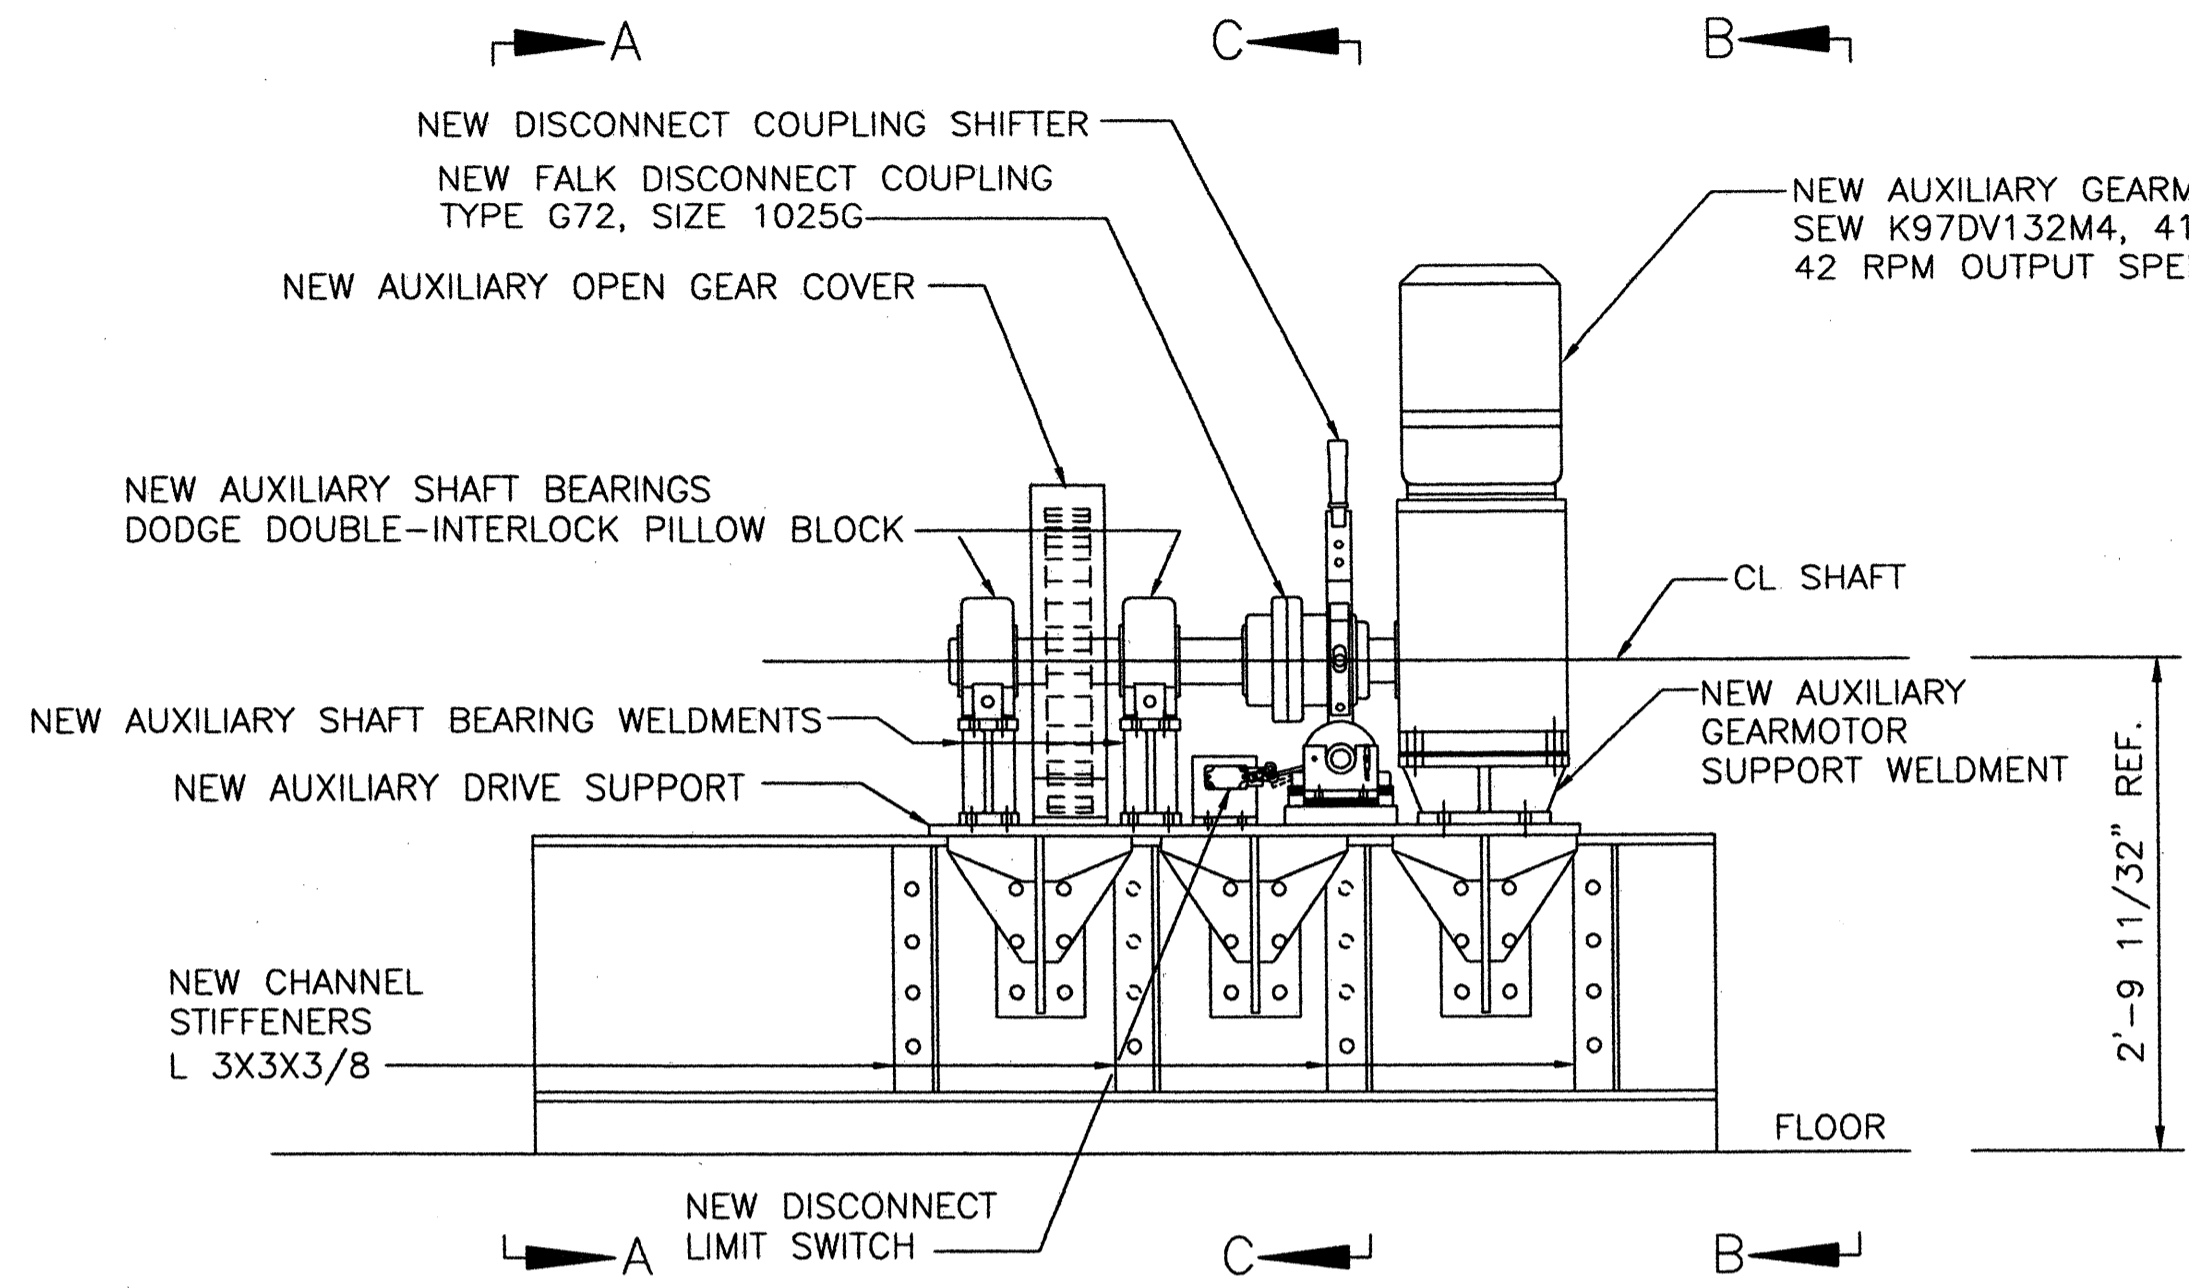


ELEVATION
SCALE: 1" = 1'-0"

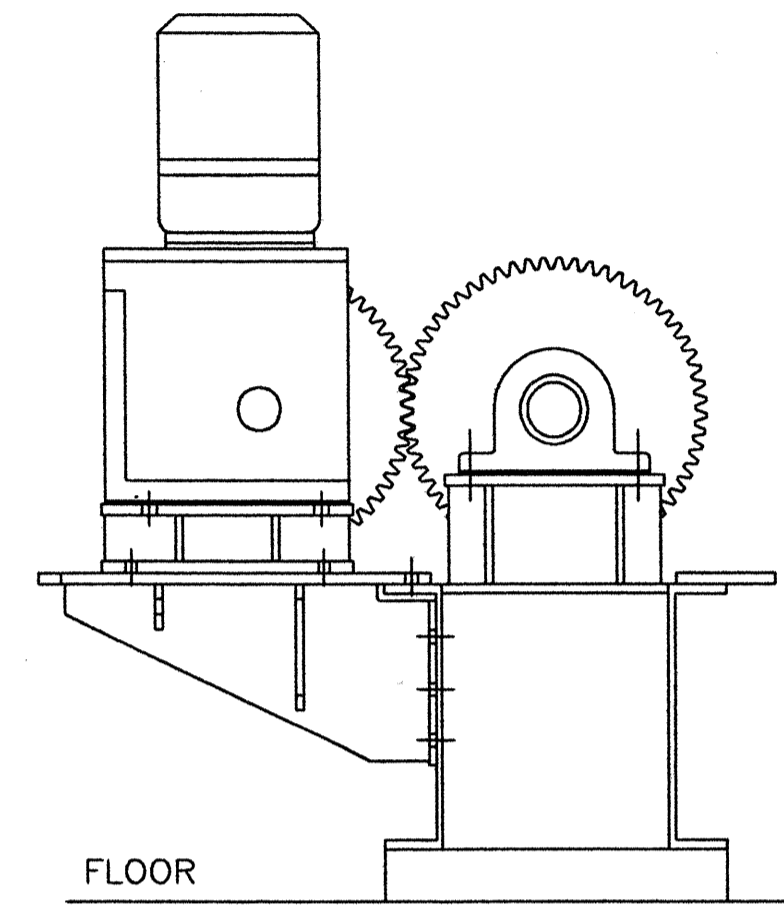


VIEW B-B
SCALE: 1" = 1'-0"
(GEAR COVER NOT SHOWN)

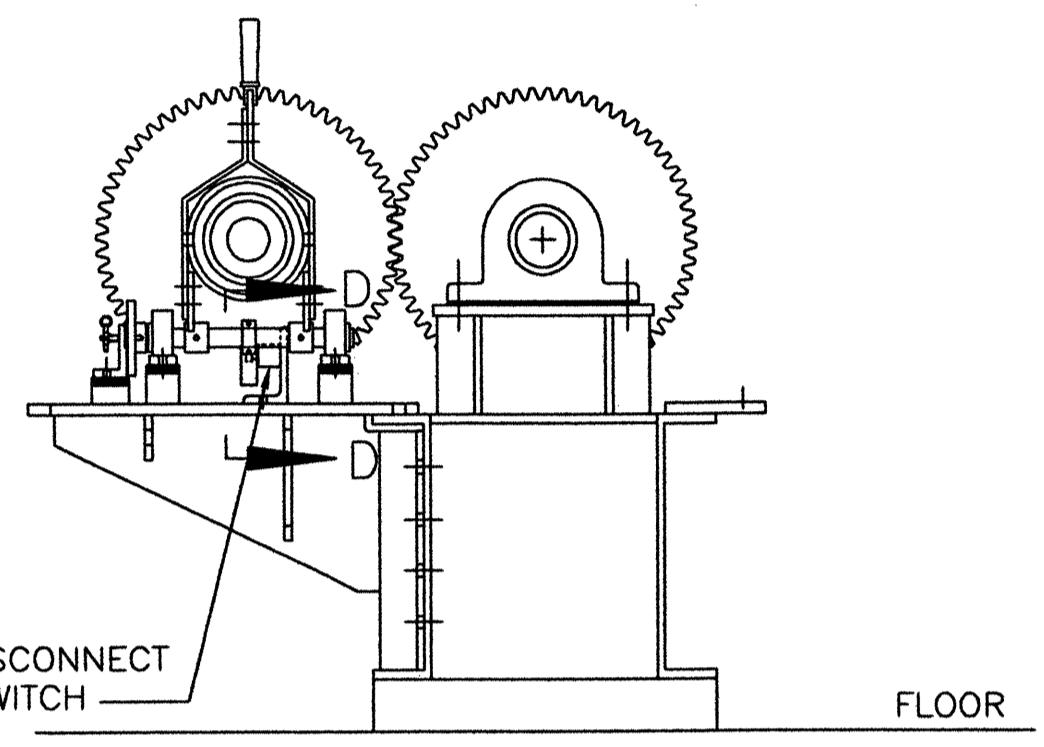


SECTION C-C
SCALE: 1" = 1'-0"
(GEAR COVER NOT SHOWN)

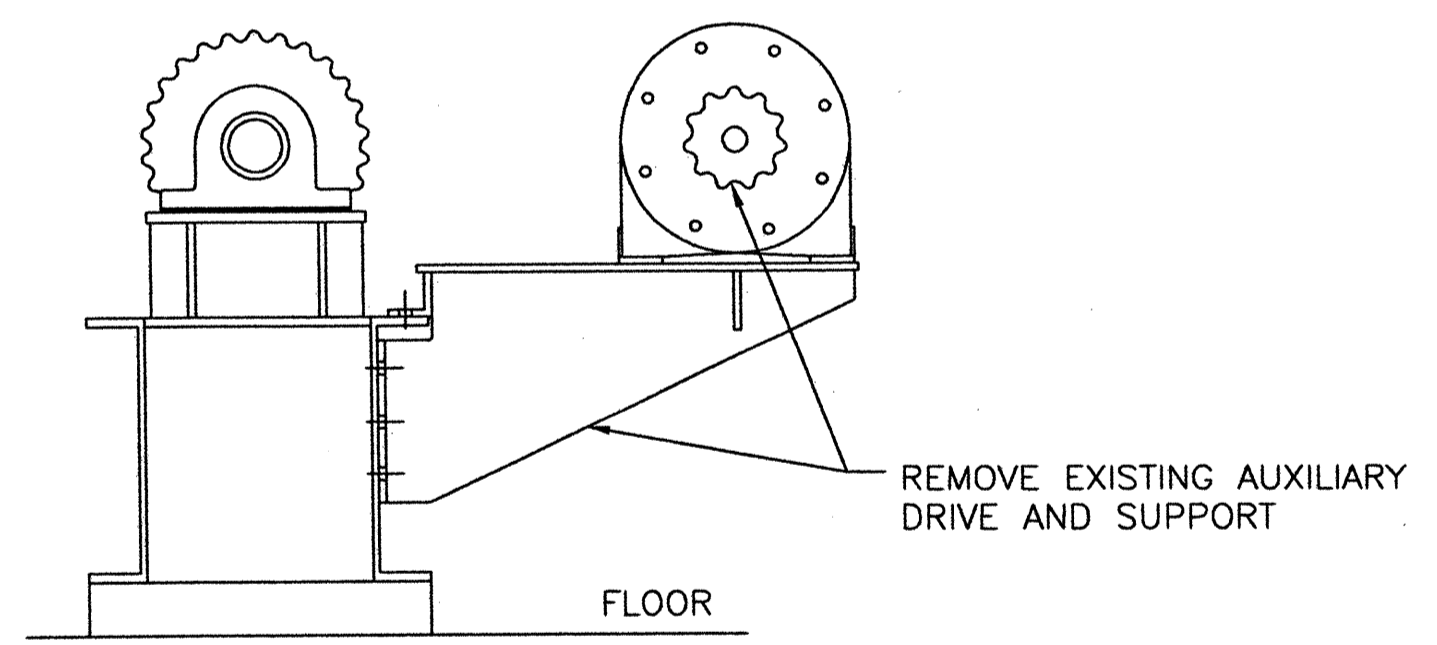

VIEW A-A
SCALE: 1" = 1'-0"
(EXISTING)

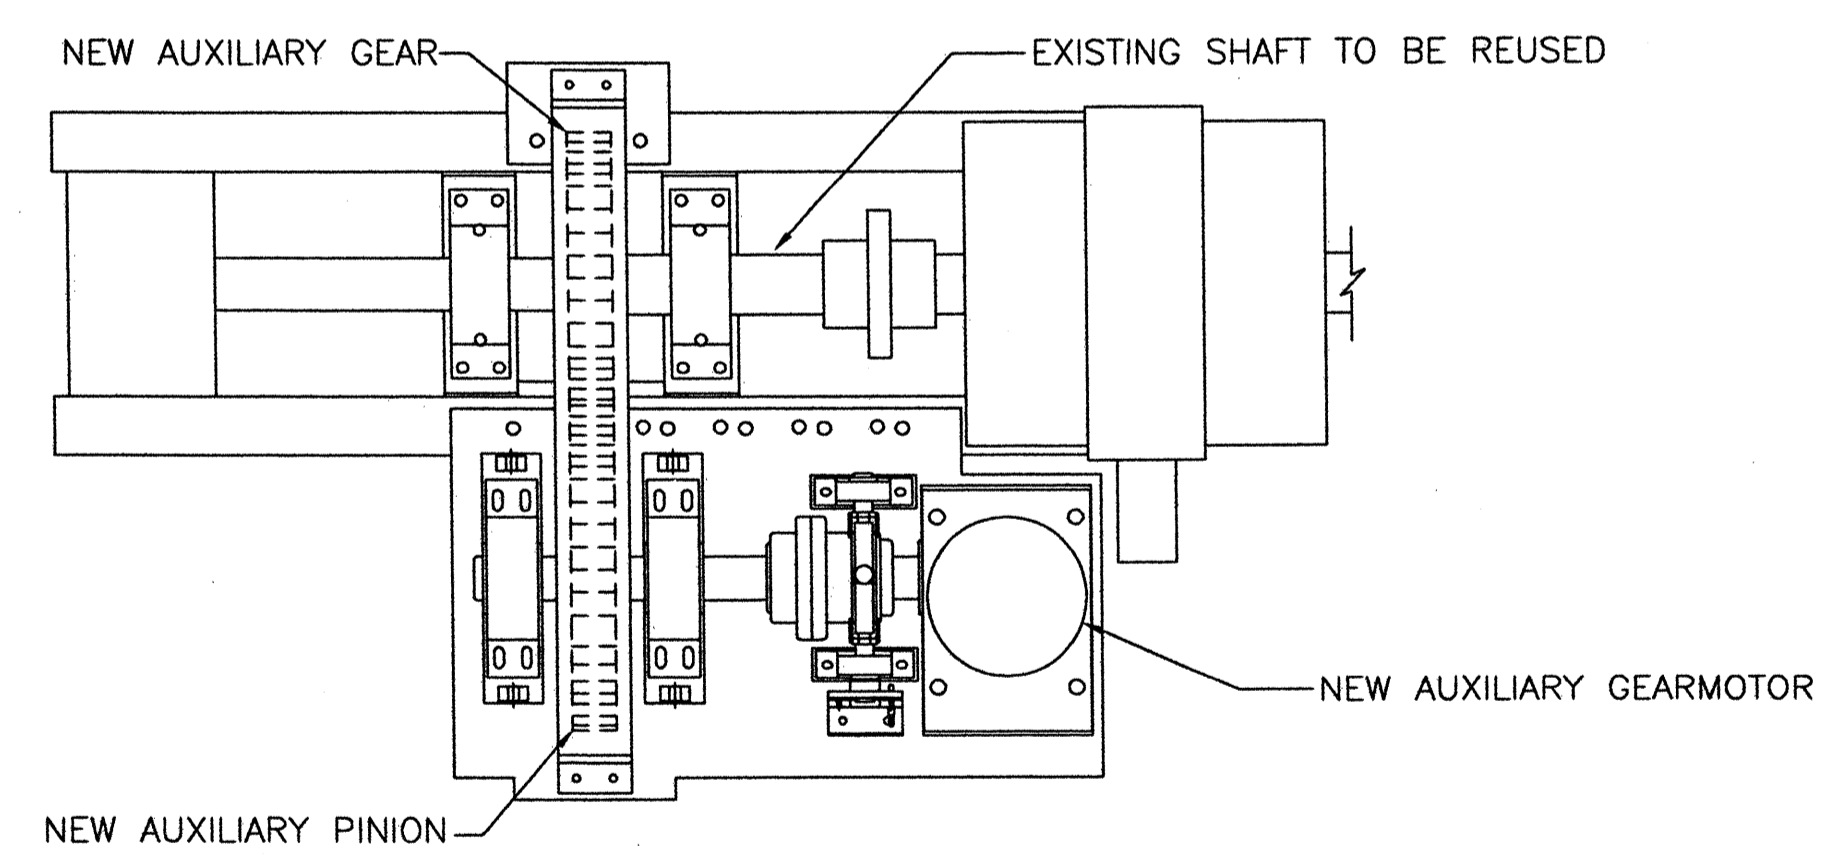



PLAN
AUXILIARY DRIVE SYSTEM
SCALE: 1" = 1'-0"

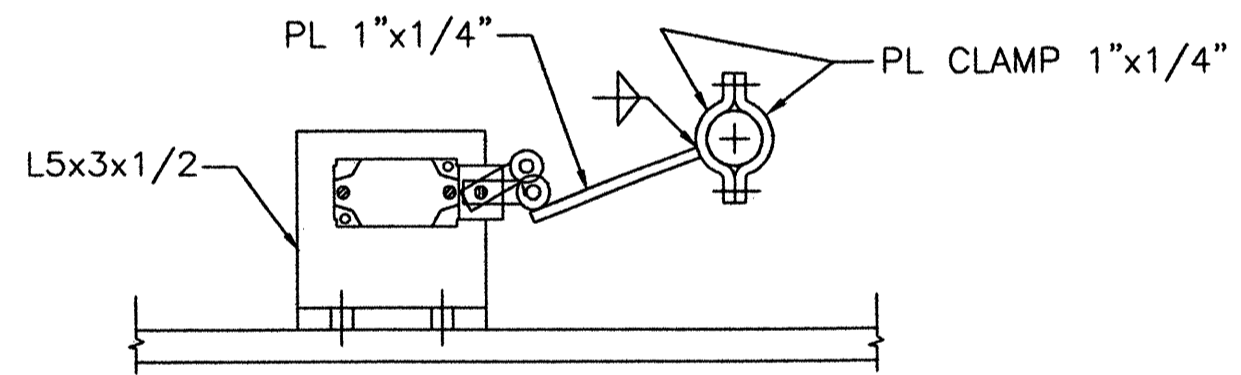

SECTION D-D
SCALE 3" 1'-0"


NOTES:

- EXISTING AUXILIARY DRIVE COMPONENTS AND SUPPORT TO BE REMOVED, SEE VIEW A-A (EXISTING).

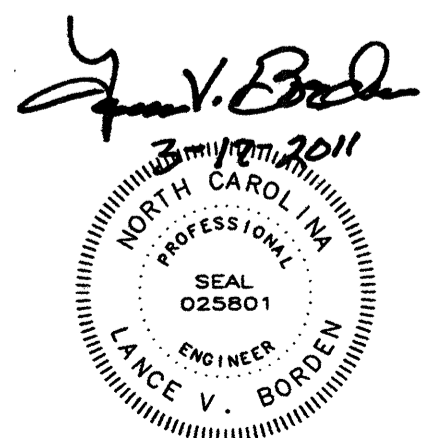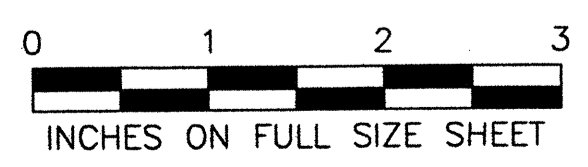

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW AUXILIARY DRIVE - LAYOUT			
DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	
DESIGNED A.M. BRODSKY	DETAILED A.M. BRODSKY	DATE	MARCH 2011
CHECKED E.A. SAMPLE	CHECKED E.A. SAMPLE	DRAWING NO.	16 OF 63


16-MB15-IND.DWG

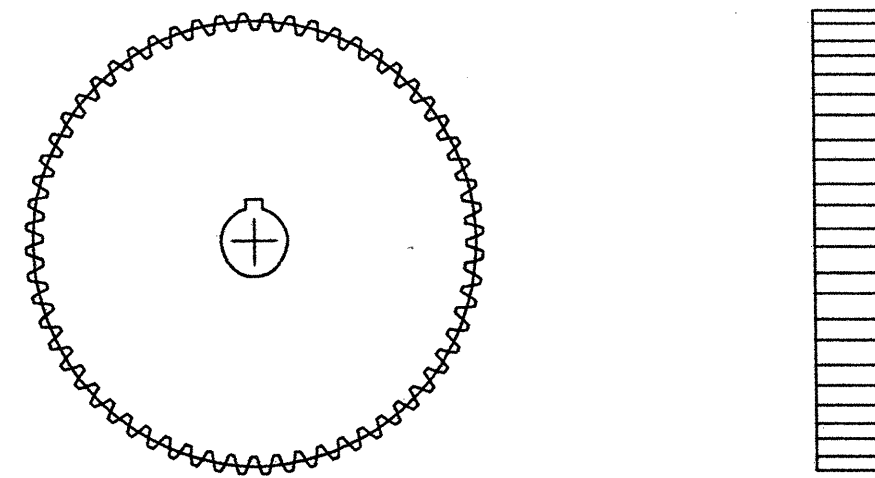

NEW AUXILIARY GEAR

SCALE: 1 1/2" = 1'-0"


QUANTITY: 2
 AGMA QUALITY # 8 OR HIGHER (PER AGMA 2000 - A88)
 MATERIAL: A668-CLASS G OR EQUIVALENT WITH MINIMUM HARDNESS 200BHN
 PITCH DIAMETER: 20"
 DIAMETRAL PITCH: 3"
 FACE WIDTH: 3"
 # TEETH: 60
 PRESSURE ANGLE: 20°
 TOOTH TYPE: FULL DEPTH
 BORE: 3-5/8" (PROVIDE ANSI FN2 FIT WITH EXISTING SHAFT)
 BREAK ALL SHARP EDGES

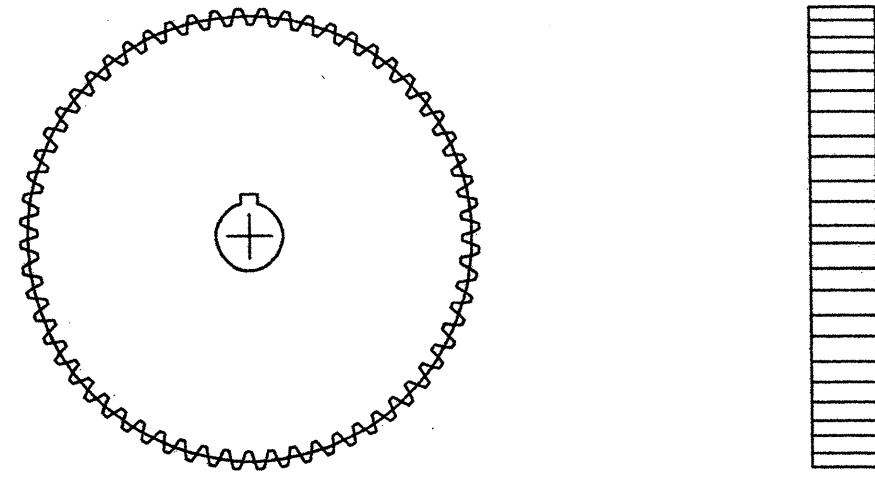

NEW AUXILIARY PINION

SCALE: 1 1/2" = 1'-0"

QUANTITY: 2
 AGMA QUALITY # 8 OR HIGHER (PER AGMA 2000 - A88)
 MATERIAL: A668-CLASS G OR EQUIVALENT WITH MINIMUM HARDNESS 200BHN
 PITCH DIAMETER: 20"
 DIAMETRAL PITCH: 3"
 FACE WIDTH: 3"
 # TEETH: 60
 PRESSURE ANGLE: 20°
 TOOTH TYPE: FULL DEPTH
 BORE: 3" (PROVIDE ANSI FN2 FIT WITH NEW SHAFT)
 BREAK ALL SHARP EDGES


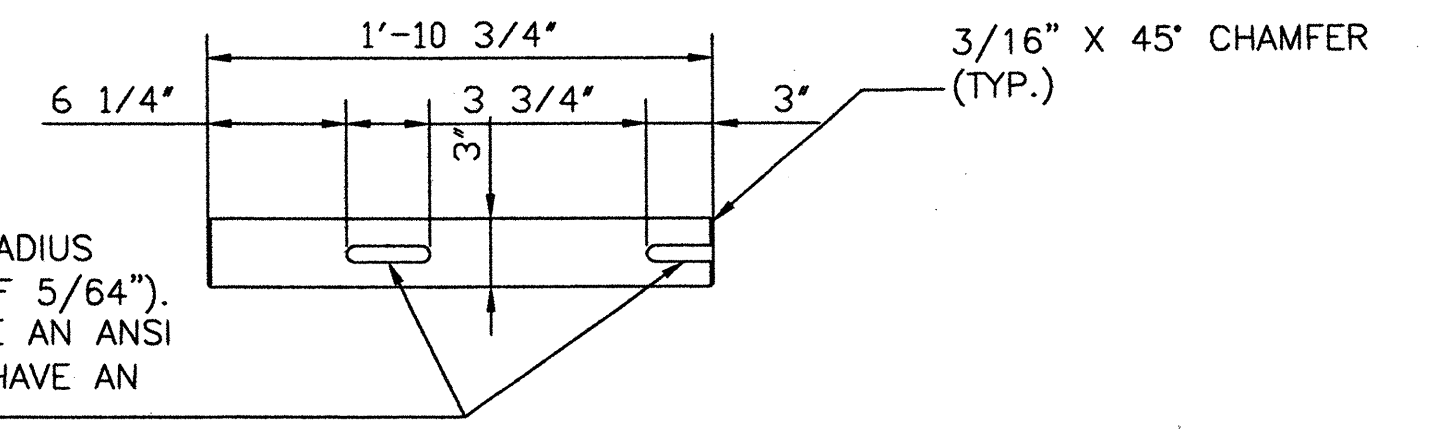


KEYWAY 3/4" WIDE X 3/8" DEEP
 WITH FILLETS IN KEYSEATS OF 1/16" RADIUS
 (KEYS TO HAVE MATCHING CHAMFERS OF 5/64").
 THE SIDES OF THE KEYWAY SHALL HAVE AN ANSI
 FN2 FIT AND THE TOP/BOTTOM SHALL HAVE AN
 ANSI LC4 FIT WITH THE KEY.

NEW AUXILIARY PINION SHAFT

SCALE: 1 1/2" = 1'-0"

MATERIAL: AISI 4140 OR EQUAL, WITH
 75,000 PSI MINIMUM YIELD STRENGTH
 QUANTITY: 2

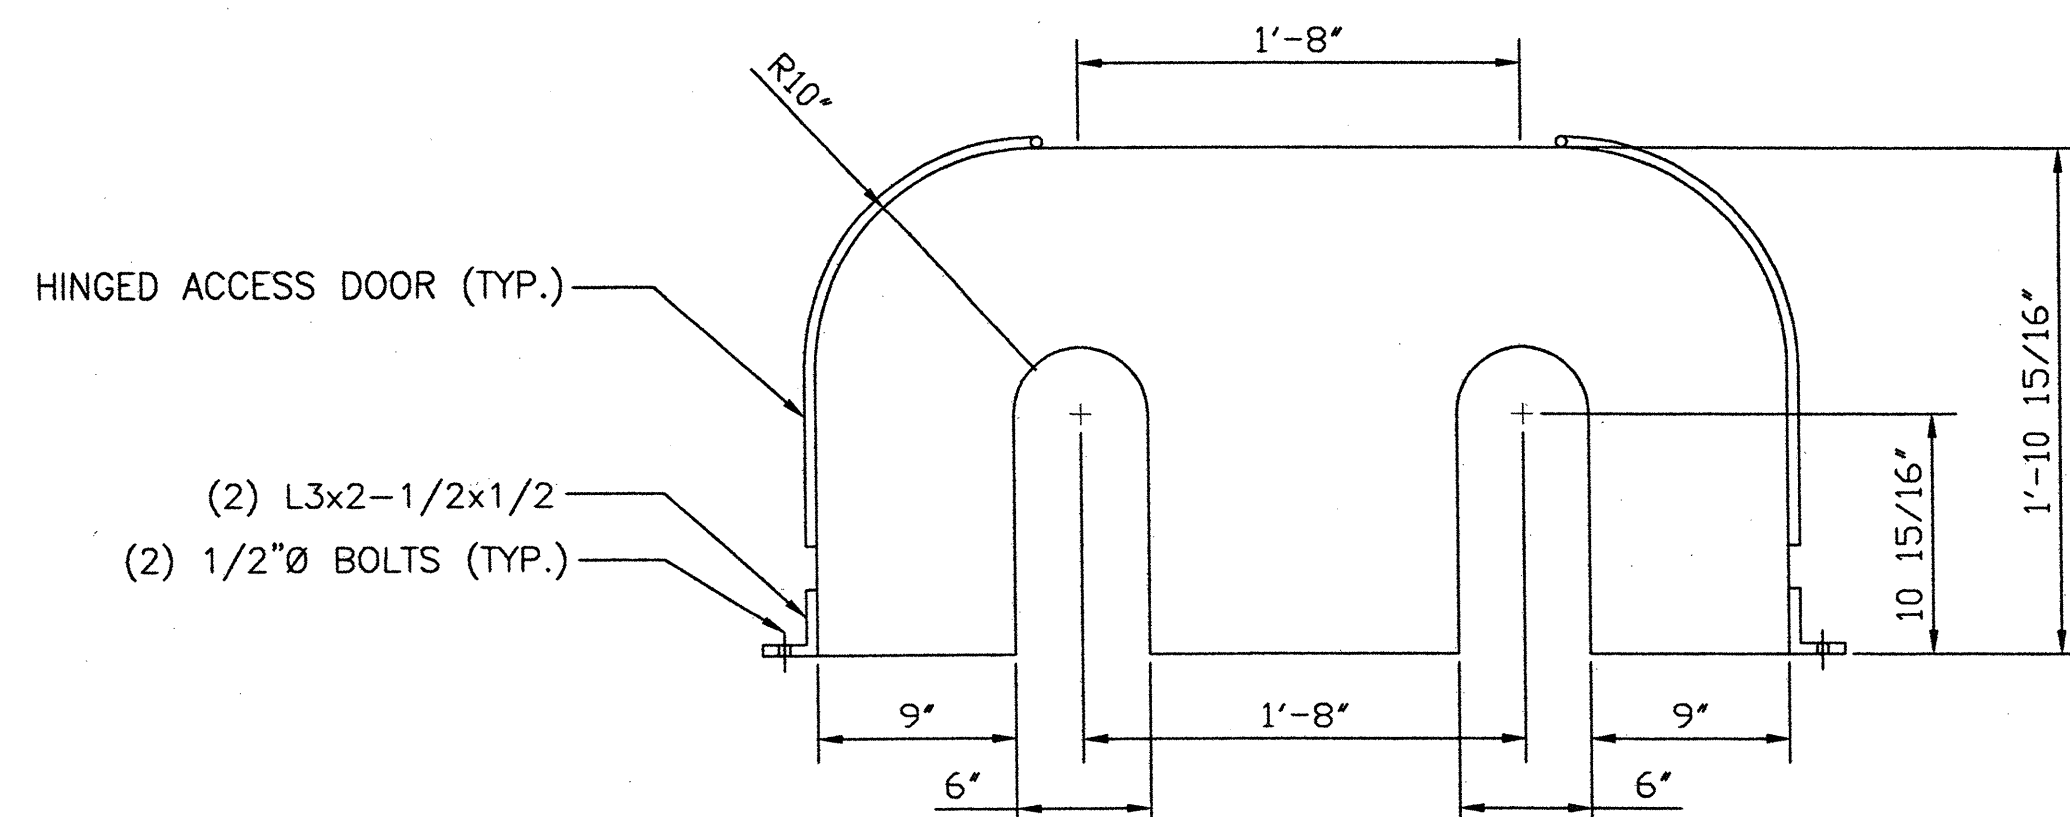
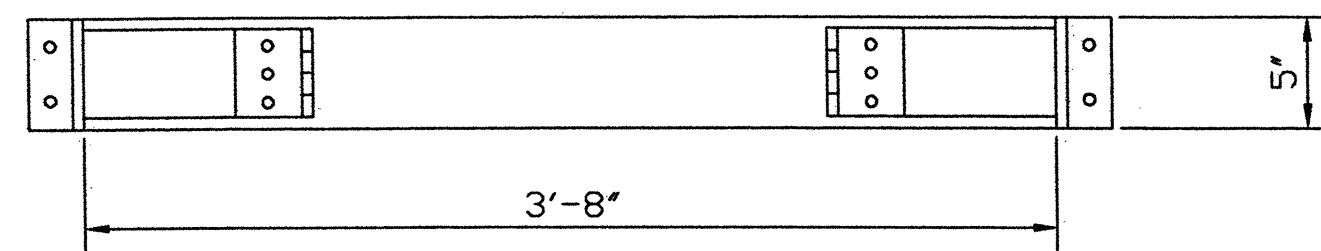


OPEN GEARING COVER

SCALE: 1 1/2" = 1'-0"
 MATERIAL: FABRICATED FROM 10GA STAINLESS STEEL UNLESS NOTED OTHERWISE
 QUANTITY: 2 REQUIRED


NOTES:

- BEFORE MOUNTING THE NEW AUXILIARY GEAR ON THE EXISTING SHAFT, A PROCEDURE MUST BE SUBMITTED BY THE CONTRACTOR AND APPROVED BY THE OWNER'S REPRESENTATIVE. THE PROCEDURE SHALL INCLUDE DETAILED STEPS FOR REMOVAL OF THE EXISTING SHAFT, REMOVAL OF THE EXISTING SPROCKET AND BEARINGS, AND INSTALLATION OF THE NEW AUXILIARY GEAR AND KEY.
- TWO THREADED STUDS TO BE WELDED TO THE OPEN GEAR COVER FOR SECURING OF EACH HINGED DOOR. WING NUTS FOR SECURING DOORS AND ALL MOUNTING HARDWARE TO BE STAINLESS STEEL.

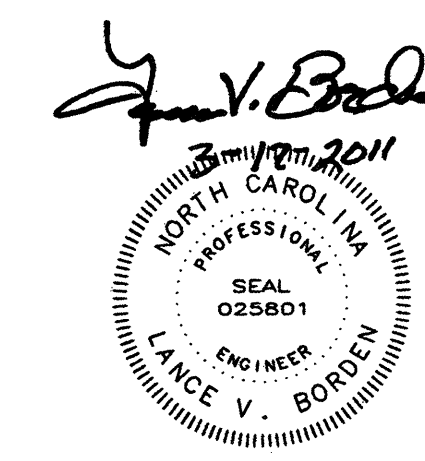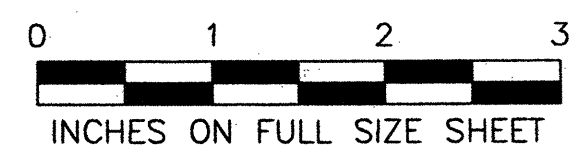


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW AUXILIARY DRIVE - DETAILS			
DESIGNED A.M. BRODSKY		CHECKED E.A. SAMPLE	
DETAILED A.M. BRODSKY		CHECKED E.A. SAMPLE	
DATE MARCH 2011		DRAWING NO. 17 OF 63	
DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	


17-MB16-MOD.DWG

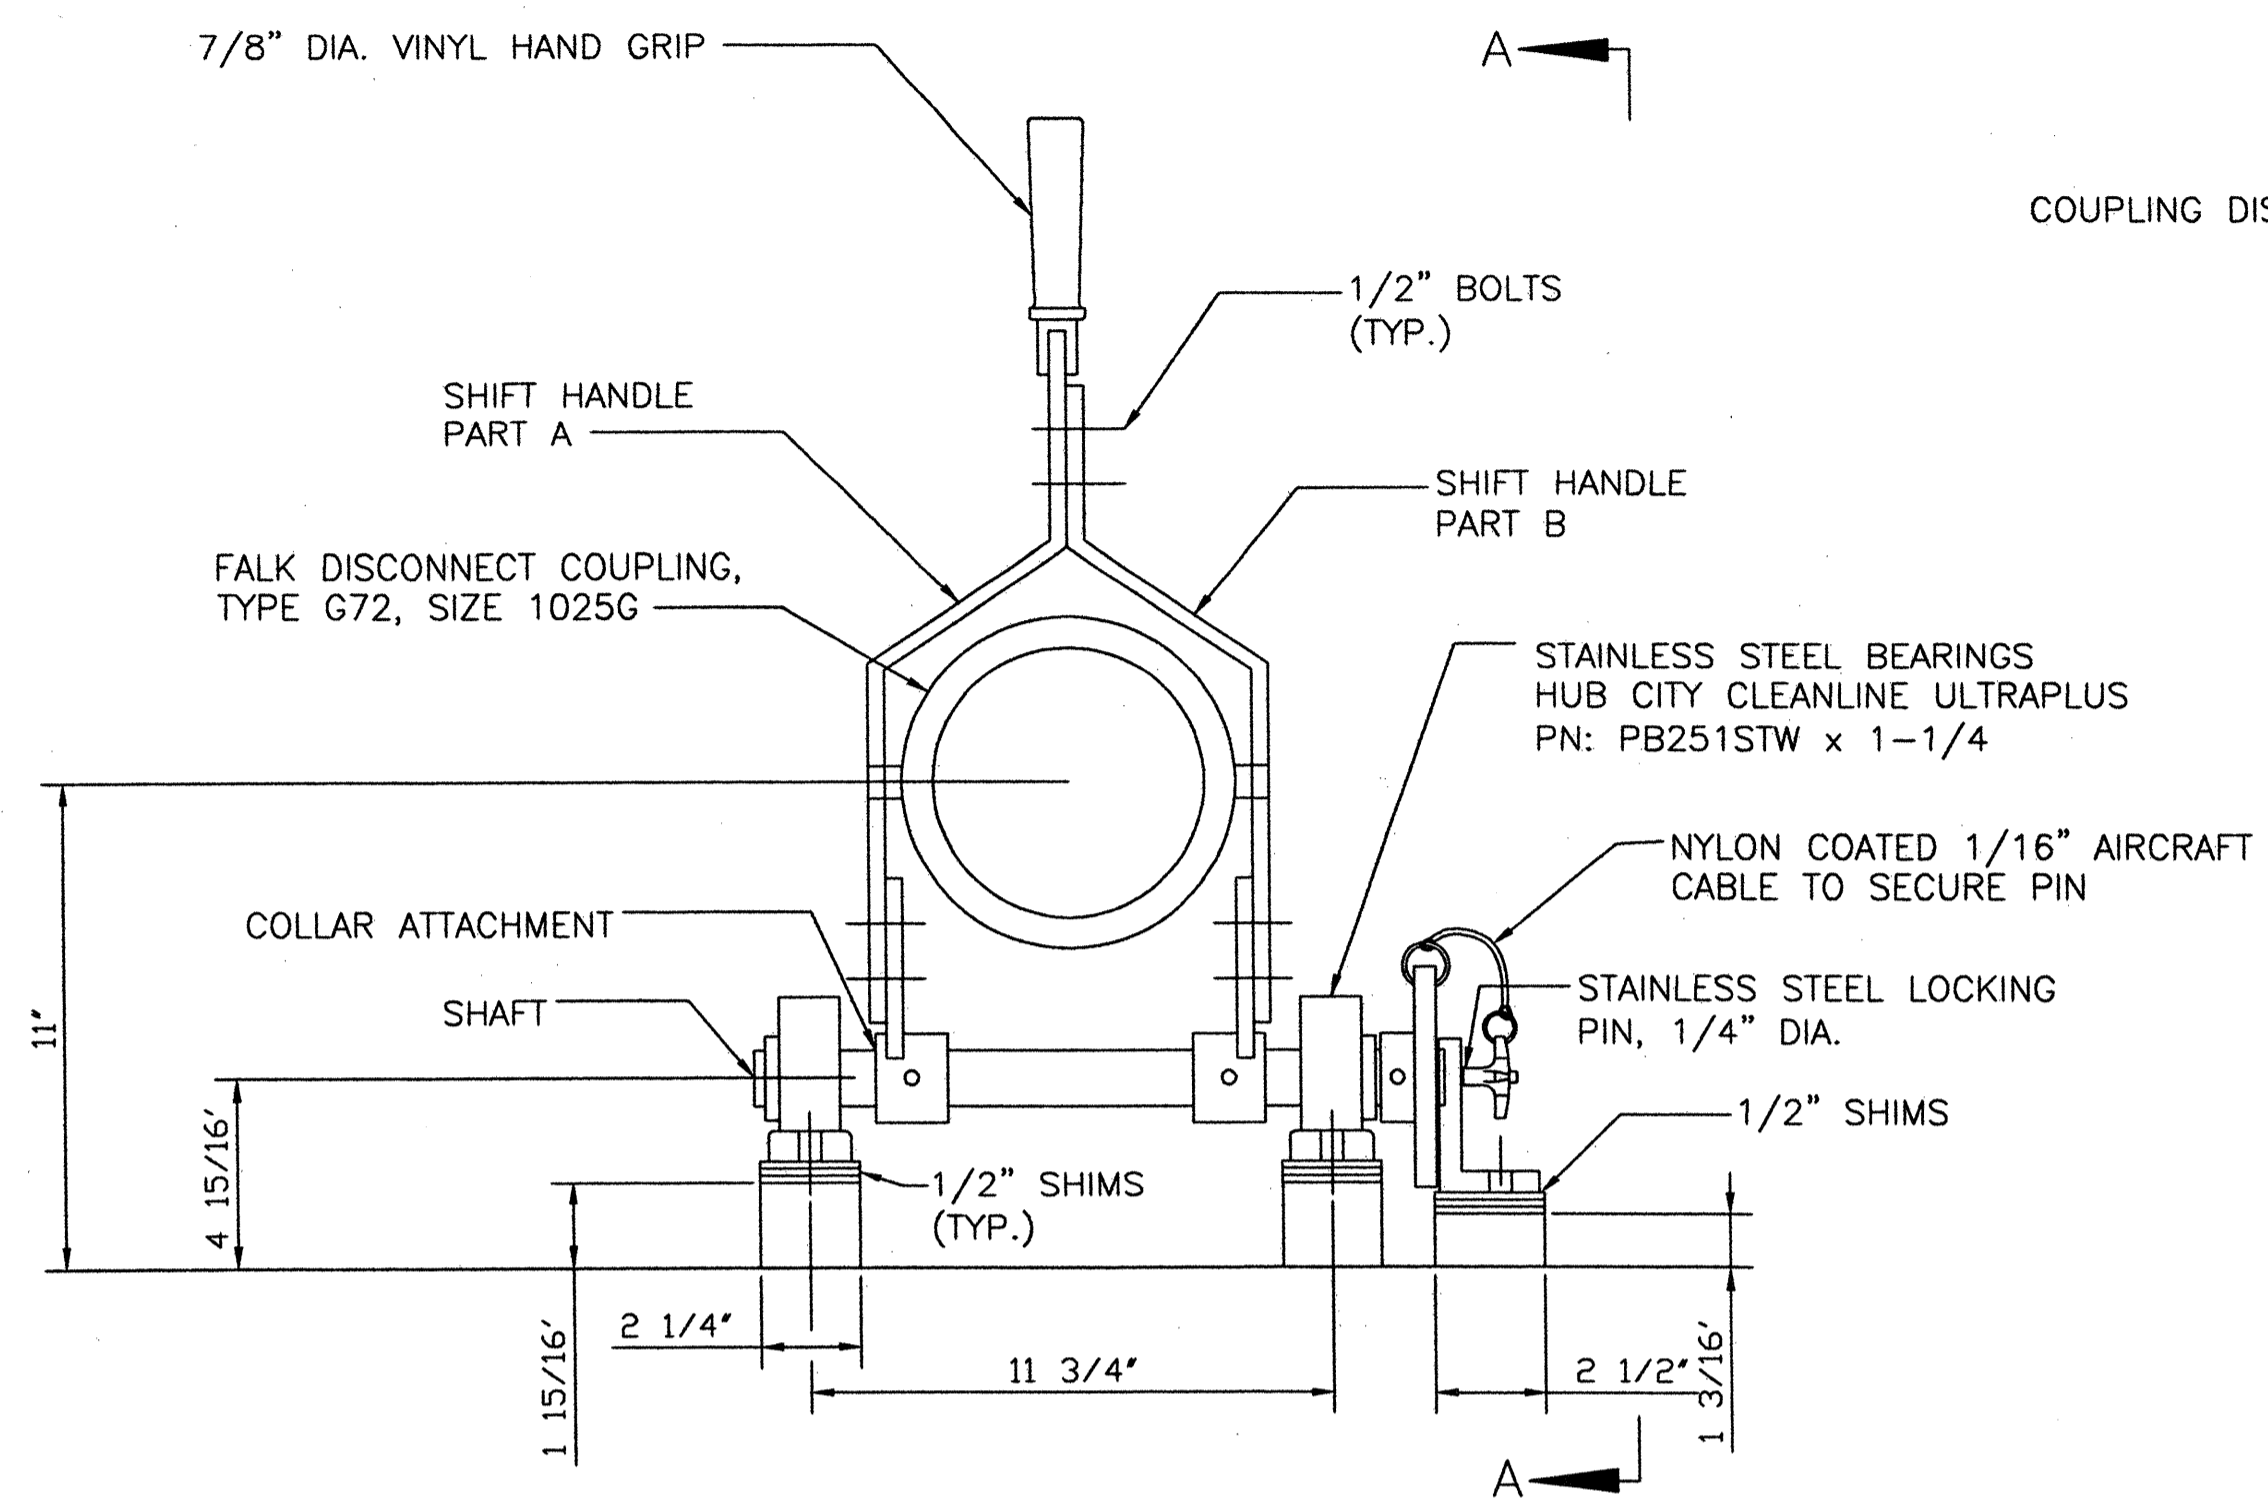


SHIFTER COUPLING HANDLE
SCALE: 3" = 1'-0"

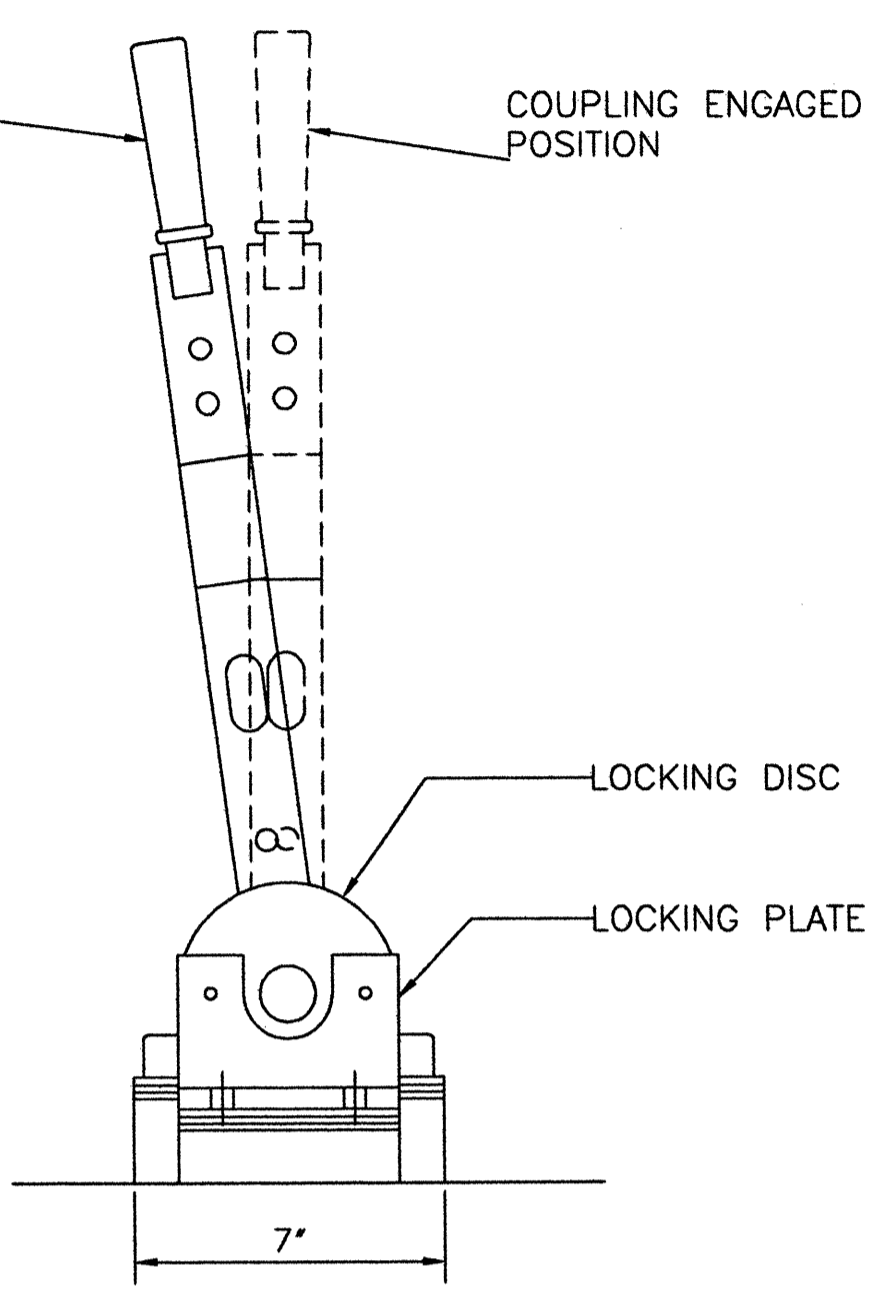


VIEW A-A
SCALE: 3" = 1'-0"

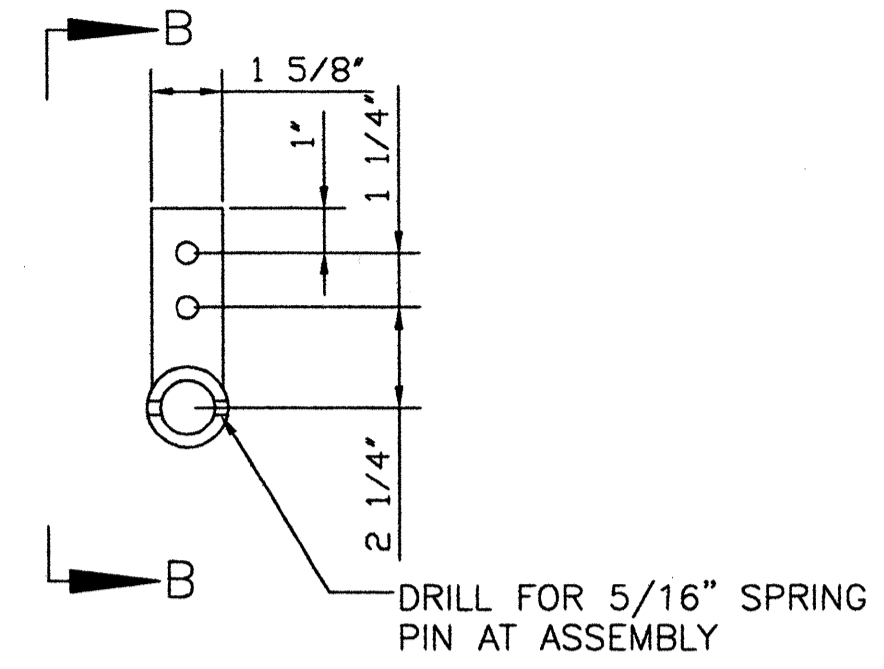

COLLAR ATTACHMENT
SCALE: 3" = 1'-0"

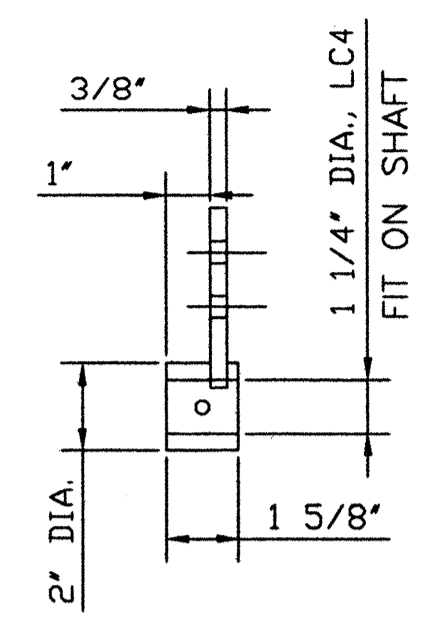


VIEW B-B
SCALE: 3" = 1'-0"

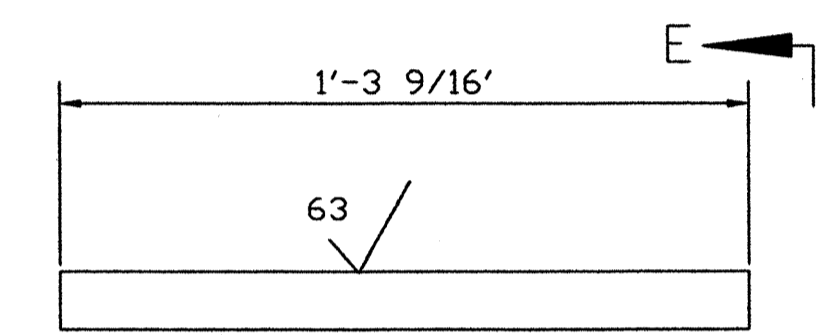


SHAFT


SCALE: 3" = 1'-0"
MATERIAL: AISI 4140 OR EQUAL, WITH 75,000 PSI MINIMUM YIELD STRENGTH
QUANTITY: 2




VIEW E-E
SCALE: 3" = 1'-0"

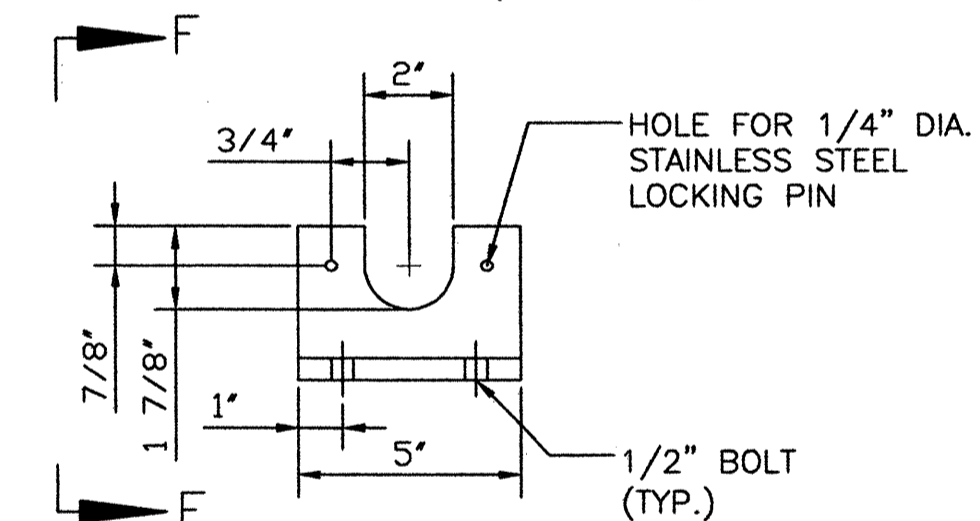


LOCKING PLATE
SCALE: 3" = 1'-0"

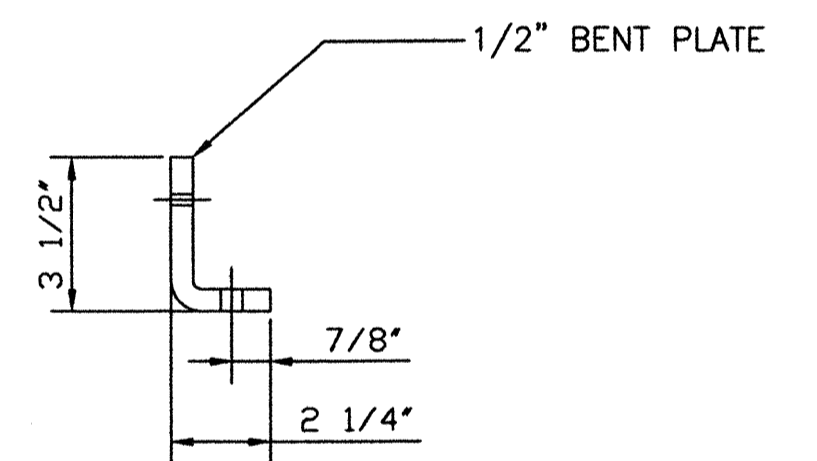



VIEW F-F
SCALE: 3" = 1'-0"

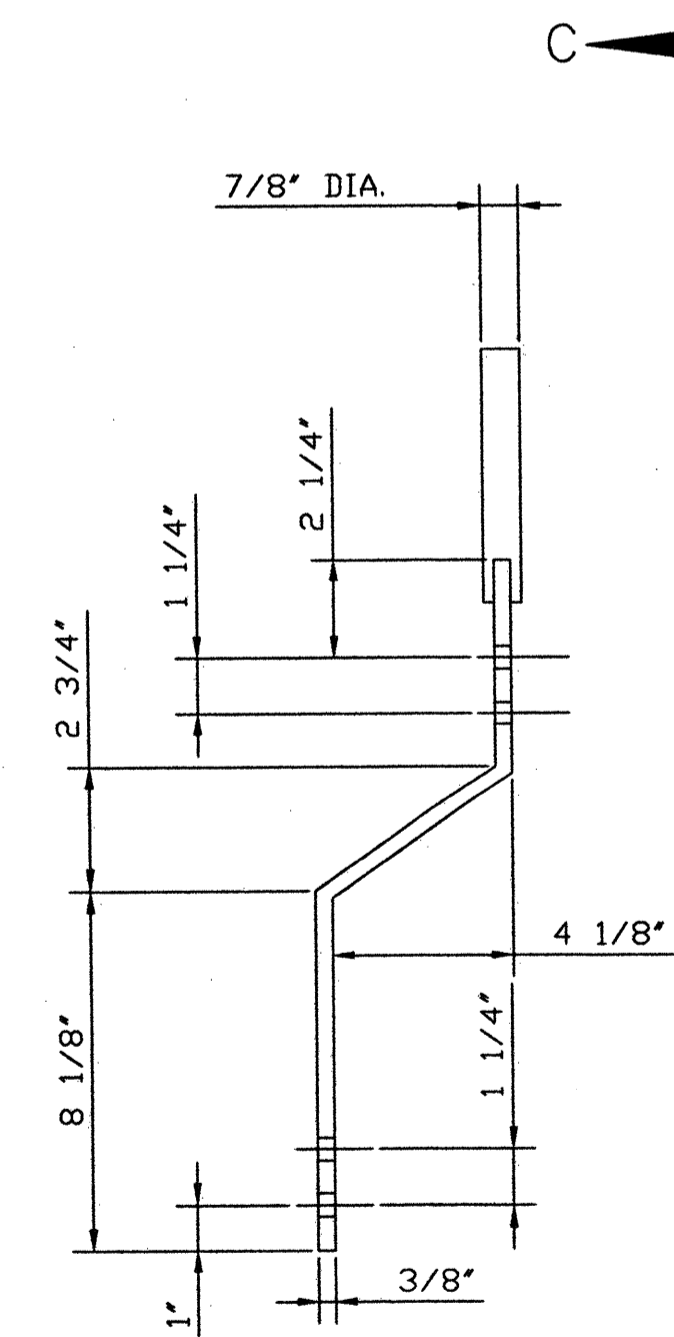


SHIFT HANDLE PART A
SCALE: 3" = 1'-0"

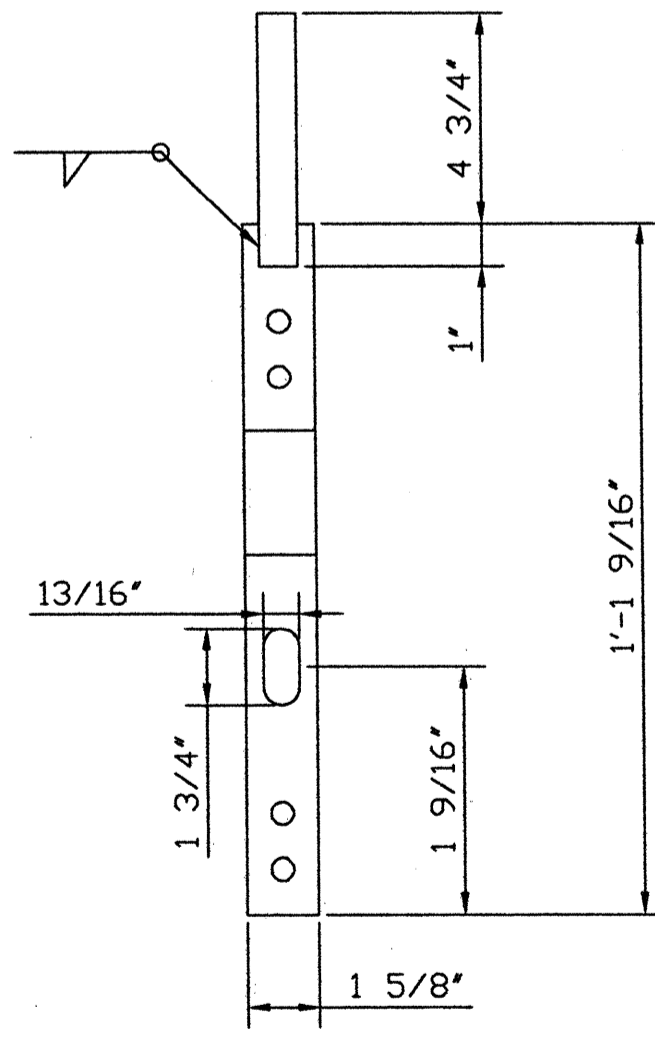


VIEW C-C
SCALE: 3" = 1'-0"

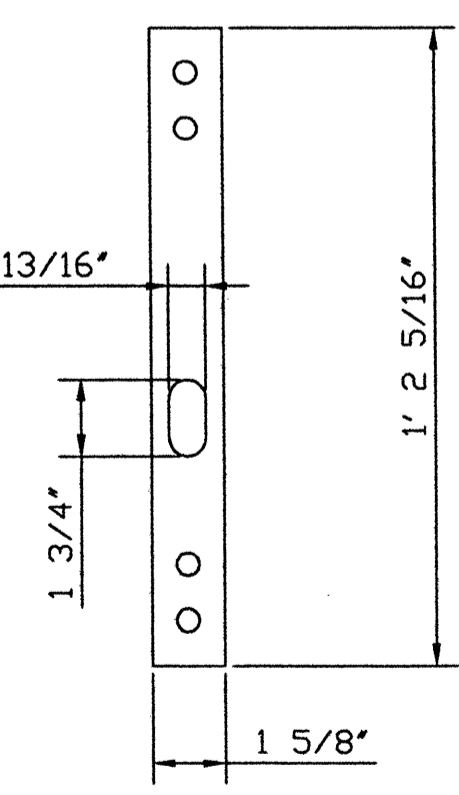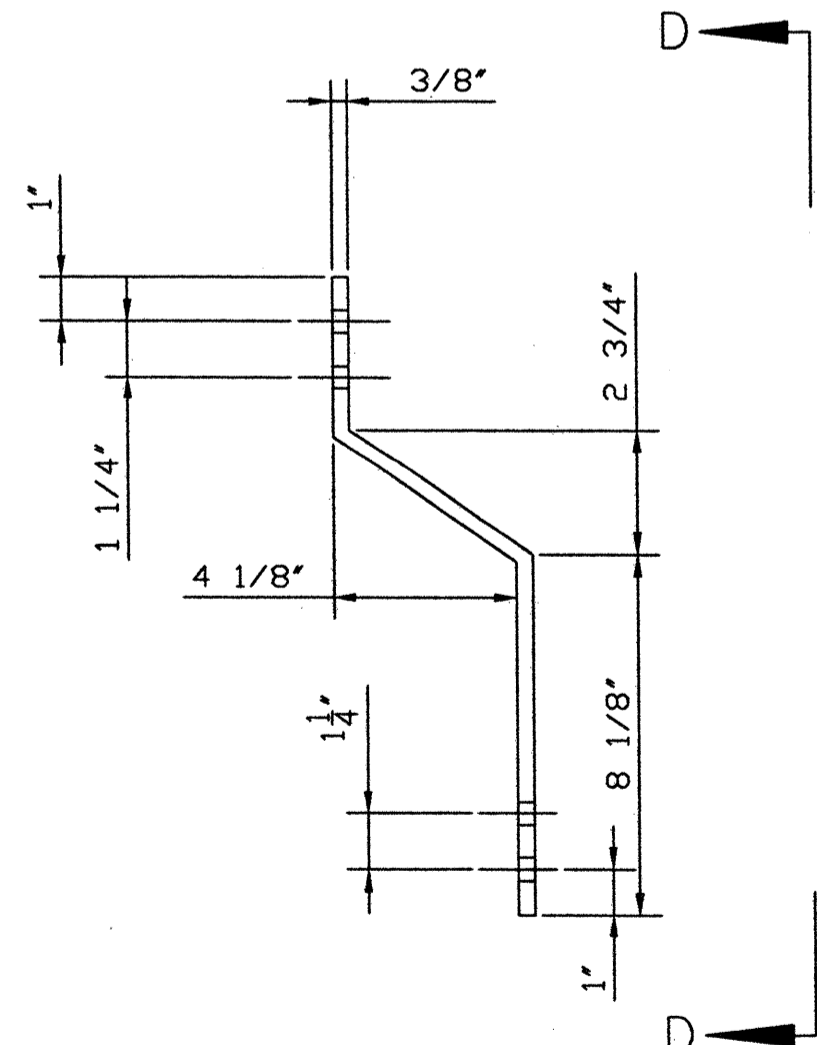


VIEW D-D
SCALE: 3" = 1'-0"

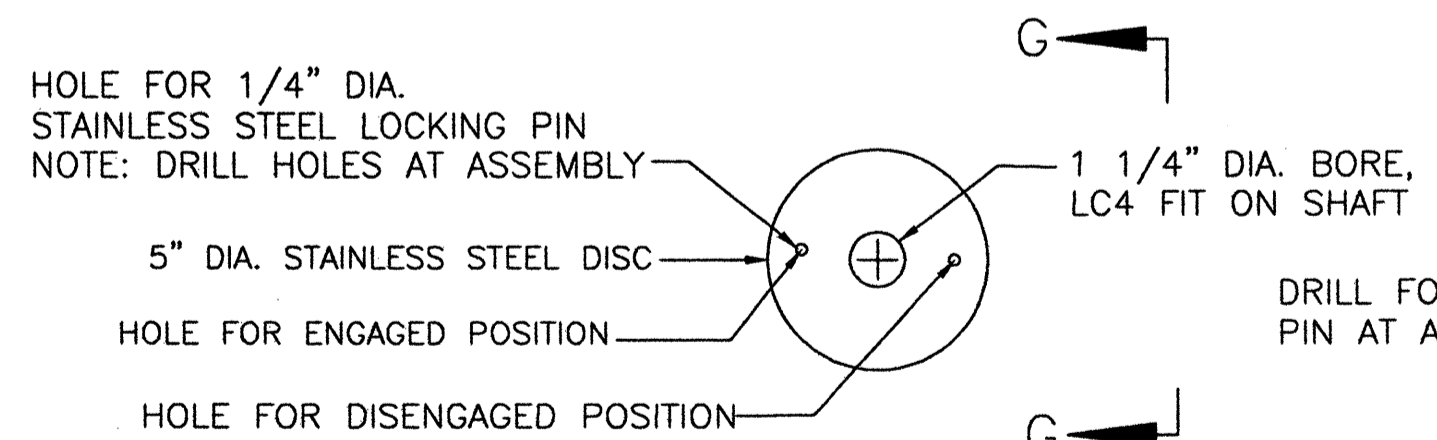


LOCKING DISC
SCALE: 3" = 1'-0"

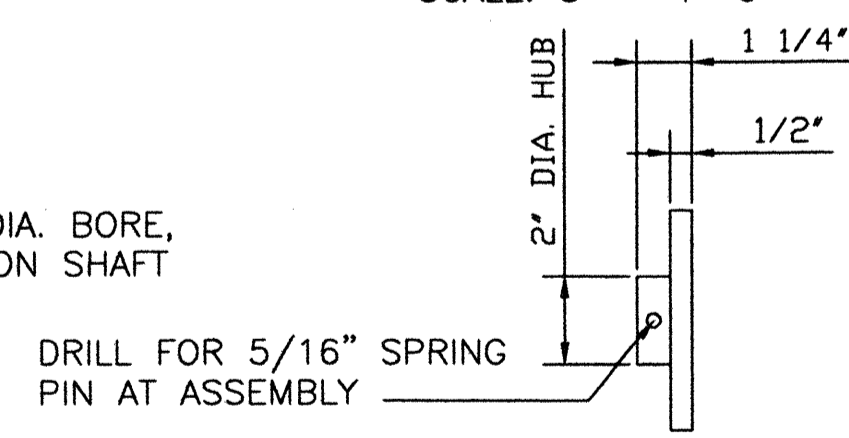

VIEW G-G
SCALE: 3" = 1'-0"

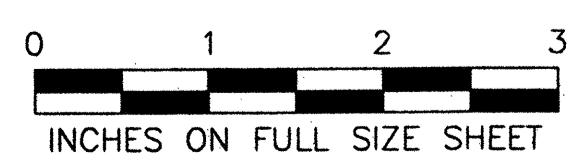


SHIFTER COUPLING HANDLE DETAILS
SCALE: 3" = 1'-0"

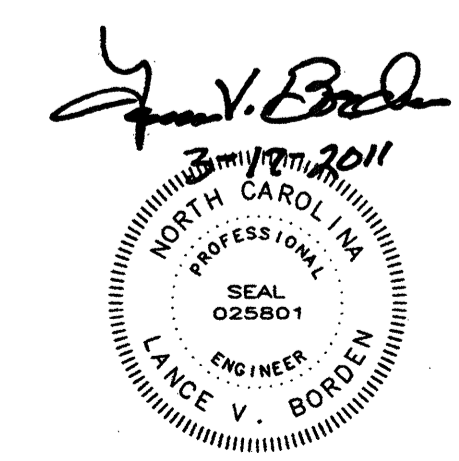


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
NEW AUXILIARY DRIVE-SHIFTER COUPLING

DESIGNED	A.M. BRODSKY	DETAILED	A.M. BRODSKY	DATE	MARCH 2011
CHECKED	E.A. SAMPLE	CHECKED	E.A. SAMPLE	DRAWING NO.	18 OF 63
DRAWN BY			E.A. RICKENBACH		
SCALE			AS NOTED		


18-MB17-INDSC.DWG

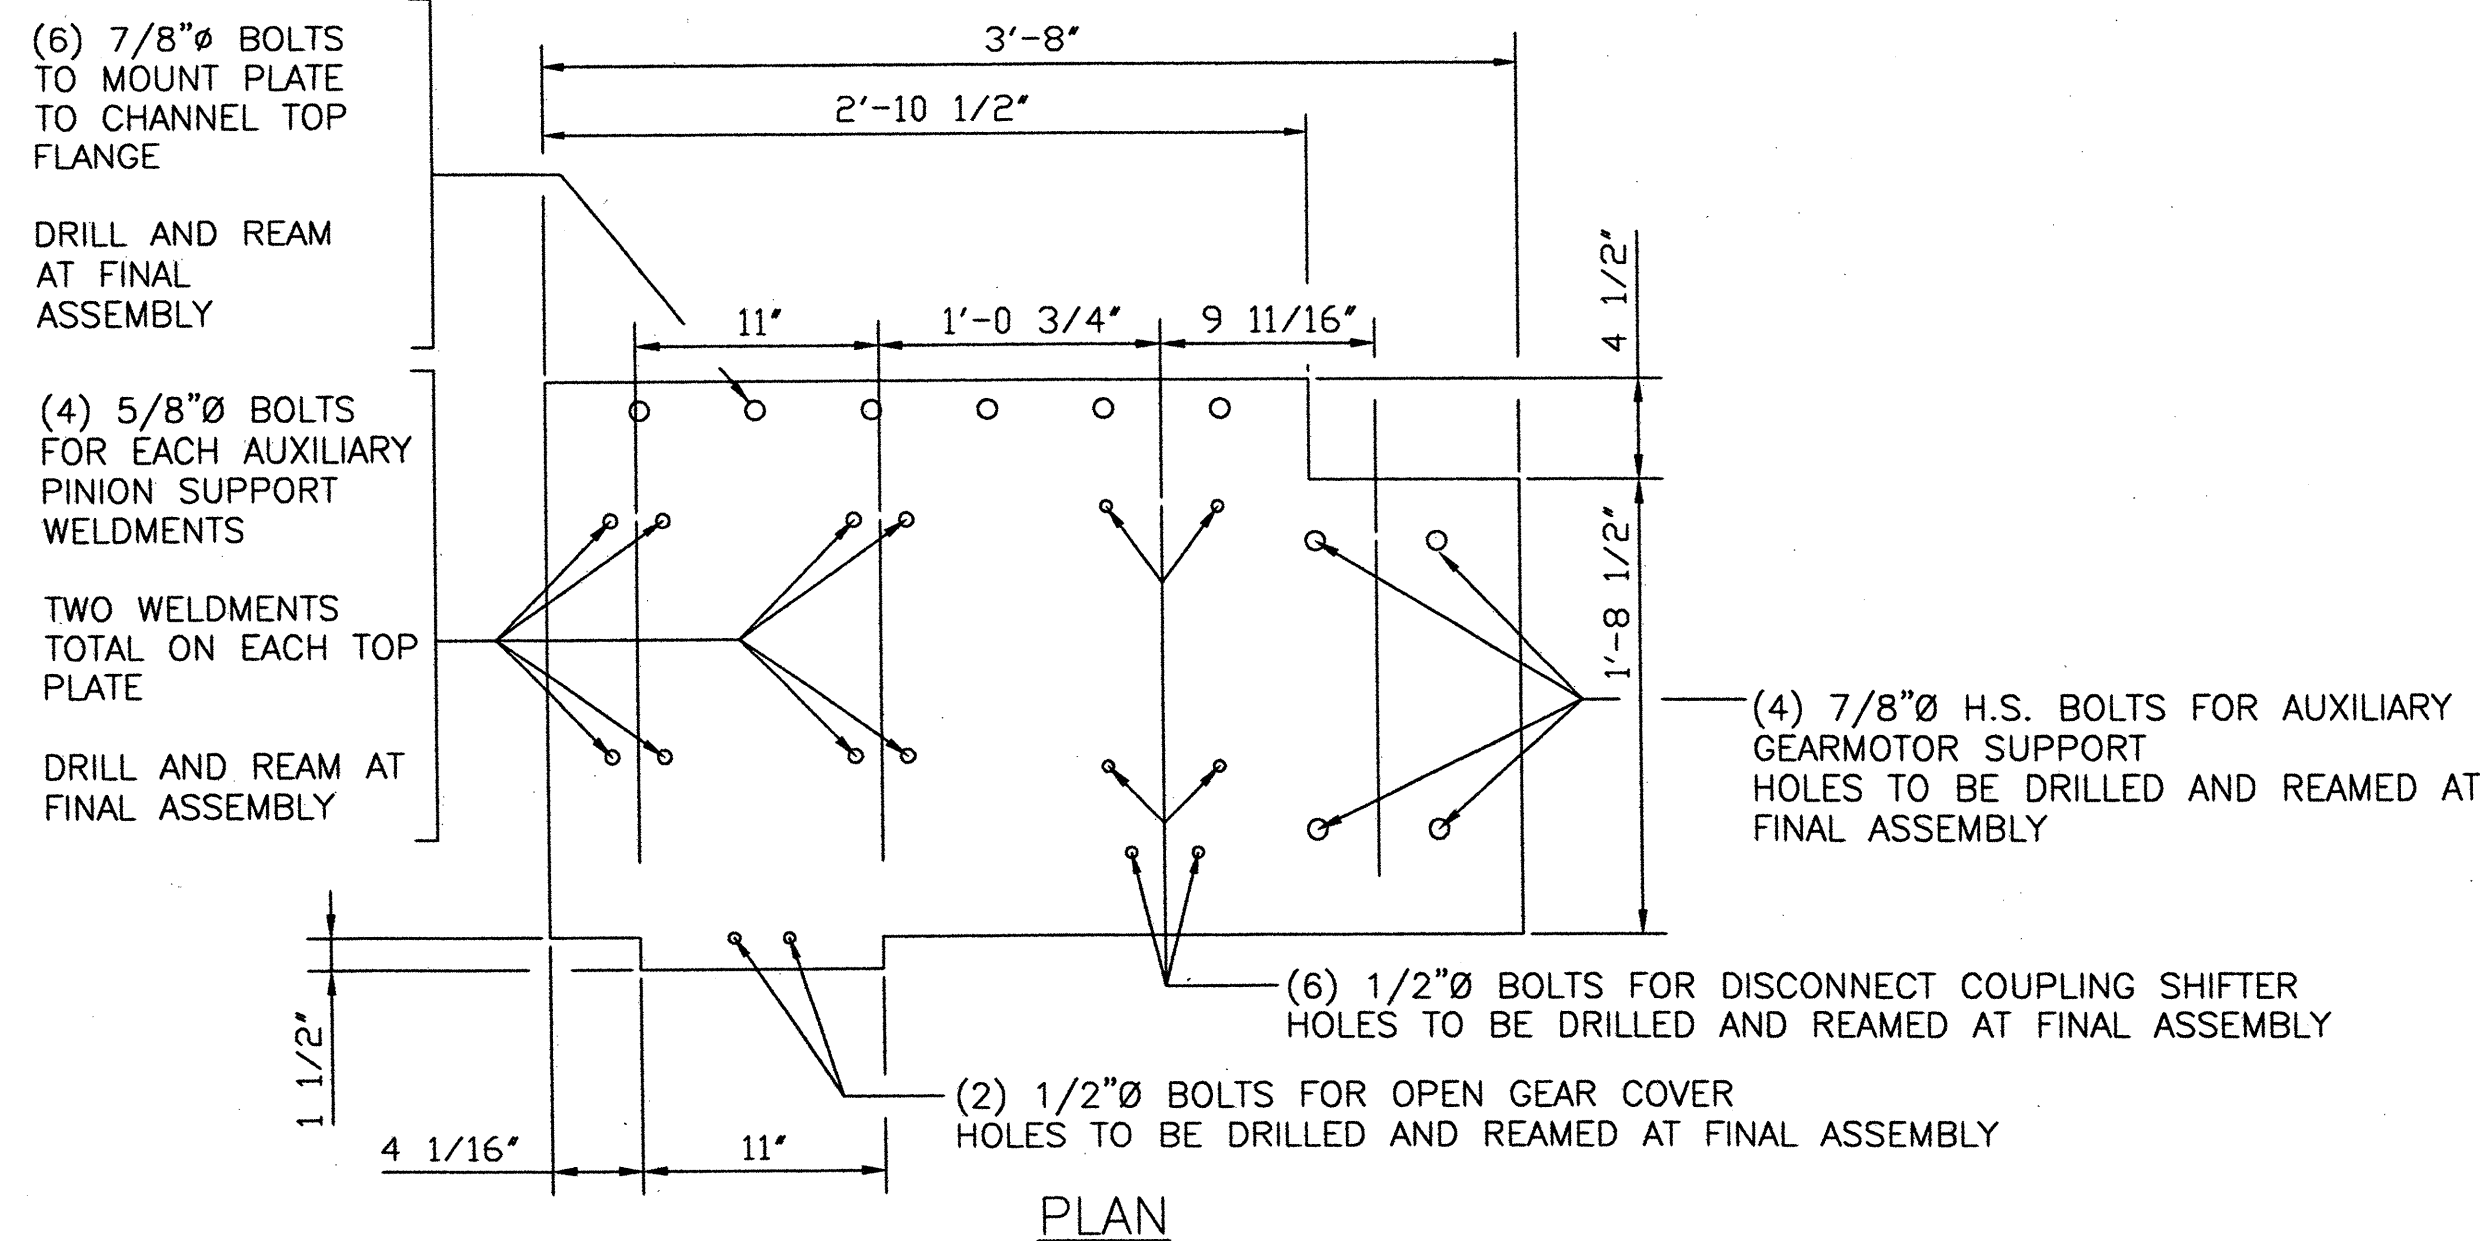

PLAN

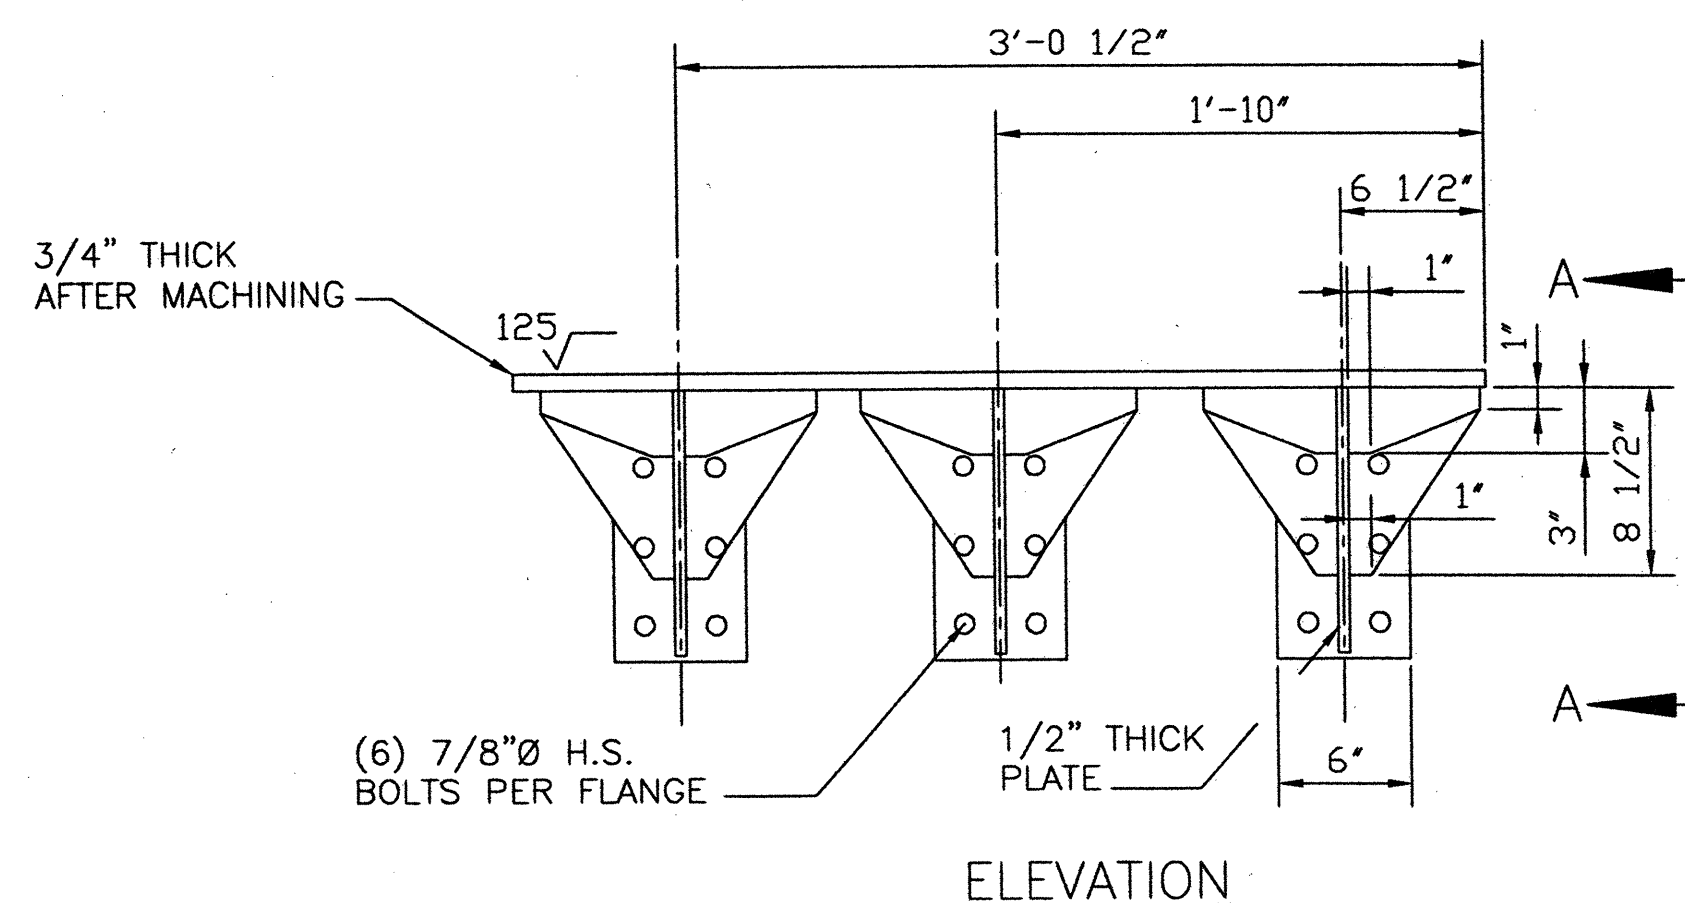


ELEVATION

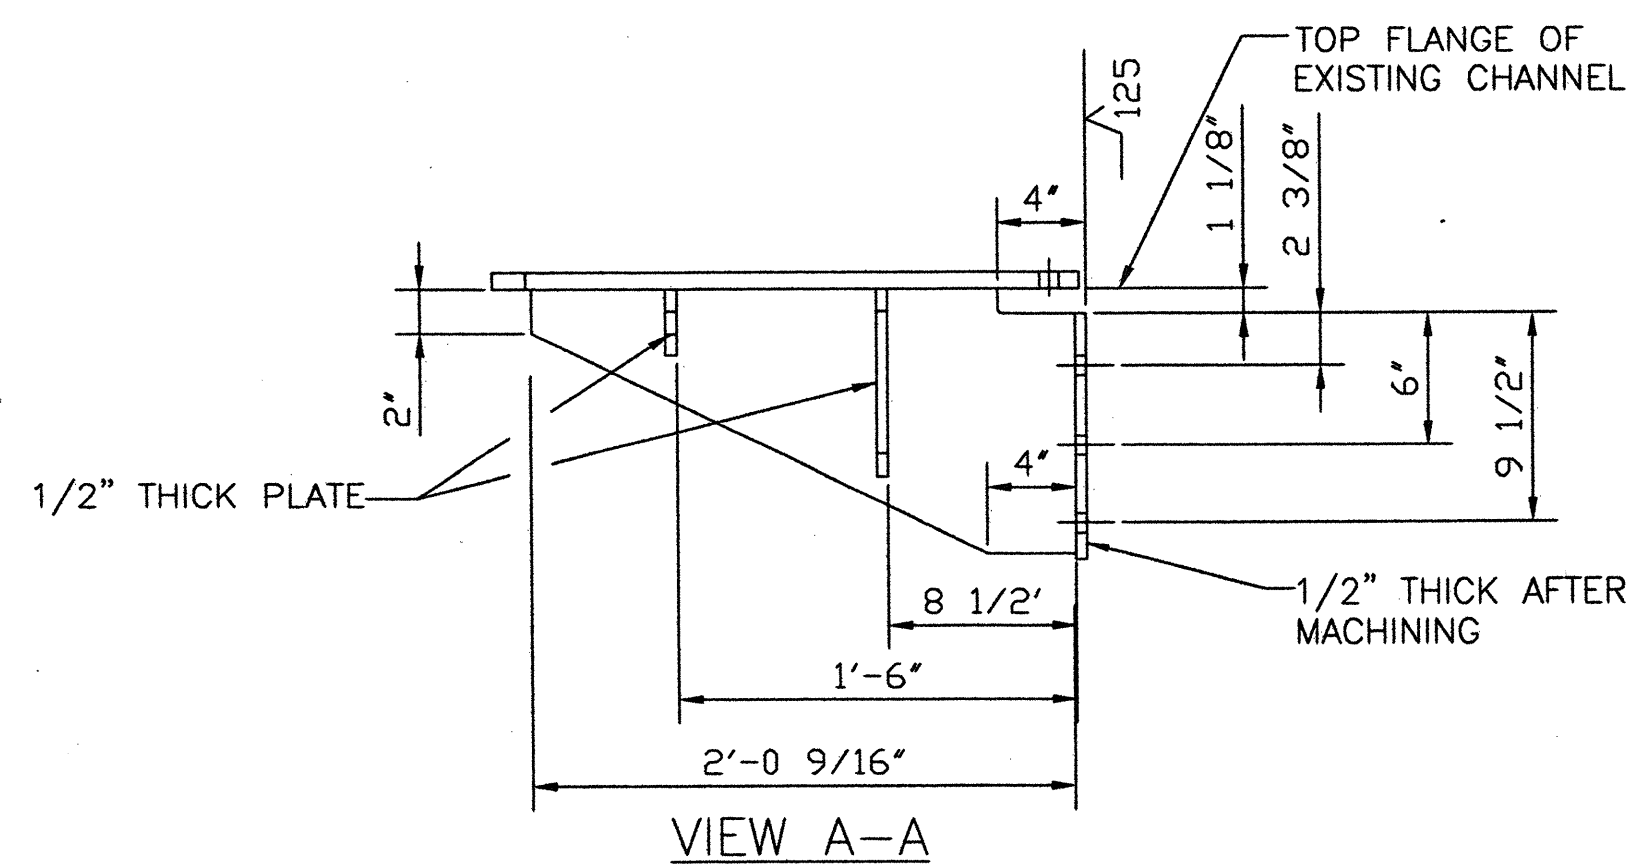

VIEW A-A


AUXILIARY DRIVE SUPPORT

SCALE: 1 1/2" = 1'-0"
 MATERIAL: ASTM A588 HSLA STEEL
 QUANTITY: 2 REQUIRED

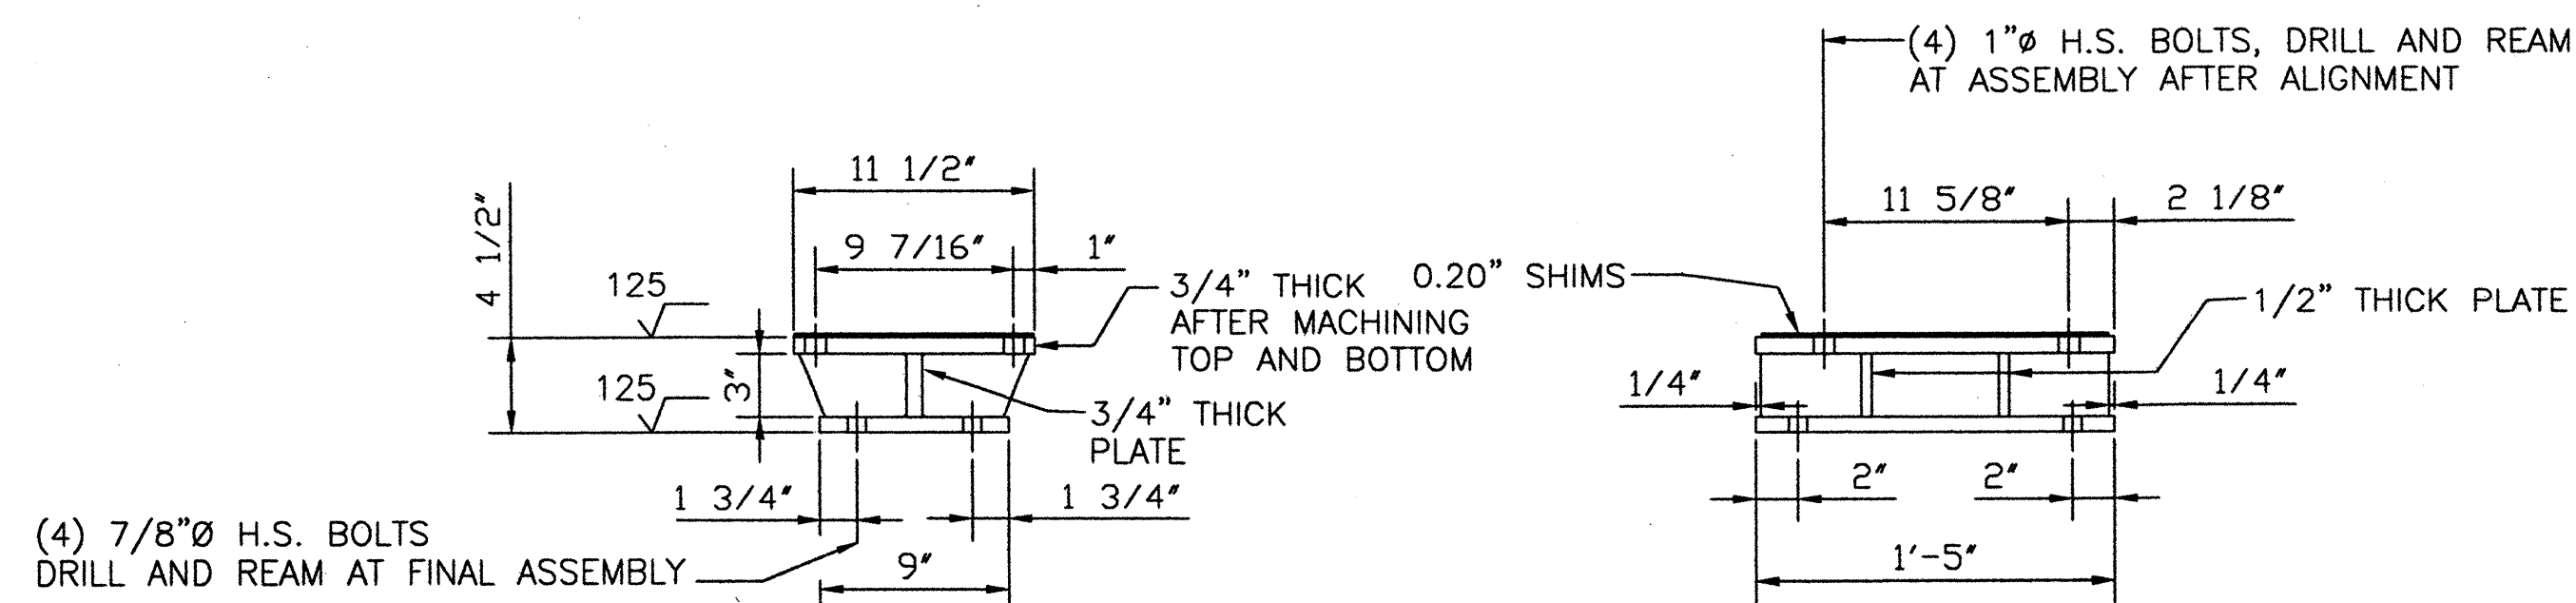


AUXILIARY GEARMOTOR SUPPORT

SCALE: 1 1/2" = 1'-0"
 MATERIAL: ASTM A588 HSLA STEEL
 QUANTITY: 2 REQUIRED

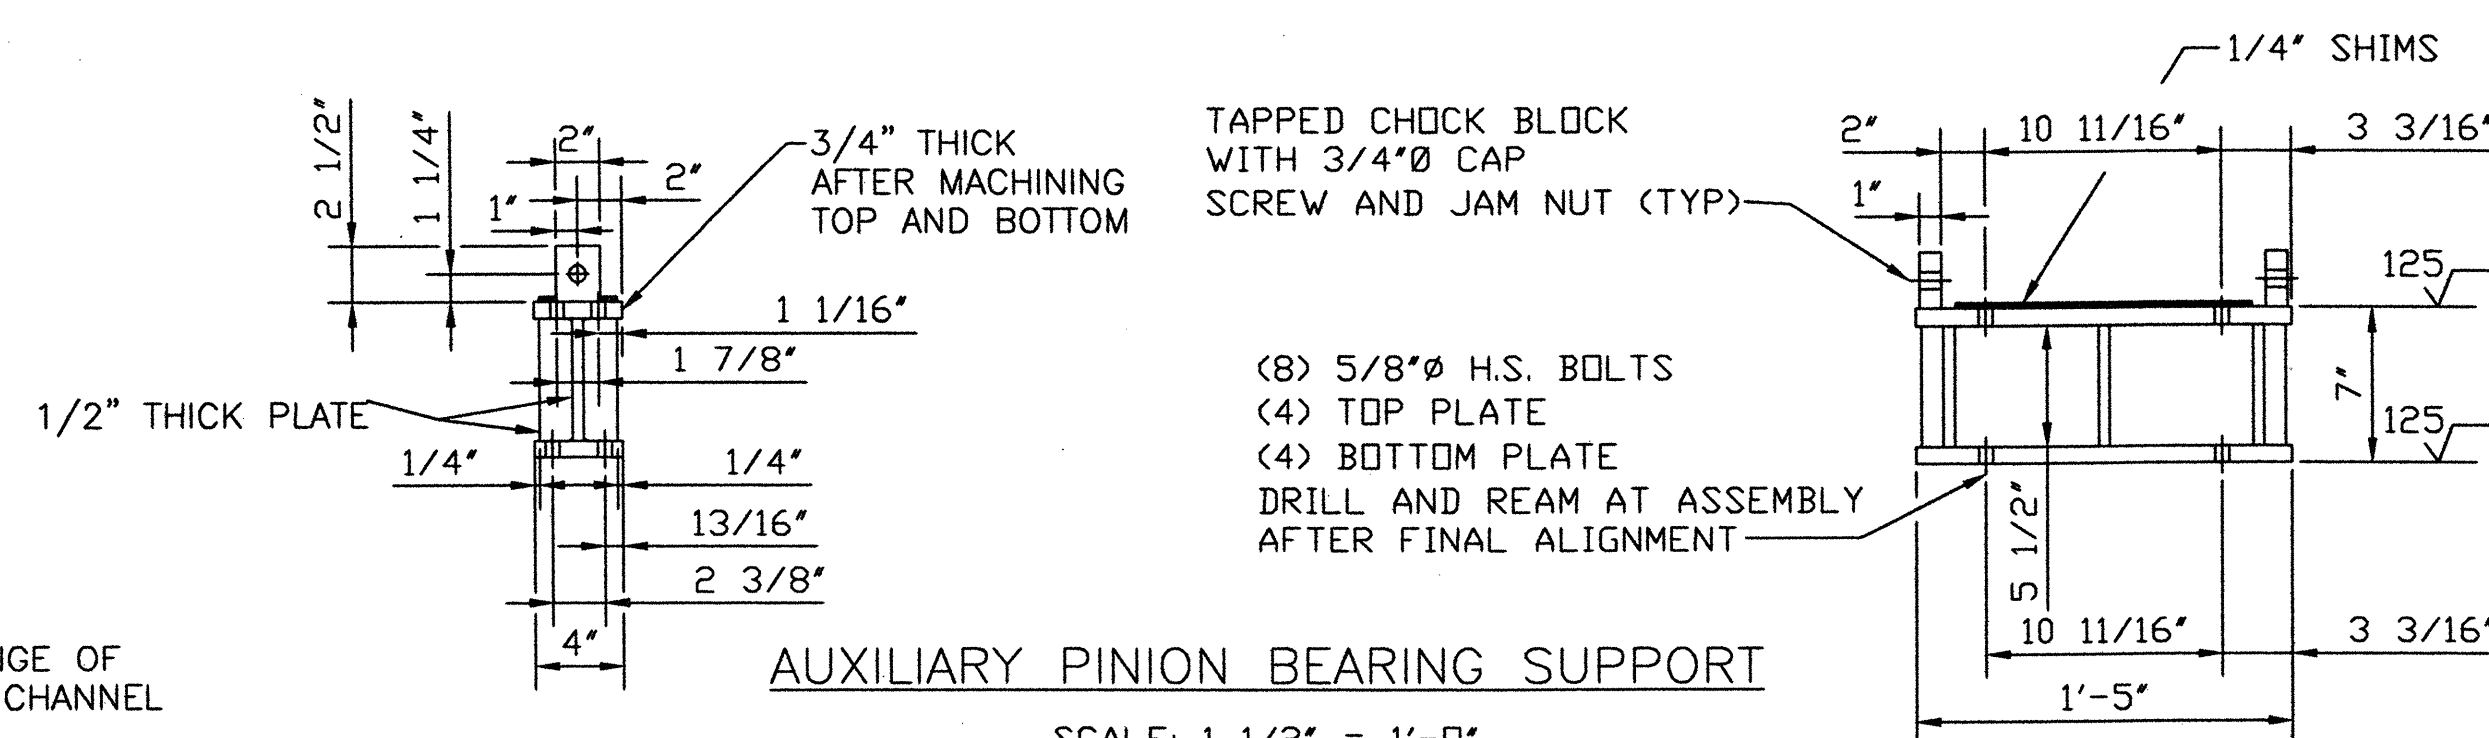



AUXILIARY PINION BEARING SUPPORT

SCALE: 1 1/2" = 1'-0"
 MATERIAL: ASTM A588 HSLA STEEL
 QUANTITY: 4 REQUIRED, 2 PER AUXILIARY DRIVE SUPPORT

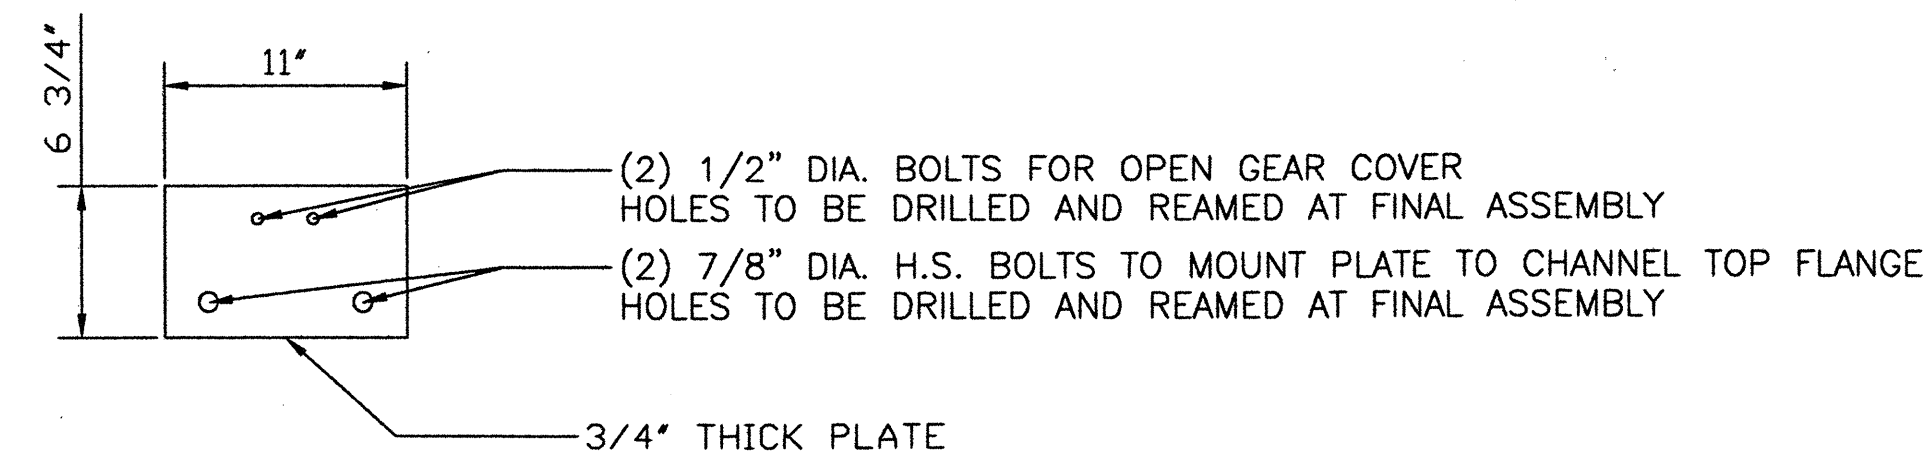

OPEN GEAR COVER SUPPORT PLATE

SCALE: 1 1/2" = 1'-0"
 MATERIAL: ASTM A588 HSLA STEEL
 QUANTITY: 2 REQUIRED

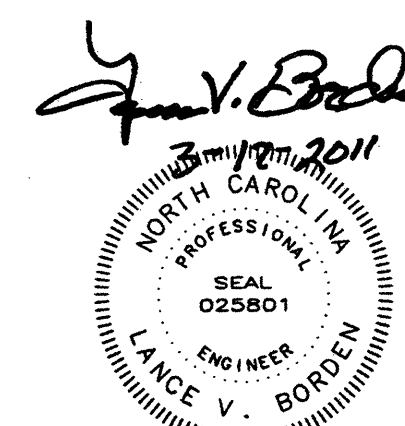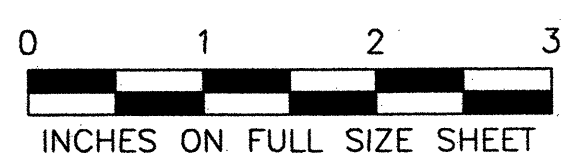


STATE OF NORTH CAROLINA
 DEPARTMENT OF TRANSPORTATION
 RALEIGH

CAPE FEAR BASCULE BRIDGE
 AND MEMORIAL LIFT BRIDGE
 WILMINGTON, NORTH CAROLINA

NEW AUXILIARY DRIVE - SUPPORTS

DESIGNED	A.M. BRODSKY	DETAILED	A.M. BRODSKY	DATE	MARCH 2011
CHECKED	E.A. SAMPLE	CHECKED	E.A. SAMPLE	DRAWING NO.	19 OF 63

MB18


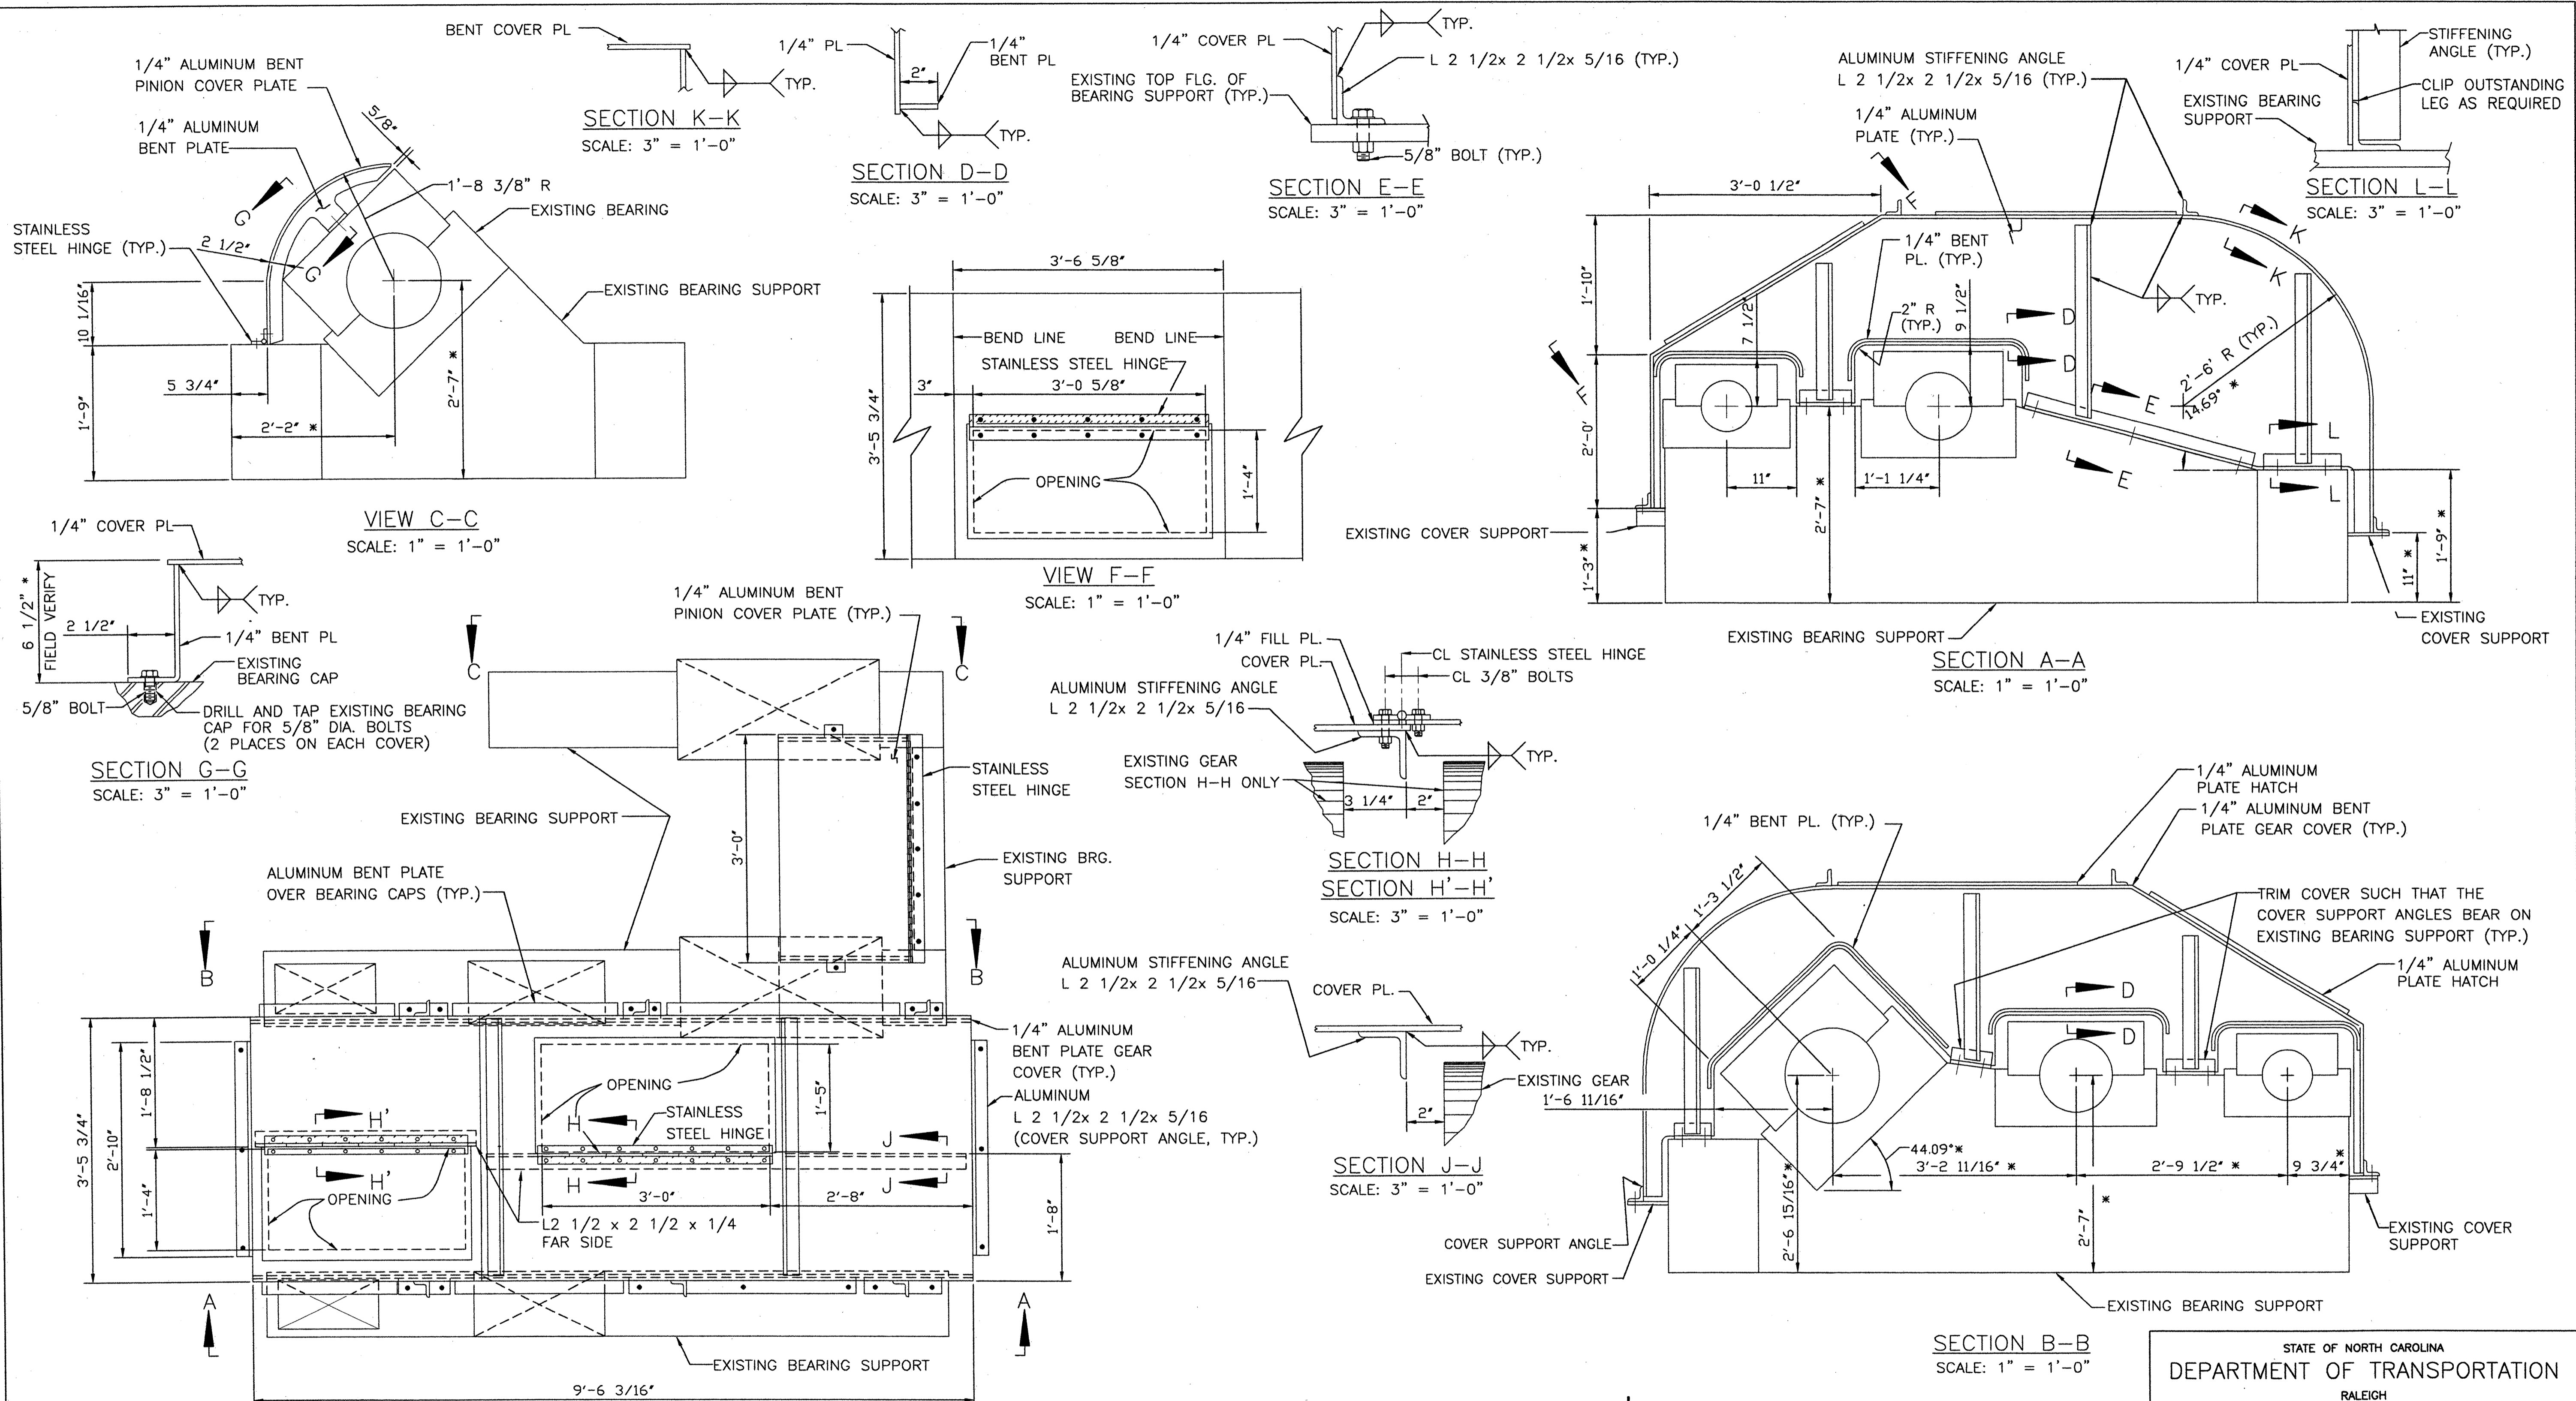


PLAN
NORTHWEST AND SOUTHEAST GEAR COVER

SCALE: 1" = 1'-0"
 (NORTHEAST AND SOUTHWEST OPPOSITE HAND,
 GEARS AND SHAFTS NOT SHOWN FOR CLARITY)


NOTES:

- * DIMENSIONS PROVIDED AS REFERENCE ONLY. FIELD VERIFY.
- ALL ITEMS NEW, UNLESS NOTED OTHERWISE.
- EXISTING GEARING COVERS TO BE REMOVED.
- COVER MATERIAL TO BE ALUMINUM, ASTM B308.
- FASTENERS TO BE STAINLESS STEEL, ASTM F593, GROUP 2 - ALLOY 316.
- HINGES TO BE TYPE 304 STAINLESS STEEL PIANO HINGES, McMASTERS-CARR PART NO. 1582A434, OR APPROVED EQUAL.

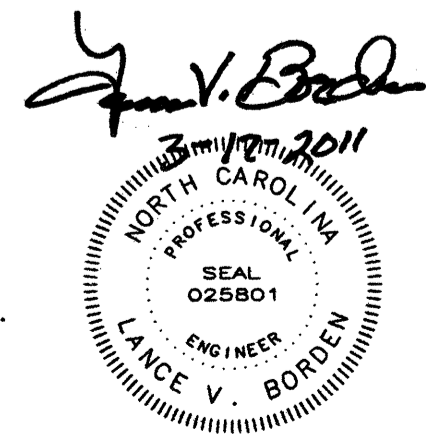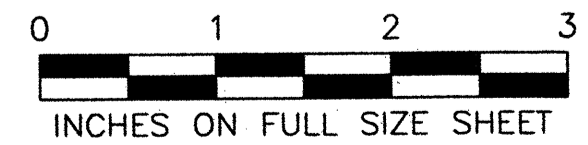


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW OPEN GEARING COVER - DETAILS			
DESIGNED	G.L. FOREST	DATE	MARCH 2011
CHECKED	E.A. SAMPLE	DRAWING NO.	20 OF 63


MB19

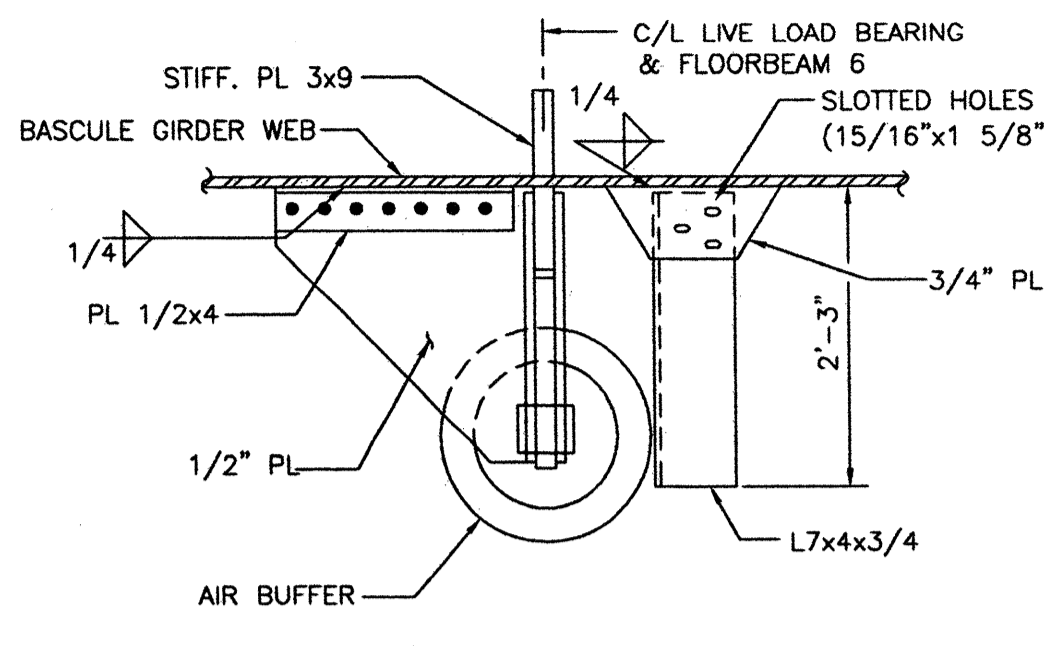


PLAN OF AIR BUFFER
SCALE: 3/4" = 1'-0"

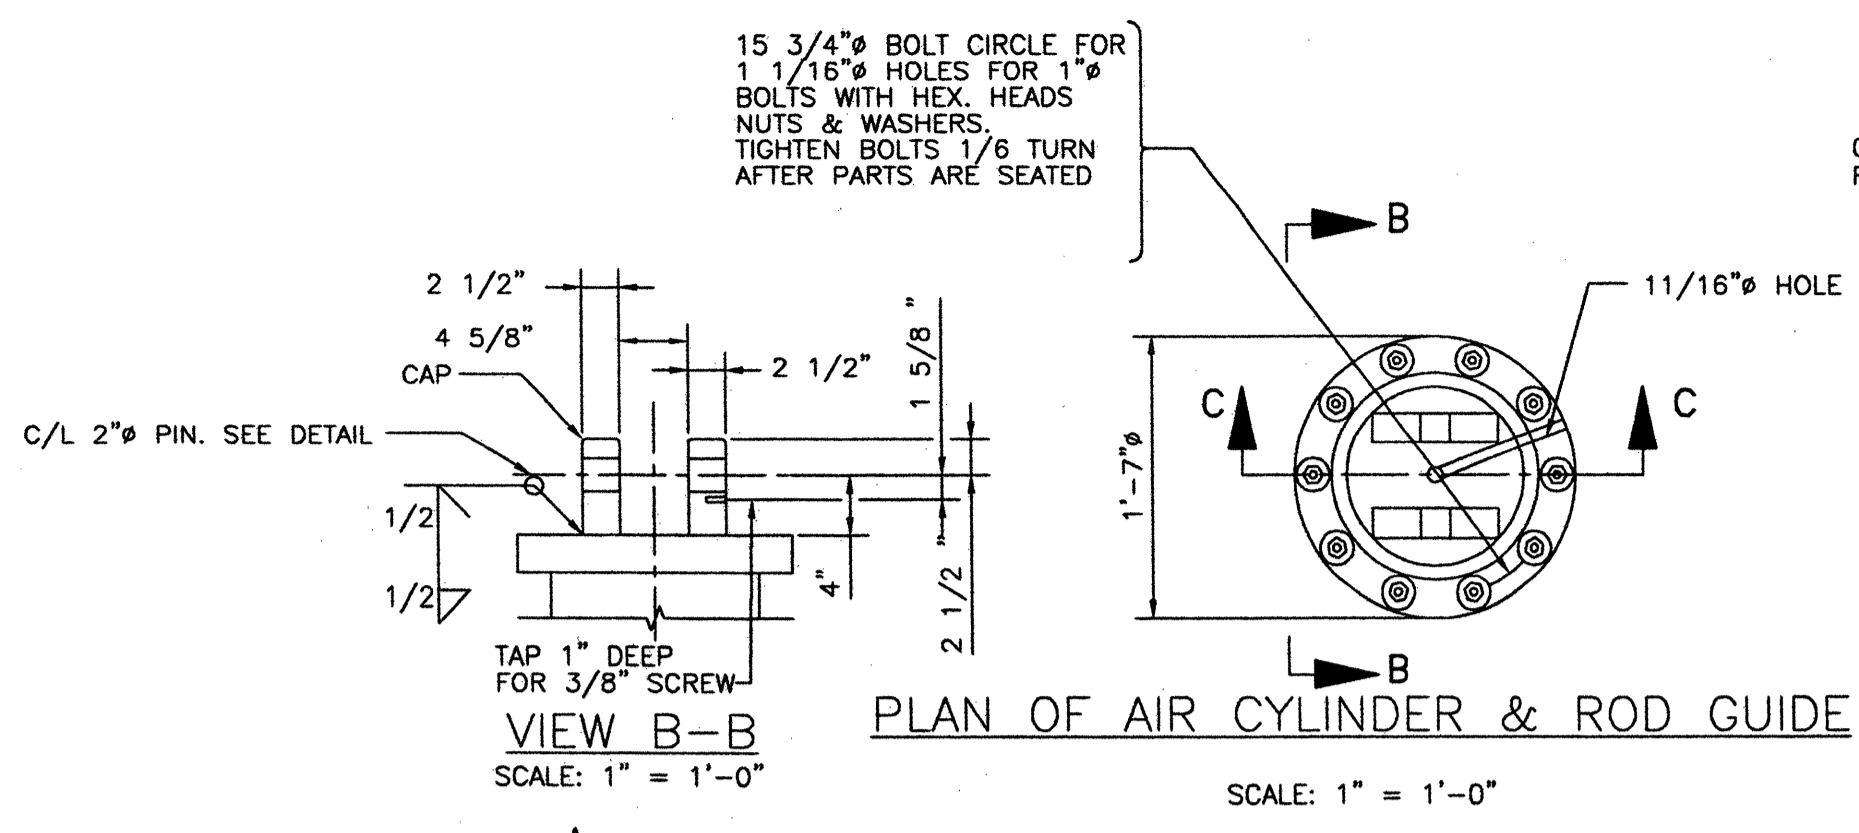


PLAN OF AIR CYLINDER & ROD GUIDE
SCALE: 1" = 1'-0"

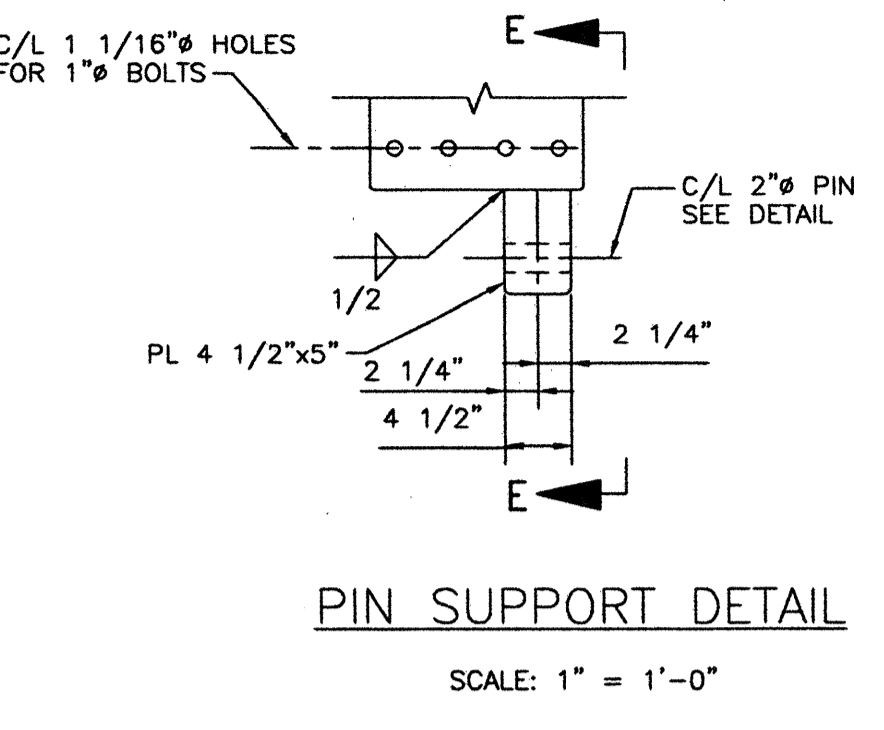


PIN SUPPORT DETAIL
SCALE: 1" = 1'-0"

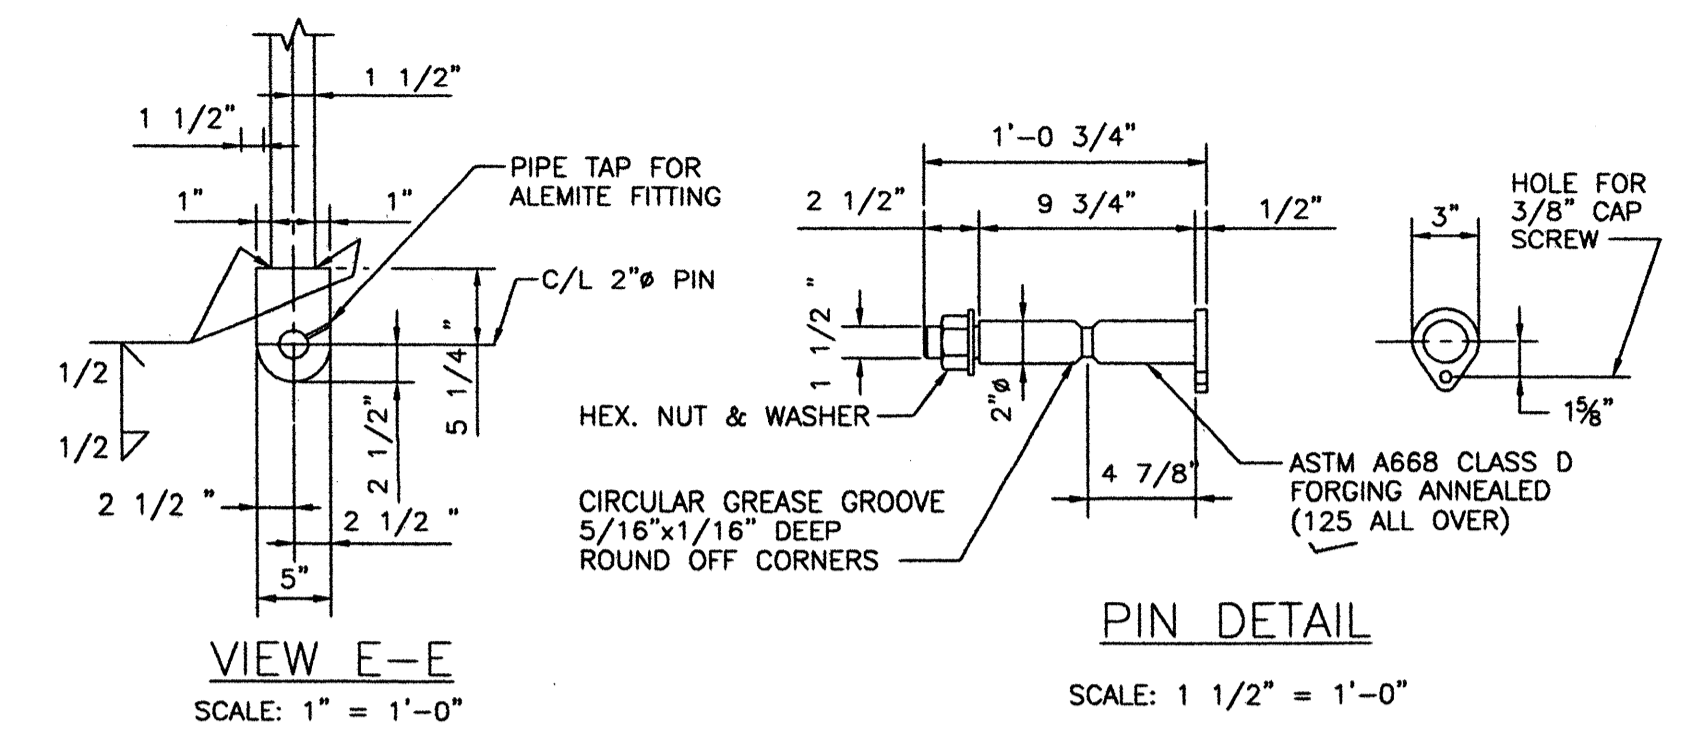


PIN DETAIL
SCALE: 1 1/2" = 1'-0"

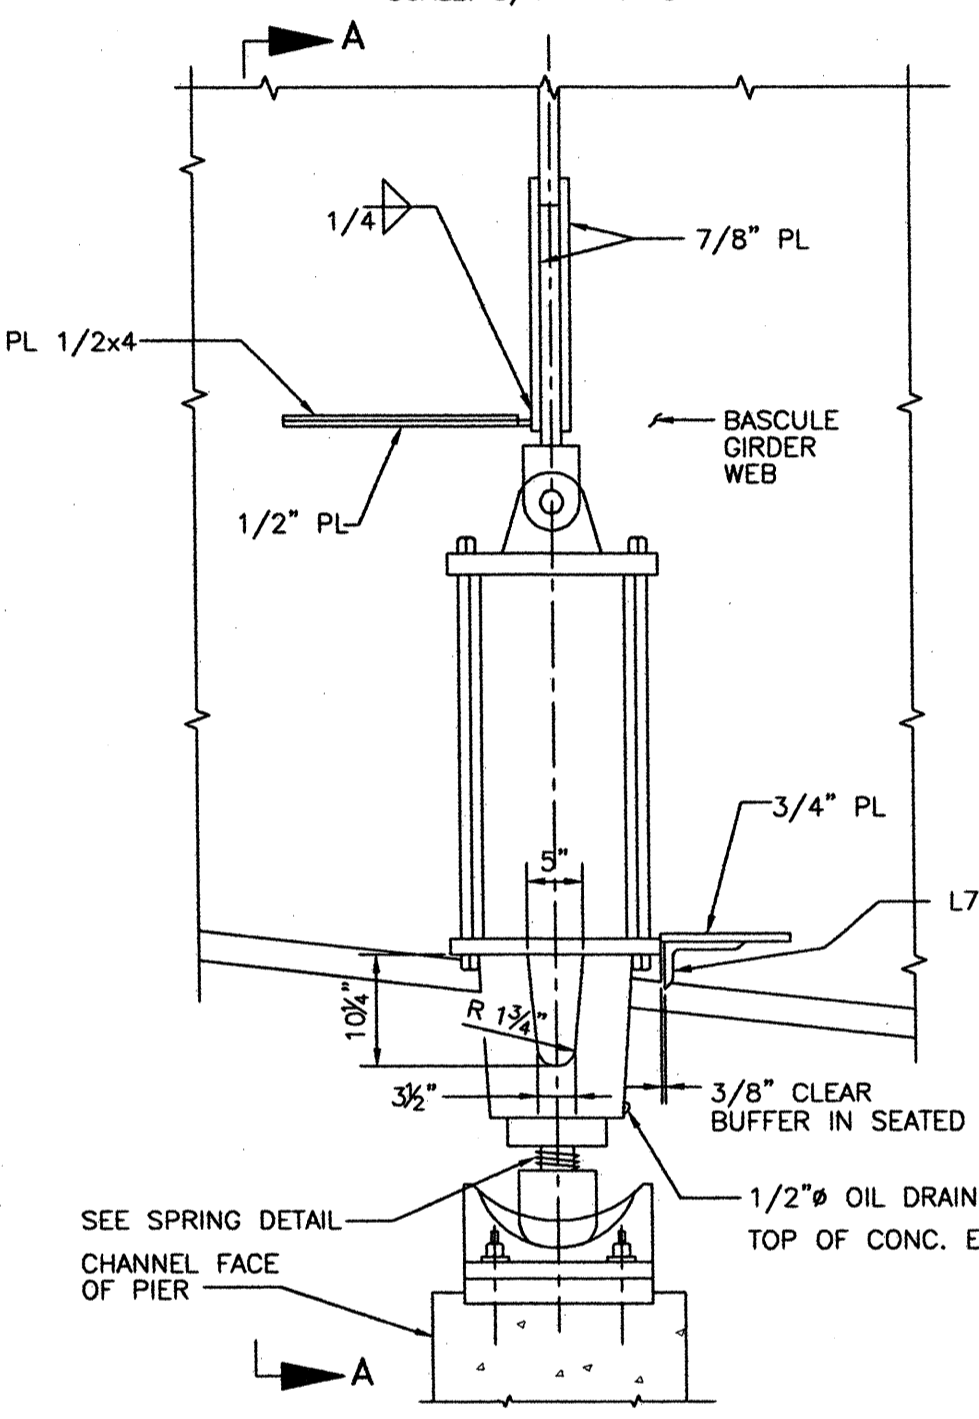


ELEVATION
SCALE: 3/4" = 1'-0"

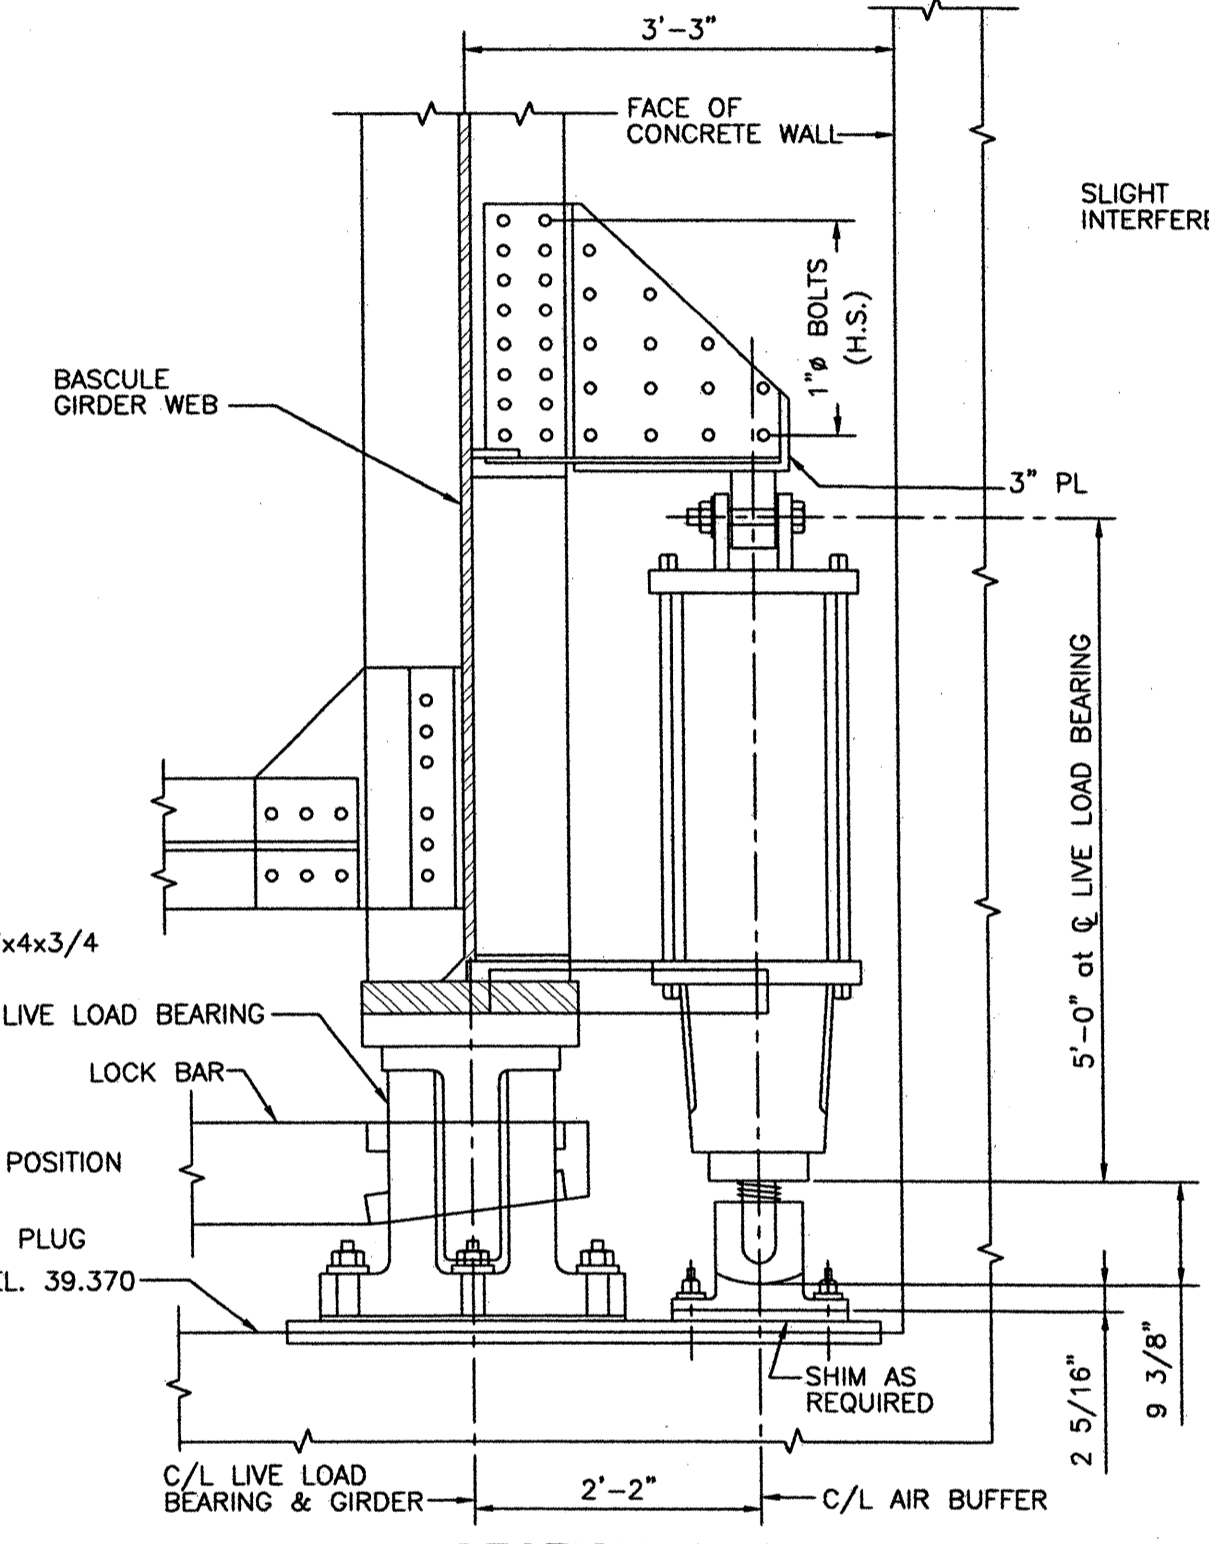


SECTION A-A
SCALE: 3/4" = 1'-0"

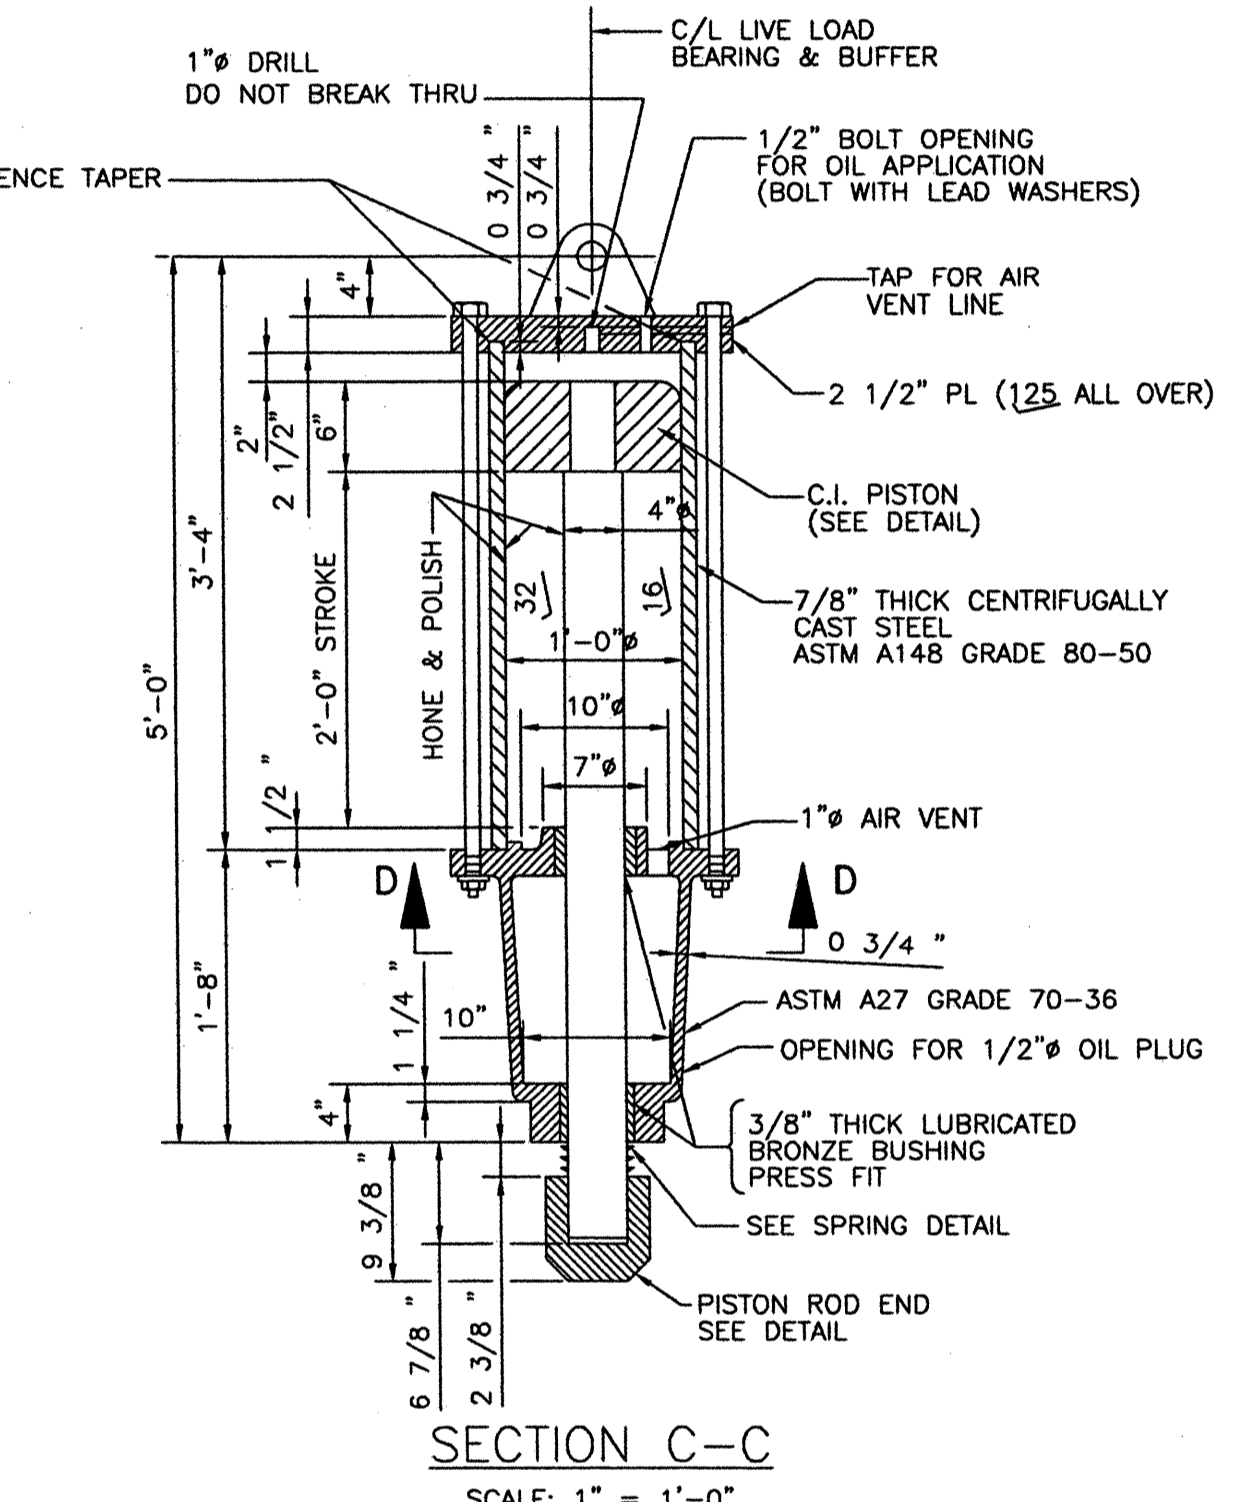


SECTION C-C
SCALE: 1" = 1'-0"

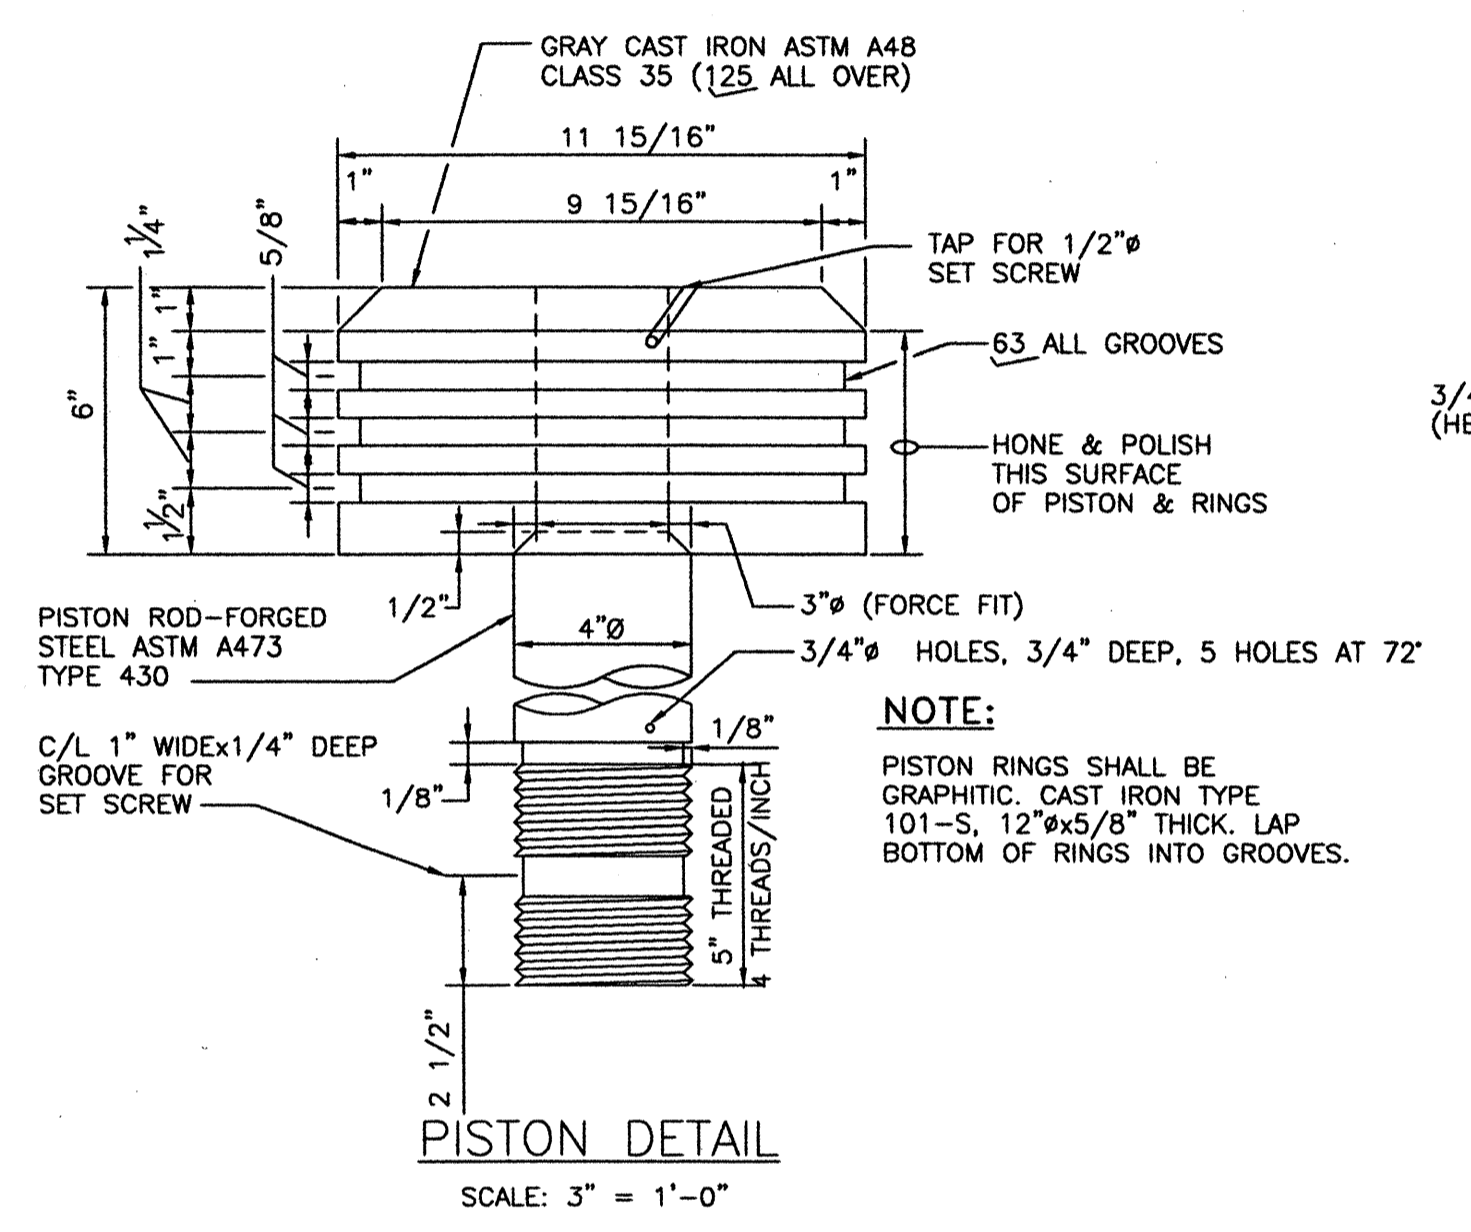


PISTON DETAIL
SCALE: 3" = 1'-0"

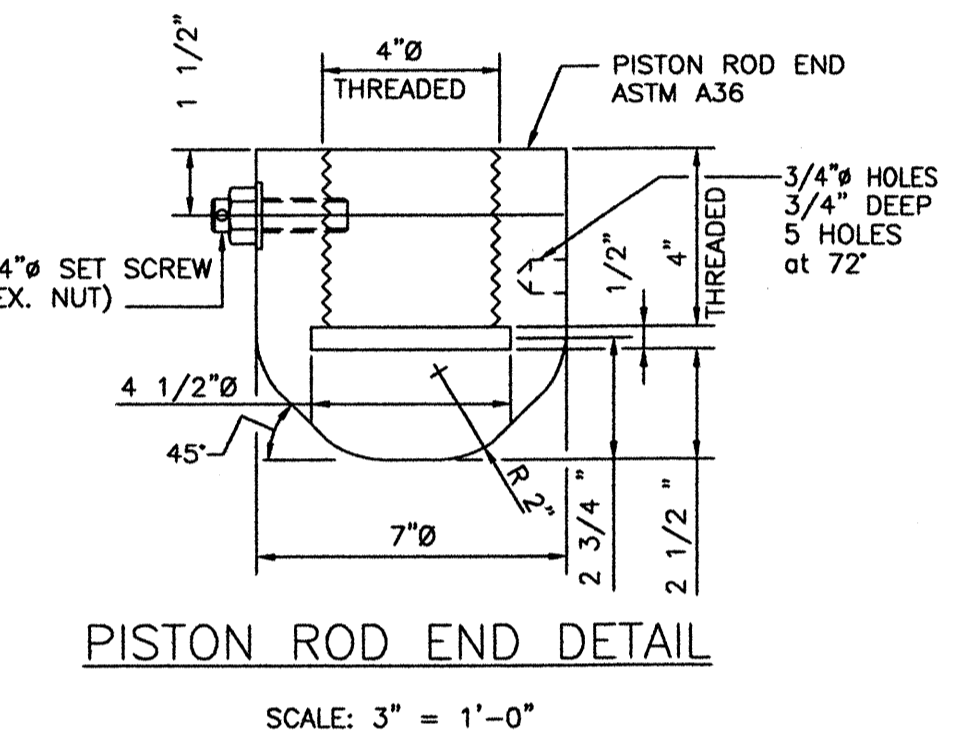


PISTON ROD END DETAIL
SCALE: 3" = 1'-0"

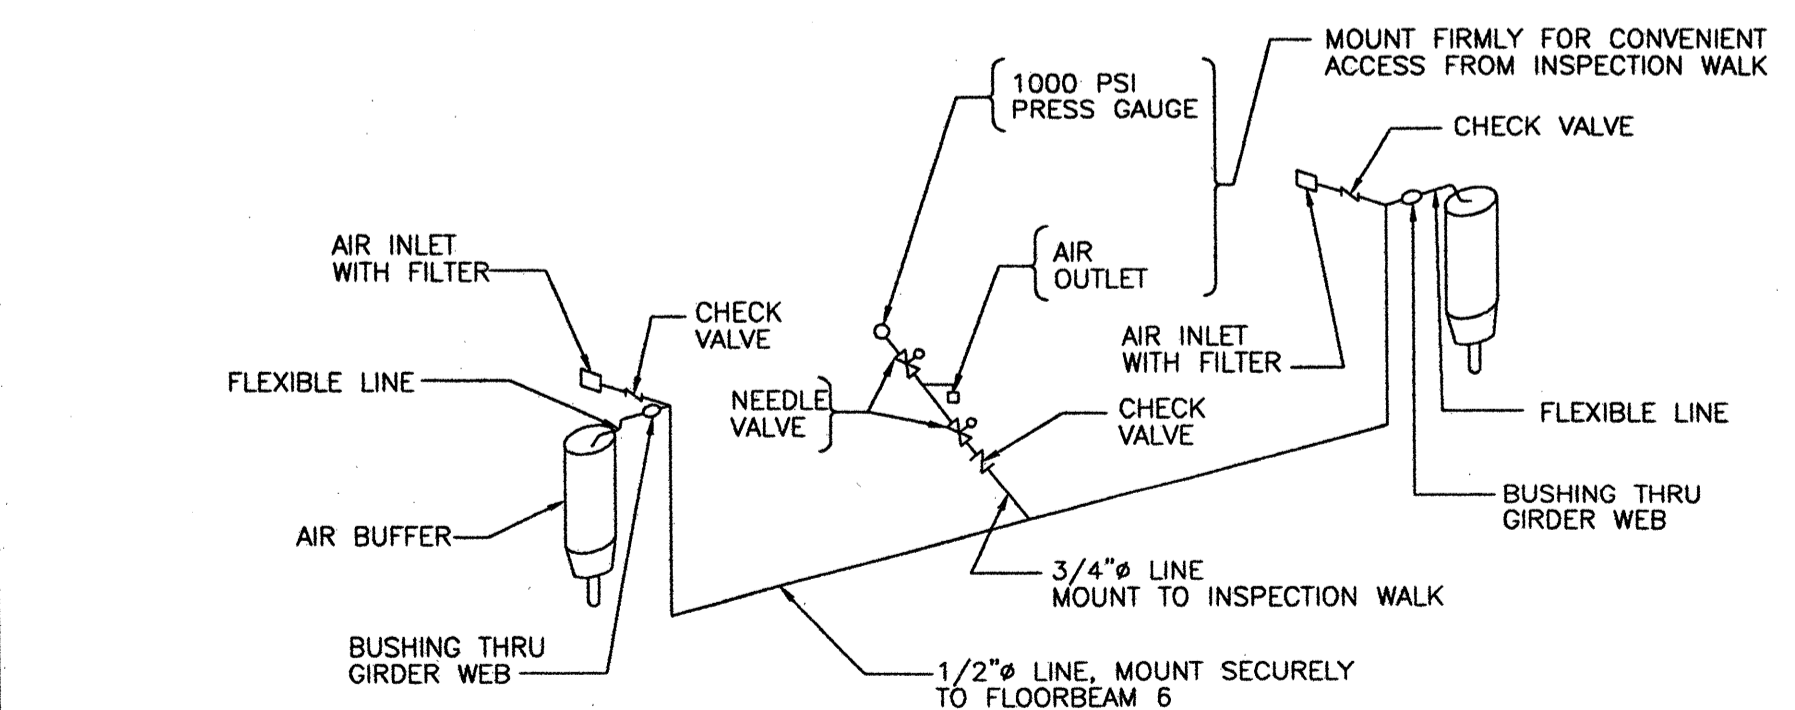

SCHEMATIC
EXISTING TYPICAL LEAF BUFFER SYSTEM
SCALE: NONE

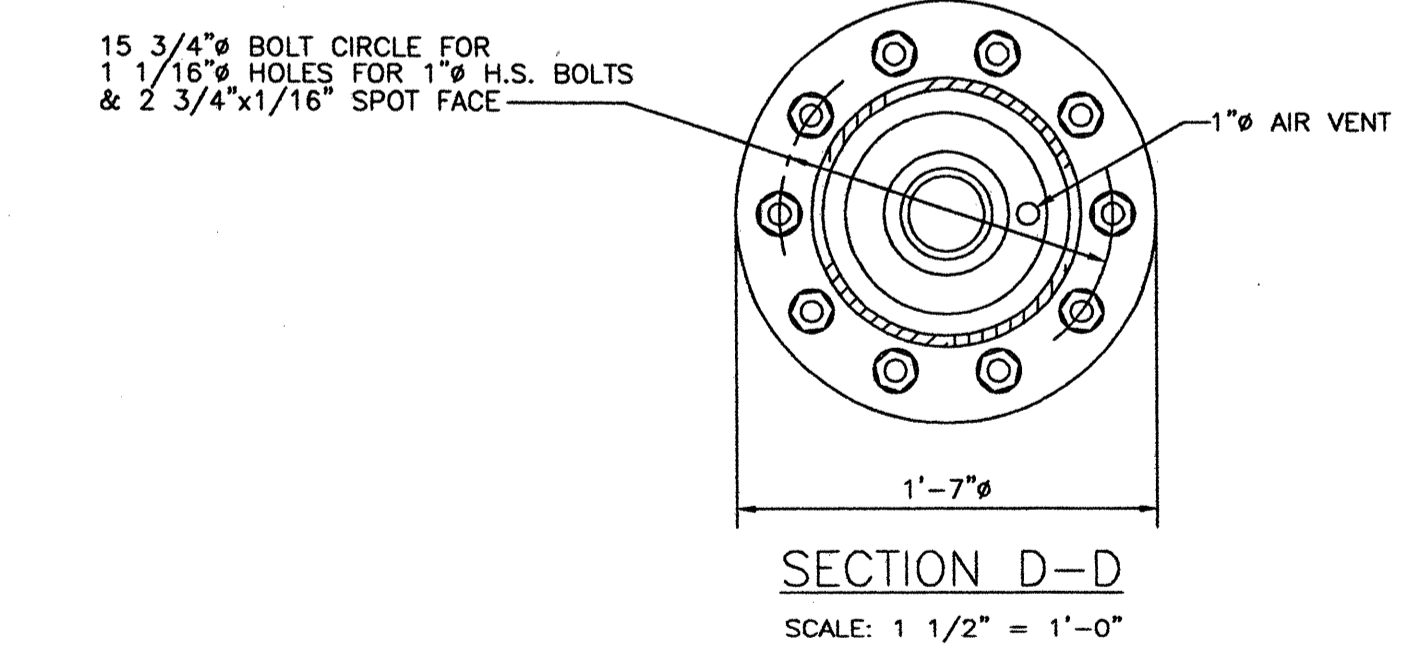


SECTION D-D
SCALE: 1 1/2" = 1'-0"

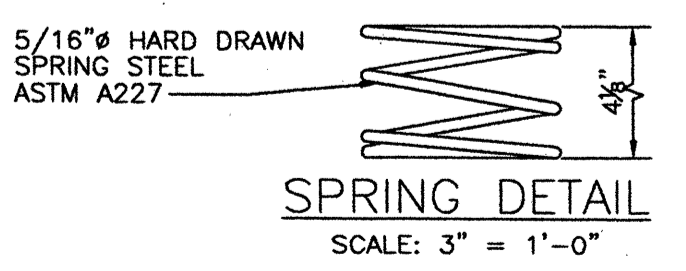


SPRING DETAIL
SCALE: 3" = 1'-0"


NOTES:
THIS DRAWING IS INCLUDED FOR REFERENCE ONLY. ALL DIMENSIONS MUST BE FIELD VERIFIED.

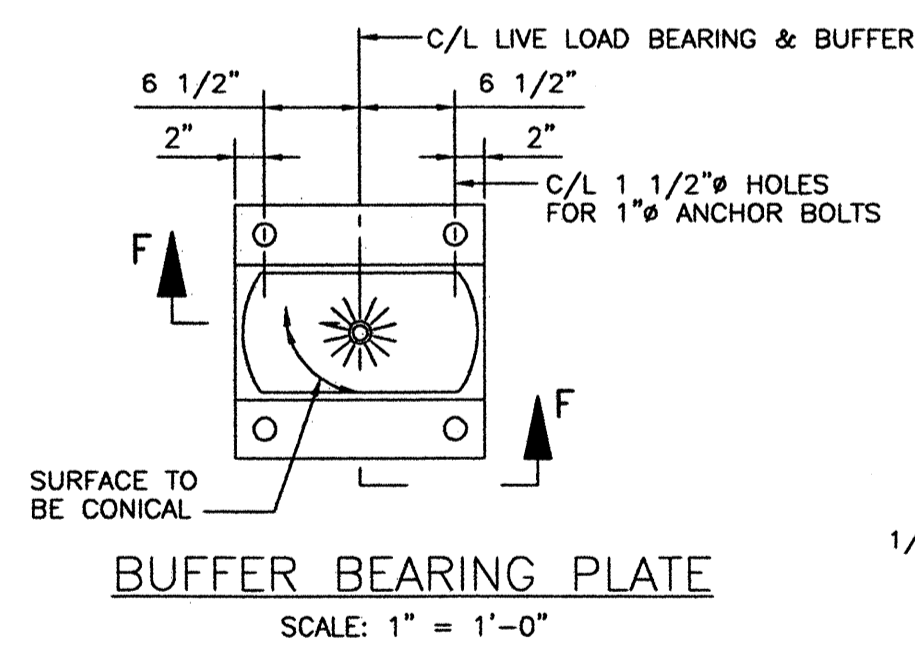



BUFFER BEARING PLATE
SCALE: 1" = 1'-0"

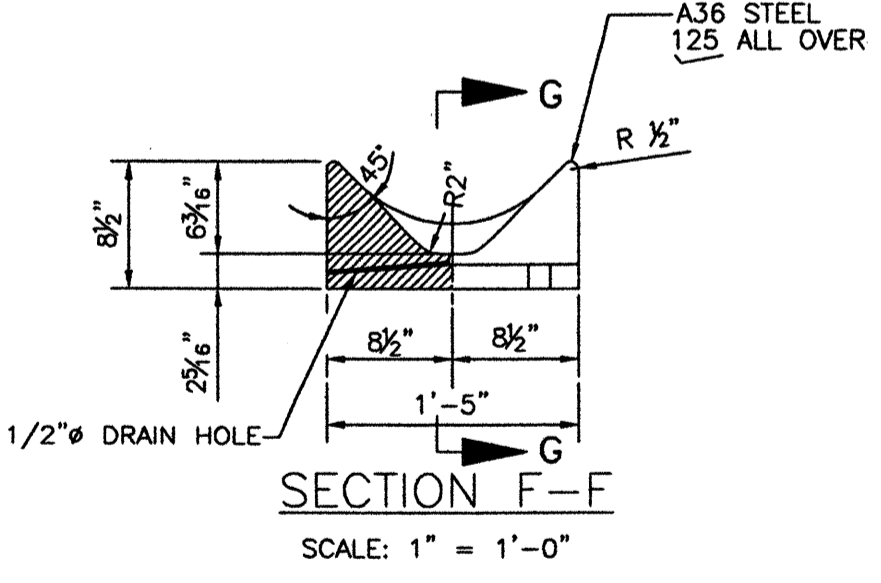


SECTION F-F
SCALE: 1" = 1'-0"

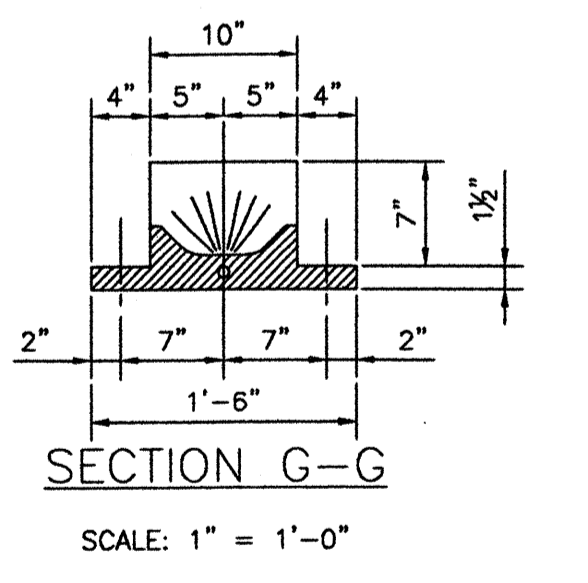

SECTION G-G
SCALE: 1" = 1'-0"

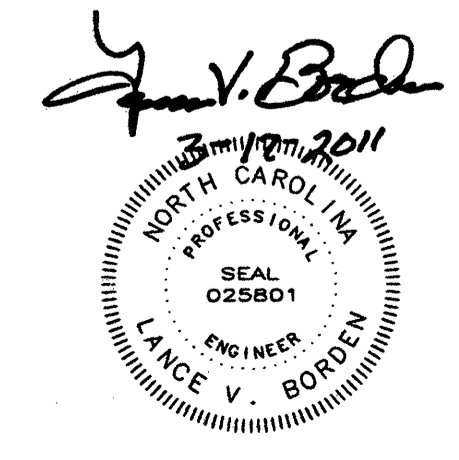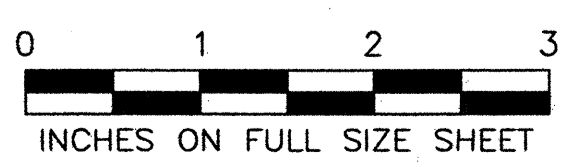


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE			
WILMINGTON, NORTH CAROLINA			
EXISTING AIR BUFFER			
DESIGNED	D.M. BARRETT	DATE	MARCH 2011
CHECKED	G.L. FOREST	DRAWING NO.	21 OF 63
DRAWN BY	E.A. RICKENBACH	SCALE	AS NOTED
MB20		CHECKED G.L. FOREST	

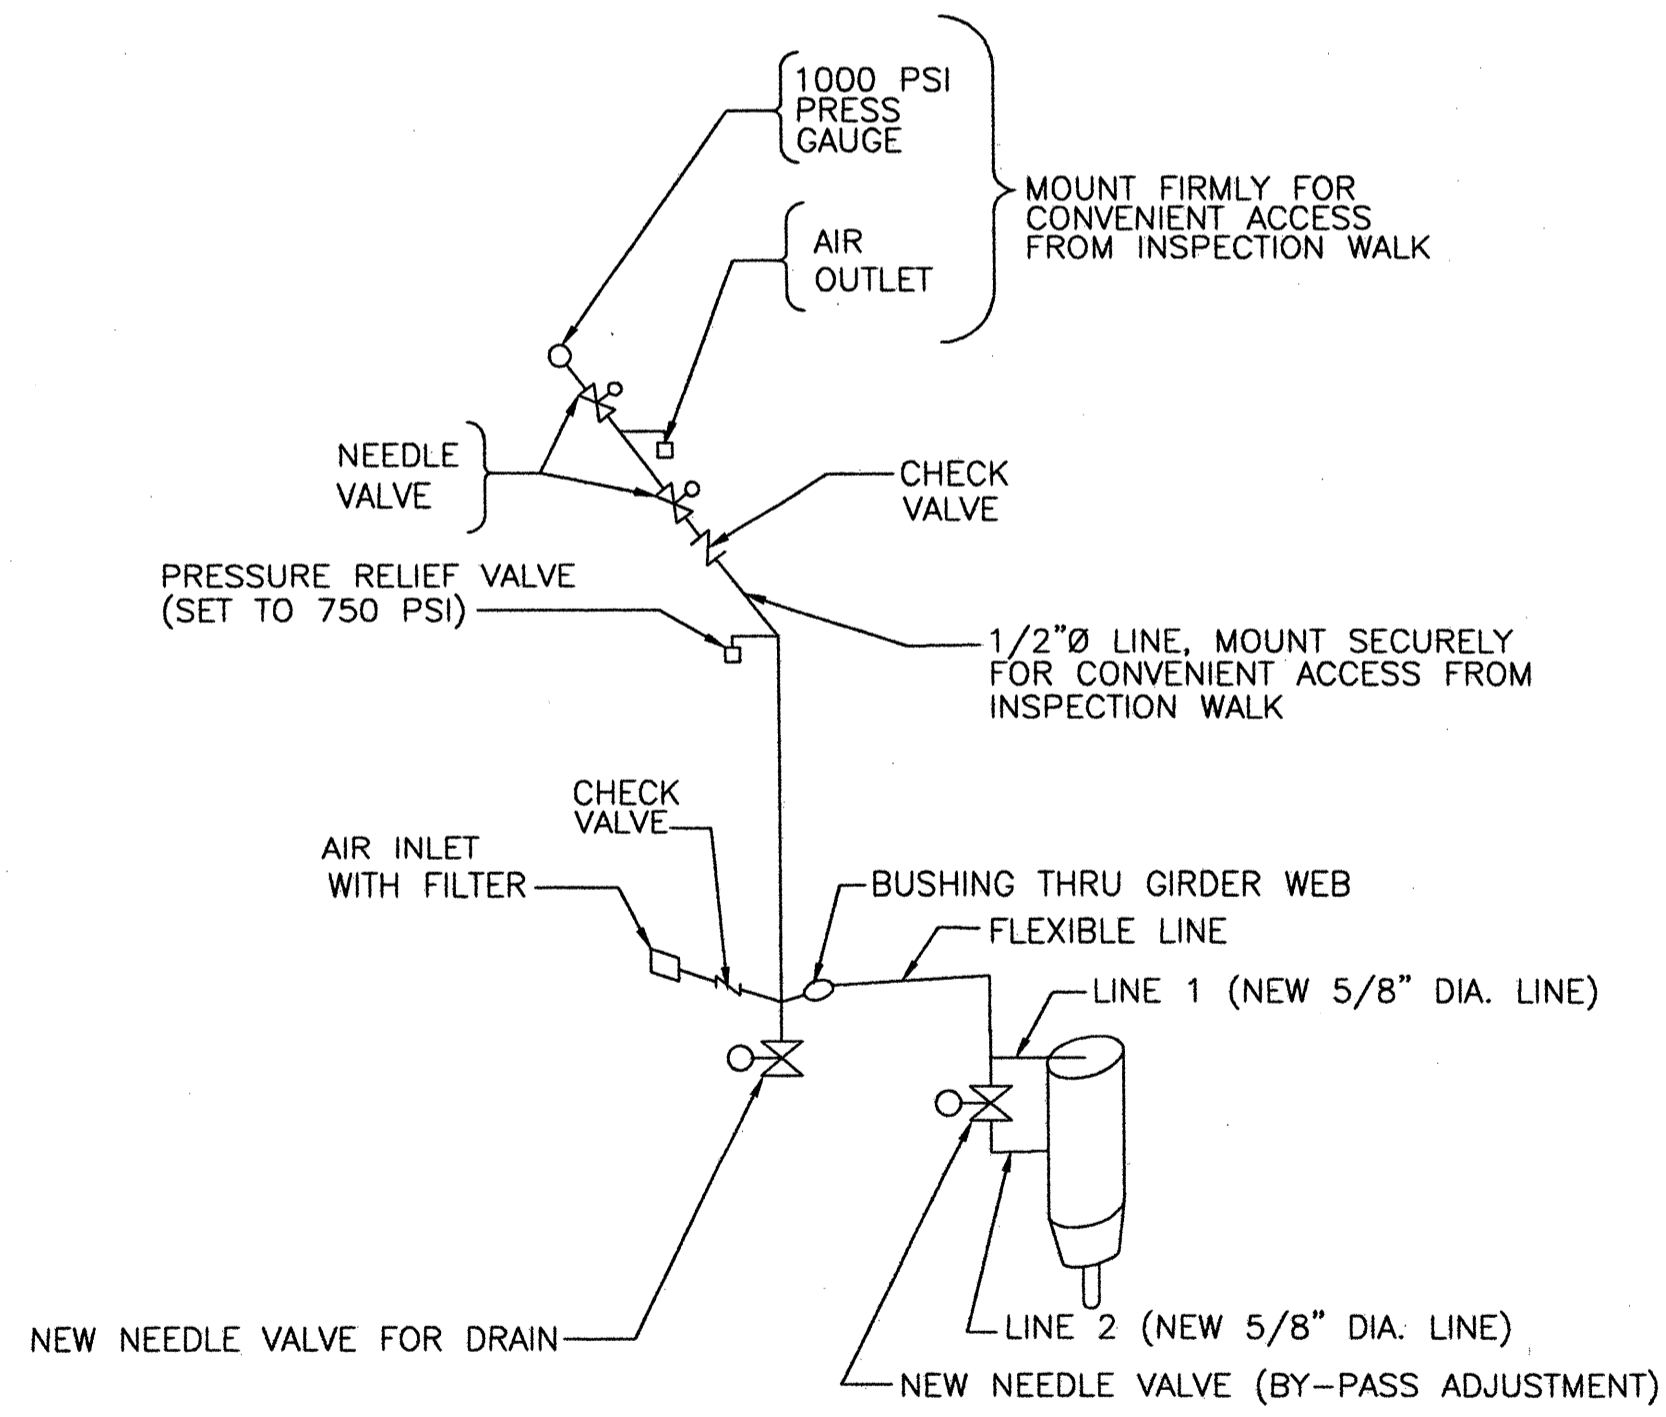


SCHMATIC
TYPICAL LEAF BUFFER SYSTEM

SCALE: NONE
QUANTITY: FOUR

NOTE:
REPLACE ALL EXISTING FITTINGS, LINES AND VALVES WITH NEW STAINLESS STEEL COMPONENTS RATED AT 1500 PSI MINIMUM.


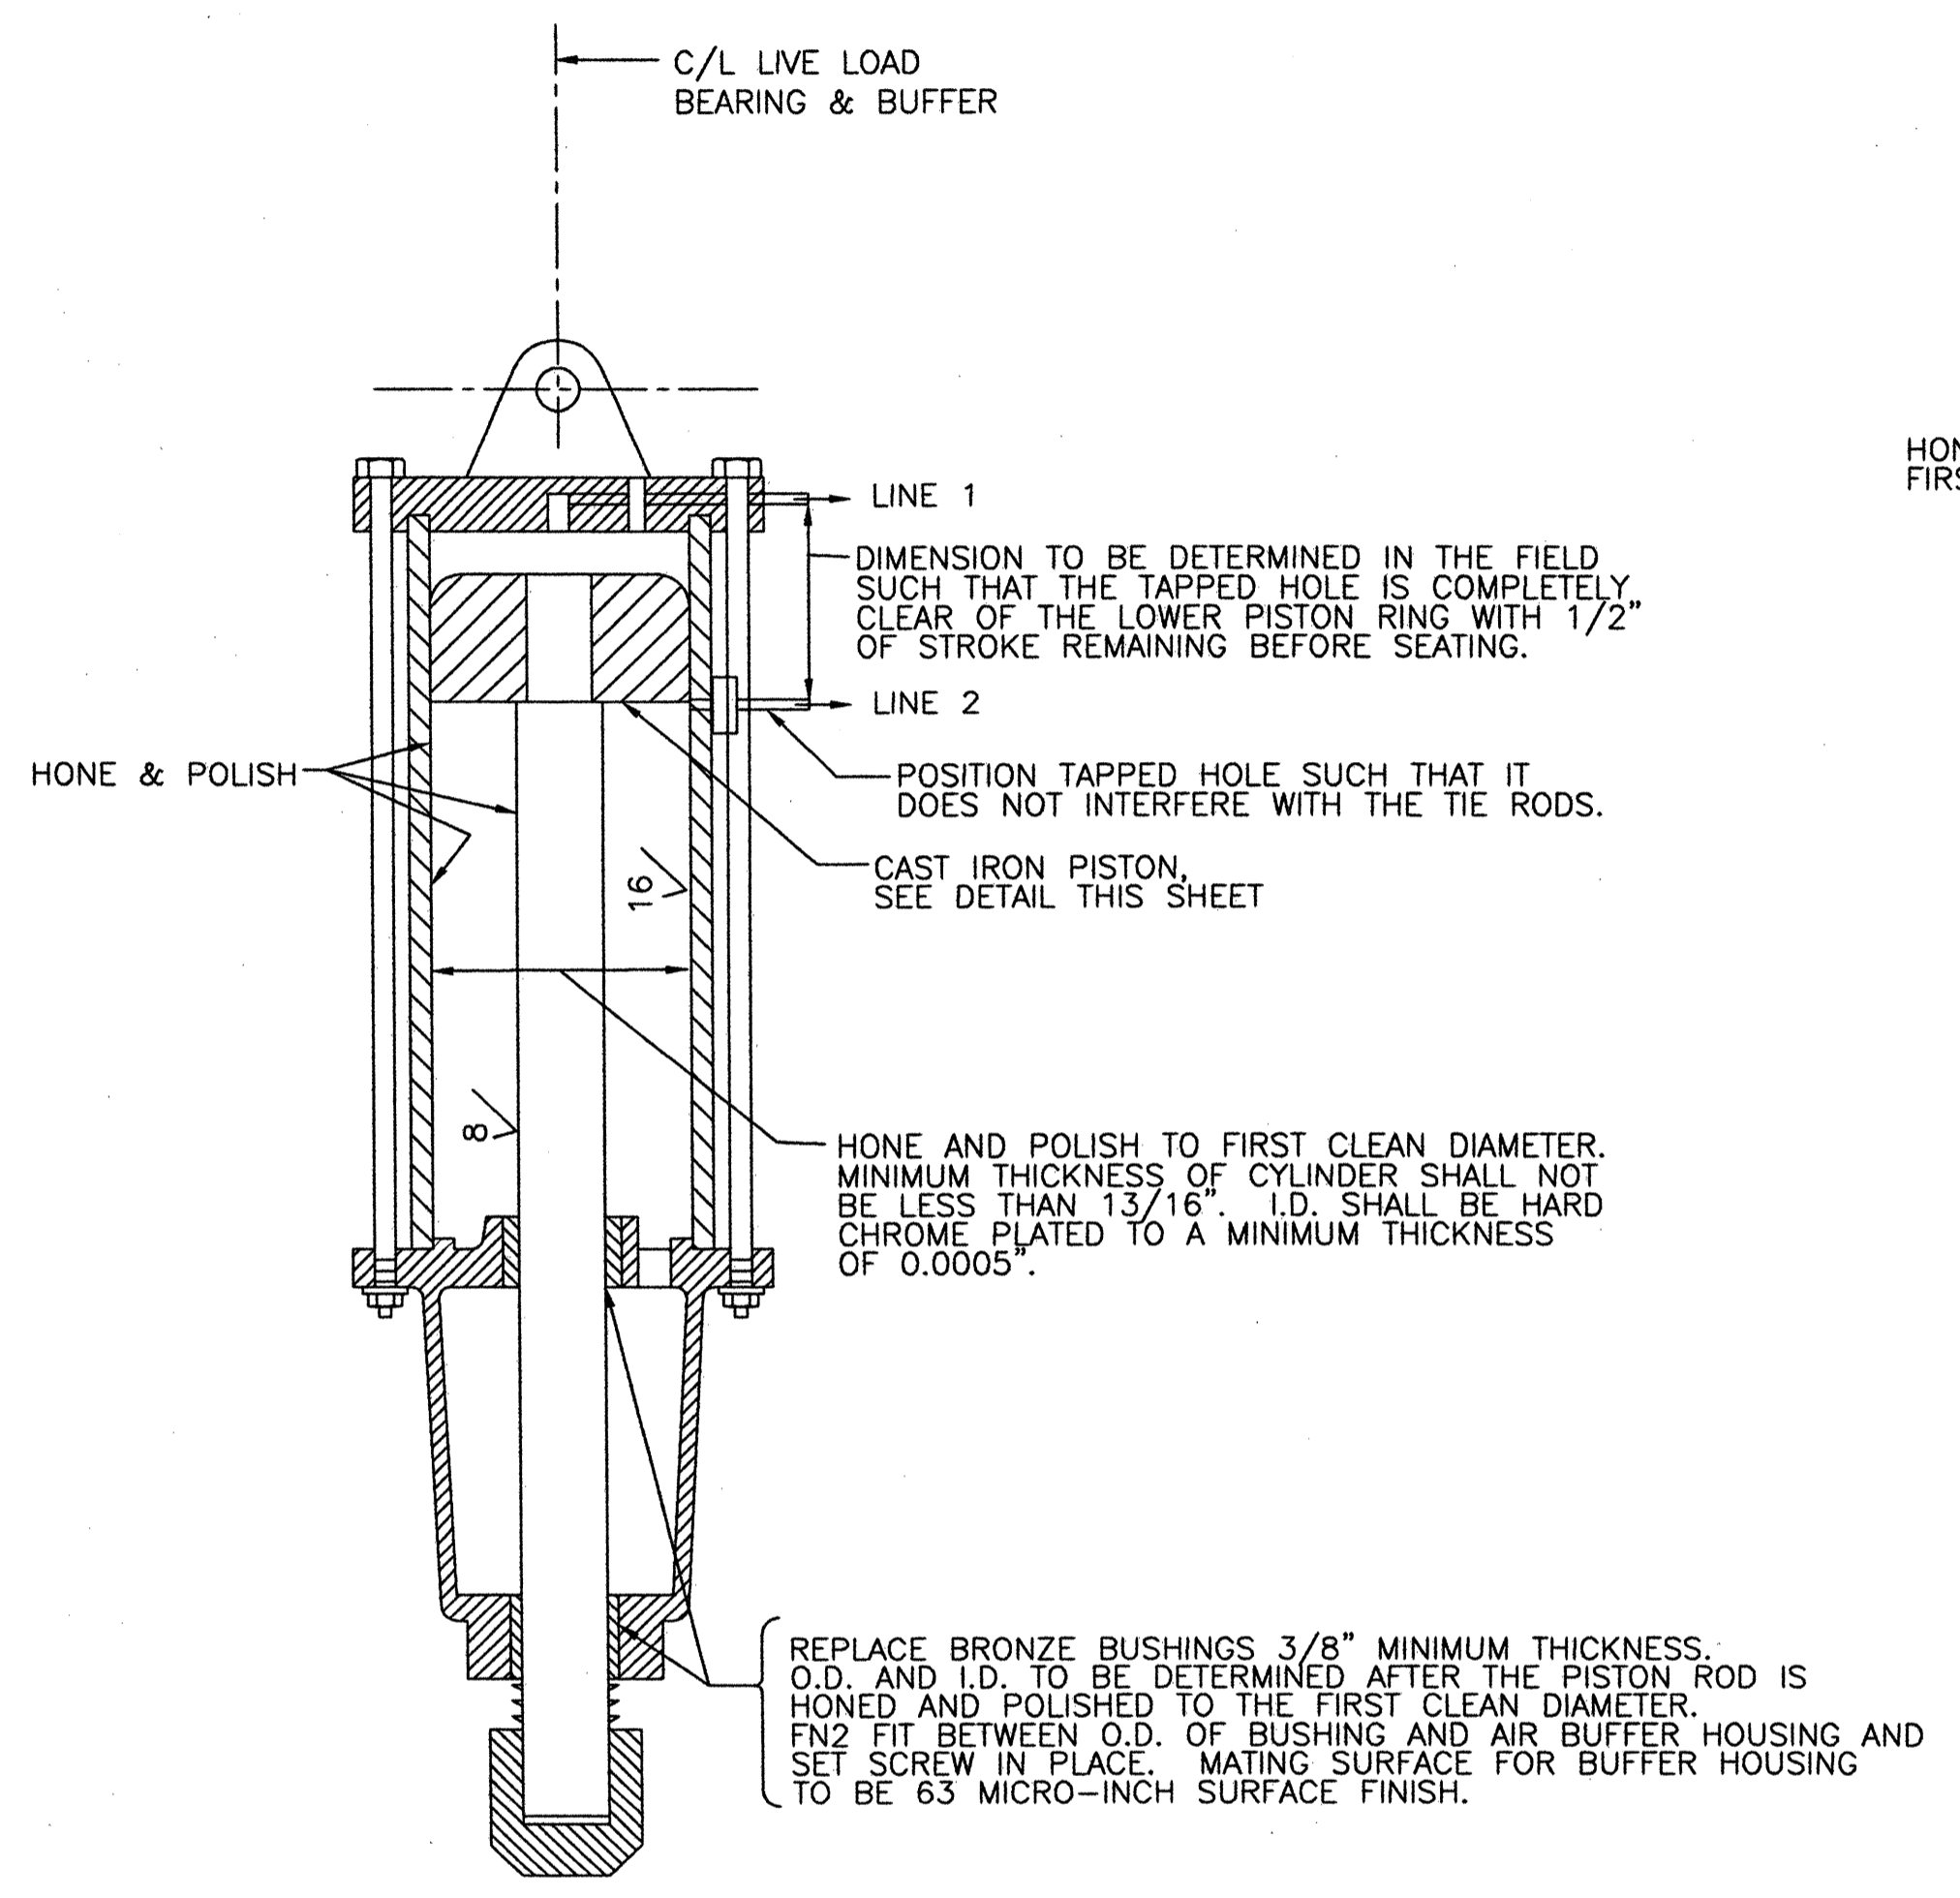


AIR BUFFER DETAIL
SCALE: 1 1/2" = 1'-0"

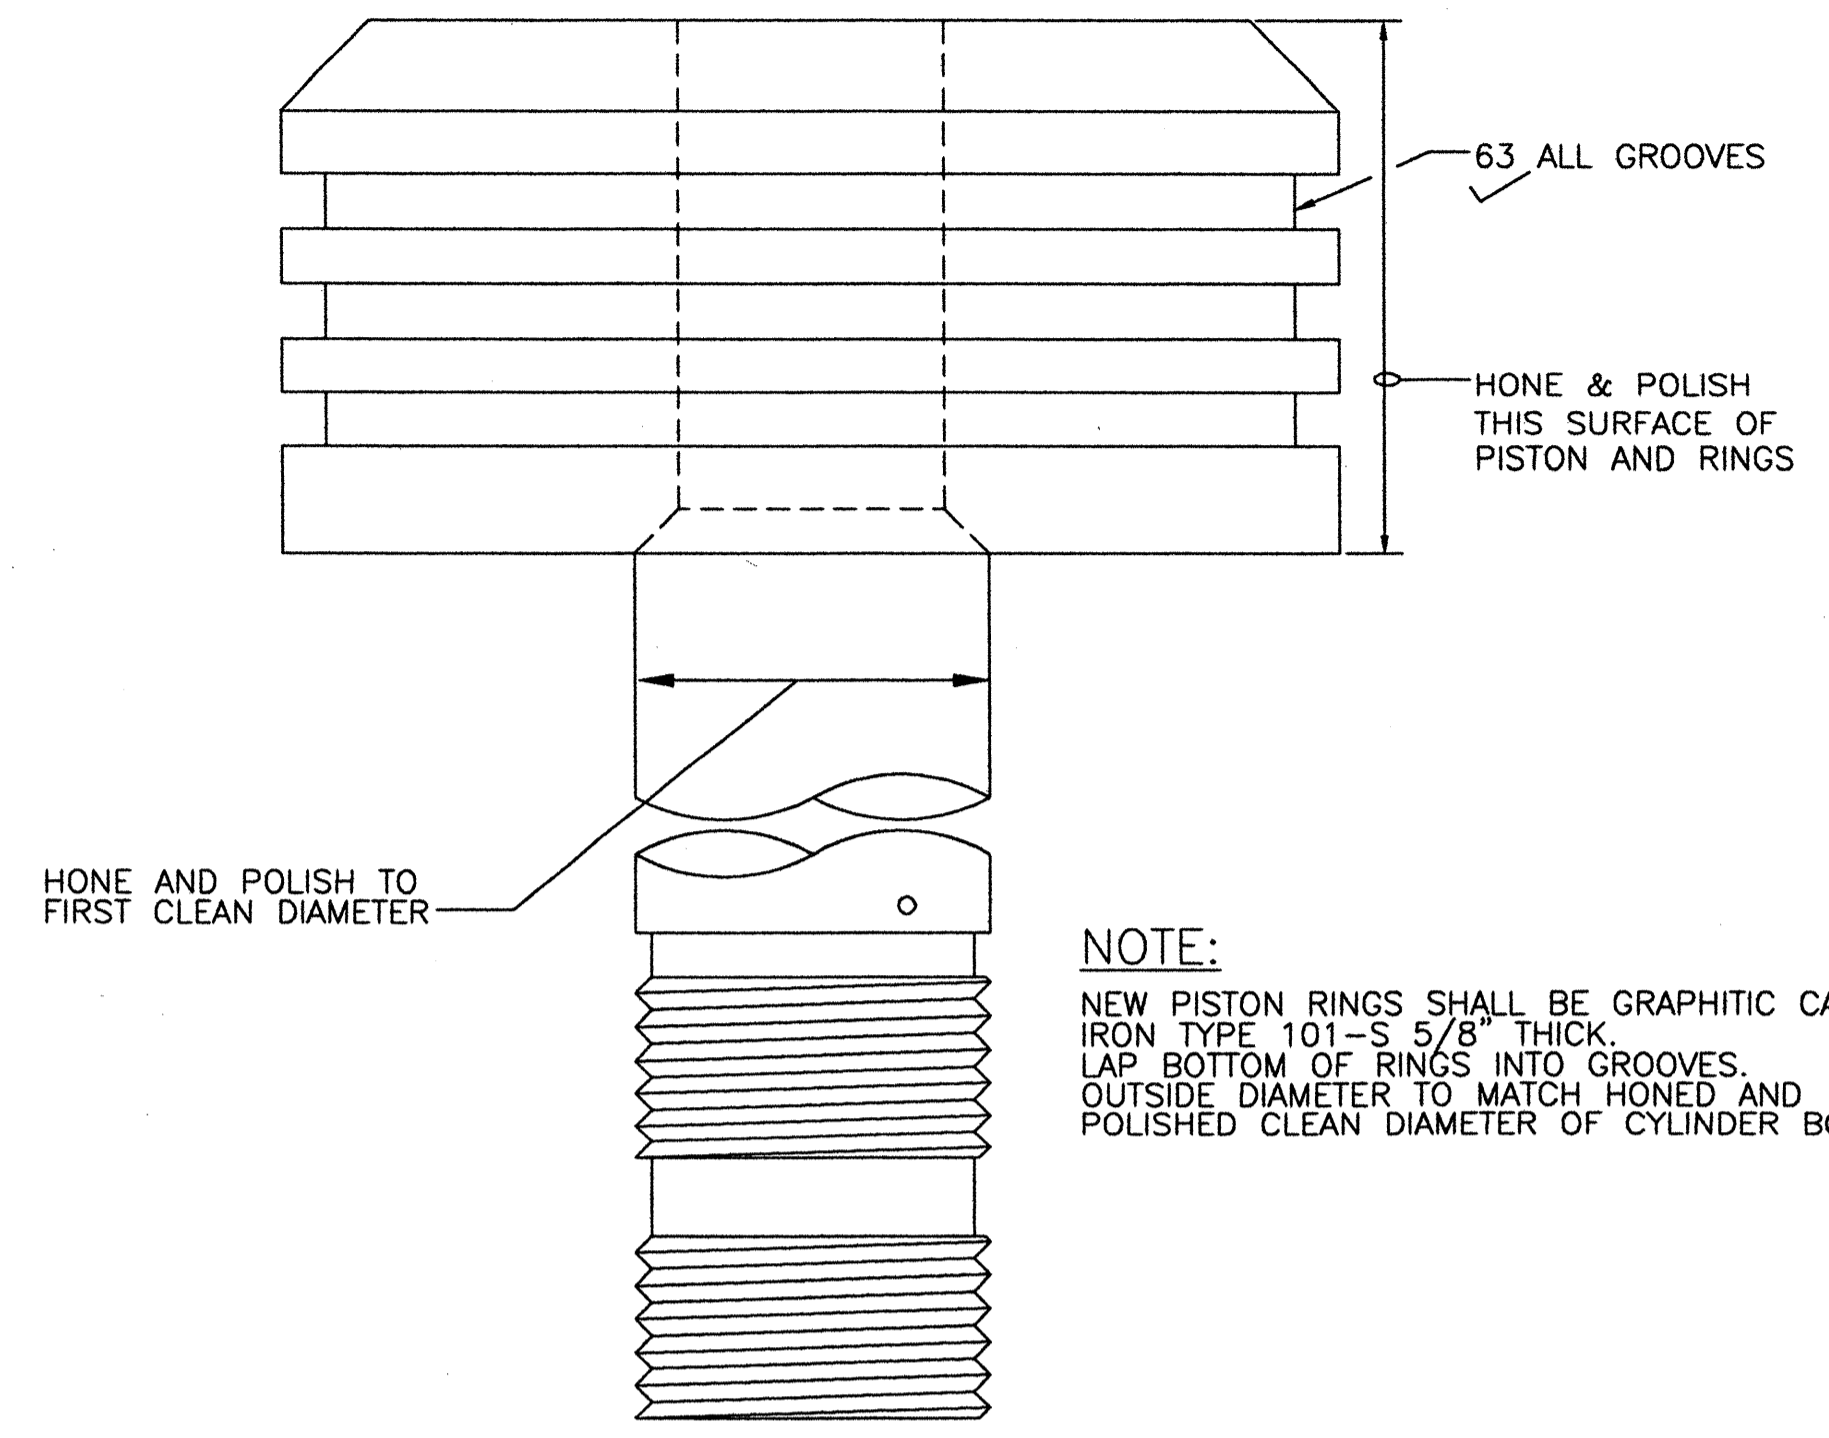


PISTON DETAIL
SCALE: 6" = 1'-0"

- NOTES:**
1. FOR SCOPE OF WORK, SEE DWG. NO. M1.
 2. ALL BUFFER FITTINGS AND LINES SHALL HAVE MINIMUM CAPACITY OF 1500 PSI.
 3. SELF LUBRICATING BRONZE BUSHINGS SHALL BE OILITE BRONZE, ASTM B438, GRADE 1, TYPE II OR APPROVED EQUAL.
 4. ALL BUSHINGS SHALL BE SECURED IN POSITION ADEQUATE TO INSURE AGAINST DISLODGE MENT DURING OPERATION.
 5. ALL EXISTING COMPONENTS TO BE REUSED SHALL BE SAND BLASTED WITH SSPC SURFACE PREP SP6 COMMERCIAL BLAST CLEANING.
 6. SEE SPECIFICATIONS FOR PRIMING AND PAINTING DETAILS. ALL COMPONENTS TO BE THOROUGHLY CLEANED, PRIMED AND PAINTED EXCEPT SLIDING SURFACES.
 7. PROVIDE LADDER BOLTED TO PIER WALL ADJACENT TO AIR BUFFER LOCATION FOR ACCESS DURING ADJUSTMENTS AND MAINTENANCE. LADDER LOCATION, TYPE, AND MOUNTING DETAILS TO BE SUBMITTED AND APPROVED BY NCDOT BEFORE INSTALLATION.

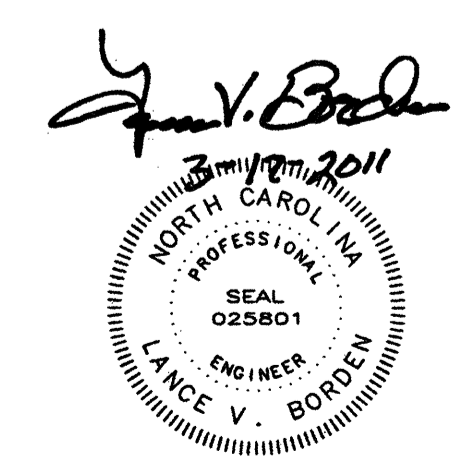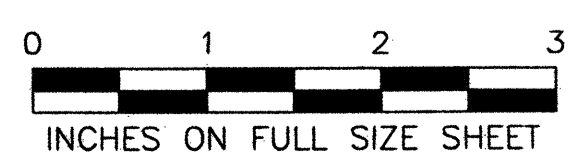


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
AIR BUFFER REHABILITATION			
DRAWN BY E.A. RICKENBACH		SCALE AS NOTED	
DESIGNED D.M. BARRETT	DETAILED A.M. BRODSKY	DATE	MARCH 2011
CHECKED G.L. FOREST	CHECKED G.L. FOREST	DRAWING NO.	22 OF 63


22-MB21-ABR.DWG

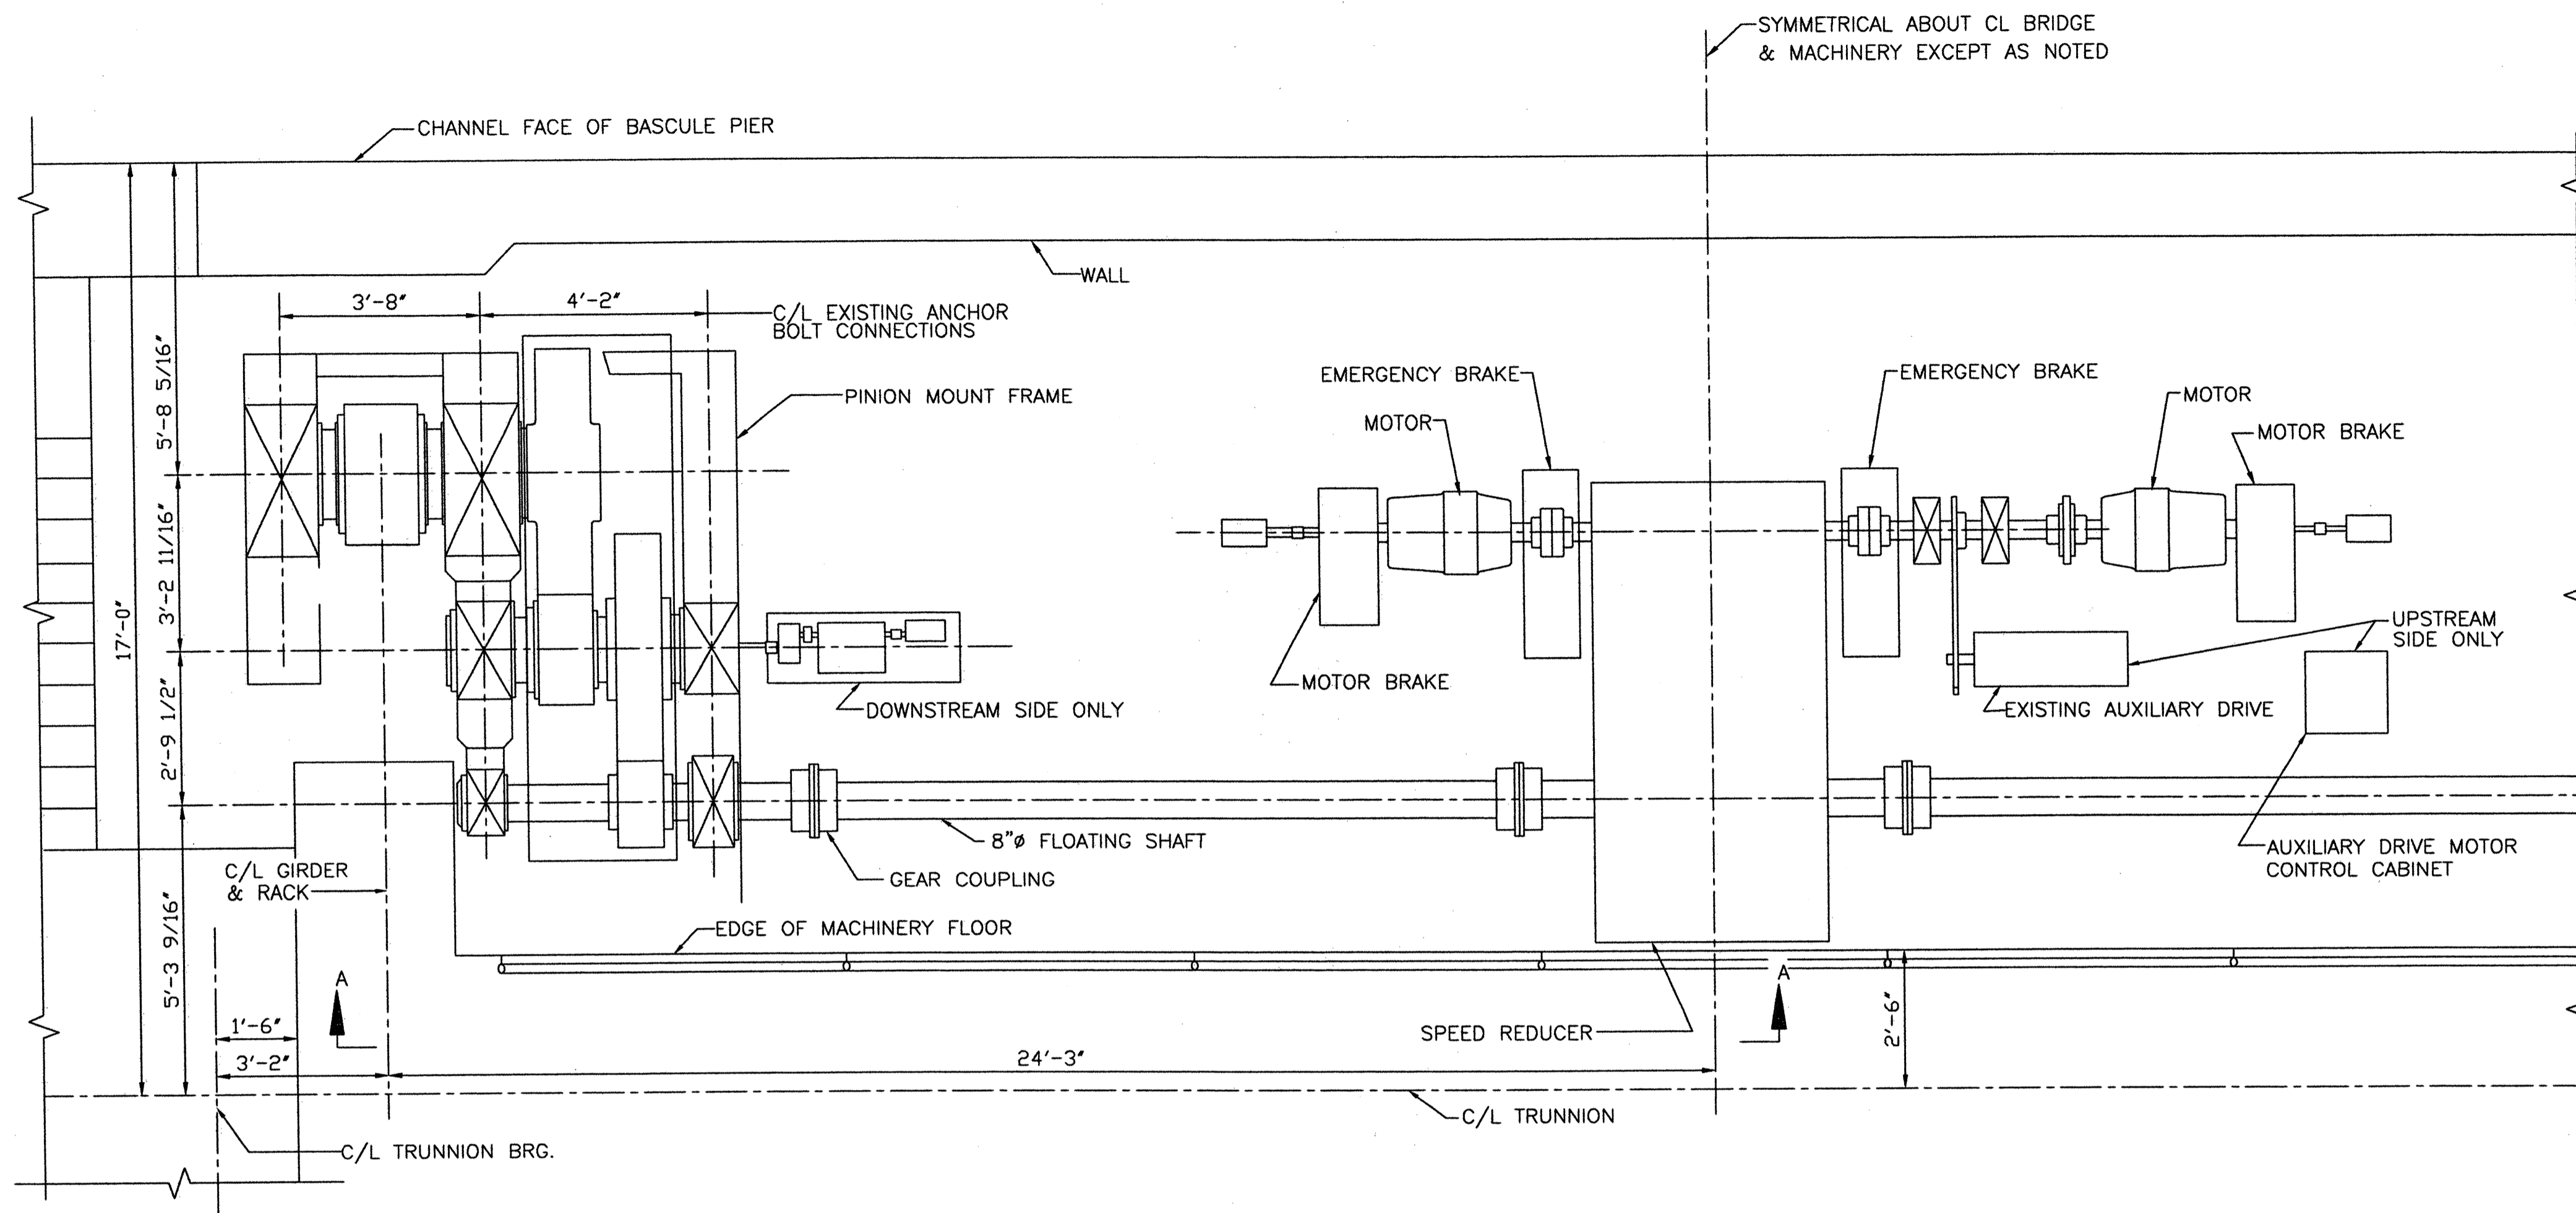



PLAN OF EXISTING OPERATING MACHINERY
SCALE: 1/2" = 1'-0"

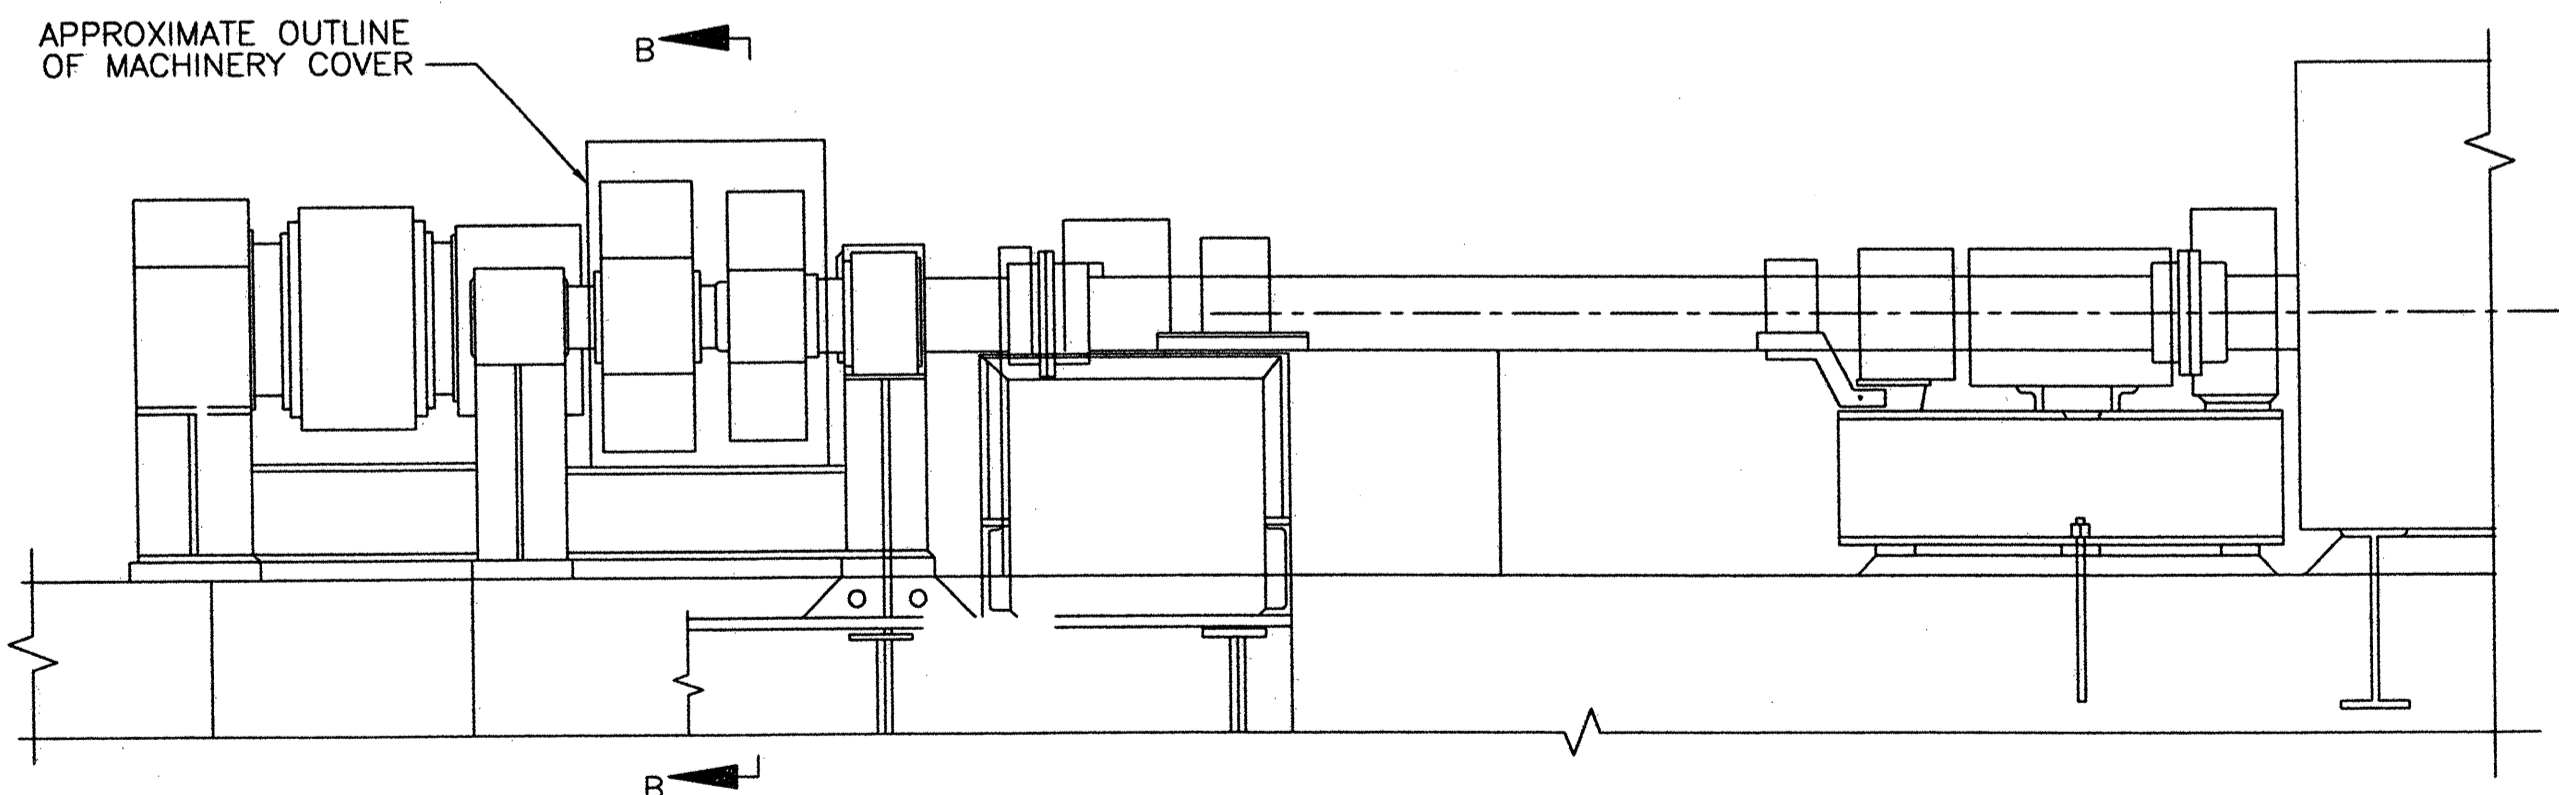

SECTION A-A
SCALE: 1/2" = 1'-0"

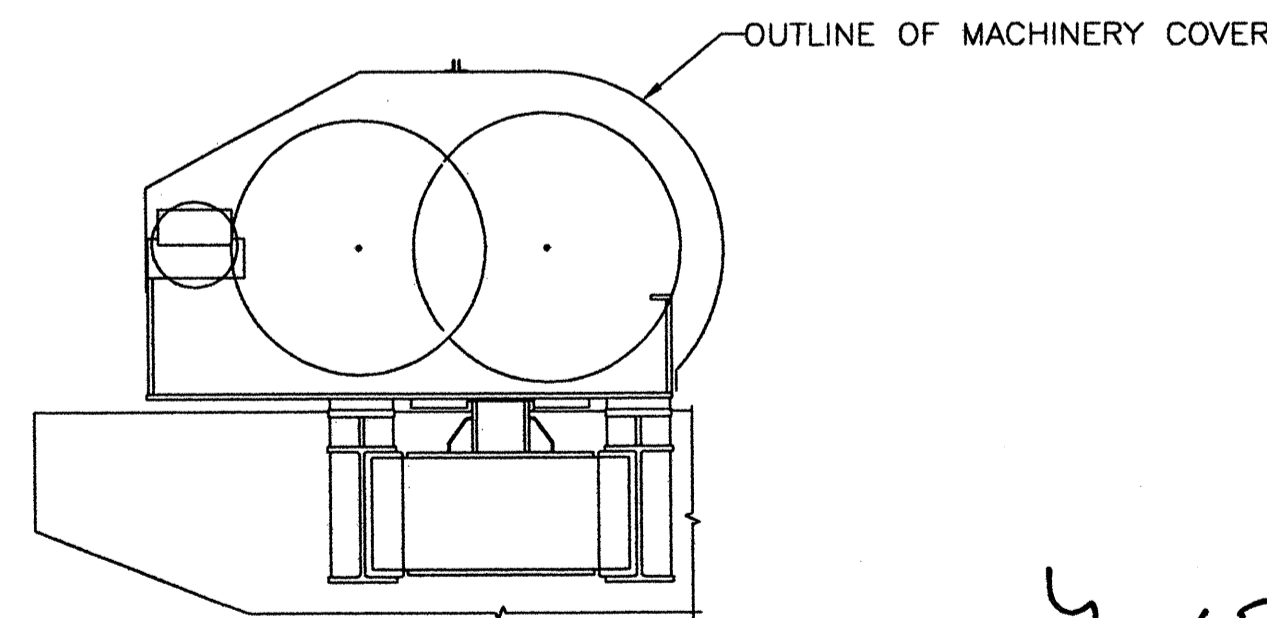



SECTION B-B
SCALE: 1/2" = 1'-0"

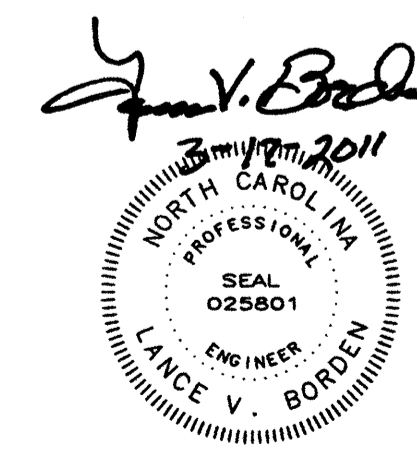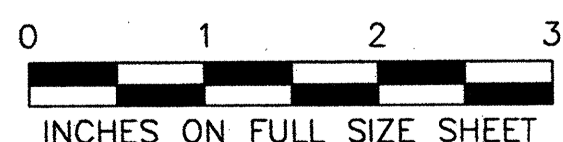


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH
CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
OPEN GEARING FRAME ANCHOR BOLT
REPLACEMENT - 1

DESIGNED	D.B. IRWIN	DETAILED	D.B. IRWIN	DATE	MARCH 2011
CHECKED	H. BUI	CHECKED	H. BUI	DRAWING NO.	23 OF 63

23-MB22-00FABRI.DWG

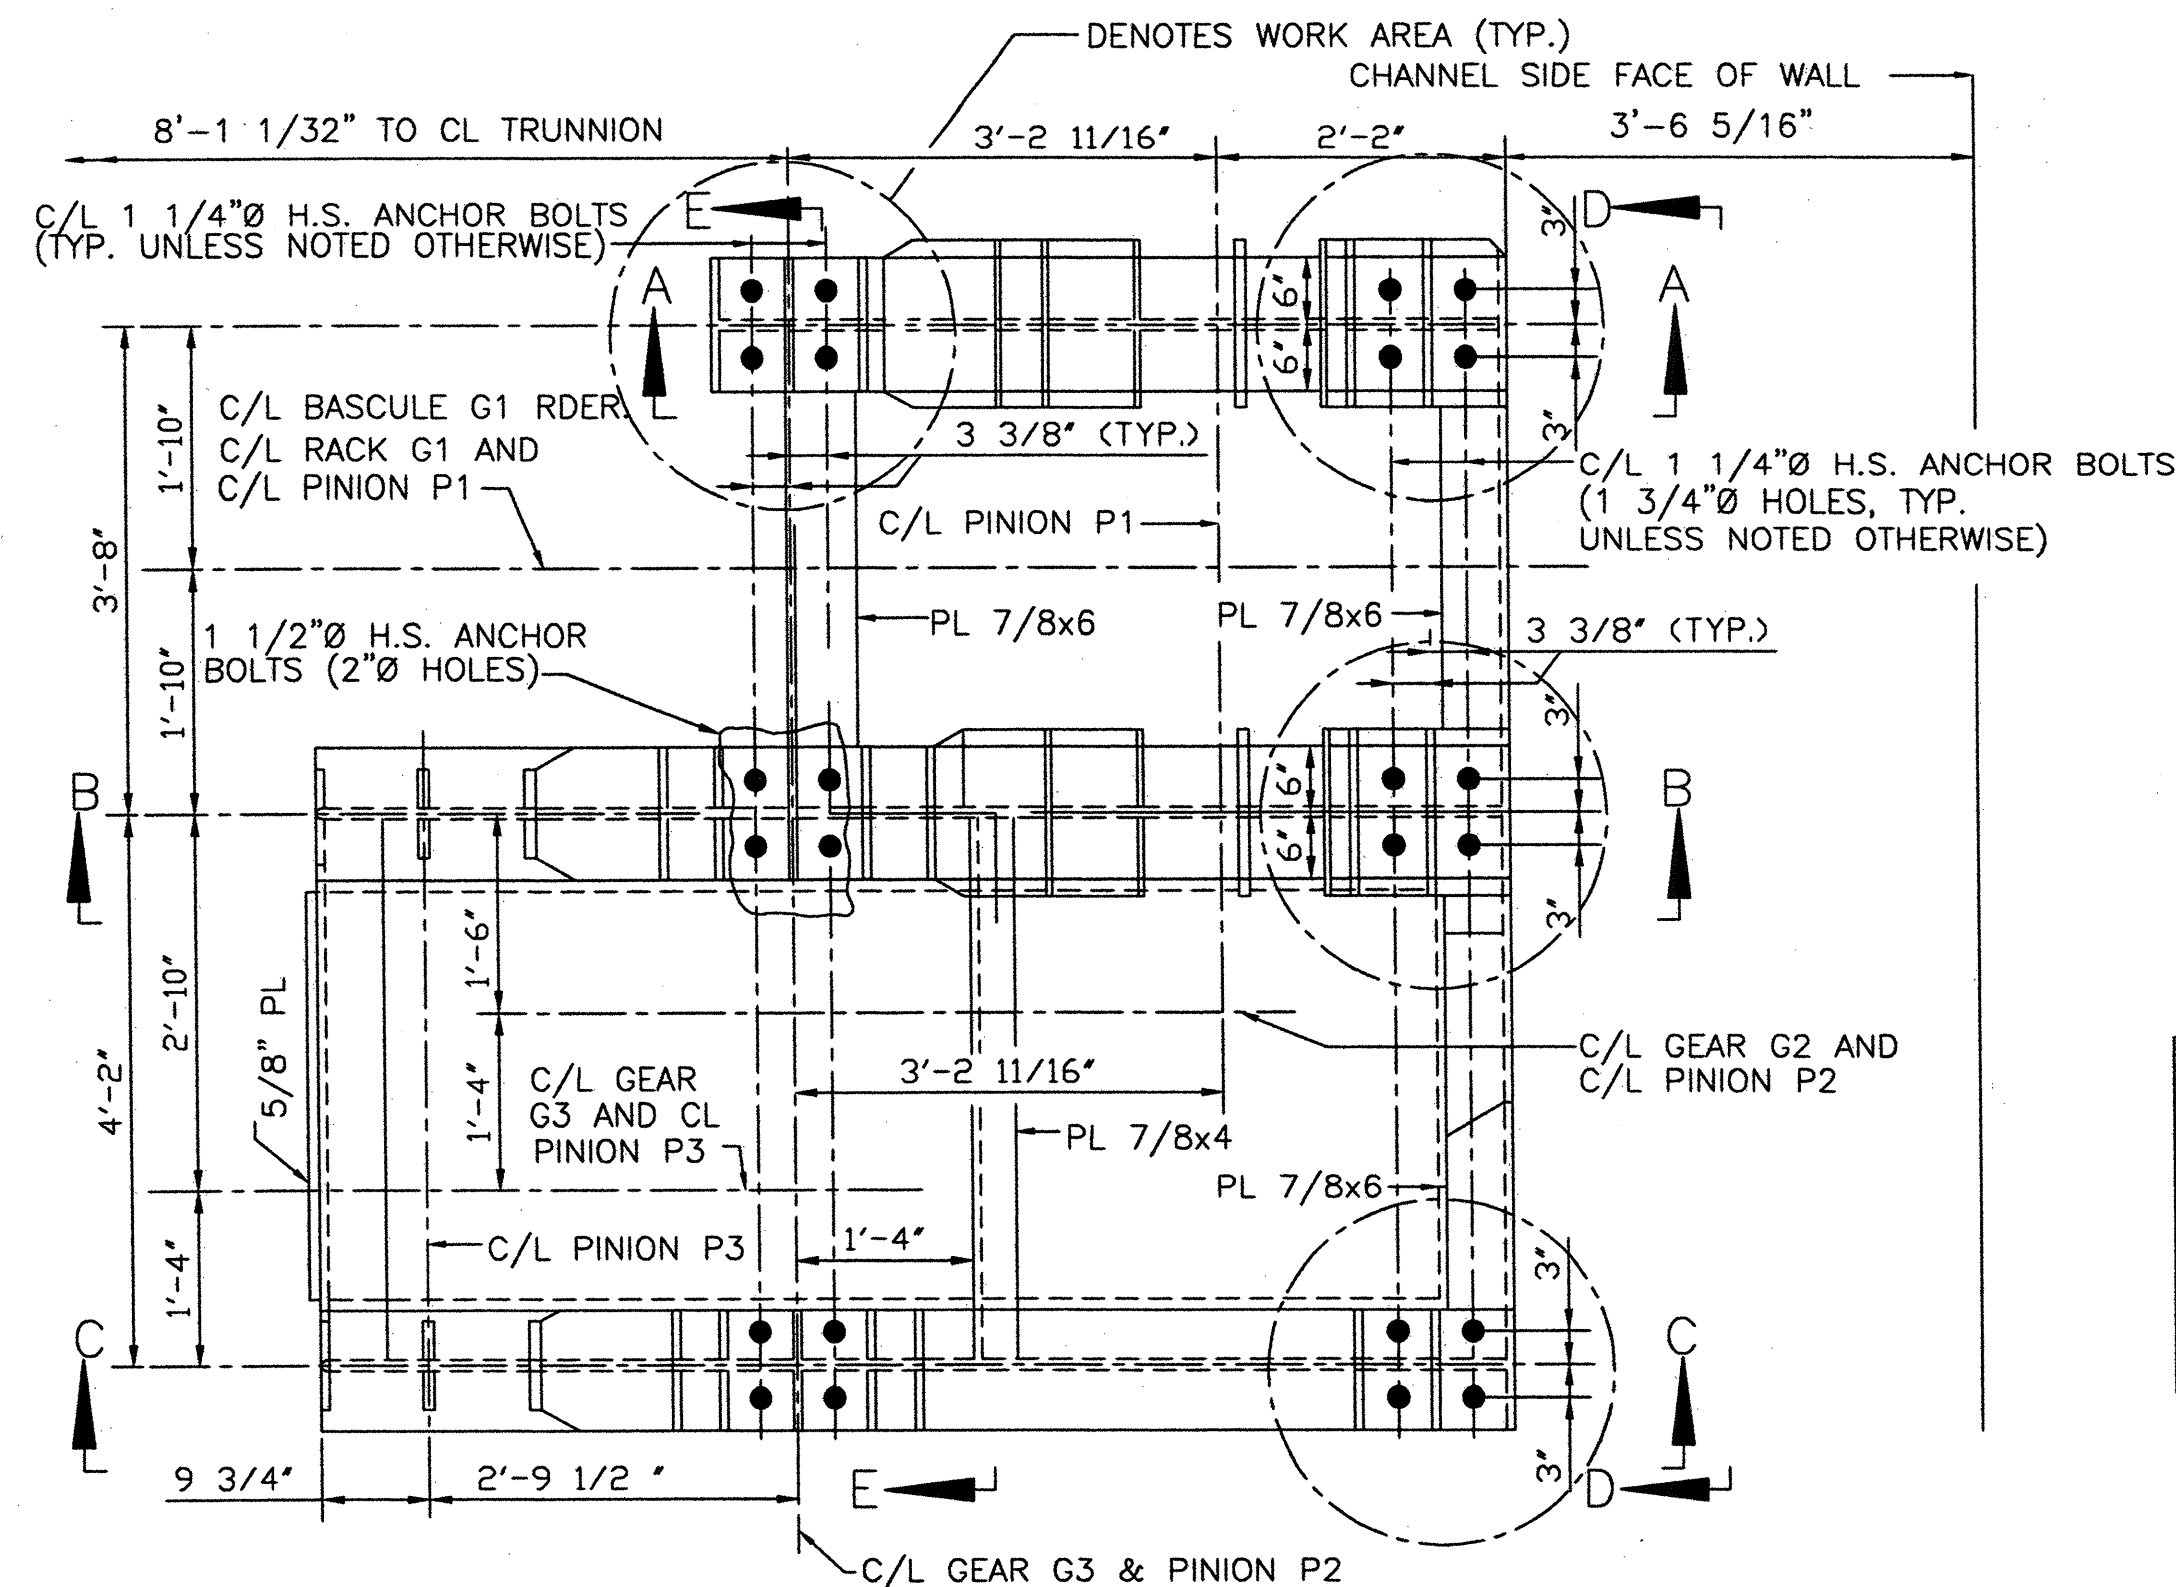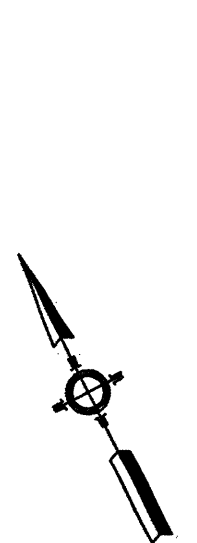


PLAN - EXISTING PINION MOUNTS
 (NORTHWEST LAYOUT SHOWN,
 OTHERS SIMILAR)
 (GRILLAGE NOT SHOWN,
 SEE SECTIONS C-C AND D-D FOR DETAILS)

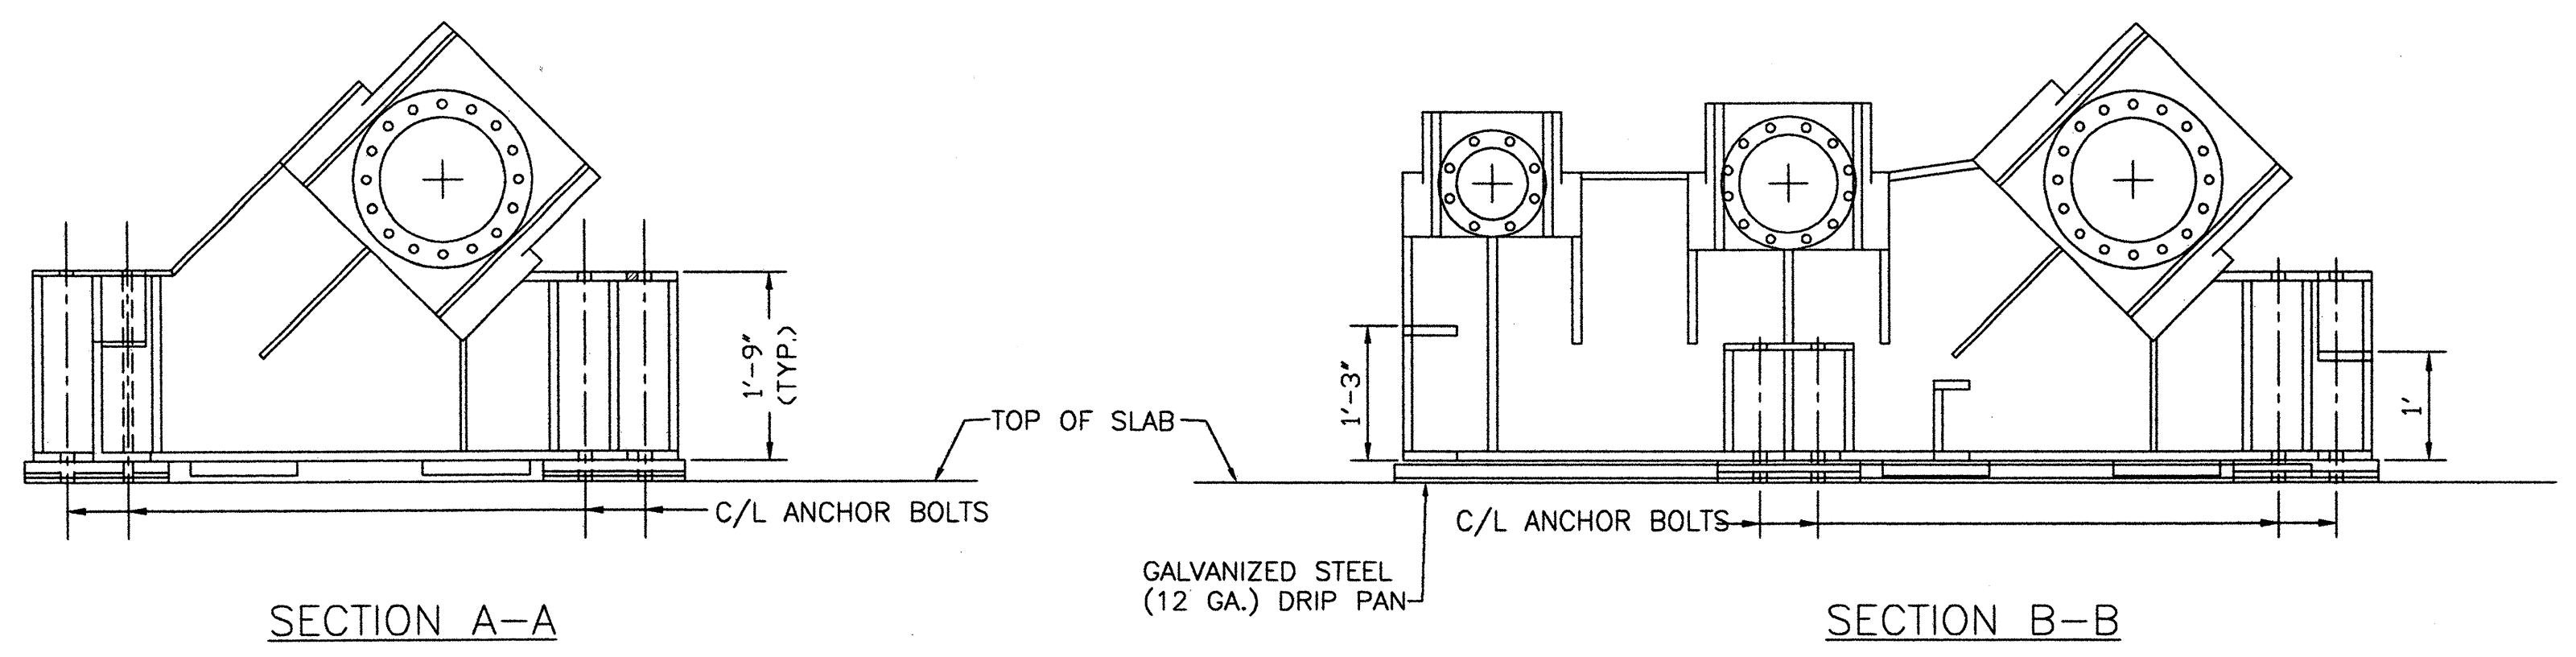


SECTION A-A

SECTION B-B


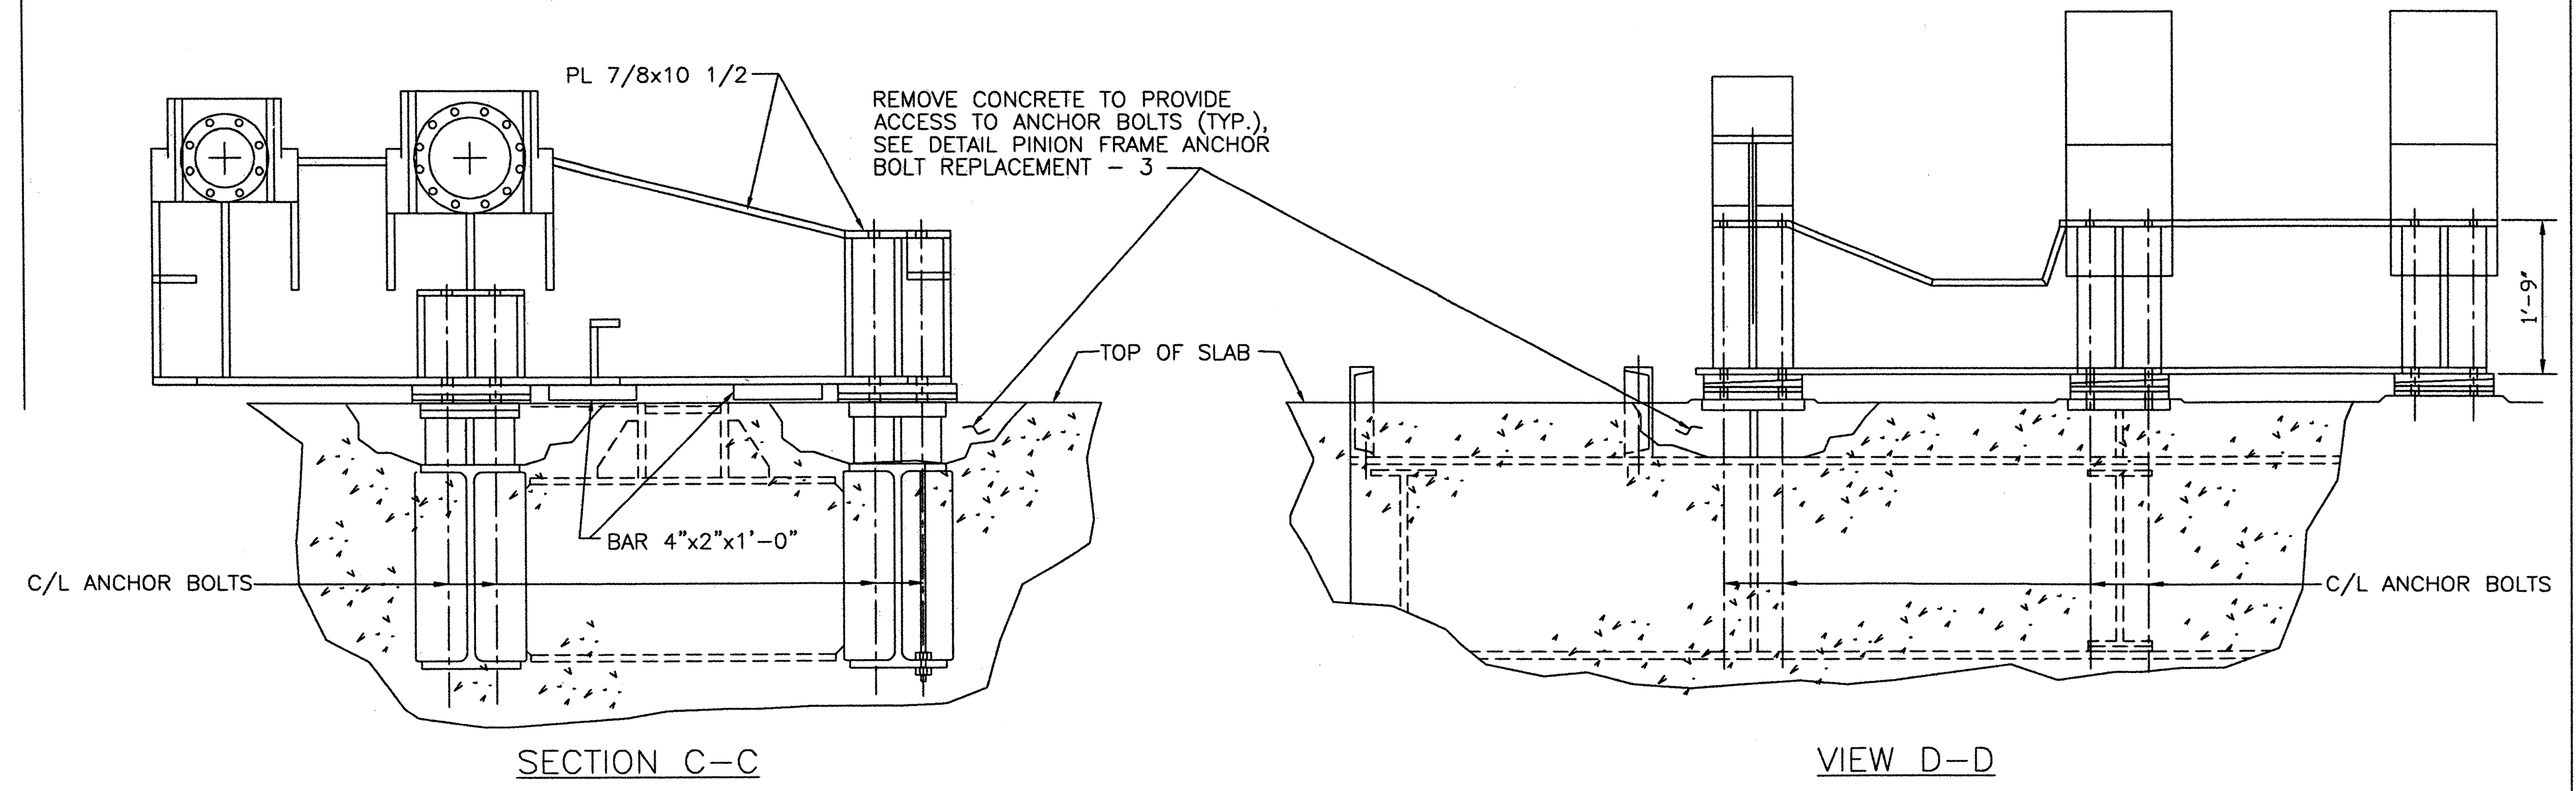


SECTION C-C

VIEW D-D


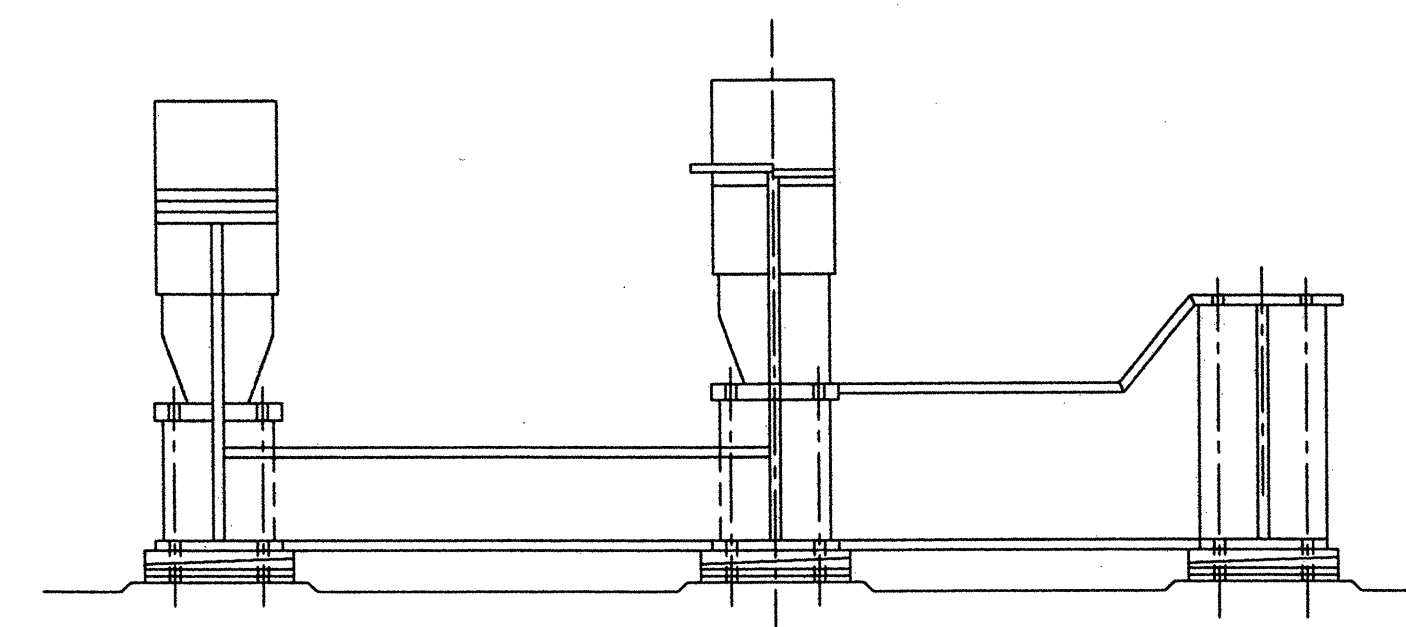


SECTION E-E

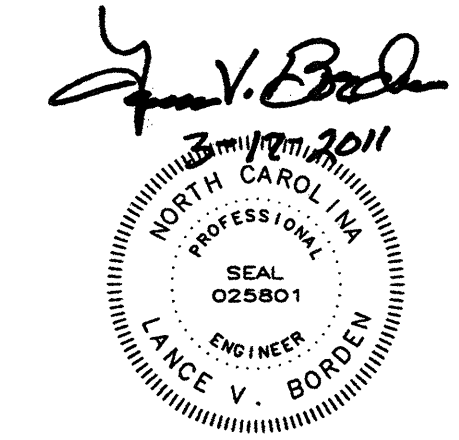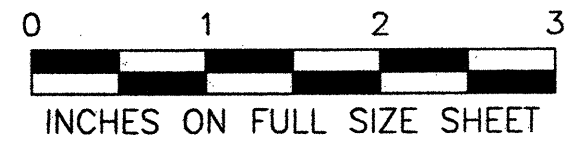

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA OPEN GEARING FRAME ANCHOR BOLT REPLACEMENT - 2			
DESIGNED	D.B. IRWIN	DATE	MARCH 2011
CHECKED	H. BUI	DRAWING NO.	24 OF 63
DRAWN BY	E.A. RICKENBACH	SCALE	AS NOTED

24-MB23-05FABRC.DWG

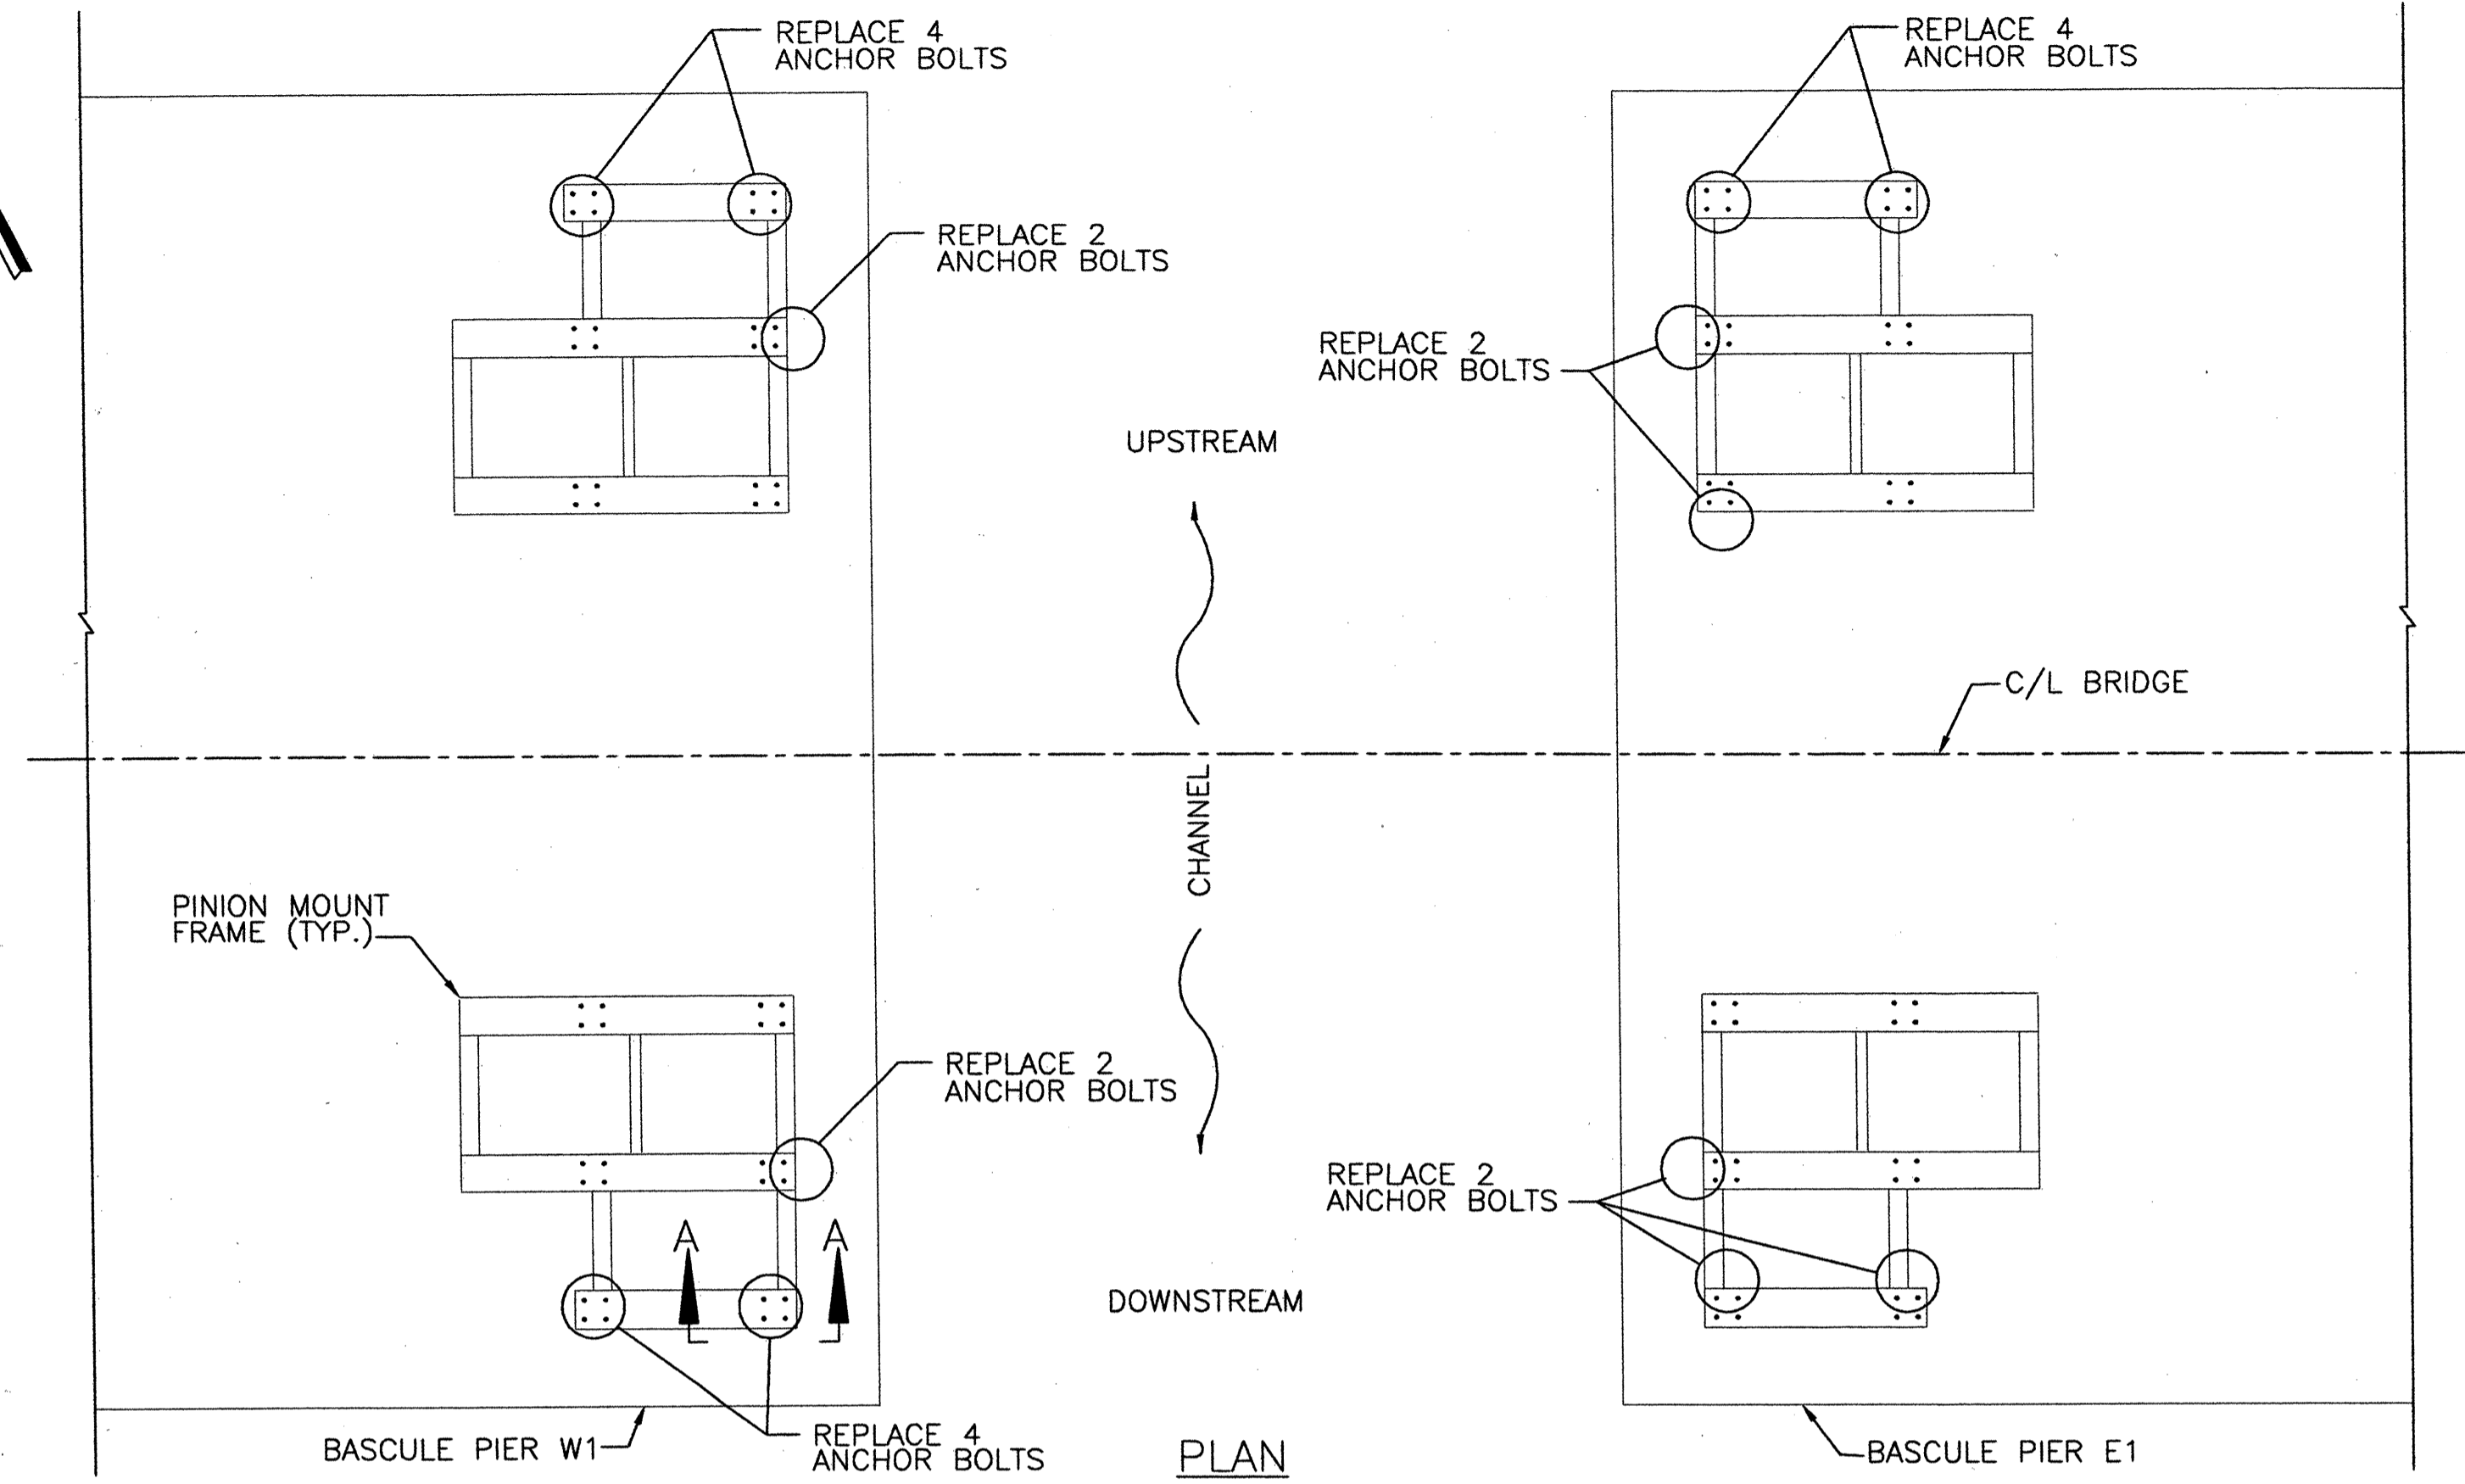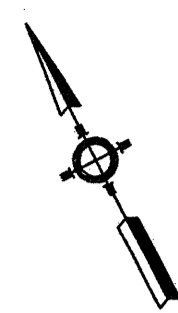



PLAN
PINION FRAME ANCHOR BOLT LAYOUT
NOT TO SCALE
(38 TOTAL TO BE REPLACED)

WELDING NOTES

- ALL WORK IS TO BE DONE IN ACCORDANCE WITH THE AASHTO/AWS BRIDGE WELDING CODE D1.5-2008 (BWC).
- THE EXISTING ANCHOR BOLT MATERIAL, THE SPECIFIED NEW ANCHOR BOLT EXTENSIONS, AND THE 1/2" BACKER PLATE ARE CONSIDERED APPROVED BASE METALS. THEREFORE, THE VARIOUS PROCEDURE QUALIFICATION TESTS AND WELDABILITY INVESTIGATION TESTING REQUIRED BY CLAUSE 5 OF THE BWC ARE NOT NECESSARY FOR THIS WORK. HOWEVER, THE CONTRACTOR IS REQUIRED TO PREPARE AND SUBMIT FOR APPROVAL BY THE ENGINEER, A COMPLETE WELDING PROCEDURE SPECIFICATION (WPS) FORM DOCUMENTING ALL WELDING VARIABLES PROPOSED FOR THE WORK. SUITABLE FORMS ARE INCLUDED IN ANNEX L OF THE BWC.
- ALL WELDING SHALL BE PERFORMED USING THE SHIELDED METAL-ARC WELDING (SMAW) PROCESS UTILIZING ELECTRODES CLASSIFIED AS E7018H4.
- ALL SURFACES TO BE WELDED, INCLUDING THE BACKER PLATE, SHALL BE PREHEATED TO 250 DEGREES F PRIOR TO WELDING, INCLUDING TACK WELDING.
- ALL COMPLETED WELDS SHALL BE RADIOGRAPHIC TESTED (RT) IN ACCORDANCE WITH CLAUSE 6 OF THE BWC. WELD QUALITY SHALL MEET THE REQUIREMENTS OF CLAUSE 6.26 OF THE BWC USING TENSILE STRESS CRITERIA.
- PRIOR TO UNDERTAKING ANY WORK ON THE STRUCTURE, THE CONTRACTOR SHALL PERFORM THREE (3) TEST WELDS UNDER CONTROLLED CONDITIONS SIMILAR TO THE CONDITIONS TO BE ENCOUNTERED IN THE FIELD. RESTRAINTS ON ACCESS FOR THE WELDERS MUST BE DUPLICATED BASED UPON ANTICIPATED TECHNIQUES TO BE EMPLOYED TO PERFORM THE WORK ON THE JOBSITE. ANCHOR BOLT AND BACKER PLATE MATERIAL USED TO PREPARE THE TEST WELDS MUST BE THE SAME AS THE NEW MATERIALS TO BE USED ON THE WORK. TEST WELDS SHALL BE MADE USING THE WPS AND ELECTRODES PROPOSED FOR THE WORK. ALL THREE (3) TEST WELDS SHALL BE RT INSPECTED AS SPECIFIED ABOVE AND SHALL MEET THE WELD QUALITY AS SPECIFIED. IN ADDITION, ONE (1) TEST WELD SHALL BE TENSION TESTED TO FAILURE BY A SUITABLE INDEPENDENT TESTING LABORATORY. MINIMUM TENSILE STRENGTH SHALL BE AT LEAST EQUAL TO THE TENSILE STRENGTH OF AN UN-WELDED SECTION OF THE SAME BAR USED TO MANUFACTURE THE NEW ANCHOR BOLT EXTENSIONS.


GENERAL PROCEDURE

- BEFORE STARTING WORK, CLEAN THE AREA AROUND THE PINION MOUNT FRAMES TO REMOVE ALL GREASE AND DEBRIS FROM THE FRAMES AND THE CONCRETE FLOOR.
- REMOVE CONCRETE TO THE LIMITS SHOWN TO PROVIDE ACCESS TO THE ANCHOR BOLTS SPECIFIED FOR REPLACEMENT.
- REPLACE THE ANCHOR BOLTS FOLLOWING THE WELDING PROCEDURE AND DETAILS SHOWN ON THIS SHEET. WORK IS PERMITTED ON ONLY ONE ANCHOR BOLT AT ANY TIME. WORK MAY PROGRESS TO ANOTHER BOLT ONLY AFTER THE WELD HAS PASSED RADIOGRAPHIC TESTING AND THE BOLT IS TIGHTENED. THE BRIDGE SHALL NOT BE OPERATED IF A BOLT IS CUT AND NOT YET WELDED, RADIOGRAPHIC TESTED, AND TIGHTENED.
- AFTER COMPLETION OF ALL WELDING, CLEAN AND PAINT THE PINION MOUNT FRAMES AND ALL NEW STEEL WITH A PAINT SYSTEM APPROVED BY NCDOT.
- APPLY AN EPOXY BONDING ADHESIVE CONFORMING TO ASTM C881, TYPE II, GRADE 2 TO THE SURFACES OF THE EXCAVATED CONCRETE AND FILL THE EXCAVATIONS WITH A NON-SHRINK CEMENTITIOUS GROUT EXTENDED WITH AN EQUAL VOLUME OF CLEAN AGGREGATE OF 1/2" MAXIMUM SIZE.

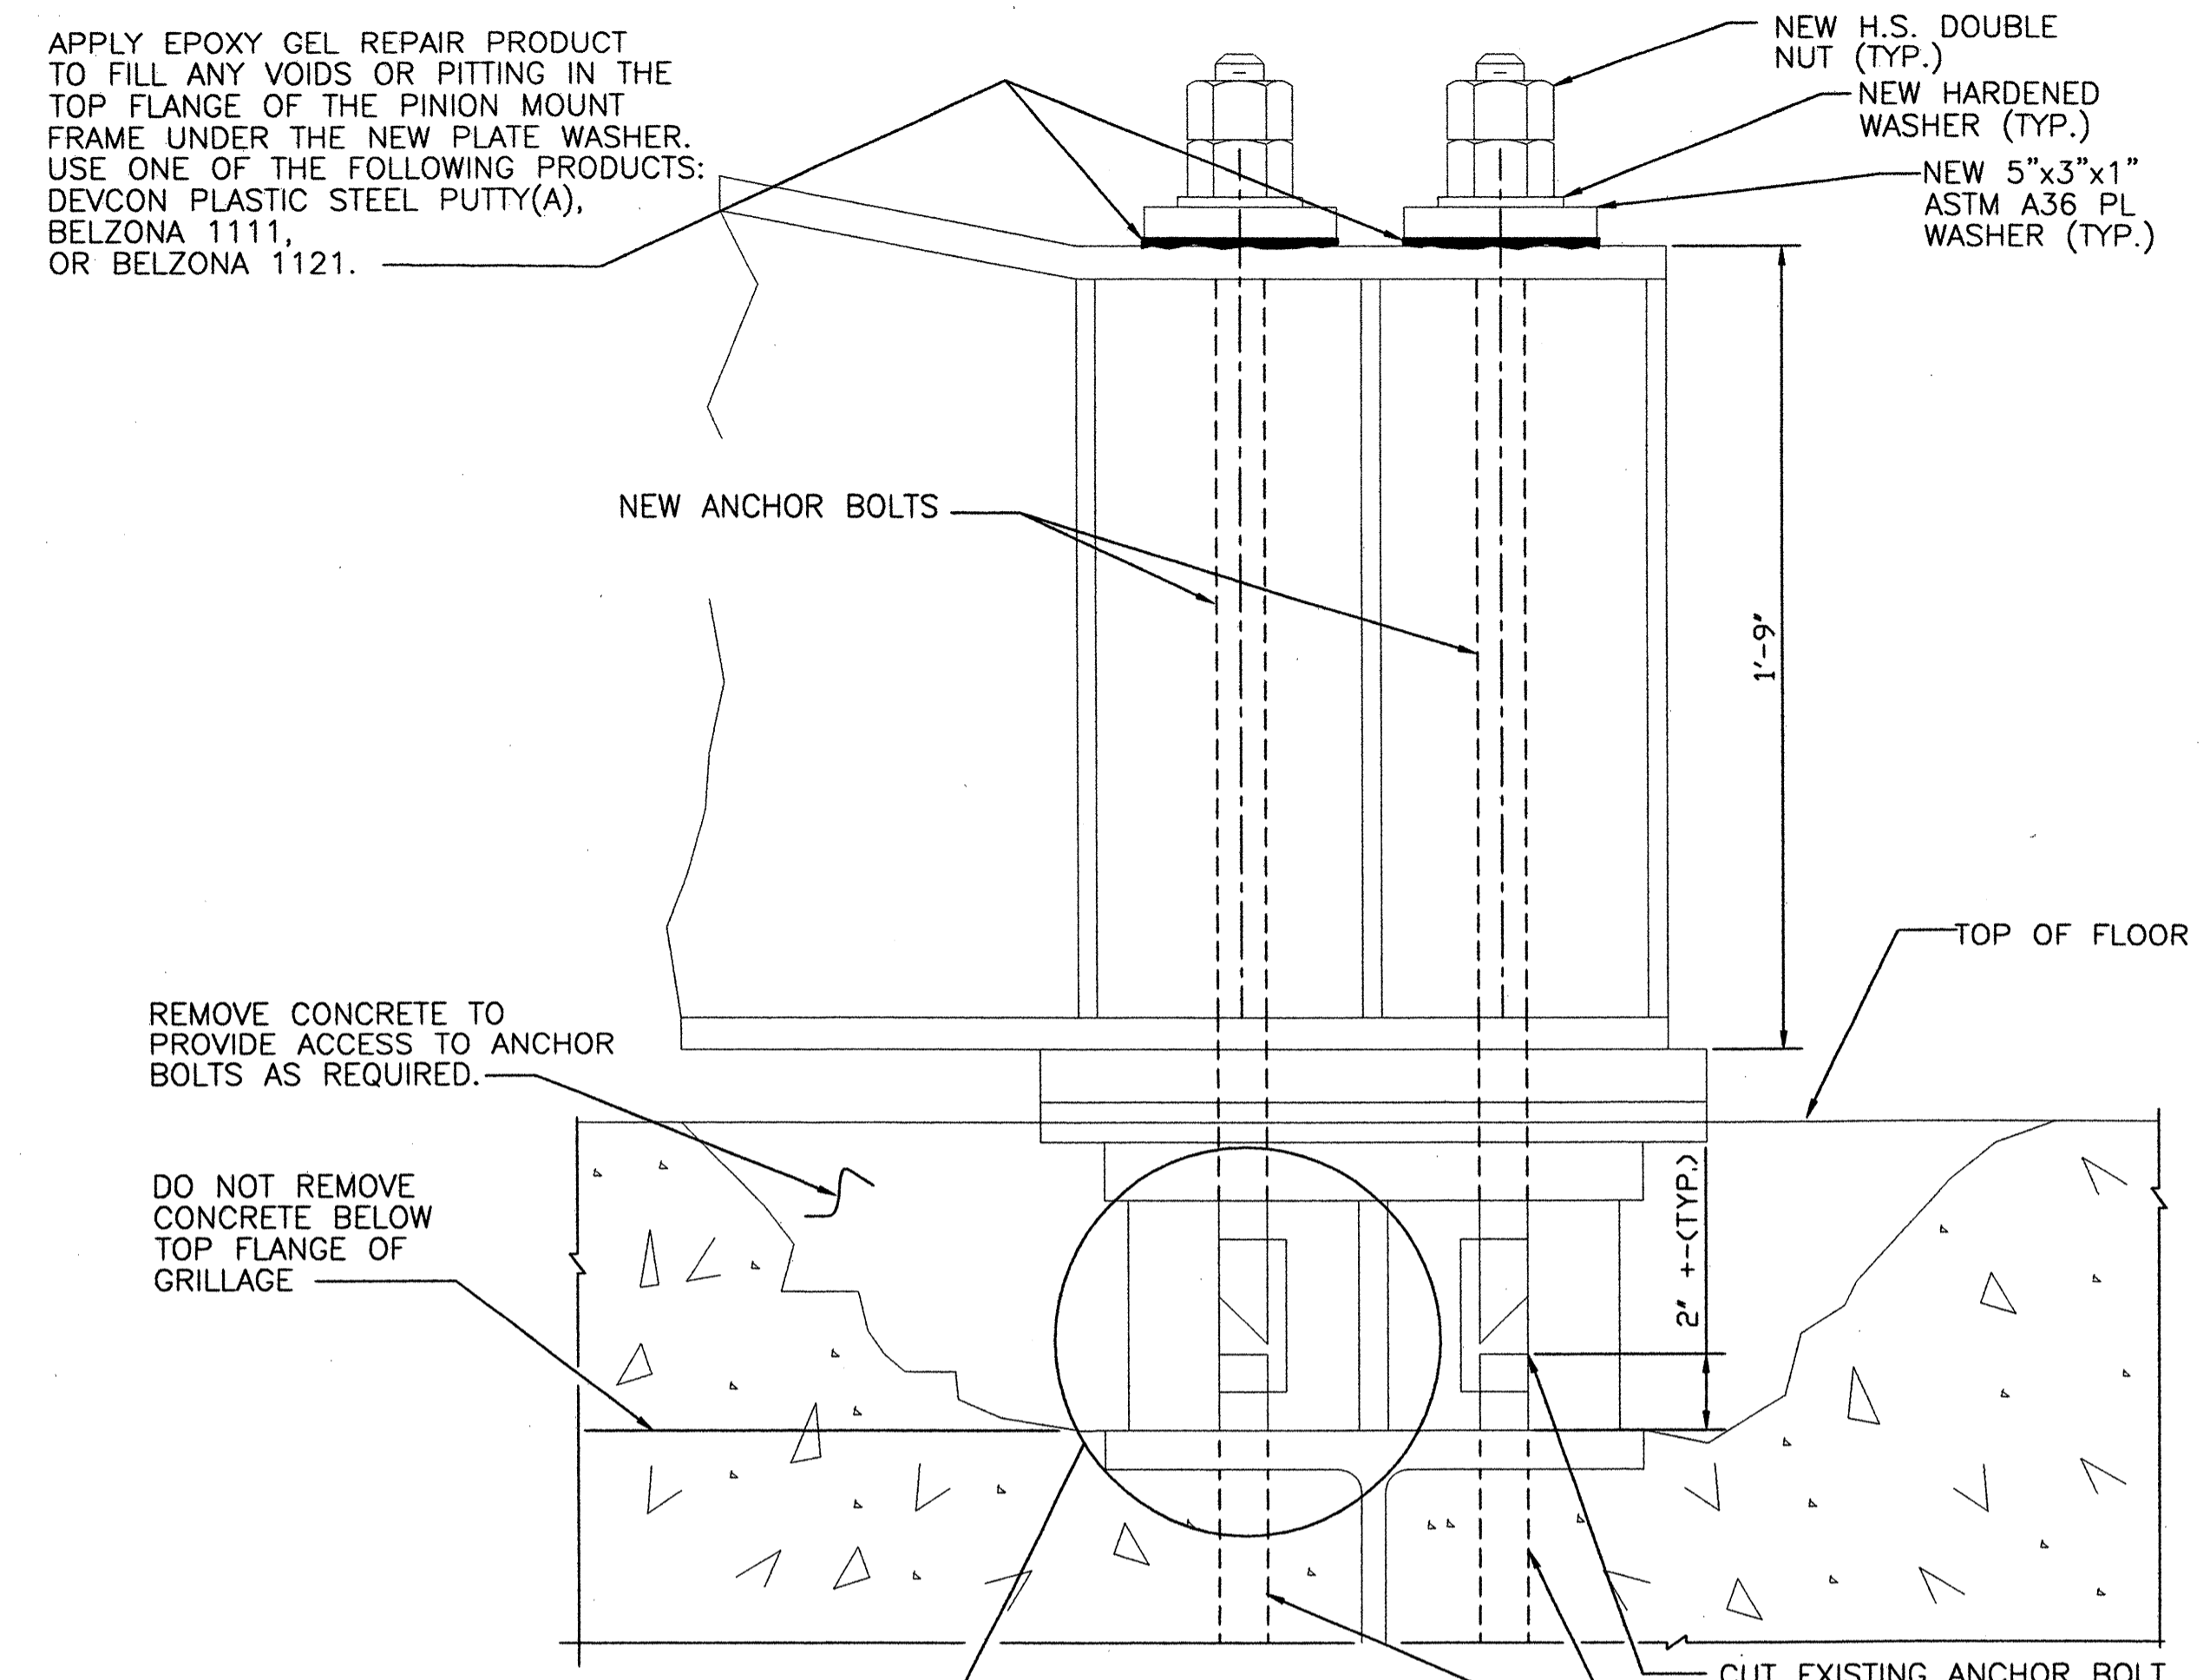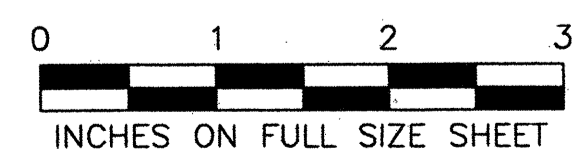


SECTION A-A
SCALE: 3" = 1'-0"
(TYPICAL ANCHOR BOLT REPLACEMENT)


NEW 1 1/4" DIA ANCHOR BOLT, ASTM F1554, GRADE 55 WITH S1 WELDABILITY REQUIREMENTS. (TYP.)

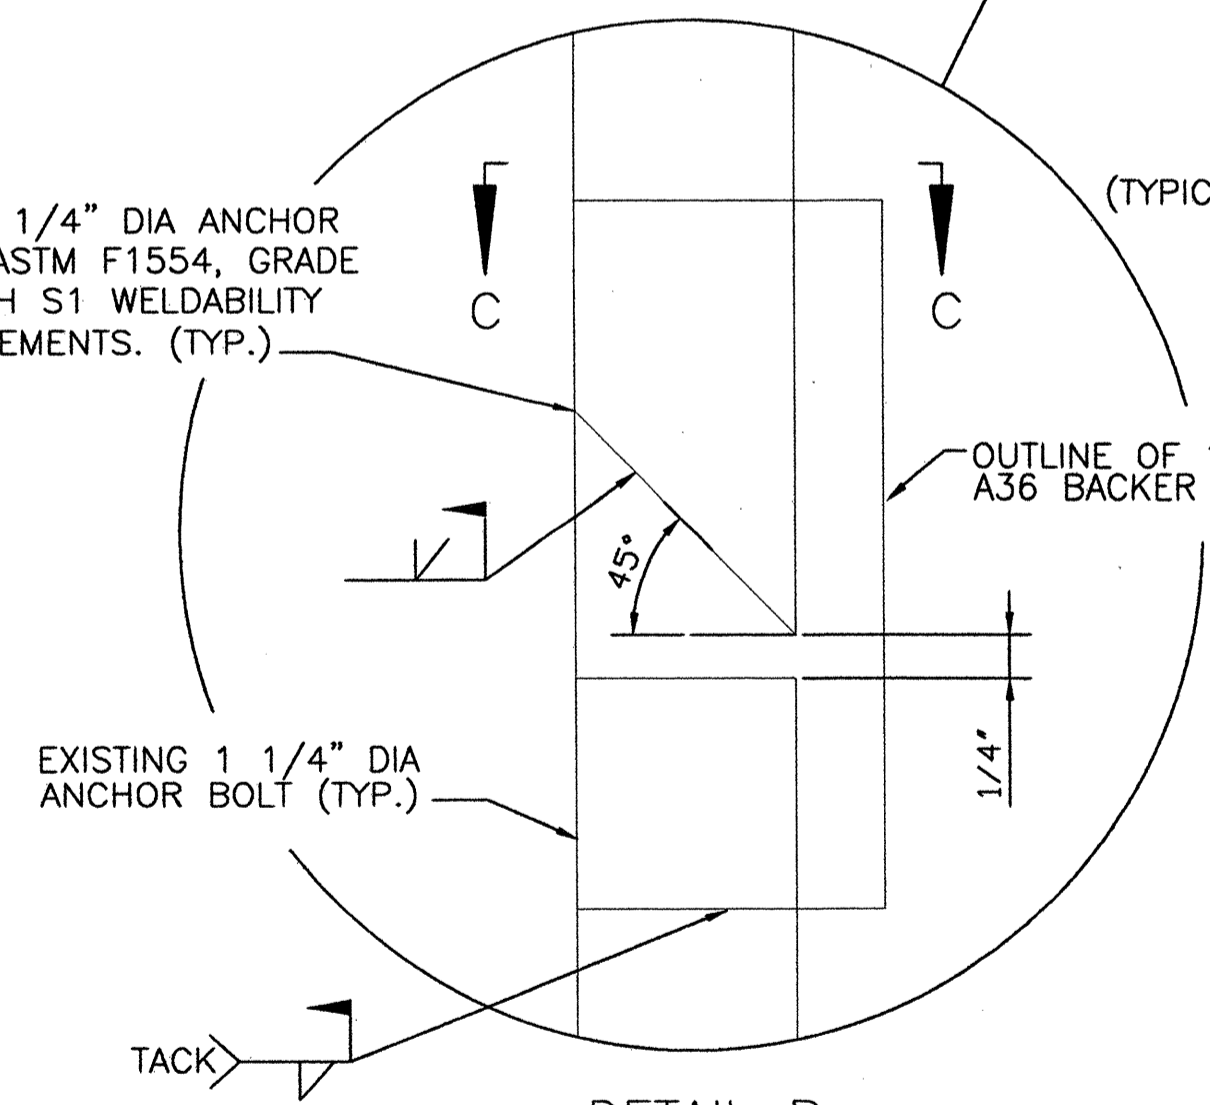

DETAIL B
SCALE: 1" = 1"

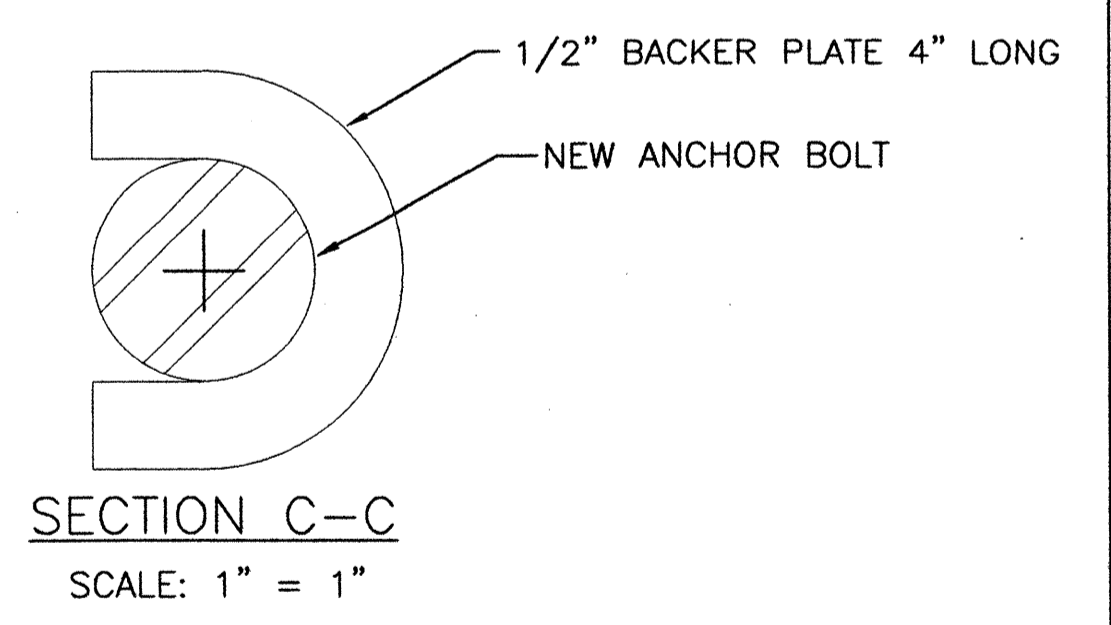


SECTION C-C
SCALE: 1" = 1"

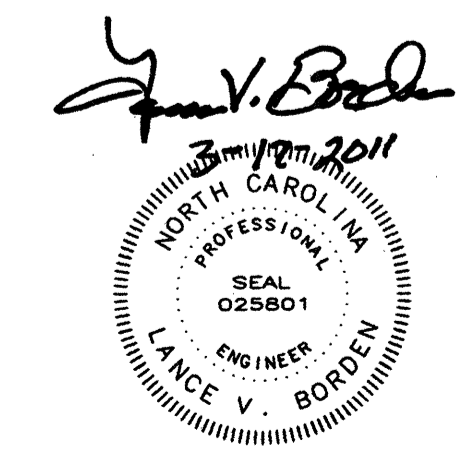


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA OPEN GEARING FRAME ANCHOR BOLT REPLACEMENT - 3			
DESIGNED D.B. IRWIN		DRAWN BY E.A. RICKENBACH	
CHECKED H. BUI		SCALE AS NOTED	
DETAILED D.B. IRWIN		DATE MARCH 2011	
CHECKED H. BUI		DRAWING NO. 25 OF 63	

MB24

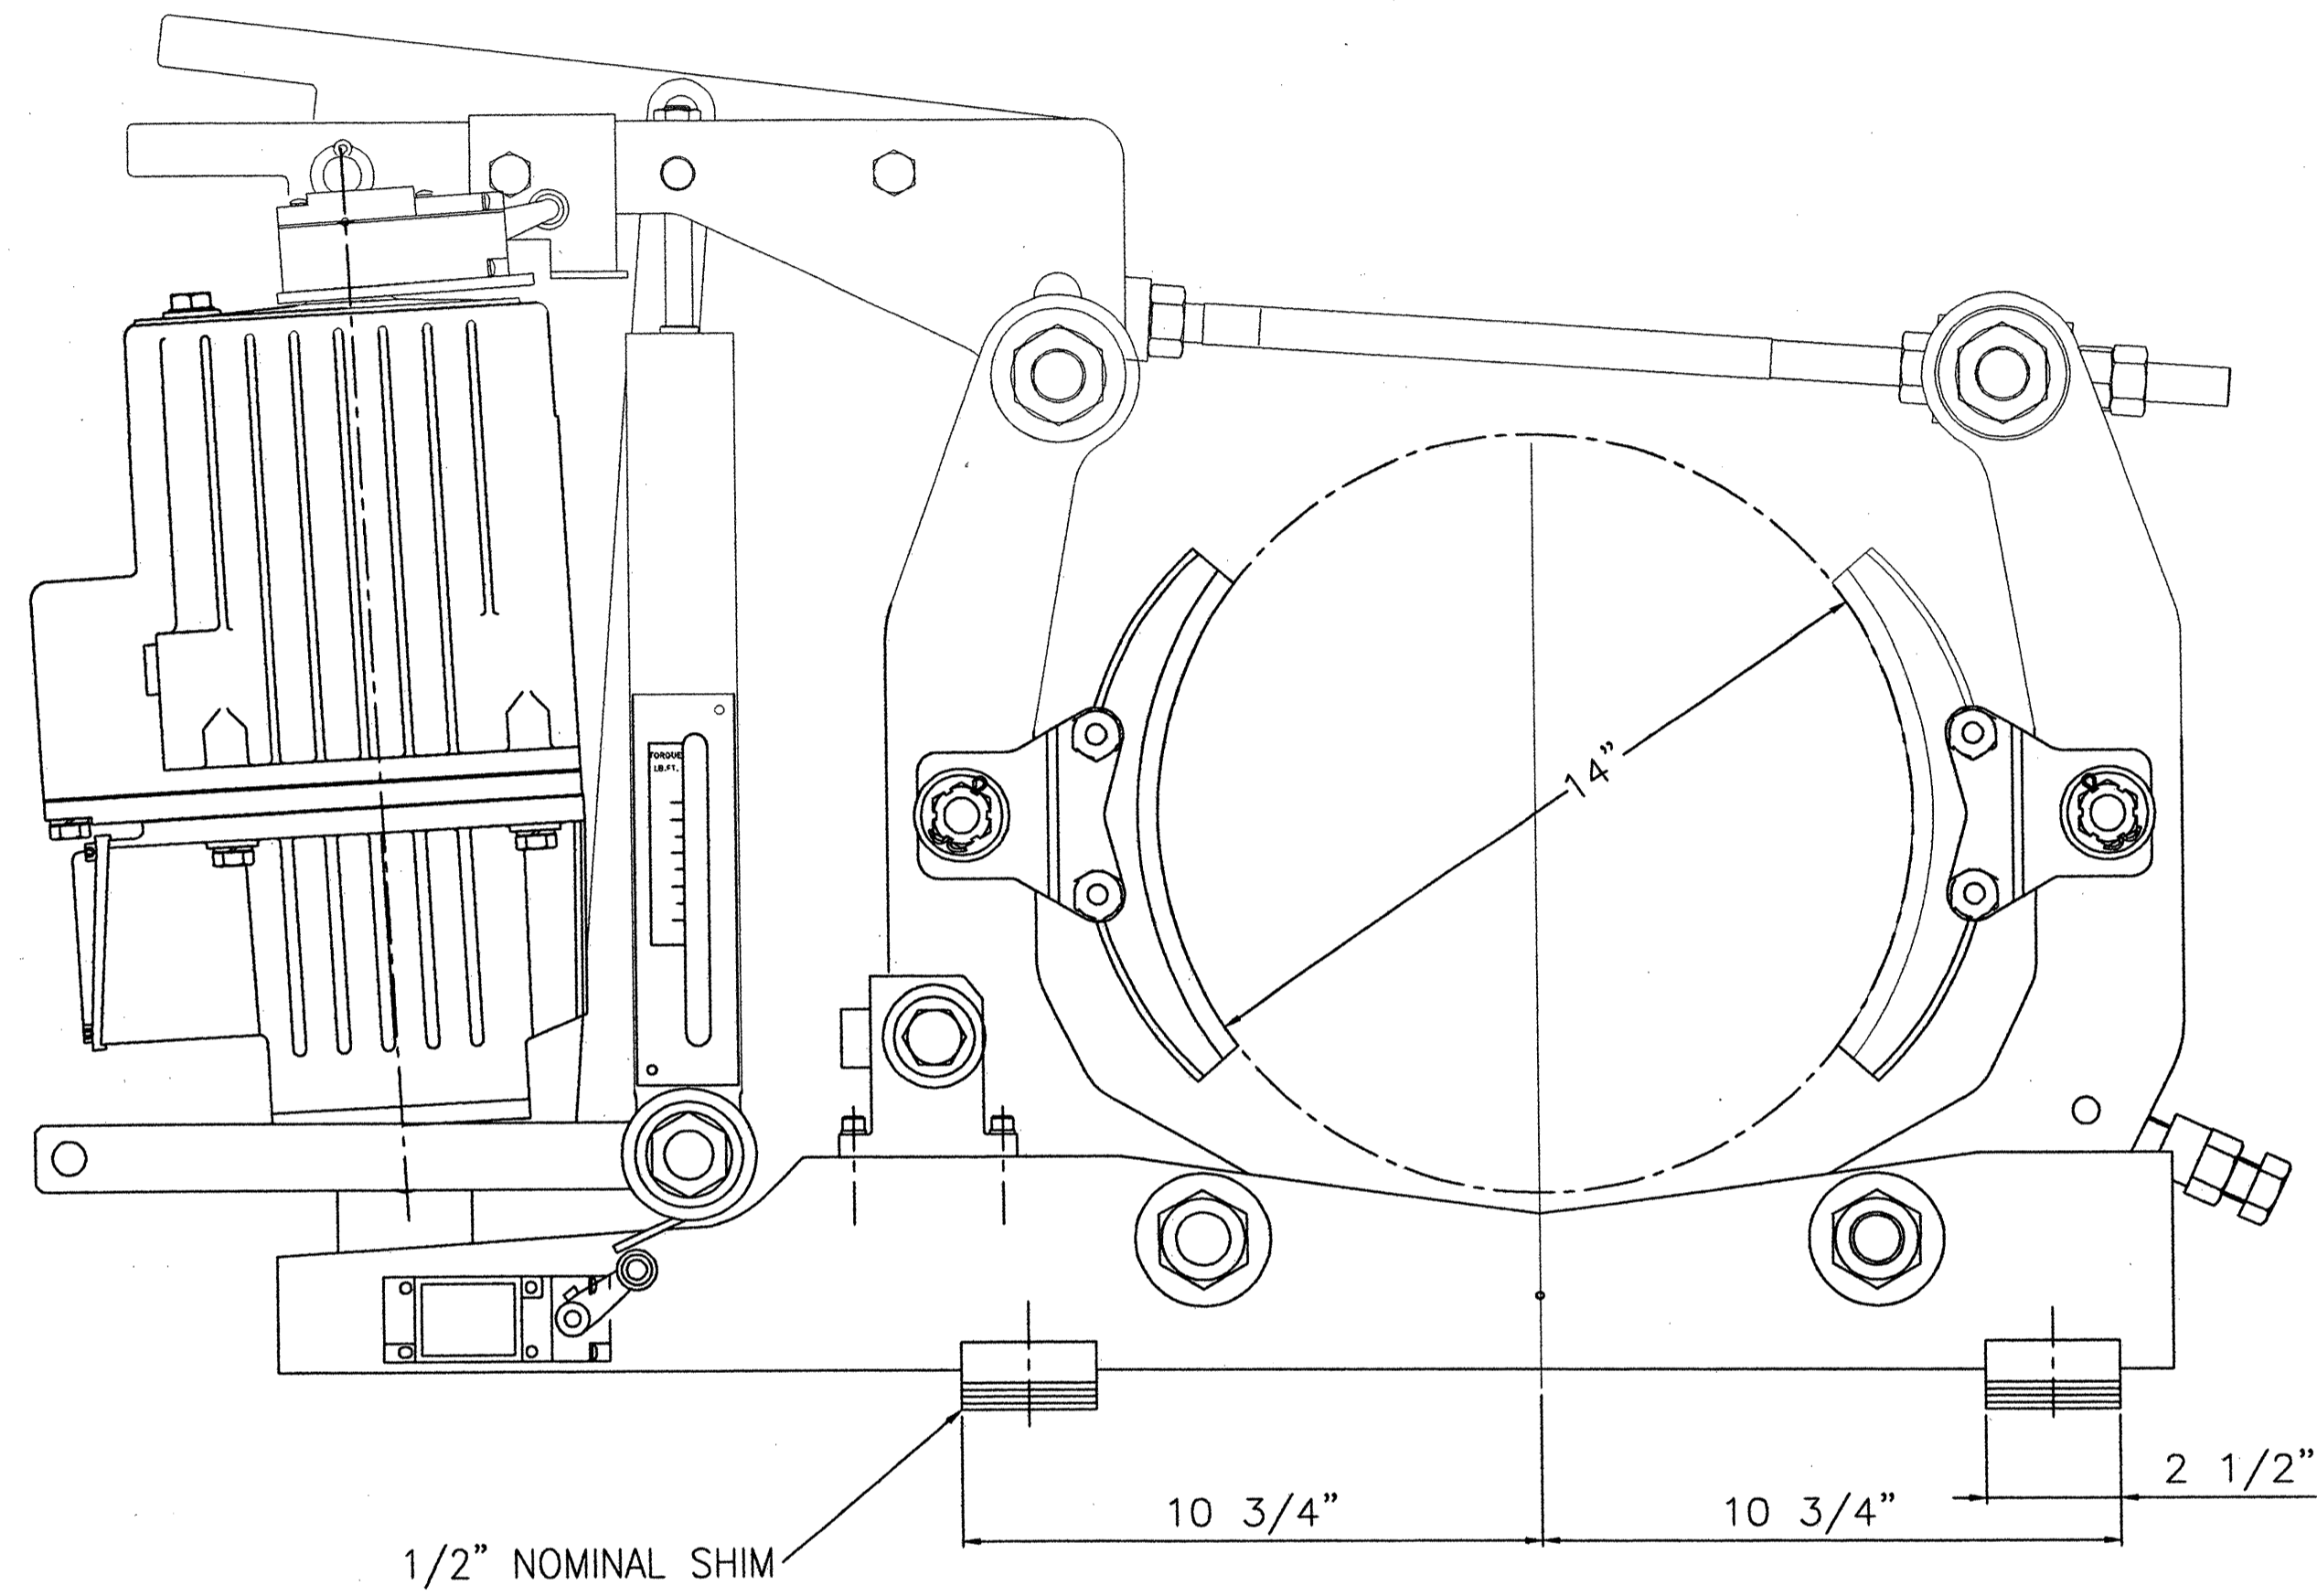


14" MBTE ED80/6 (LHR)(3LS)SHOE BRAKE
DROP-IN (GE IC9516)

MAX.TORQUE: 800 lb.ft.

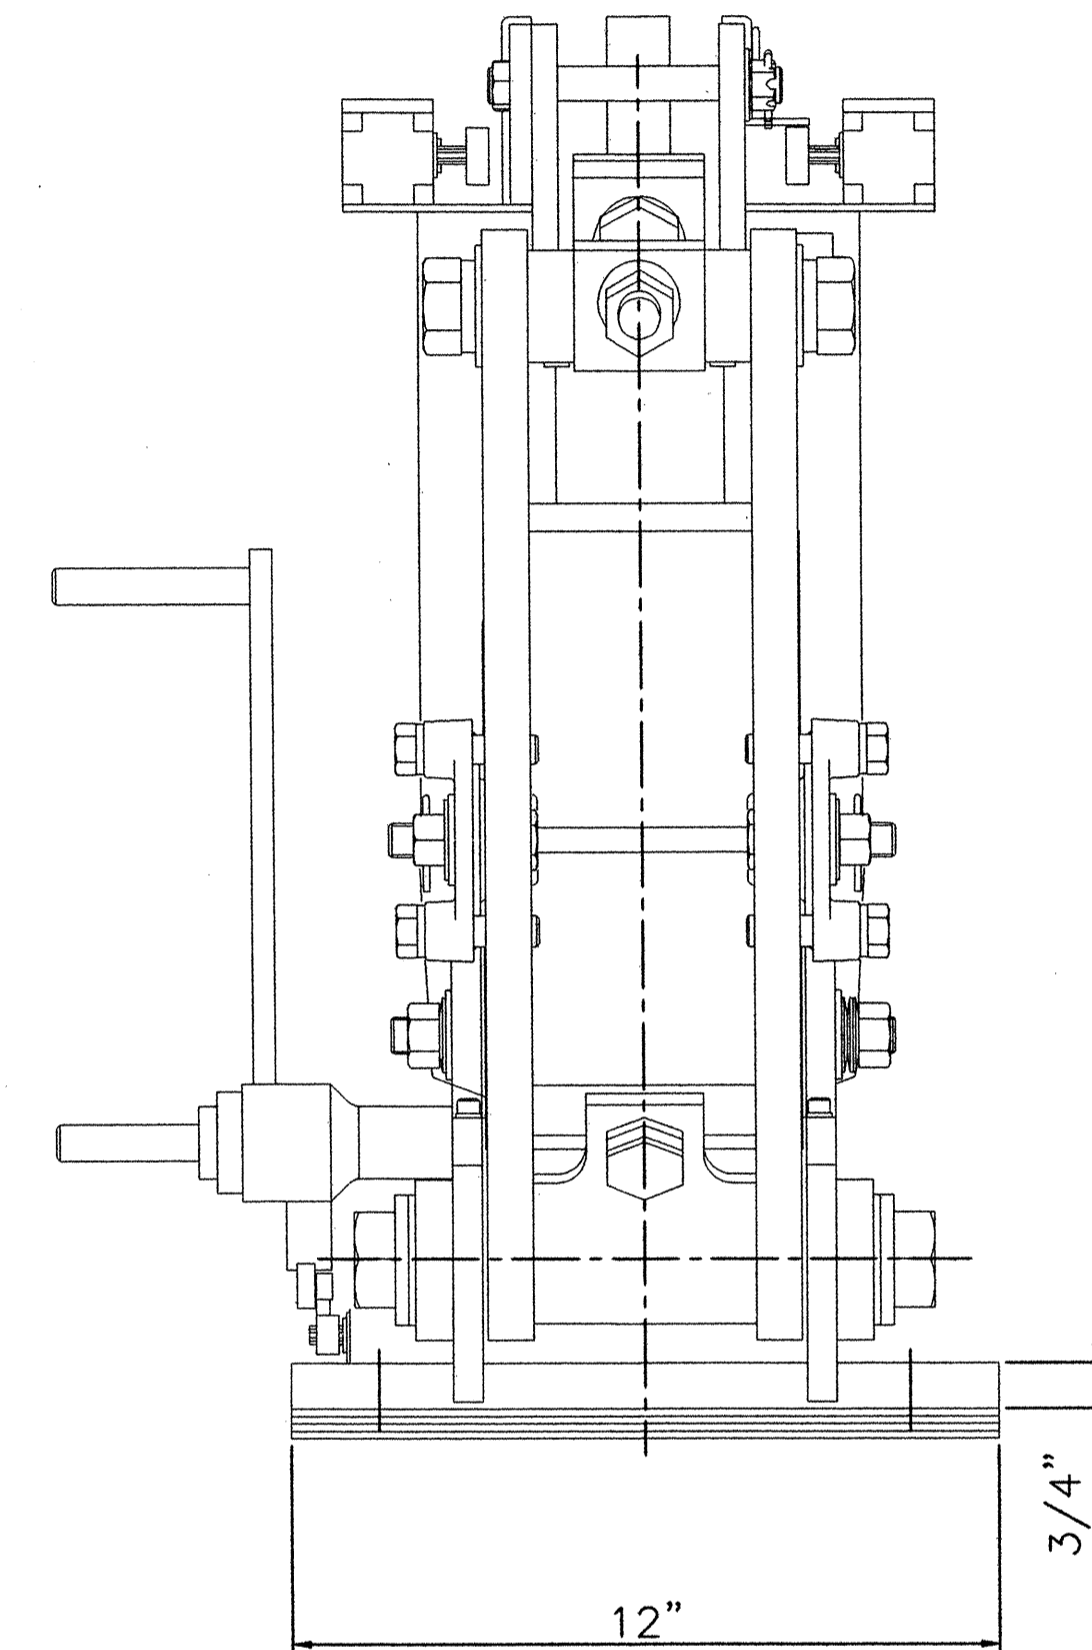


NOTES:

1. MOUNTING BOLT HOLES TO BE DRILLED BASED ON FIELD MEASUREMENTS.
2. ALL DIMENSIONS ON EXISTING BRAKES TO BE FIELD VERIFIED FOR PROPER FIT WITH NEW BRAKES BEFORE NEW BRAKES ARE ORDERED. ALL EXISTING BRAKES AND BRAKE LOCATIONS MAY NOT BE IDENTICAL.
3. NEW BRAKES TO BE SUPPLIED WITH STAINLESS STEEL COVERS MODIFIED FOR MANUAL HAND RELEASE.

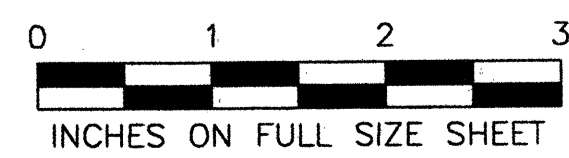

26-MB25-SDBR.DWG

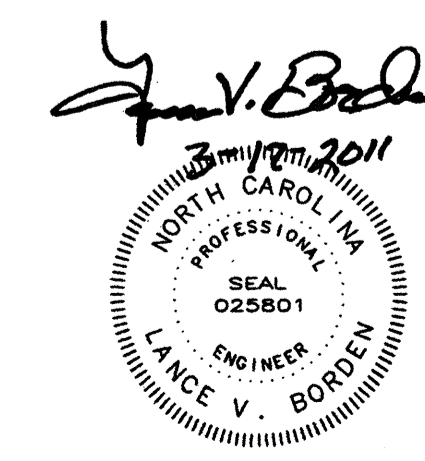

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA SPAN DRIVE BRAKE REPLACEMENT			
DESIGNED D.M. BARRETT		DRAWN BY D.M. BARRETT	
CHECKED A.M. BRODSKY		SCALE AS NOTED	
DETAILED D.M. BARRETT		DATE MARCH 2011	
CHECKED A.M. BRODSKY		DRAWING NO. 26 OF 63	

MB25

ELECTRICAL GENERAL NOTES (BASCULE BRIDGE)

1. GENERAL

- 1.01 ALL WORK SHALL COMPLY WITH THE NATIONAL ELECTRICAL CODE (2008 EDITION), THE NORTH CAROLINA ELECTRICAL CODE (2008 EDITION), THE NORTH CAROLINA DEPARTMENT OF TRANSPORTATION STANDARD SPECIFICATIONS FOR ROADS AND STRUCTURES (LATEST EDITION), THE AASHTO LRFD MOVABLE HIGHWAY BRIDGE DESIGN SPECIFICATIONS (LATEST EDITION), AND ALL APPLICABLE STATE AND/OR LOCAL CODES.
- 1.02 FOR THE PURPOSES OF APPLYING THE NATIONAL ELECTRICAL CODE, THE FOLLOWING LOCATION DEFINITIONS SHALL APPLY.
 - (1) DRY LOCATIONS: INSIDE THE CONTROL HOUSE CONTROL ROOM, RESTROOM, ELECTRICAL ROOM, AND GENERATOR ROOM.
 - (2) DAMP LOCATIONS: INSIDE THE CONTROL HOUSE WORK ROOM, AND FUEL TANK ROOM.
 - (3) WET LOCATIONS: ANY LOCATION NOT DEFINED AS DRY OR DAMP, INCLUDING WITHIN THE BASCULE PIERS.
- 1.03 ALL EQUIPMENT, RACEWAYS, WIRING, ETC. SHALL BE INSTALLED IN A NEAT AND WORKMAN LIKE MANNER IN ACCORDANCE WITH NECA 1 (STANDARD PRACTICES FOR GOOD WORKMANSHIP IN ELECTRICAL CONTRACTING), AND WITHOUT VIOLATING ANY REQUIRED CLEAR WORKING SPACE (NEC 110.26).
- 1.04 IN NO WAY SHALL THESE PLANS BE INTERPRETED AS REQUIRING A VIOLATION OF THE NATIONAL ELECTRICAL CODE, OR ANY OTHER APPLICABLE FEDERAL, STATE, OR LOCAL CODE OR REGULATION. IN ANY CASE OF DISPUTE BETWEEN THESE PLANS AND THE NATIONAL ELECTRICAL CODE, THE MORE STRINGENT REQUIREMENT SHALL GOVERN.
- 1.05 THE INSTALLATION OF ALL EQUIPMENT AND MATERIALS SHALL COMPLY WITH THEIR RESPECTIVE MANUFACTURERS' RECOMMENDATIONS AND INSTALLATION PROCEDURES.
- 1.06 THE CONTRACTOR IS EXPECTED TO DELIVER A COMPLETE, WORKING, AND SAFE ELECTRICAL SYSTEM.
- 1.07 VARIATIONS FROM THESE PLANS MUST BE SUBMITTED TO THE ENGINEER FOR APPROVAL. ALL CHANGES SHALL BE REFLECTED IN THE AS-BUILT DRAWINGS.
- 1.08 IN ADDITION TO THE MATERIALS, COMPONENTS, AND EQUIPMENT SHOWN ON THE PLANS, PROVIDE ALL RACEWAYS, JUNCTION AND PULL BOXES, FITTINGS, CONDUCTORS, CONNECTORS, AND OTHER ITEMS REQUIRED TO PROVIDE A COMPLETE, FUNCTIONAL, AND SAFE INSTALLATION.
- 1.09 THE CONTRACTOR SHALL BEAR FULL RESPONSIBILITY FOR VERIFICATION OF ALL RELEVANT DIMENSIONS, EQUIPMENT SPECIFICATIONS, ELECTRICAL LOADS, CIRCUIT LOADS, AND SIMILAR INFORMATION PRIOR TO PURCHASE AND/OR FABRICATION OF EQUIPMENT OR MATERIALS. EQUIPMENT RATINGS AND/OR WIRE SIZES SHOWN ON THE PLANS SHALL BE INCREASED WHERE REQUIRED BY THE LOADS SERVED.
- 1.10 THE CONTRACTOR SHALL INVESTIGATE AND/OR VERIFY THE LOCATIONS OF ALL EXISTING FACILITIES, ABOVE GROUND AND UNDERGROUND, PRIOR TO CONSTRUCTION. ANY DAMAGE TO EXISTING FACILITIES SHALL BE REPAIRED BY THE CONTRACTOR AS DIRECTED BY THE ENGINEER AT NO ADDITIONAL COST.
- 1.11 THE CONTRACTOR SHALL CAREFULLY TRACE, LOCATE, IDENTIFY, AND DOCUMENT ALL EXISTING EQUIPMENT, CONDUCTORS, RACEWAYS, AND OTHER ITEMS WHICH ARE EXISTING AND TO REMAIN IN PLACE, BE RE-ROUTED, OR BE RELOCATED. THE CONTRACTOR SHALL EXERCISE CARE NOT TO DAMAGE OR OTHERWISE DISTURB ANY ITEMS WHICH ARE EXISTING AND TO REMAIN IN PLACE.
- 1.12 NUMBERS IN PARENTHESES ASSOCIATED WITH EQUIPMENT REFER TO ITEM NUMBERS IN THE EQUIPMENT SCHEDULES.
- 1.13 ALL EQUIPMENT, RACEWAYS, WIRING, ETC. SHOWN ON THESE PLANS, OR OTHERWISE REQUIRED, SHALL BE NEW UNLESS SPECIFICALLY NOTED OTHERWISE.
- 1.14 LOCATIONS OF RACEWAYS, CABLES, AND EQUIPMENT SHOWN ARE DIAGRAMMATIC ONLY. EXACT LOCATIONS SHALL BE DETERMINED IN THE FIELD BY THE CONTRACTOR AND SUBJECT TO THE APPROVAL OF THE ENGINEER.
- 1.15 DO NOT CUT, DRILL, OR WELD ANY STRUCTURAL MEMBER WITHOUT THE EXPLICIT PERMISSION OF THE ENGINEER ON A CASE-BY-CASE BASIS.
- 1.15 THE EXISTING BRIDGE NAVIGATION LIGHTING SYSTEM SHALL REMAIN OPERATIONAL AT ALL TIMES DURING CONSTRUCTION. THE CONTRACTOR SHALL PROVIDE TEMPORARY NAVIGATION LIGHTS AND WIRING AS NECESSARY TO MEET THIS REQUIREMENT.



2. WIRING MATERIALS & METHODS

- 2.01 UNLESS EXPLICITLY INDICATED OTHERWISE, ONLY THE FOLLOWING WIRING METHODS ARE PERMITTED.
 - GENERAL
 - 1. PLASTIC COATED STEEL RIGID METAL CONDUIT (RMC)
 - 2. LIQUIDTIGHT FLEXIBLE METAL CONDUIT (LFMC)
 - FOR NEW LIGHTING AND RECEPTACLE CIRCUITS IN THE BASCULE PIERS
 - 1. RIGID NONMETALLIC CONDUIT (RNC) - SCH 40 PVC
 - 2. LIQUIDTIGHT FLEXIBLE NONMETALLIC CONDUIT (LFNC)
- 2.02 THE USE OF FLEXIBLE CONDUIT SHALL BE LIMITED TO THE FOLLOWING.
 - 1. FOR FINAL CONNECTIONS TO MOTORS AND SIMILAR EQUIPMENT SUBJECT TO VIBRATION, LENGTHS SHALL NOT BE LESS THAN 18 INCHES, BUT SHALL NOT EXCEED 36 INCHES.
 - 2. WHERE FLEXIBILITY IS REQUIRED. LENGTHS SHALL NOT EXCEED 18 INCHES, UNLESS EXPLICITLY INDICATED OTHERWISE OR WITH THE SPECIAL PERMISSION OF THE ENGINEER.
 - 3. AS MAY BE OTHERWISE SPECIFICALLY SHOWN IN THESE PLANS.
 - 4. FLEXIBLE CONDUIT SHALL NOT BE USED IN LIEU OF BENDS IN RIGID CONDUIT, EXCEPT WITH THE SPECIAL PERMISSION OF THE ENGINEER.
 - 5. FOR FLEXIBLE CONDUIT CONNECTIONS BETWEEN TWO SECTIONS OF RIGID CONDUIT, PROVIDE A CONDUIT BODY ON AT LEAST ONE SIDE OF THE FLEXIBLE CONDUIT.
- 2.03 ALUMINUM CONDUITS, BOXES, ENCLOSURES, ETC. SHALL BE ISOLATED FROM CONCRETE AND/OR STRUCTURAL STEEL WITH NEOPRENE SHIMS. GALVANIZED CONDUITS, BOXES, ENCLOSURES, ETC. SHALL BE ISOLATED FROM UNPAINTED STEEL WITH NEOPRENE SHIMS.
- 2.04 RIGID CONDUITS SHALL BE SUPPORTED WITHIN 18 INCHES OF ALL TERMINATIONS AND AT REGULAR INTERVALS NOT TO EXCEED 6 FEET. FLEXIBLE CONDUITS SHALL BE SUPPORTED WITHIN 12 INCHES OF ALL TERMINATIONS AND AT REGULAR INTERVALS NOT TO EXCEED 3 FEET.
- 2.05 ALL CONDUIT CONNECTIONS TO BOXES AND ENCLOSURES WHICH DO NOT HAVE INTEGRAL THREADED HUBS SHALL UTILIZE WEATHERPROOF GROUNDING TYPE HUBS OR CONNECTORS. ALL HUBS AND CONNECTORS SHALL HAVE INSULATED THROATS OR BE PROVIDED WITH INSULATED BUSHINGS.
- 2.06 ANY CONDUIT ROUTINGS SHOWN ON THESE PLANS ARE CONCEPTUAL ONLY. ACTUAL ROUTINGS SHALL BE DETERMINED BY THE CONTRACTOR BASED ON ACTUAL CONDITIONS AND SUBMITTED TO THE ENGINEER FOR APPROVAL.
- 2.07 ALL CONDUCTORS SHALL BE STRANDED COPPER TYPE XHHW-2, EXCEPT WHERE SHOWN OTHERWISE ON THE PLANS. THE MINIMUM SIZE FOR FIELD POWER AND CONTROL WIRING SHALL BE 12 AWG.
- 2.08 SUPPORT CABLES IN VERTICAL RACEWAYS IN ACCORDANCE WITH NEC 300.19 WITH CABLE SUPPORTS INSTALLED AT TERMINAL CABINETS AND/OR PULL BOXES.
- 2.09 NEUTRAL CONDUCTORS SHALL NOT BE SHARED BETWEEN MULTIPLE BRANCH CIRCUITS, EXCEPT FOR DESIGNATED MULTIWIRED LIGHTING AND RECEPTACLE CIRCUITS WHERE CLEARLY SHOWN ON THE PLANS.
- 2.10 MINIMUM CONDUIT SIZE SHALL BE 3/4 INCH, EXCEPT THAT 1/2 INCH SHALL BE PERMITTED FOR FLEXIBLE CONDUIT CONNECTIONS TO LUMINAIRES.
- 2.11 WIRING IN ENCLOSURES, CABINETS, BOXES, ETC. SHALL BE NEATLY ROUTED, AND BUNDLED WITH PVC CABLE TIES OR PLACED IN NON-METALLIC WIRING TROUGHS.
- 2.12 SPARE AND UN-TERMINATED CONDUCTORS SHALL BE CAPPED, OR CONNECTED TO SPARE TERMINAL BLOCKS WHERE AVAILABLE, AND CLEARLY IDENTIFIED. ONE FULL TURN OF SLACK FOR ALL SPARE CONDUCTORS SHALL BE PROVIDED IN ALL ENCLOSURES, CABINETS, BOXES, ETC.
- 2.13 ONE FULL TURN OF SLACK SHALL BE PROVIDED FOR ALL CONDUCTORS IN ALL PULL BOXES, JUNCTION BOXES, AND TERMINAL CABINETS.
- 2.14 RACEWAYS CROSSING EXPANSION JOINTS, OR OTHERWISE SUBJECT TO MOVEMENT, SHALL BE PROVIDED WITH EXPANSION AND/OR DEFLECTION FITTINGS, OR OTHER APPROVED MEANS, TO COMPENSATE FOR SUCH MOVEMENT. EACH SUCH EXPANSION AND/OR DEFLECTION MEANS SHALL BE PROVIDED WITH AN EXTERNAL COPPER BONDING JUMPER, SIZED 6 AWG MINIMUM.

- 2.15 CONDUCTORS SPLICES SHALL BE MADE ONLY IN JUNCTION BOXES, OUTLET OR DEVICE BOXES, AND EQUIPMENT ENCLOSURES. SPLICES SHALL BE MADE ONLY ON TERMINAL BLOCKS, EXCEPT FOR SPLICES AT LUMINAIRES AND WIRING DEVICES WHICH SHALL UTILIZE INSULATED SET-SCREW TYPE, OR SIMILAR APPROVED, CONNECTORS. TWIST-ON (WIRENUT) TYPE CONNECTORS SHALL NOT BE USED. TERMINAL BLOCKS SHALL NOT HAVE MORE THAN TWO CONDUCTORS PER TERMINAL.
- 2.16 LAYOUT OF TERMINAL BLOCKS IN JUNCTION BOXES AND TERMINAL CABINETS SHALL COMPLY WITH THE REQUIREMENTS FOR WIRE BENDING SPACE GIVEN IN NEC 312.6, EXCEPT THAT THE MINIMUM SPACE PERMITTED SHALL BE 2 INCHES. PROPOSED LAYOUTS, INCLUDING ANTICIPATED LOCATIONS AND SIZES OF KNOCKOUTS, SHALL BE SUBMITTED FOR APPROVAL PRIOR TO FABRICATION.
- 2.17 A CONDUIT BODY OR BOX SHALL BE PROVIDED ON AT LEAST ONE SIDE OF ALL FLEXIBLE CONDUITS.
- 2.18 ALL RACEWAYS SHALL BE ARRANGED TO DRAIN. CONDUIT DRAINS SHALL BE INSTALLED IN A CONDUIT BODY AT THE LOW POINT OF ALL RUNS.
- 2.19 UNLESS SPECIFICALLY INDICATED OTHERWISE, CONDUIT AND CABLE ENTRANCES IN DAMP AND WET LOCATIONS SHALL BE MADE ONLY IN THE BOTTOM OF CABINETS AND/OR ENCLOSURES.
- 2.20 CONDUCTORS WITH GREEN COLORED INSULATION MAY BE USED ONLY FOR GROUNDING CONDUCTORS. RE-IDENTIFICATION OF CONDUCTORS WITH GREEN COLORED INSULATION, SUCH AS WITH COLORED TAPE, IS NOT PERMITTED.

3. GROUNDING & BONDING

- 3.01 ALL CIRCUITS SHALL INCLUDE AN EQUIPMENT GROUNDING CONDUCTOR. EQUIPMENT GROUNDING CONDUCTORS SHALL BE SIZED EQUAL TO THE CIRCUIT CONDUCTORS, EXCEPT WHERE SHOWN OTHERWISE ON THE PLANS.
- 3.02 GROUNDING TYPE HUBS AND CONNECTORS SHALL BE CONNECTED TO THE EQUIPMENT GROUNDING CONDUCTOR(S) CONTAINED WITHIN THEIR ASSOCIATED CONDUIT OR CABLE.
- 3.03 ALL GROUNDING CONDUCTORS WITHIN AN EQUIPMENT ENCLOSURE OR TERMINAL CABINET SHALL BE TERMINATED ON A COMMON UNINSULATED GROUNDING BAR.

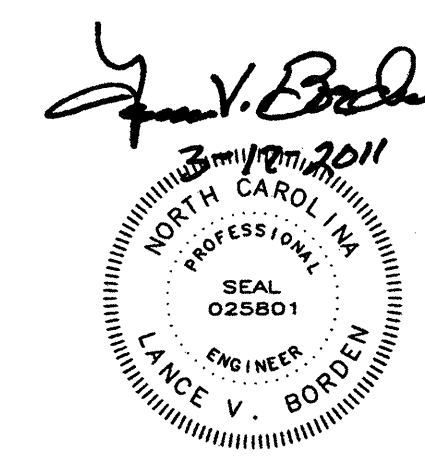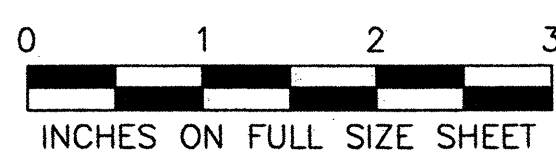

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL GENERAL NOTES BASCULE BRIDGE - 1			
DRAWN BY N.E. ALGER		SCALE AS NOTED	
DESIGNED N.E. ALGER	DETAILED N.E. ALGER	DATE MARCH 2011	EB1
CHECKED Q.C. TON	CHECKED Q.C. TON	DRAWING NO. 27 OF 63	

27-EB1-EC08B1.DWG

ELECTRICAL GENERAL NOTES (BASCULE BRIDGE) (CONTINUED)

4. IDENTIFICATION

- 4.01 ALL CONDUCTORS SHALL BE UNIQUELY IDENTIFIED AND CLEARLY LABELED WITH MACHINE PRINTED, WEATHERPROOF, NON-SHRINK SLEEVE TYPE LABELS.
- 4.02 ALL TERMINAL BLOCKS SHALL BE CLEARLY LABELED, AT EACH TERMINAL POSITION, WITH ENGRAVED PLASTIC WEATHERPROOF LABELS (WHITE TEXT ON BLACK BACKGROUND) ATTACHED WITH STAINLESS STEEL HARDWARE.
- 4.03 ALL ELECTRICAL EQUIPMENT ENCLOSURES, PULL AND JUNCTION BOXES, AND SIMILAR ITEMS SHALL BE CLEARLY LABELED WITH ENGRAVED PLASTIC WEATHERPROOF LABELS (WHITE TEXT ON BLACK BACKGROUND) ATTACHED WITH STAINLESS STEEL HARDWARE.

3. MISCELLANEOUS MATERIALS & METHODS

- 3.01 UNLESS NOTED OTHERWISE FOR A SPECIFIC APPLICATION, ALL BOLTS, NUTS, WASHERS, AND SIMILAR HARDWARE SHALL BE TYPE 316 STAINLESS STEEL.
- 3.02 UNLESS NOTED OTHERWISE FOR A SPECIFIC APPLICATION, ALL CONCRETE ANCHORS SHALL BE EITHER EPOXY ADHESIVE TYPE OR WEDGE STUD TYPE. ALL CONCRETE ANCHORS SHALL BE TYPE 316 STAINLESS STEEL.
- 3.03 ALL BOLTED, AND SIMILAR, CONNECTIONS SHALL UTILIZE LOCK WASHERS. CONNECTIONS WHICH DO NOT PERMIT THE USE OF LOCK WASHERS SHALL UTILIZE AN APPROVED MEDIUM STRENGTH THREADLOCKING ADHESIVE.
- 3.04 SUPPORTS FOR ELECTRICAL EQUIPMENT SHALL BE FABRICATED FROM TYPE 316 STAINLESS STEEL OR TYPE A36 STEEL (HOT-DIP GALVANIZED AFTER FABRICATION).
- 3.05 THE OPERATING HANDLE(S) OF ALL MANUALLY OPERABLE DEVICES SHALL NOT BE LESS THAN 2 FEET, NOR MORE THAN 6'-7", ABOVE THE FLOOR.
- 3.06 EQUIPMENT ENCLOSURES, CABINETS, BOXES, AND SIMILAR ITEMS SHALL BE INSTALLED PLUMB AND SECURELY FASTENED IN PLACE.

6. REMOVALS, SALVAGE, & DISPOSAL

- 6.01 EXCEPT WHERE SPECIFICALLY NOTED OTHERWISE, ONLY EXISTING CONCRETE EMBEDDED RACEWAYS AND BOXES MAY BE ABANDONED IN PLACE. EXISTING UNDERGROUND RACEWAYS, UNDERGROUND BOXES, AND OTHER EQUIPMENT SHALL NOT BE ABANDONED IN PLACE, EXCEPT WHERE SPECIFICALLY NOTED OTHERWISE.

EXISTING CONCRETE EMBEDDED RACEWAYS WHICH ARE TO BE ABANDONED IN PLACE SHALL HAVE ALL CONDUCTORS REMOVED, BE GROUND FLUSH WITH THE CONCRETE, AND FILLED WITH NON-SHRINK GROUT FLUSH WITH THE CONCRETE.

EXISTING CONCRETE EMBEDDED BOXES WHICH ARE TO BE ABANDONED IN PLACE SHALL HAVE ALL CONDUCTORS REMOVED AND BE COVERED WITH A NEW BLANK GALVANIZED STEEL COVER.

- 6.02 THE CONTRACTOR SHALL BEAR FULL RESPONSIBILITY FOR PROPER DISPOSAL OF REMOVED EQUIPMENT AND MATERIALS IN ACCORDANCE WITH ALL APPLICABLE REGULATIONS.

7. WORKING DRAWINGS & SUBMITTALS

- 7.01 THE CONTRACTOR SHALL BE RESPONSIBLE FOR PROVIDING ALL REQUIRED WORKING DRAWINGS AND PRODUCT SUBMITTALS, WORKING IN COOPERATION AND COMMUNICATION WITH THE ENGINEER IN ORDER TO PROVIDE A COMPLETE, FUNCTIONAL, AND SAFE INSTALLATION IN ACCORDANCE WITH THE REQUIREMENTS AND INTENTS OF THESE PLANS, THE SPECIFICATIONS, THE CONTRACT DOCUMENTS, AND ALL APPLICABLE CODES.
- 7.02 ALL REQUIRED WORKING DRAWINGS AND PRODUCT DESCRIPTIVE DATA SHALL BE SUBMITTED TO THE PROJECT ENGINEER FOR REVIEW AND APPROVAL. SUCH ITEMS MUST BE APPROVED BY THE PROJECT ENGINEER PRIOR TO PURCHASE OF THE RELATED MATERIALS AND/OR UNDERTAKING OF THE RELATED WORK.
- 7.03 SUBMIT COMPLETE DESCRIPTIVE DATA FOR EACH ITEM OF EQUIPMENT AND MATERIAL.
- 7.04 WIRING DIAGRAMS AND SCHEMATICS PROVIDED IN THESE PLANS ARE FOR ILLUSTRATIVE PURPOSES ONLY. THE CONTRACTOR SHALL BEAR FULL RESPONSIBILITY FOR DEVELOPING ALL REQUIRED DIAGRAMS, INCLUDING FIELD INTERCONNECTION DIAGRAMS.
- 7.05 WIRING LAYOUTS AND TABULATIONS PROVIDED IN THESE PLANS ARE FOR ILLUSTRATIVE PURPOSES ONLY. THE CONTRACTOR SHALL BEAR FULL RESPONSIBILITY FOR DEVELOPING THE ACTUAL LAYOUTS AND TABULATIONS.
- 7.06 THE CONTRACTOR SHALL DEVELOP ALL FINAL MOUNTING DETAILS FOR ALL EQUIPMENT. SUCH DETAILS SHALL COMPLY WITH ANY TYPICAL DETAILS SHOWN ON THESE PLANS.

8. DOCUMENTATION OF EXISTING WIRING

- 8.01 THE CONTRACTOR SHALL TRACE, MARK, AND DOCUMENT EXISTING WIRING AT THE MACHINERY DECKS AND ON THE BASCULE SPANS PRIOR TO BEGINNING REPLACEMENT OF ANY WIRING, CONDUITS, OR BOXES IN THESE AREAS. THIS PREPARATION IS NECESSARY IN ORDER TO ENSURE THAT THE NEW WIRING WILL CORRECTLY REPLICATE THE EXISTING WIRING WHICH IS TO BE REPLACED.



ALL EXISTING WIRING TO BE REPLACED SHALL BE POSITIVELY TRACED FROM END TO END TO DETERMINE EXISTING CONNECTIONS AT BOTH ENDS.

AS EACH WIRE IS TRACED, IT SHALL BE MARKED AT BOTH ENDS WITH NEW ADHESIVE MARKERS. IF THE WIRE IN QUESTION IS ALREADY MARKED, THE EXISTING MARKERS SHALL BE RETAINED AND THE NEW MARKERS ADDED IN SUCH A MANNER THAT THE TWO ARE DISTINGUISHABLE. THE NUMBERS ON THE NEW MARKERS SHALL BE PRECEDED WITH A DISTINGUISHING CHARACTER (SUCH AS +) TO CLEARLY DIFFERENTIATE THE NEW MARKERS FROM ANY EXISTING MARKERS.

THE WIRE NUMBERS (BOTH EXISTING AND NEW) AND CONNECTIONS AT EACH END SHALL BE CAREFULLY AND NEATLY DOCUMENTED.


FOR ALL TERMINAL CABINETS AND JUNCTION BOXES, A SKETCH SHOWING THE RELATIVE LAYOUTS OF THE EXISTING TERMINALS SHALL BE PRODUCED. EACH TERMINAL SHALL CLEARLY IDENTIFY THE NUMBERS (BOTH EXISTING AND NEW) OF ANY WIRES CONNECTED TO IT.

- 8.02 AFTER THE TRACING, MARKING, AND DOCUMENTATION ARE COMPLETE, THE CONTRACTOR SHALL SUBMIT THE RESULTING DOCUMENTATION TO THE ENGINEER, WHO WILL REVIEW IT FOR COMPLETENESS AND GENERAL ACCEPTABILITY. THE CONTRACTOR MAY NOT PROCEED WITH REPLACEMENT OF ANY WIRING, CONDUITS, OR BOXES IN THESE AREAS UNTIL THE ENGINEER HAS REVIEWED AND APPROVED THIS DOCUMENTATION.
- 8.03 THE CONTRACTOR SHALL USE THE RESULTING DOCUMENTATION AS A GUIDE IN MAKING CONNECTIONS BETWEEN NEW WIRING AND EXISTING WIRING AND EQUIPMENT.
- 8.04 THE CONTRACTOR SHALL BEAR FULL RESPONSIBILITY FOR ENSURING THE CORRECT CONNECTION OF ALL NEW WIRING, AND THAT BRIDGE OPERATION AFTER REPLACEMENT OF ANY WIRING IS THE SAME AS IT WAS BEFORE REPLACEMENT. IN ADDITION TO THE WIRING SHOWN ON THESE SHEETS, THE CONTRACTOR SHALL PROVIDE AND INSTALL ANY ADDITIONAL WIRING (AND ALSO INCLUDING CONDUITS, BOXES, AND RELATED ITEMS) AS MAY BE NECESSARY TO REPLICATE THE EXISTING WIRING WHICH IS TO BE REPLACED.

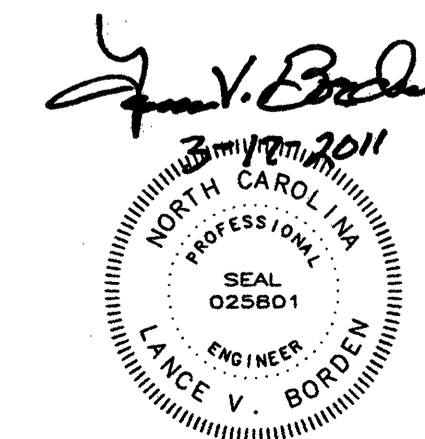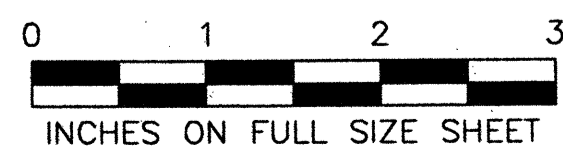


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL GENERAL NOTES BASCULE BRIDGE - 2			
DESIGNED N.E. ALGER		DRAWN BY N.E. ALGER	
CHECKED Q.C. TON		SCALE AS NOTED	
DATE MARCH 2011		DRAWING NO. 28 OF 63	

EB2

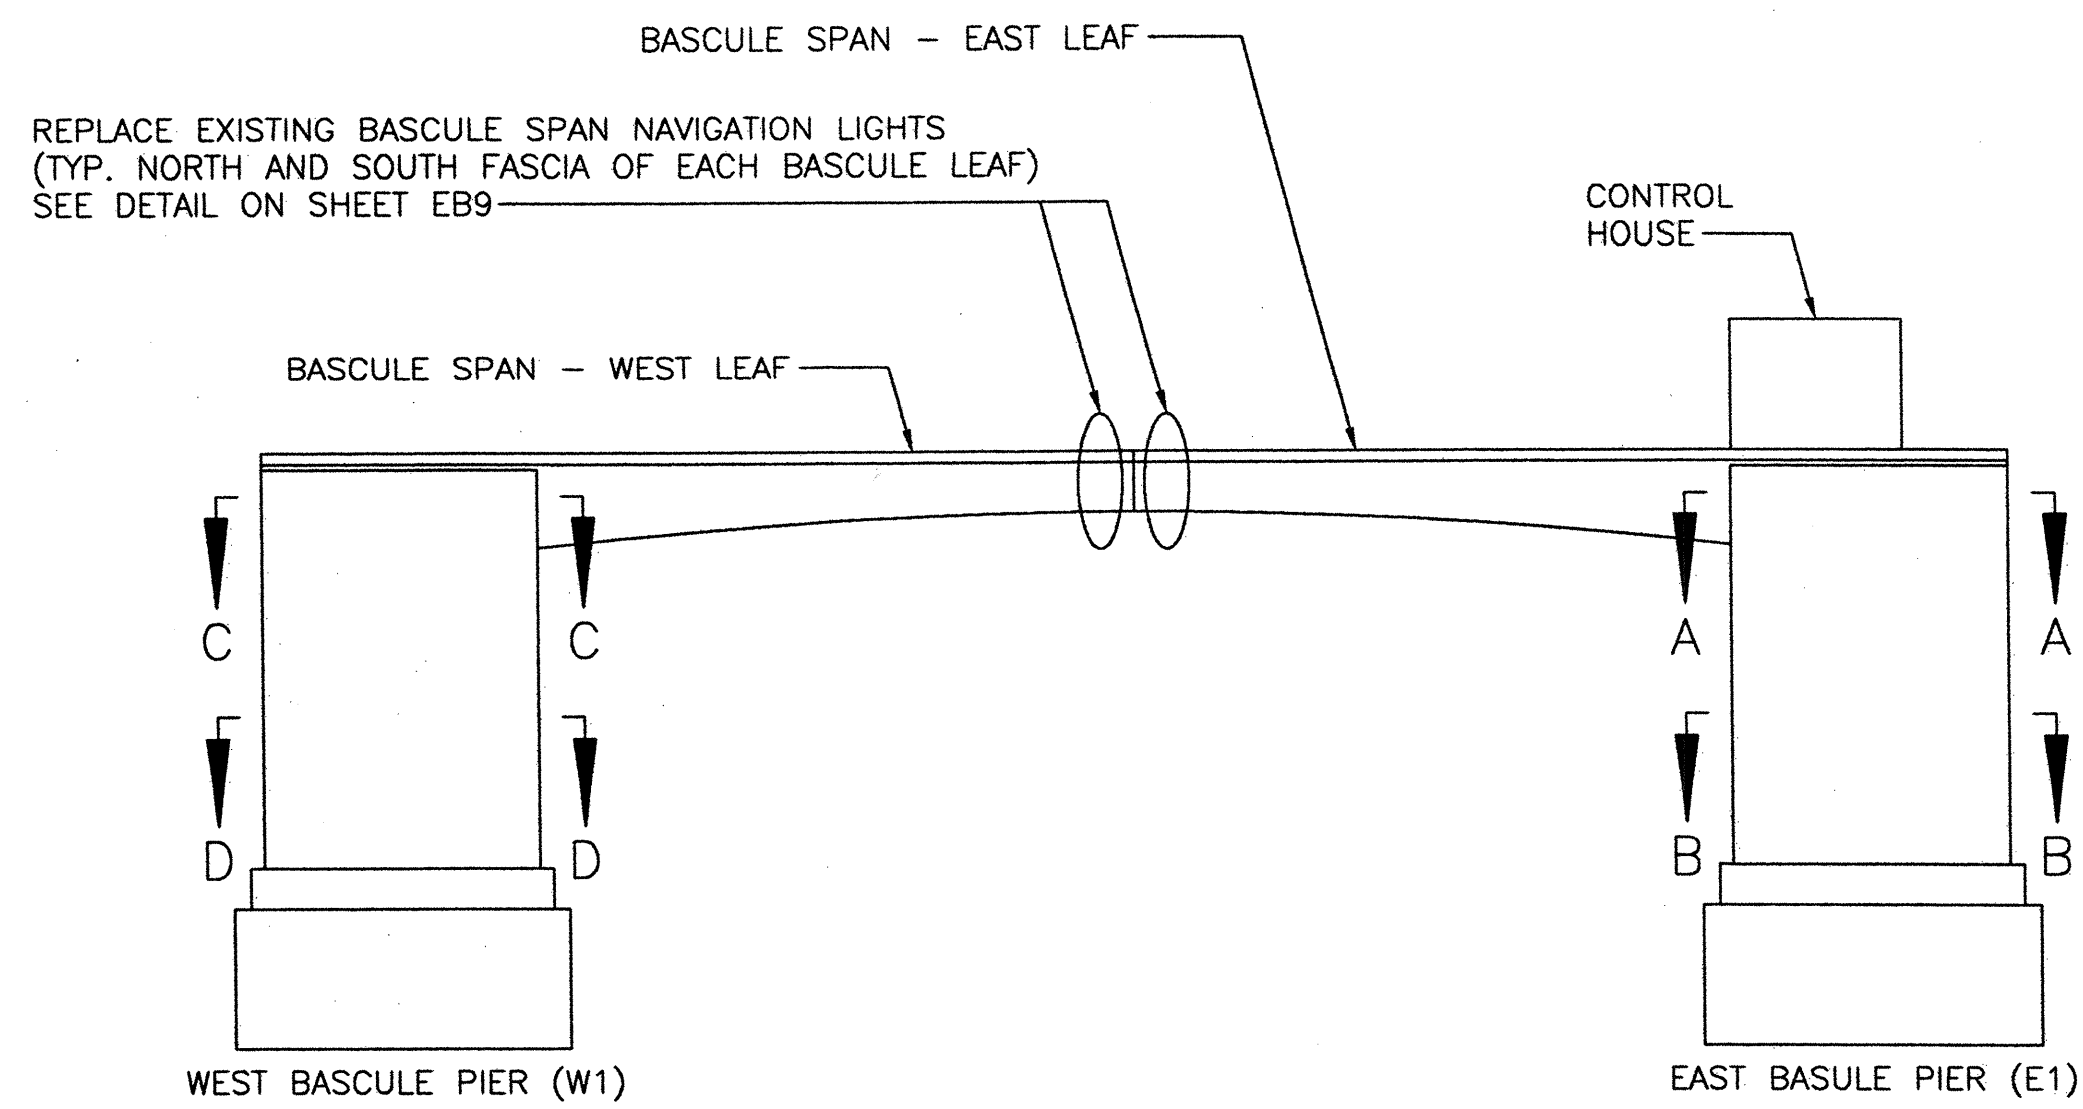

SIMPLIFIED ELEVATION - BASCULE PIERS AND SPANS

SCALE: NONE

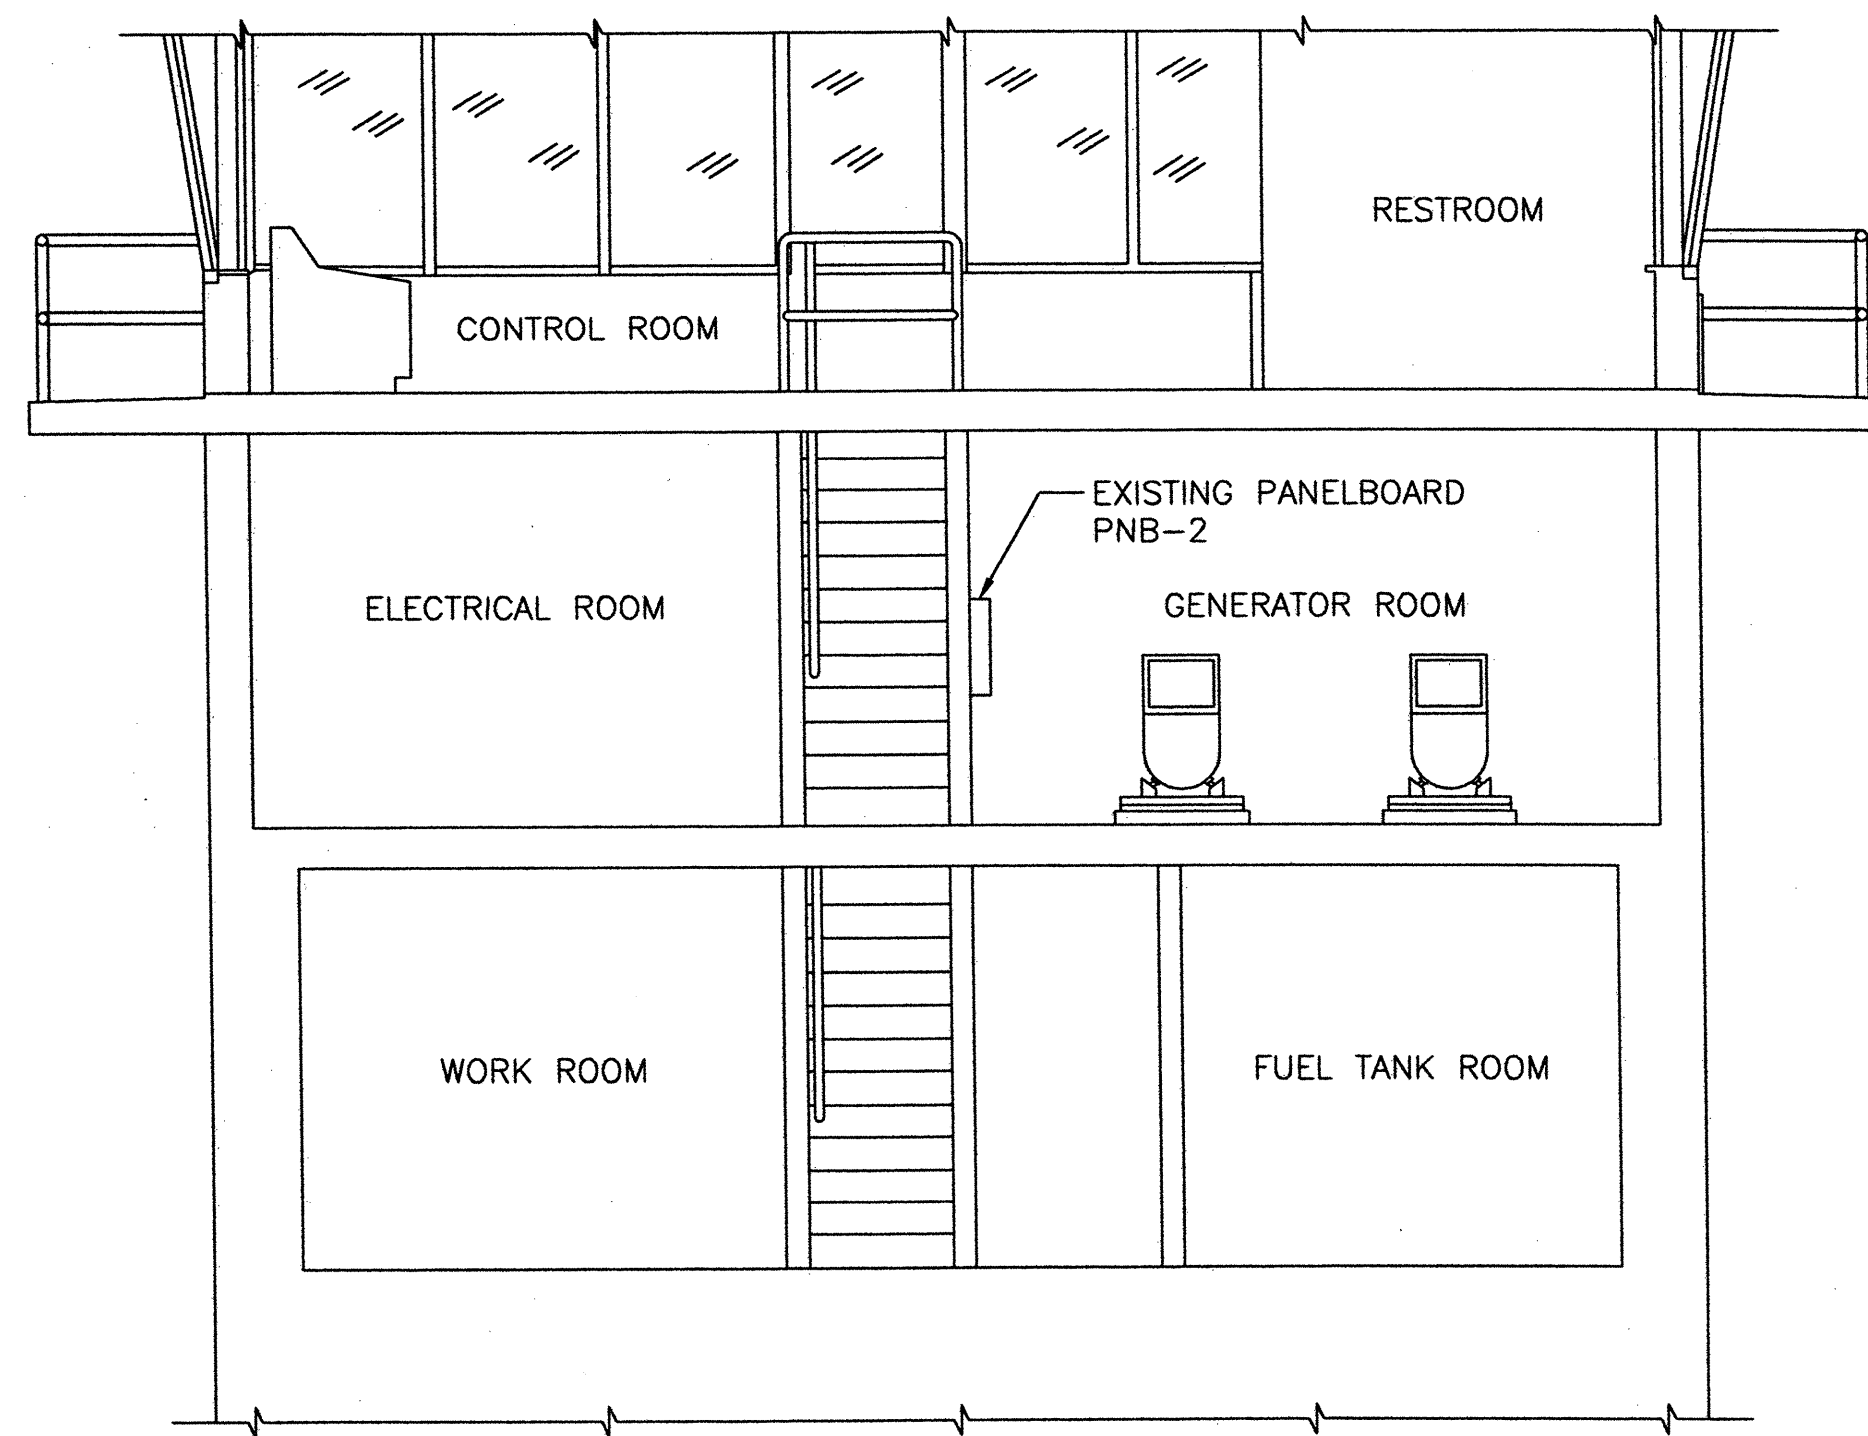


PARTIAL SECTION THROUGH CONTROL HOUSE

SCALE: 1/4" = 1'-0"

NOTE: NOT ALL FEATURES AND EQUIPMENT SHOWN.


SEE DETAILS ON SHEET EB6 FOR WALL MOUNTED ELECTRICAL EQUIPMENT

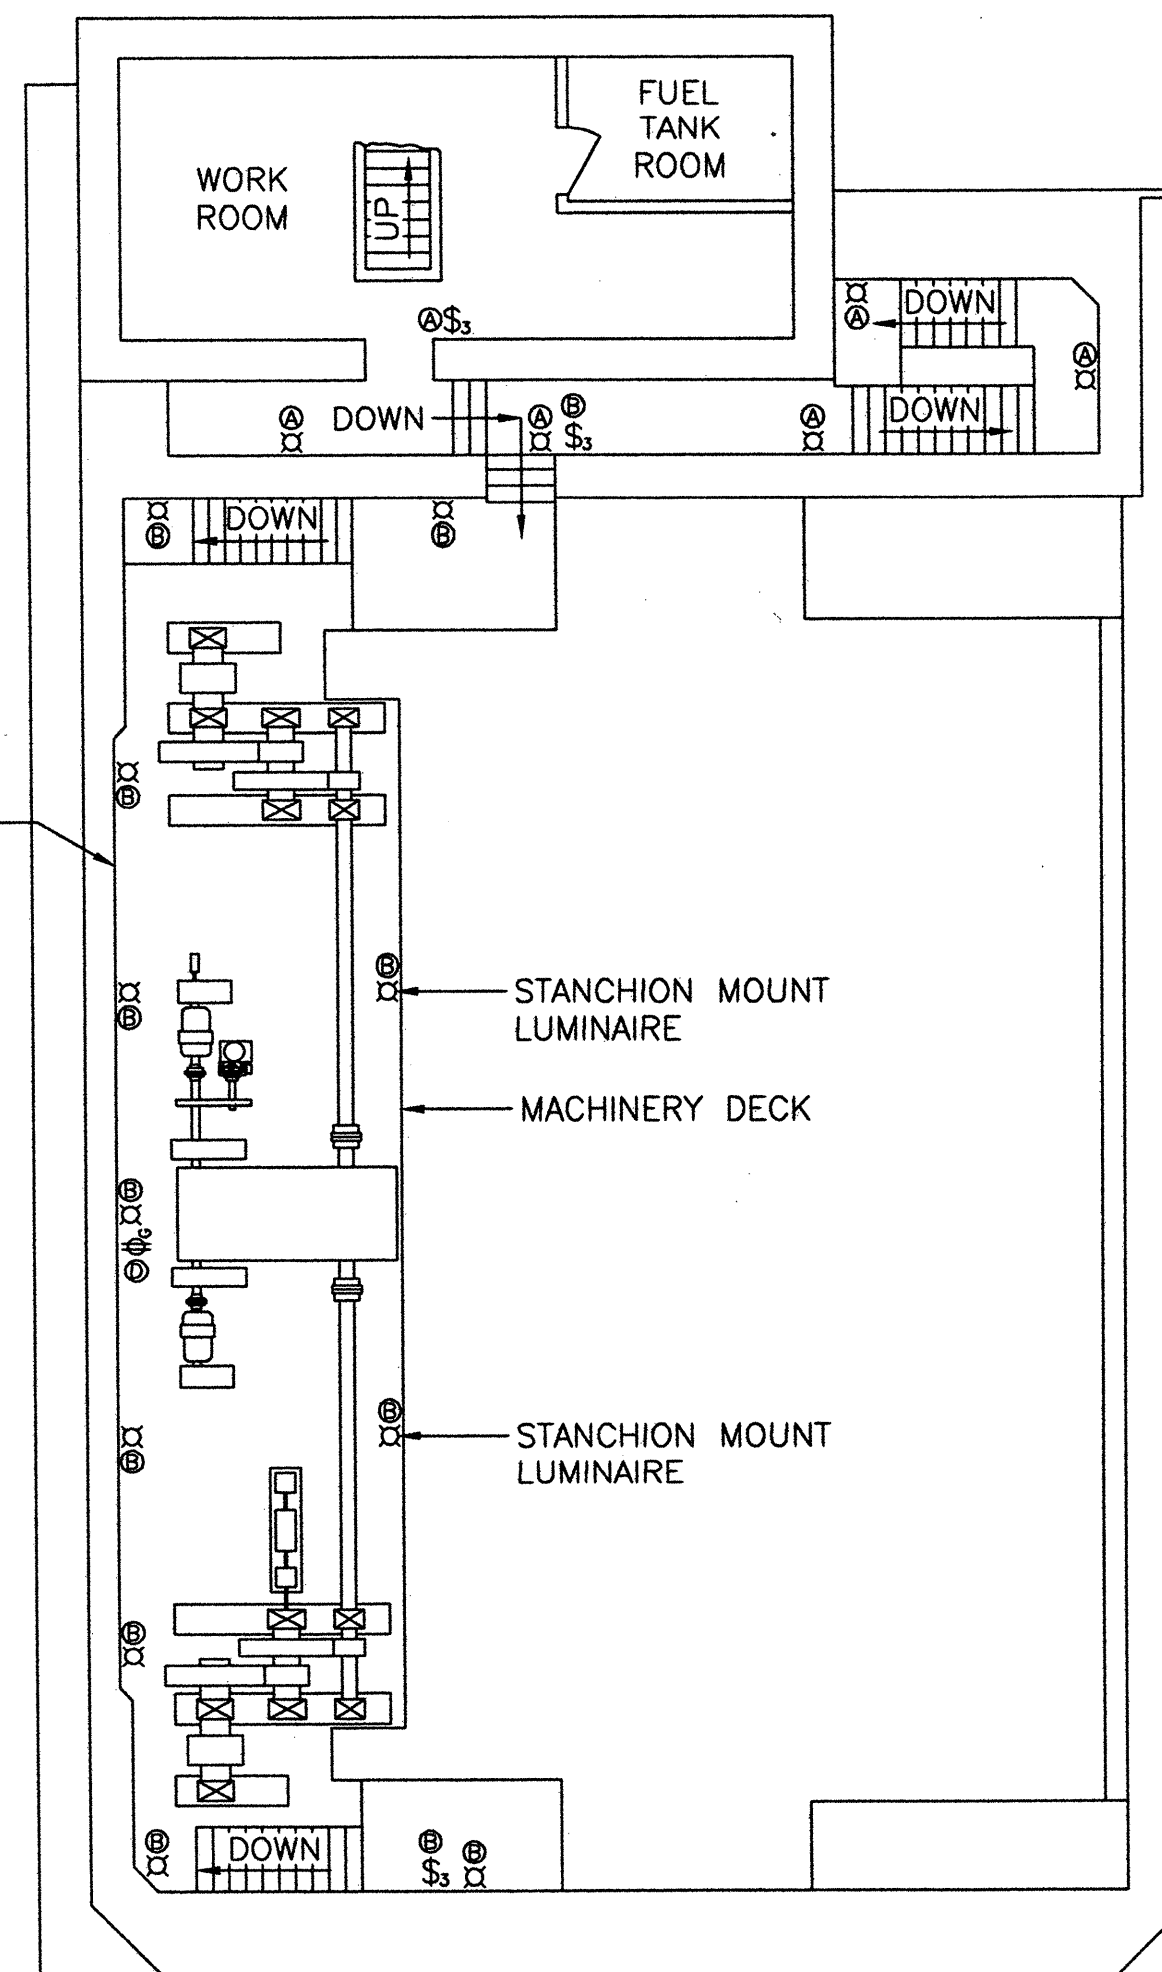

SECTION A-A

SCALE: 1/8" = 1'-0"

NOTE: NOT ALL FEATURES AND EQUIPMENT SHOWN.

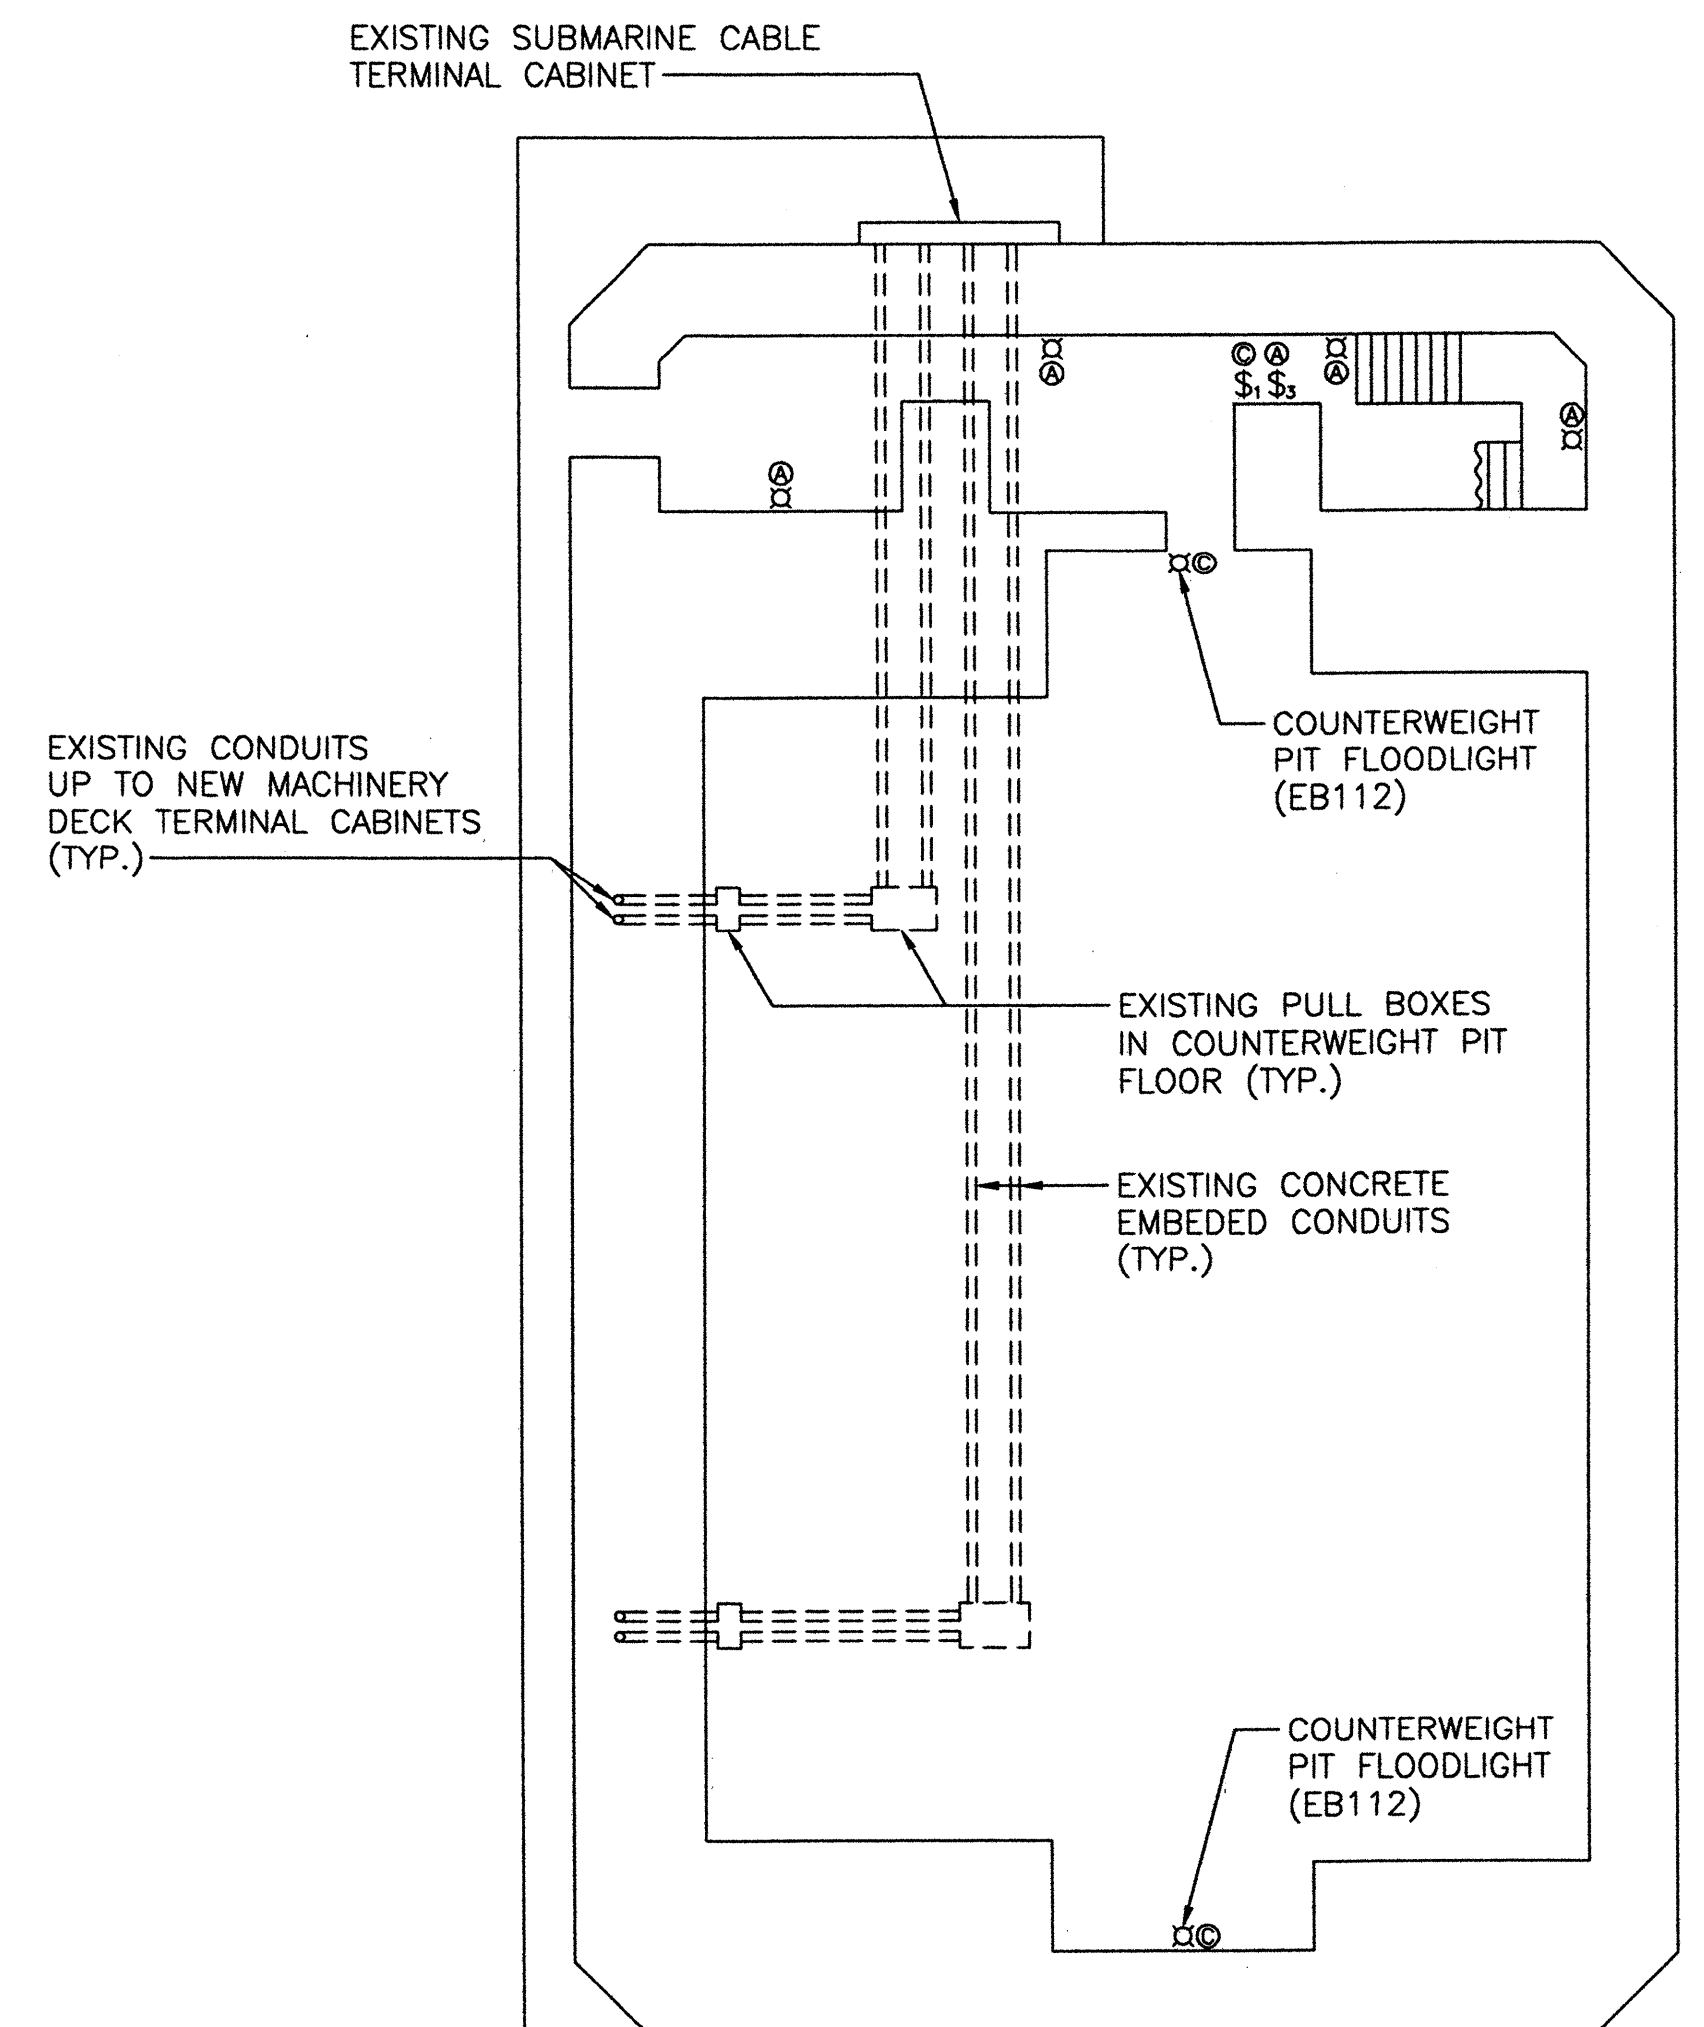

SECTION B-B

SCALE: 1/8" = 1'-0"


NOTE: NOT ALL FEATURES AND EQUIPMENT SHOWN.

DEVICE LEGEND


- \$1 SINGLE POLE SWITCH (EB113)
- \$3 THREE WAY SWITCH (EB113)
- ⊠ LUMINAIRE (TYPE AS INDICATED)
- ⊕ GFCI RECEPTACLE (EB114)
- ⊙ LETTER INDICATES DEVICES ON A COMMON CIRCUIT

NOTES:

1. ALL ELECTRICAL ITEMS ARE NEW EXCEPT AS NOTED.
2. ALL LUMINAIRES ARE VAPORTIGHT INCANDESCENT TYPE EB111 EXCEPT AS NOTED.
3. SEE SHEET EB4 FOR SECTIONS C-C AND D-D.
4. SEE SHEET EB5 FOR DETAILS OF MACHINERY DECK.

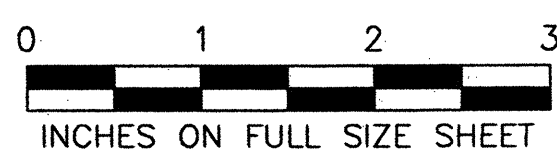

29-EB3-EP01.DWG

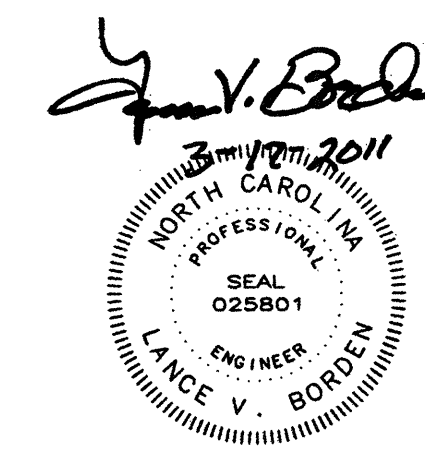


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA

ELECTRICAL PLANS AND DETAILS - 1

DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	CHECKED	Q.C. TON
DRAWN BY		N.E. ALGER	
SCALE		AS NOTED	
DRAWING NO. 29 OF 63			


EB3

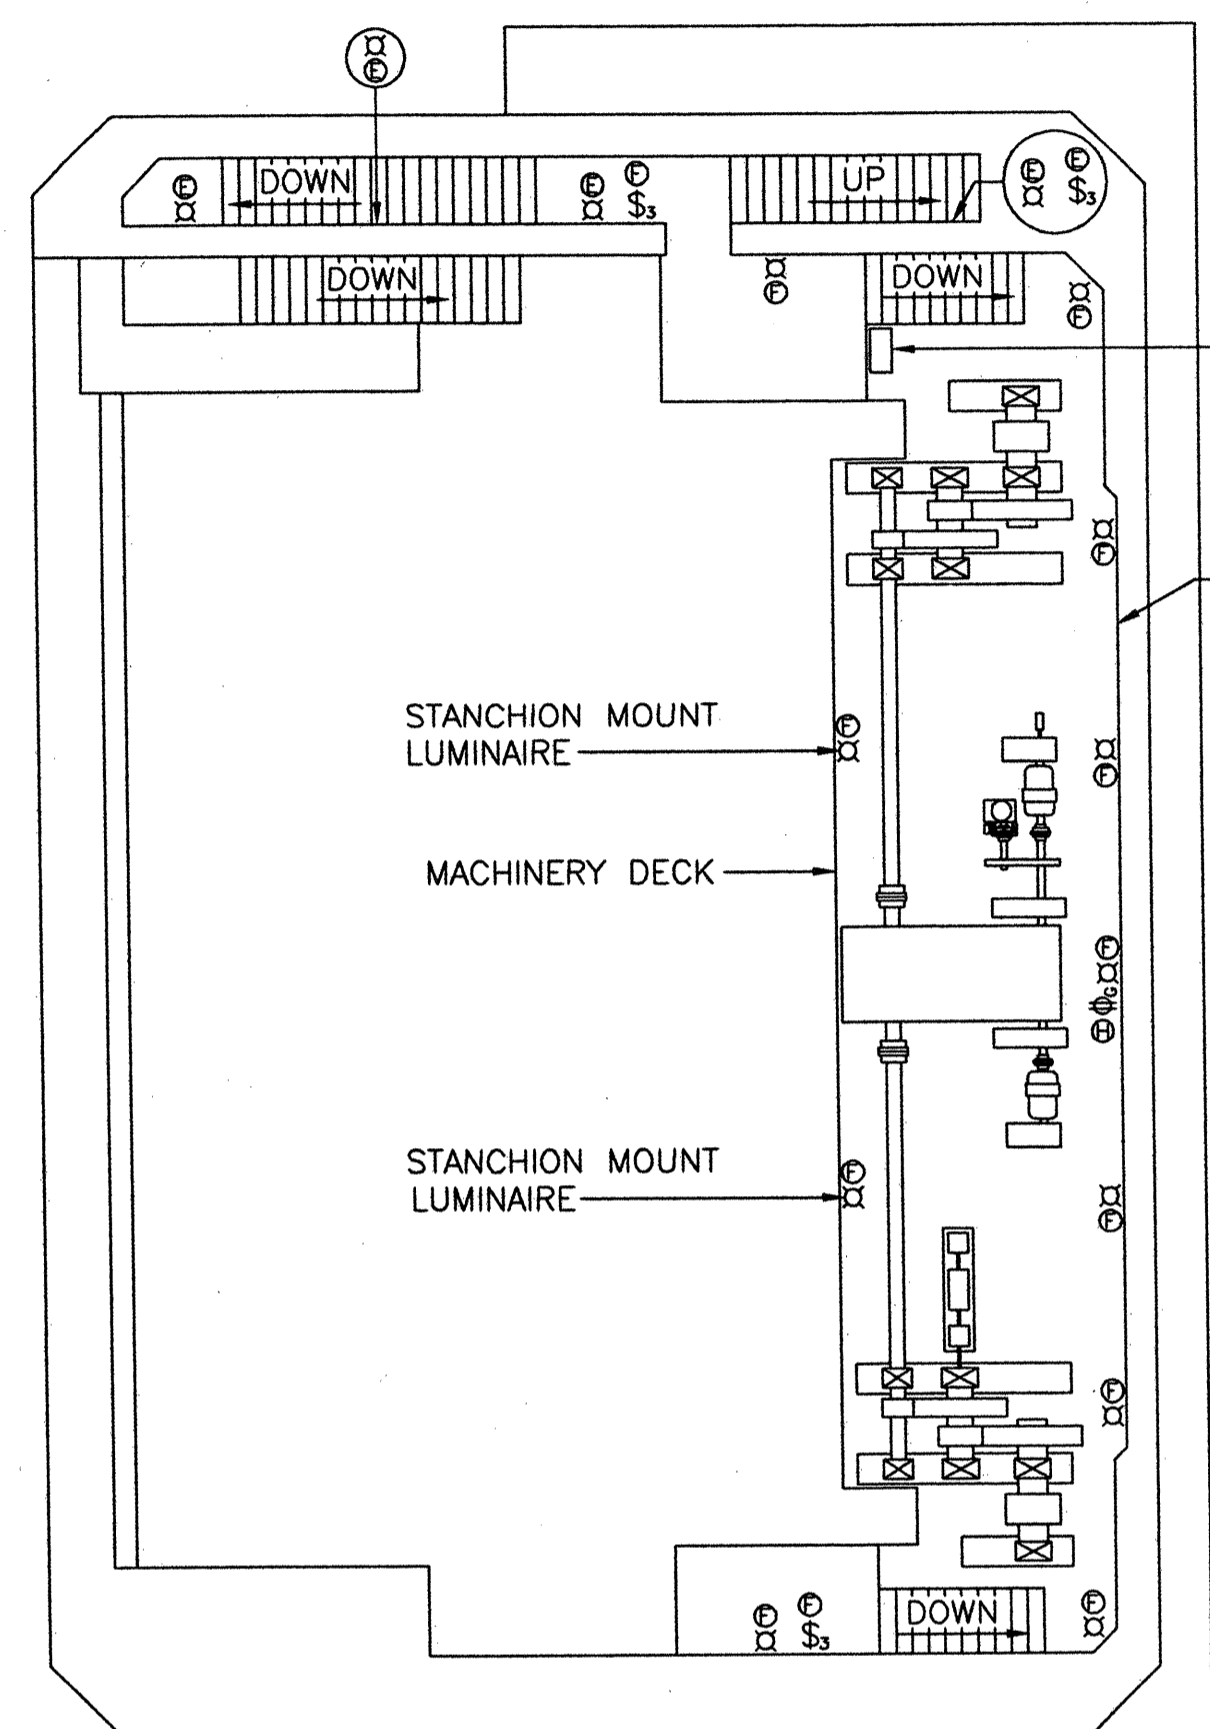

SECTION C-C

SCALE: 1/8" = 1'-0"


NOTE: NOT ALL FEATURES AND EQUIPMENT SHOWN.

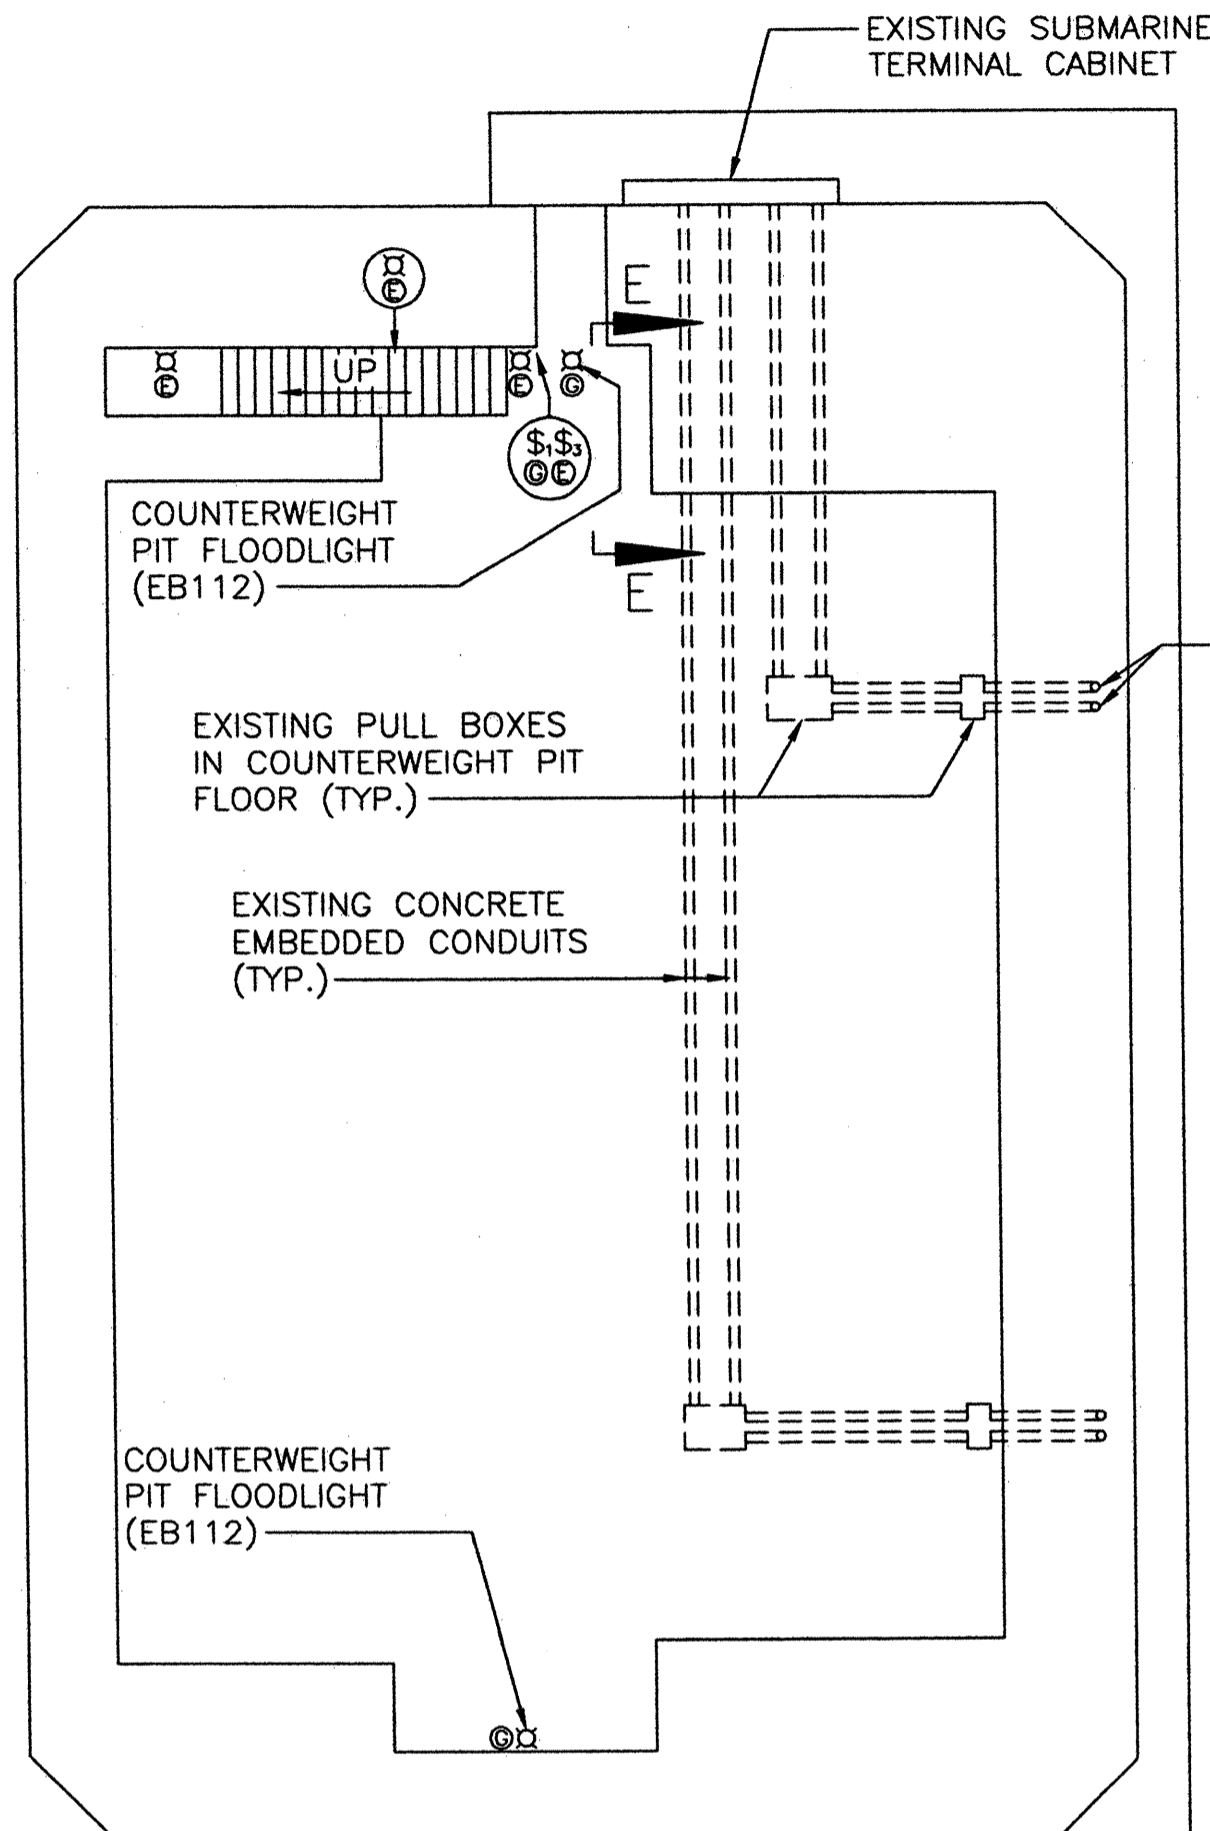

SECTION D-D


SCALE: 1/8" = 1'-0"

NOTE: NOT ALL FEATURES AND EQUIPMENT SHOWN.

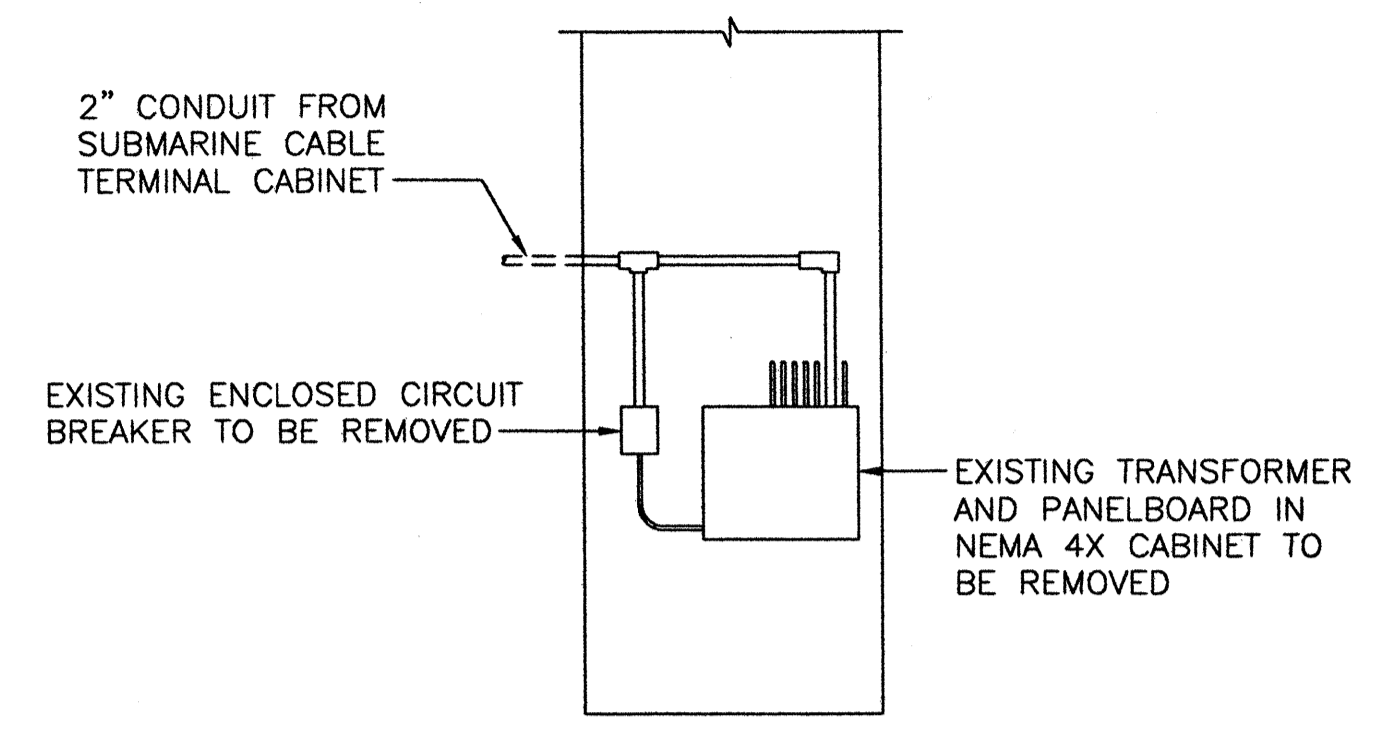

SECTION E-E -- EXISTING

SCALE: 1/4" = 1'-0"

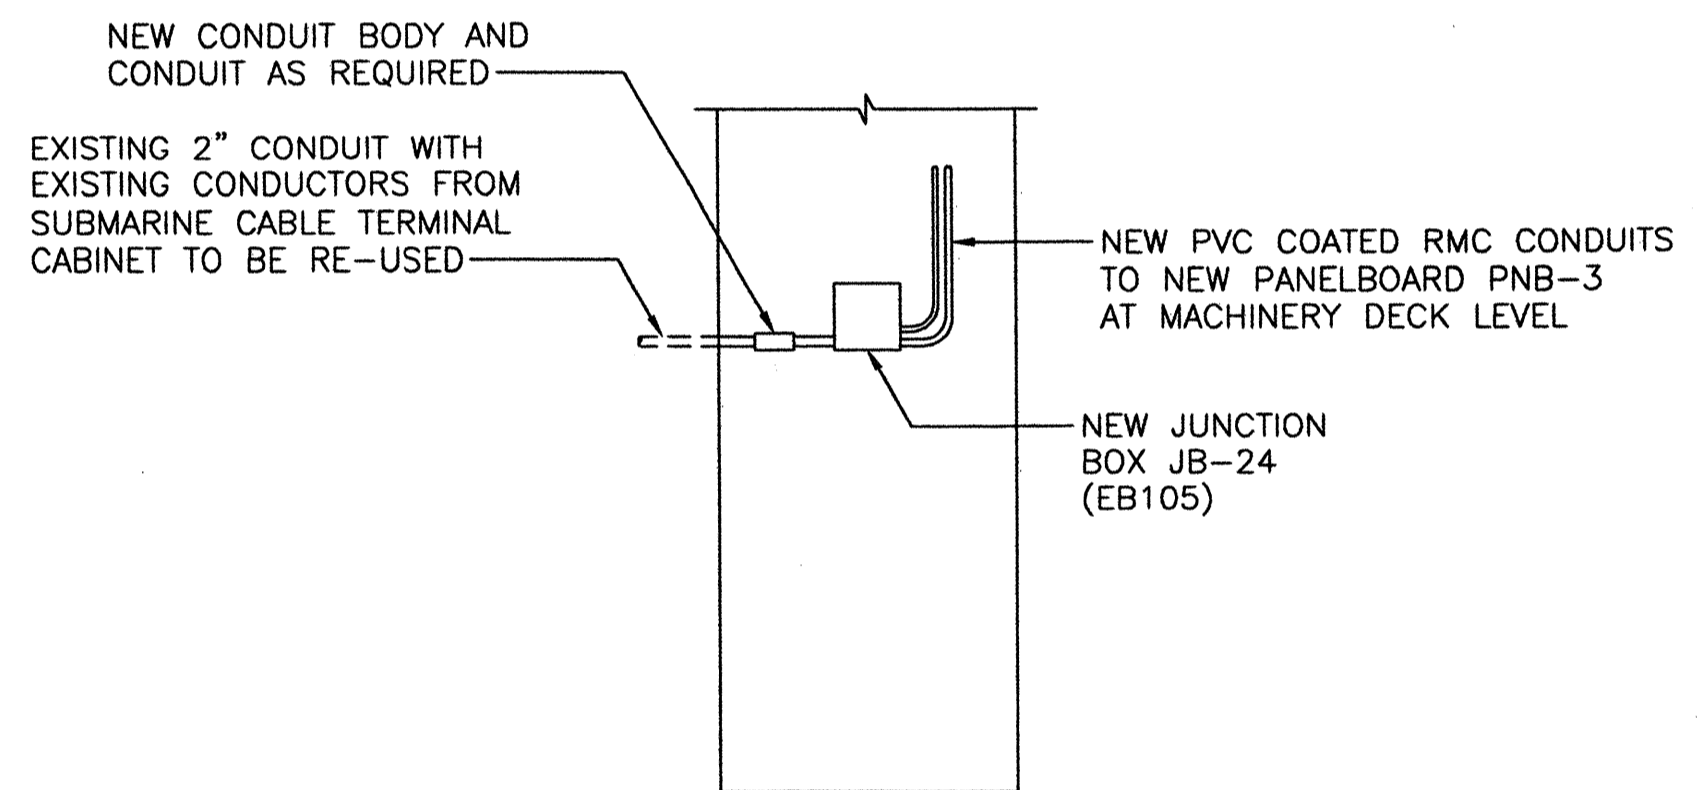

SECTION E-E -- NEW


SCALE: 1/4" = 1'-0"

DEVICE LEGEND


- \$ SINGLE POLE SWITCH (EB113)
- \$ THREE WAY SWITCH (EB113)
- ⊗ LUMINAIRE (TYPE AS INDICATED)
- ⊕ GFCI RECEPTACLE (EB114)
- ⊙ LETTER INDICATES DEVICES ON A COMMON CIRCUIT

NOTES:

1. ALL ELECTRICAL ITEMS ARE NEW EXCEPT AS NOTED.
2. ALL LUMINAIRES ARE VAPORTIGHT INCANDESCENT TYPE (EB111) EXCEPT AS NOTED.
3. SEE SHEET EB3 FOR LOCATIONS OF SECTIONS C-C AND D-D.
3. SEE SHEET EB4 FOR DETAILS OF MACHINERY DECK.

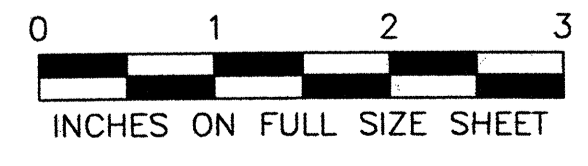


INCHES ON FULL SIZE SHEET

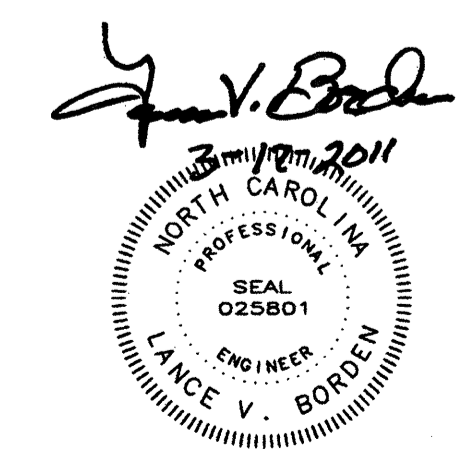

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL PLANS AND DETAILS - 2			
DRAWN BY		N.E. ALGER	
SCALE		AS NOTED	
DESIGNED	N.E. ALGER	DETAILED	N.E. ALGER
CHECKED	Q.C. TON	CHECKED	Q.C. TON
DATE		MARCH 2011	
DRAWING NO.		30 OF 63	


EB4

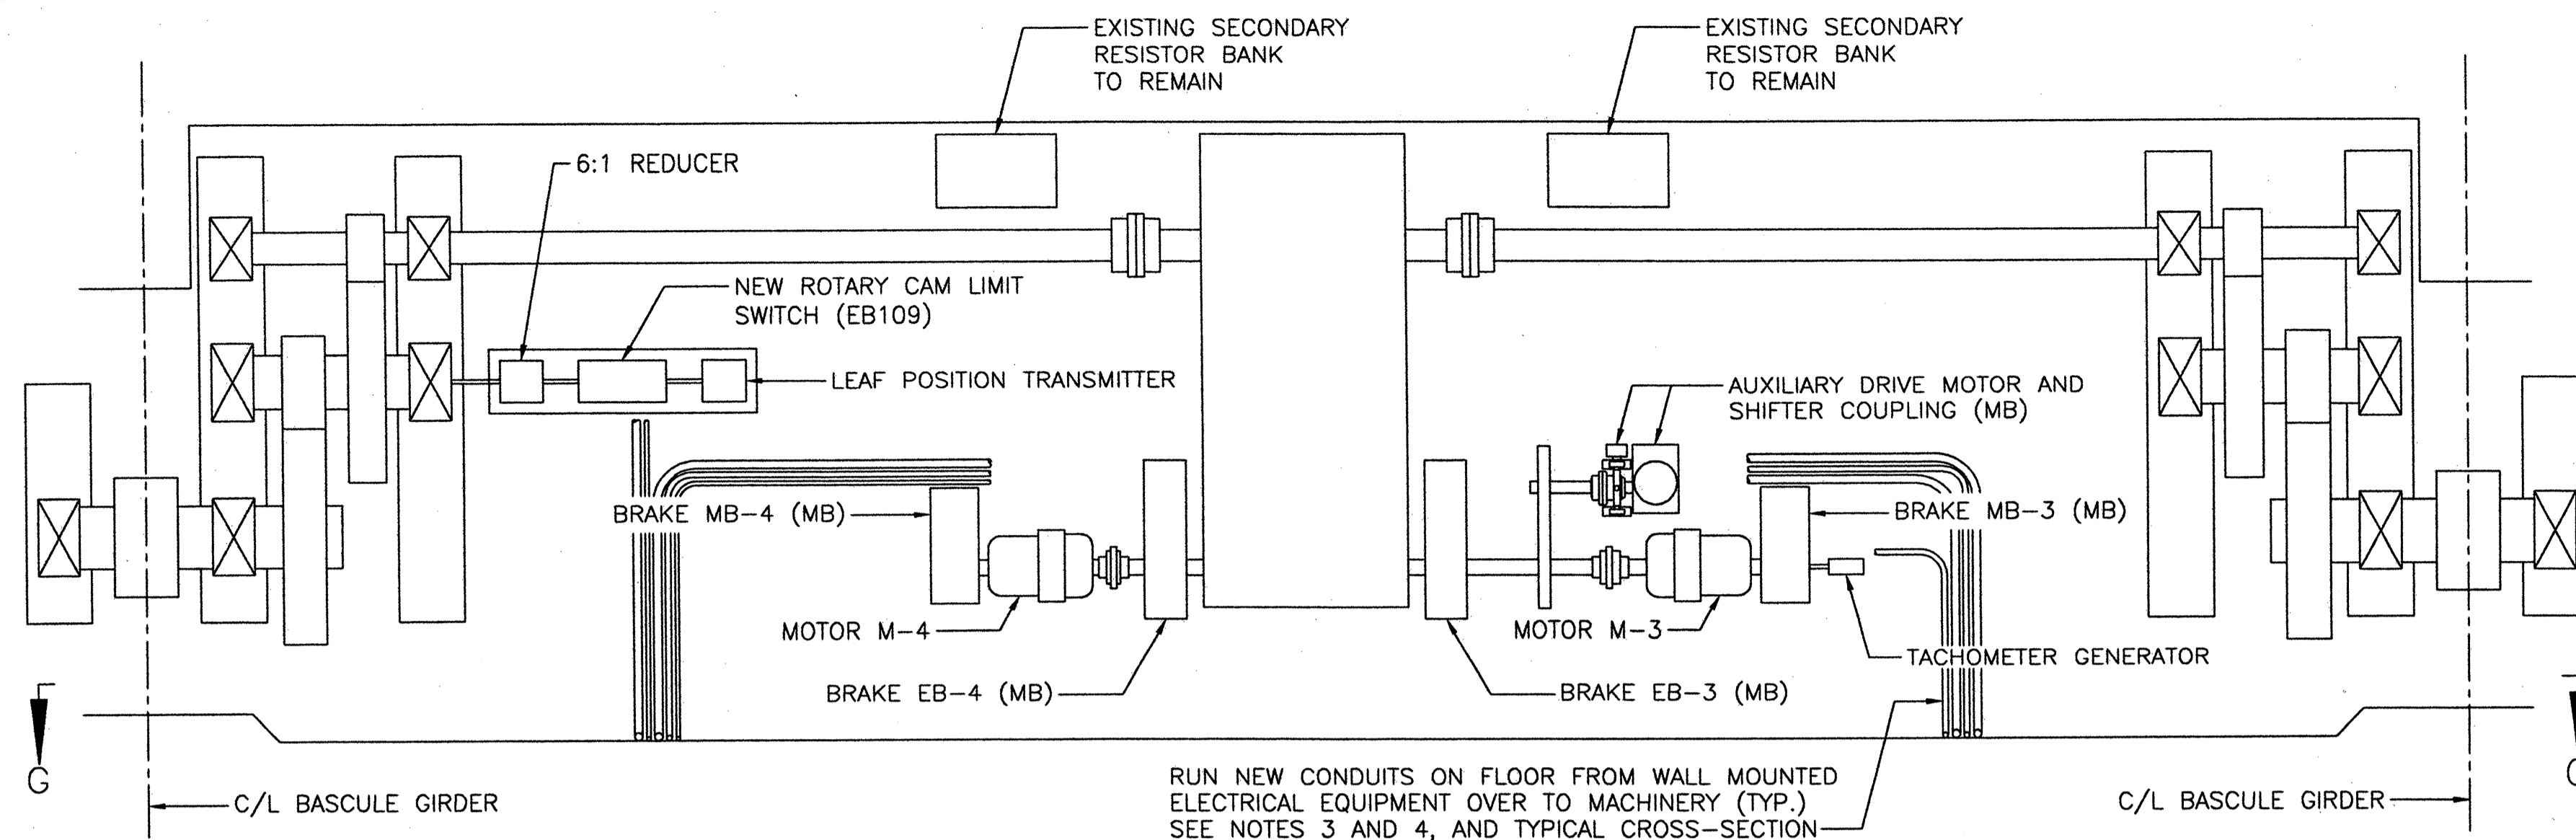

MACHINERY DECK ELECTRICAL LAYOUT - WEST BASCULE PIER (W1)

SCALE: 3/8" = 1'-0"

RUN NEW CONDUITS ON FLOOR FROM WALL MOUNTED ELECTRICAL EQUIPMENT OVER TO MACHINERY (TYP.) SEE NOTES 3 AND 4, AND TYPICAL CROSS-SECTION


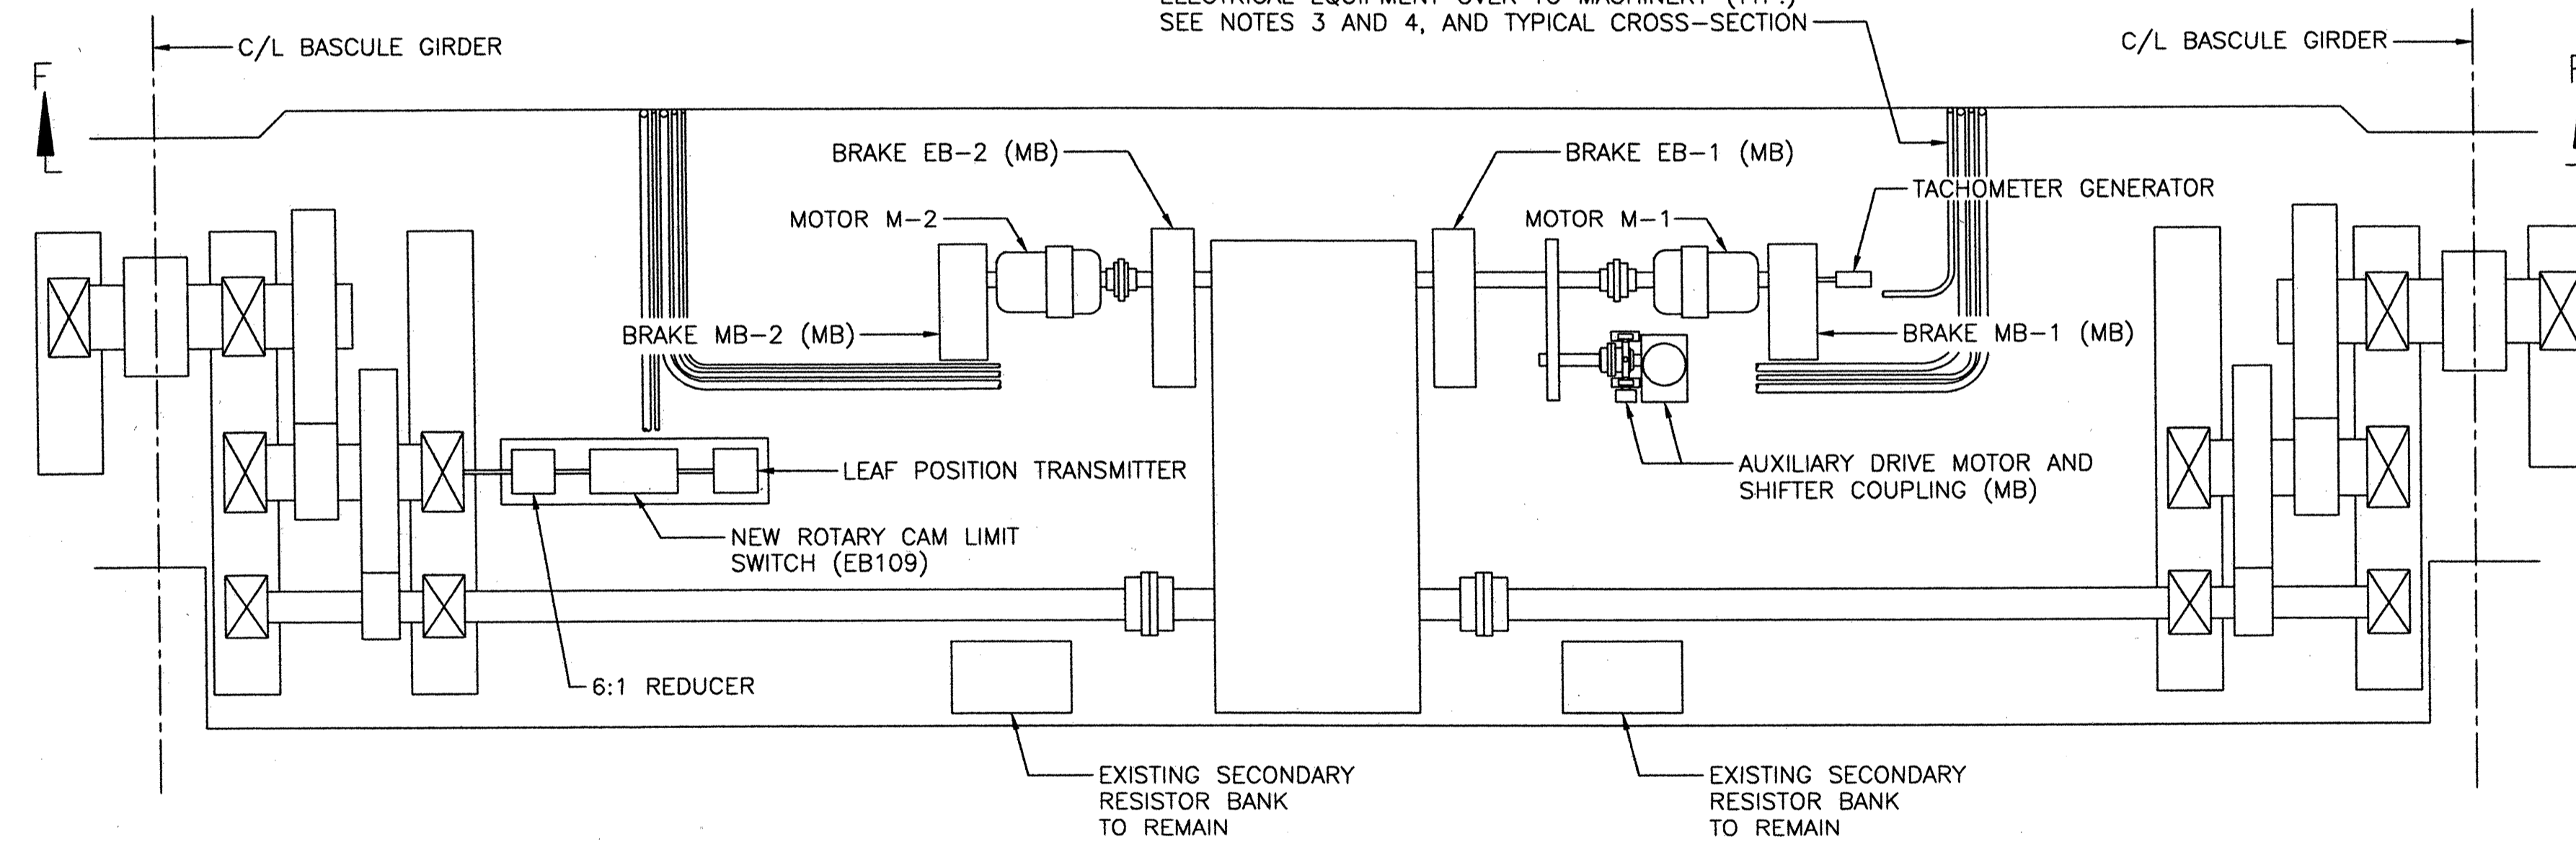


MACHINERY DECK ELECTRICAL LAYOUT - EAST BASCULE PIER (E1)

SCALE: 3/8" = 1'-0"


NOTES:

- ITEMS MARKED WITH "EB" NUMBERS ARE NEW ELECTRICAL EQUIPMENT. ITEMS MARKED WITH (MB) ARE NEW MECHANICAL ITEMS; REFER TO THE MECHANICAL PLANS. ALL OTHER ITEMS ARE EXISTING TO REMAIN.
- SEE SHEET E6 FOR SECTIONS F-F AND G-G.
- CONDUIT ARRANGEMENT SHOWN IS CONCEPTUAL; ACTUAL ARRANGEMENT SHALL BE DETERMINED BY THE CONTRACTOR. CONDUIT ROUTING SHALL GENERALLY BE AS SHOWN.
- CONDUITS ON MACHINERY DECK FLOOR SHALL BE COVERED BY A NEW WALKWAY. SEE TYPICAL CROSS SECTION ON THIS SHEET.
- CONCRETE ENCASED CONDUITS AT VARIOUS LOCATIONS ON THE MACHINERY DECK WHICH ARE TO BE ABANDONED DUE TO INSTALLATION OF NEW CONDUITS SHALL BE CUT-OFF FLUSH WITH THE CONCRETE AND CAPPED WITH NON-SHRINK GROUT.
- ALL NEW RIGID CONDUITS AT MACHINERY DECK SHALL BE PVC COATED RMC; ALL NEW FLEXIBLE CONDUITS SHALL BE LFMC.

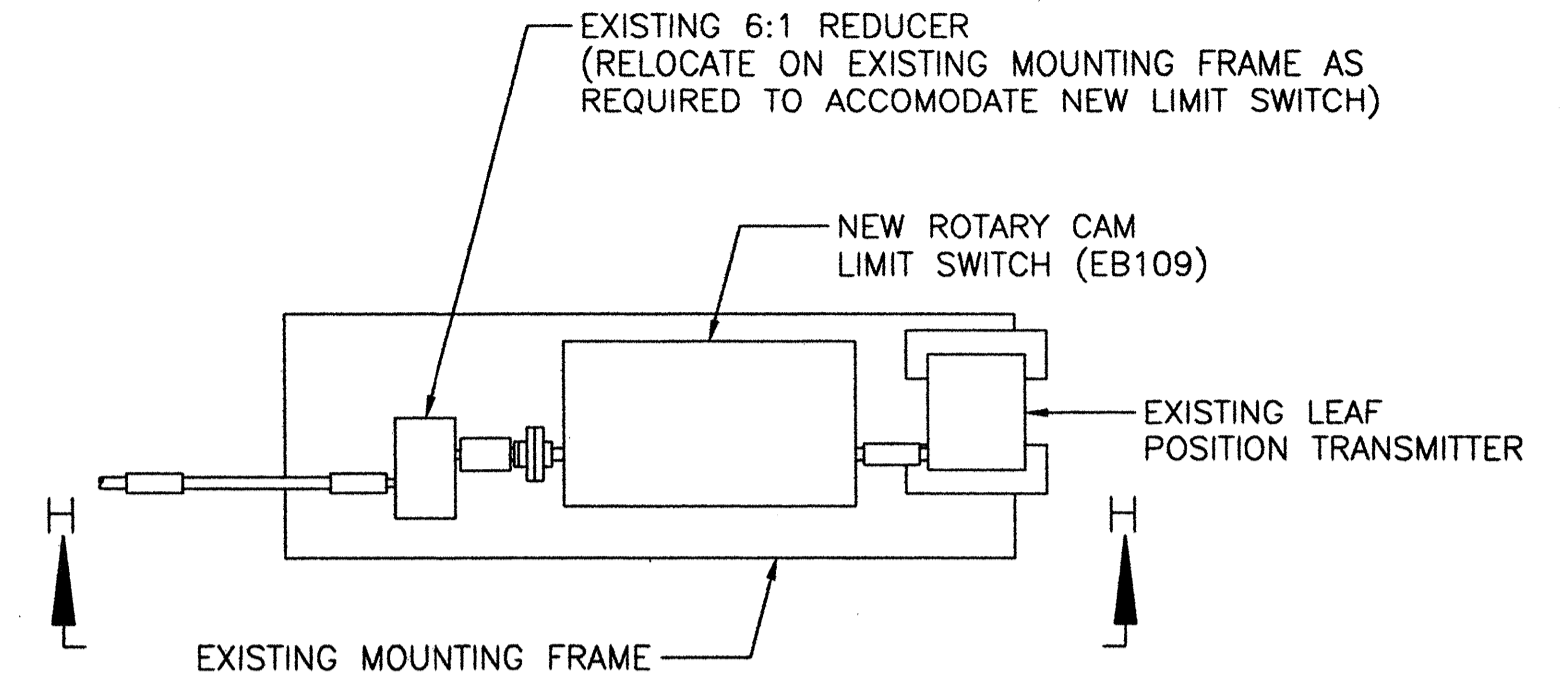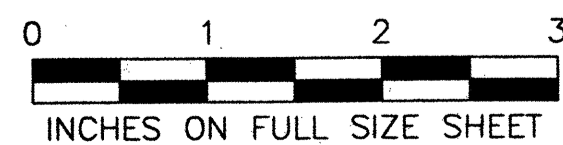

TYPICAL DETAIL - NEW ROTARY CAM LIMIT SWITCH

SCALE: NONE

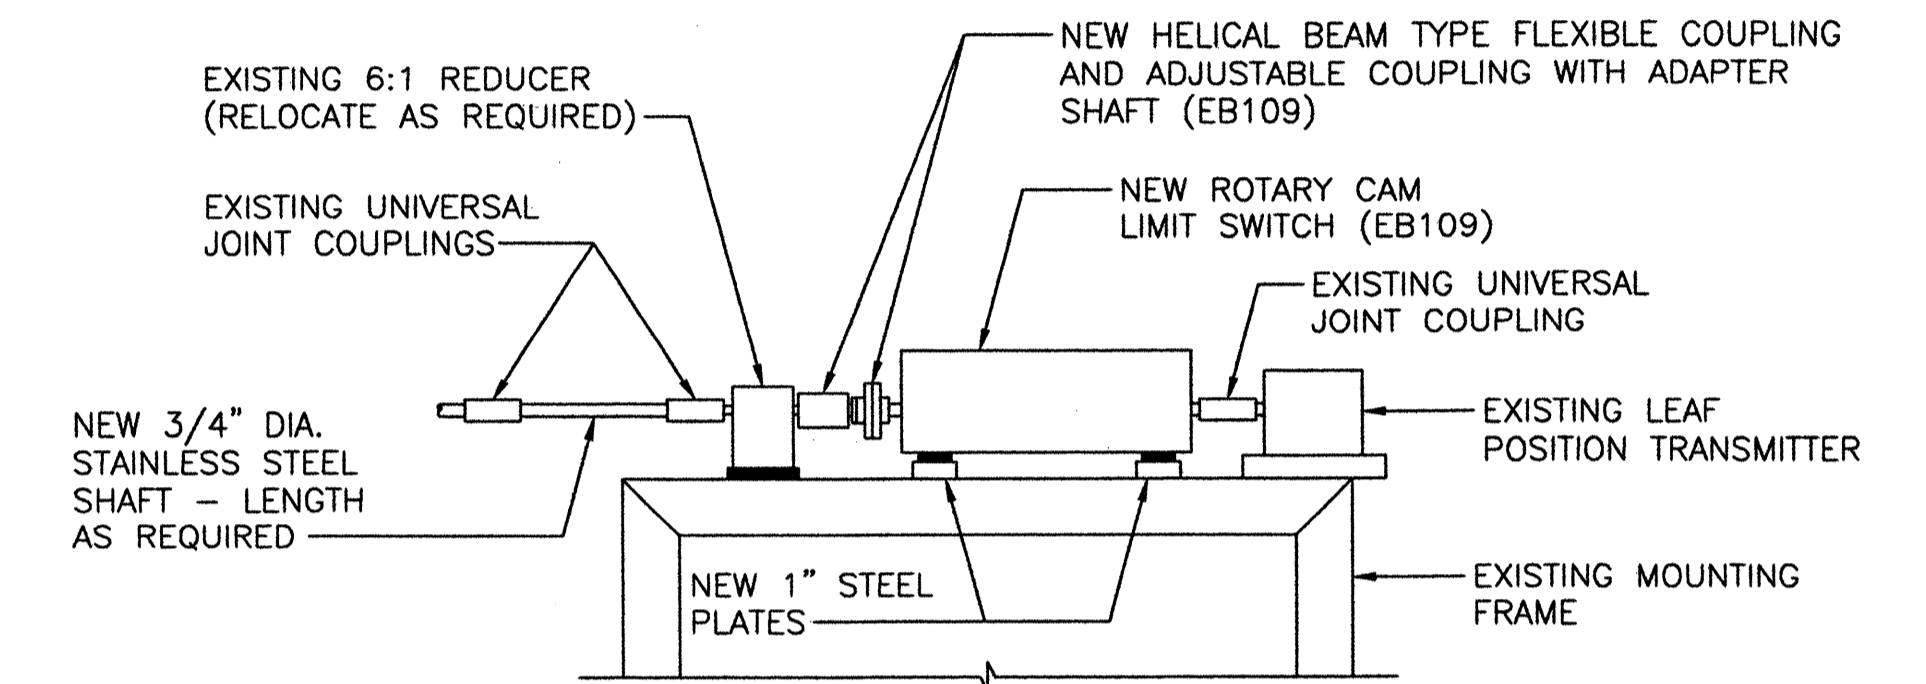

SECTION H-H


SCALE: NONE

SHIM REDUCER AND NEW LIMIT SWITCH WITH STAINLESS STEEL SHIMS AS REQUIRED FOR PROPER ALIGNMENT OF ALL COMPONENTS. MECHANICAL INSTALLATION AND ALIGNMENT OF ALL COMPONENTS SHALL BE BY PROPERLY QUALIFIED MACHINISTS.

YELLOW MOLDED FIBERGLASS GRATING 1-1/2" HEIGHT, 1-1/2" SQUARE MESH, UV RESISTANT, WITH NON-SLIP QUARTZ GRIT SURFACE

6" x 1-11/16" x 3/8" FIBERGLASS STRUCTURAL CHANNEL


CONCRETE MACHINERY DECK FLOOR 1/2" DIA. WEDGE STUD TYPE CONCRETE ANCHOR WITH MATCHING WASHER AND HEX NUT AT MAX 12" CENTERS (TYP.)

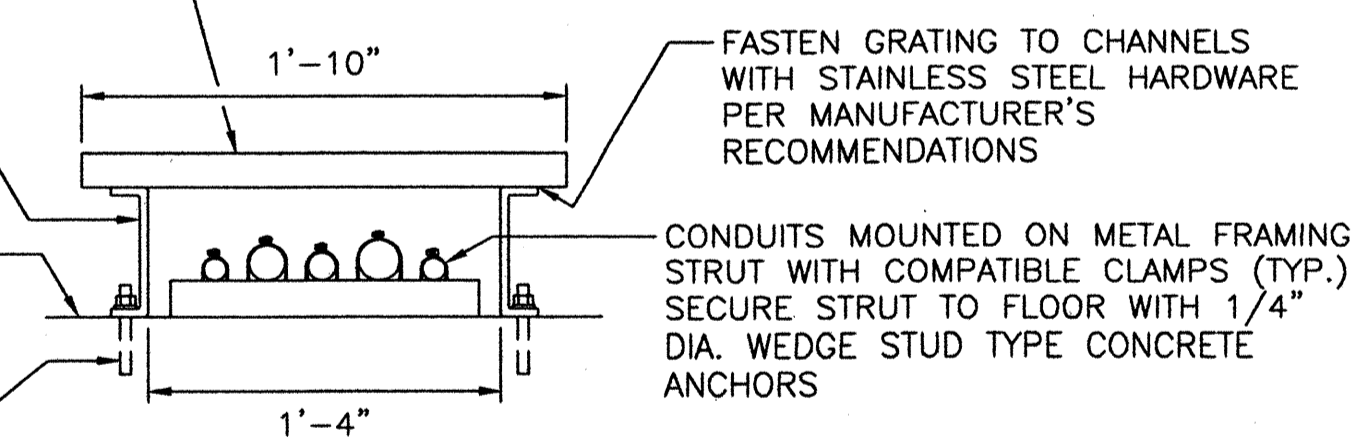


TYPICAL CROSS-SECTION - CONDUITS ON FLOOR

SCALE: 1-1/2" = 1'-0"

FIBERGLASS GRATING AND CHANNEL SHALL BE AS MANUFACTURED BY MCNICHOLS COMPANY (TAMPA, FL), OR APPROVED EQUAL. METAL FRAMING STRUT AND CONDUIT CLAMPS SHALL BE TYPE 316 STAINLESS STEEL, SIMILAR TO COOPER B-LINE B22.

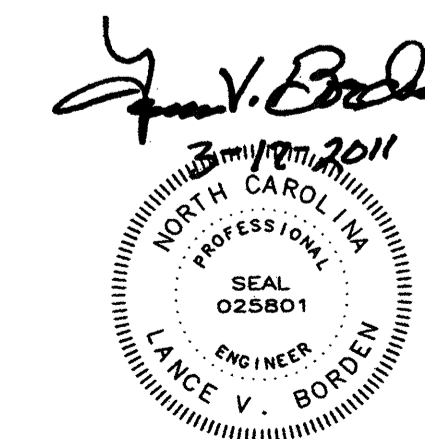

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE			
WILMINGTON, NORTH CAROLINA			
ELECTRICAL PLANS AND DETAILS - 3			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	31 OF 63

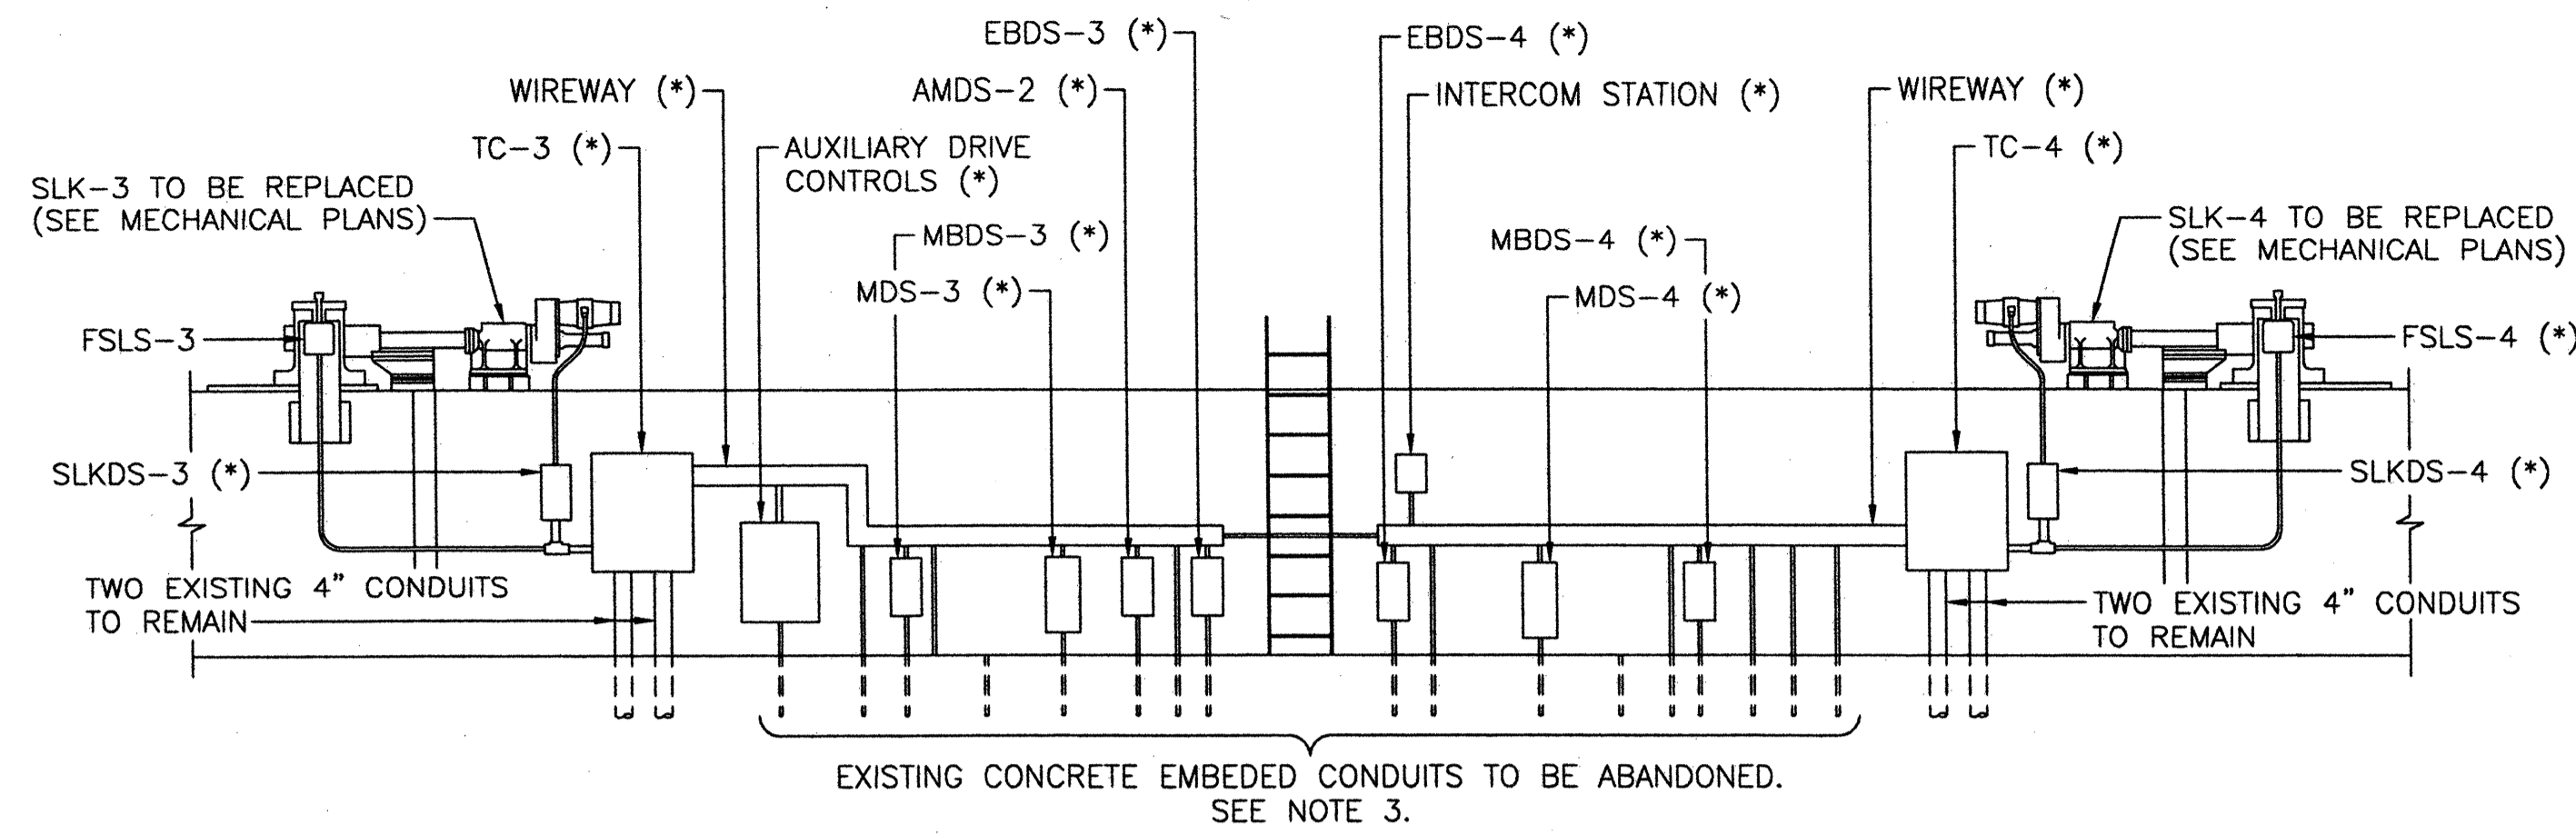


SECTION G-G - EXISTING

SCALE: 1/4" = 1'-0"

ITEMS MARKED WITH (*) ARE TO BE REMOVED. ALL CONDUITS SHOWN SHALL BE REMOVED, EXCEPT FOR THE EXISTING 4" CONDUITS ENTERING THE BOTTOM OF TERMINAL CABINETS TC-3 AND -4.

EXISTING LIGHTS AND RECEPTACLES TO BE REMOVED ARE NOT SHOWN.

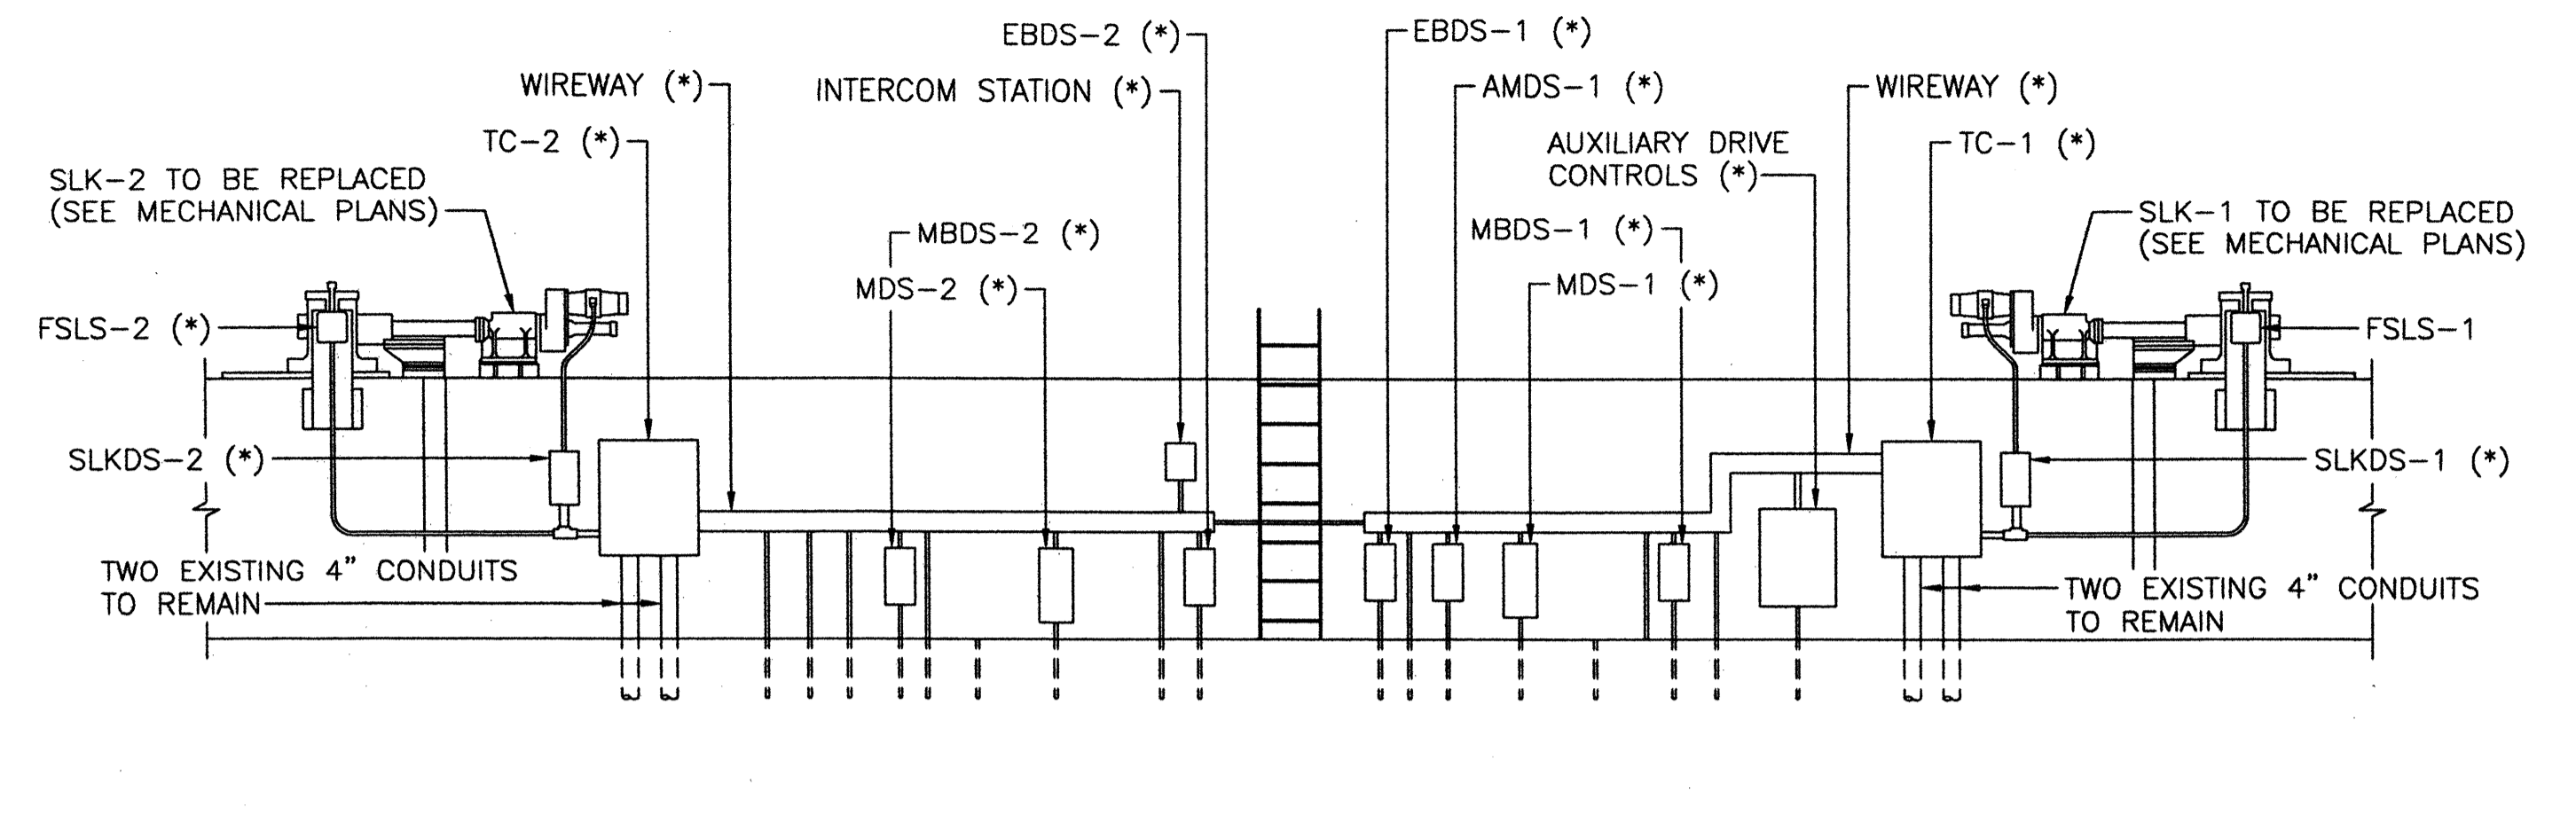


SECTION F-F - EXISTING

SCALE: 1/4" = 1'-0"

ITEMS MARKED WITH (*) ARE TO BE REMOVED. ALL CONDUITS SHOWN SHALL BE REMOVED, EXCEPT FOR THE EXISTING 4" CONDUITS ENTERING THE BOTTOM OF TERMINAL CABINETS TC-1 AND -2.

EXISTING LIGHTS AND RECEPTACLES TO BE REMOVED ARE NOT SHOWN.

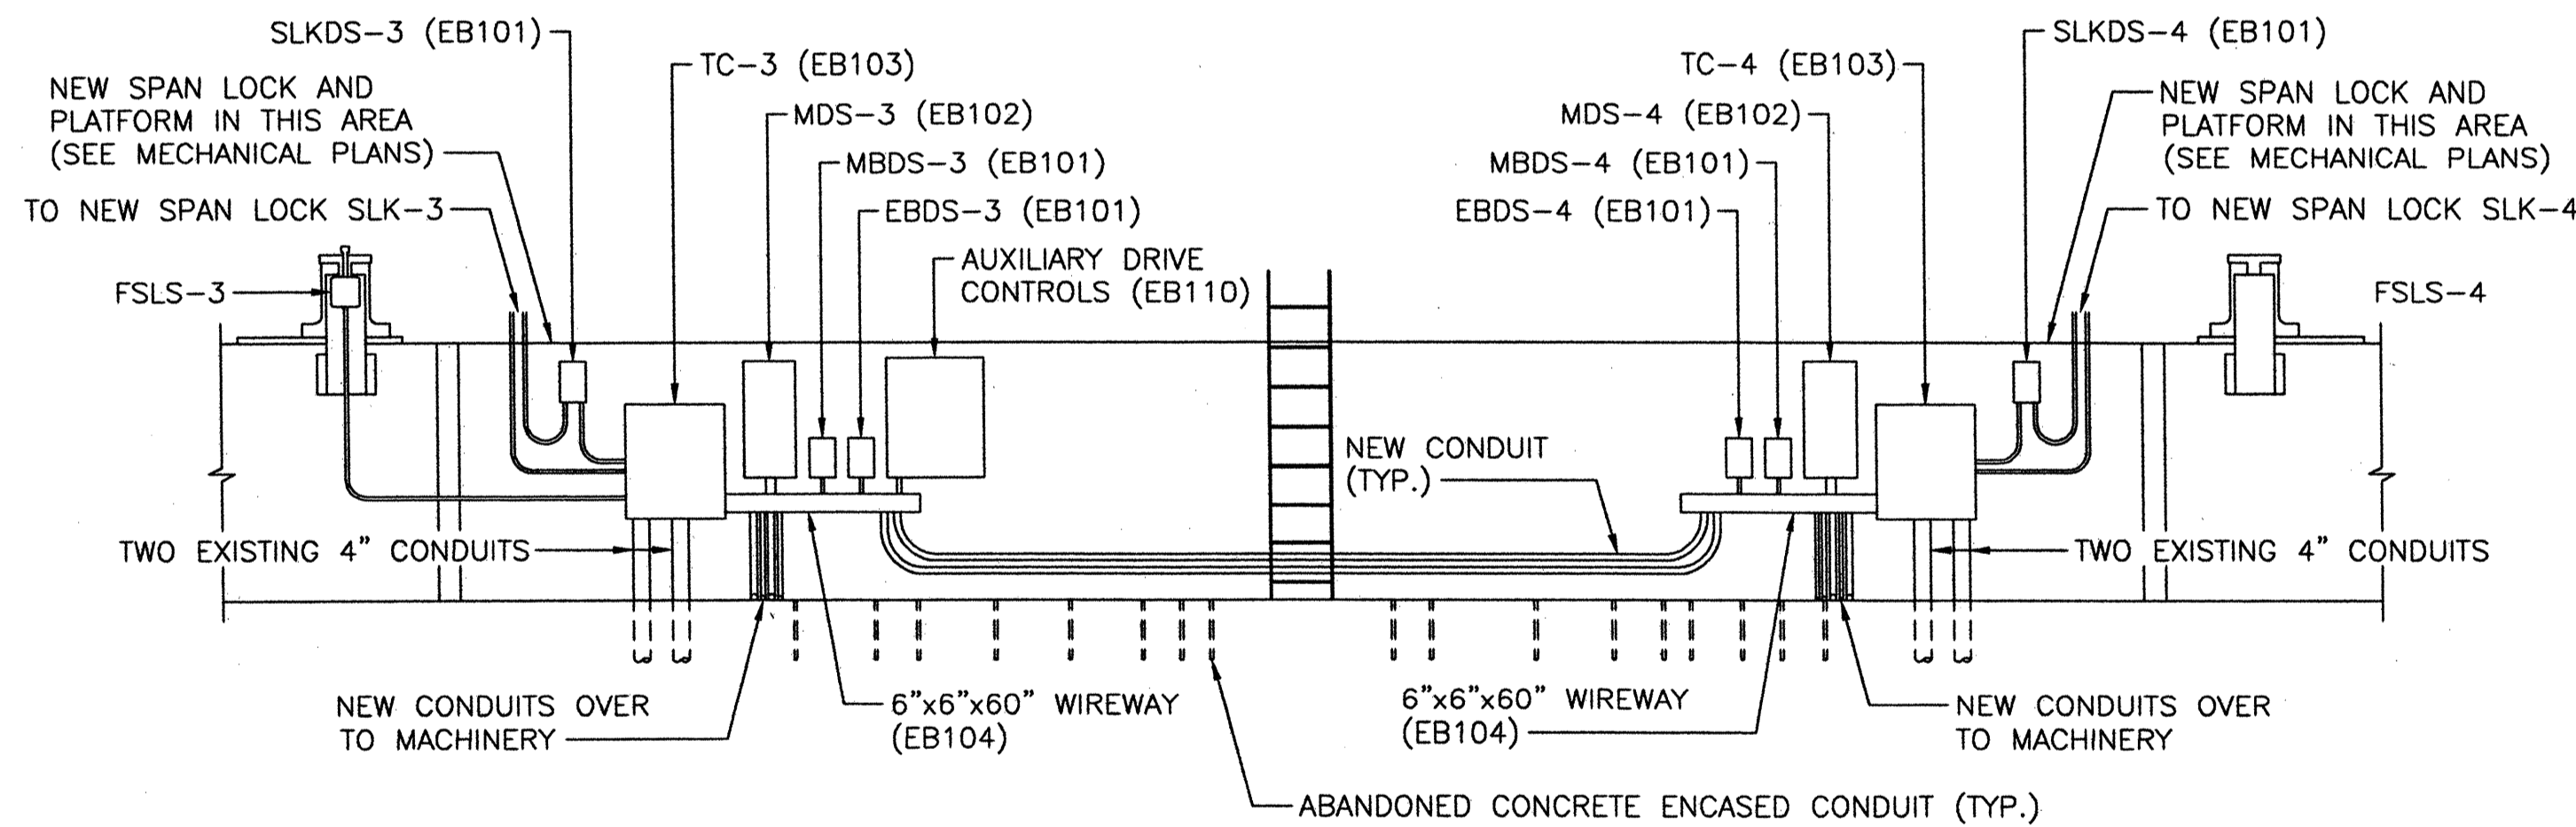


SECTION G-G - NEW

SCALE: 1/4" = 1'-0"

ITEMS MARKED WITH "EB" NUMBERS ARE NEW ELECTRICAL EQUIPMENT. ITEMS MARKED WITH (MB) ARE MECHANICAL ITEMS; REFER TO THE MECHANICAL PLANS. ALL OTHER ITEMS ARE EXISTING TO REMAIN. ALL CONDUITS ARE NEW, EXCEPT AS NOTED.

NEW LIGHTS AND RECEPTACLES ARE NOT SHOWN.

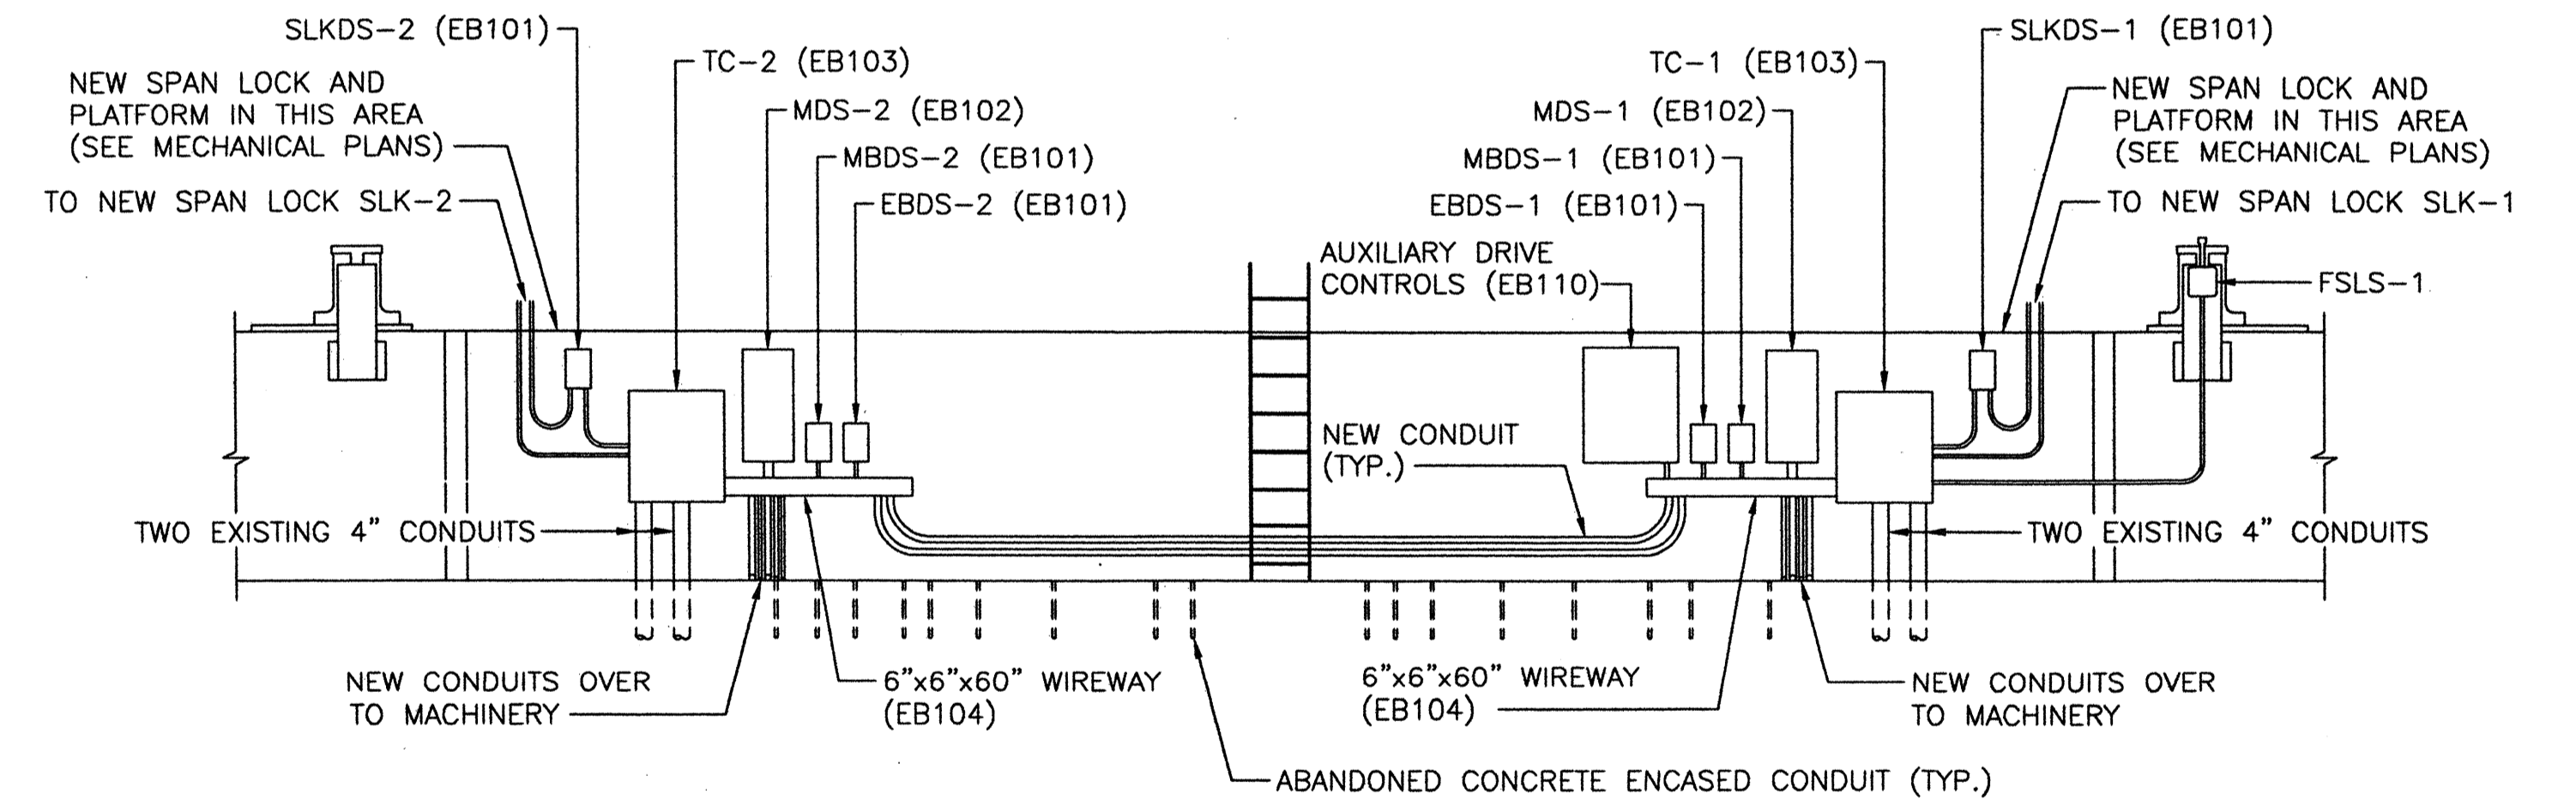

SECTION F-F - NEW



SCALE: 1/4" = 1'-0"

ITEMS MARKED WITH "EB" NUMBERS ARE NEW ELECTRICAL EQUIPMENT. ITEMS MARKED WITH (MB) ARE MECHANICAL ITEMS; REFER TO THE MECHANICAL PLANS. ALL OTHER ITEMS ARE EXISTING TO REMAIN. ALL CONDUITS ARE NEW, EXCEPT AS NOTED.

NEW LIGHTS AND RECEPTACLES ARE NOT SHOWN.


NOTES:

- SEE SHEET EB5 FOR LOCATIONS OF SECTIONS F-F AND G-G.
- ARRANGEMENTS OF NEW ELECTRICAL EQUIPMENT AND CONDUITS SHOWN ARE CONCEPTUAL; ACTUAL ARRANGEMENTS SHALL BE DETERMINED BY THE CONTRACTOR.
- CONCRETE ENCASED CONDUITS WHICH ARE TO BE ABANDONED SHALL BE CUT-OFF FLUSH WITH THE CONCRETE AND CAPPED WITH NON-SHRINK GROUT.
- ALL NEW RIGID CONDUITS AT MACHINERY DECK SHALL BE PVC COATED RMC; ALL NEW FLEXIBLE CONDUITS SHALL BE LFMC.
- SEE SHEET EB19 FOR DEVICE DESIGNATIONS.

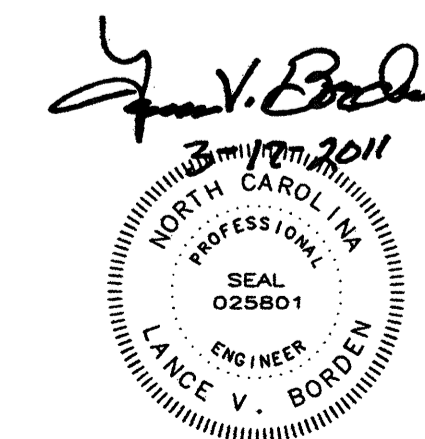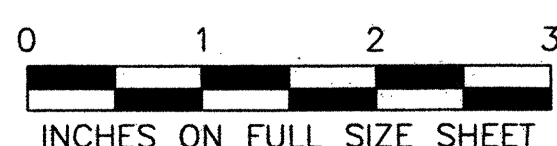


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL PLANS AND DETAILS - 4			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	32 OF 63


32-EBE-EPD.DWG

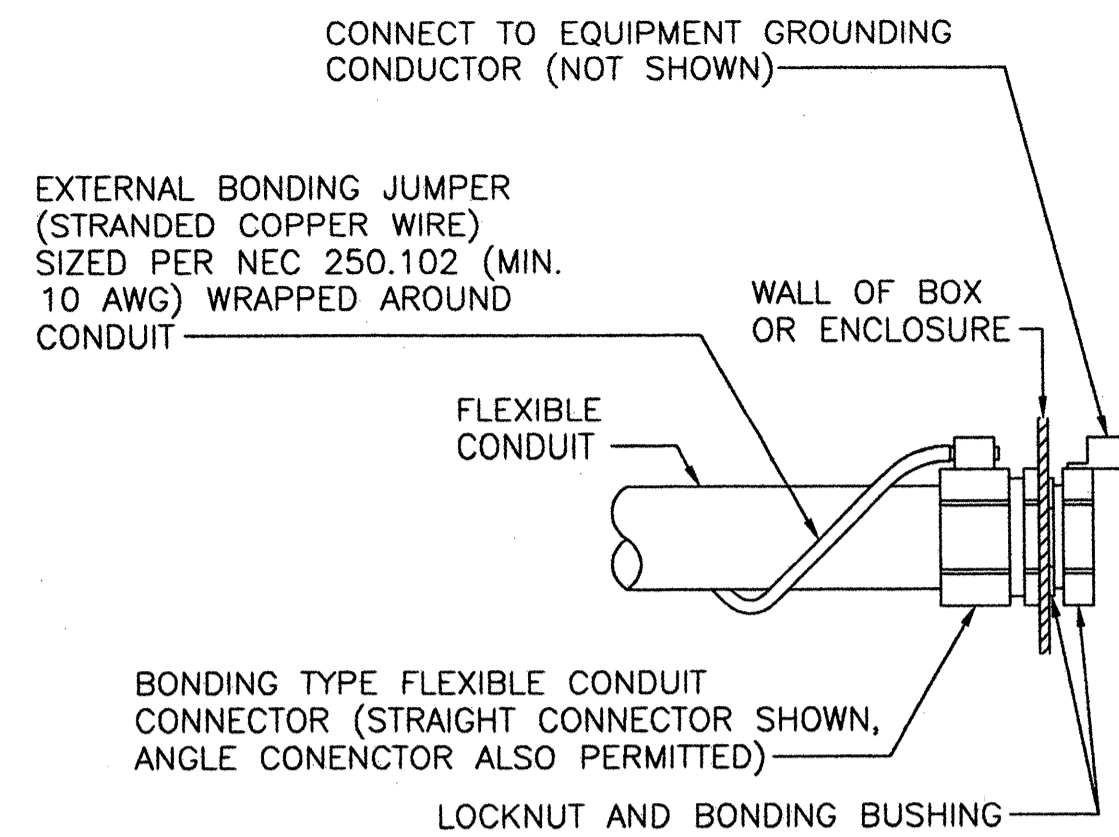

FLEXIBLE CONDUIT
(ALL LOCATIONS)

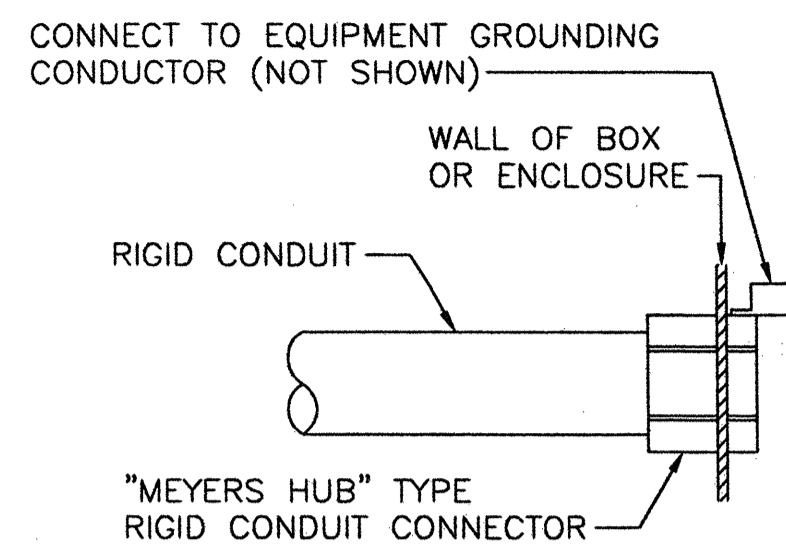

RIGID CONDUIT
(DAMP OR WET LOCATIONS)

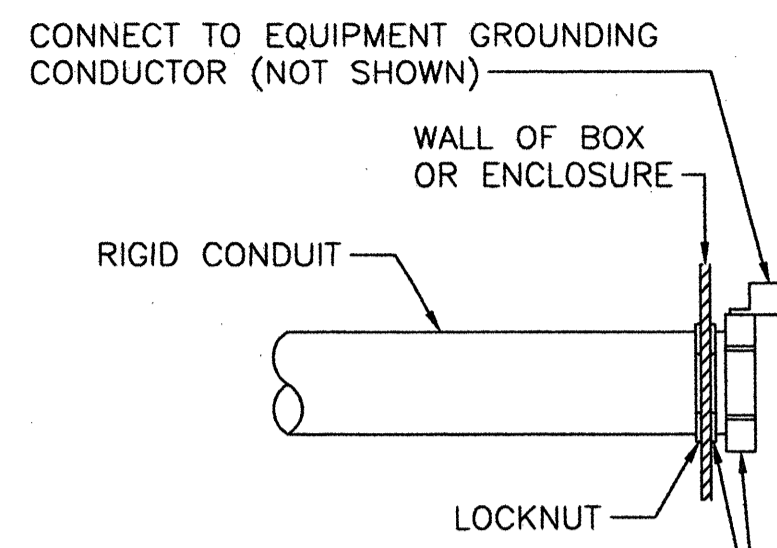

RIGID CONDUIT
(DRY LOCATIONS)


TYPICAL DETAILS - CONDUIT TERMINATIONS

SCALE: NONE

TERMINATIONS SHOWN ARE FOR BOXES OR ENCLOSURES WITHOUT INTEGRAL THREADED HUBS. TERMINATIONS FOR BOXES OR ENCLOSURES WITH INTEGRAL THREADED HUBS ARE SIMILAR, BUT WITHOUT LOCKNUTS, BONDING BUSHINGS, OR "MEYERS HUBS".

TERMINATIONS SHOWN ARE FOR TYPE RMC OR LFMC CONDUIT. TERMINATIONS FOR TYPE RNC OR LFNC ARE SIMILAR, BUT WITHOUT BONDING FITTINGS OR BUSHINGS.


FITTINGS FOR USE WITH PVC COATED RMC CONDUIT SHALL BE PVC COATED. FITTINGS FOR USE WITH LFMC CONDUIT IN WET LOCATIONS SHALL BE PVC COATED. FITTINGS FOR USE WITH RNC OR LFNC CONDUIT SHALL BE NON-METALLIC.

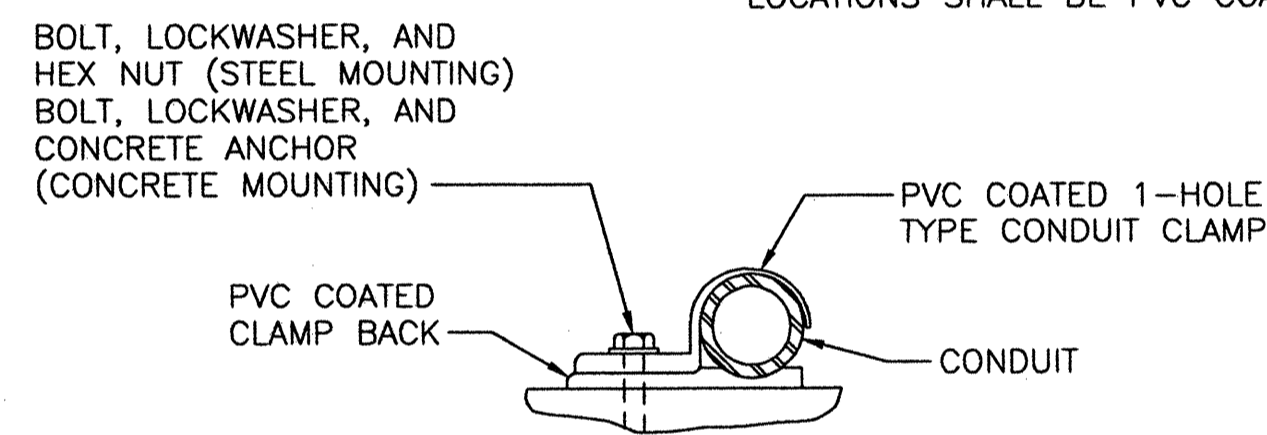

TYPICAL DETAIL - CONDUIT CLAMP
FOR TYPE RMC & LFMC CONDUIT

SCALE: NONE

ALL MOUNTING HARDWARE SHALL BE TYPE 316 STAINLESS STEEL.

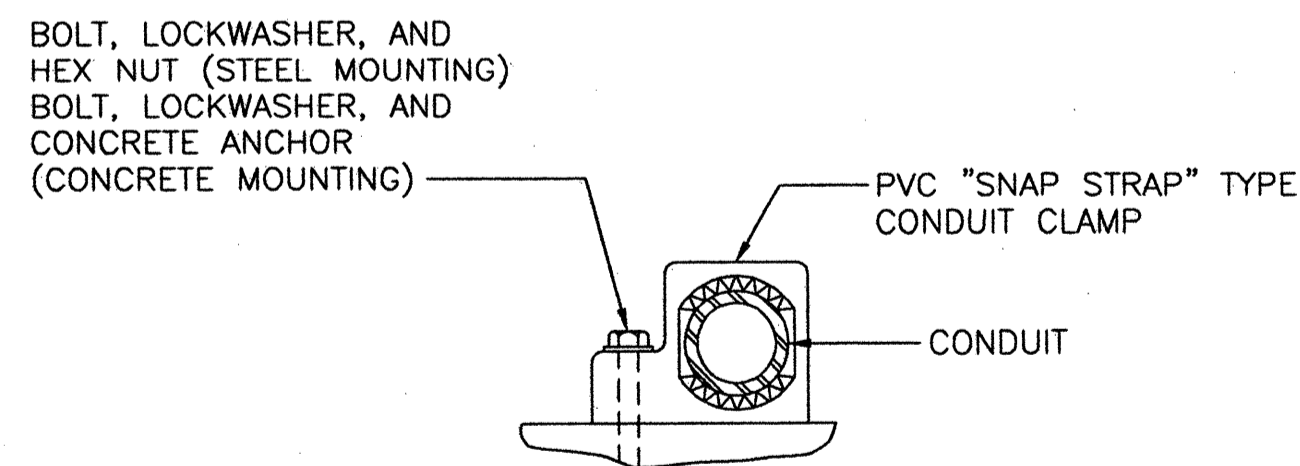



TYPICAL DETAIL - CONDUIT CLAMP
FOR TYPE RNC & LFNC CONDUIT

SCALE: NONE

ALL MOUNTING HARDWARE SHALL BE TYPE 316 STAINLESS STEEL.

NOTES:


- OBTAIN PERMISSION FROM THE ENGINEER PRIOR TO DRILLING OR CUTTING ANY STRUCTURAL ELEMENT.

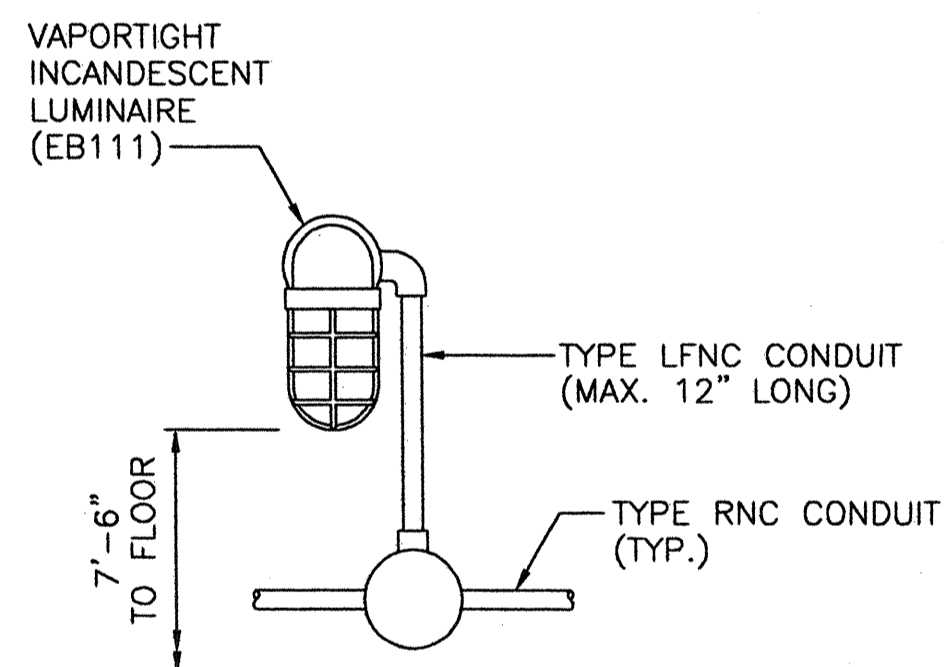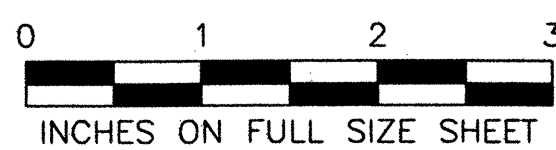

TYPICAL DETAIL - WALL MOUNTED
LUMINAIRE

SCALE: NONE

ALL MOUNTING HARDWARE SHALL BE TYPE 316 STAINLESS STEEL.

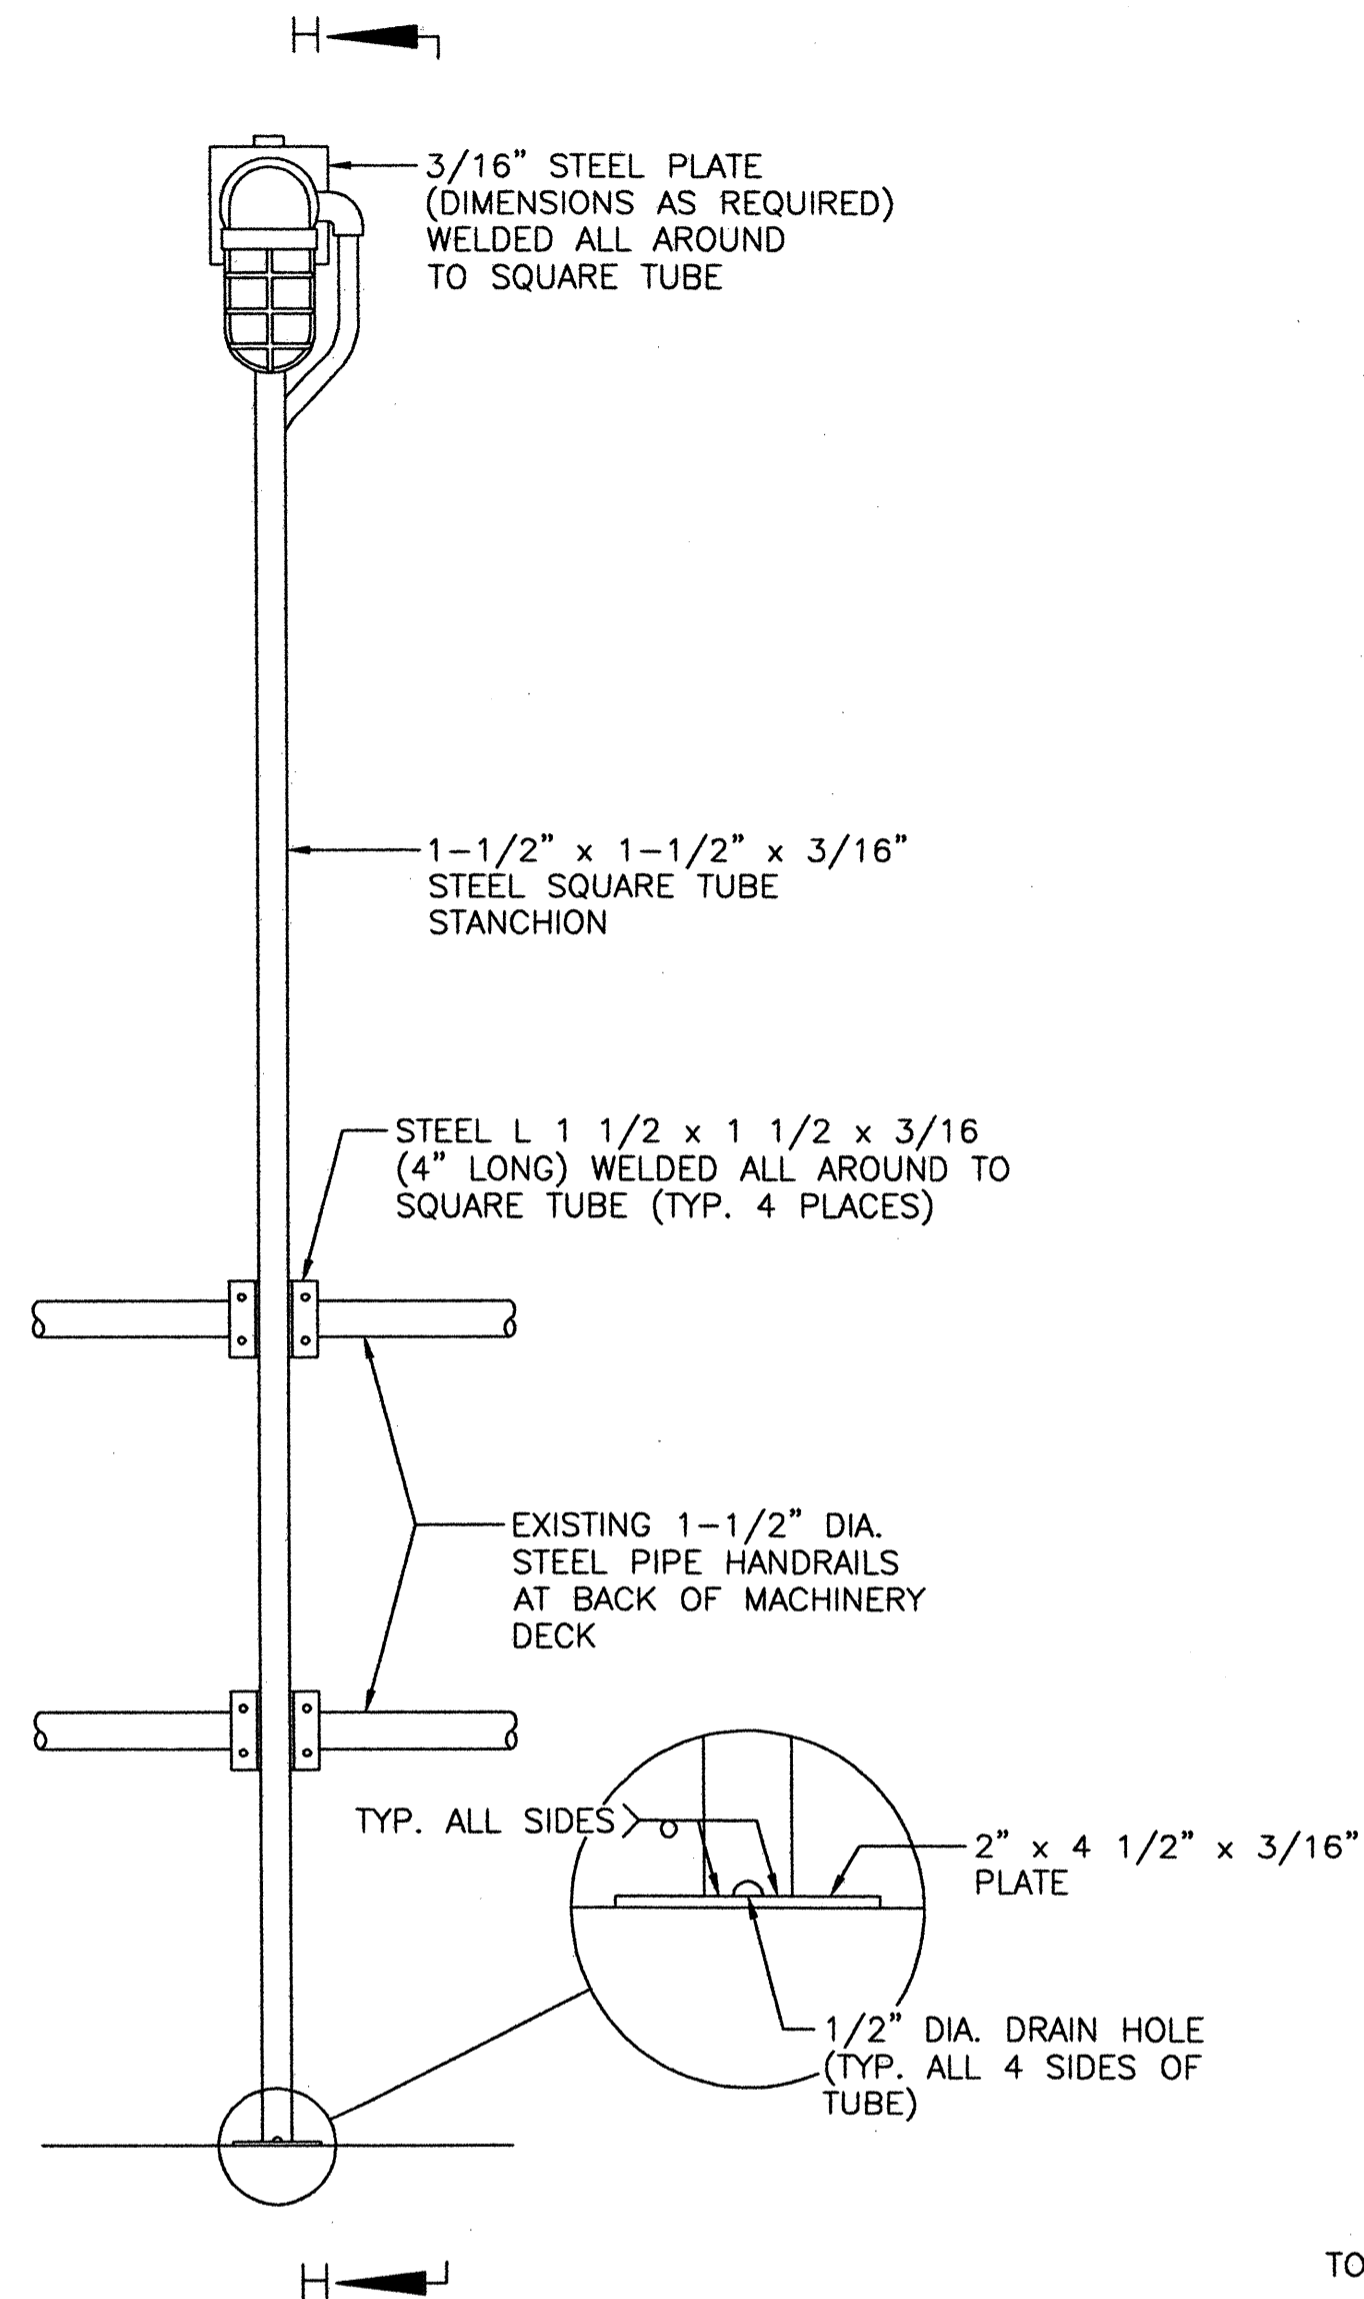


TYPICAL DETAIL - MACHINERY PLATFORM
STANCHION MOUNTED LUMINAIRE

SCALE: NONE

COMPLETE STANCHION ASSEMBLY, INCLUDING PLATES AND ANGLES, SHALL BE HOT-DIP GALVANIZED AFTER FABRICATION.


SQUARE TUBE, PLATE, AND ANGLES SHALL BE TYPE A36, OR EQUIVALENT, STEEL.

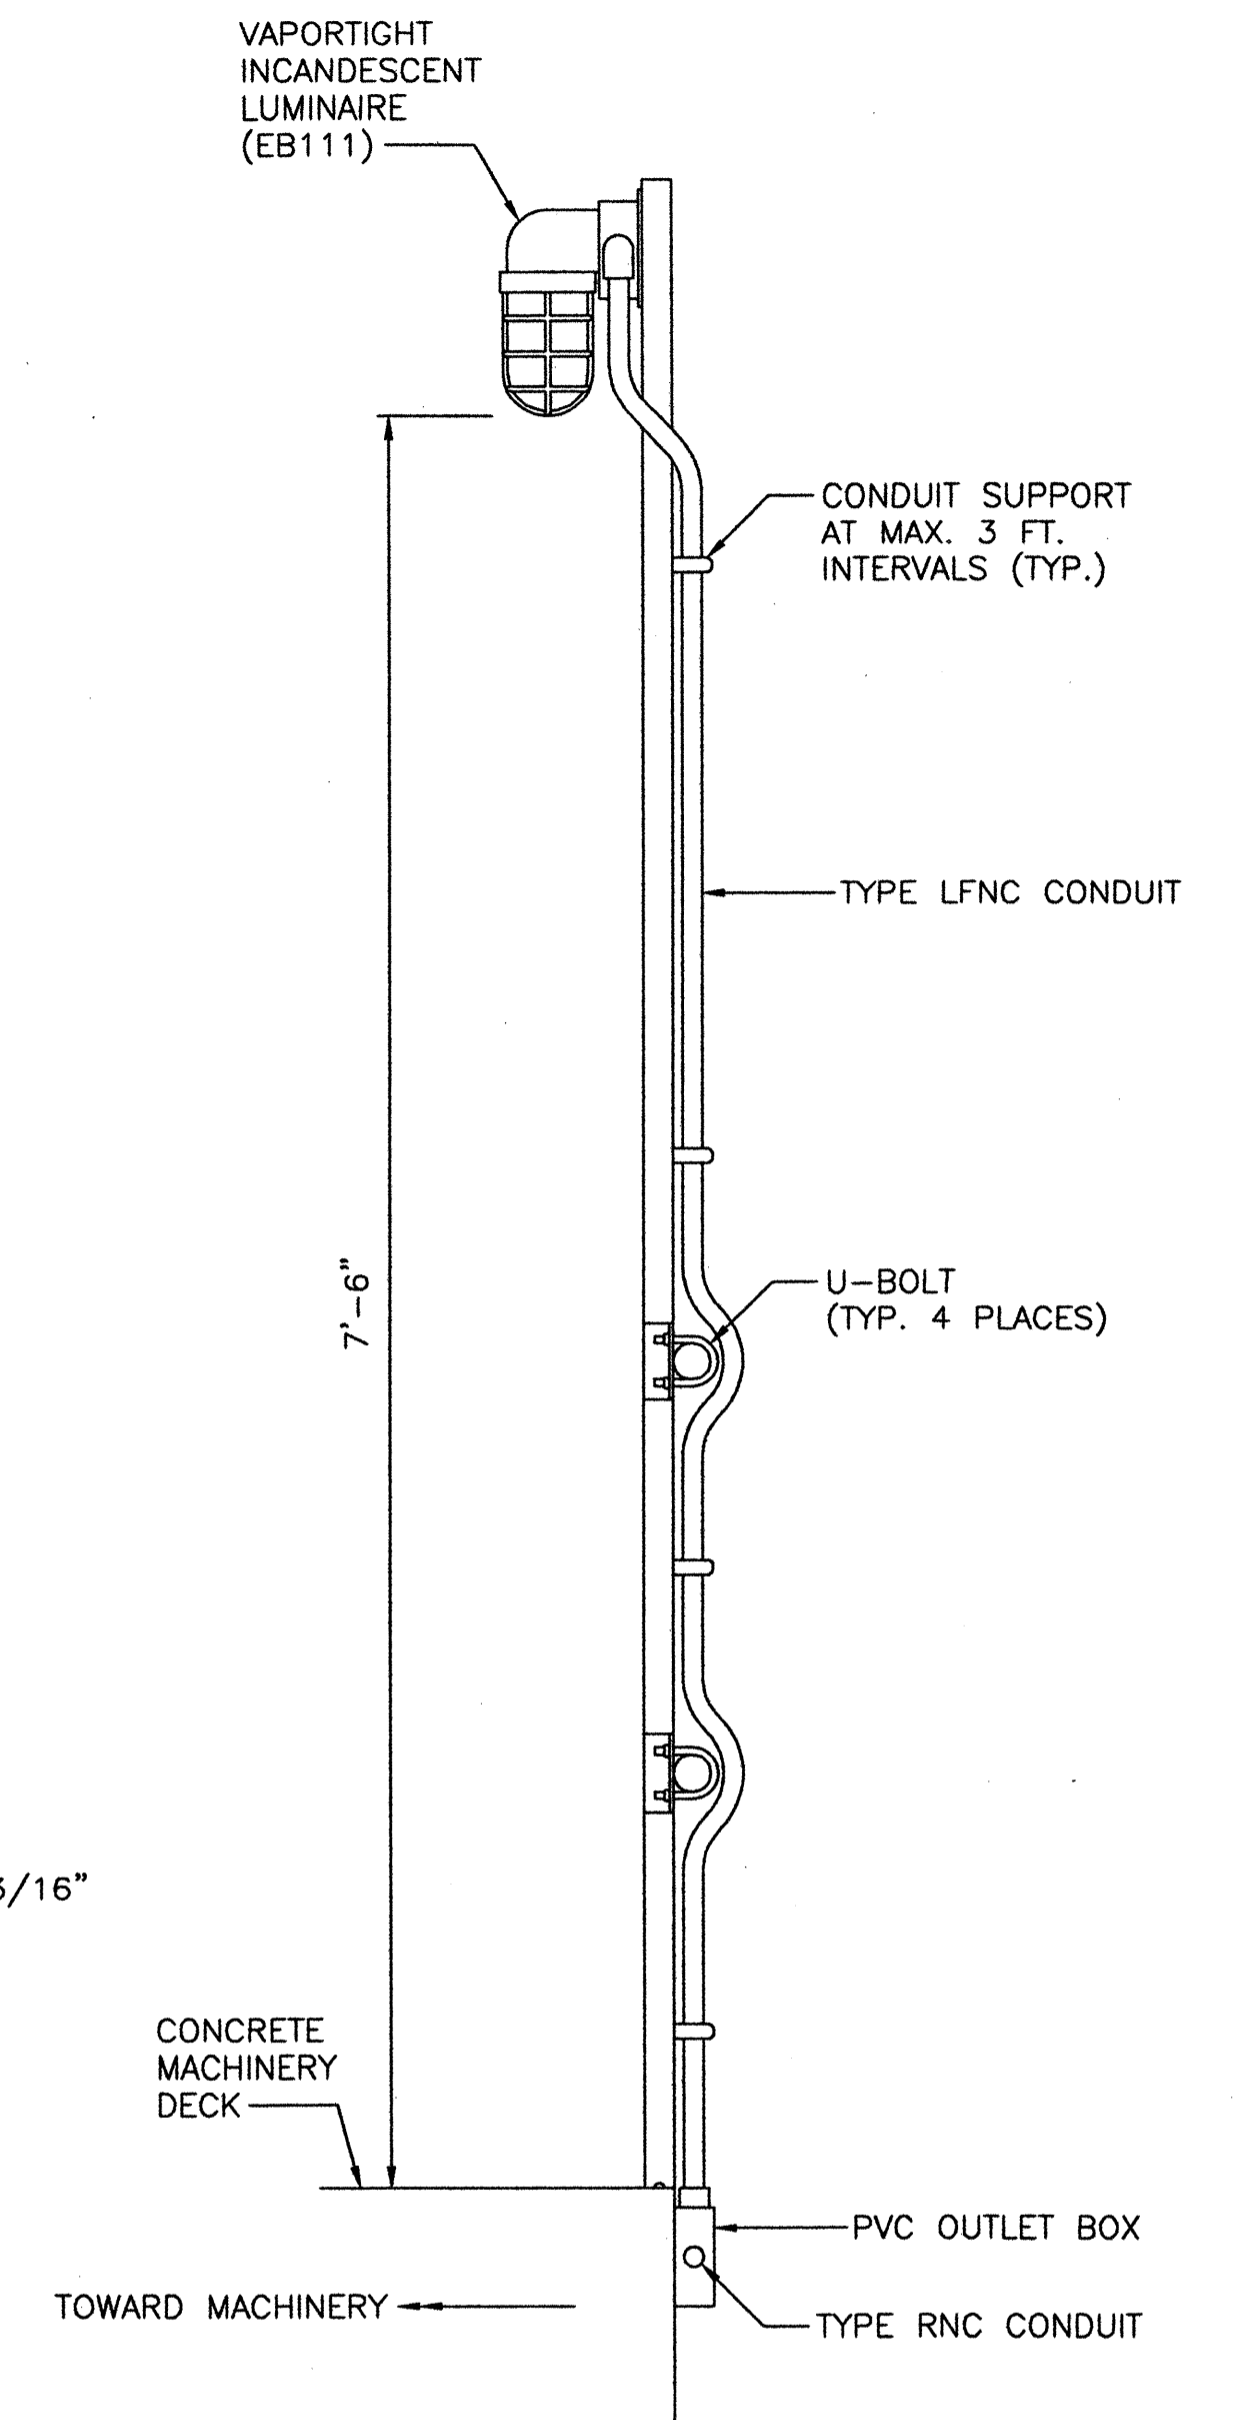

SECTION H-H

SCALE: NONE

U-BOLTS AND LUMINAIRE MOUNTING HARDWARE SHALL BE TYPE 316 STAINLESS STEEL.

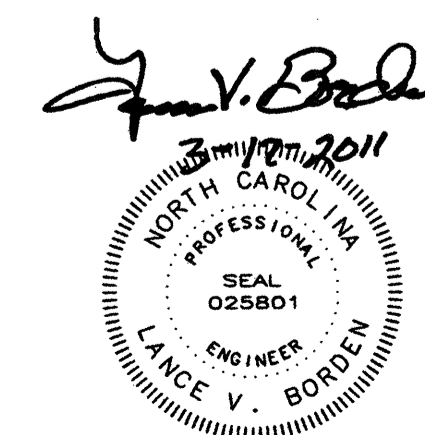


STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA

ELECTRICAL PLANS AND DETAILS - 5

DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	33 OF 63
DRAWN BY	N.E. ALGER	SCALE	AS NOTED


EXISTING CENTER LOCK MACHINER IN THIS AREA TO BE REPLACED WITH NEW (SEE MECHANICAL PLANS)

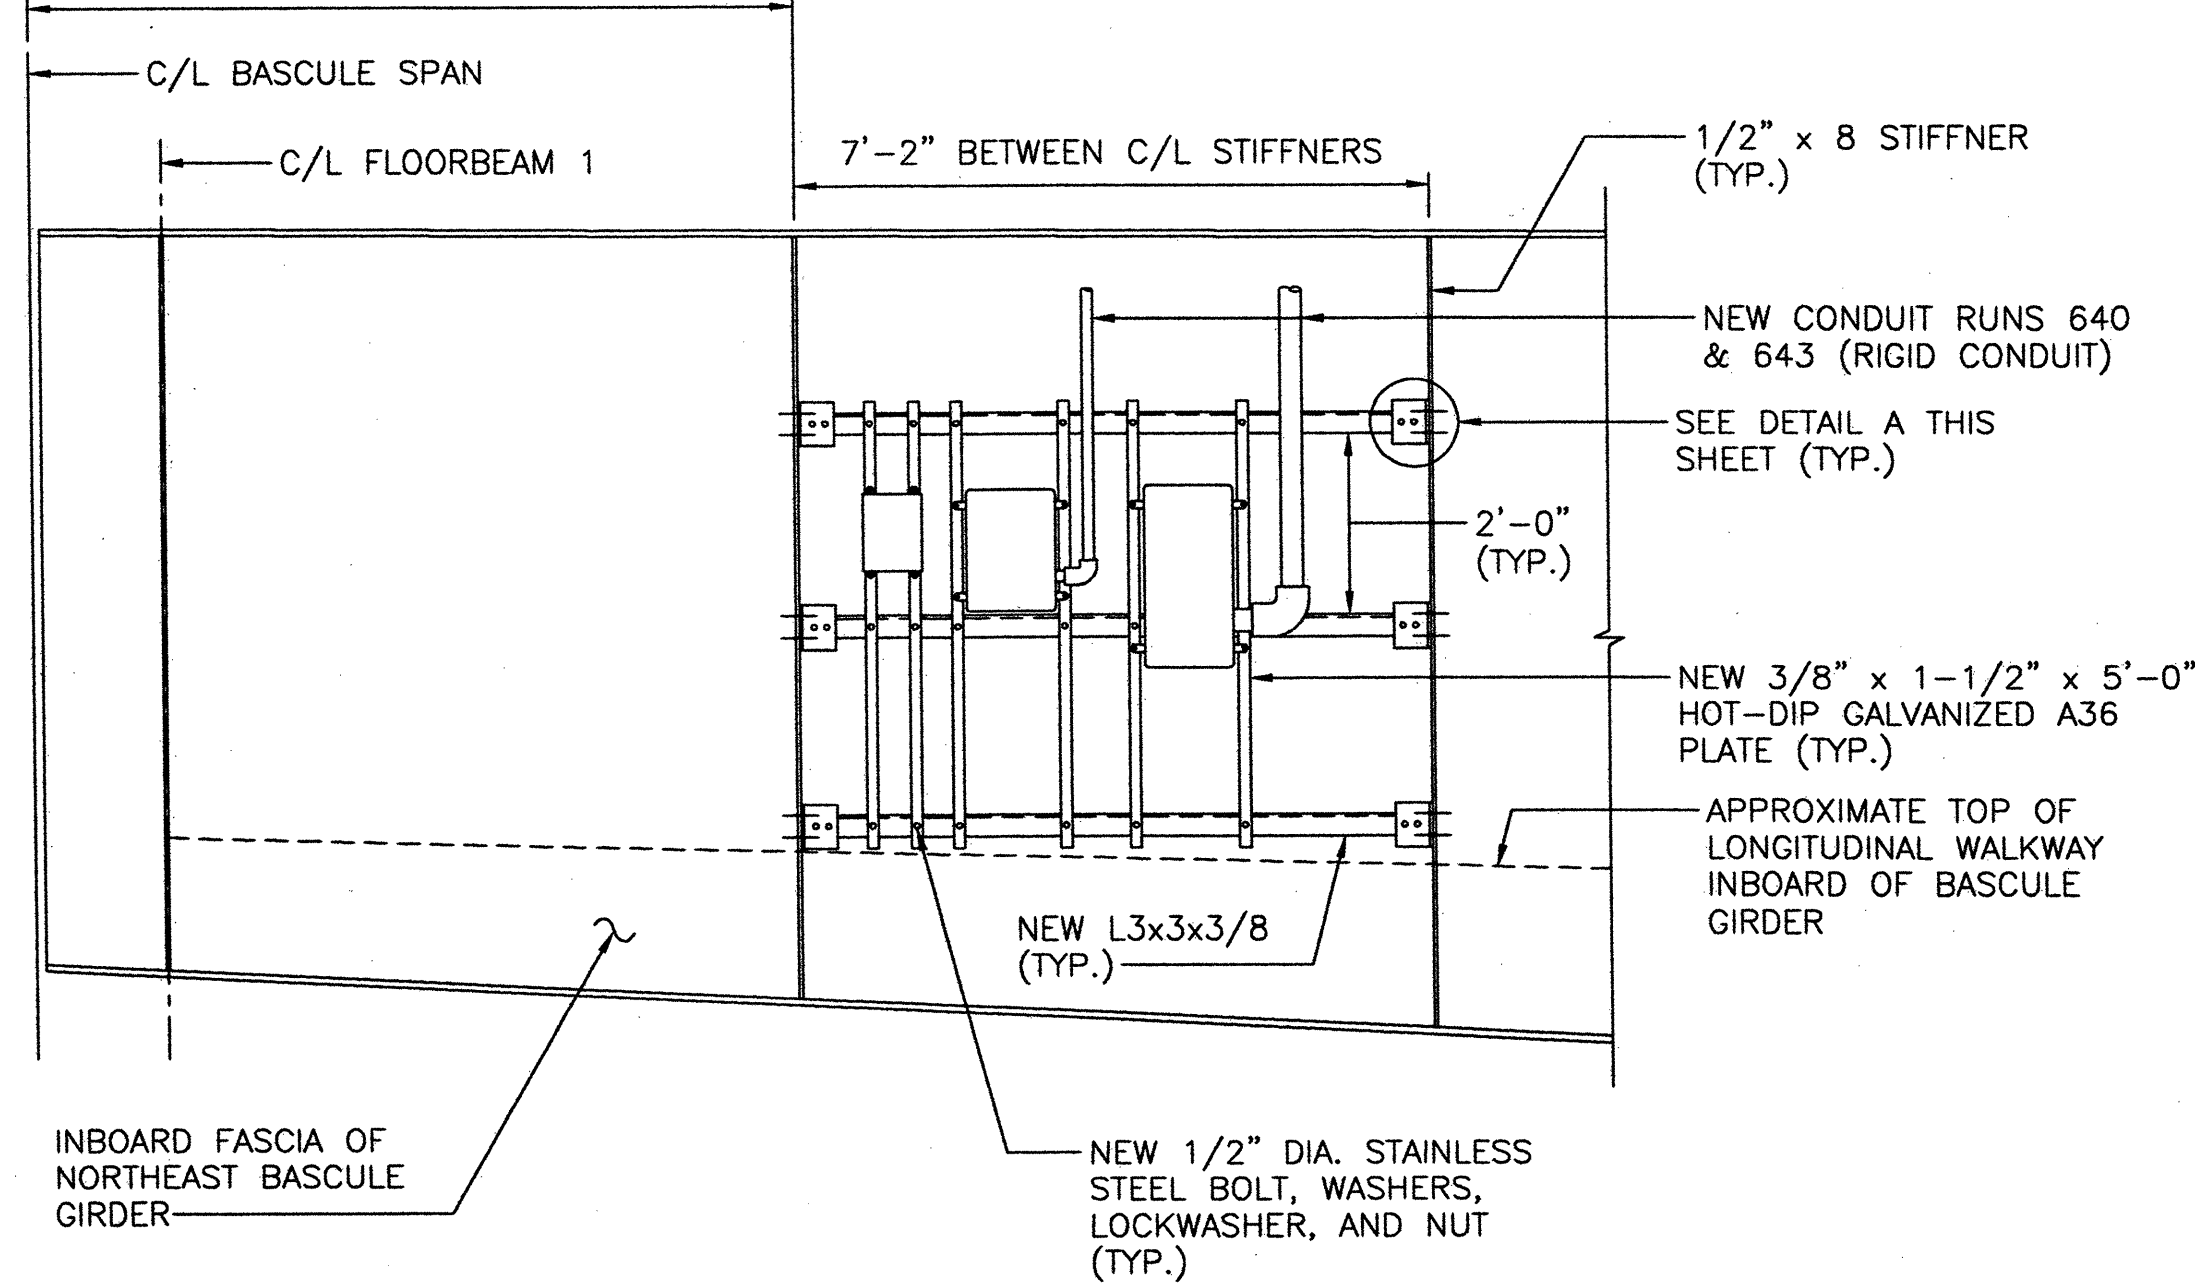

ELEVATION - CENTER LOCK ELECTRICAL EQUIPMENT


SCALE: 1/2" = 1'-0"

EQUIPMENT AT NORTHEAST BASCULE GIRDER SHOWN. EQUIPMENT AT SOUTHEAST BASCULE GIRDER SIMILAR, BUT OPPOSITE HAND. NOT ALL CONDUITS SHOWN. EXCEPT AS NOTED, ALL CONDUIT CONNECTIONS BETWEEN BOXES, ENCLOSURES, AND EQUIPMENT SHOWN IN THIS VIEW SHALL UTILIZE TYPE LFMC CONDUIT. ACTUAL ARRANGEMENT OF EQUIPMENT AND CONDUITS TO BE DETERMINED BY THE CONTRACTOR.

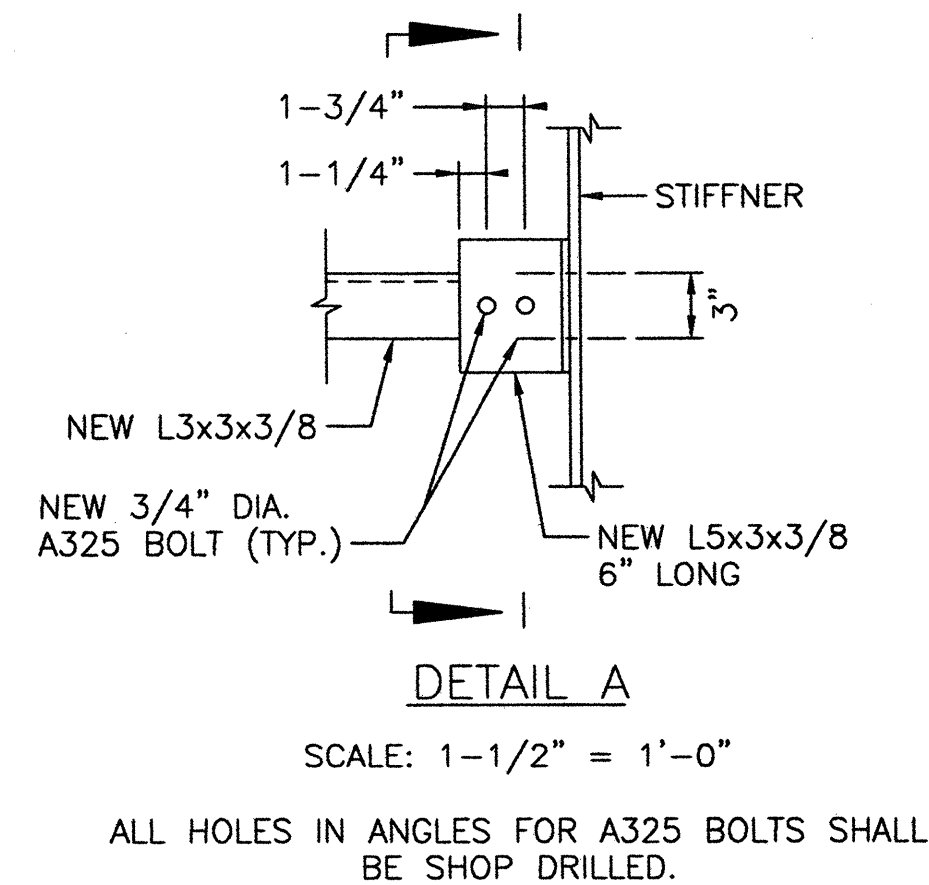

DETAIL A

SCALE: 1-1/2" = 1'-0"

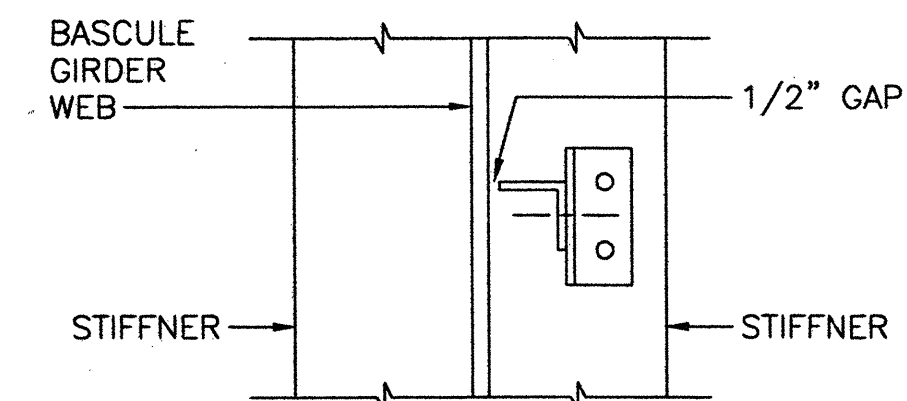


SECTION I-I

SCALE: 1-1/2" = 1'-0"

NOTES:


1. PRIOR TO STARTING WORK, THE CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS OF THE EXISTING STRUCTURE.
2. ALL WORK RELATED TO THE INSTALLATION OF NEW STRUCTURAL STEEL ELEMENTS (ANGLES, TEES, PLATES, ETC.) SHOWN ON THIS SHEET SHALL CONFORM TO THE REQUIREMENTS OF SECTION 440 (STEEL STRUCTURES) OF THE NCDOT STANDARD SPECIFICATIONS FOR ROADS AND STRUCTURES, AND BE PERFORMED BY QUALIFIED IRONWORKERS. ALL STRUCTURAL ELEMENTS SHALL BE SHOP AND FIELD PAINTED IN ACCORDANCE WITH THE REQUIREMENTS OF SECTION 442 (PAINTING STEEL STRUCTURES), EXCEPT WHERE HOT-DIP GALVANIZED.
3. UNLESS OTHERWISE NOTED, ALL STEEL PLATES AND SHAPES SHOWN ON THIS SHEET SHALL CONFORM TO ASTM A709, GRADE 50W. ASTM A588 MAY BE SUBSTITUTED FOR A709, GRADE 50W WITH THE APPROVAL OF THE ENGINEER AND AT NO ADDITIONAL COST TO THE DEPARTMENT. CVN TESTING IS NOT REQUIRED.
4. WHERE A325 BOLTS ARE INDICATED, THEY SHALL BE TYPE 3, WITH A563 GRADE C3 HEAVY HEX NUTS AND F436, TYPE 3 HARDENED WASHERS. A325 BOLTS, NUTS, AND WASHERS SHALL BE HOT-DIP GALVANIZED.
5. WHERE STAINLESS STEEL BOLTS AND/OR OTHER HARDWARE IS INDICATED, THEY SHALL BE TYPE 316. ALL ELECTRICAL BOXES AND OTHER EQUIPMENT SHALL BE MOUNTED USING STAINLESS STEEL BOLTS, NUTS, WASHERS, AND LOCKWASHERS.
6. PRIOR TO FASTENING NEW STRUCTURAL ELEMENTS TO EXISTING BRIDGE STRUCTURAL ELEMENTS, CLEAN AND RE-PAINT THE AREA ON THE EXISTING STRUCTURE WHICH WILL BE IN CONTACT WITH THE NEW ELEMENT. CLEANING SHALL BE WITH POWER TOOLS TO SSPC SP11 TO REMOVE RUST AND POOR COATING. NEW PAINT SHALL BE A THICK EPOXY MASTIC TOPCOAT (CARBOMASTIC 15 AS MANUFACTURED BY CARBOLINE, OR APPROVED EQUAL). NOTE THAT THE EXISTING STRUCTURE PAINT SYSTEM MAY BE LEAD BASED.
7. ALL RIGID CONDUIT ON BASCULE SPAN SHALL BE PVC COATED TYPE RMC; ALL FLEXIBLE CONDUIT SHALL BE TYPE LFMC.

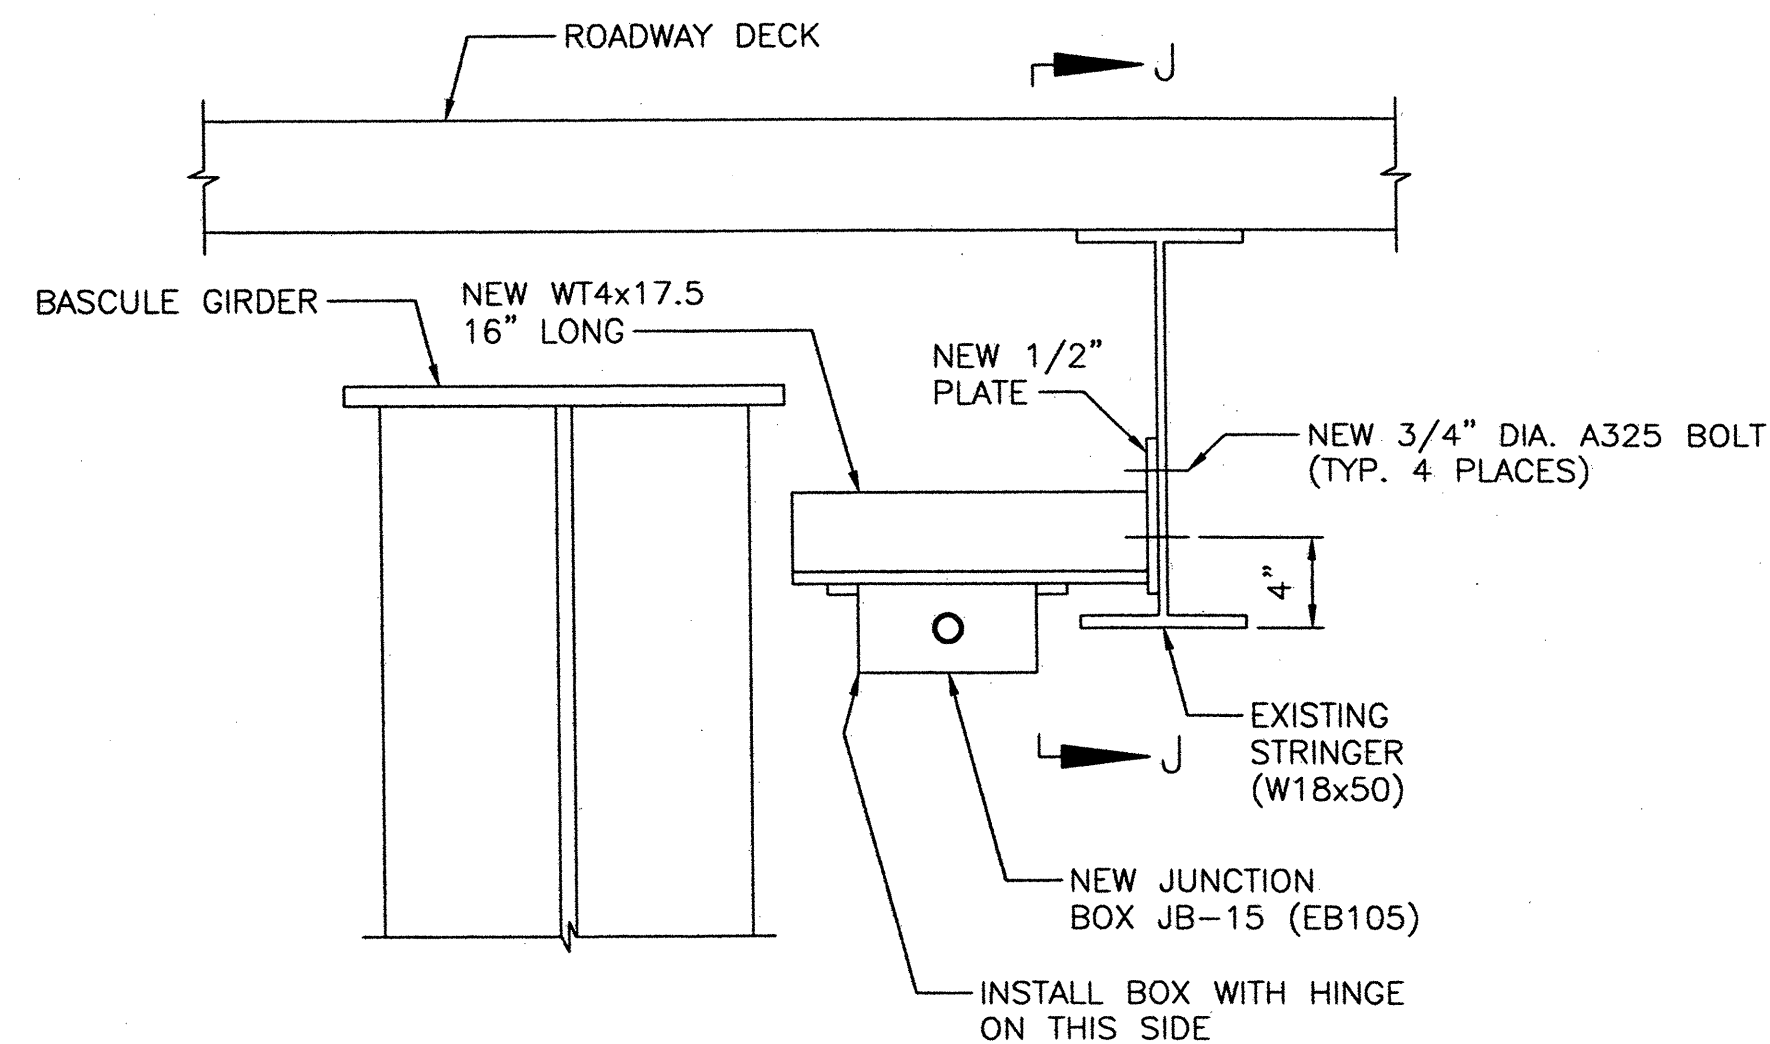

DETAIL - JB-15 MOUNTING

SCALE: 1-1/2" = 1'-0"



PLATE AND WT SHALL BE SHOP DRILLED FOR ALL REQUIRED HOLES (A325 BOLTS AND BOX MOUNTING BOLTS)

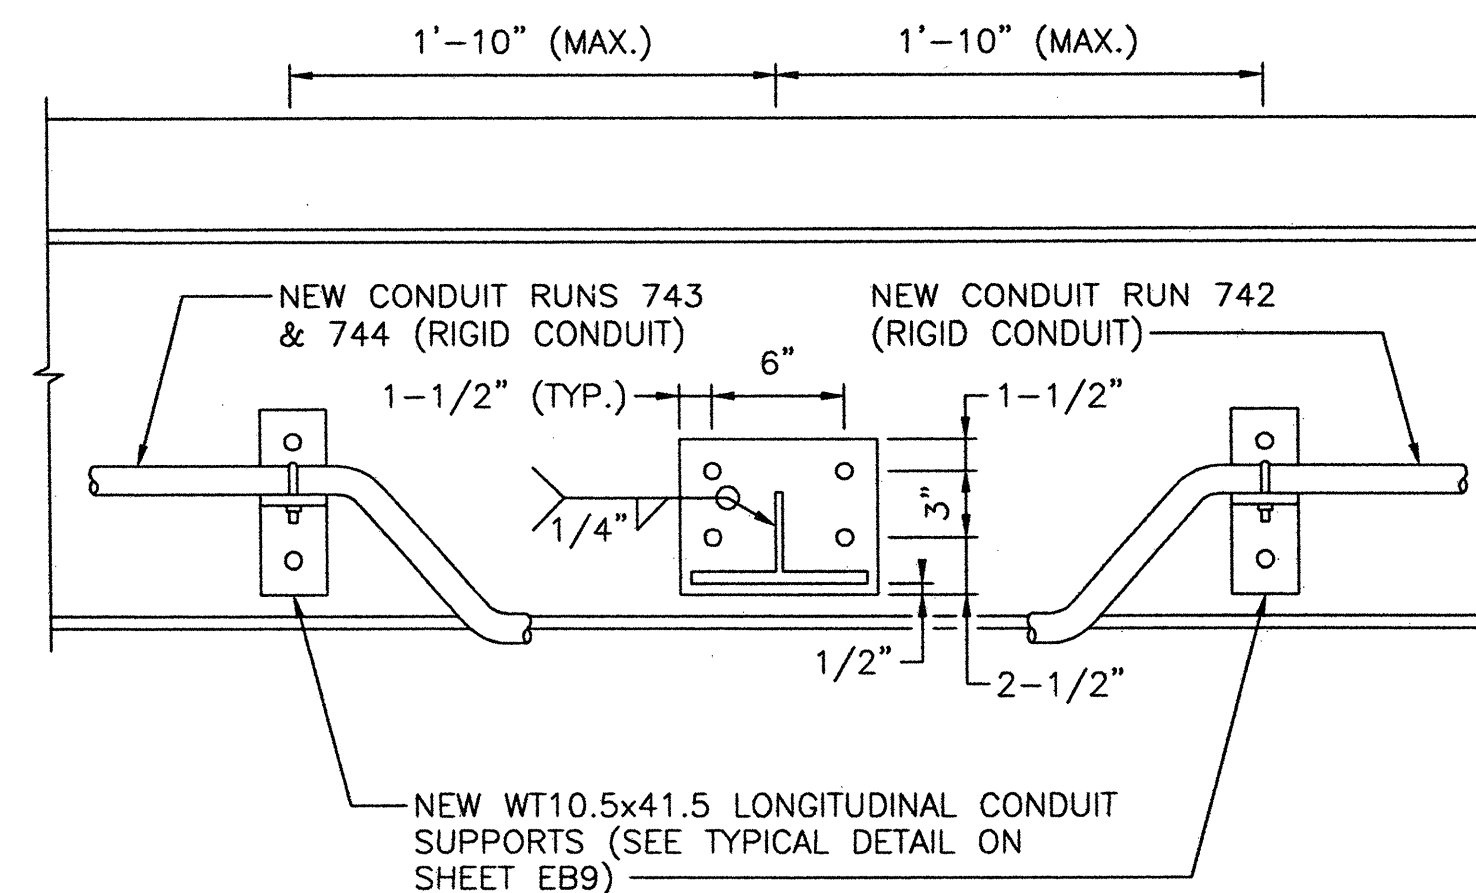

SECTION J-J


SCALE: 1-1/2" = 1'-0"

JUNCTION BOX NOT SHOWN FOR CLARITY.

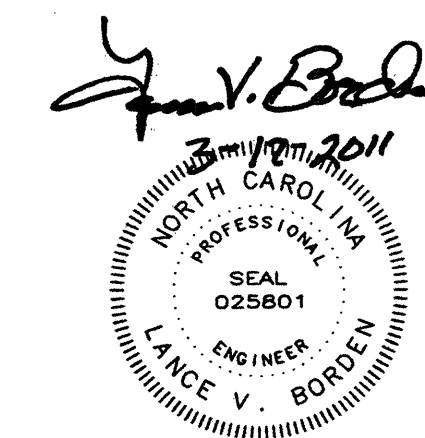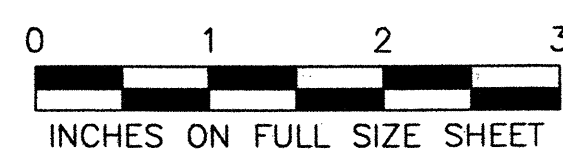

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL PLANS AND DETAILS - 6			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	CHECKED	Q.C. TON
DRAWN BY		N.E. ALGER	
SCALE		AS NOTED	
DRAWING NO. 34 OF 63			

34-EBB-EPDG.DWG

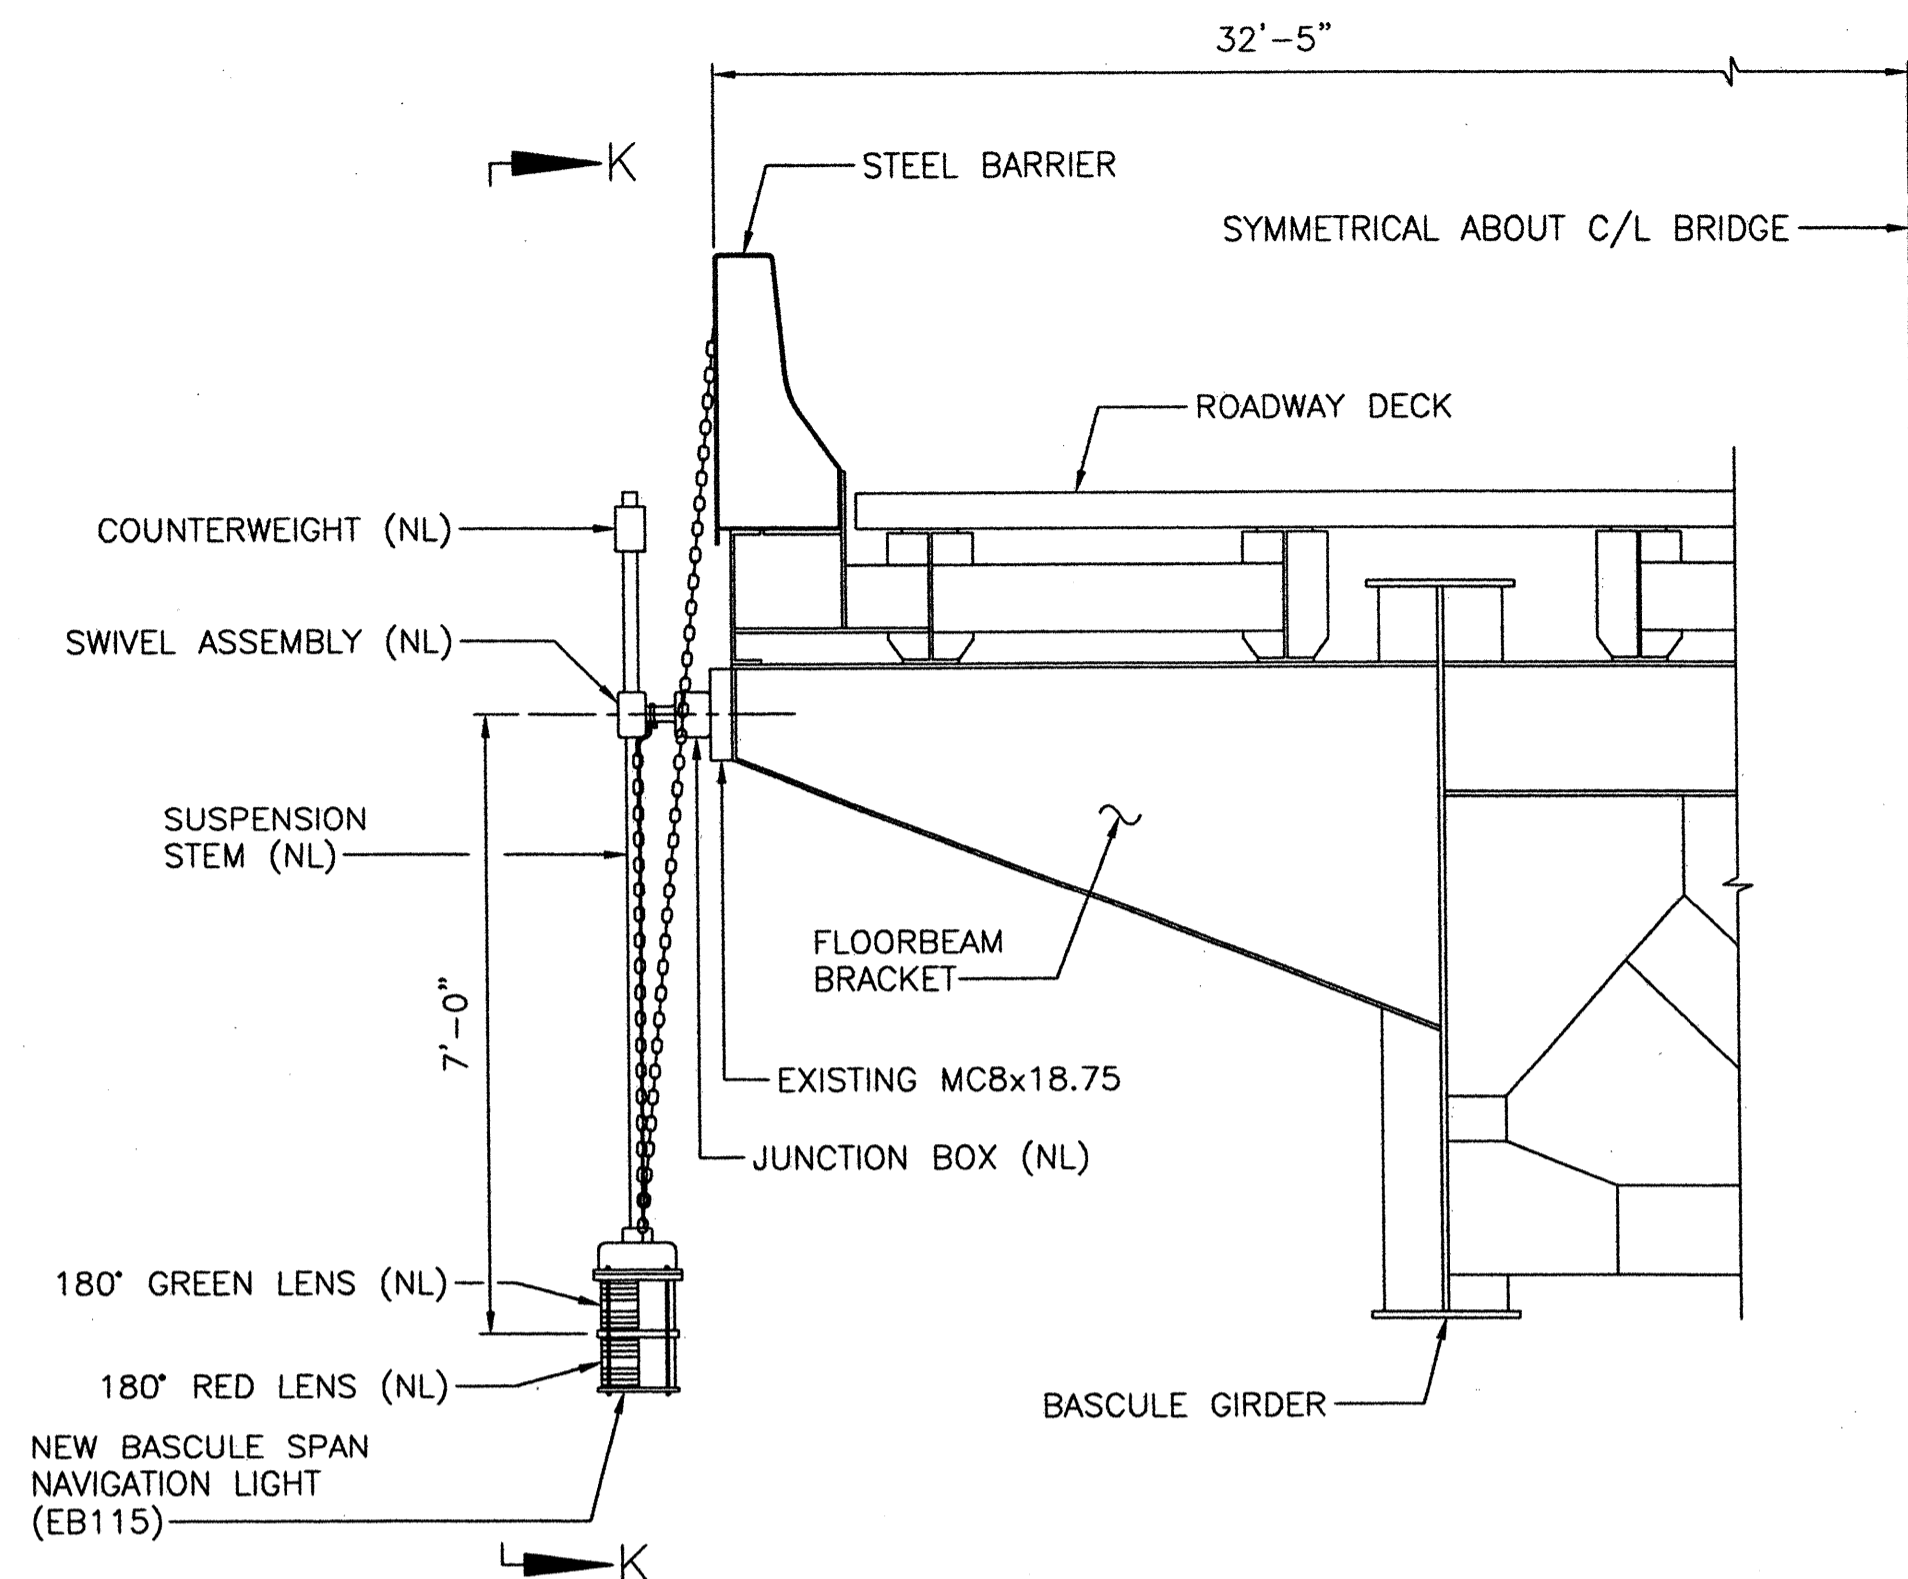


PARTIAL CROSS SECTION - BASCULE LEAF AT FLOORBEAM 1

SCALE: 1/2" = 1'-0"

VIEW IS LOOKING TOWARD CENTERLINE OF BASCULE SPAN. TYPICAL BOTH BASCULE LEAVES. CENTER LOCKS, CONDUITS, JUNCTION BOXES, WALKWAYS, AND SIMILAR ITEMS NOT SHOWN.

ITEMS MARKED (NL) SHALL BE SUPPLIED AS PART OF THE NEW NAVIGATION LIGHT.

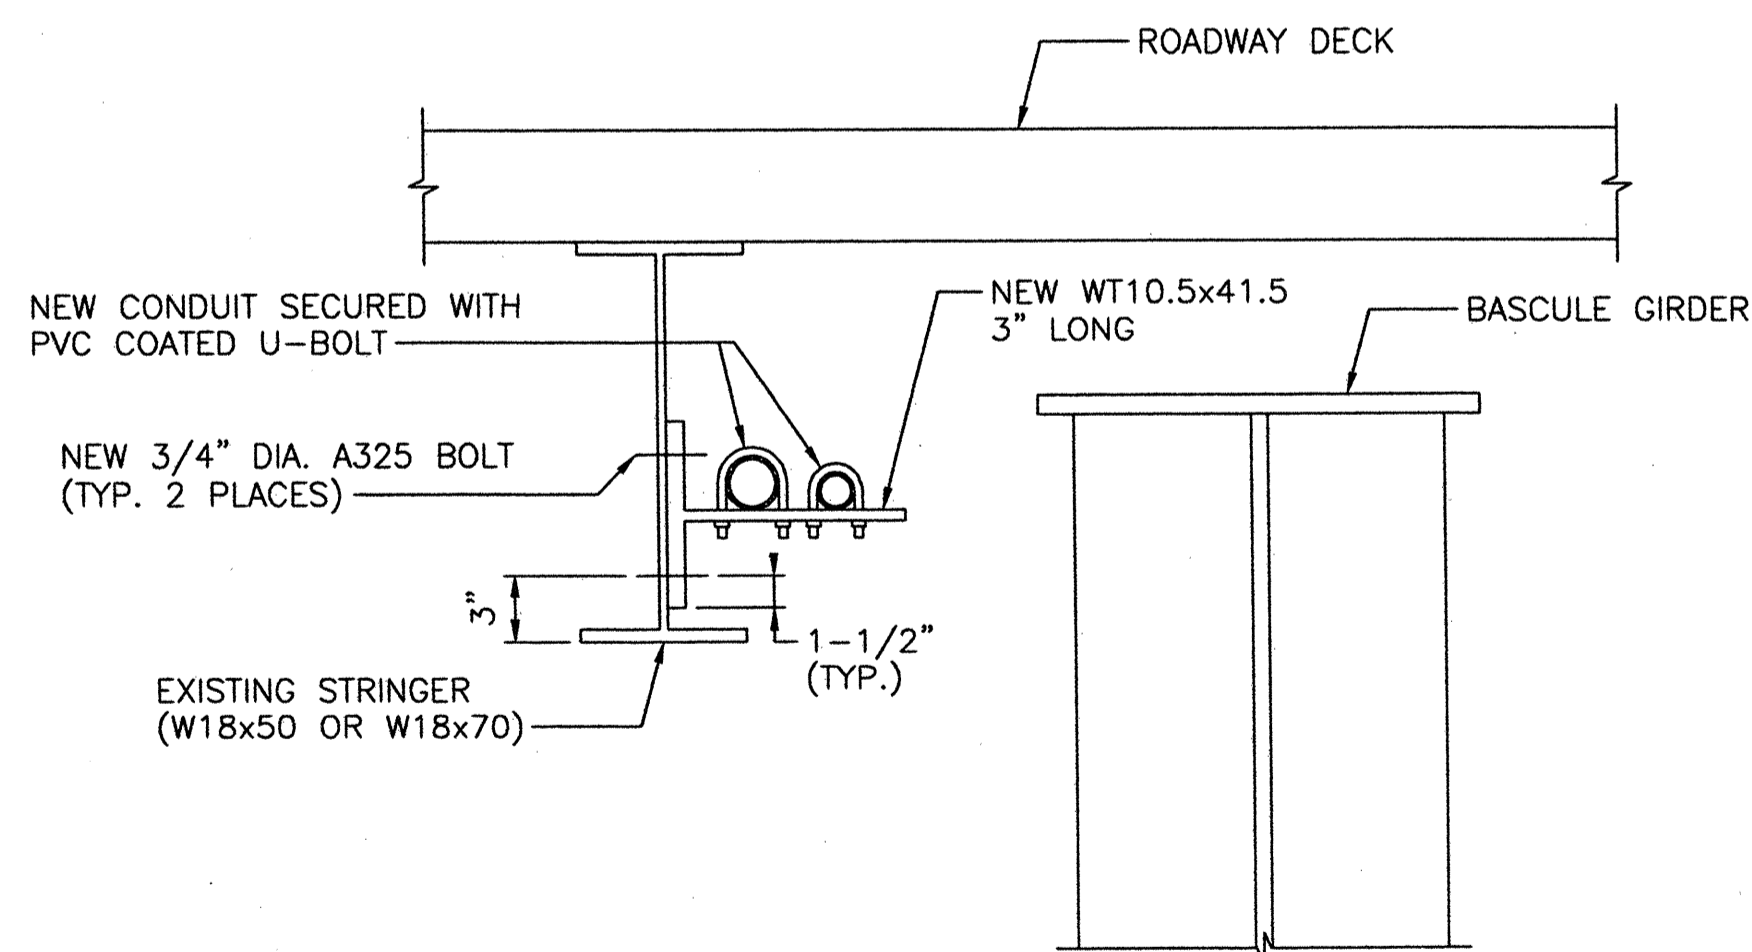


TYPICAL DETAIL - LONGITUDINAL BASCULE SPAN CONDUITS SUPPORT

SCALE: 1-1/2" = 1'-0"

ANGLES SHALL BE SHOP DRILLED FOR ALL REQUIRED HOLES (A325 BOLTS AND U-BOLTS).

INSTALL AT MAXIMUM 5 FOOT INTERVALS; APPROXIMATELY 50 LOCATIONS (CONTRACTOR TO FIELD DETERMINE EXACT REQUIRED QUANTITY).

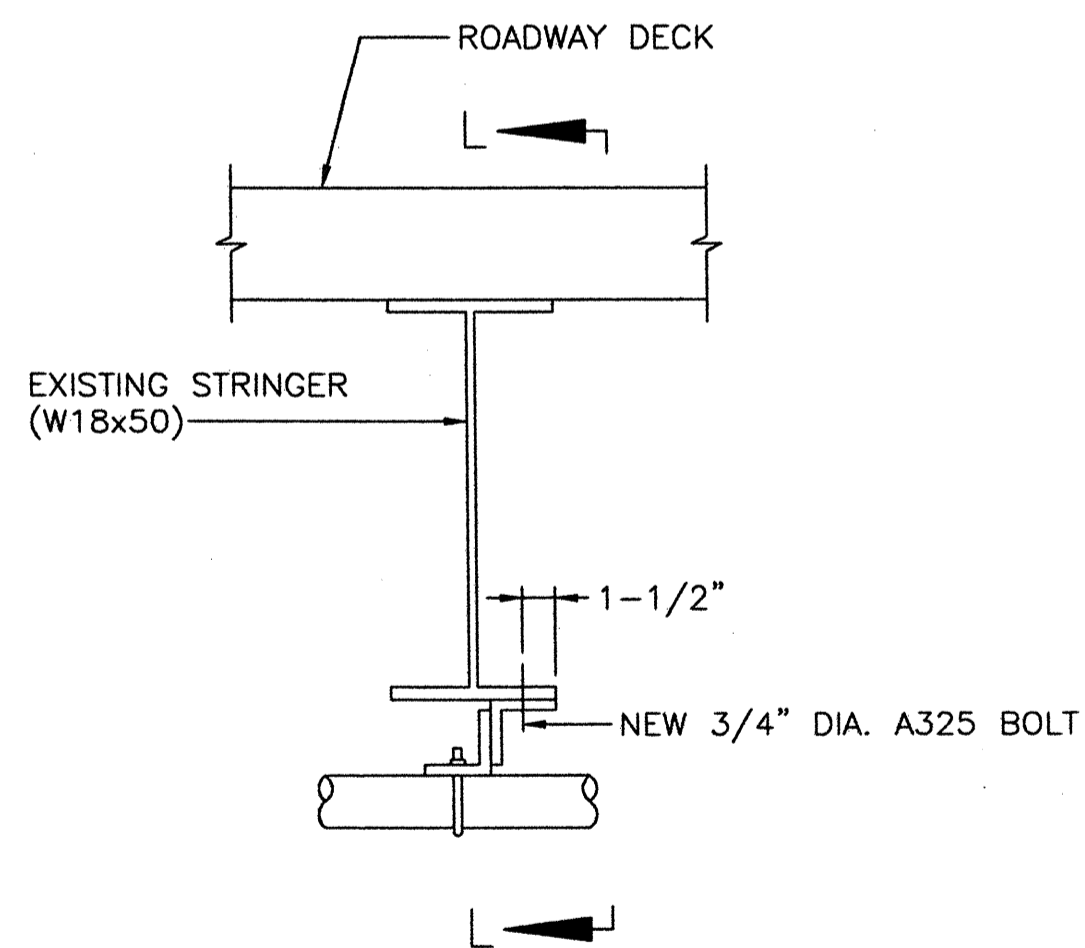


TYPICAL DETAIL - TRANSVERSE BASCULE SPAN CONDUITS SUPPORT

SCALE: 1-1/2" = 1'-0"

ANGLES SHALL BE SHOP DRILLED FOR ALL REQUIRED HOLES (A325 BOLTS AND U-BOLTS).

INSTALL AT EACH STRINGER; APPROXIMATELY 32 LOCATIONS (CONTRACTOR TO FIELD DETERMINE EXACT REQUIRED QUANTITY).

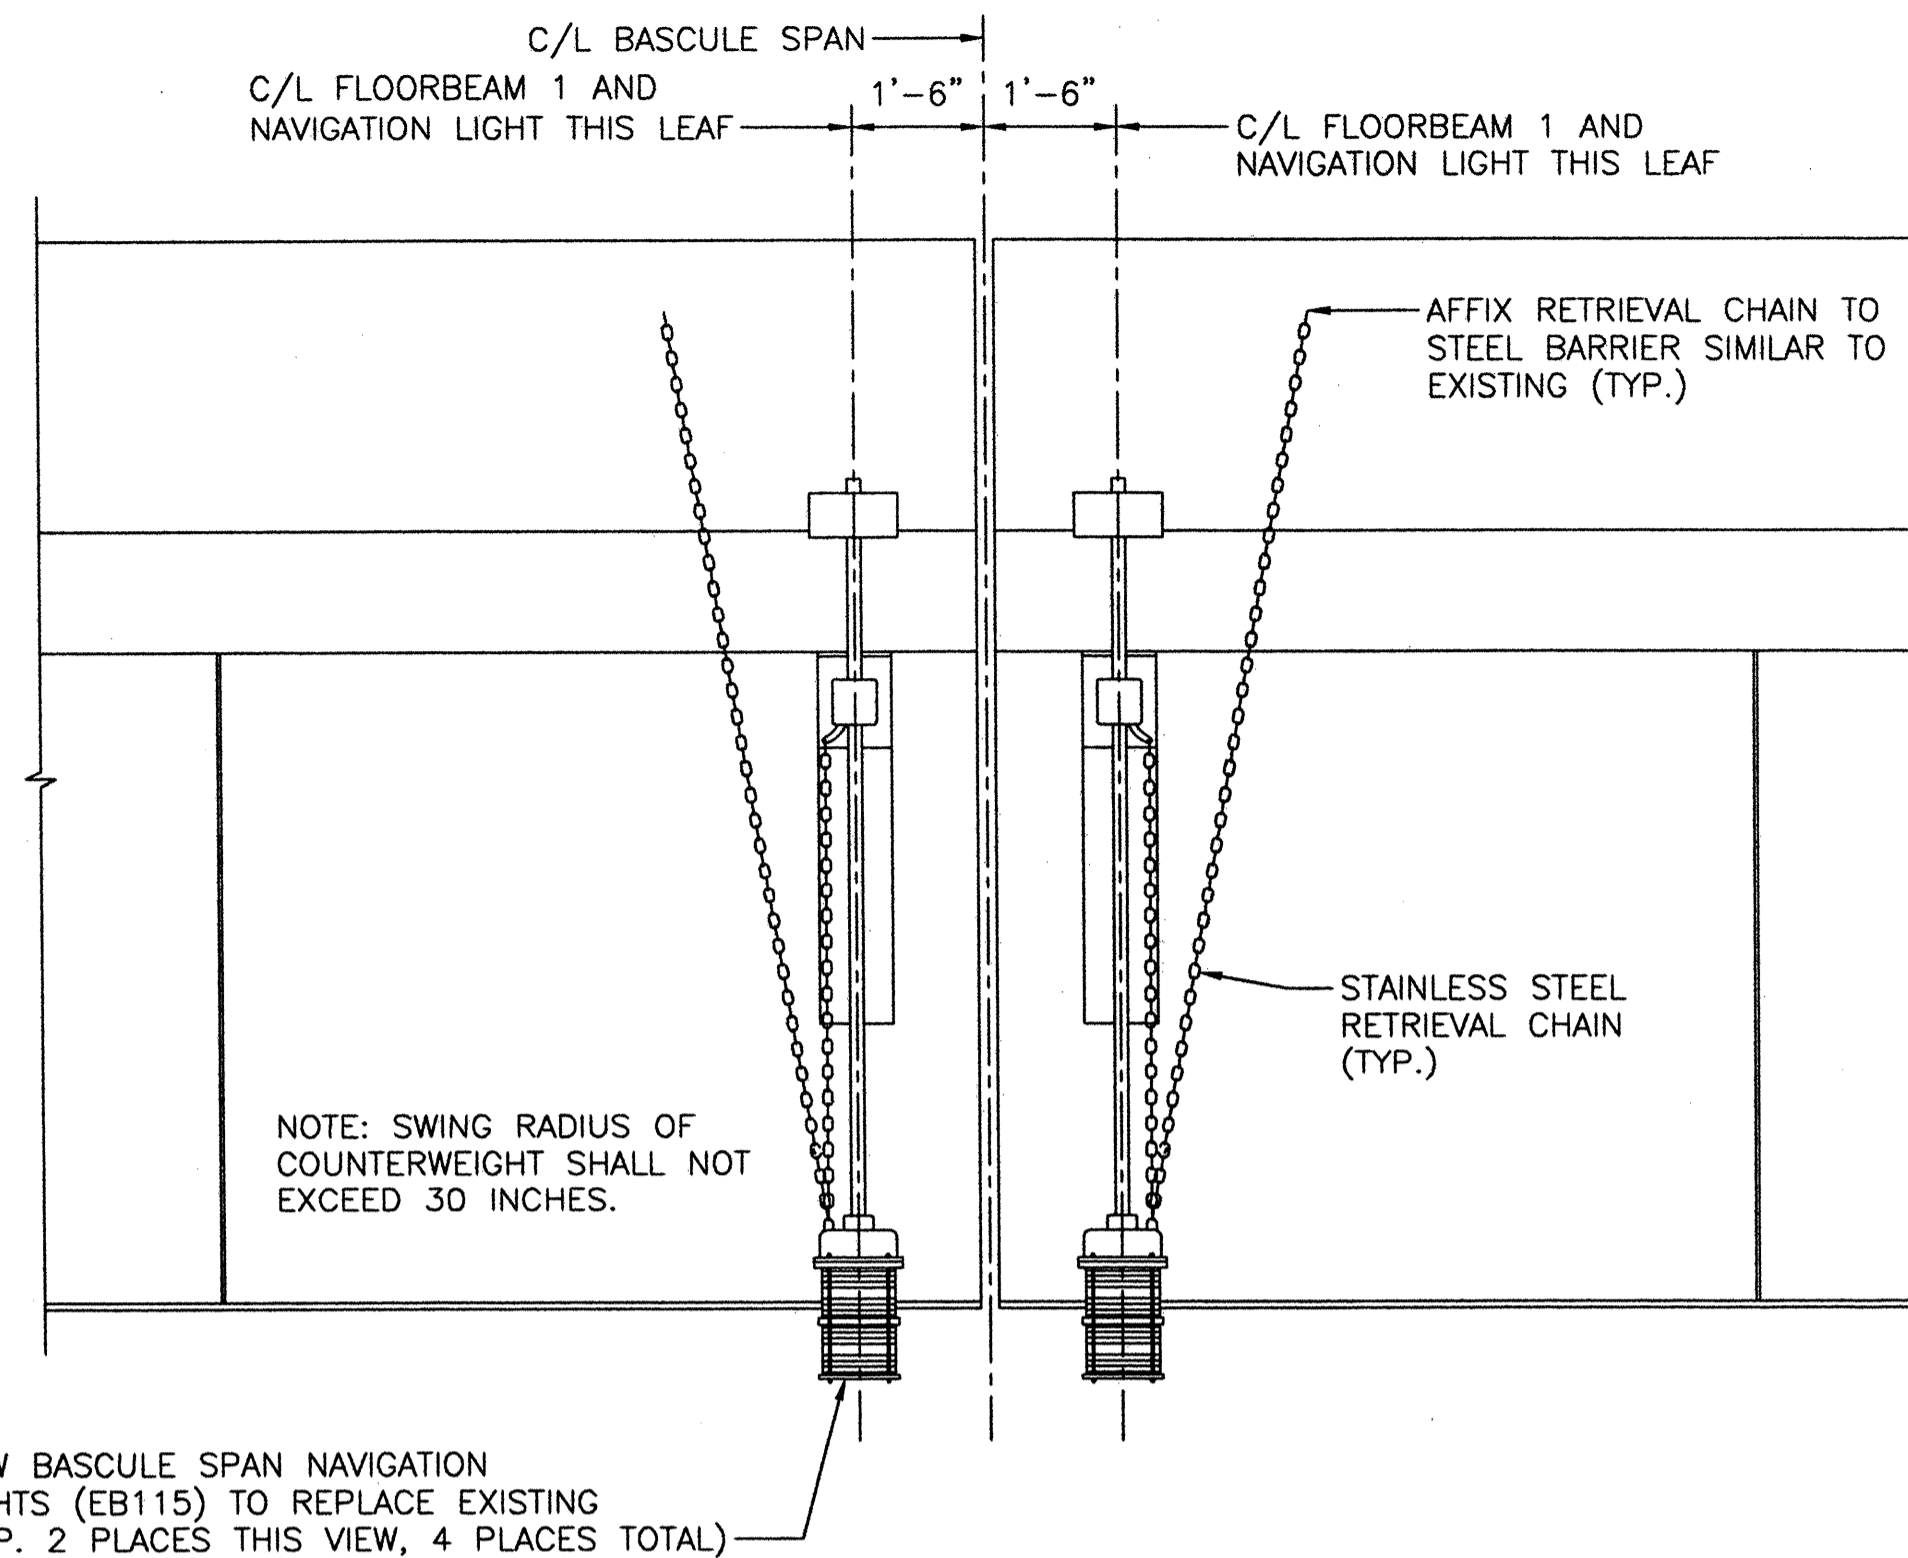


VIEW K-K

SCALE: 1/2" = 1'-0"


CONDUITS TO NAVIGATION LIGHTS NOT SHOWN.

NOTES:

1. NOTES 1 THRU 7 (INCLUSIVE) ON SHEET EB8 SHALL APPLY TO THIS SHEET ALSO.
2. CONTRACTOR SHALL PROVIDE TEMPORARY NAVIGATION LIGHTS AND ASSOCIATED WIRING AS REQUIRED TO MAINTAIN NAVIGATION LIGHTING OF THE BASCULE SPAN LEAVES DURING REPLACEMENT OF THE EXISTING NAVIGATION LIGHTS AND WIRING. SEE GENERAL NOTE 1.16 ON SHEET EB1.

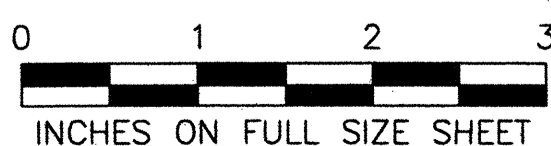


35-ENG-EPD.DWG

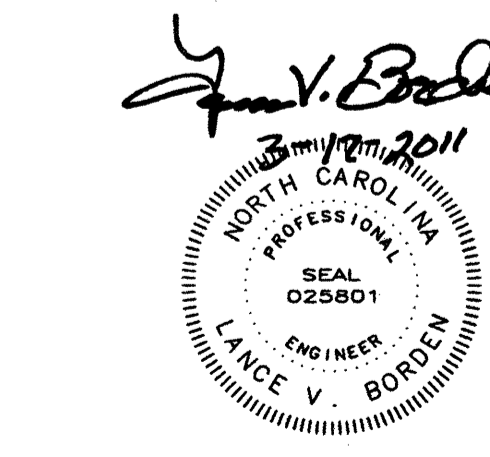

EB9

STATE OF NORTH CAROLINA					
DEPARTMENT OF TRANSPORTATION					
RALEIGH					
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA					
ELECTRICAL PLANS AND DETAILS - 7					
DESIGNED	N.E. ALGER	DETAILED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	CHECKED	Q.C. TON	DRAWING NO.	35 OF 63
				DRAWN BY	N.E. ALGER
				SCALE	AS NOTED

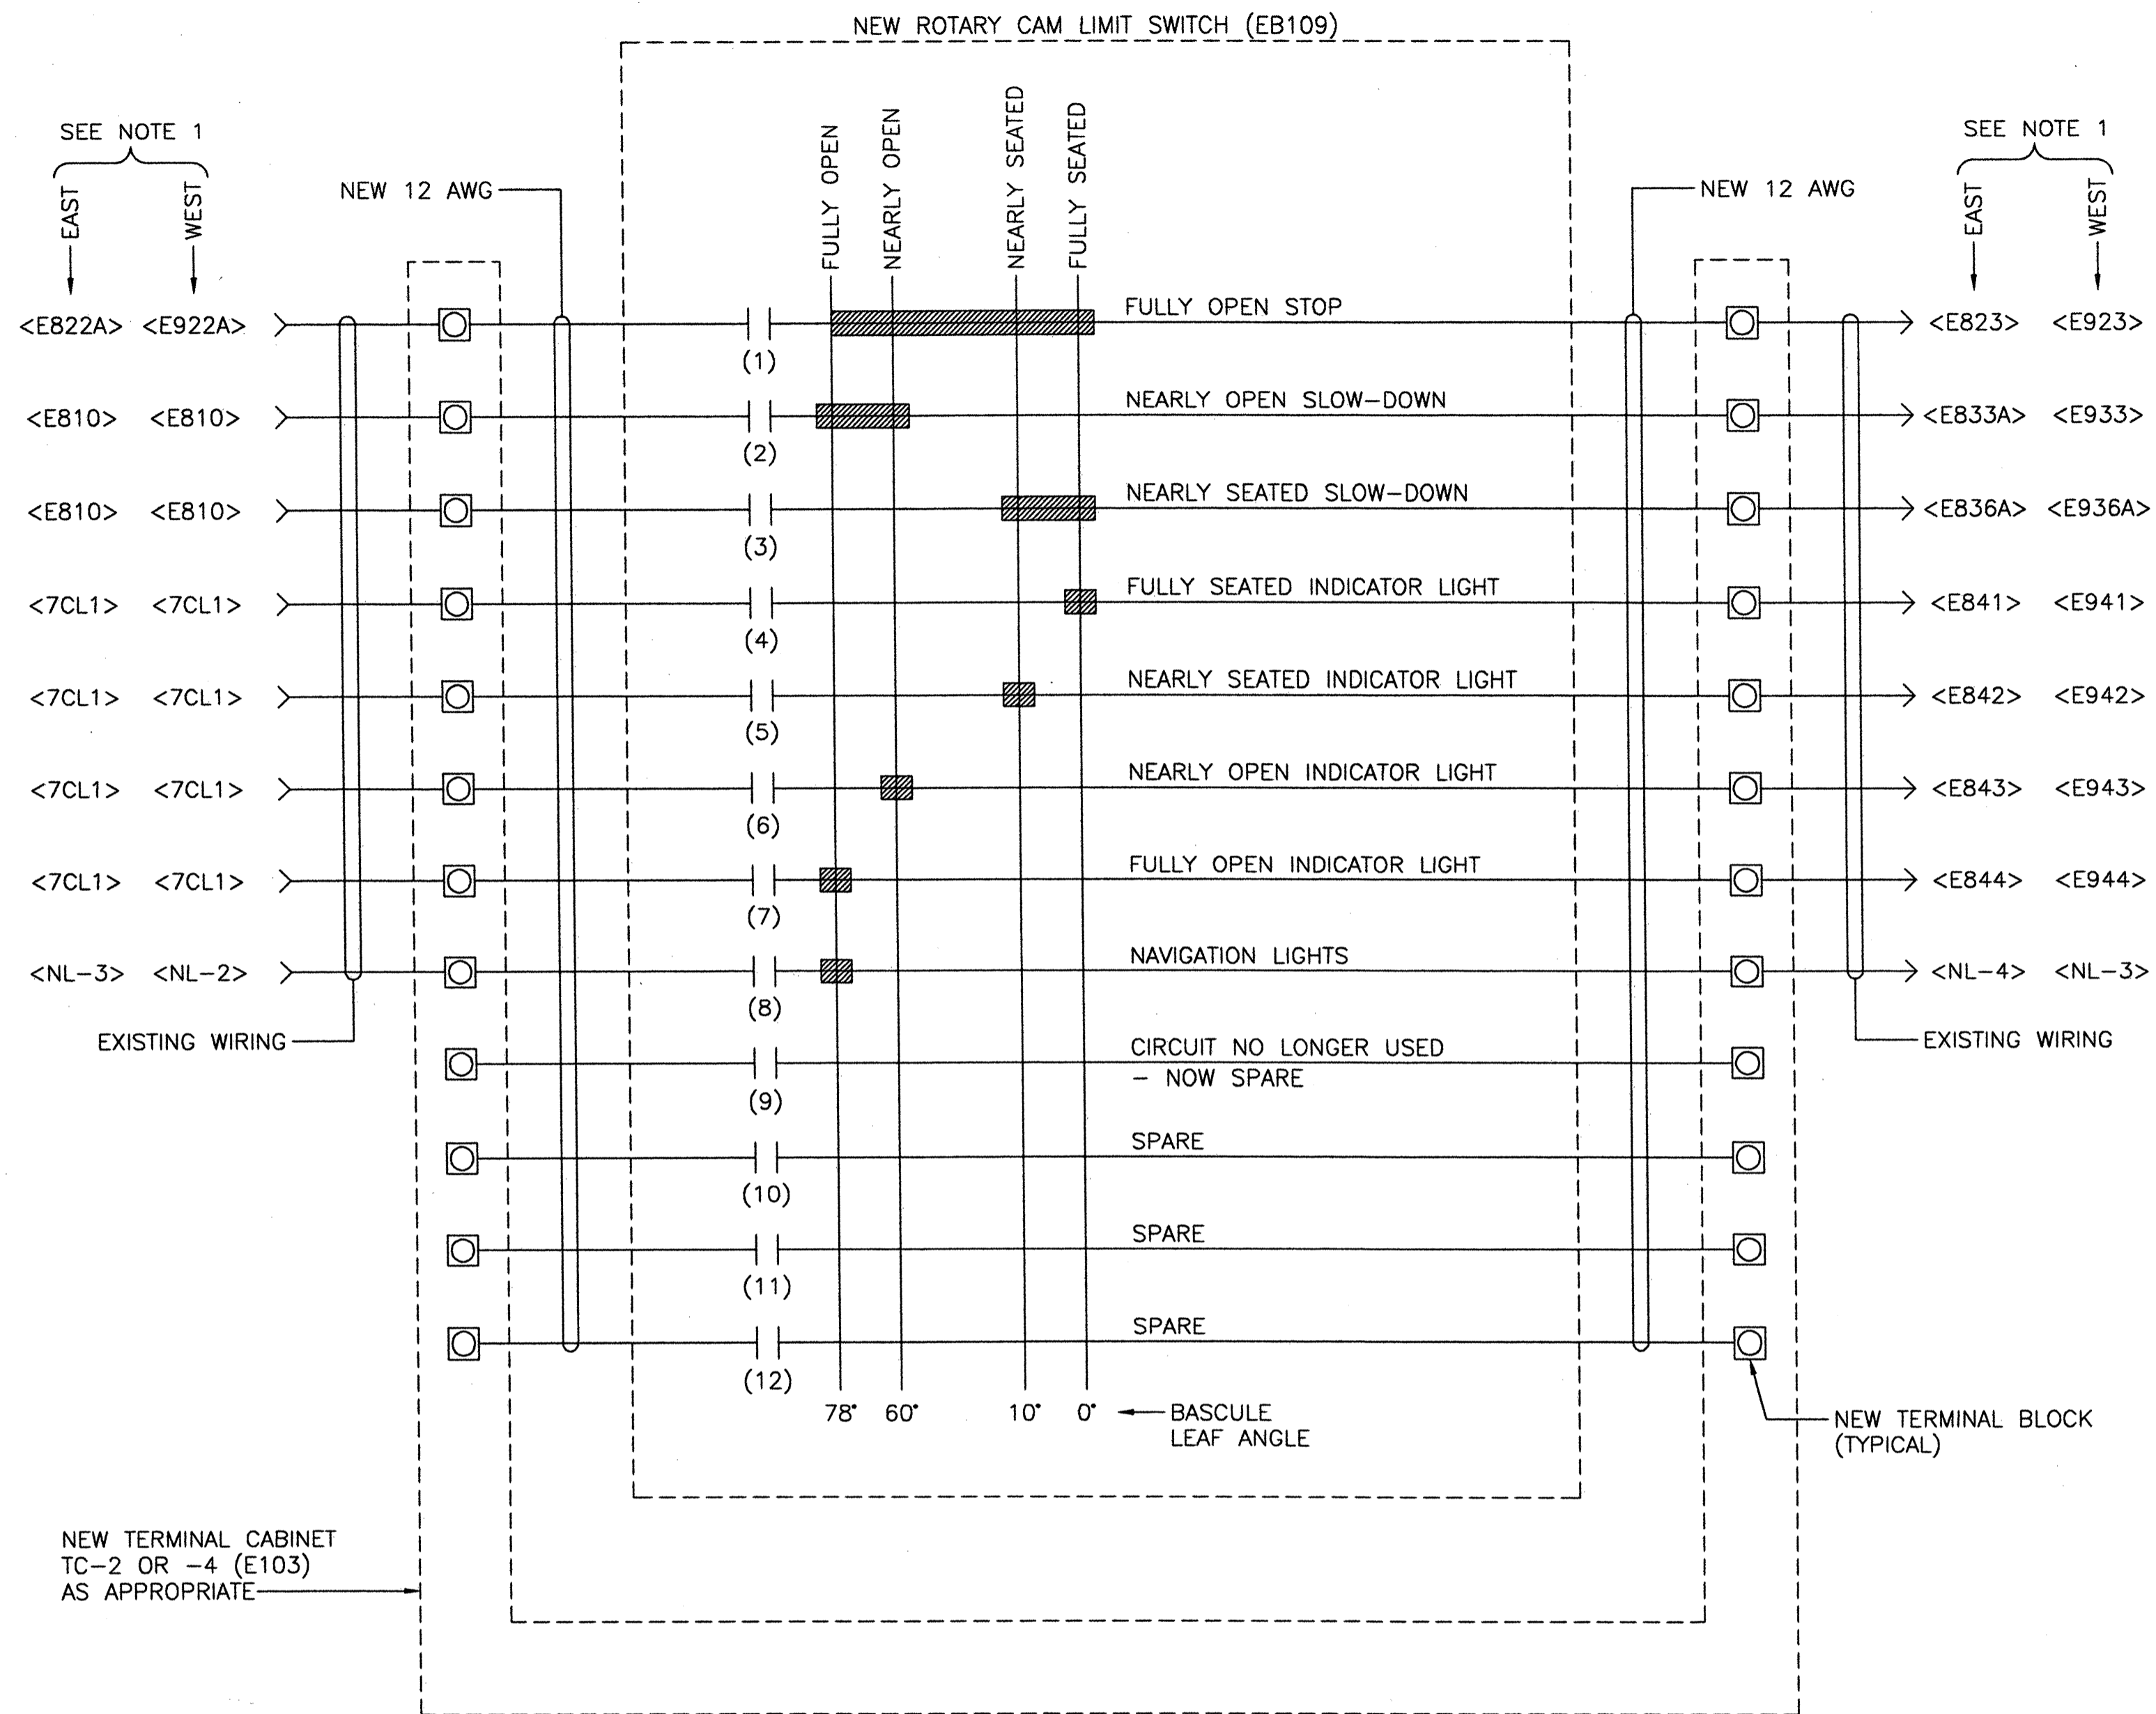


TYPICAL WIRING - NEW ROTARY CAM LIMIT SWITCHES

SCALE: NONE

NOTES:


1. NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
2. REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.

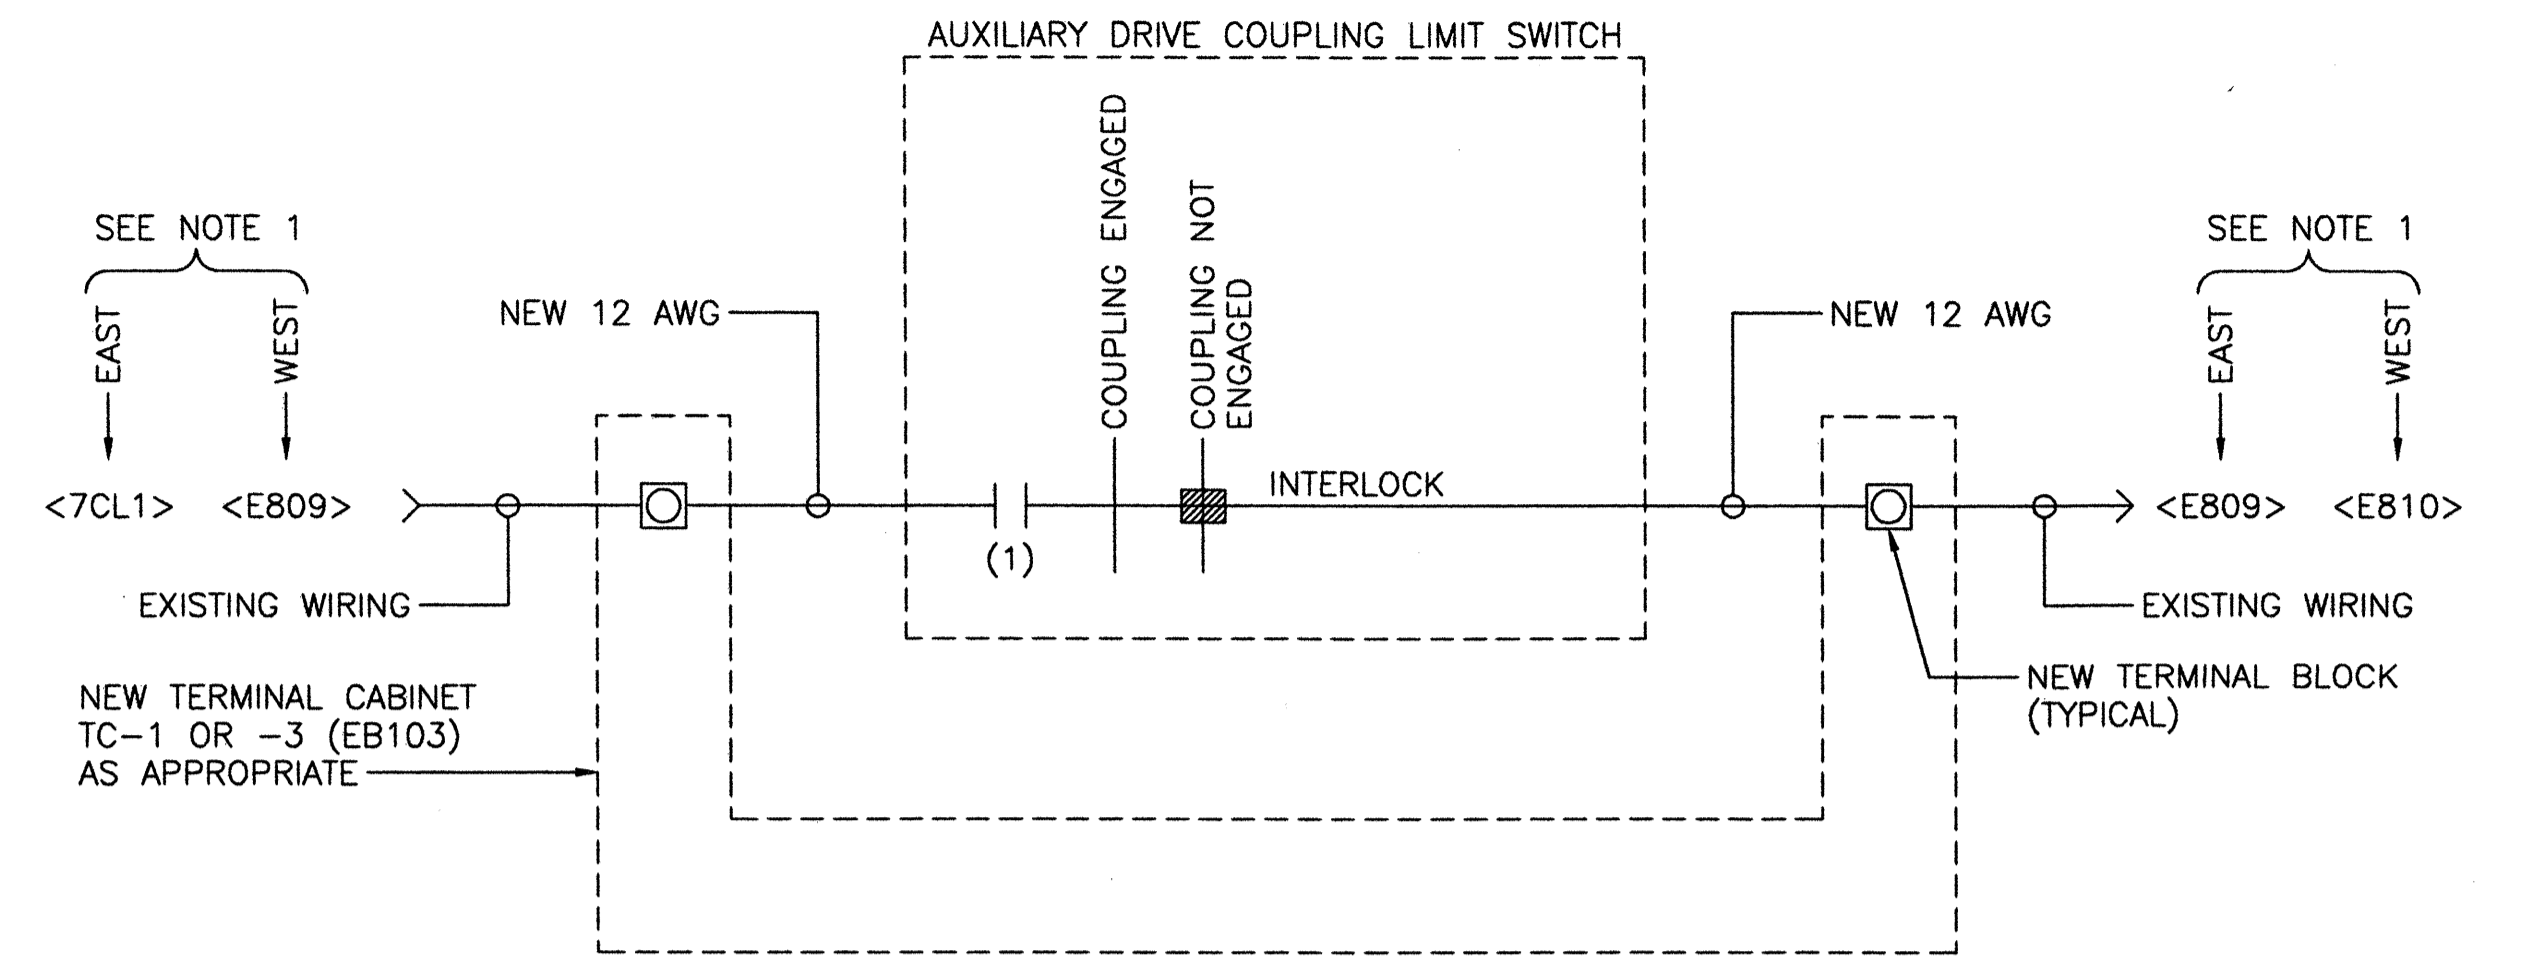

TYPICAL WIRING - AUXILIARY DRIVE COUPLING LIMIT SWITCH

SCALE: NONE

LIMIT SWITCHES ARE PROVIDED WITH AUXILIARY DRIVE COUPLING ASSEMBLIES; SEE MECHANICAL PLANS.


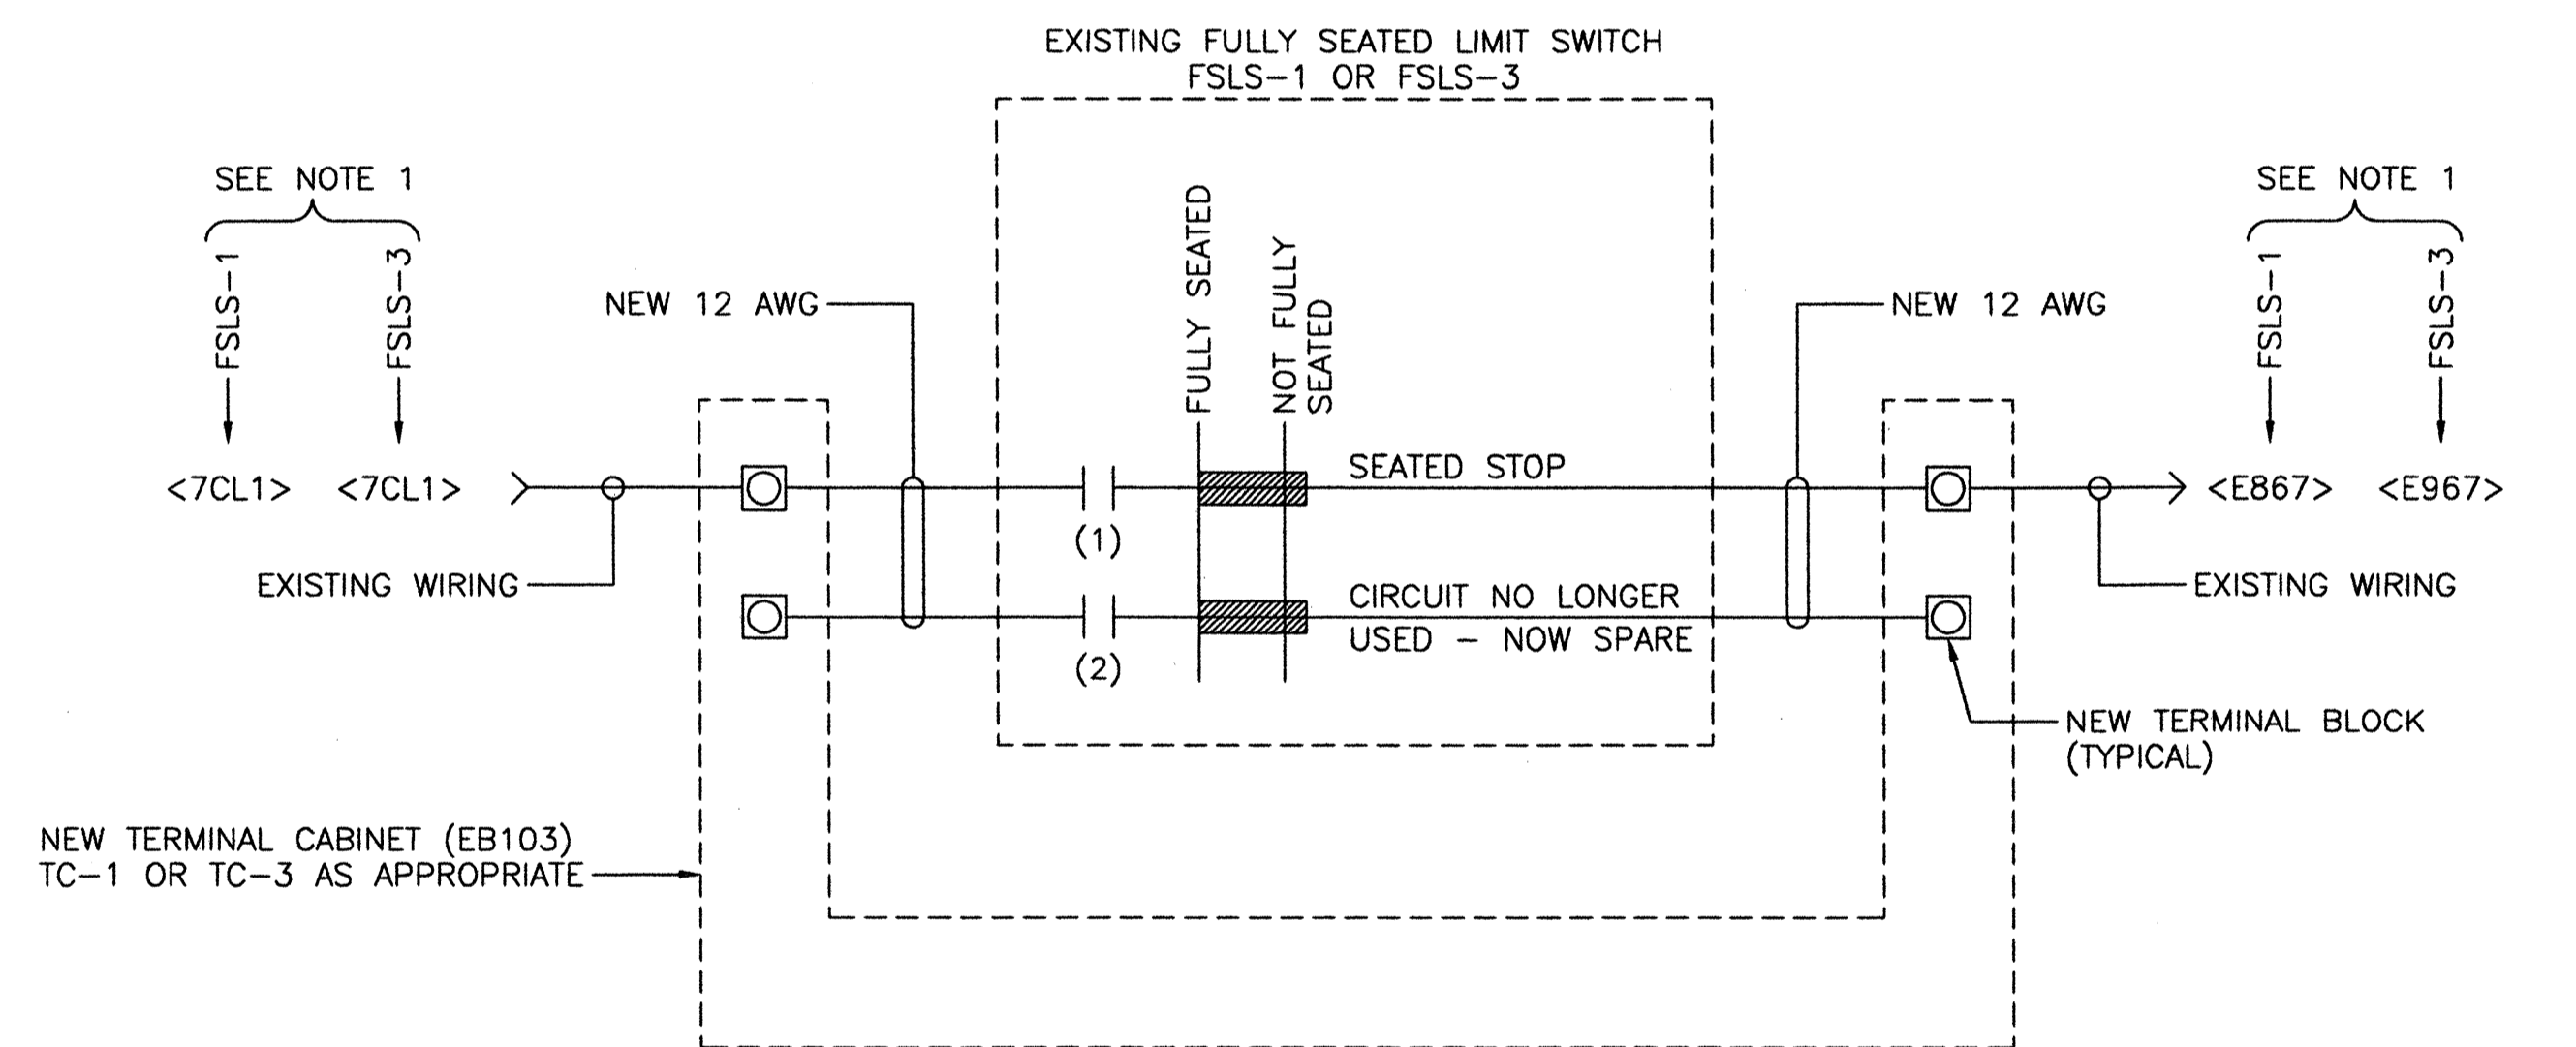


TYPICAL WIRING - FULLY SEATED LIMIT SWITCHES

SCALE: NONE


ONLY LIMIT SWITCHES FLS-1 AND FLS-3 ARE TO REMAIN AND BE RE-WIRED; LIMIT SWITCHES FLS-2 AND FLS-4 ARE TO BE REMOVED.

36-EB10-ES1.DWG

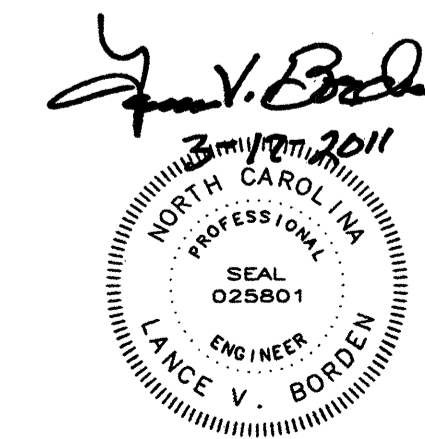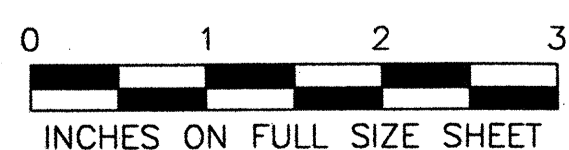


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL SCHEMATICS - 1			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	36 OF 63

EB10

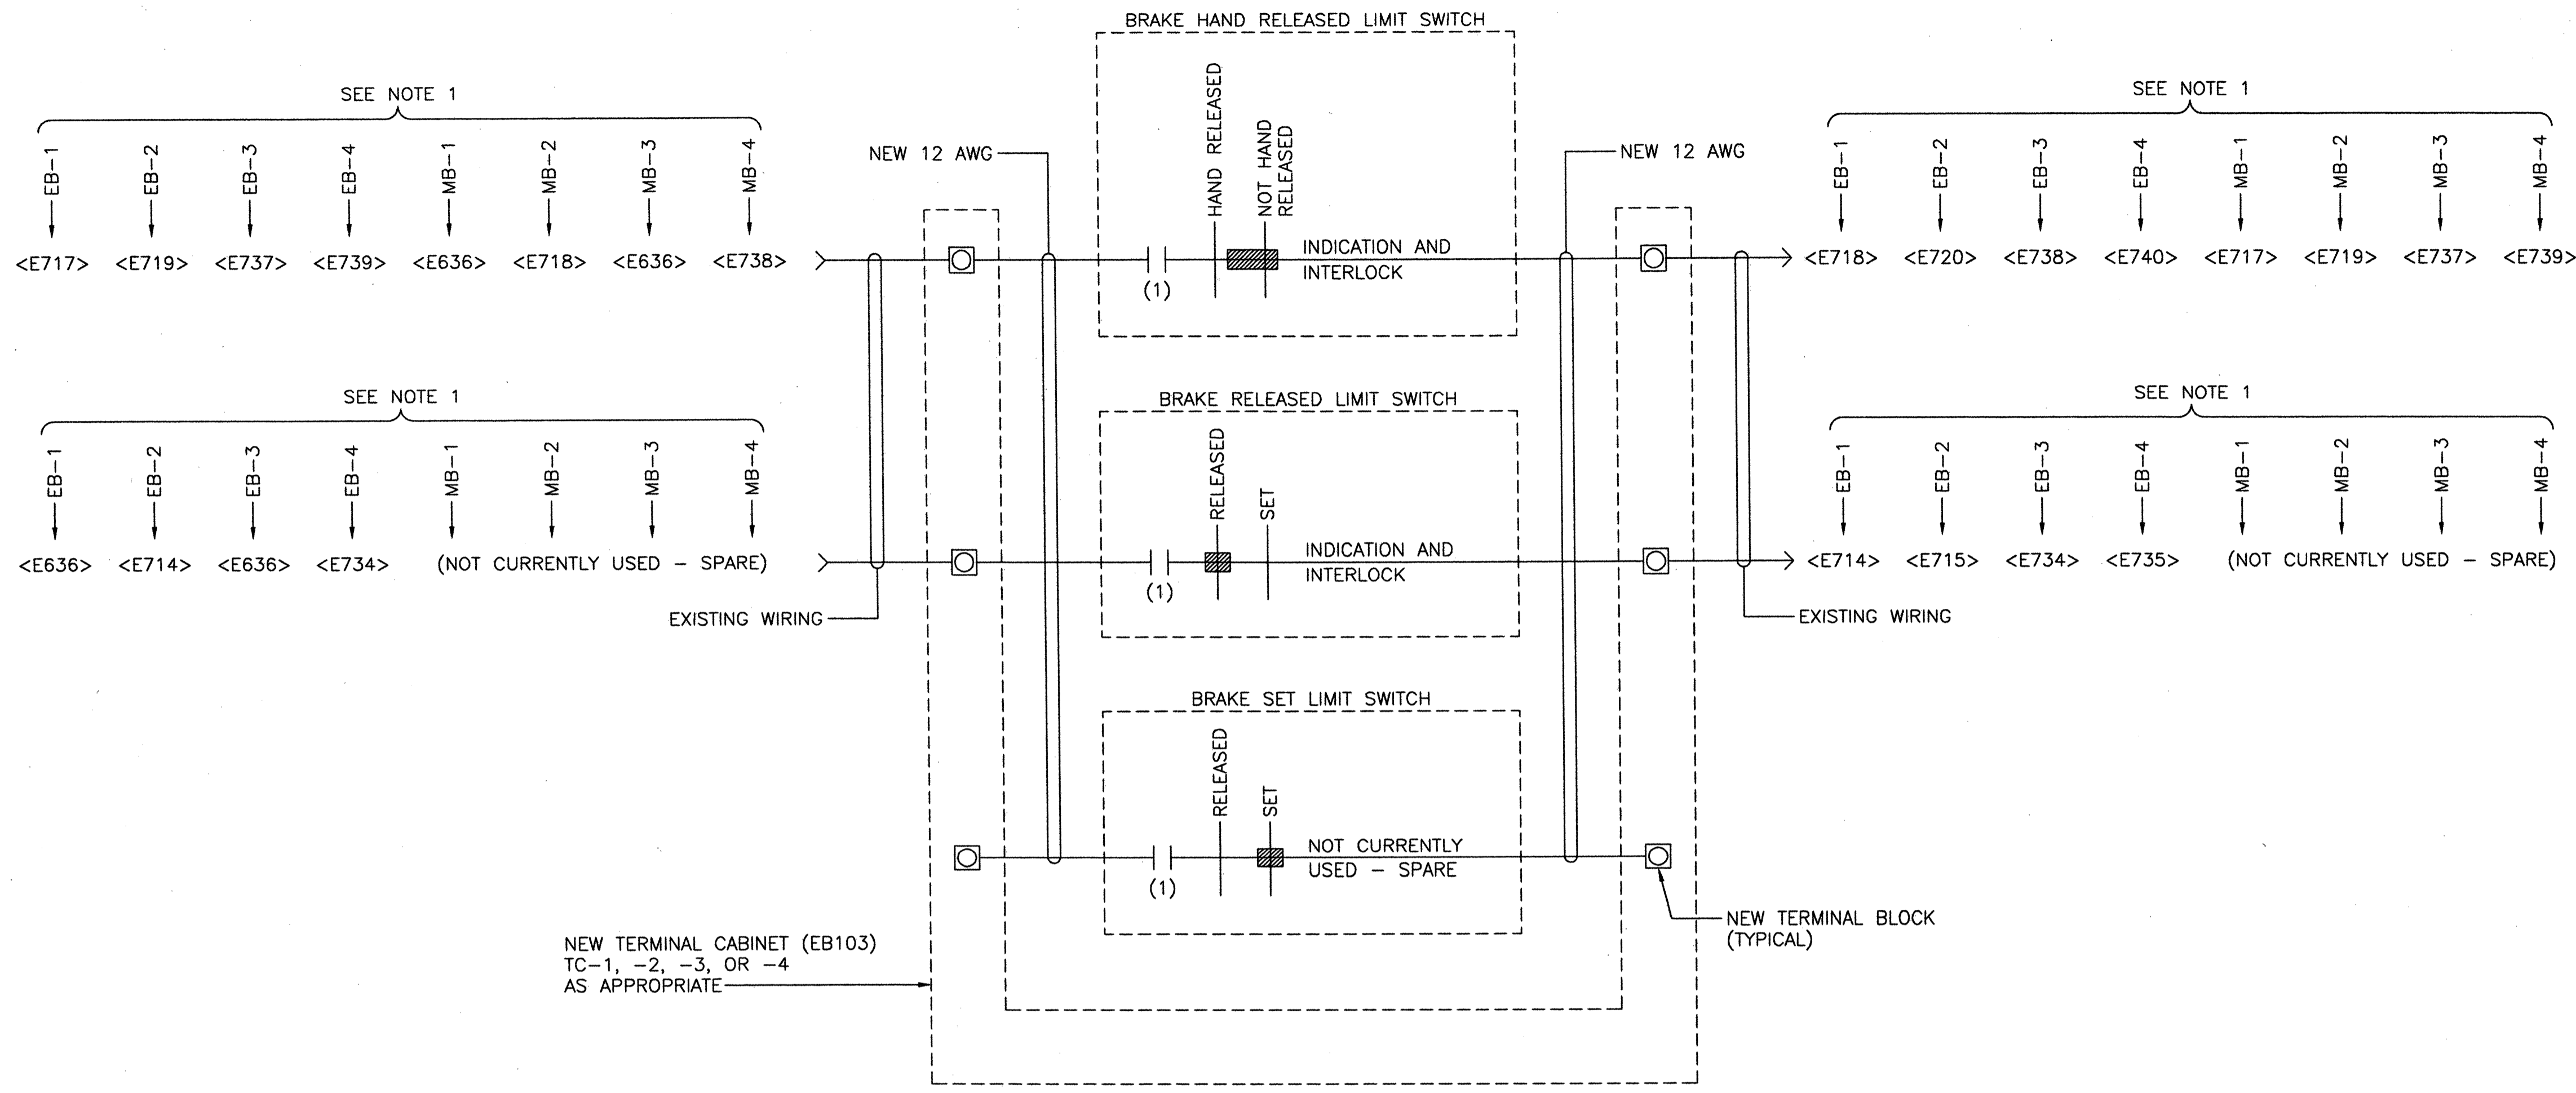


TYPICAL WIRING - BRAKE LIMIT SWITCHES
SCALE: NONE

LIMIT SWITCHES ARE PROVIDED WITH BRAKES; SEE MECHANICAL PLANS.

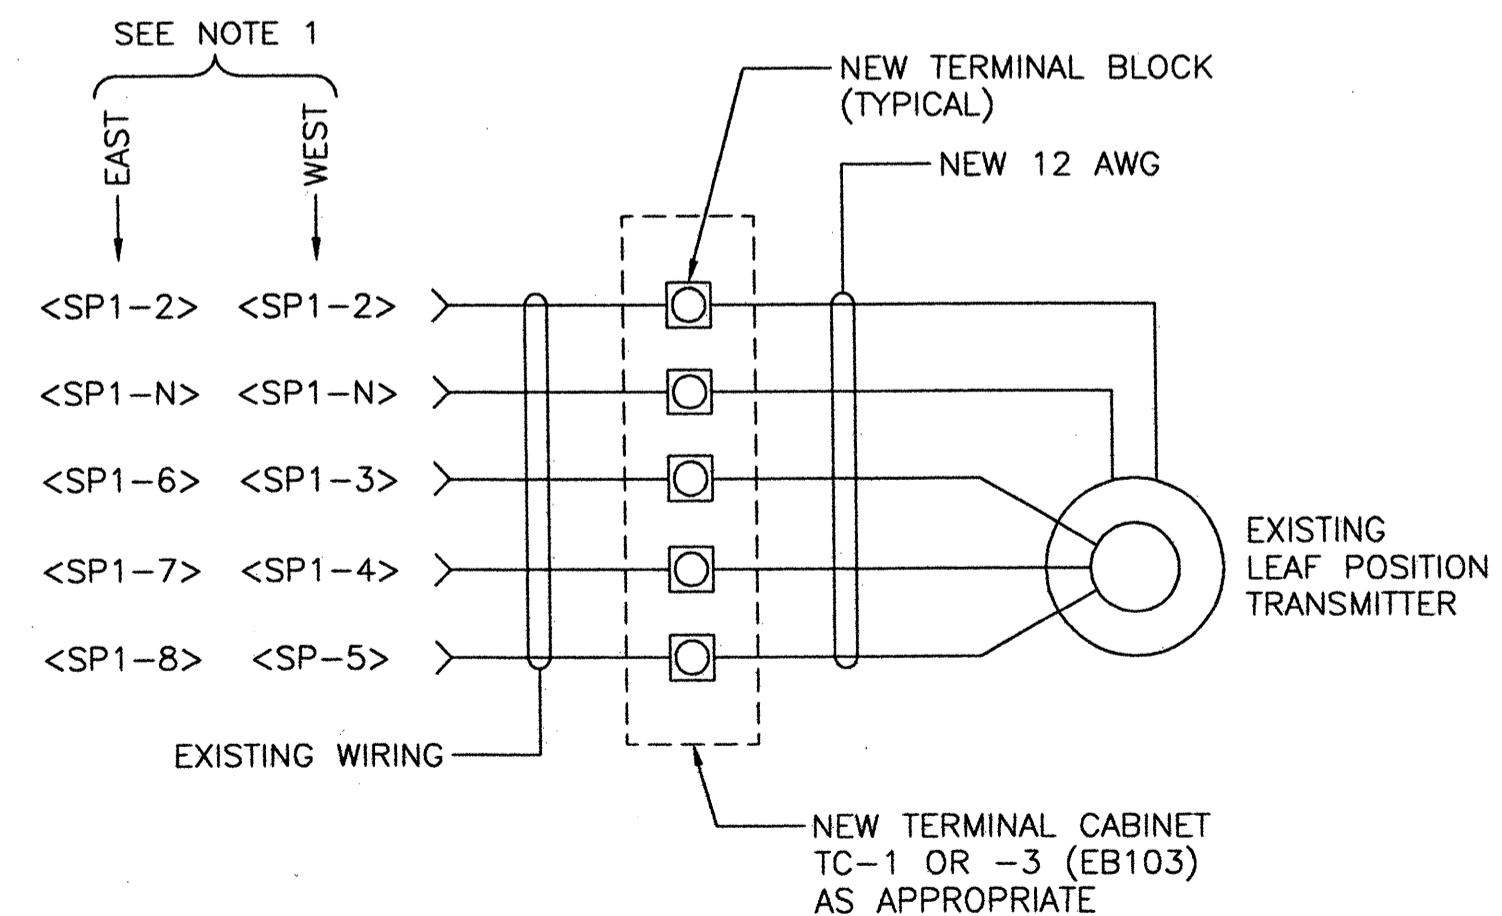



TYPICAL WIRING - LEAF POSITION TRANSMITTERS
SCALE: NONE

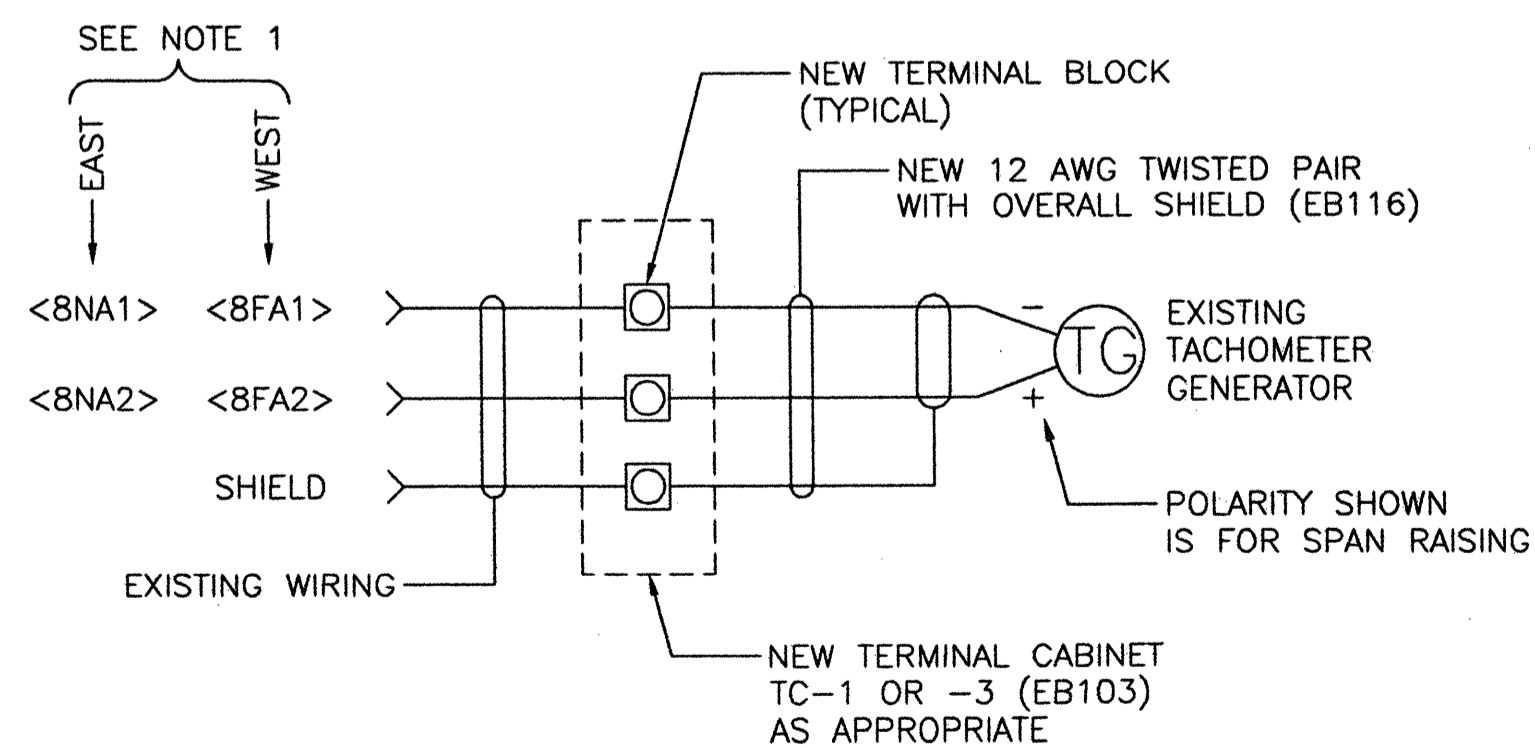

TYPICAL WIRING - TACHOMETERS
SCALE: NONE

NOTES:


- NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
- REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.

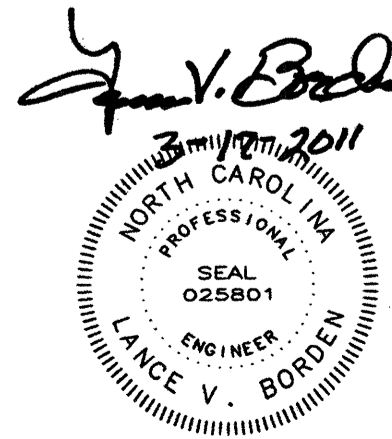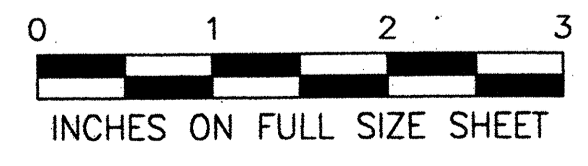

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL SCHEMATICS - 2			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	37 OF 63

EB11

37-EB11-ES2.DWG

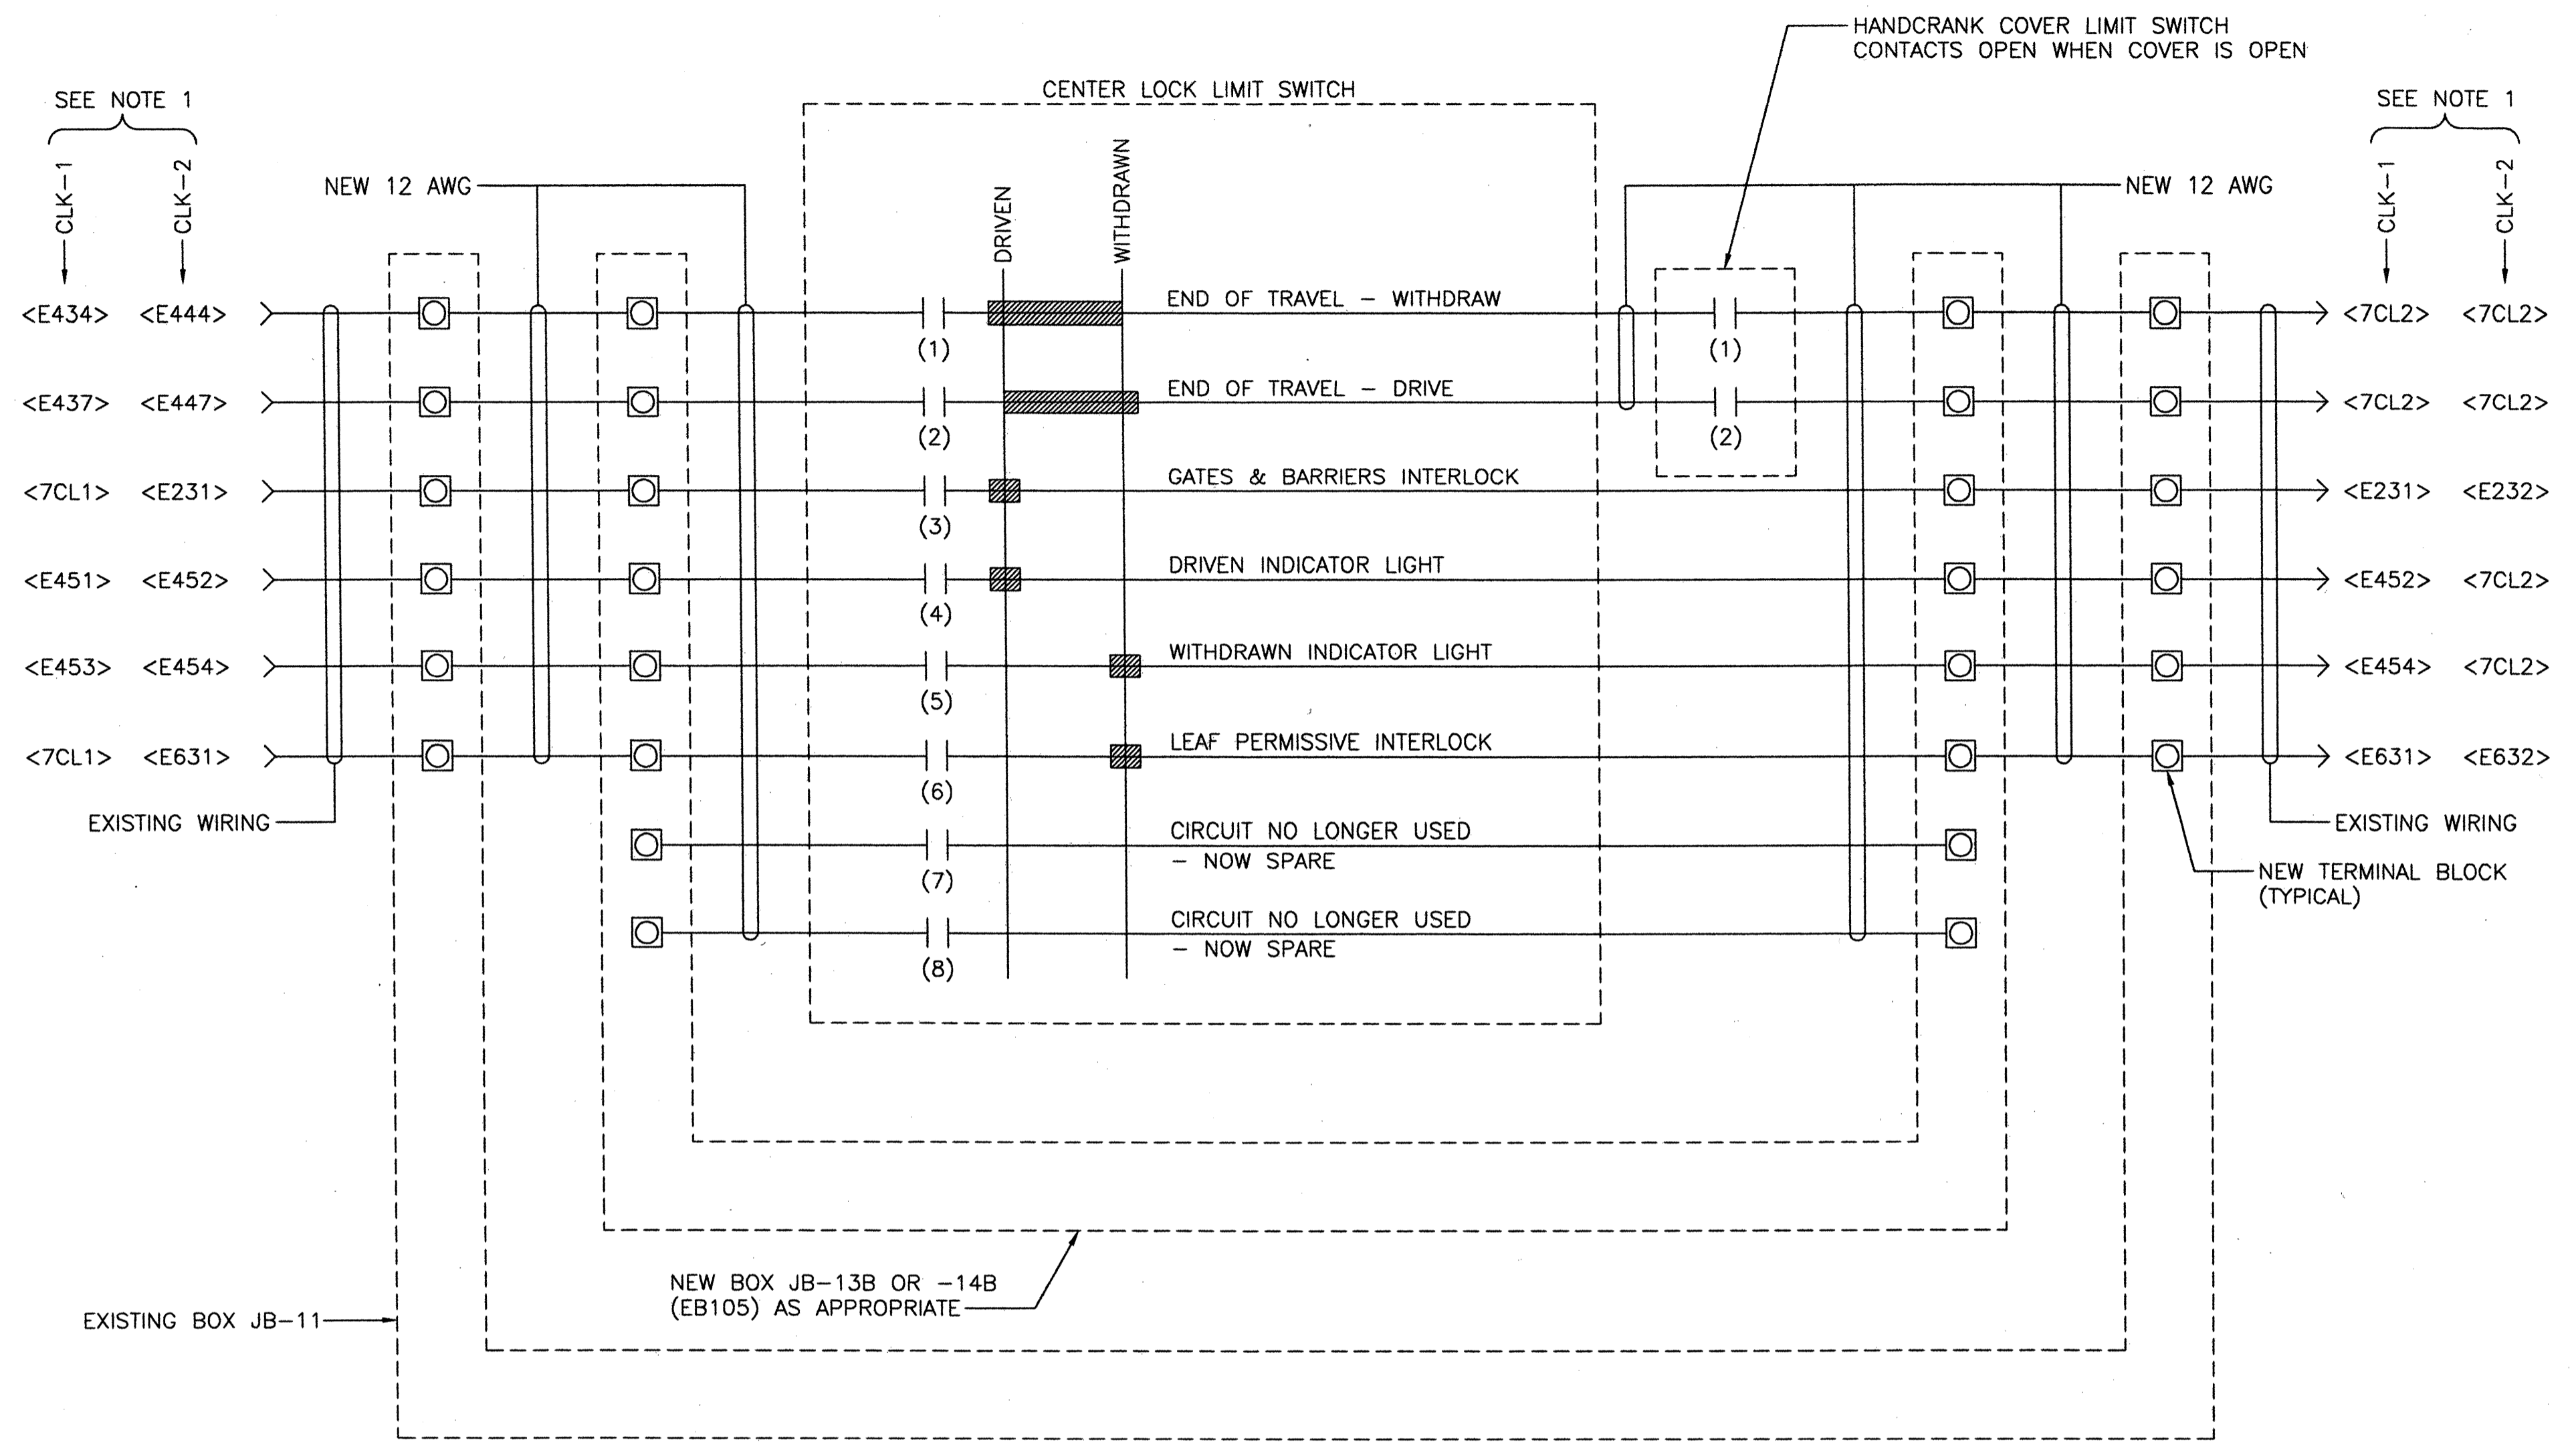



TYPICAL WIRING - CENTER LOCK LIMIT SWITCHES

SCALE: NONE

LIMIT SWITCHES ARE PROVIDED WITH CENTER LOCK ASSEMBLIES; SEE MECHANICAL PLANS.

NOTES:

1. NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
2. REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.

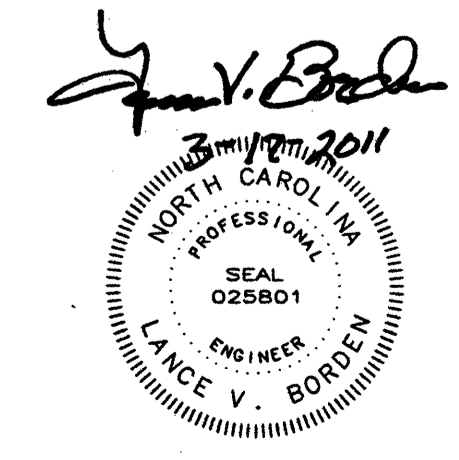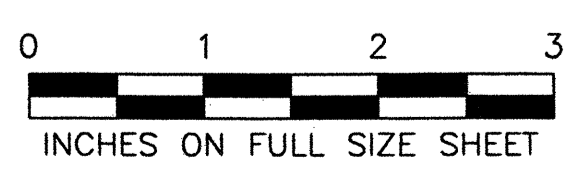


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL SCHEMATICS - 3			
DRAWN BY		N.E. ALGER	
SCALE		AS NOTED	
DESIGNED	N.E. ALGER	DETAILED	N.E. ALGER
CHECKED	Q.C. TON	CHECKED	Q.C. TON
DATE		MARCH 2011	
DRAWING NO.		38 OF 63	

EB12



38-EB12-ESS.DWG

NOTES:

- NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
- REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.

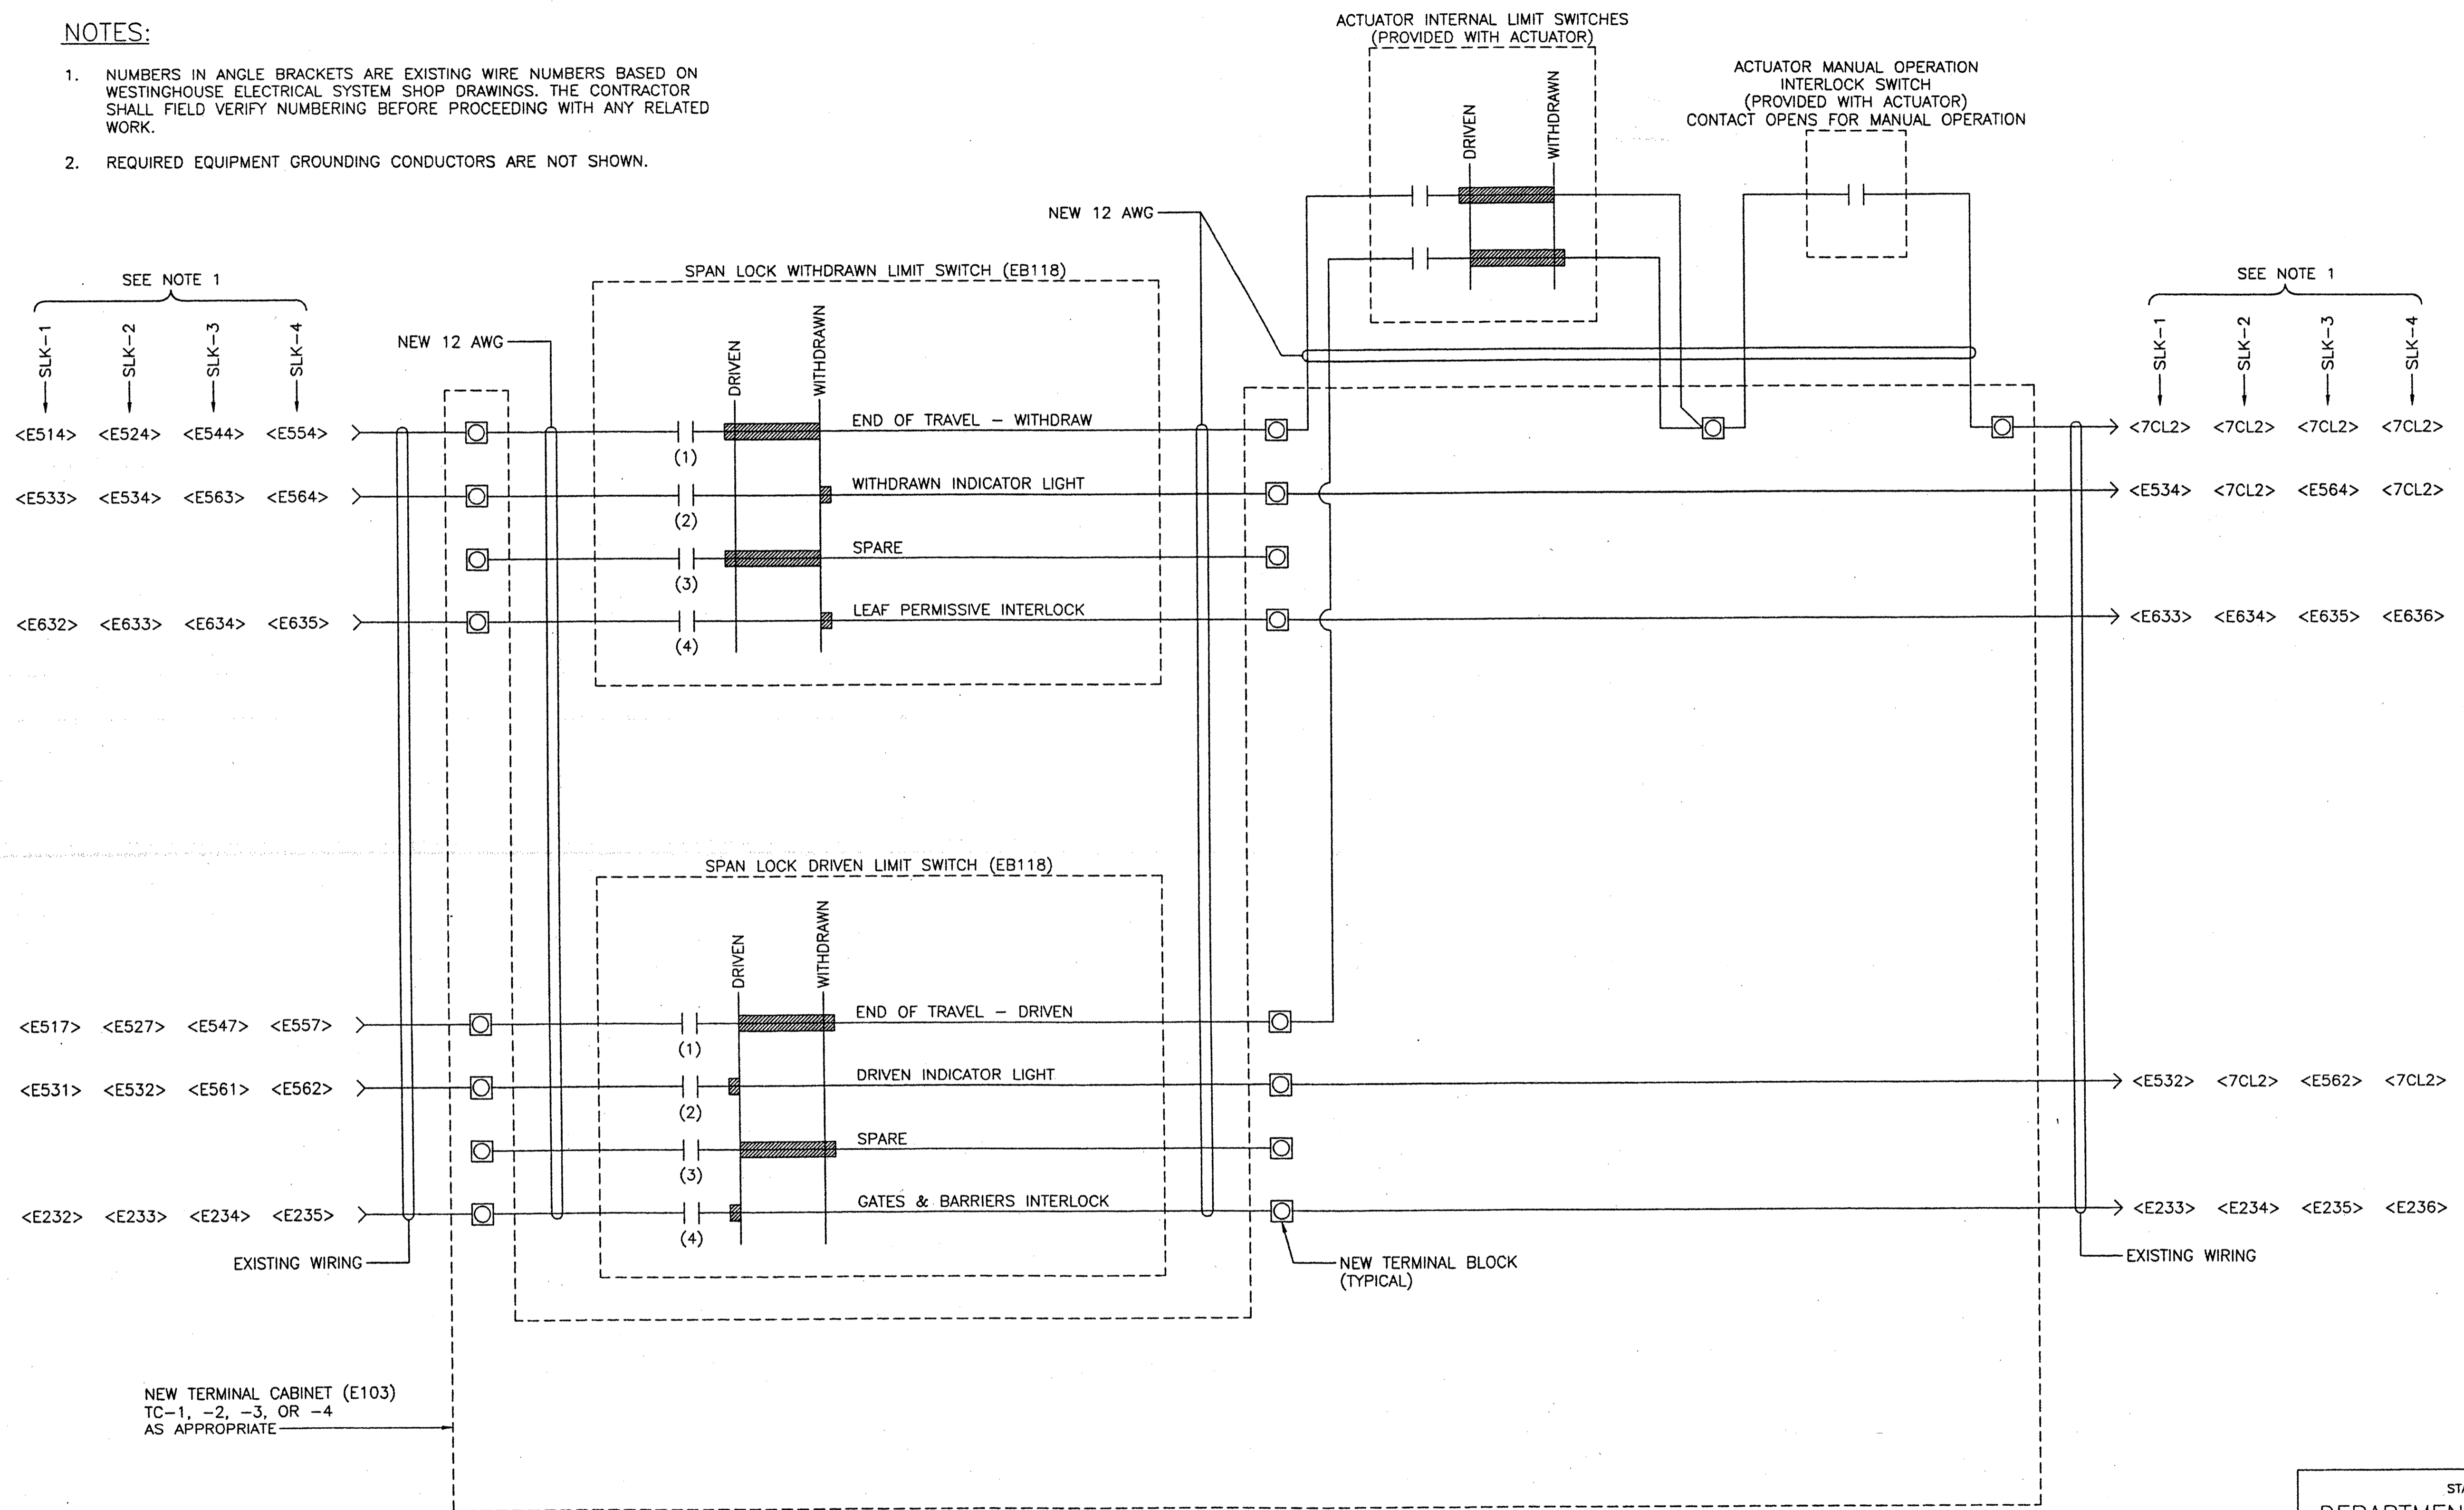



TYPICAL WIRING - SPAN LOCK LIMIT SWITCHES
SCALE: NONE

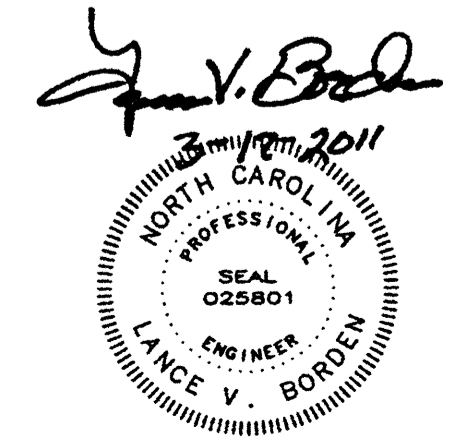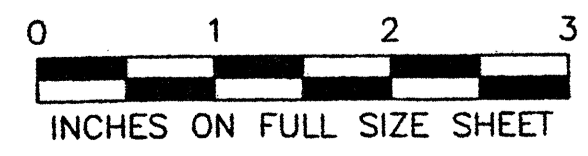

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL SCHEMATICS - 4			
DRAWN BY		N.E. ALGER	
SCALE		AS NOTED	
DESIGNED	N.E. ALGER	DETAILED	N.E. ALGER
CHECKED	Q.C. TON	CHECKED	Q.C. TON
DATE		MARCH 2011	
DRAWING NO. 39 OF 63			


39-EB13-ES4.DWG

SEE NOTE 1 (TYP.)

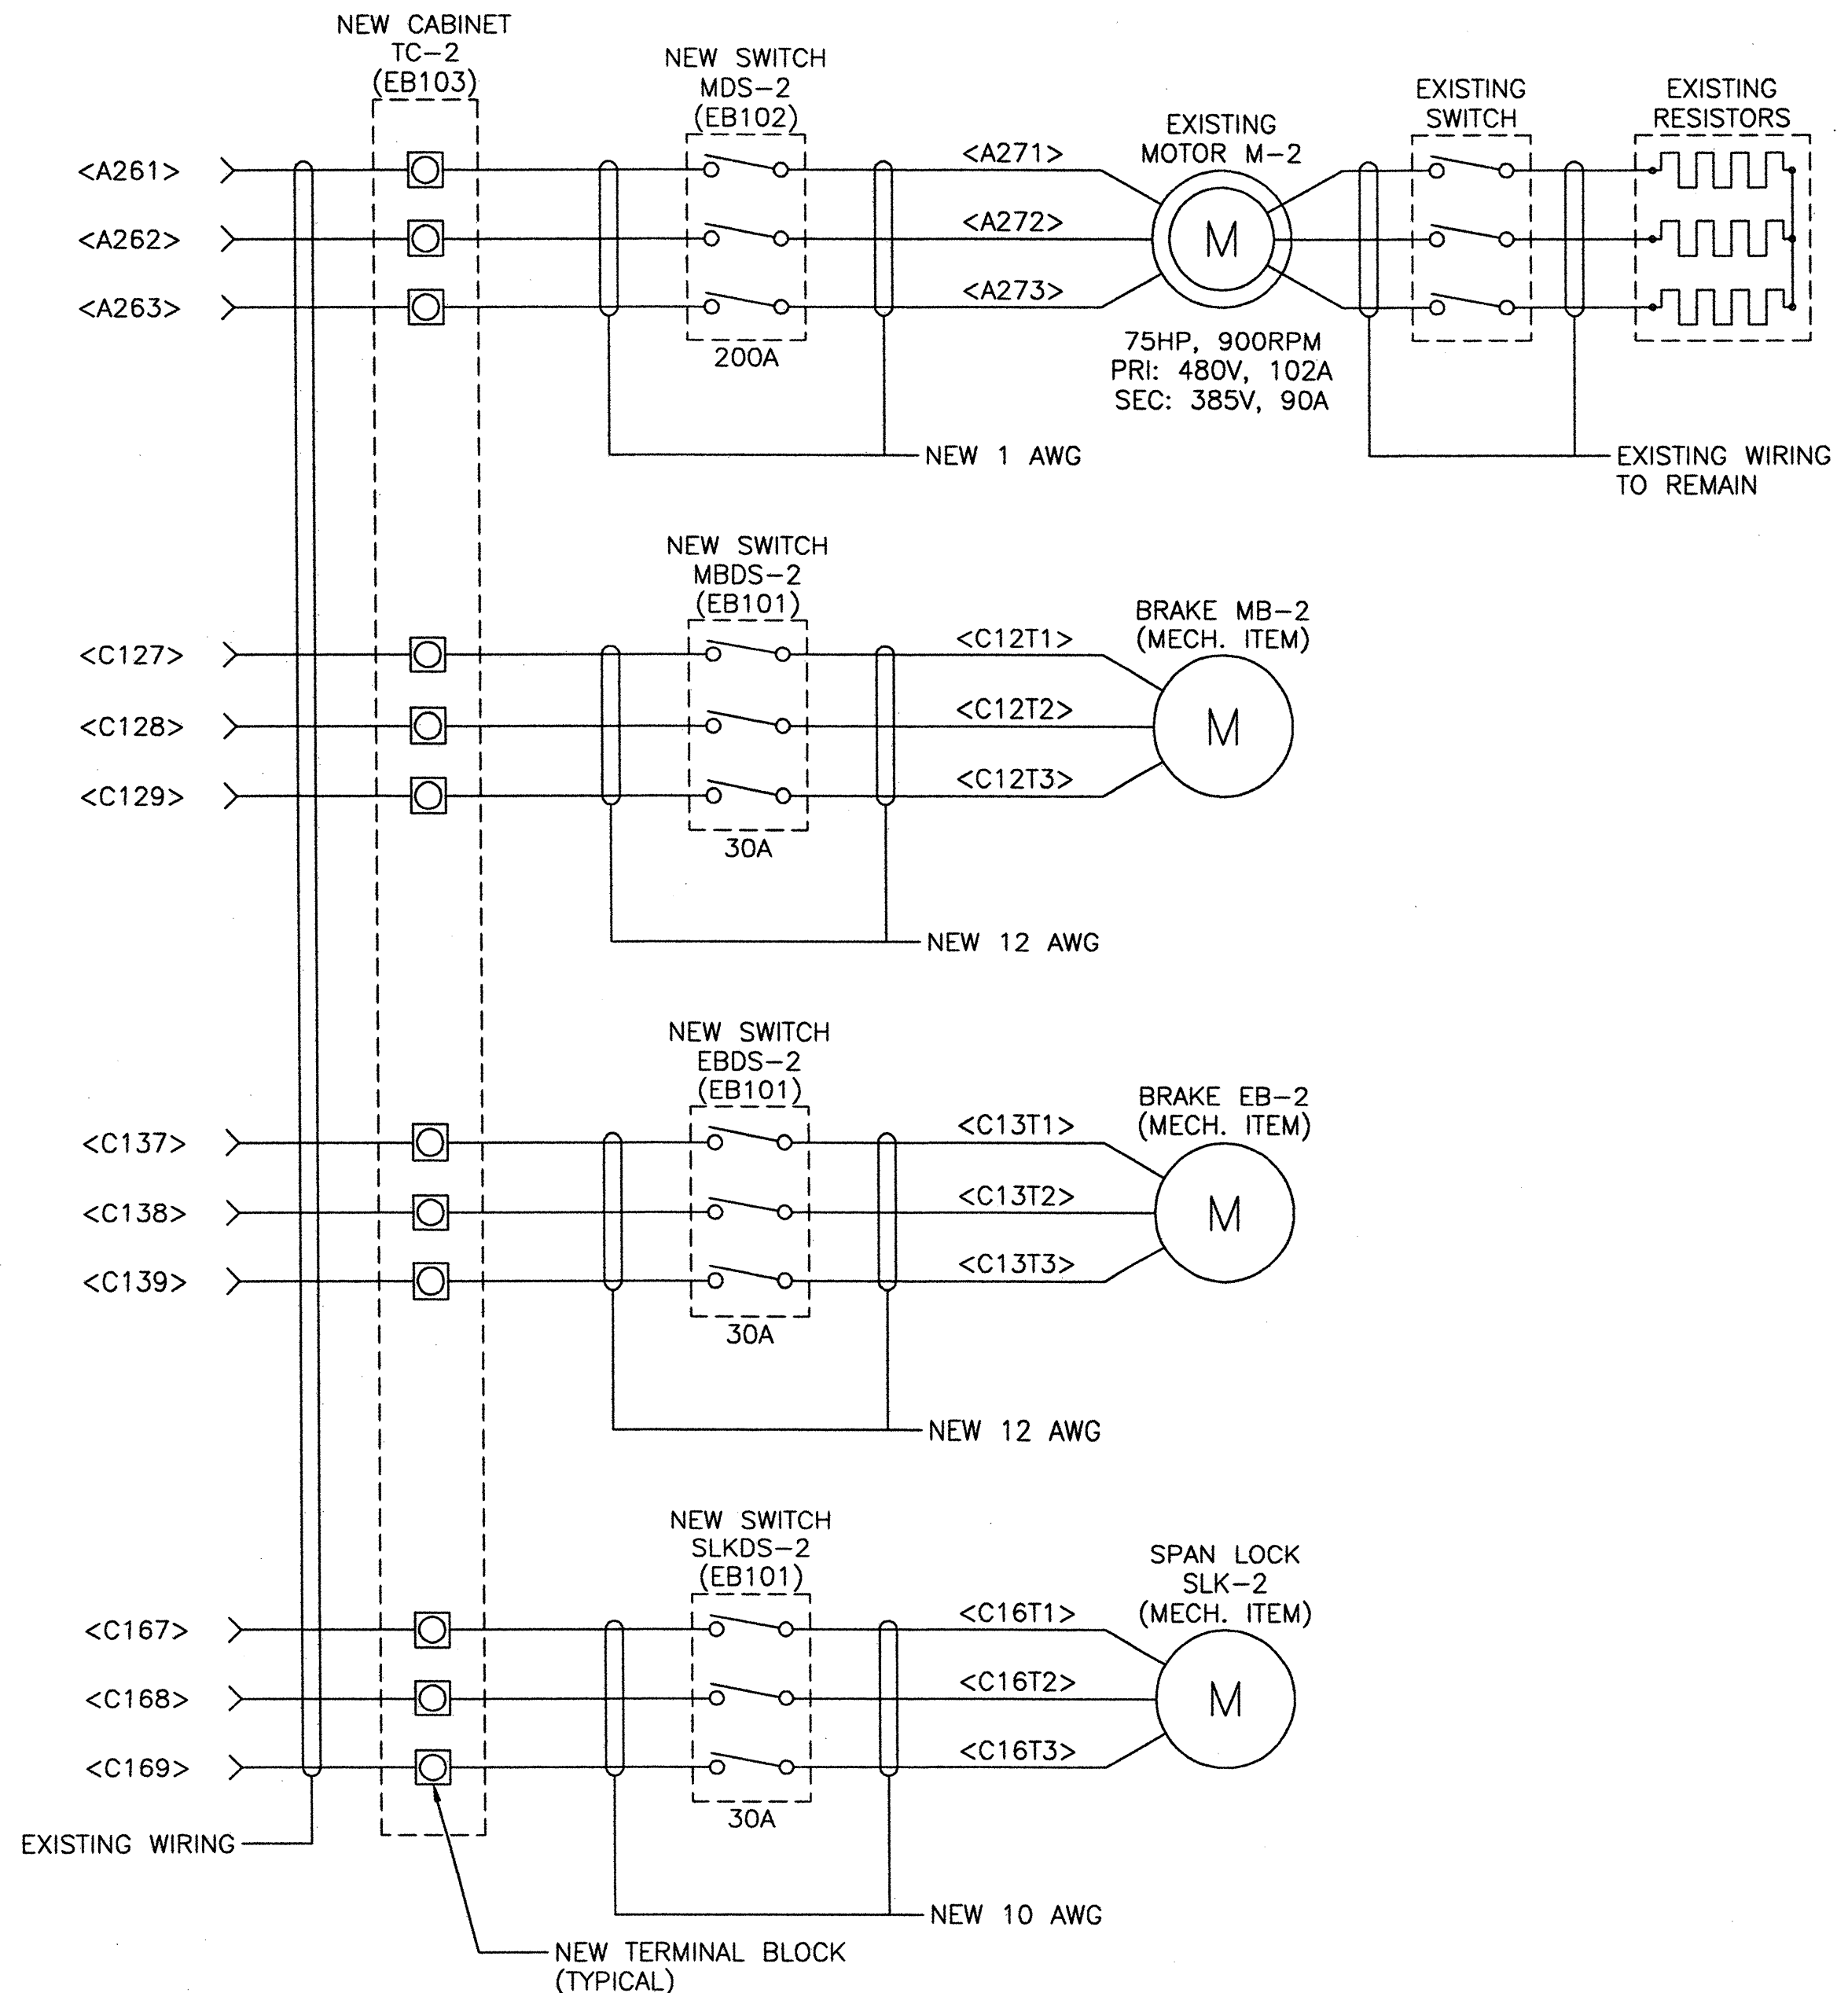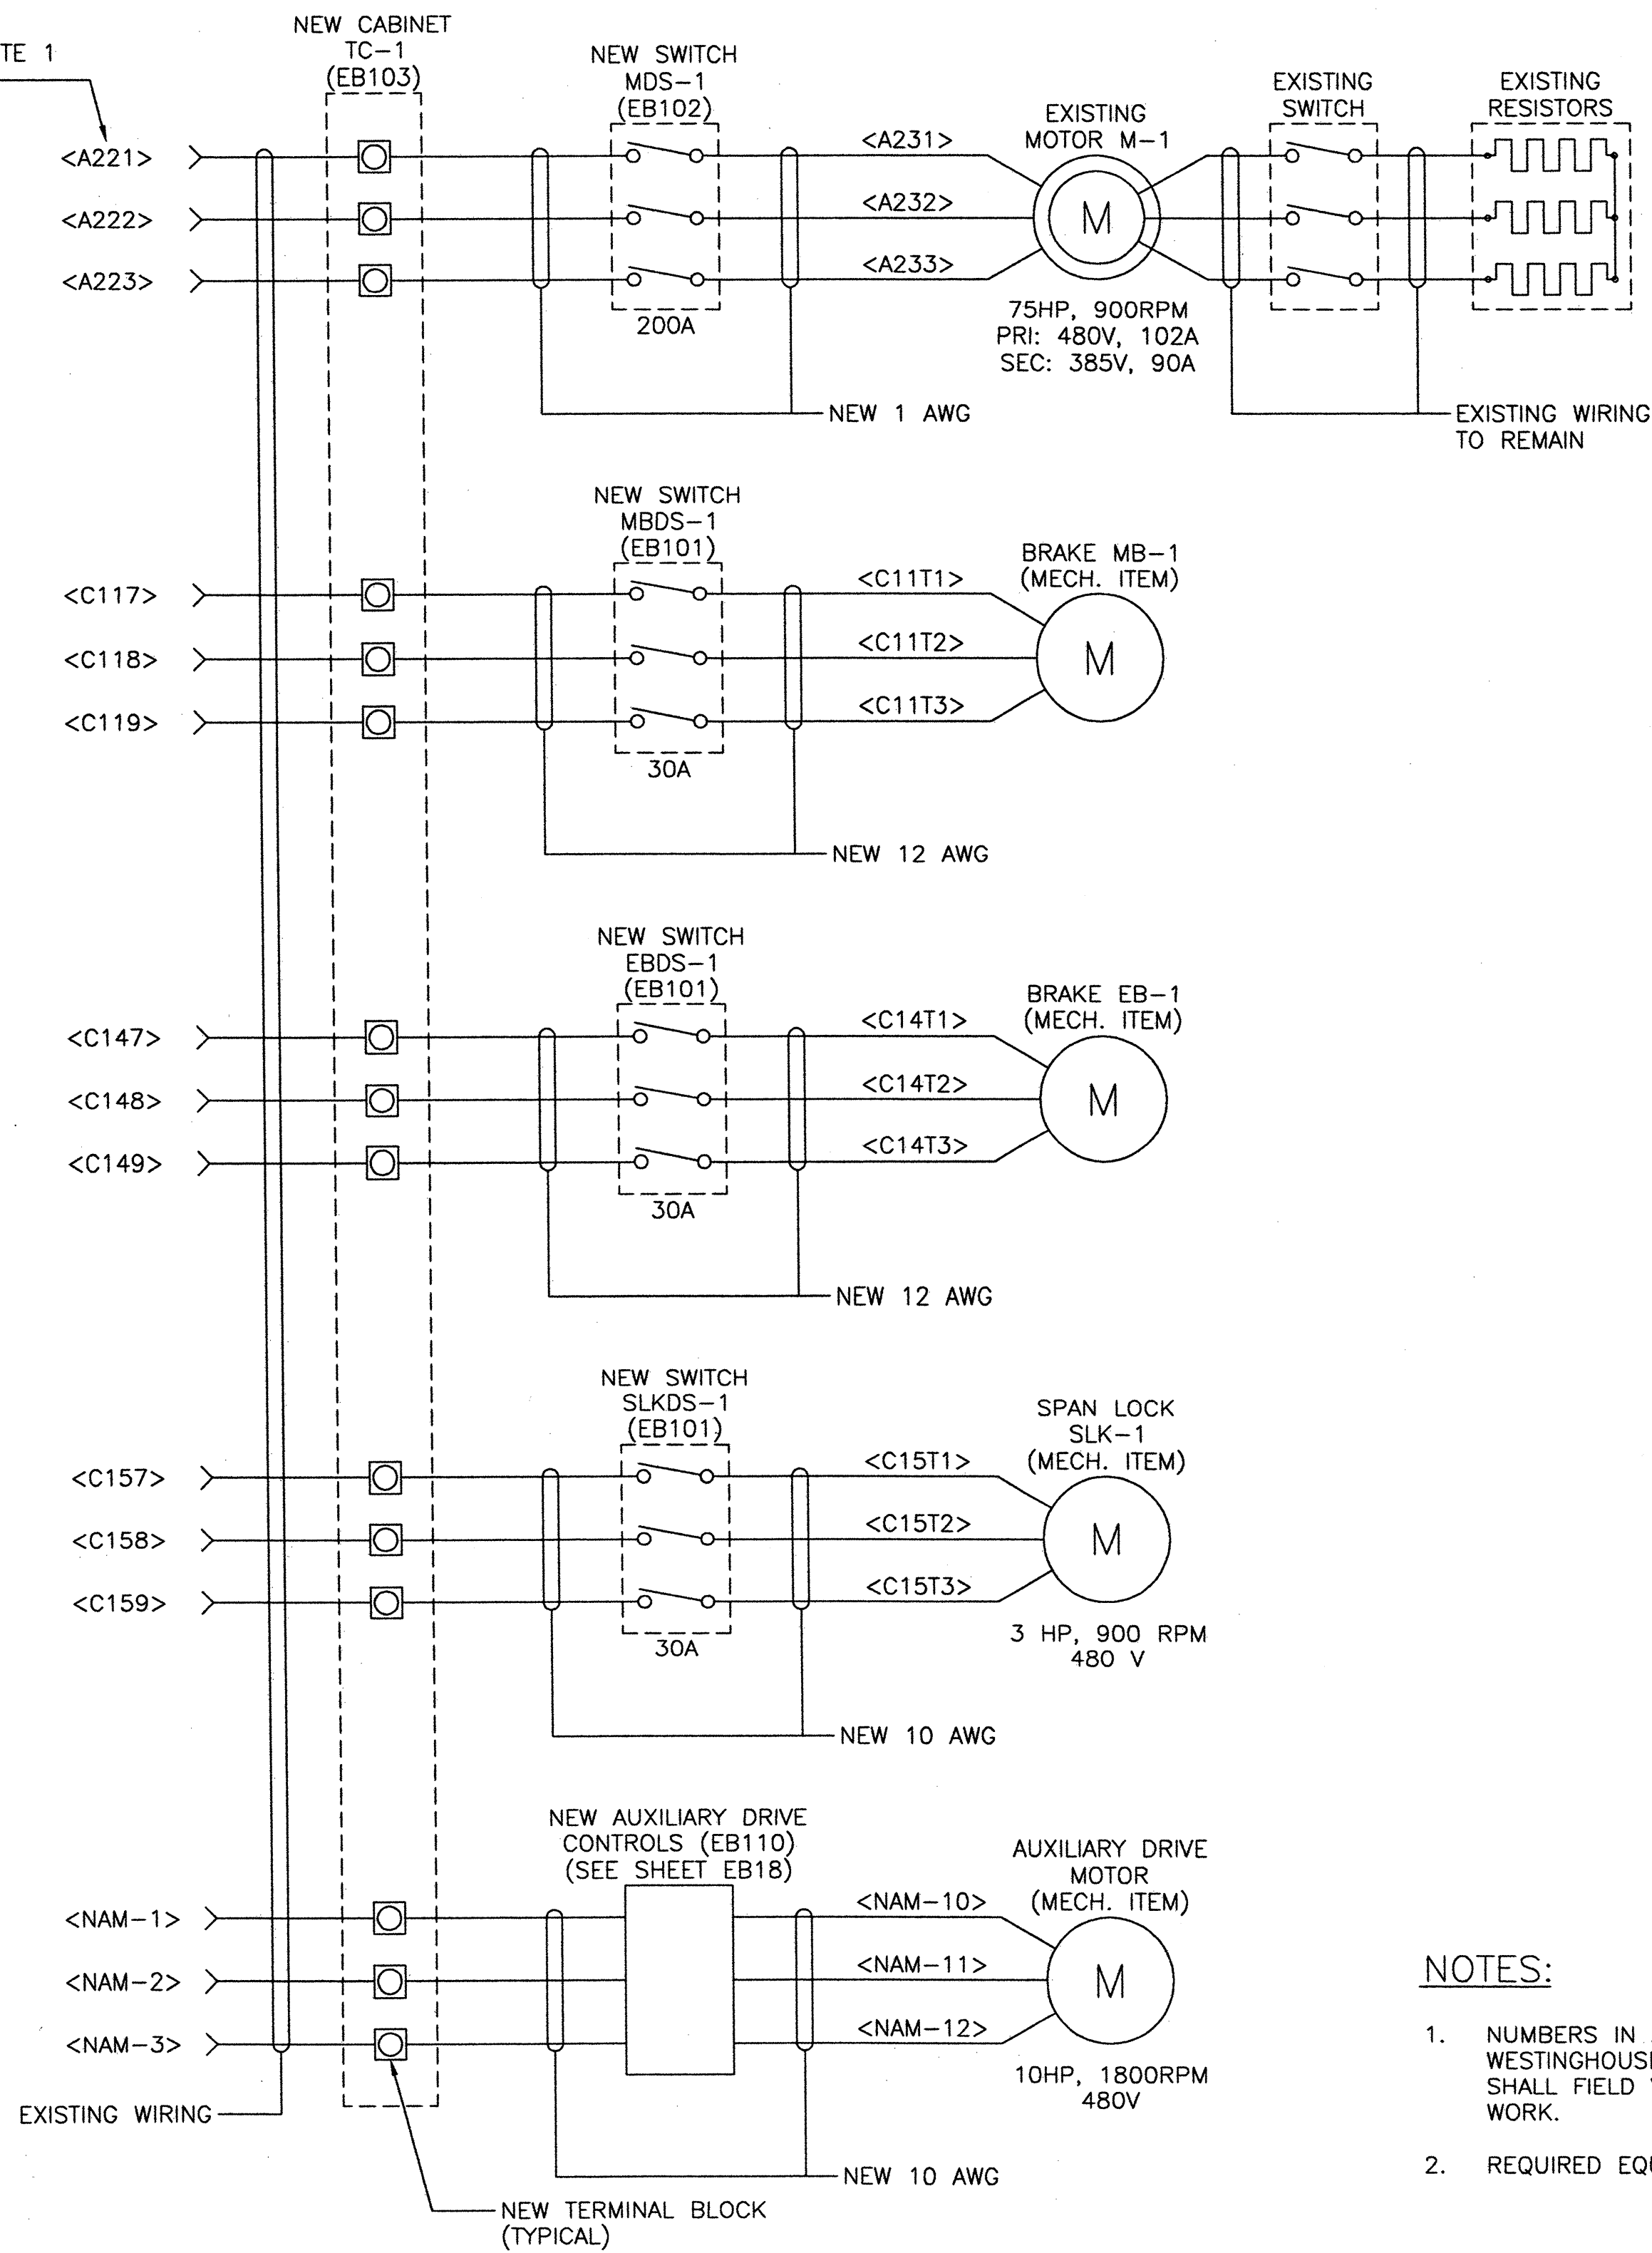


NOTES:

1. NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
2. REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.

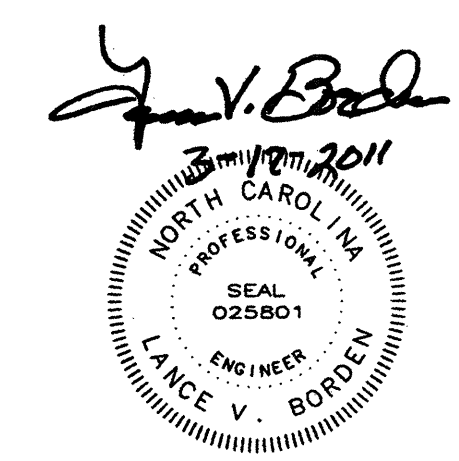



STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE			
WILMINGTON, NORTH CAROLINA			
ELECTRICAL SCHEMATICS - 5			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	40 OF 63

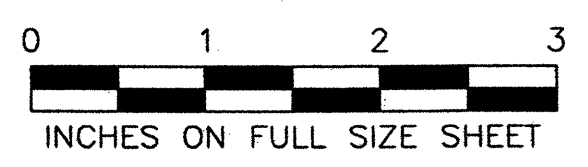

40-EB14-ESS.DWG


EB14

SEE NOTE 1
(TYP.)

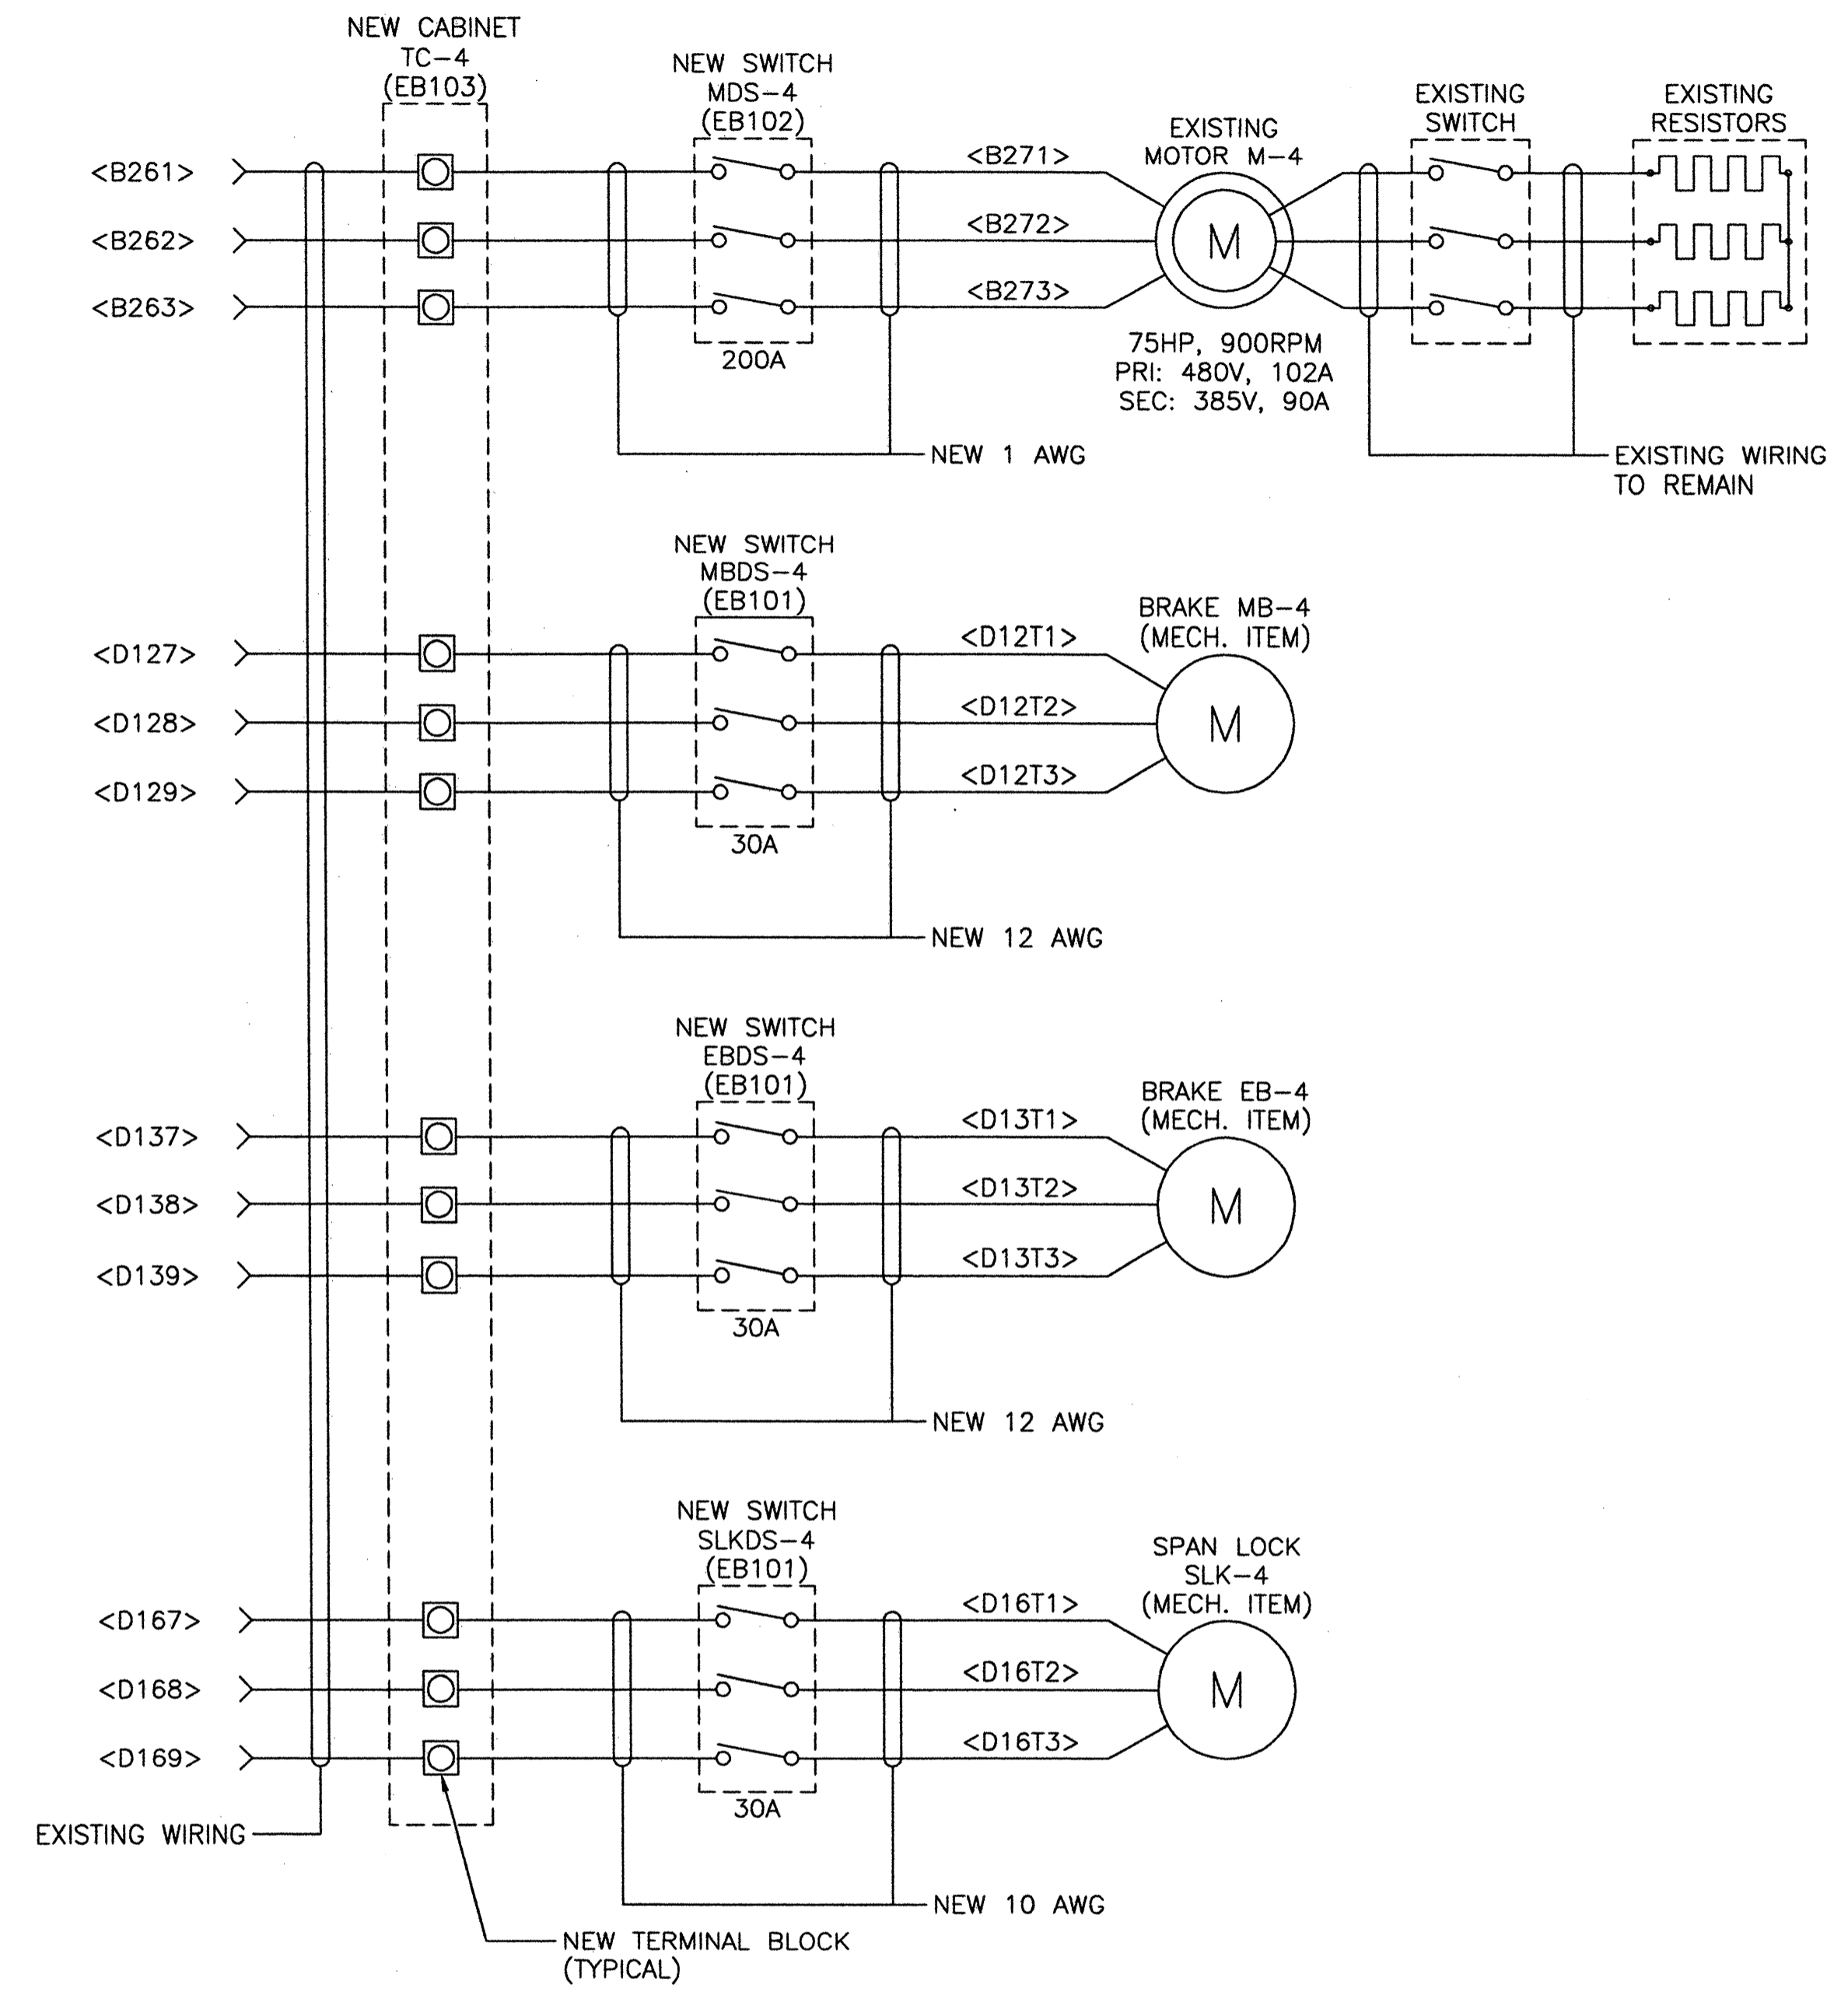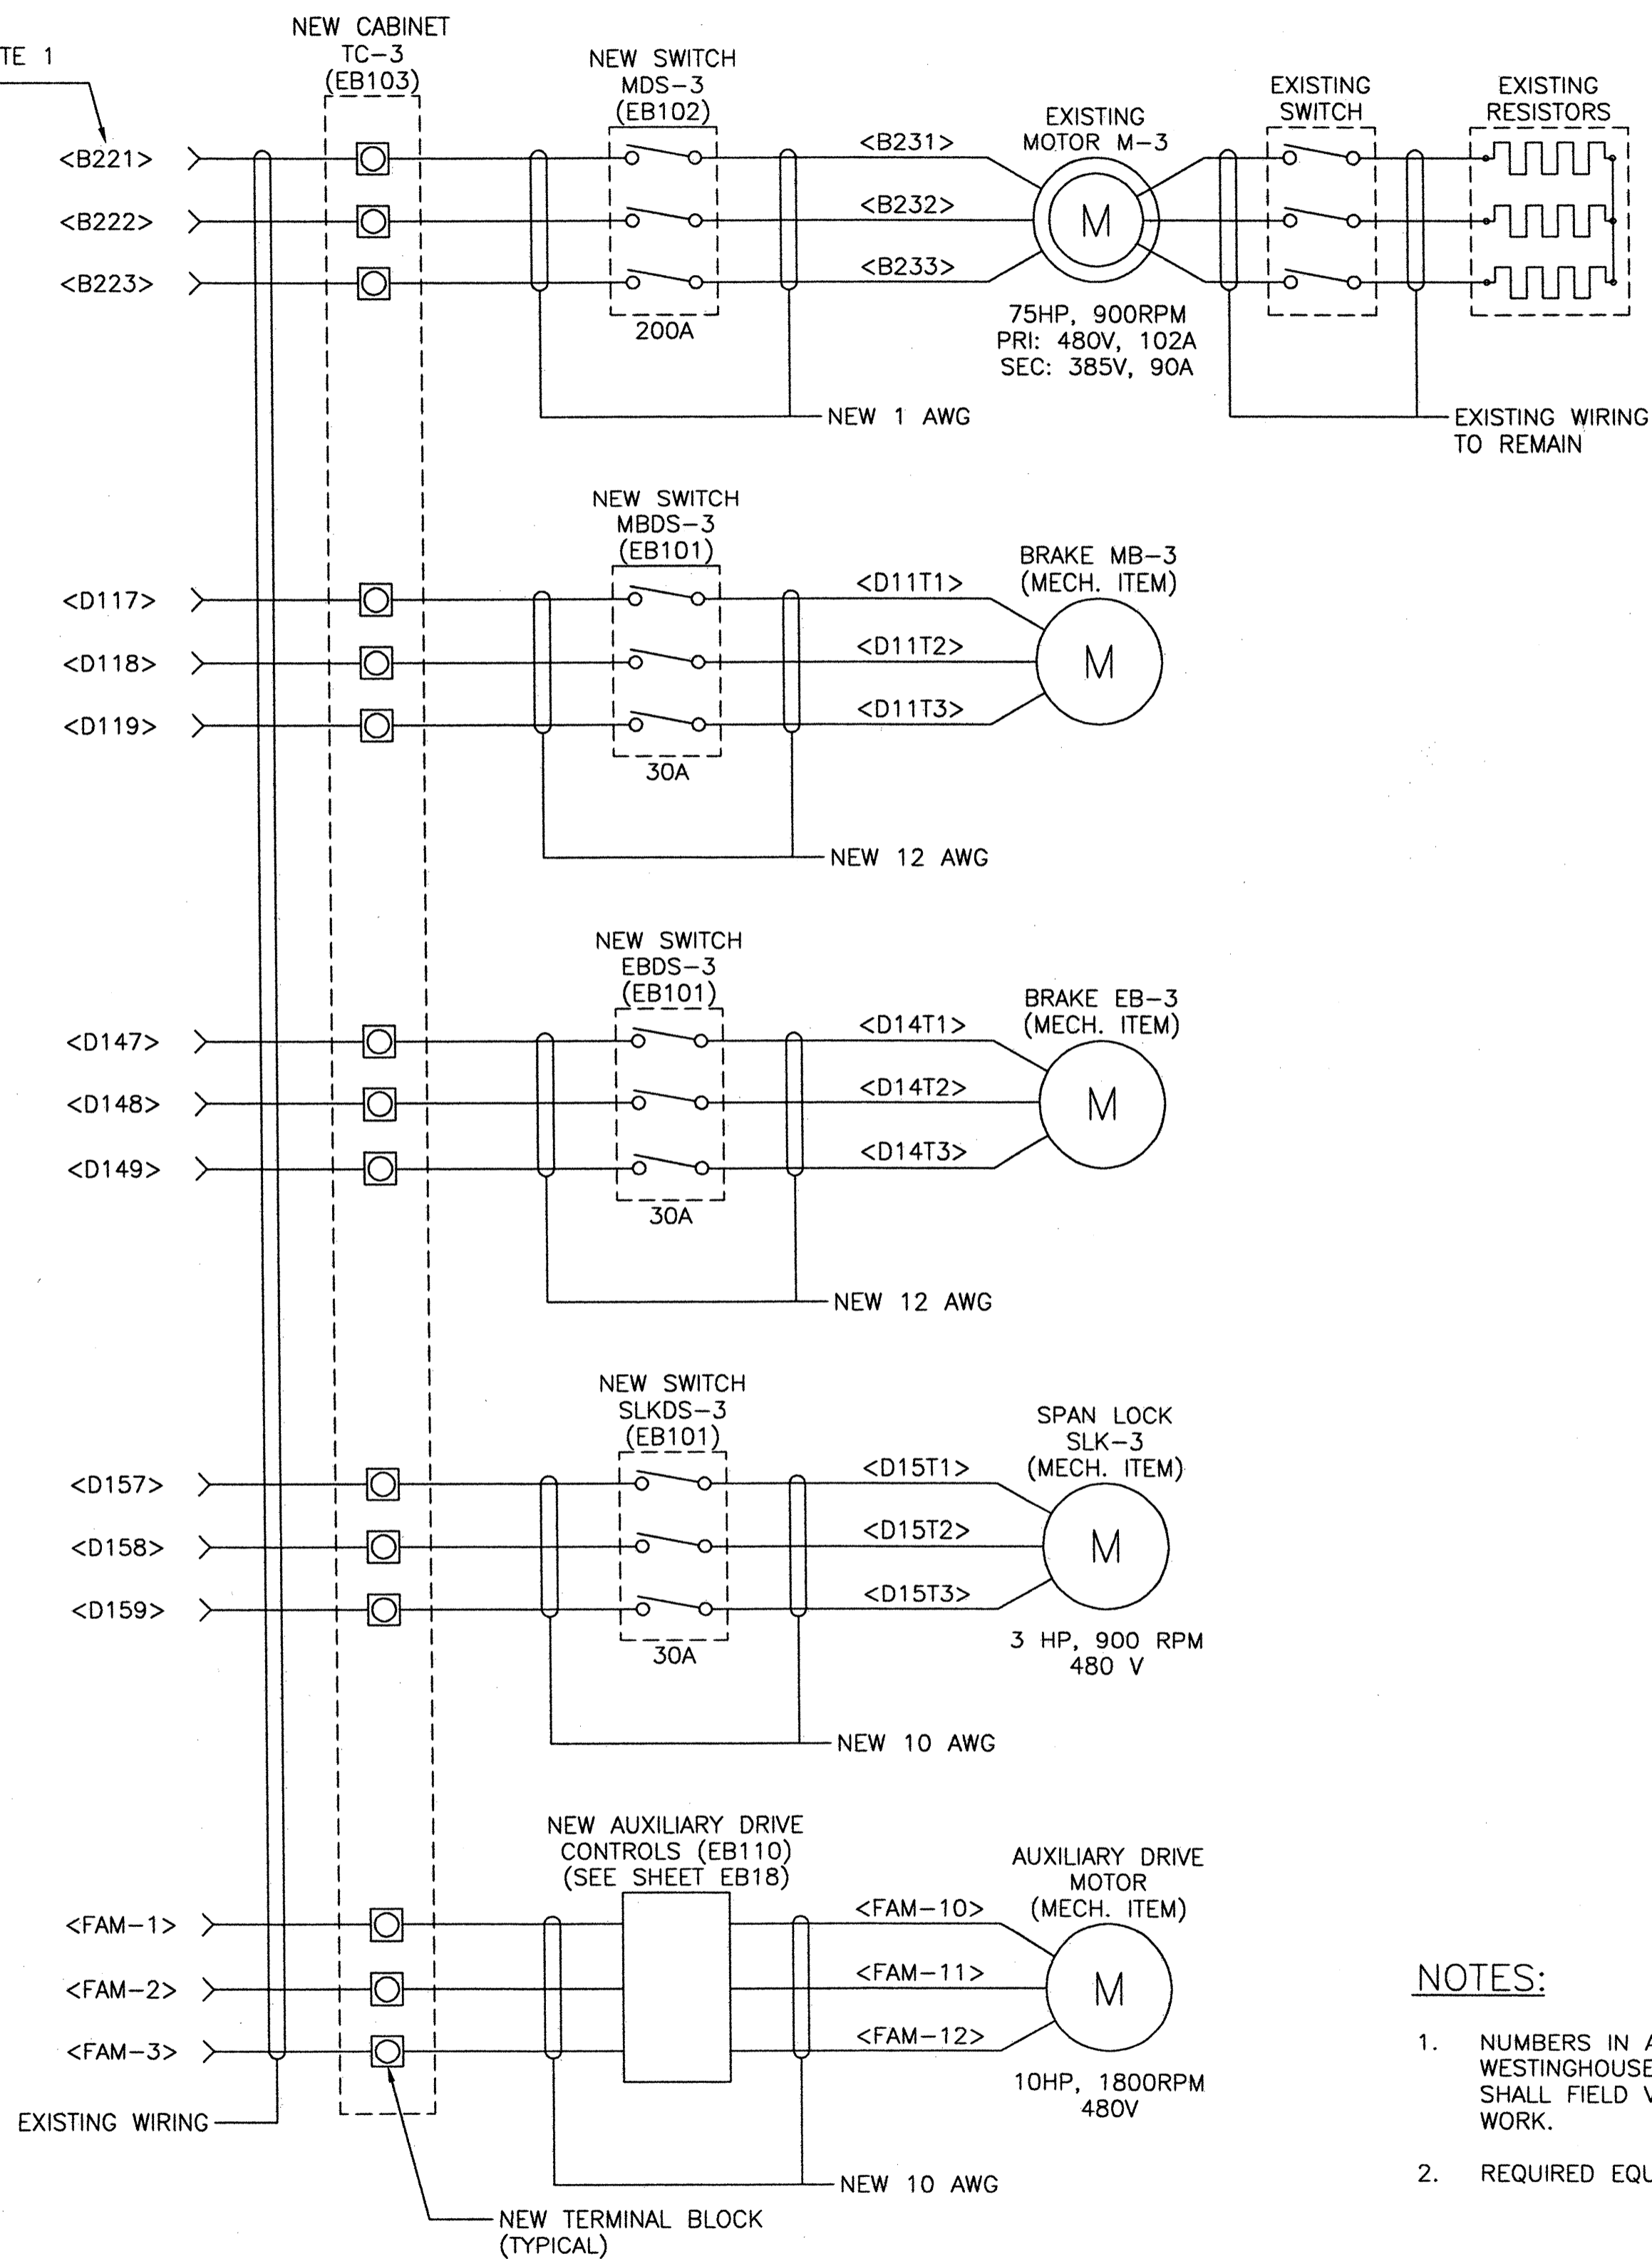


NOTES:

1. NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
2. REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.


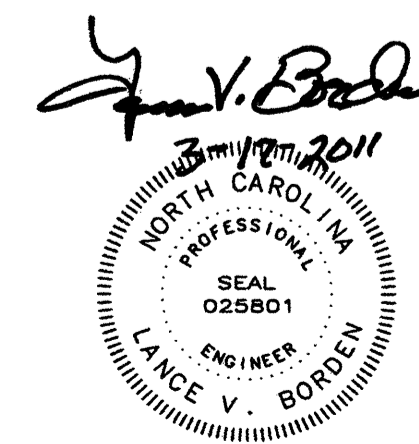


STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
ELECTRICAL SCHEMATICS - 6			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	41 OF 63

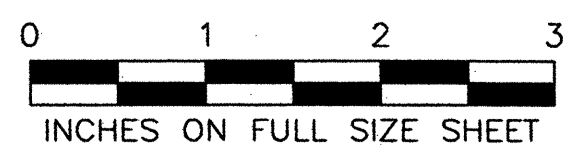



41-EB15-ESB.DWG

SEE NOTE 1
(TYP.)

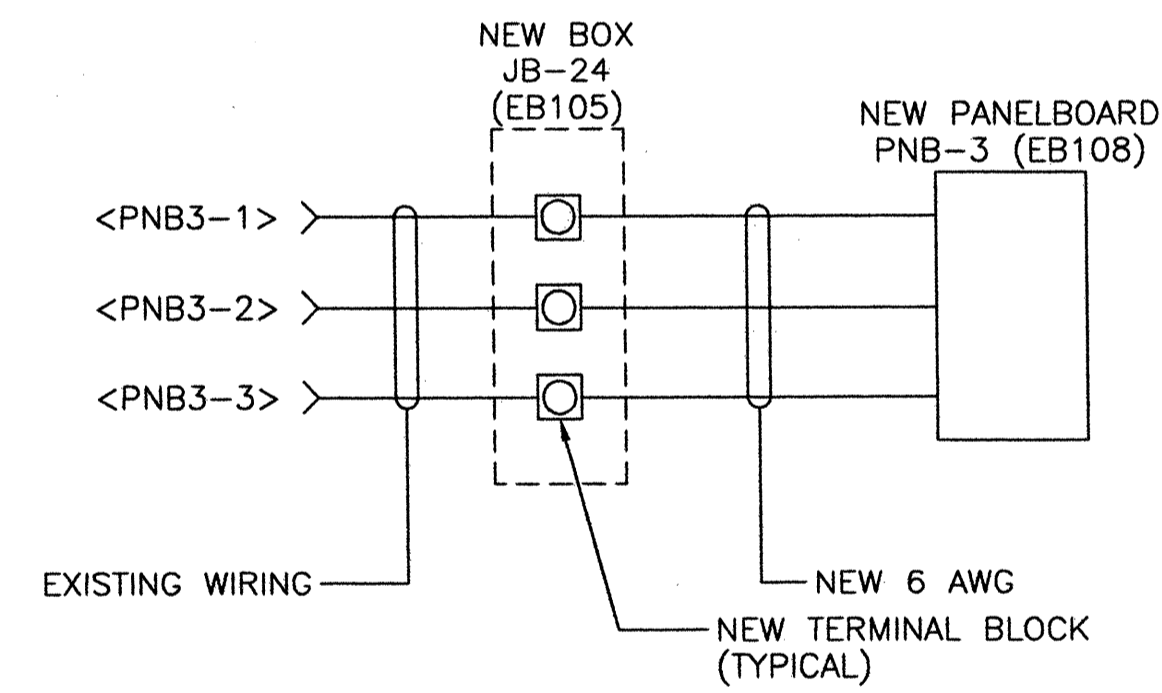
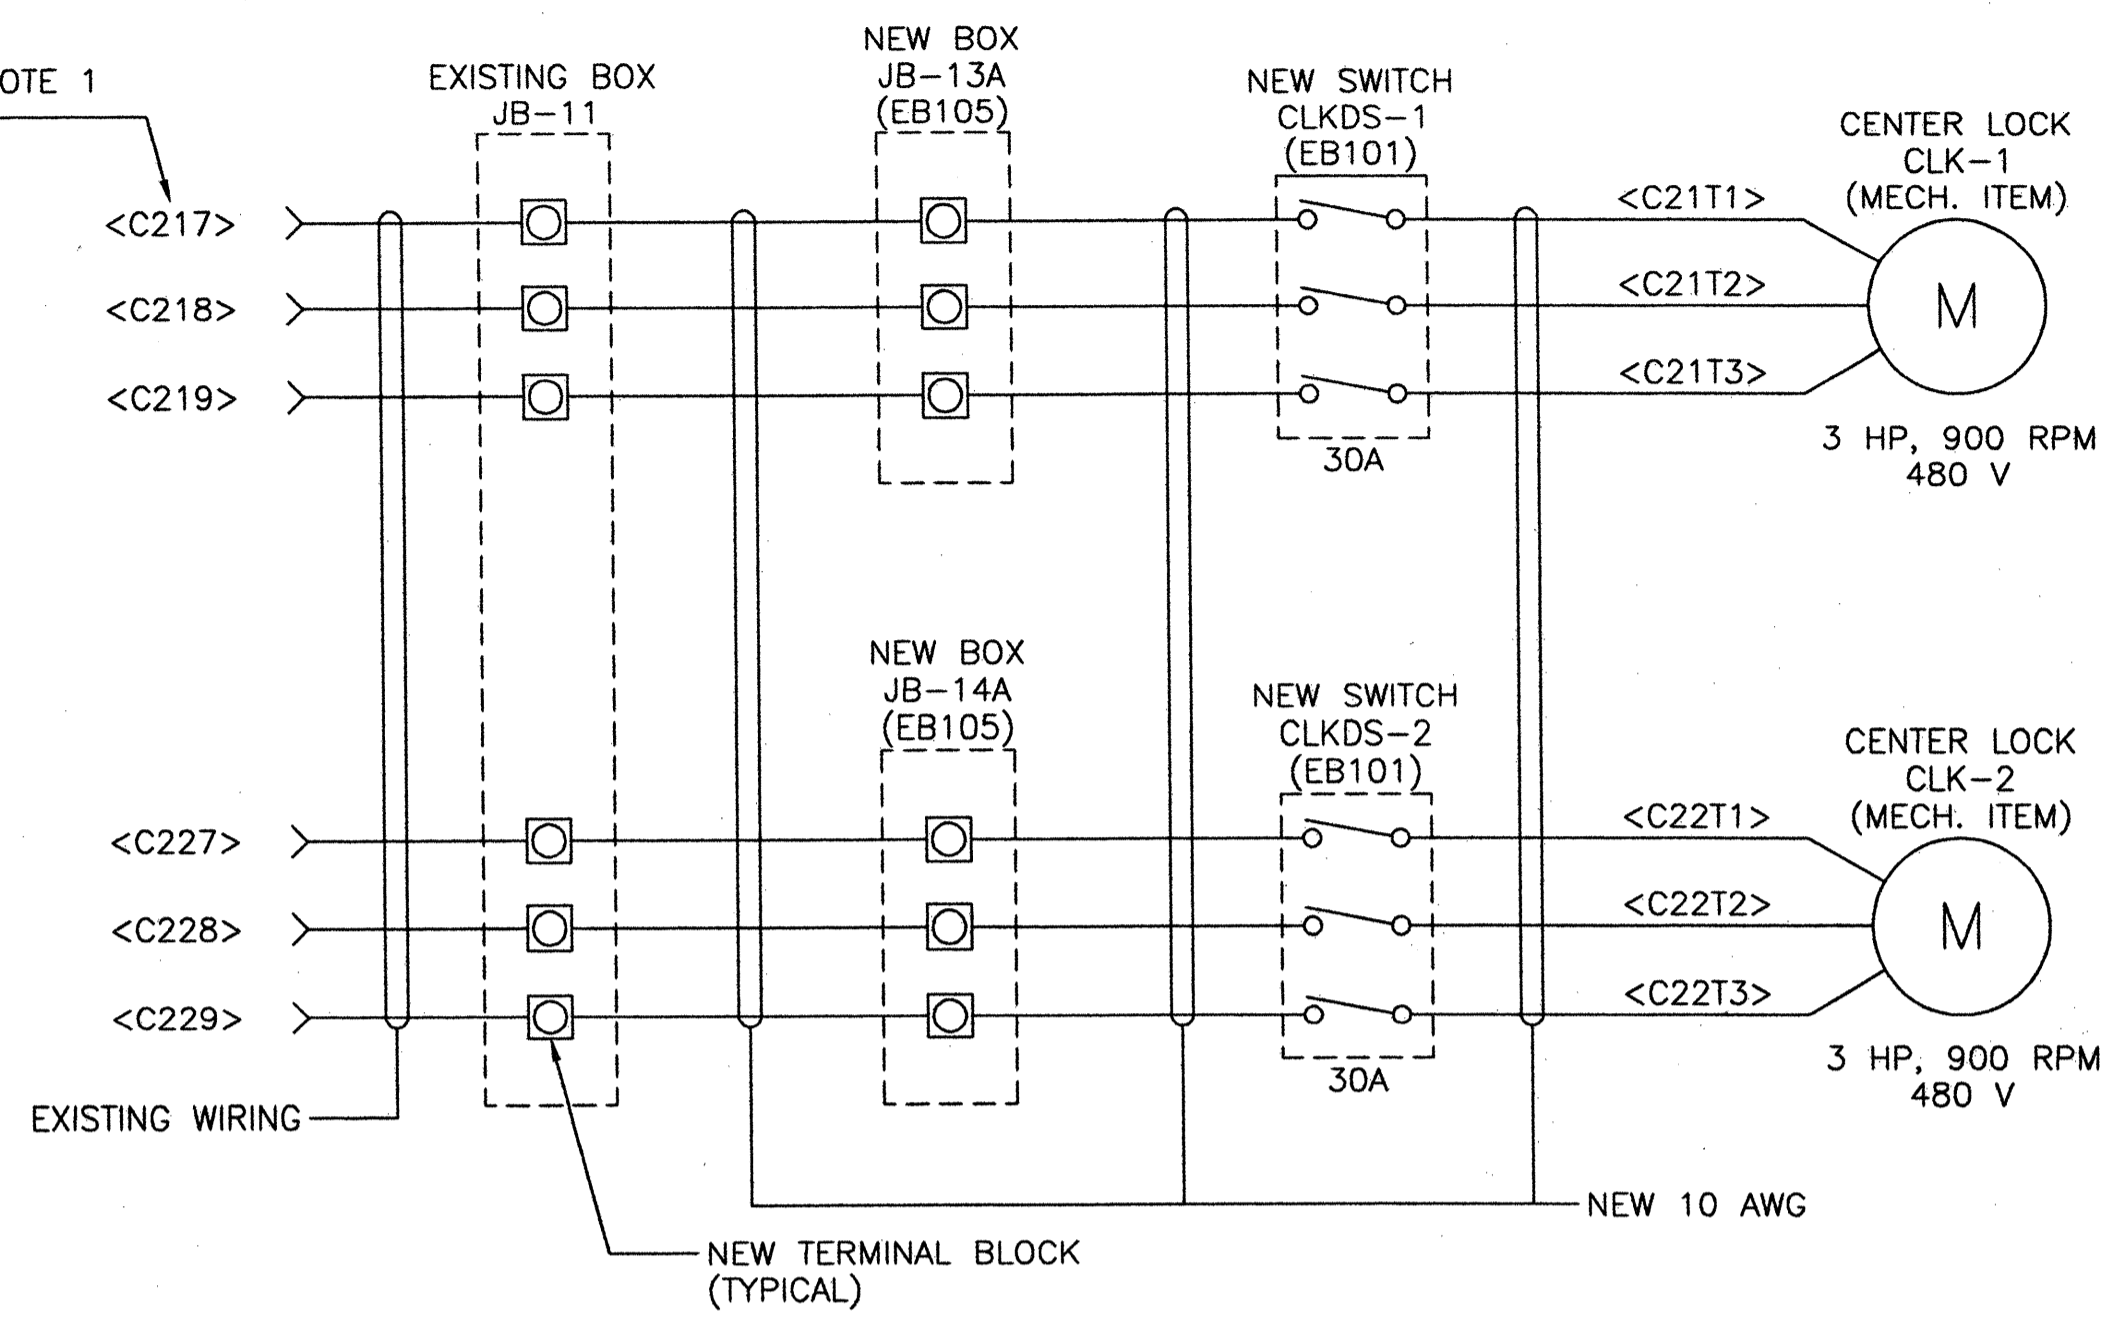


NOTES:

1. NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
2. REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.

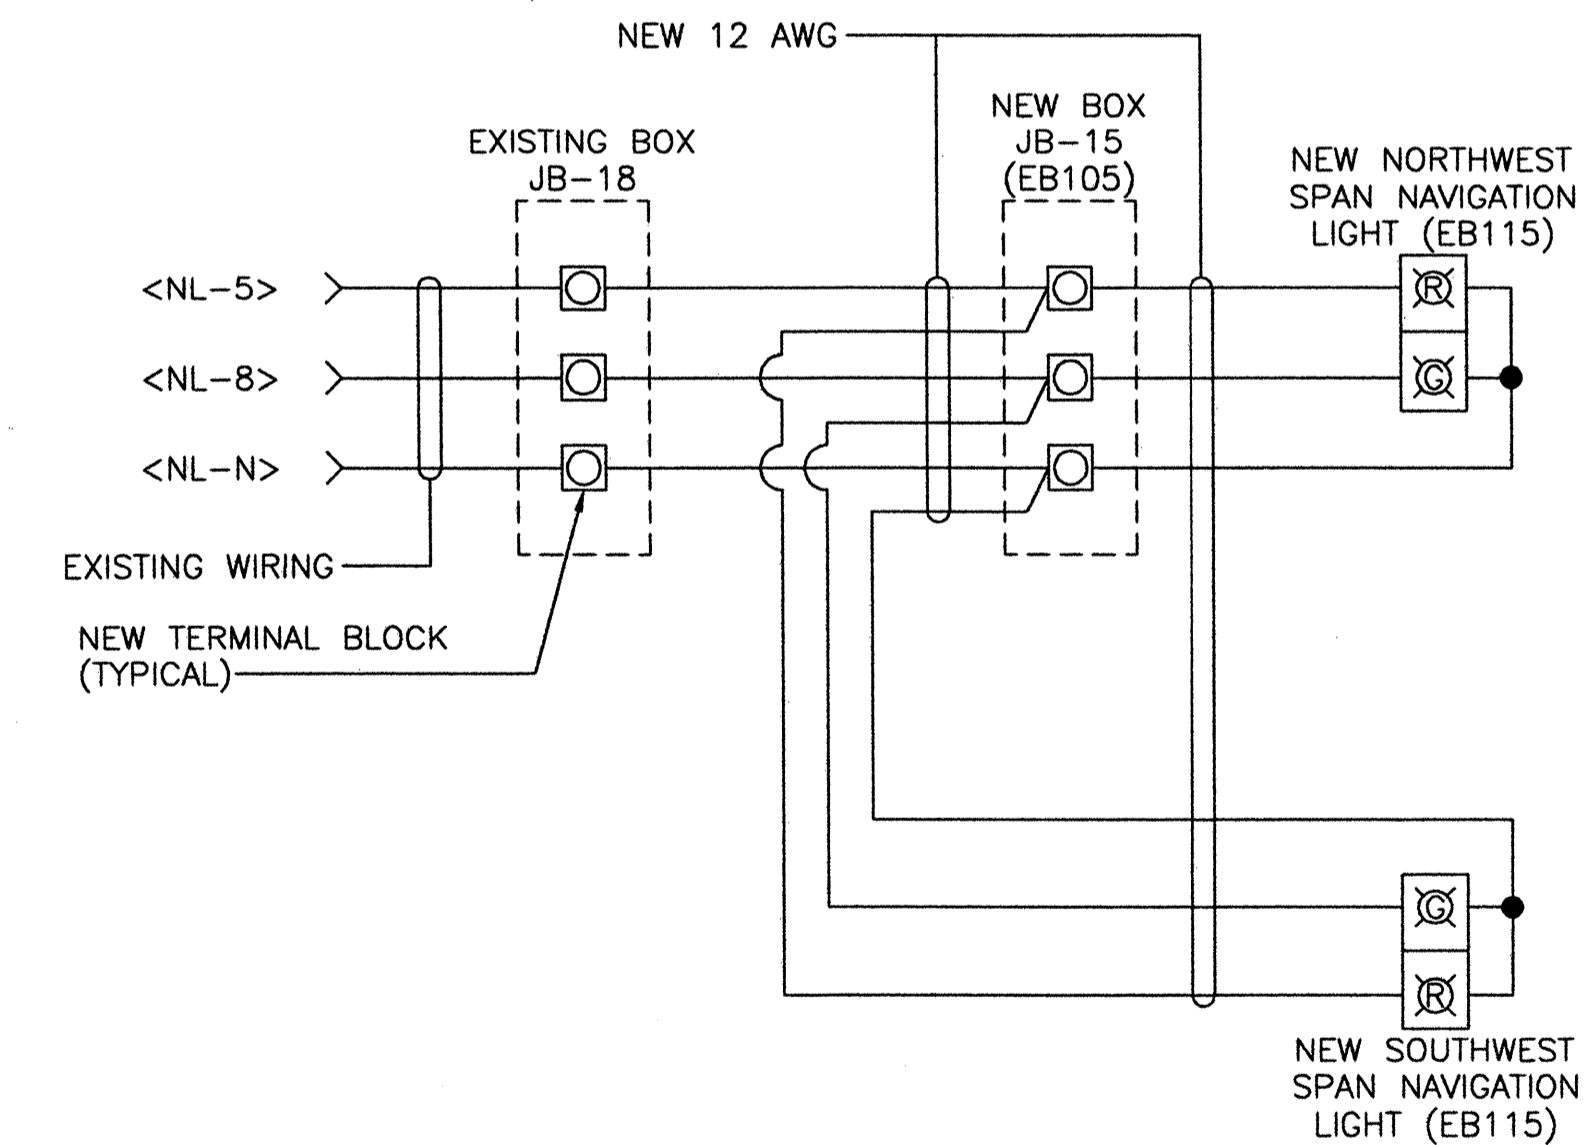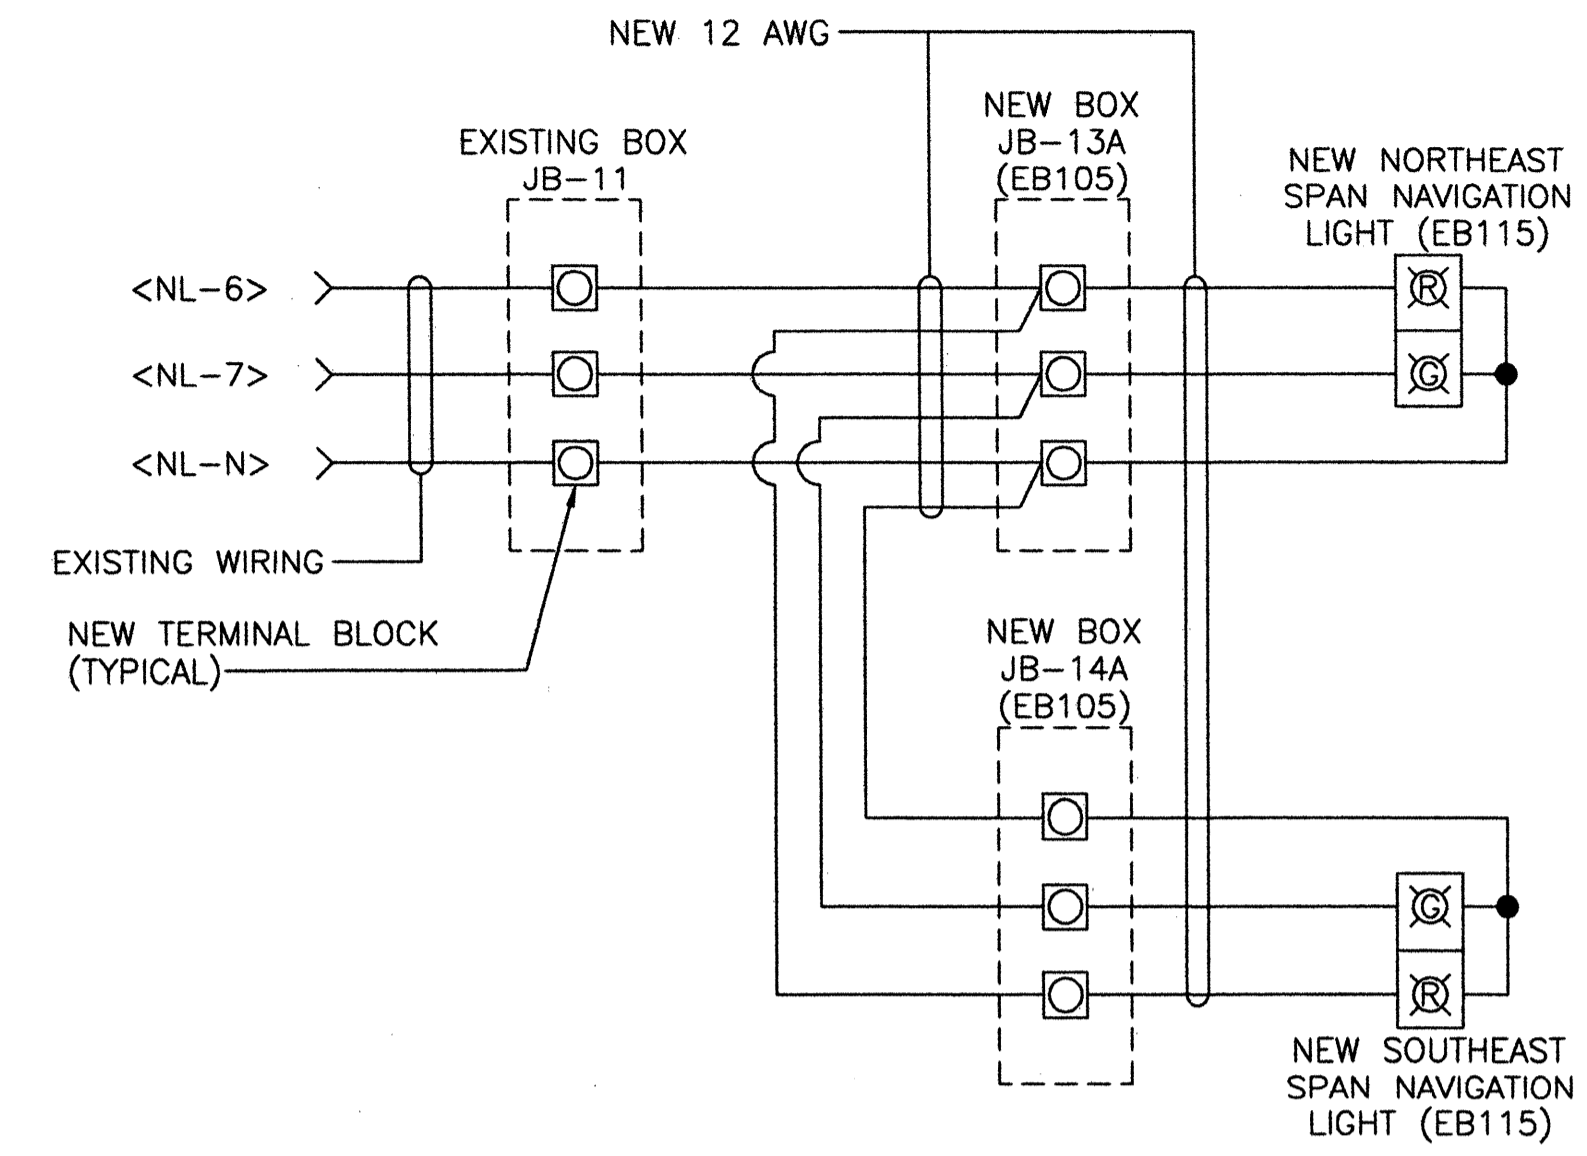

42-EB16-ES7.DWG

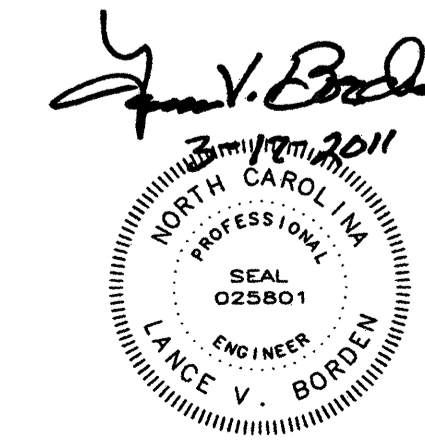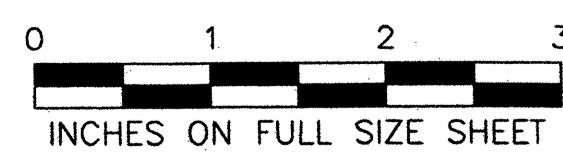



STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA

ELECTRICAL SCHEMATICS - 7



DESIGNED	N.E. ALGER	DETAILED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	CHECKED	Q.C. TON	DRAWING NO.	42 OF 63

EB16

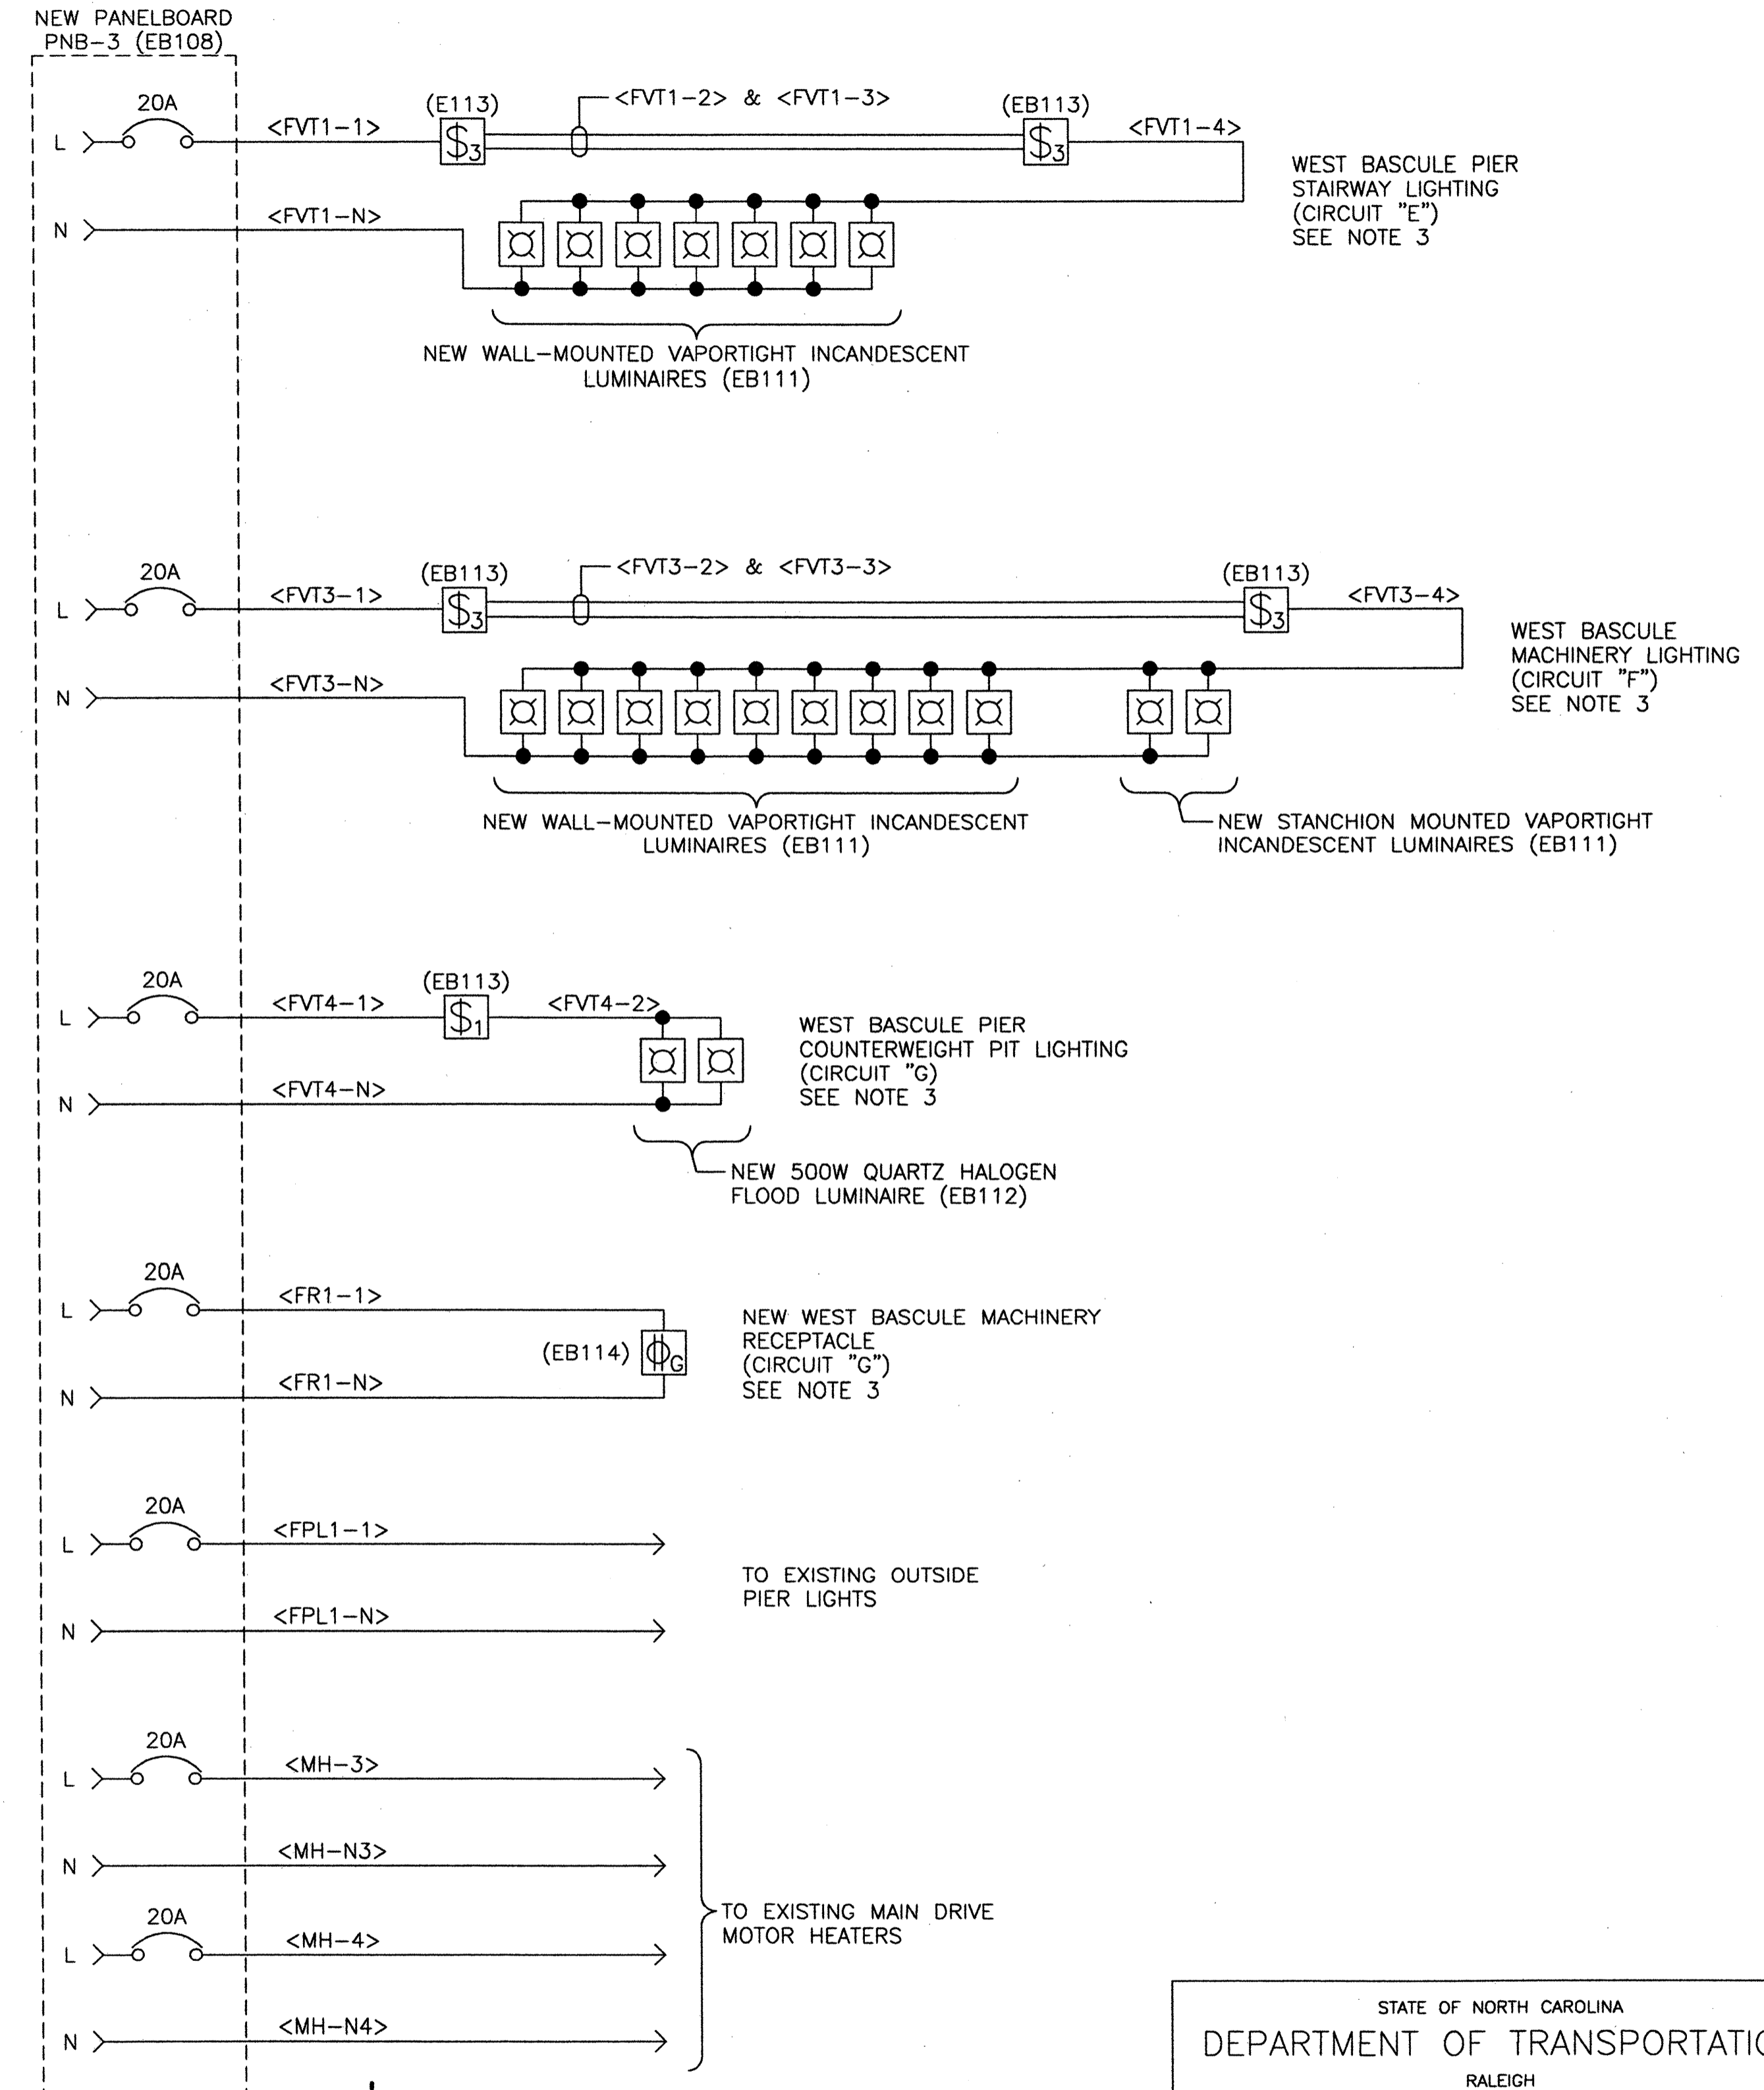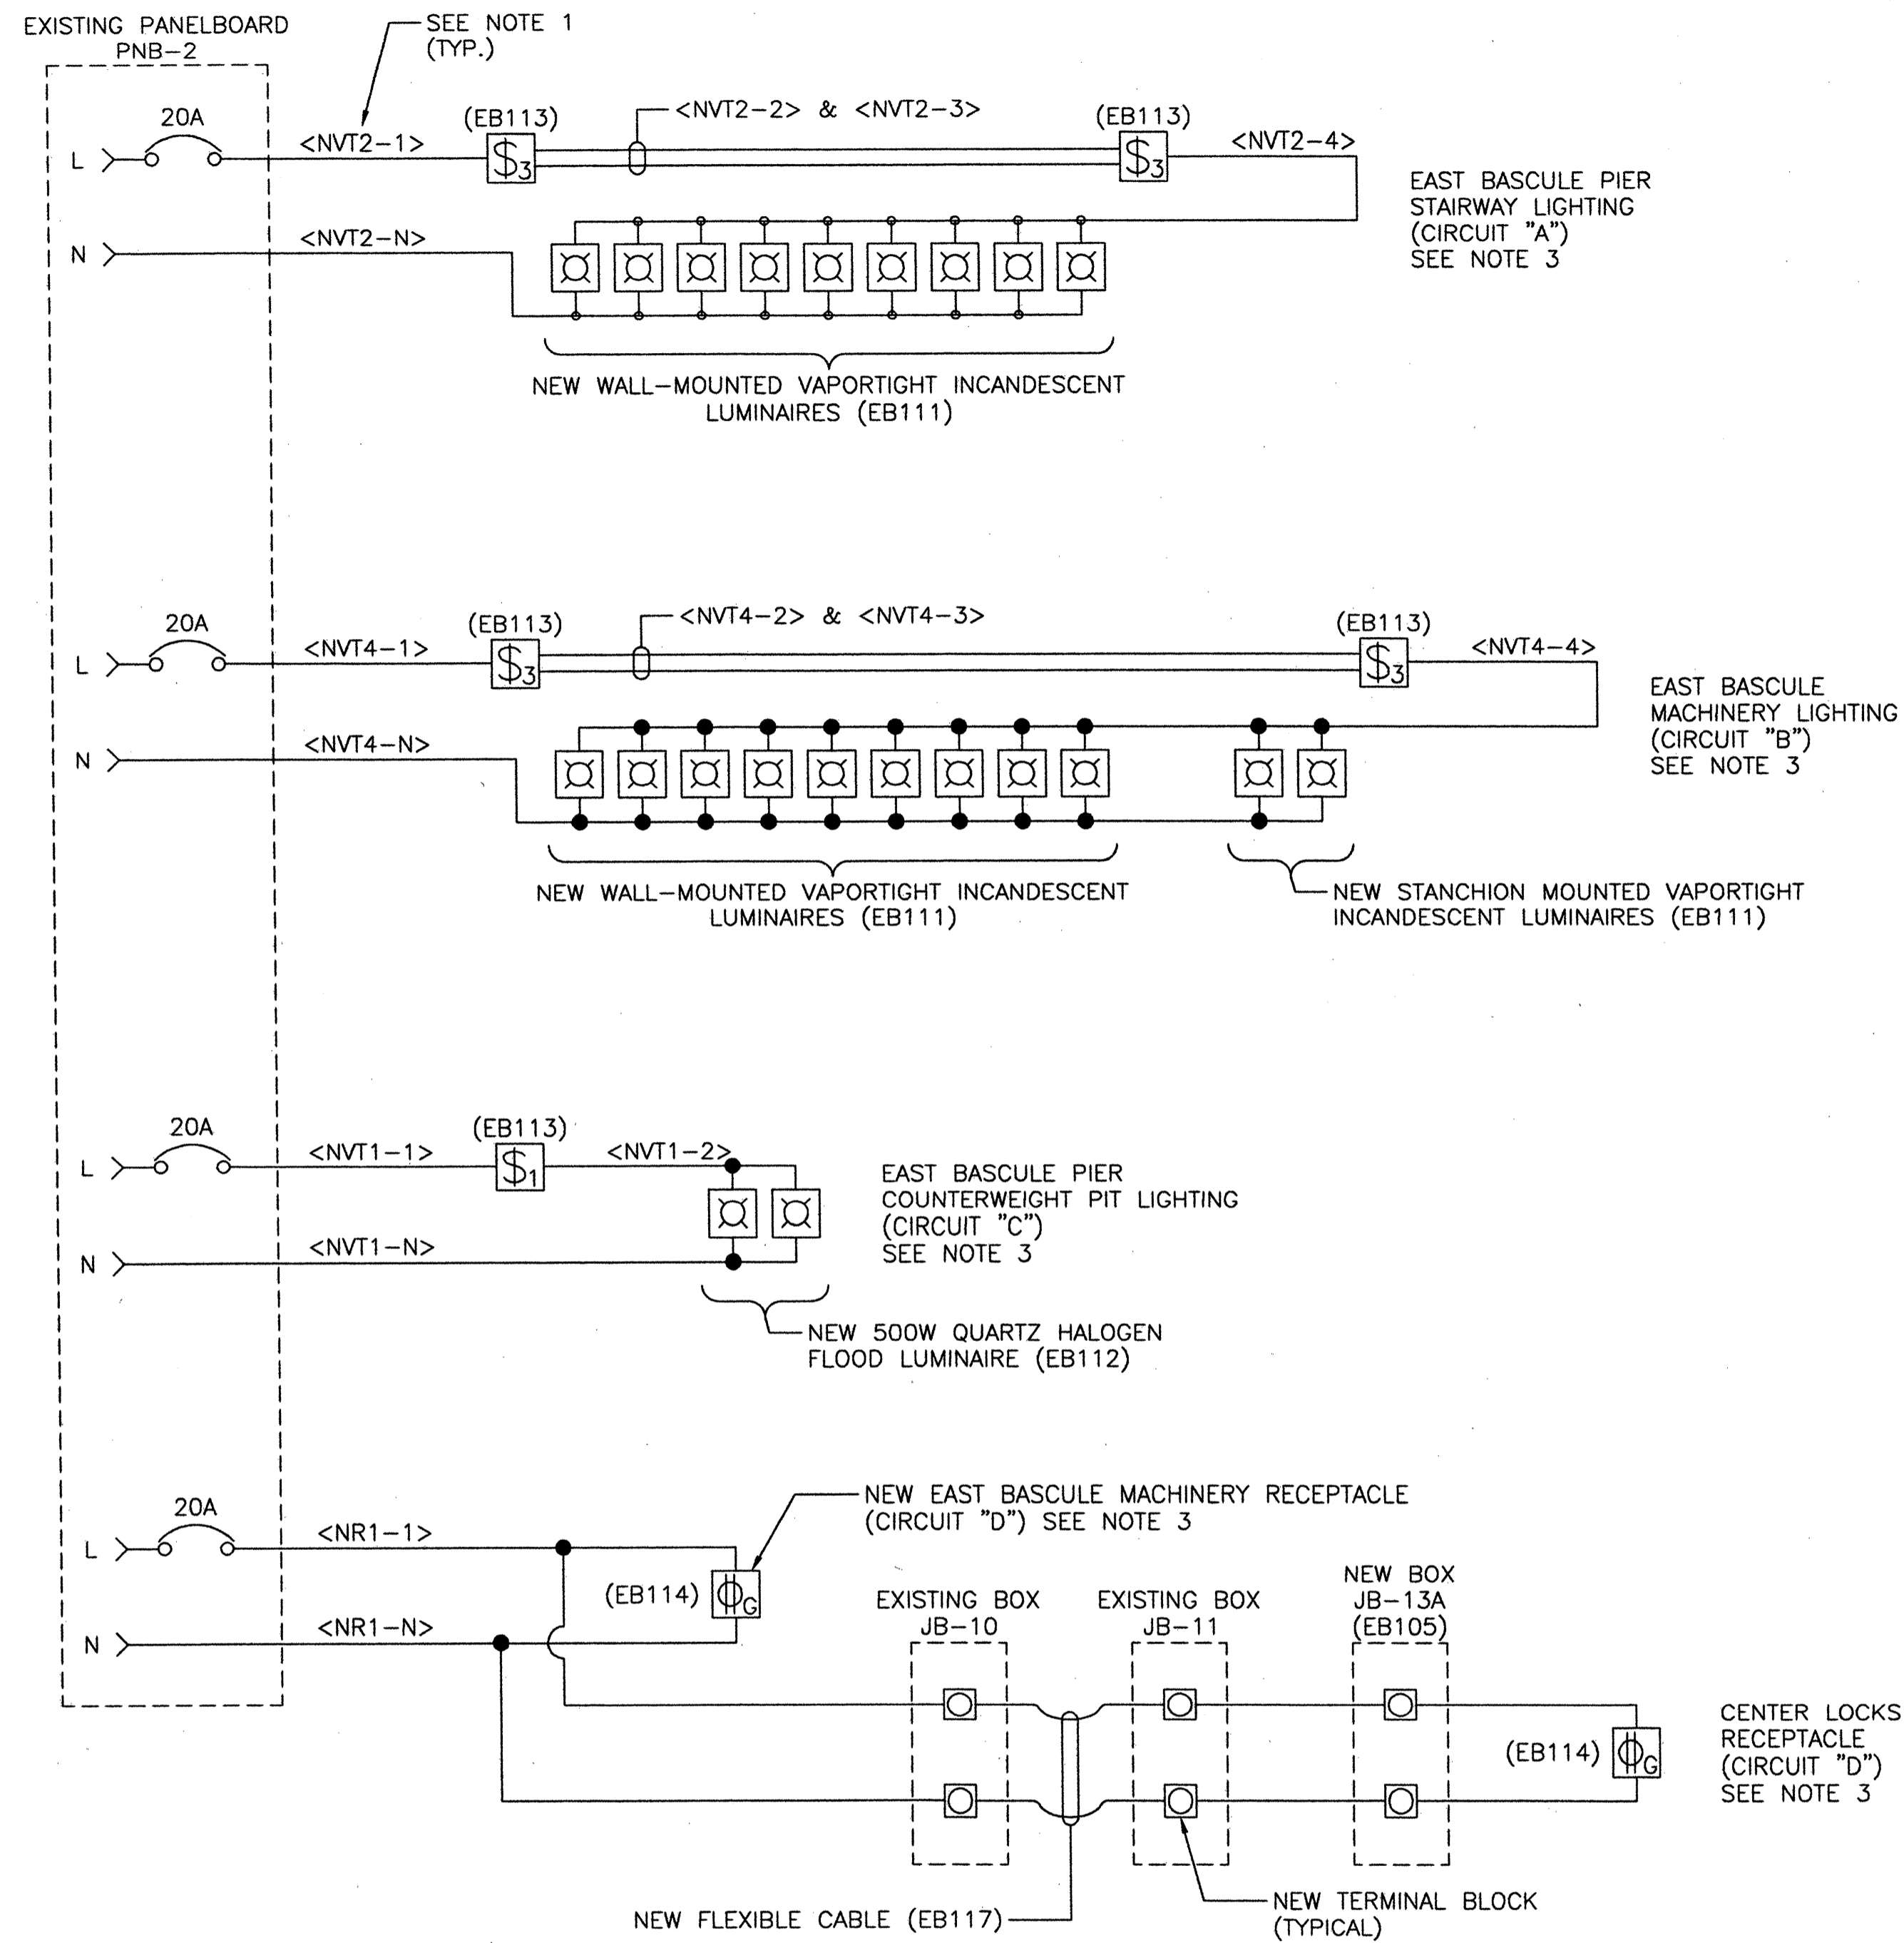


NOTES:

1. NUMBERS IN ANGLE BRACKETS ARE EXISTING WIRE NUMBERS BASED ON WESTINGHOUSE ELECTRICAL SYSTEM SHOP DRAWINGS. THE CONTRACTOR SHALL FIELD VERIFY NUMBERING BEFORE PROCEEDING WITH ANY RELATED WORK.
2. REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.
3. ALL WIRING FOR LIGHTING AND RECEPTACLE CIRCUITS IS NEW, MINIMUM 12 AWG.

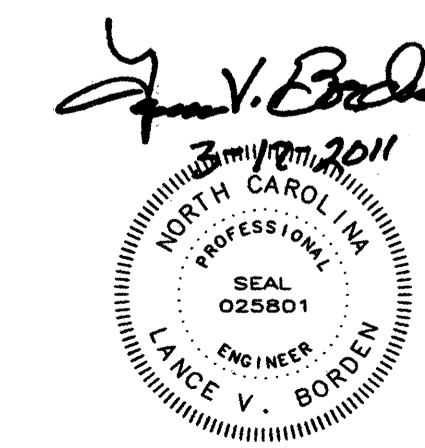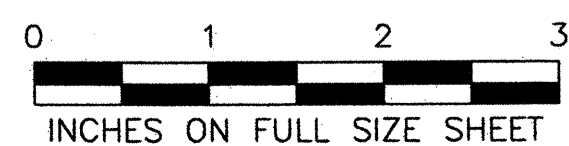

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE			
WILMINGTON, NORTH CAROLINA			
ELECTRICAL SCHEMATICS - 8			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	43 OF 63

EB17

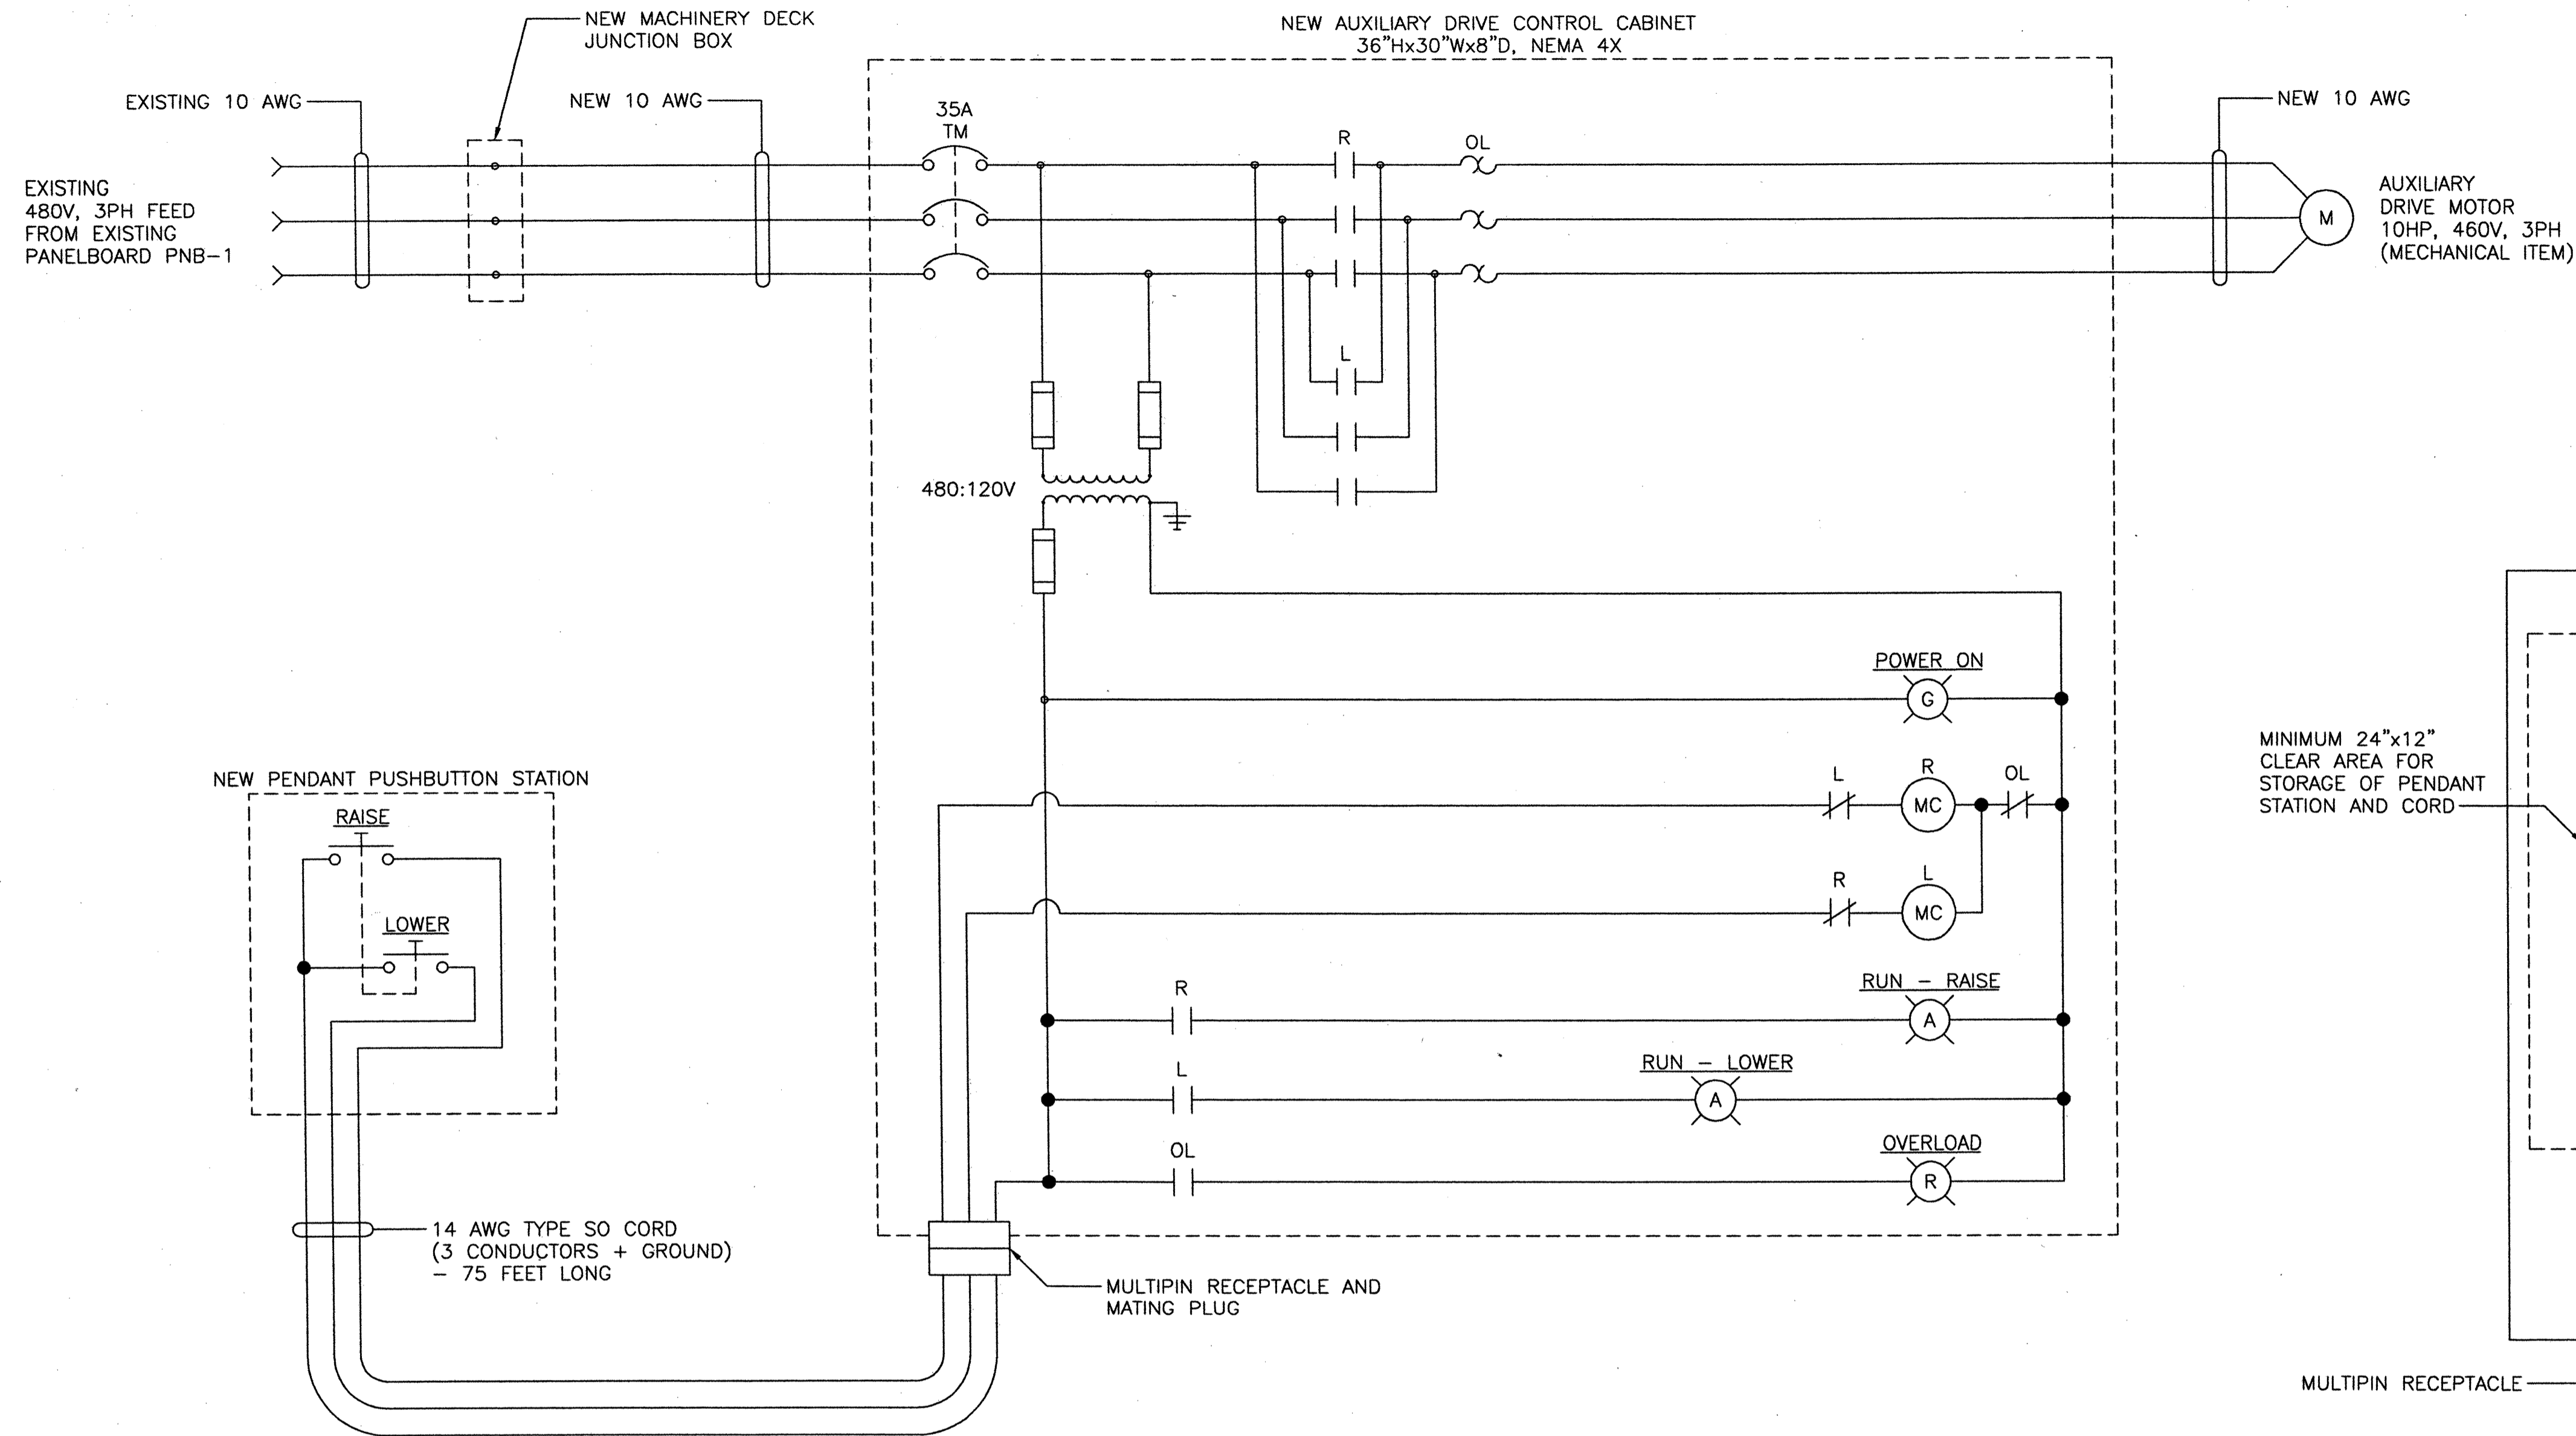


NEW AUXILIARY DRIVE CONTROL - SCHEMATIC

SCALE: NONE

TYPICAL NEW NEARSIDE AND FARMSIDE CONTROLS.

(EB110)

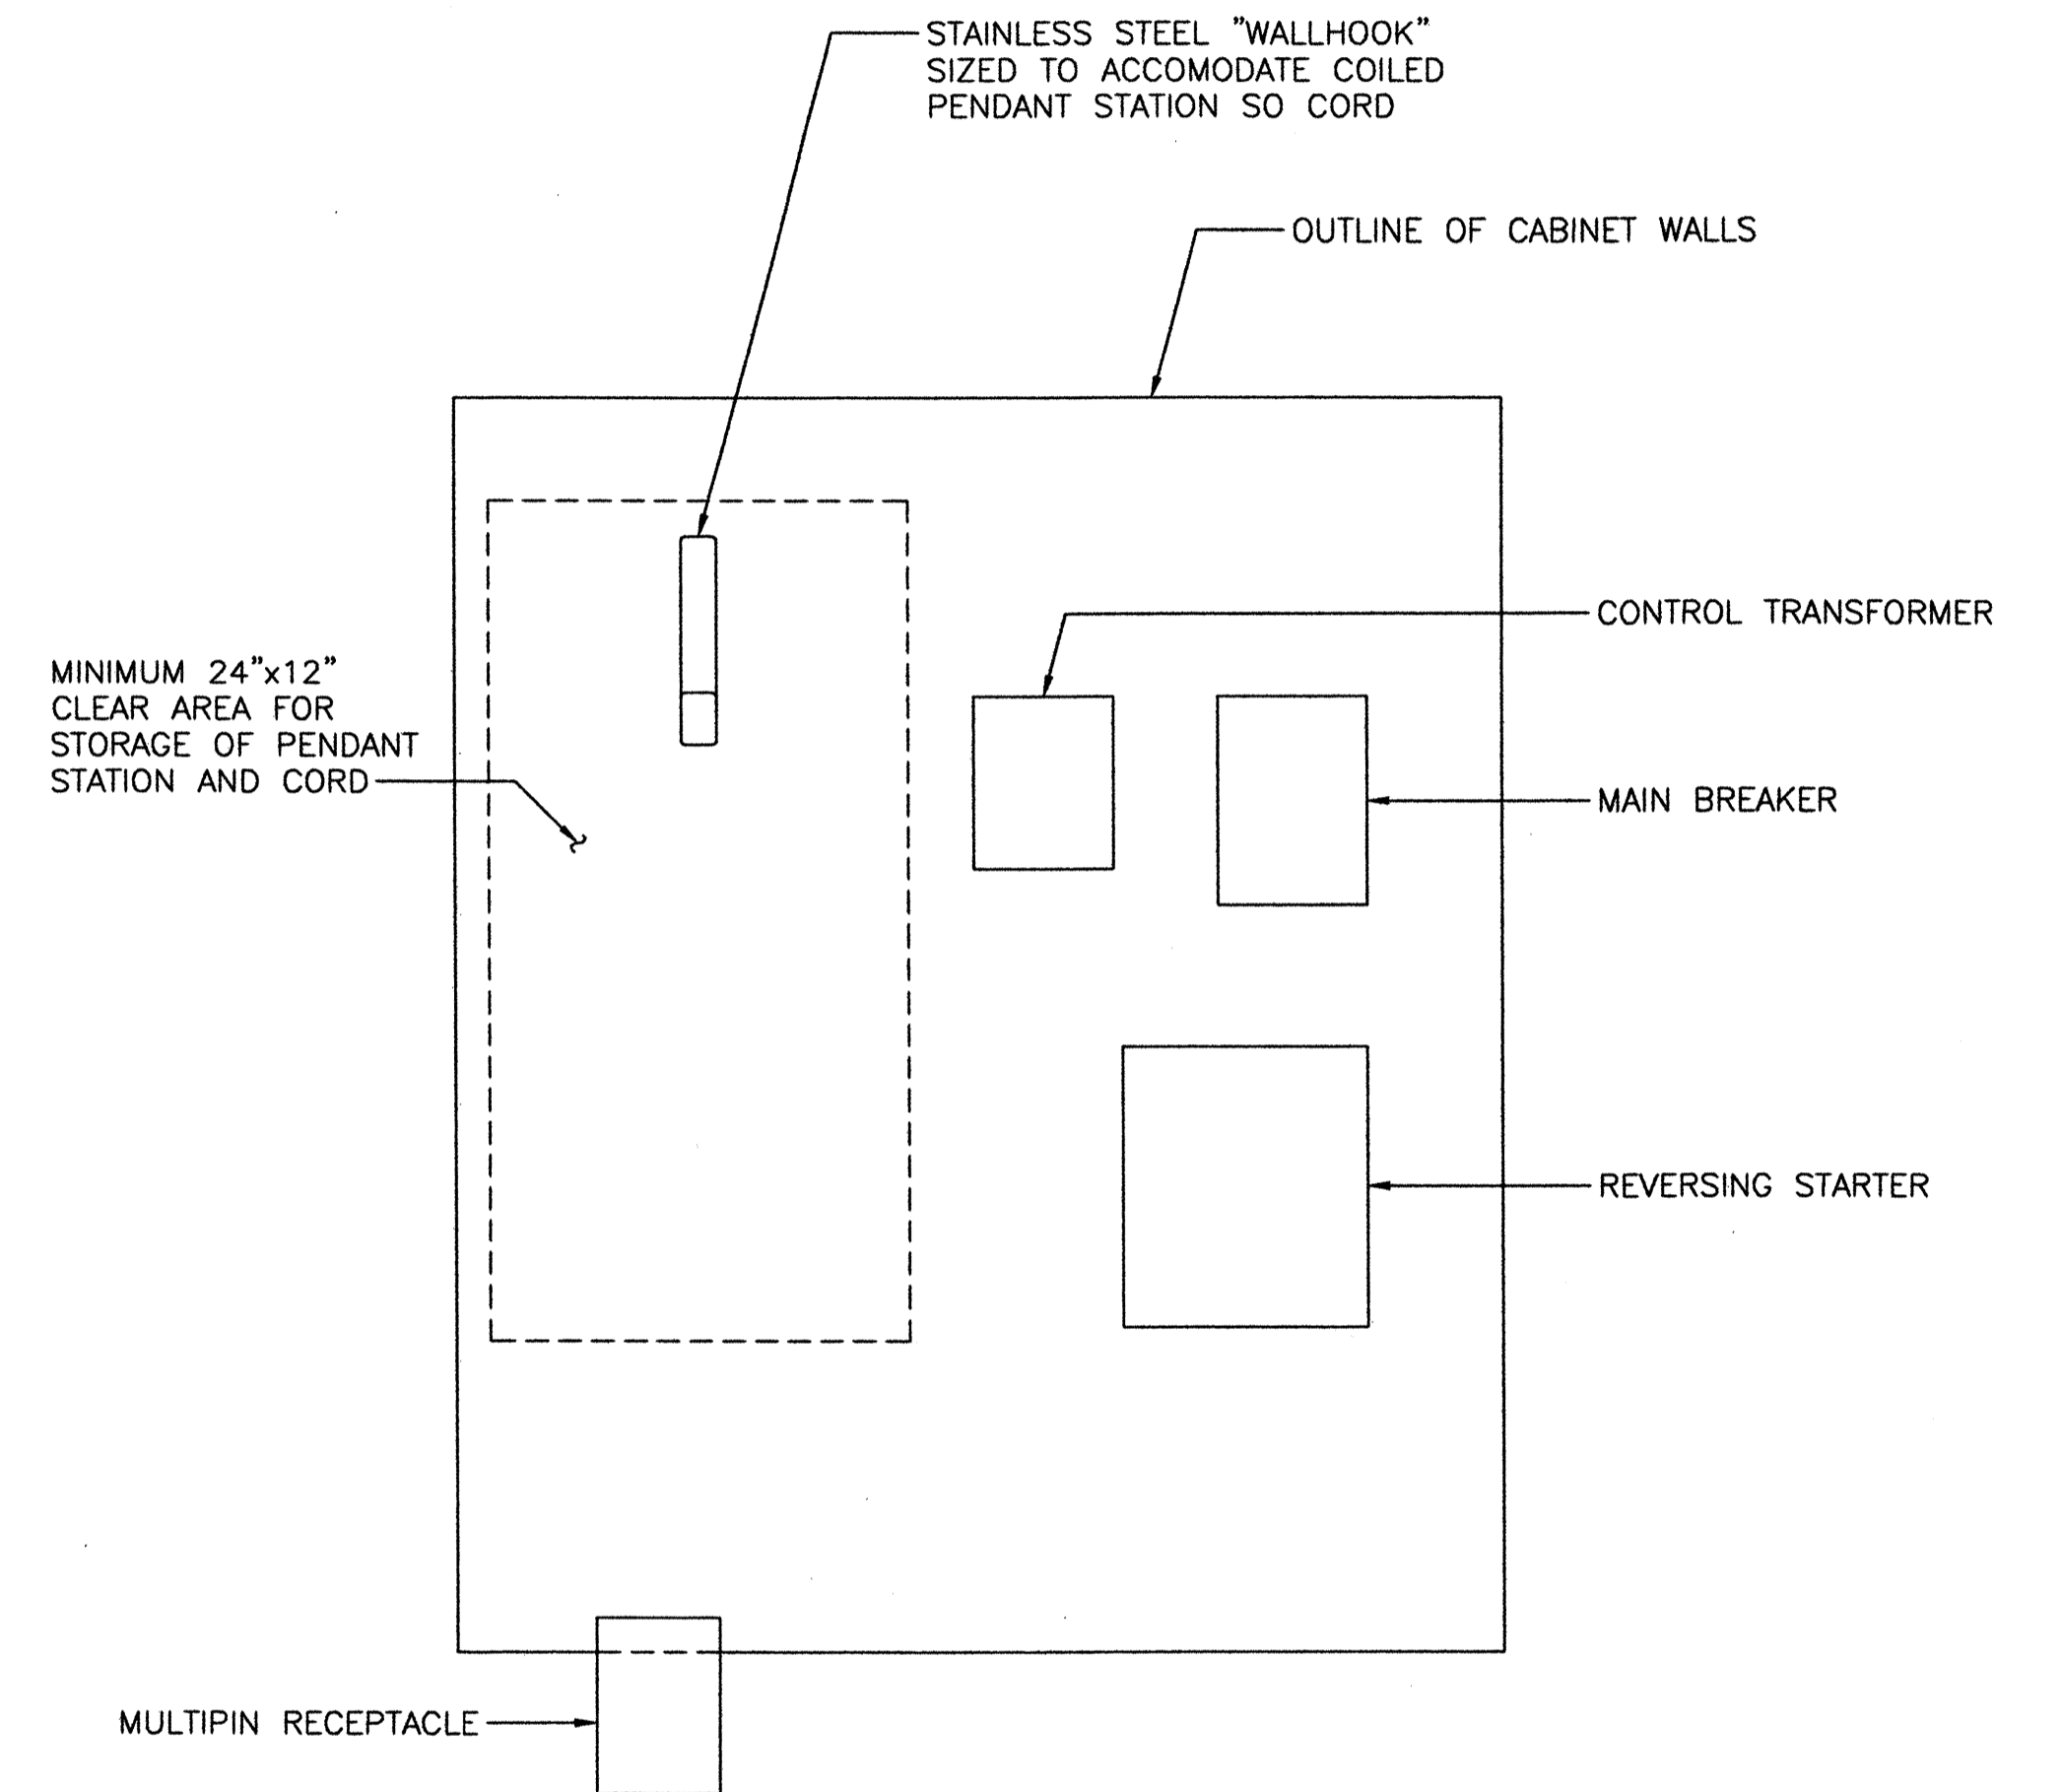



NEW AUXILIARY DRIVE CONTROL - CABINET LAYOUT

SCALE: NONE

TYPICAL NEW NEARSIDE AND FARMSIDE CONTROLS.

NOTES:


- CONTROLS FOR THE NEARSIDE AUXILIARY DRIVE ARE SHOWN. CONTROLS FOR THE FARMSIDE AUXILIARY DRIVE ARE SIMILAR.
- ALL ITEMS SHOWN ARE NEW, EXCEPT FOR THE AUXILIARY DRIVE MOTOR.
- REQUIRED EQUIPMENT GROUNDING CONDUCTORS ARE NOT SHOWN.
- ALL WIRING, INCLUDING CABINET INTERNAL WIRING, SHALL BE TYPE XHHW-2. MINIMUM SIZE SHALL BE 14 AWG.
- CIRCUIT BREAKER SHALL BE THERMAL-MAGNETIC MOLDED CASE TYPE. STARTER SHALL BE FULL VOLTAGE REVERSING TYPE, NEMA SIZE 1. PILOT LIGHTS SHALL BE 30MM, TYPE 4/4X/13, PUSH-TO-TEST, WITH LED LAMPS. PILOT LIGHTS SHALL BE MOUNTED ON THE CABINET COVER. TERMINAL BLOCKS SHALL BE HEAVY DUTY, PHENOLIC INSULATED, WITH BOX TYPE LUGS. CABINET SHALL BE NEMA 4X TYPE 316 STAINLESS STEEL WITH FLANGE MOUNTED OPERATOR FOR MAIN BREAKER. CABINET SHALL BE PROVIDED WITH BREATHER AND DRAIN.
- PENDANT PUSHBUTTON STATION SHALL BE RATED NEMA 4X, WITH TWO MECHANICALLY INTERLOCKED PUSHBUTTONS.
- MULTIPIN RECEPTACLE AND MATING PLUG SHALL CONSIST OF SPRING LOADED SILVER-NICKEL CONTACTS IN POLYESTER HOUSINGS RATED NEMA 4X. A LATCHING PAWL SHALL HOLD THE RECEPTACLE AND PLUG TOGETHER WHEN ENGAGED. RECEPTACLE SHALL BE EQUIPPED WITH A FLIP-OPEN COVER AND BE MOUNTED IN THE BOTTOM WALL OF THE CABINET. PLUG SHALL BE MOUNTED IN A POLYESTER HANDLE ON THE END OF THE PENDANT STATION SO CORD.

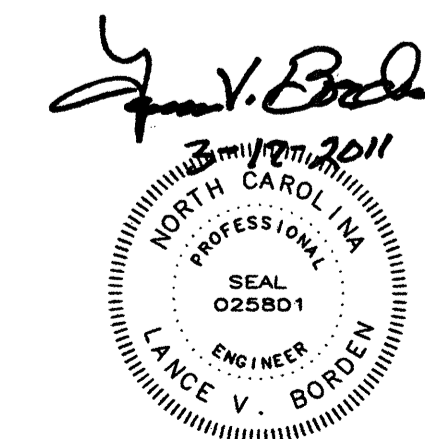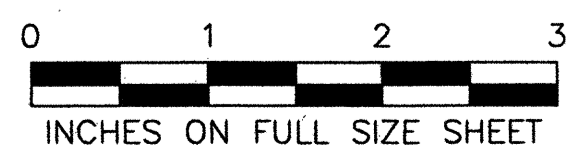

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
NEW AUXILIARY DRIVE CONTROLS			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	44 OF 63


EB18

44-EB18-WDC.DWG

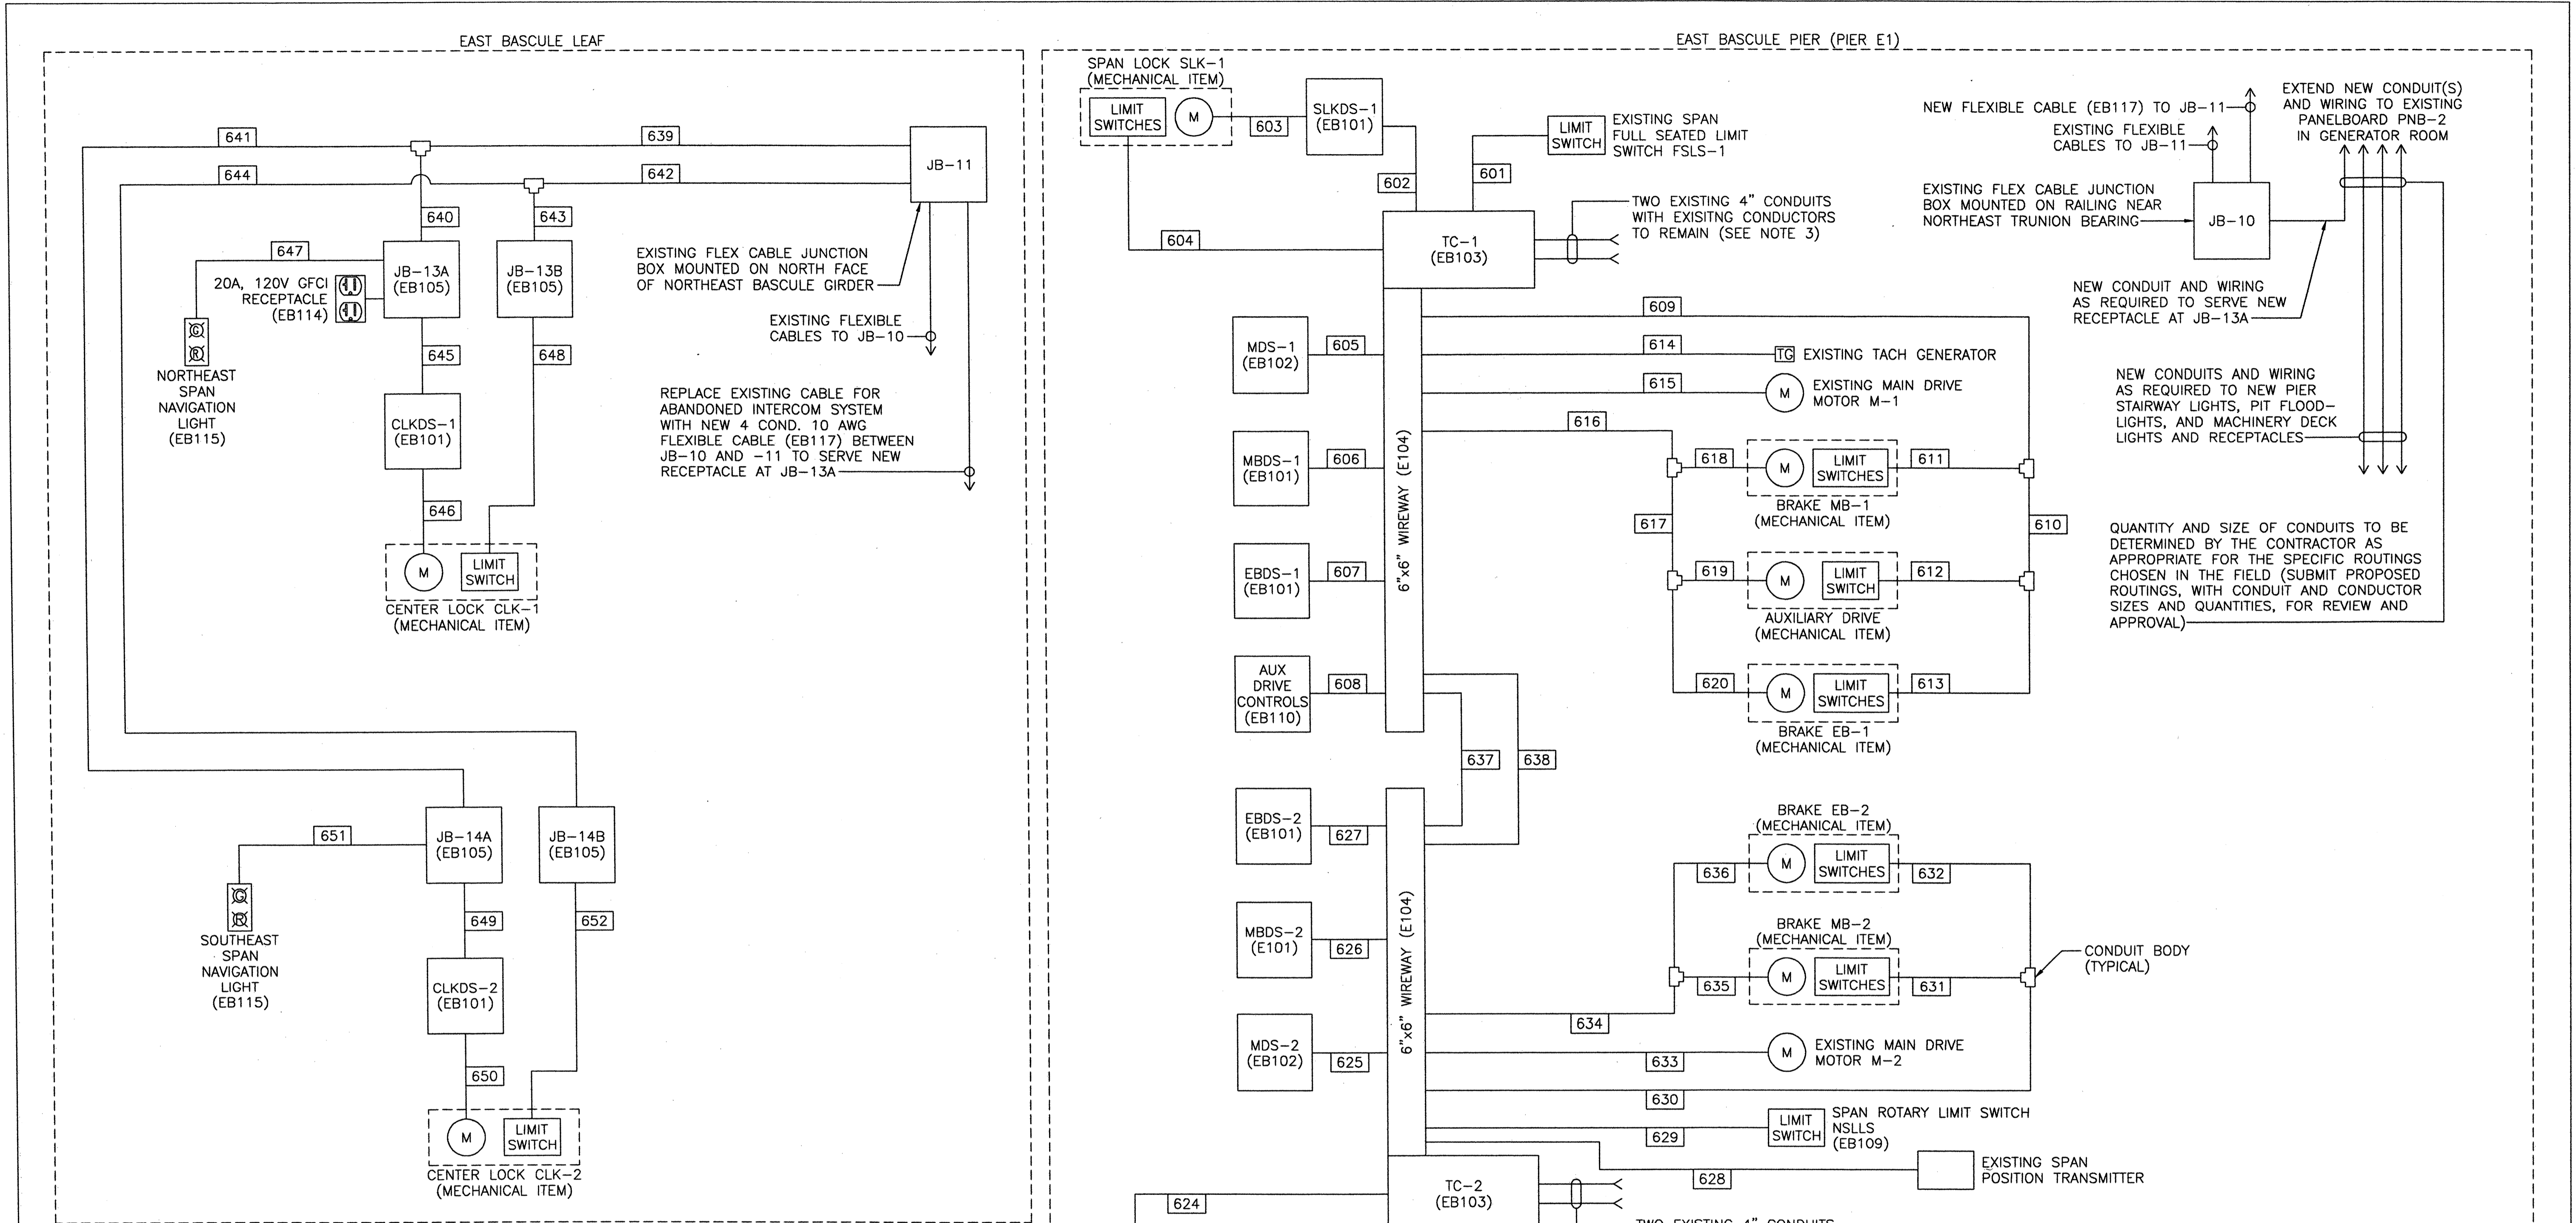


- NOTES:**
- THIS LAYOUT IS DIAGRAMMATIC, AND IS NOT INTENDED TO SHOW CONDUIT AND/OR EQUIPMENT IN THEIR EXACT PHYSICAL LOCATIONS OR RELATIONSHIPS.
 - ALL CONDUITS AND EQUIPMENT SHOWN ON THIS SHEET ARE NEW EXCEPT AS NOTED.
 - THE EXISTING CONDUCTORS ENTERING TERMINAL CABINETS TC-1 AND -2 VIA THE EXISTING 4" CONDUITS ARE TO REMAIN AND BE CONNECTED TO THE NEW WIRING ACCORDING TO THEIR EXISTING CONNECTIONS.

- DEVICE DESIGNATIONS:**
- | | |
|-------|-----------------------------------|
| AMDS | AUXILIARY MOTOR DISCONNECT SWITCH |
| CLK | CENTER LOCK |
| CLKDS | CENTER LOCK DISCONNECT SWITCH |
| EBDS | EMERGENCY BRAKE DISCONNECT SWITCH |
| FSLLS | FULLY SEATED LIMIT SWITCH |
| FSLLS | FAR SIDE LEAF LIMIT SWITCH |
| JB | JUNCTION BOX |
| MDS | MOTOR DISCONNECT SWITCH |
| MBDS | MOTOR BRAKE DISCONNECT SWITCH |
| NSLLS | NEAR SIDE LEAF LIMIT SWITCH |
| SLK | SPAN LOCK |
| SLKDS | SPAN LOCK DISCONNECT SWITCH |
| TC | TERMINAL CABINET |


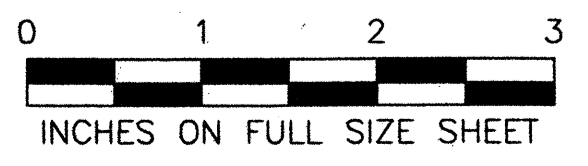


45-EB-9-CL.DWG

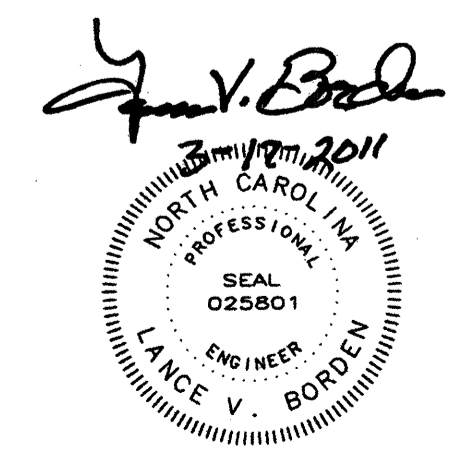



STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE			
WILMINGTON, NORTH CAROLINA			
CONDUIT LAYOUT - 1			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	45 OF 63

EB19

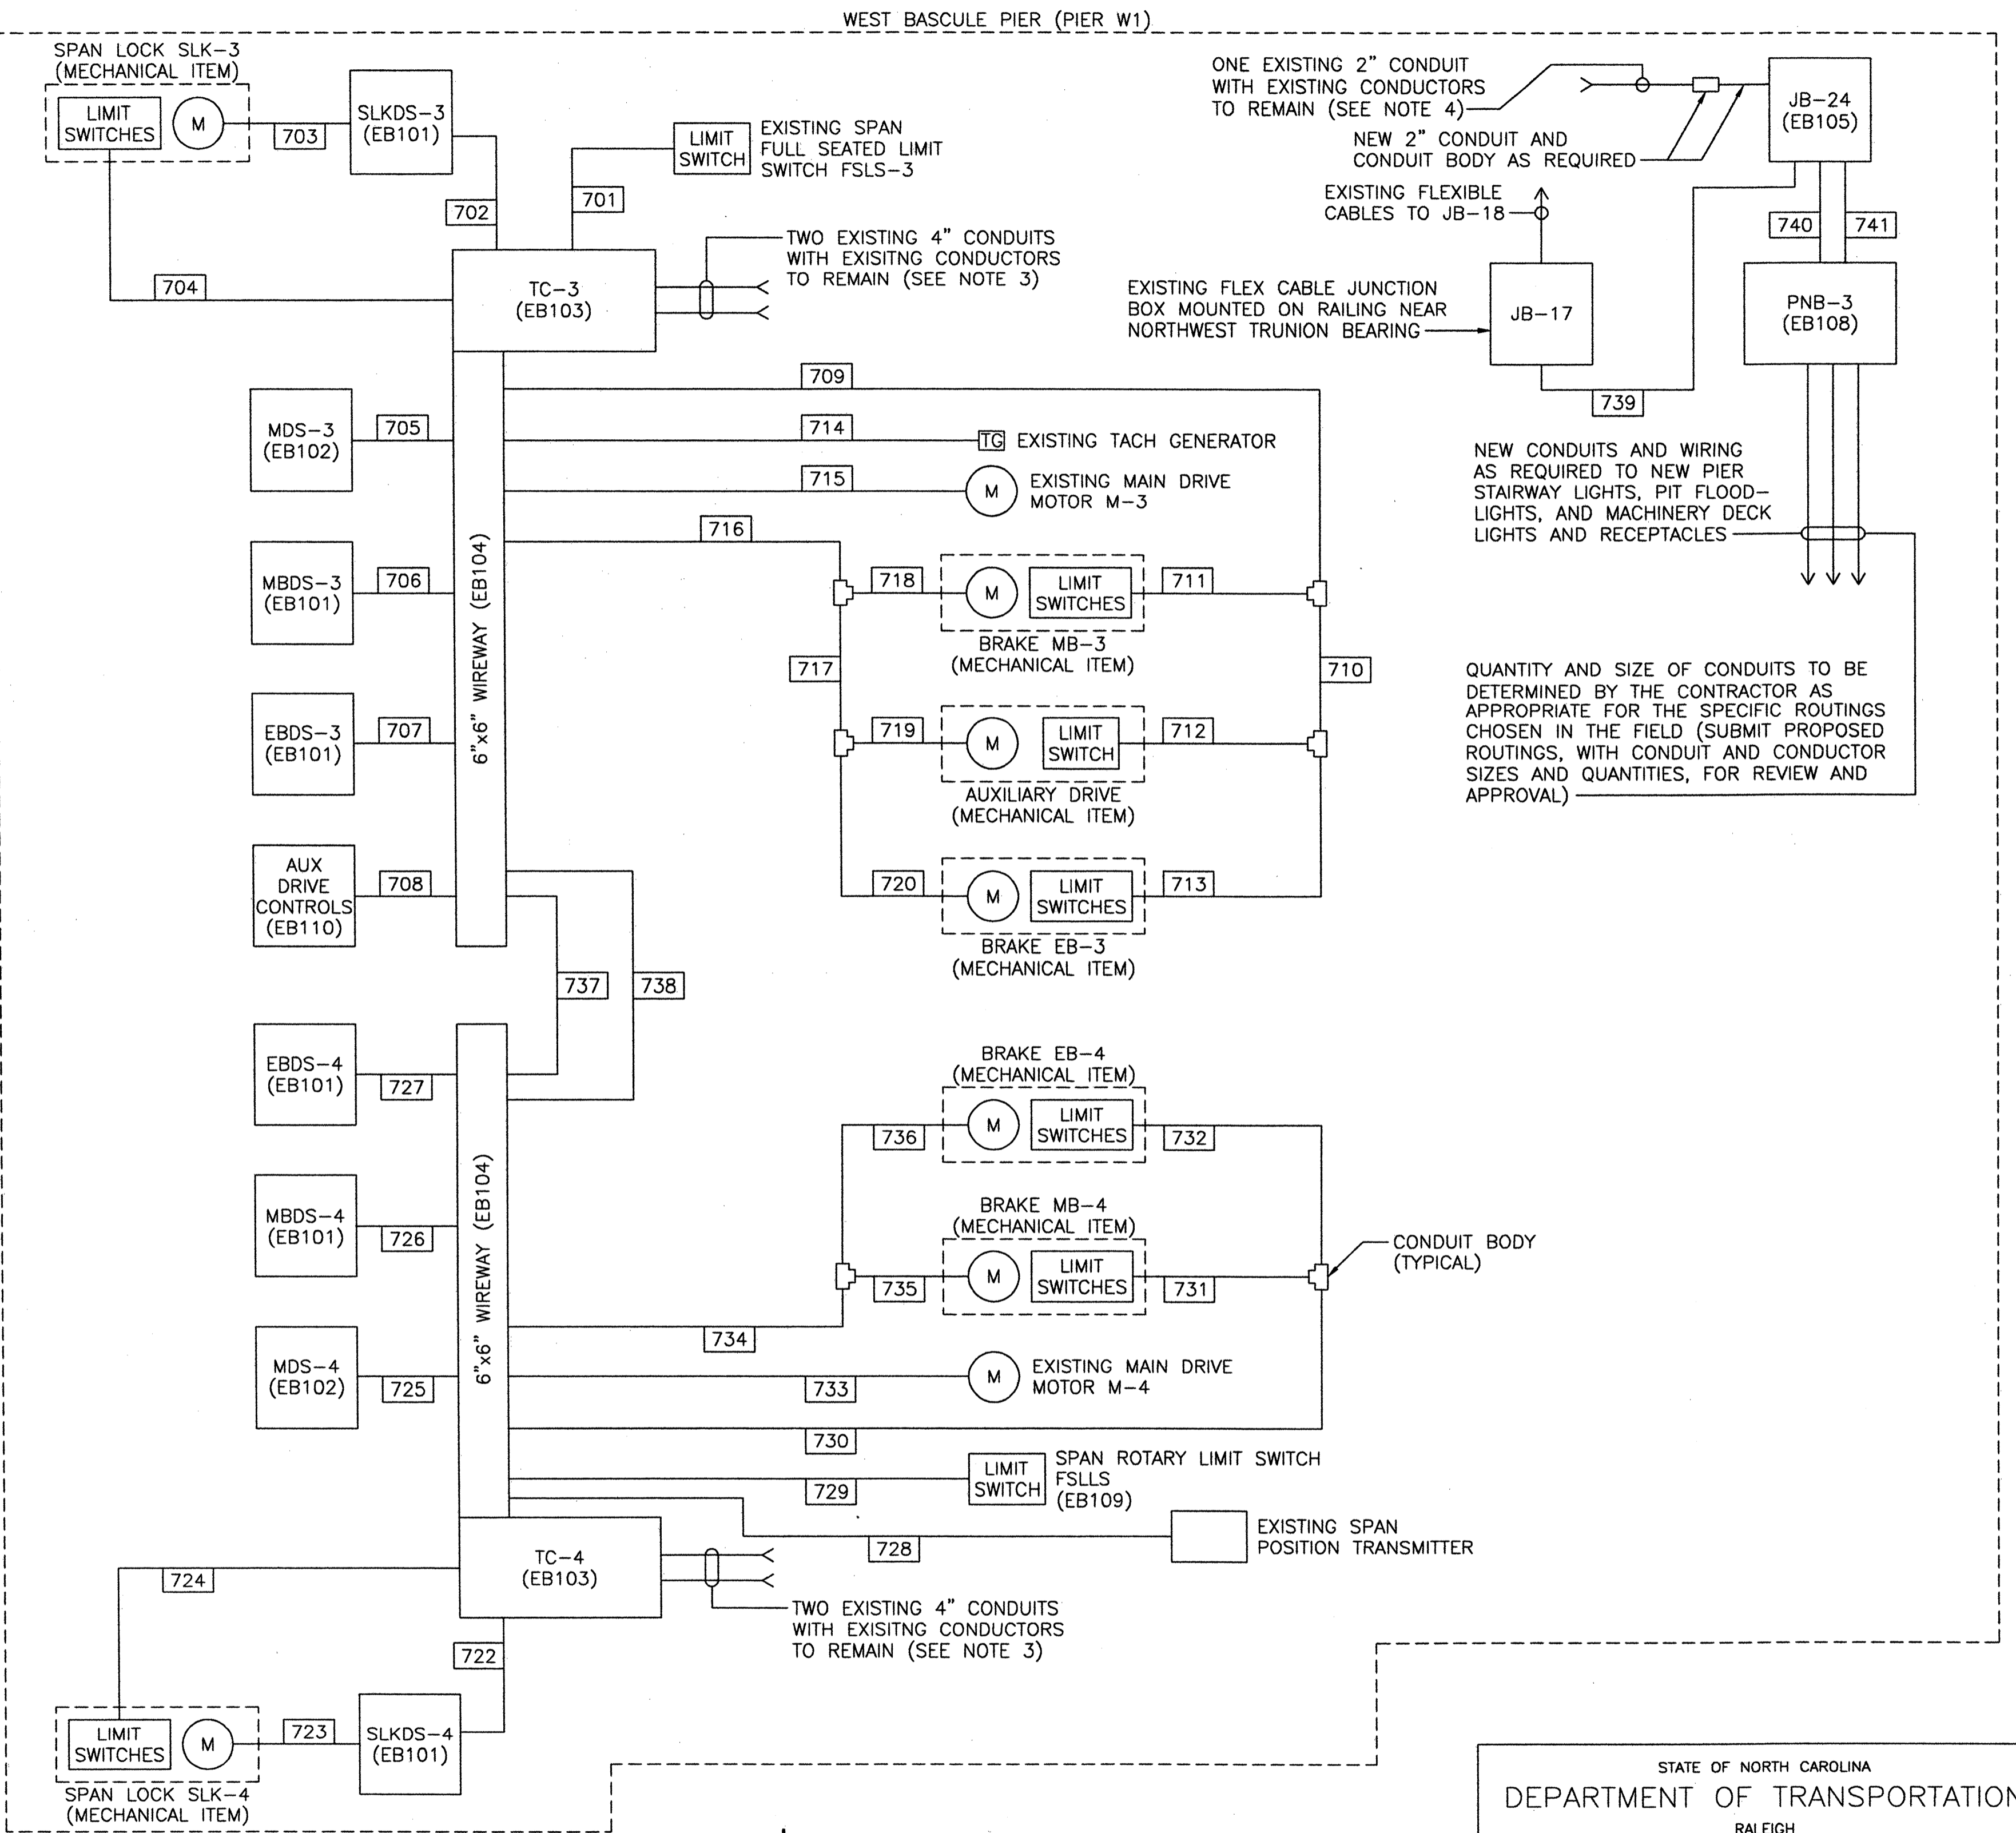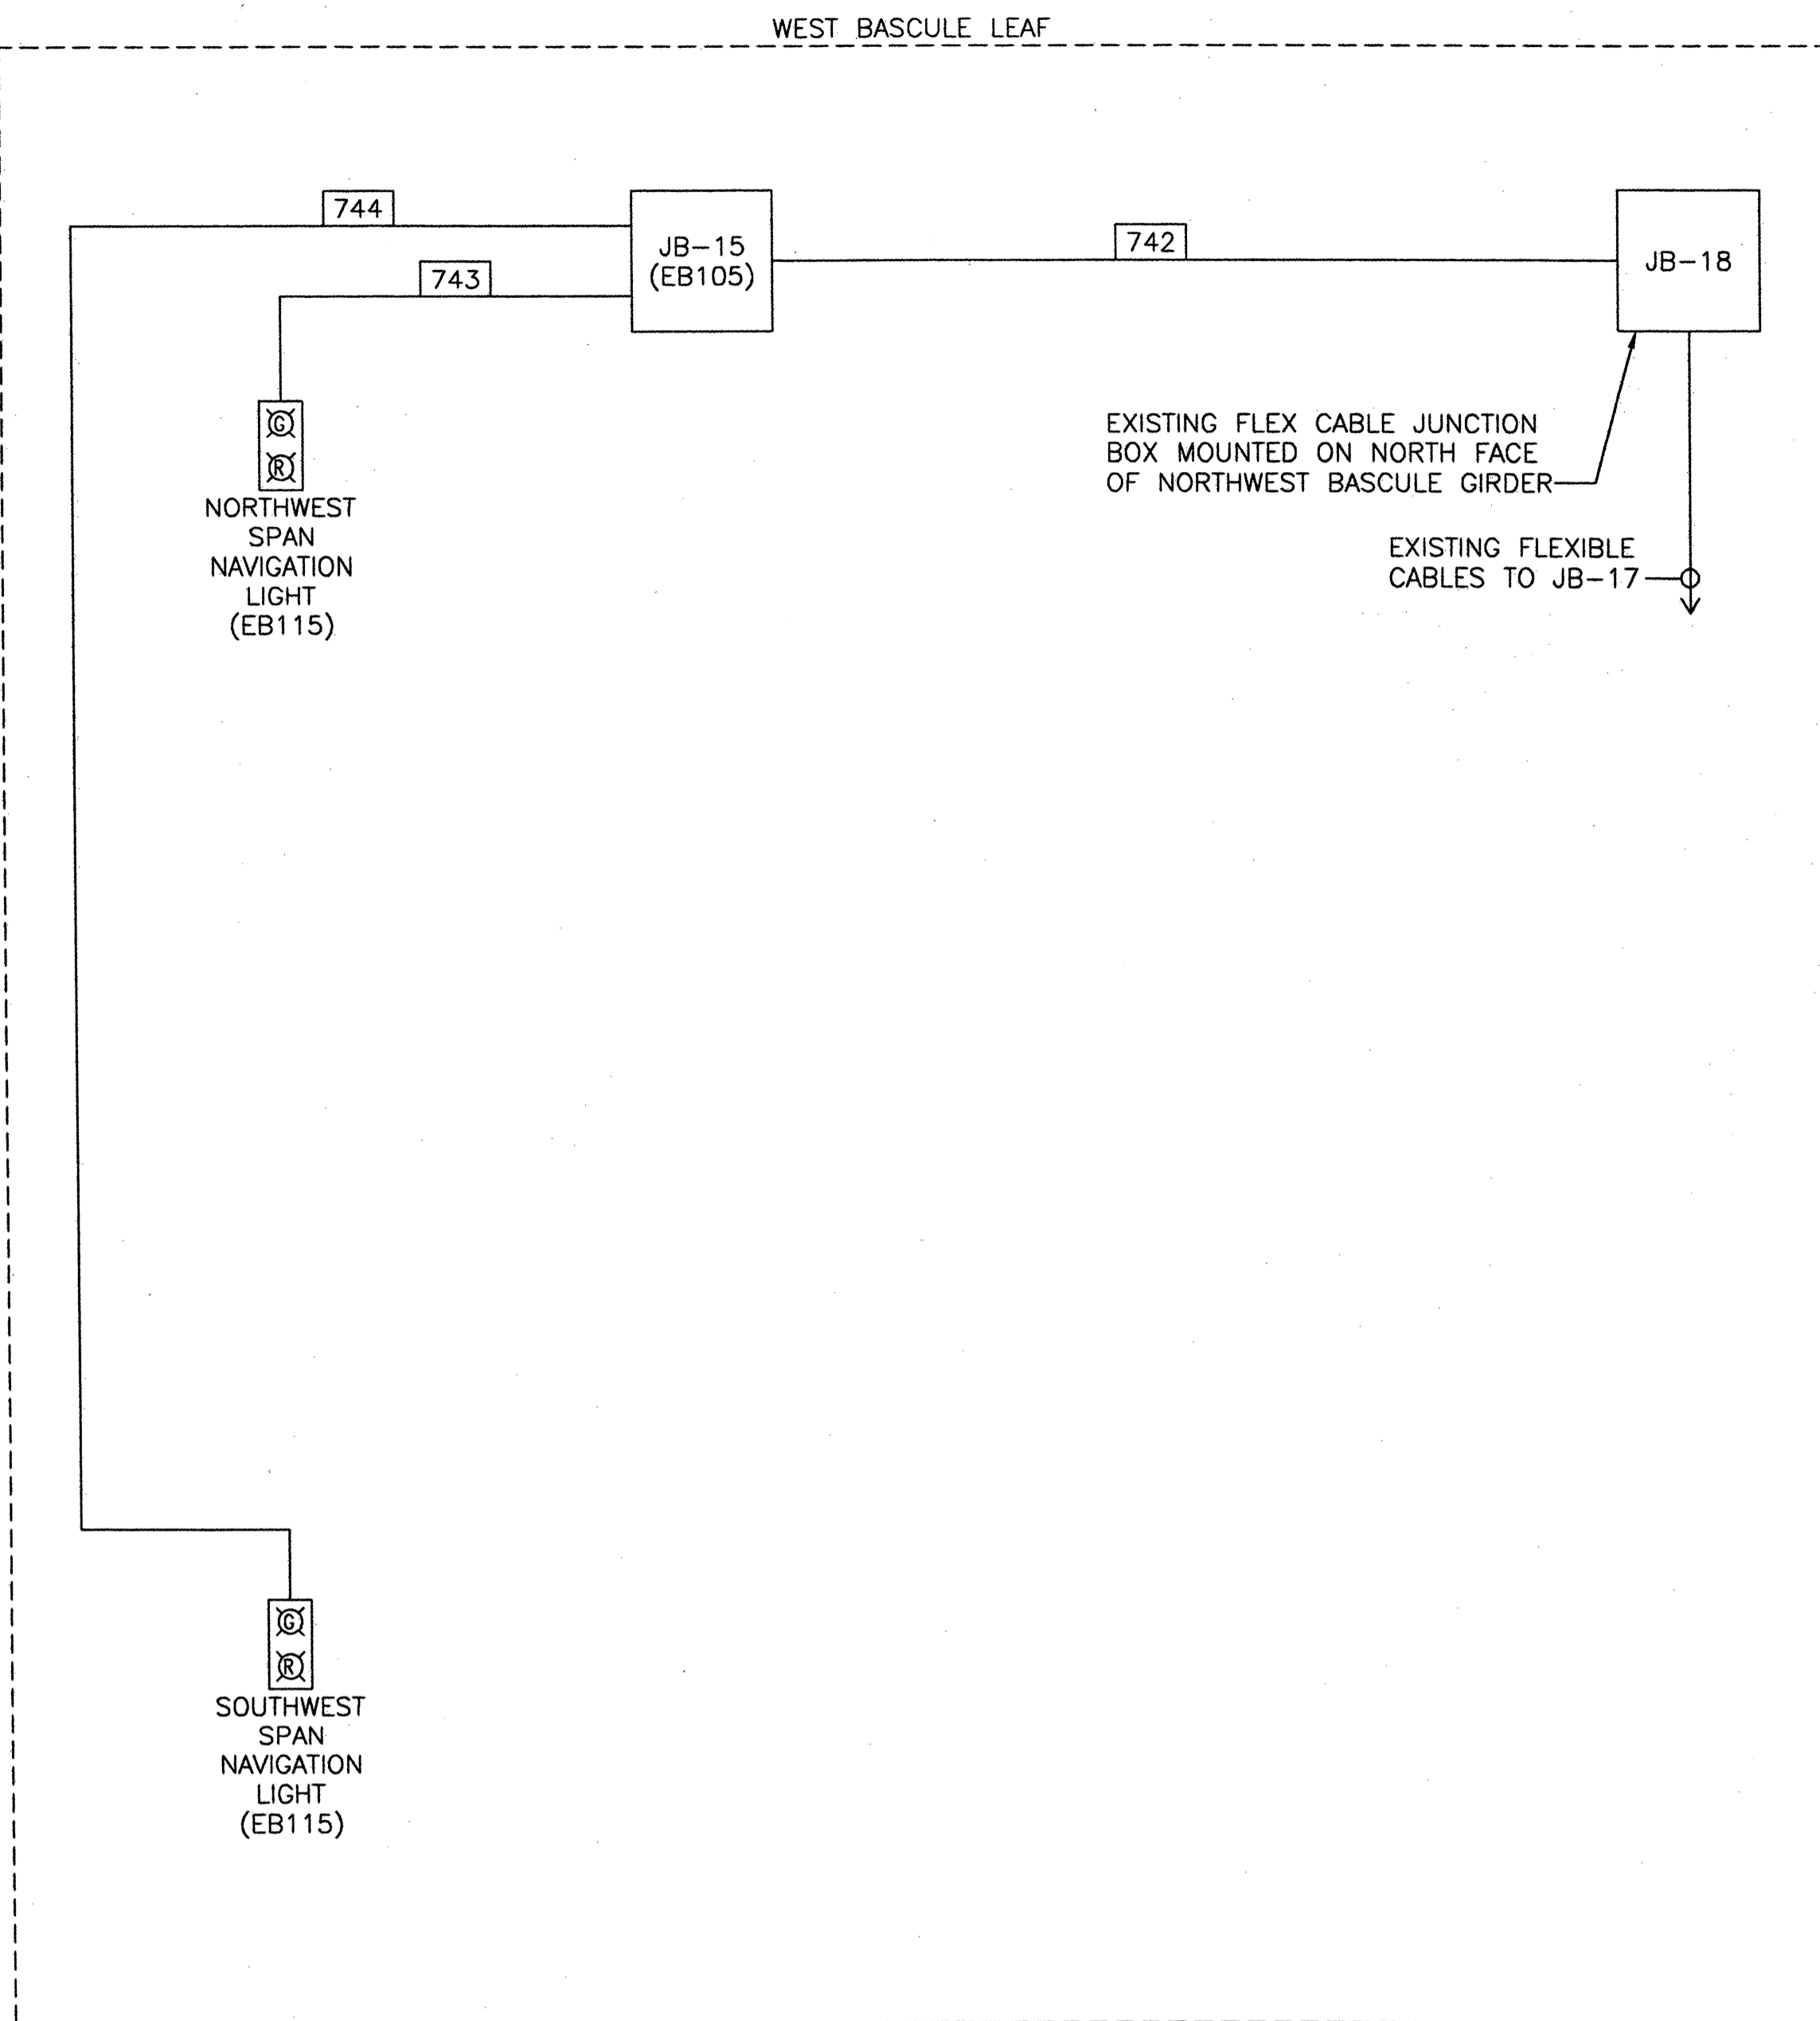

NOTES:

1. THIS LAYOUT IS DIAGRAMMATIC, AND IS NOT INTENDED TO SHOW CONDUIT AND/OR EQUIPMENT IN THEIR EXACT PHYSICAL LOCATIONS OR RELATIONSHIPS.
2. ALL CONDUITS AND EQUIPMENT SHOWN ON THIS SHEET ARE NEW EXCEPT AS NOTED.
3. THE EXISTING CONDUCTORS ENTERING TERMINAL CABINETS TC-3 AND -4 VIA THE EXISTING 4" CONDUITS ARE TO REMAIN AND BE CONNECTED TO THE NEW WIRING ACCORDING TO THEIR EXISTING CONNECTIONS.
4. THE EXISTING CONDUCTORS WITHIN THIS CONDUIT ARE TO REMAIN AND BE CONNECTED TO THE NEW WIRING ACCORDING TO THEIR EXISTING CONNECTIONS.
5. SEE SHEET EB19 FOR DEVICE DESIGNATIONS.

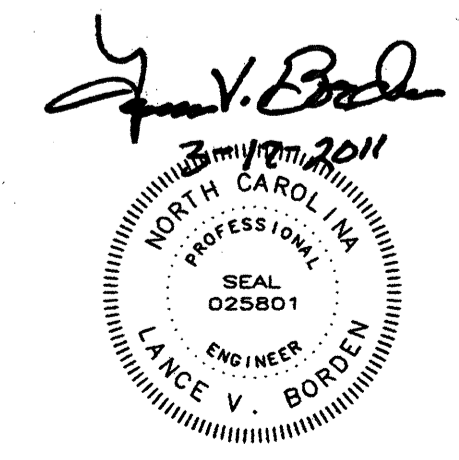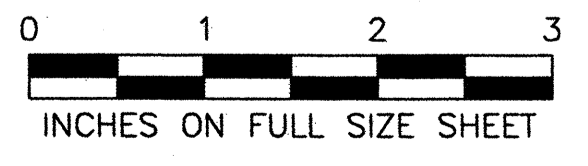

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
CONDUIT LAYOUT - 2			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	46 OF 63
DRAWN BY	N.E. ALGER	SCALE	AS NOTED
DETAILED	N.E. ALGER	CHECKED	Q.C. TON

28-EB20-CC.DWG


EB20

BRIDGE WIRING TABULATION - EAST				
RUN NUMBER	CONDUIT TRADE SIZE	CONDUCTORS		SERVING
		CIRCUIT	GROUND	
601	3/4	(4) 12 AWG	12 AWG	FULLY SEATED LIMIT SWITCH FLSL-1
602	3/4	(3) 10 AWG	10 AWG	SWITCH SLKDS-1
603	3/4	(3) 10 AWG	10 AWG	SPAN LOCK SLK-1 MOTOR
604	1-1/4	(30) 12 AWG	12 AWG	SPAN LOCK SLK-1 LIMIT SWITCHES
605	2	(3) 1 AWG	6 AWG	SWITCH MDS-1
		(3) 1 AWG	6 AWG	MOTOR M-1
606	3/4	(3) 12 AWG	12 AWG	SWITCH MBDS-1
		(3) 12 AWG	12 AWG	BRAKE MB-1
607	3/4	(3) 12 AWG	12 AWG	SWITCH EBDS-1
		(3) 12 AWG	12 AWG	BRAKE EB-1
608	1	(3) 10 AWG	10 AWG	AUXILIARY DRIVE CONTROLS
		(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
609	1-1/4	(6) 12 AWG	12 AWG	BRAKE MB-1 LIMIT SWITCHES
		(6) 12 AWG	12 AWG	BRAKE EB-1 LIMIT SWITCHES
		(4) 12 AWG	12 AWG	AUXILIARY DRIVE COUPLING LIMIT SWITCH
610	1-1/4	(6) 12 AWG	12 AWG	BRAKE EB-1 LIMIT SWITCHES
		(4) 12 AWG	12 AWG	AUXILIARY DRIVE COUPLING LIMIT SWITCH
611	3/4	(6) 12 AWG	12 AWG	BRAKE MB-1 LIMIT SWITCHES
612	3/4	(4) 12 AWG	12 AWG	AUXILIARY DRIVE COUPLING LIMIT SWITCH
613	3/4	(6) 12 AWG	12 AWG	BRAKE EB-1 LIMIT SWITCHES
614	1	NOTE 1	12 AWG	TACHOMETER GENERATOR
615	1-1/2	(3) 1 AWG	6 AWG	MOTOR M-1
		(2) 10 AWG		MOTOR WINDING HEATERS
616	1	(3) 12 AWG	12 AWG	BRAKE MB-1
		(3) 12 AWG	12 AWG	BRAKE EB-1
		(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
617	1	(3) 12 AWG	12 AWG	BRAKE EB-1
		(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
618	3/4	(3) 12 AWG	12 AWG	BRAKE MB-1
619	3/4	(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
620	3/4	(3) 12 AWG	12 AWG	BRAKE EB-1
621	NOT USED			
622	3/4	(3) 10 AWG	10 AWG	SWITCH SLKDS-2
623	3/4	(3) 10 AWG	10 AWG	SPAN LOCK SLK-2 MOTOR
624	1-1/4	(30) 12 AWG	12 AWG	SPAN LOCK SLK-2 LIMIT SWITCHES
625	2	(3) 1 AWG	6 AWG	SWITCH MDS-2
		(3) 1 AWG	6 AWG	MOTOR M-2
626	3/4	(3) 12 AWG	12 AWG	SWITCH MBDS-2
		(3) 12 AWG	12 AWG	BRAKE MB-2
627	3/4	(3) 12 AWG	12 AWG	SWITCH EBDS-2
		(3) 12 AWG	12 AWG	BRAKE EB-2
628	3/4	(5) 12 AWG	12 AWG	SPAN POSITION TRANSMITTER
629	1-1/4	(24) 12 AWG	12 AWG	SPAN ROTARY CAM LIMIT SWITCH
630	1	(6) 12 AWG	12 AWG	BRAKE MB-2 LIMIT SWITCHES
		(6) 12 AWG	12 AWG	BRAKE EB-2 LIMIT SWITCHES


BRIDGE WIRING TABULATION - EAST (CONTINUED)				
RUN NUMBER	CONDUIT TRADE SIZE	CONDUCTORS		SERVING
		CIRCUIT	GROUND	
631	3/4	(6) 12 AWG	12 AWG	BRAKE MB-2 LIMIT SWITCHES
632	3/4	(6) 12 AWG	12 AWG	BRAKE EB-2 LIMIT SWITCHES
633	1-1/2	(3) 1 AWG	6 AWG	MOTOR M-2
		(2) 10 AWG		MOTOR WINDING HEATERS
634	3/4	(3) 12 AWG	12 AWG	BRAKE MB-2
		(3) 12 AWG	12 AWG	BRAKE EB-2
635	3/4	(3) 12 AWG	12 AWG	BRAKE MB-2
636	3/4	(3) 12 AWG	12 AWG	BRAKE EB-2
637	1-1/2	(9) 10 AWG	10 AWG	POWER INTERCONNECTIONS AS REQUIRED
638	1-1/2	(20) 12 AWG	12 AWG	CONTROL INTERCONNECTIONS AS REQUIRED
639	1-1/4	(3) 10 AWG	10 AWG	SWITCH CLKDS-1
		(3) 10 AWG		SWITCH CLKDS-2
		(3) 10 AWG		SPAN NAVIGATION LIGHTS
		(2) 10 AWG		JB-13A RECEPTACLE
640	1-1/4	(6) 10 AWG	(2) 10 AWG	SPARE
		(3) 10 AWG		SWITCH CLKDS-1
		(6) 10 AWG		SPAN NAVIGATION LIGHTS
		(2) 10 AWG		JB-13A RECEPTACLE
641	1	(3) 10 AWG	10 AWG	SPARE
		(3) 10 AWG		SWITCH CLKDS-2
		(3) 10 AWG		SPAN NAVIGATION LIGHTS
642	2	(20) 12 AWG	12 AWG	CENTER LOCK CLK-1 CONTROL
		(20) 12 AWG		CENTER LOCK CLK-2 CONTROL
643	2	(20) 12 AWG	12 AWG	CENTER LOCK CLK-1 CONTROL
		(20) 12 AWG		CENTER LOCK CLK-2 CONTROL (FROM JB-11 TO JB-13B)
644	1-1/4	(20) 12 AWG	12 AWG	CENTER LOCK CLK-2 CONTROL
		(20) 12 AWG		CENTER LOCK CLK-2 CONTROL (FROM JB-13B TO JB-14B)
645	3/4	(3) 10 AWG	10 AWG	SWITCH CLKDS-1
646	3/4	(3) 10 AWG	10 AWG	CENTER LOCK CLK-1 MOTOR
647	3/4	(3) 10 AWG	10 AWG	NORTHEAST SPAN NAVIGATION LIGHT
648	1-1/4	(16) 12 AWG	12 AWG	CENTER LOCK CLK-1 LIMIT SWITCH
649	3/4	(3) 10 AWG	10 AWG	SWITCH CLKDS-2
650	3/4	(3) 10 AWG	10 AWG	CENTER LOCK CLK-2 MOTOR
651	3/4	(3) 10 AWG	10 AWG	SOUTHEAST SPAN NAVIGATION LIGHT
652	1-1/4	(16) 12 AWG	12 AWG	CENTER LOCK CLK-2 LIMIT SWITCH

NOTES:

- ONE 12 AWG TWISTED PAIR WITH OVERALL SHIELD. (ITEM EB116)
- SEE SHEET EB19 FOR EAST SIDE CONDUIT LAYOUT DIAGRAM.

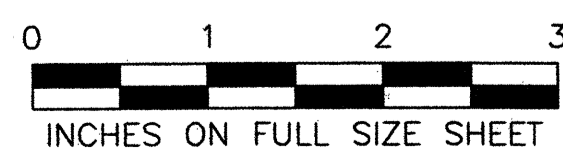

47-EB21-CWT.DWG

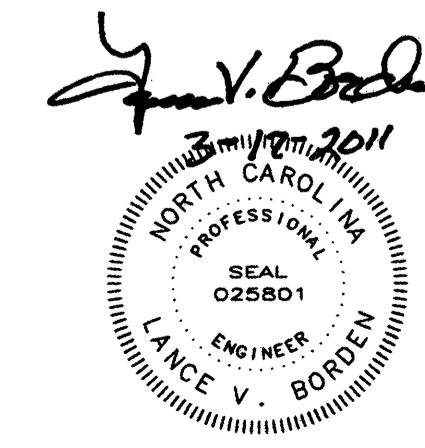

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

CAPE FEAR BASCULE BRIDGE
AND MEMORIAL LIFT BRIDGE
WILMINGTON, NORTH CAROLINA
CONDUIT AND WIRING TABULATION - 1

DESIGNED	N.E. ALGER	DETAILED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	CHECKED	Q.C. TON	DRAWING NO.	47 OF 63

EB21



DRAWN BY N.E. ALGER
SCALE AS NOTED

BRIDGE WIRING TABULATION -- WEST				
RUN NUMBER	CONDUIT TRADE SIZE	CONDUCTORS		SERVING
		CIRCUIT	GROUND	
701	3/4	(4) 12 AWG	12 AWG	FULLY SEATED LIMIT SWITCH FSLs-3
702	3/4	(3) 10 AWG	10 AWG	SWITCH SLKDS-3
703	3/4	(3) 10 AWG	10 AWG	SPAN LOCK SLK-3 MOTOR
704	1-1/4	(30) 12 AWG	12 AWG	SPAN LOCK SLK-3 LIMIT SWITCHES
705	2	(3) 1 AWG	6 AWG	SWITCH MDS-3
		(3) 1 AWG	6 AWG	MOTOR M-3
706	3/4	(3) 12 AWG	12 AWG	SWITCH MBDS-3
		(3) 12 AWG	12 AWG	BRAKE MB-3
707	3/4	(3) 12 AWG	12 AWG	SWITCH EBDS-3
		(3) 12 AWG	12 AWG	BRAKE EB-3
708	1	(3) 10 AWG	10 AWG	AUXILIARY DRIVE CONTROLS
		(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
709	1-1/4	(6) 12 AWG	12 AWG	BRAKE MB-3 LIMIT SWITCHES
		(6) 12 AWG	12 AWG	BRAKE EB-3 LIMIT SWITCHES
		(4) 12 AWG	12 AWG	AUXILIARY DRIVE COUPLING LIMIT SWITCH
710	1-1/4	(6) 12 AWG	12 AWG	BRAKE EB-3 LIMIT SWITCHES
		(4) 12 AWG	12 AWG	AUXILIARY DRIVE COUPLING LIMIT SWITCH
711	3/4	(6) 12 AWG	12 AWG	BRAKE MB-3 LIMIT SWITCHES
712	3/4	(4) 12 AWG	12 AWG	AUXILIARY DRIVE COUPLING LIMIT SWITCH
713	3/4	(6) 12 AWG	12 AWG	BRAKE EB-3 LIMIT SWITCHES
714	1	NOTE 1	12 AWG	TACHOMETER GENERATOR
715	1-1/2	(3) 1 AWG	6 AWG	MOTOR M-3
		(2) 10 AWG		MOTOR WINDING HEATERS
716	1	(3) 12 AWG	12 AWG	BRAKE MB-3
		(3) 12 AWG	12 AWG	BRAKE EB-3
		(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
717	1	(3) 12 AWG	12 AWG	BRAKE EB-3
		(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
718	3/4	(3) 12 AWG	12 AWG	BRAKE MB-3
719	3/4	(3) 10 AWG	10 AWG	AUXILIARY DRIVE MOTOR
720	3/4	(3) 12 AWG	12 AWG	BRAKE EB-3
721	NOT USED			
722	3/4	(3) 10 AWG	10 AWG	SWITCH SLKDS-4
723	3/4	(3) 10 AWG	10 AWG	SPAN LOCK SLK-4 MOTOR
724	1-1/4	(30) 12 AWG	12 AWG	SPAN LOCK SLK-4 LIMIT SWITCHES
725	2	(3) 1 AWG	6 AWG	SWITCH MDS-4
		(3) 1 AWG	6 AWG	MOTOR M-4
726	3/4	(3) 12 AWG	12 AWG	SWITCH MBDS-4
		(3) 12 AWG	12 AWG	BRAKE MB-4
727	3/4	(3) 12 AWG	12 AWG	SWITCH EBDS-4
		(3) 12 AWG	12 AWG	BRAKE EB-4
728	3/4	(5) 12 AWG	12 AWG	SPAN POSITION TRANSMITTER
729	1-1/4	(24) 12 AWG	12 AWG	SPAN ROTARY CAM LIMIT SWITCH
730	1	(6) 12 AWG	12 AWG	BRAKE MB-4 LIMIT SWITCHES
		(6) 12 AWG	12 AWG	BRAKE EB-4 LIMIT SWITCHES


BRIDGE WIRING TABULATION -- WEST (CONTINUED)				
RUN NUMBER	CONDUIT TRADE SIZE	CONDUCTORS		SERVING
		CIRCUIT	GROUND	
731	3/4	(6) 12 AWG	12 AWG	BRAKE MB-4 LIMIT SWITCHES
732	3/4	(6) 12 AWG	12 AWG	BRAKE EB-4 LIMIT SWITCHES
733	1-1/2	(3) 1 AWG	6 AWG	MOTOR M-4
		(2) 10 AWG		MOTOR WINDING HEATERS
734	3/4	(3) 12 AWG	12 AWG	BRAKE MB-4
		(3) 12 AWG	12 AWG	BRAKE EB-4
735	3/4	(3) 12 AWG	12 AWG	BRAKE MB-4
736	3/4	(3) 12 AWG	12 AWG	BRAKE EB-4
737	1-1/2	(9) 10 AWG	10 AWG	POWER INTERCONNECTIONS AS REQ'D
738	1-1/2	(20) 12 AWG	12 AWG	CONTROL INTERCONNECTIONS AS REQ'D
739	3/4	(3) 10 AWG	10 AWG	SPAN NAVIGATION LIGHTS
740	1	(3) 6 AWG	6 AWG	FEED TO PNB-3
741	1-1/4	(12) 10 AWG	10 AWG	RE-FEED TO EXISTING-TO-REMAIN CIRCUITS
742	1	(3) 10 AWG	10 AWG	SPAN NAVIGATION LIGHTS
		(3) 10 AWG		SPARE
744	3/4	(3) 10 AWG	10 AWG	NORTHWEST SPAN NAVIGATION LIGHT
745	3/4	(3) 10 AWG	10 AWG	SOUTHWEST SPAN NAVIGATION LIGHT

NOTES:

- ONE 12 AWG TWISTED PAIR WITH OVERALL SHIELD. (ITEM EB116)
- SEE SHEET EB19 FOR EAST SIDE CONDUIT LAYOUT DIAGRAM.

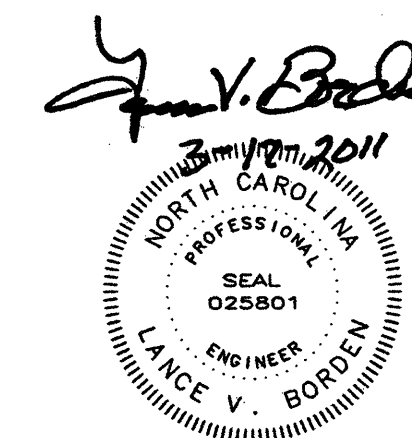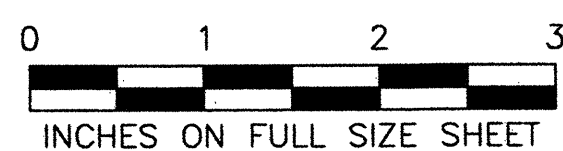

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA			
CONDUIT AND WIRING TABULATION - 2			
DESIGNED N.E. ALGER		DRAWN BY N.E. ALGER	
CHECKED Q.C. TON		SCALE AS NOTED	
DATE MARCH 2011		DRAWING NO. 48 OF 63	

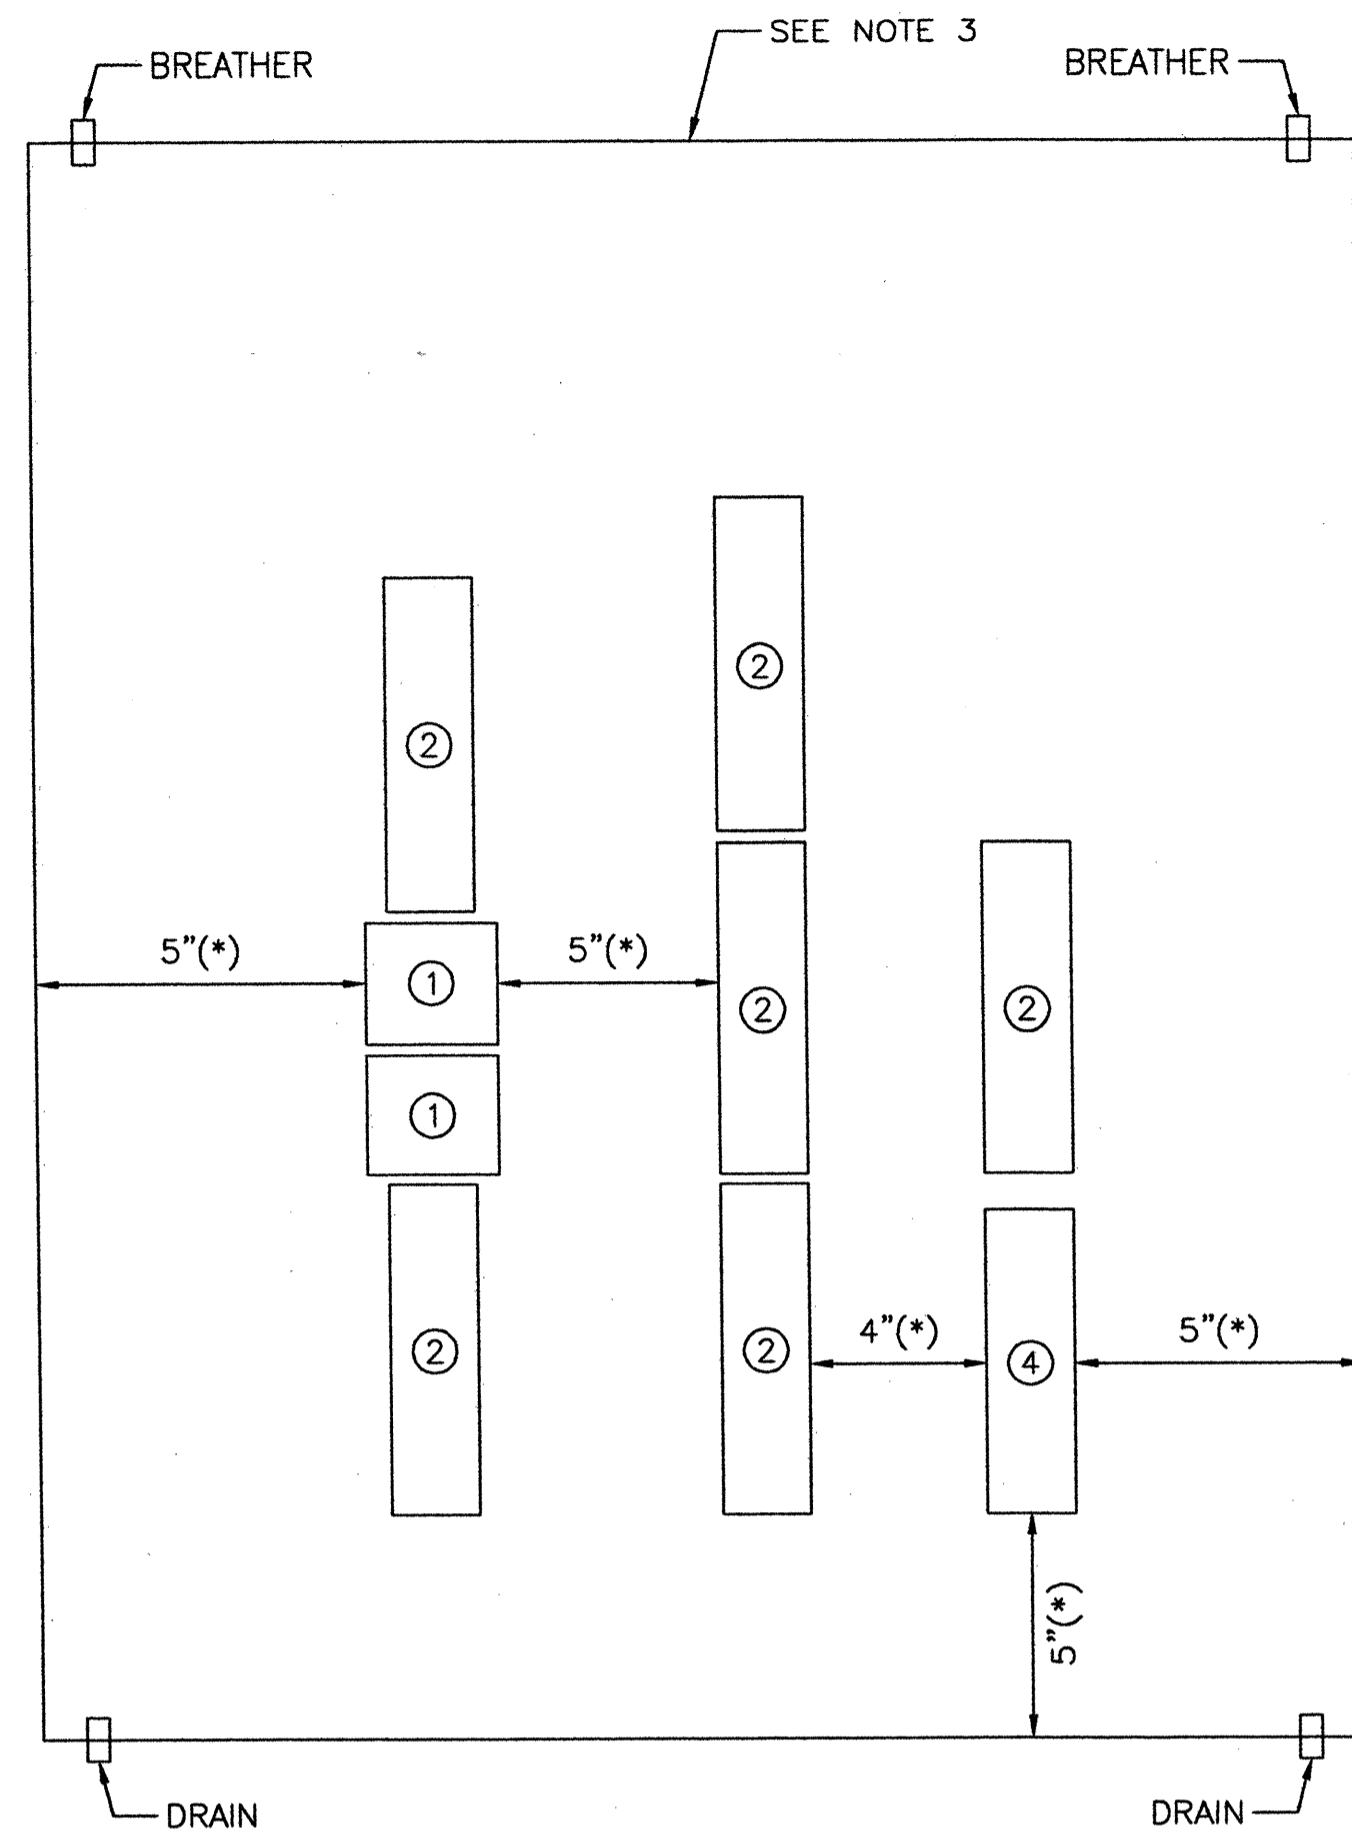

LAYOUT -- NEW TYPICAL MACHINERY DECK
TERMINAL CABINET

SCALE: NONE

TYPICAL OF NEW CABINETS TC-1, -2, -3, AND -4.


ITEM EB103

BOX IS 36"Hx30"Wx12"D.

NOTES:

- LAYOUT SHOWN FOR THE NEW MACHINERY DECK TERMINAL CABINETS IS CONCEPTUAL. THE ACTUAL LAYOUT SHALL BE AS REQUIRED TO PERMIT EXISTING CONDUCTORS WHICH ARE TO BE RE-USED TO REACH THEIR RESPECTIVE TERMINALS, AND SHALL BE DETERMINED BY THE CONTRACTOR IN THE FIELD. THE ACTUAL LAYOUT SHALL CONFORM TO THE MINIMUM SPACINGS NOTED.
- (*) INDICATES MINIMUM REQUIRED SPACING, NOT AN ACTUAL DIMENSION.
- CONDUIT ENTRANCES SHALL NOT BE MADE IN THE TOP WALLS OF THE INDICATED BOXES.
- THESE BOXES SHALL INCLUDE FACTORY MADE BOSSED, DRILLED, AND TAPPED HOLES FOR ALL REQUIRED CONDUITS, PLUS ONE SPARE HOLE FOR A 1" CONDUIT.
- PRIOR TO ORDERING ANY BOXES, SUBMIT FOR APPROVAL DIMENSIONED DRAWINGS SHOWING THE LAYOUT OF ALL REQUIRED TERMINAL BLOCKS (BASED ON THE DIMENSIONS OF THE ACTUAL SUPPLIED TERMINAL BLOCKS) AND GROUND BARS. DRAWINGS SHALL ALSO SHOW THE LOCATIONS AND SIZES OF ALL REQUIRED CONDUIT HOLES, LOCATIONS OF BREATHERS AND DRAINS, AND ALL OTHER SIGNIFICANT FEATURES.

BREATHER SHALL BE INSTALLED AS CLOSE AS POSSIBLE TO THE BACK WALL

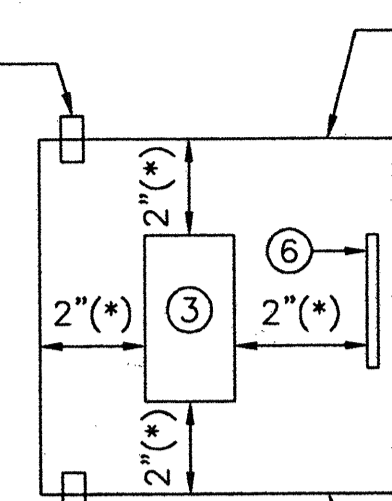

DRAIN SHALL BE INSTALLED AS CLOSE AS POSSIBLE TO THE COVER

HUB FOR ONE 1" DIA. CONDUIT IN THIS WALL

HUBS FOR TWO 3/4" DIA. AND ONE 1" DIA. CONDUITS IN THIS WALL (1" DIA. CONDUIT HOLE IS SPARE)


LAYOUT -- NEW JUNCTION
BOX JB-15

SCALE: NONE

ITEM EB105

BOX IS 8"Hx8"Wx4"D.
SEE NOTE 4.


MECHANICAL LUG FOR (1) 14-2/0 AWG
ILSCO TA-2/0, OR APPROVED EQUAL
(TYP. 4 PLACES PER ASSEMBLY)

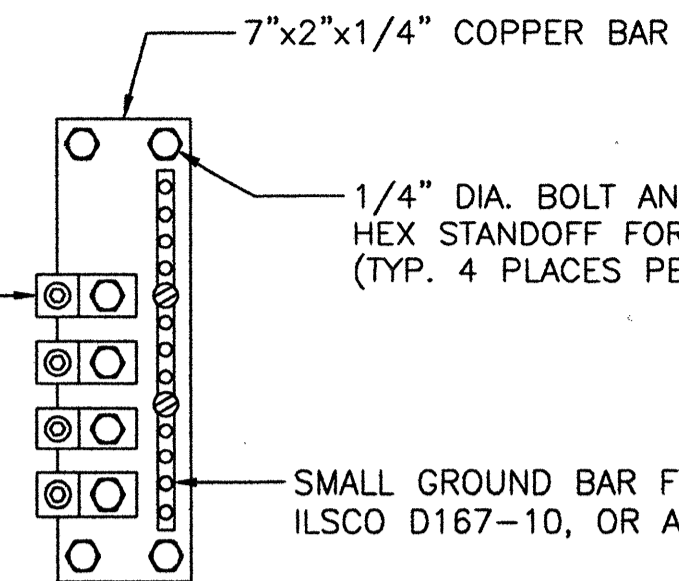

DETAIL -- LARGE GROUND BAR ASSEMBLY

SCALE: NONE

ALL HARDWARE SHALL BE TYPE 316 STAINLESS STEEL. ALL BOLTED CONNECTIONS SHALL UTILIZE LOCKWASHERS.

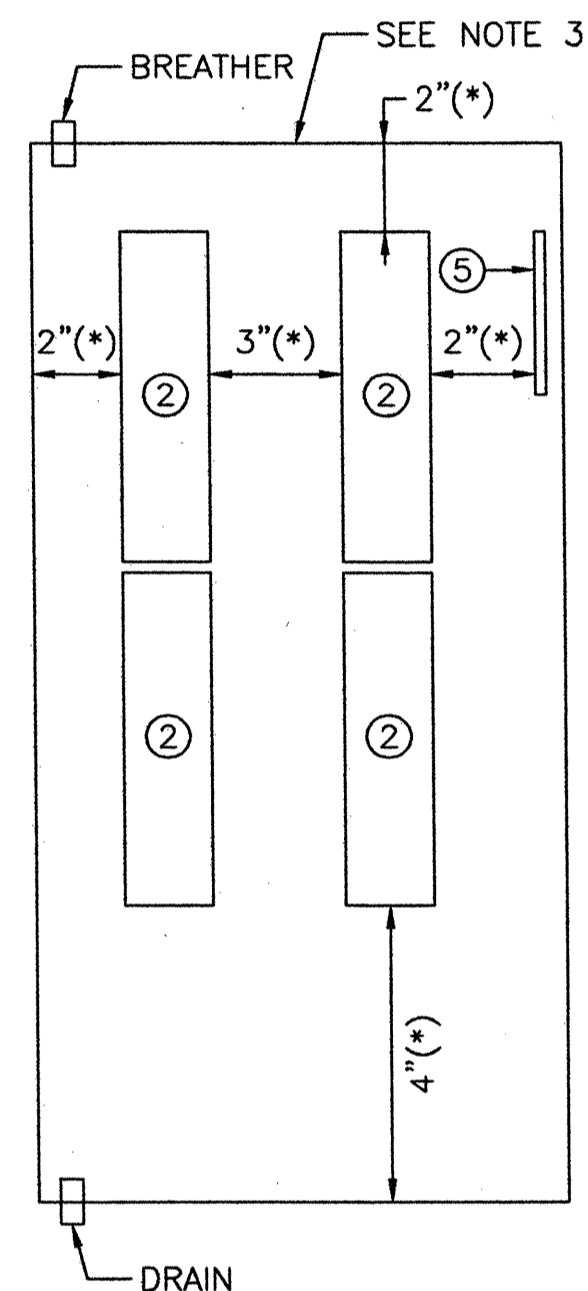


LAYOUT -- NEW JUNCTION
BOX JB-13A

SCALE: NONE

ITEM EB105

BOX IS 24"Hx12"Wx6"D.
SEE NOTE 4.

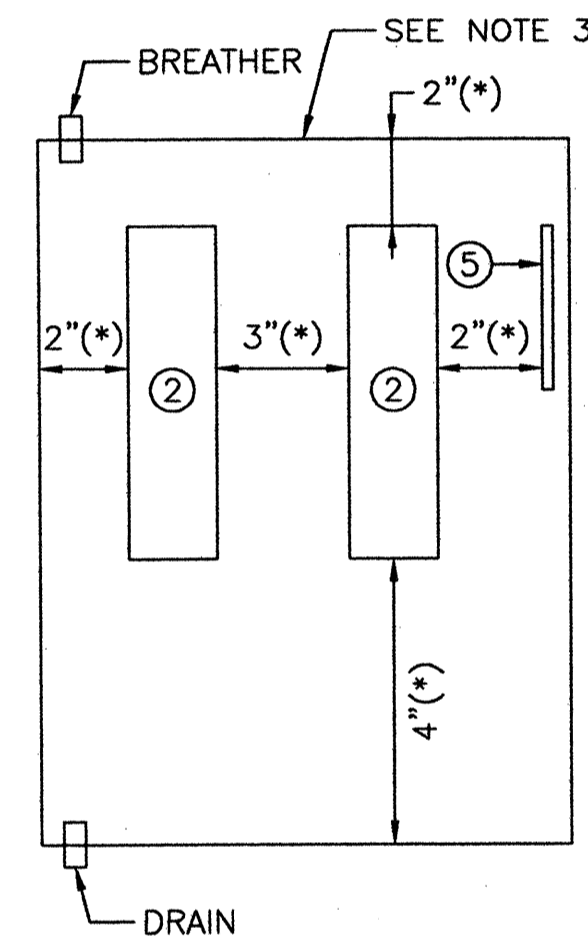


LAYOUT -- NEW JUNCTION
BOX JB-13B

SCALE: NONE

ITEM EB105

BOX IS 16"Hx12"Wx6"D.
SEE NOTE 4.

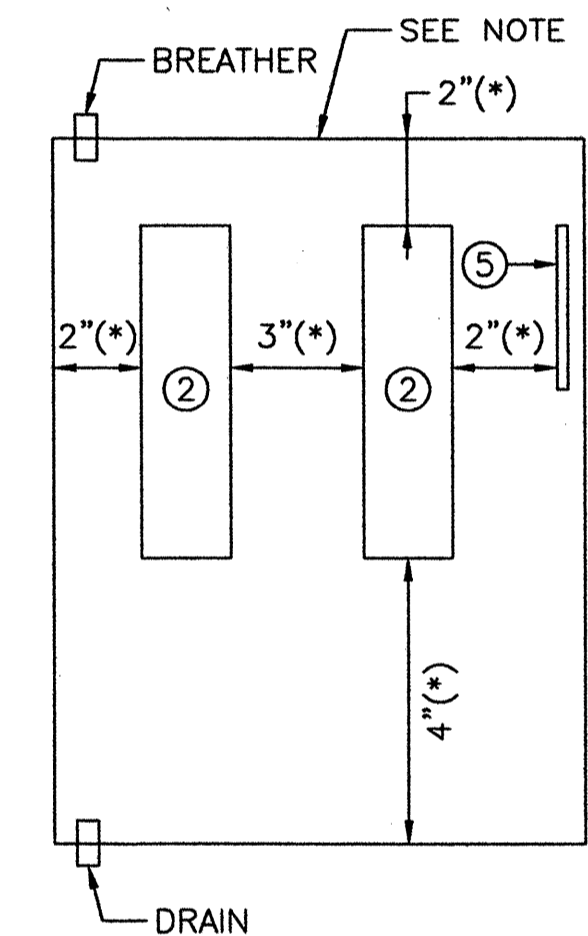


LAYOUT -- NEW JUNCTION
BOXES JB-14A & -14B

SCALE: NONE

ITEM EB105

BOX IS 16"Hx12"Wx6"D.
SEE NOTE 4.

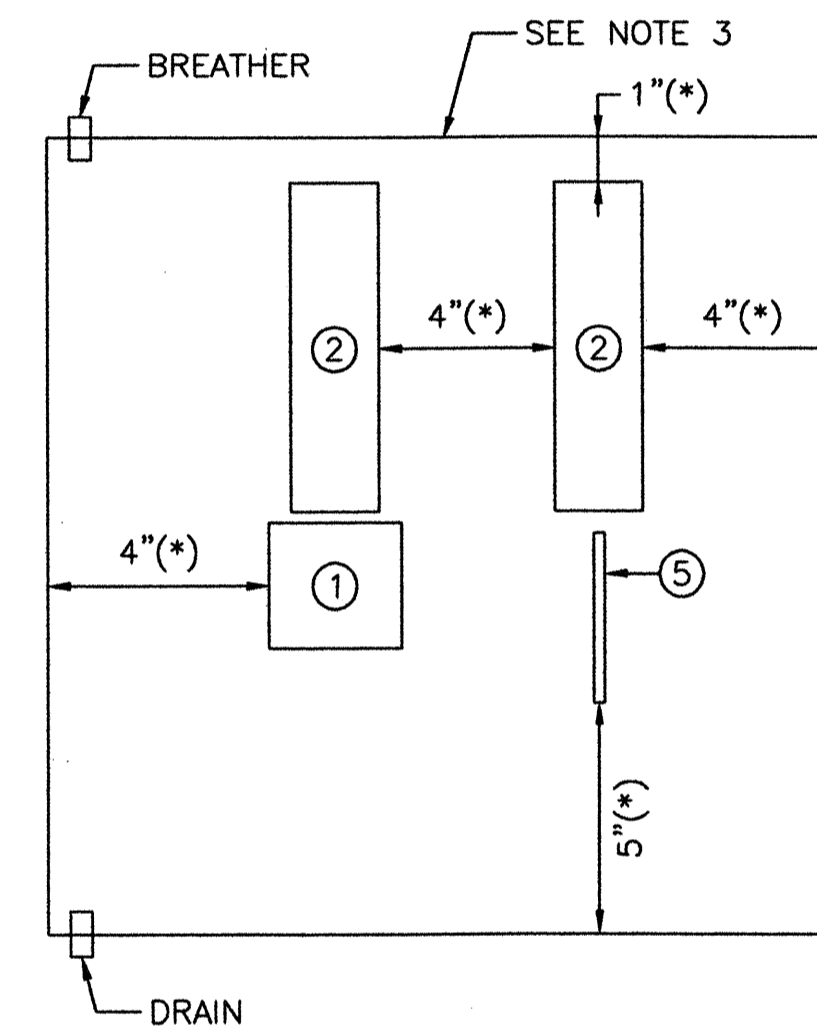

LAYOUT -- NEW JUNCTION
BOX JB-24


SCALE: NONE

ITEM EB105


BOX IS 18"Hx18"Wx8"D.
SEE NOTE 4.

TERMINAL BLOCK LEGEND

- LARGE TERMINAL BLOCK. 3 POLES. 14-2/0 AWG. (EB107)
- SMALL TERMINAL BLOCK. 12 POLES. 18-4 AWG. (EB106)
- SMALL TERMINAL BLOCK. 6 POLES. 18-4 AWG. (EB106)
- LARGE GROUND BAR ASSEMBLY. SEE DETAIL THIS SHEET.
- SMALL GROUND BAR. (7) 14-6 AWG. ILSCO D167-6, OR APPROVED EQUAL.
- SMALL GROUND BAR. (5) 14-6 AWG. ILSCO D167-4, OR APPROVED EQUAL.

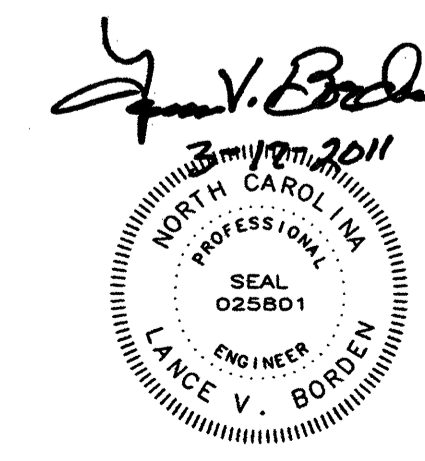

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE WILMINGTON, NORTH CAROLINA TERMINAL CABINETS AND JUNCTION BOXES			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	CHECKED	Q.C. TON
DRAWN BY		N.E. ALGER	
SCALE		AS NOTED	
DRAWING NO.		49 OF 63	

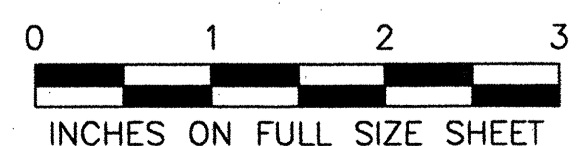



49-EB23-TCUB.DWG

ELECTRICAL EQUIPMENT SCHEDULE					
ITEM NUMBER	QUANTITY	ITEM NAME	MANUFACTURER OR SUPPLIER	CATALOG NUMBER OR MODEL	DESCRIPTION
EB101	14	30A DISCONNECT SWITCH	CUTLER-HAMMER	DH361UWK	HEAVY DUTY, SINGLE THROW, NON-FUSED SAFETY SWITCH. UL LISTED. 3 POLE, 600VAC, 30A, 20HP (AT 480VAC, 3PH). NEMA 4X STAINLESS STEEL (TYPE 316) ENCLOSURE WITH VIEWING WINDOW OVER SWITCH BLADES. 10KA SYMMETRICAL SHORT CIRCUIT AT 480VAC.
EB102	4	200A DISCONNECT SWITCH	CUTLER-HAMMER	DH364UWK	HEAVY DUTY, SINGLE THROW, NON-FUSED SAFETY SWITCH. UL LISTED. 3 POLE, 600VAC, 200A, 125HP (AT 480VAC, 3PH). NEMA 4X STAINLESS STEEL (TYPE 316) ENCLOSURE WITH VIEWING WINDOW OVER SWITCH BLADES. 10KA SYMMETRICAL SHORT CIRCUIT AT 480VAC.
EB103	4	MACHINERY DECK TERMINAL CABINET	HOFFMAN	A-36H3012SS6LP	NEMA 4X STAINLESS STEEL (TYPE 316) WALL MOUNT JUNCTION BOX. UL LISTED. 36" HIGH, 30" WIDE, 12" DEEP. CONTINUOUSLY HINGED, CLAMPED COVER. 14 GAUGE BODY. STAINLESS STEEL BREATHERS AND DRAINS. STAINLESS STEEL INNER PANEL WITH TERMINAL BLOCKS AS INDICATED. SEE ELECTRICAL GENERAL NOTE 2.16.
EB104	4	WIREWAY	HOFFMAN	CUSTOM	NEMA 4X STAINLESS STEEL (TYPE 316) FEED-THROUGH WIREWAY. 6"x6" CROSS-SECTION, 60" LONG. HINGED, CLAMPED COVER. 16 GAUGE BODY. WITH CLOSURE PLATE, BOX CONNECTOR, SUPPORT BRACKETS FOR WALL MOUNTING, AND ALL OTHER NECESSARY HARDWARE.
EB105	6	JUNCTION BOX	O-Z/GEDNEY	YW-A	NEMA 4 CAST ALUMINUM BOX JUNCTION BOX. UL LISTED. DIMENSIONS AS INDICATED. STAINLESS STEEL COVER HINGE AND CLAMP BOLTS. EXTERNAL CAST MOUNTING LUGS. FACTORY SUPPLIED BOSSED, DRILLED, AND TAPPED CONDUIT HOLES AS REQUIRED. STAINLESS STEEL DRAIN AND BREATHER IN DRILLED AND TAPPED HOLES. ALUMINUM INNER PANEL WITH TERMINAL BLOCKS AS INDICATED. SEE ELECTRICAL GENERAL NOTE 2.16.
EB106	AS REQ'D	SMALL TERMINAL BLOCK	MARATHON SPECIAL PRODUCTS	985 GP	HEAVY DUTY TERMINAL BLOCK. UL RECOGNIZED. 600V, 85A, 150C. TIN PLATED ALUMINUM BOX TYPE LUGS WITH NICKEL PLATED STEEL SCREWS FOR VARIOUS COMBINATIONS OF 18 AWG - 4 AWG COPPER CONDUCTORS. PHENOLIC BASE. NUMBER OF POLES AS INDICATED.
EB107	AS REQ'D	LARGE TERMINAL BLOCK	MARATHON SPECIAL PRODUCTS	1423572	HEAVY DUTY 3 POLE TERMINAL BLOCK. UL RECOGNIZED. 600V, 175A, 90C. TIN PLATED COPPER OR ALUMINUM SCREW LUGS WITH ONE OPENING PER POLE FOR 14 AWG - 2/0 AWG COPPER CONDUCTORS. PHENOLIC BASE.
EB108	1	PANELBOARD PNB-3	CUTLER-HAMMER	P48G28T15P	MINI-POWER CENTER CONSISTING OF A DRY TYPE TRANSFORMER AND CIRCUIT BREAKER TYPE BRANCH CIRCUIT PANELBOARD. UL LISTED. 480:208Y/120VAC, 3 PHASE, 15KVA. WITH TWELVE 20A, 1 POLE BRANCH CIRCUIT BREAKERS. NEMA 3R ENCLOSURE. PANELBOARD SHALL BE MOUNTED INSIDE A NEMA 4X STAINLESS STEEL CABINET (SEE BELOW).
			HOFFMAN	A-48H3612SS6LP	NEMA 4X STAINLESS STEEL (TYPE 316) WALL MOUNT JUNCTION BOX. UL LISTED. 48" HIGH, 36" WIDE, 12" DEEP. CONTINUOUSLY HINGED, CLAMPED COVER. 14 GAUGE BODY. STAINLESS STEEL BREATHERS AND DRAINS. STAINLESS STEEL INNER PANEL.

ELECTRICAL EQUIPMENT SCHEDULE (CONTINUED)					
ITEM NUMBER	QUANTITY	ITEM NAME	MANUFACTURER OR SUPPLIER	CATALOG NUMBER OR MODEL	DESCRIPTION
EB109	2	BASCULE LEAF ROTARY CAM LIMIT SWITCH	GEMCO	1980-412-D-SP-X	ROTARY CAM LIMIT SWITCH. SINGLE TURN. 12 CAMS, SPDT SWITCHES. CONTACTS RATED 10A AT 120VAC. NEMA 4/4X STAINLESS STEEL (TYPE 316) HOUSING. REAR SHAFT EXTENSION. CAMS ADJUSTABLE WITHOUT TOOLS, SETTABLE FROM 4 TO 356 DEGREES.
			HELICAL PRODUCTS COMPANY	MC7C	HELICAL BEAM TYPE FLEXIBLE COUPLING. STAINLESS STEEL. INTEGRAL CLAMP ATTACHMENT. BORE(S) AND KEYWAY(S) TO MATCH SHAFTS. MISALIGNMENT CAPACITY: 5 DEGREES ANGULAR, 0.030 INCHES PARALLEL OFFSET, 0.010 INCHES AXIAL.
			GEMCO	3001	DIRECT DRIVE ADJUSTABLE COUPLING WITH BORE TO MATCH ROTARY CAM SWITCH INPUT SHAFT. INFINITELY ADJUSTABLE, WITH 50:1 ADJUSTMENT RATIO.
EB110	2	AUXILIARY DRIVE CONTROLS	CUSTOM	CUSTOM	CONTROLS FOR AUXILIARY DRIVE MOTOR, WITH ALL CHARACTERISTICS AS SHOWN.
EB111	38	VAPORTIGHT INCANDESCENT LUMINAIRE	HUBBELL INDUSTRIAL LIGHTING	NVB15GG-LT	ENCLOSED AND GASKETED WALLMOUNT INCANDESCENT LUMINAIRE. UL LISTED (1598). 120VAC. MAX 150W LAMP. NEMA 3 AND 4X GLASS FILLED (30%) THERMOPLASTIC POLYESTER BODY, GUARD, AND SPLICE BOX. GLASS GLOBE. SUITABLE FOR 90C SUPPLY WIRE. WITH 100W ROUGH-SERVICE LAMP.
EB112	4	COUNTERWEIGHT PIT FLOODLIGHT	PAULUHN	QA1605	QUARTZ HALOGEN FLOODLIGHT. UL LISTED (1598A - MARINE OUTSIDE TYPE SALTWATER). 120VAC. 500W LAMP. IP66 COPPER FREE ALUMINUM HOUSING WITH OVEN-CURED POLYESTER POWDER COAT FINISH. ONE-PIECE HIGH TEMPERATURE SILICONE GASKET. THERMAL AND SHOCK RESISTANT HIGH IMPACT TEMPERED GLASS LENS. HAMMERTONE ALUMINUM REFLECTOR. SPRING LOADED LAMPHOLDER. STAINLESS STEEL HARDWARE AND WIRE GUARD. WITH 500W LAMP.
EB113	10	LIGHT SWITCH	HUBBELL	HBL1221BLK HBL1223BLK	HEAVY DUTY SPECIFICATION GRADE, AC SWITCH. UL LISTED. 120-277VAC, 20A. SINGLE POLE OR THREE-WAY AS REQUIRED.
EB114	3	GFCI RECEPTACLE	HUBBELL	GF5362GYA	HEAVY DUTY SPECIFICATION GRADE DUPLEX AC GFCI RECEPTACLE. UL LISTED. 120VAC, 20A, NEMA 5-20R.
EB115	4	BASCULE SPAN NAVIGATION LIGHT	B&B ROADWAY	BS	WATERWAY NAVIGATION LIGHT FOR MARKING BASCULE SPANS. 180 DEGREE, 200MM O.D., GREEN FRESNEL LENS ABOVE 180 DEGREE, 200MM O.D., RED FRESNEL LENS. 120VAC, MINIMUM 840 CANDELAS LED LAMPS. CAST ALUMINUM HOUSING AND SWIVEL MOUNTING BASE WITH ANTI-SWING BRAKE. GALVANIZED SCH40 STEEL PIPE STEM. STAINLESS STEEL (TYPE 316) RETRIEVAL CHAIN. GALVANIZED STEEL PLATE COUNTERWEIGHT. JUNCTION BOX MATCHING MOUNTING BASE FOOTPRINT.
EB116	AS REQ'D	TACHOMETER CABLE	BELDEN	3103A	TYPE TC INSTRUMENTATION CABLE. UL LISTED. ONE 12 AWG PAIR, STRANDED (7X20) COPPER CONDUCTORS. OVERALL 100% COVERAGE FOIL SHIELD AND DRAIN WIRE. 600V PVC/NYLON INSULATION. OIL AND UV RESISTANT PVC OUTER JACKET.
EB117	AS REQ'D	FLEXIBLE CABLE	AMERICAN INSULATED WIRE CORP.	20734	TYPE SOOW FLEXIBLE CORD. UL LISTED. FOUR 10 AWG STRANDED (104X30) COPPER CONDUCTORS. 600V EPDM INSULATION AND CPE JACKET, RATED 90C. WEATHER, WATER, SUNLIGHT, OIL, AND FLAME RESISTANT.
EB118	8	LIVE LOAD SPAN LOCK LIMIT SWITCH	NAMCO	E4800-20140	HEAVY DUTY LEVER ARM LIMIT SWITCH. FOUR CIRCUITS (2 N.O. AND 2 N.C.). CONTACTS RATED 20A AT 120VAC. NEMA 4X, 6P, 7, AND 9 CAST BRONZE HOUSING. -40C TO +90C SERVICE. CW AND CCW OPERATION.
				EL150-58901	SIDE ROLLER TYPE OPERATING LEVER COMPATIBLE WITH LIMIT SWITCH. 4 INCH BRONZE ARM AND 1 1/4 INCH DIAMETER NYLON ROLLER.

NOTES:

- THESE EQUIPMENT SCHEDULES DO NOT NECESSARILY PROVIDE AN EXHAUSTIVE LISTING OF ALL EQUIPMENT REQUIRED.
- REFERENCE TO A SPECIFIC MANUFACTURER'S NAME AND/OR CATALOG NUMBER IS INTENDED TO DENOTE THE QUALITY AND CHARACTERISTICS OF THE EQUIPMENT AND MATERIAL AND NOT TO SPECIFICALLY EXCLUDE OTHER ACCEPTABLE PRODUCTS, BUT ANY SUBSTITUTIONS TO REFERENCED ITEMS MUST BE APPROVED BY THE ENGINEER.
- THE CONTRACTOR SHALL CONFIRM ALL QUANTITIES AND THE AVAILABILITY OF ALL SPECIFIED ITEMS.

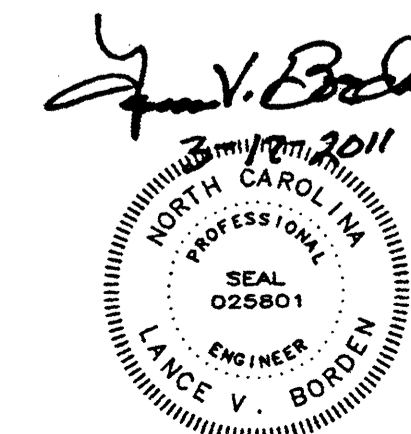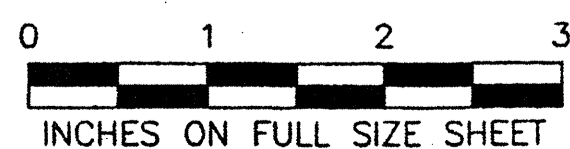

STATE OF NORTH CAROLINA			
DEPARTMENT OF TRANSPORTATION			
RALEIGH			
CAPE FEAR BASCULE BRIDGE AND MEMORIAL LIFT BRIDGE			
WILMINGTON, NORTH CAROLINA			
ELECTRICAL EQUIPMENT SCHEDULE			
DESIGNED	N.E. ALGER	DATE	MARCH 2011
CHECKED	Q.C. TON	DRAWING NO.	50 OF 63

EB24