


ELEVATION

4-BOLT METAL RAIL ANCHOR ASSEMBLY


STAGE I - (191 ASSEMBLIES REQUIRED) STAGE II - (191 ASSEMBLIES REQUIRED) TOTAL - (382 ASSEMBLIES REQUIRED)

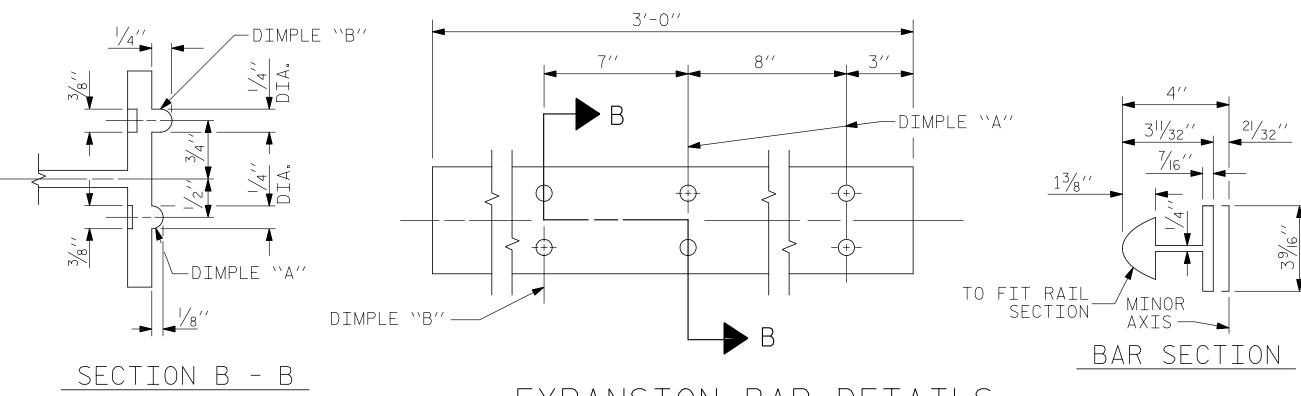

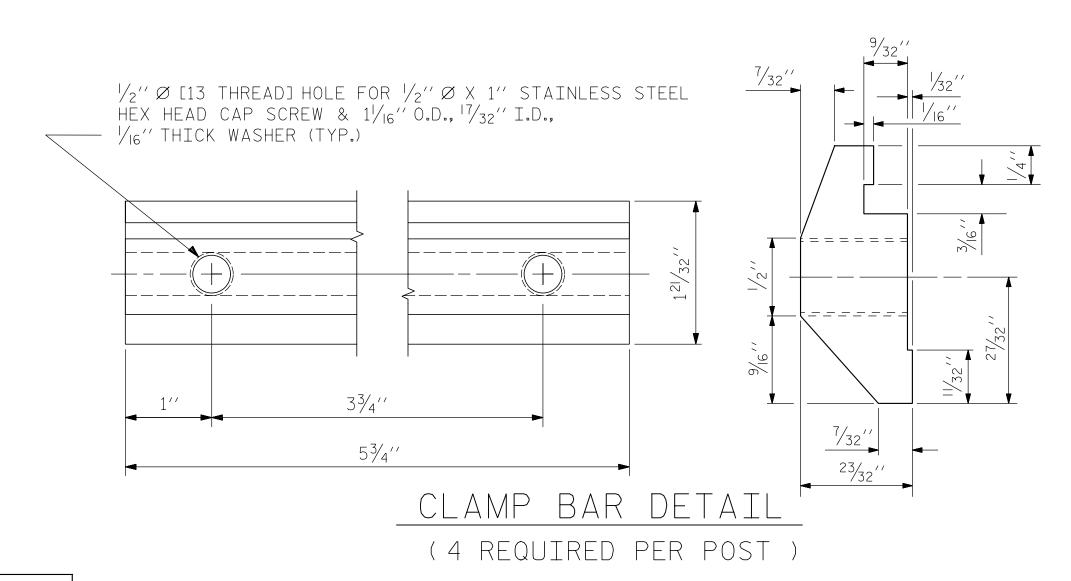


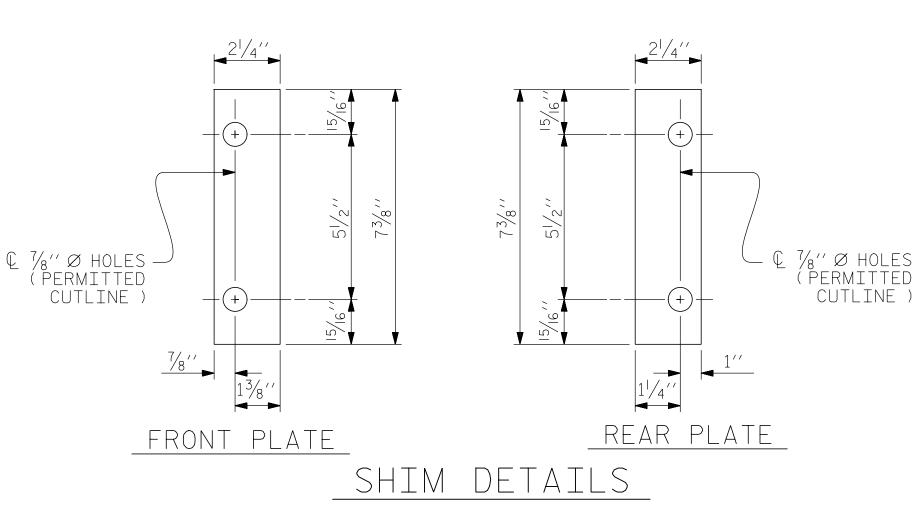

NOTE:
SHIMS MAY BE CUT ALONG PERMITTED CUTLINE OR
SLOTTED TO EDGE OF PLATE TO FACILITATE PLACEMENT.

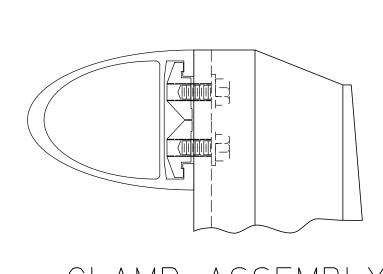

CLAMP ASSEMBLY



— Docusigned by:
Paul Holshouser

48793.3.1 PROJECT NO.__ BLADEN COUNTY STATION: 118+81.78 -L-

_ SEMI-ELLIPSE

MAJOR

AXIS

MINOR AXIS

SHEET 2 OF 3

RAIL SECTION

NOTES

STRUCTURAL CONCRETE ANCHOR ASSEMBLY

A. FERRULES SHALL BE MADE FROM STEEL MEETING THE REQUIREMENTS OF AASHTO M169, GRADE 12L14 AND SHALL HAVE A MINIMUM LENGTH OF THREADS OF 2"

REQUIREMENTS OF ASTM A307. BOLTS AND WASHERS SHALL BE GALVANIZED.

OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE

C. WIRE STRUT SHOWN IN THE CONCRETE ANCHOR ASSEMBLY DETAIL IS THE

D. THE METAL RAIL ANCHOR ASSEMBLIES TO BE HOT DIPPED GALVANIZED TO

E. THE COST OF THE METAL RAIL ANCHOR ASSEMBLY WITH BOLTS AND WASHERS

STRENGTH OF 90,000 PSI IS ACCEPTABLE.

CONFORM TO REQUIREMENTS OF AASHTO M111.

BOLTS OR DOWELS, SEE THE STANDARD SPECIFICATIONS.

AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE $\frac{3}{4}$ " \varnothing X $2\frac{1}{2}$ " GALVANIZED BOLTS AND

WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS

MINIMUM ALLOWABLE SIZE AND SHALL HAVE A MINIMUM TENSILE STRENGTH OF 100,000 PSI. AS AN OPTION, A $7/6^{\prime\prime}$ Ø WIRE STRUT WITH A MINIMUM TENSILE

COMPLETE IN PLACE SHALL BE INCLUDED IN THE PRICE BID FOR LINEAR FEET

F. BOLTS TO BE TIGHTENED ONE-HALF TURN WITH A WRENCH FROM A FINGER-TIGHT

THE CONTRACTOR MAY USE ADHESIVELY ANCHORED ANCHOR BOLTS IN PLACE OF THE METAL RAIL ANCHOR ASSEMBLY. LEVEL ONE FIELD TESTING IS REQUIRED, AND THE YIELD LOAD OF THE $\frac{3}{4}$ % BOLT IS 10 KIPS. FOR ADHESIVELY ANCHORED ANCHOR

REQUIREMENTS OF ASTM F593 ALLOY 304 STAINLESS STEEL WITH MINIMUM 75,000 PSI ULTIMATE STRENGTH. NUTS SHALL MEET THE REQUIREMENTS OF ASTM F594

WHEN ADHESIVELY ANCHORED ANCHOR BOLTS ARE USED, BOLTS SHALL MEET THE

ALLOY 304 STAINLESS STEEL AND WASHERS SHALL MEET THE REQUIREMENTS OF ASTM F844 EXCEPT THEY SHALL BE MADE FROM ALLOY 304 STAINLESS STEEL.

B. 4 - $\frac{3}{4}$ " \varnothing X 2 $\frac{1}{2}$ " BOLTS WITH WASHERS. BOLTS SHALL CONFORM TO THE

THE STRUCTURAL CONCRETE ANCHOR ASSEMBLY SHALL CONSIST OF THE

FOLLOWING COMPONENTS:

FOR 3/4" FERRULES.

ENGINEER.

OF METAL RAIL.

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

2 BAR METAL RAIL

SHEET NO REVISIONS S-58 NO. BY: ICE of Carolinas, PLLC DATE: DATE: 4505 Falls of Neuse Road, Suite 110 TOTAL SHEETS Raleigh, North Carolina 27609 Phone: 803-822-0333 License #: P-0999

DRAWN BY: ____B.J.MANTEI DATE: 6-3-20 CHECKED BY: J. N. AUSTIN DATE: 6-4-20 DESIGN E.O.R.: P. R. HOLSHOUSER DATE: 7-23-20

DOCUMENT NOT CONSIDERED FINAL **UNLESS ALL SIGNATURES COMPLETED**

CAROLINAS, PLLC

EXPANSION BAR DETAILS

SIDE VIEW

€ 1/8" Ø HOLES -

RAIL CAP

SUPERSTRUCTURE