


## ELASTOMERIC BEARING DETAILS

ELASTOMER IN ALL BEARINGS SHALL BE 60 DUROMETER HARDNESS.

DEAD LOAD DEFLECTION AND	ND CAMBER
	3'-0" × 1'-9"
30' & 35' CORED SLAB UNIT	0.6″Ø L.R. STRAND
CAMBER (SLAB ALONE IN PLACE)	1/4″ ╽
DEFLECTION DUE TO SUPERIMPOSED DEAD LOAD	1/8″ ♦
FINAL CAMBER	l∕ <sub>8</sub> ″

\*\* INCLUDES FUTURE WEARING SURFACE

CONCRETE RELEASE STRENGTH						
UNIT	PSI					
30′& 35′UNITS	4000					

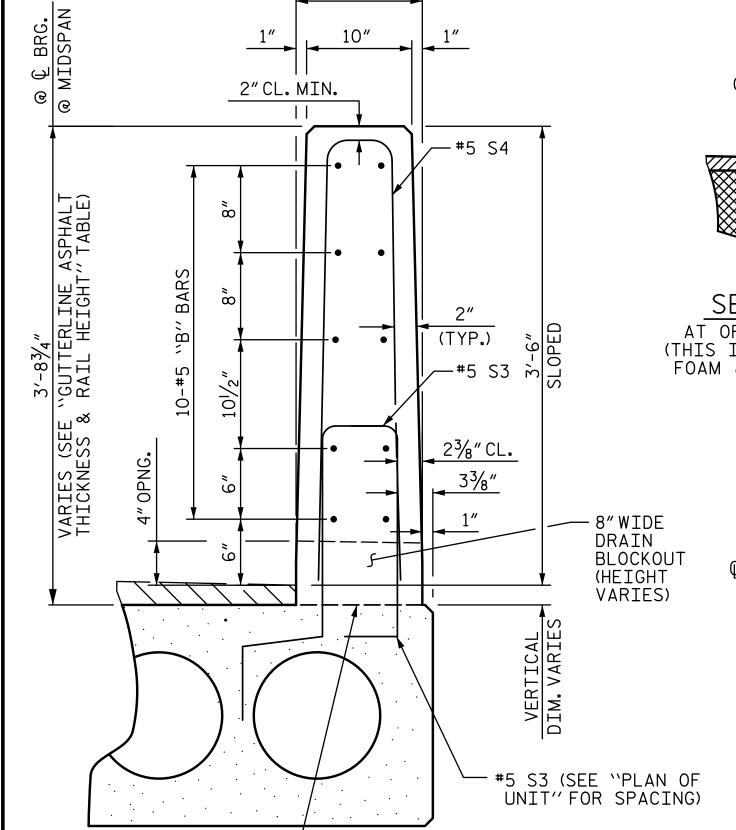

REV. 5/18

CHECKED BY : BCH 6/09


MAA/THC

BAR BARS PER PAIR OF EXTERIOR UNITS TOTAL NO. SIZE TY 30'UNIT	PE LENGTH WEIGHT					
30' UNIT						
*B9 20 20 #5 S	TR 29'-6" 615					
* S4 78 78 #5 2	2 7'-2" 583					
*EPOXY COATED REINFORCING STEEL LBS. 11						
CLASS AA CONCRETE CU.YDS.						
TOTAL VERTICAL CONCRETE BARRIER RAIL LN.	FT. 60.14					

BILL OF MATERIAL FOR VERTICAL CONCRETE BARRIER RAIL							
BAR	BARS PER PAIR OF EXTERIOR UNITS	TOTAL NO.	SIZE	TYPE	LENGTH	WEIGHT	
	35' UNIT						
<b></b> ₩B10	80	80	#5	STR	10'-5"	869	
<del>*</del> \$4	88	88	#5	2	7′-2″	658	
*EPOXY COATED REINFORCING STEEL LBS. 1527							
CLASS AA CONCRETE CU.YDS. 9.0							
TOTAL VERTICAL CONCRETE BARRIER RAIL LN.FT. 70.14							

GUTTERLINE ASPI	HALT THICKNESS & RAI	L HEIGHT
	ASPHALT OVERLAY THICKNESS	RAIL HEIGHT
	@ MID-SPAN	@ MID-SPAN
30′& 35′UNITS	25/8″	3′-85⁄8″

CORED	UIRED	CORED	SLABS	S REQ	UIRED		
	NUMBER	LENGTH	TOTAL LENGTH		NUMBER	LENGTH	TOTAL LENGTH
30'UNIT				35' UNIT			
EXTERIOR C.S.	2	30'-0"	60'-0"	EXTERIOR C.S.	. 2	35′-0″	70′-0″
INTERIOR C.S.	8	30'-0"	240'-0"	INTERIOR C.S.	. 8	35′-0″	280'-0"
TOTAL	10		300′-0″	TOTAL	10		350′-0″

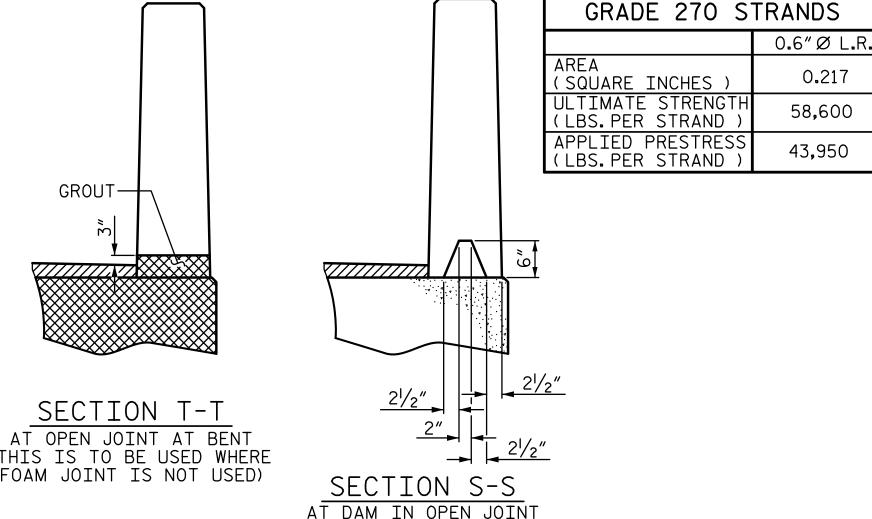

END OF RAIL DETAILS

## NOTES

BAR TYPES

2'-10''

ALL BAR DIMENSIONS ARE OUT TO OUT

EXTERIOR UNIT |

40

38

221

14

15

15

358

4.5

227

| LENGTH | WEIGHT |

INTERIOR UNIT

29′-7″

4′-6″

5′-4″

5′-5″

5′-6″

5′-7″

5′-9″

LENGTH | WEIGHT

40

221

14

15

15

15

358

4.5

SIGNATURES COMPLETED

BILL OF MATERIAL FOR ONE 30' CORED SLAB UNIT

29′-7″

4′-6″

5′-4″

5′-7″

5′-5″

5′-6″

5′-7″

5′-9″

BAR | NUMBER | SIZE | TYPE

8

62

39

4

4

| 4

REINFORCING STEEL

0.6" Ø L.R. STRANDS

REINFORCING STEEL

5000 P.S.I. CONCRETE CU. YDS.

\* EPOXY COATED

S5

S6

S8

#4 | STR

#5 |

#5

#4

#4

#4

#4 | 3

#4 | 3

6"

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL REINFORCING STEEL CAST WITH THE CORED SLAB SECTIONS SHALL BE GRADE 60 AND SHALL BE INCLUDED IN THE UNIT PRICE BID FOR PRESTRESSED CONCRETE CORED SLABS.

RECESSES FOR TRANSVERSE STRANDS SHALL BE GROUTED AFTER THE TENSIONING OF THE STRANDS.

THE 21/2" Ø DOWEL HOLES AT FIXED ENDS OF SLAB SECTIONS SHALL BE FILLED WITH NON-SHRINK GROUT.

THE BACKER RODS SHALL CONFORM TO THE REQUIREMENTS OF TYPE M

BOND BREAKER. SEE SECTION 1028 OF THE STANDARD SPECIFICATIONS.

WHEN CORED SLABS ARE CAST, AN INTERNAL HOLD-DOWN SYSTEM SHALL BE EMPLOYED TO PREVENT VOIDS FROM RISING OR MOVING SIDEWAYS. AT LEAST SIX WEEKS PRIOR TO CASTING CORED SLABS, THE CONTRACTOR SHALL SUBMIT TO THE ENGINEER FOR REVIEW AND COMMENT, DETAILED DRAWINGS OF THE PROPOSED HOLD-DOWN SYSTEM. IN ADDITION TO STRUCTURAL DETAILS. LOCATION AND SPACING OF THE HOLD-DOWNS SHALL BE INDICATED.

ALL REINFORCING STEEL IN THE VERTICAL CONCRETE BARRIER RAIL SHALL BE EPOXY COATED.

PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE CORED SLAB UNIT ENDS.

APPLY EPOXY PROTECTIVE COATING TO CORED SLAB UNIT ENDS.

GROOVED CONTRACTION JOINTS,  $\frac{1}{2}$ " IN DEPTH, SHALL BE TOOLED IN ALL EXPOSED FACES OF THE BARRIER RAIL AND IN ACCORDANCE WITH ARTICLE 825-10(B) OF THE STANDARD SPECIFICATIONS. A CONTRACTION JOINT SHALL BE LOCATED AT EACH THIRD POINT BETWEEN BARRIER RAIL EXPANSION JOINTS. ONLY ONE CONTRACTION JOINT IS REQUIRED AT MIDPOINT OF BARRIER RAIL SEGMENTS LESS THAN 20 FEET IN LENGTH AND NO CONTRACTION JOINTS ARE REQUIRED FOR THOSE SEGMENTS LESS THAN 10 FEET IN LENGTH.

FLAME CUTTING OF THE TRANSVERSE POST-TENSIONING STRAND IS NOT ALLOWED.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE CORED SLAB UNIT SHALL BE DONE WHEN THE CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN THE REQUIRED STRENGTH SHOWN IN THE "CONCRETE RELEASE STRENGTH" TABLE.

FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

THE PERMITTED THREADED INSERTS ARE DETAILED AS AN OPTION FOR THE CONTRACTOR TO ATTACH FALSEWORK AND FORMWORK DURING CONSTRUCTION.

THE PERMITTED THREADED INSERTS IN THE EXTERIOR UNITS SHALL BE SIZED BY THE CONTRACTOR, SPACED AT 4'-0" CENTERS AND GALVANIZED IN ACCORDANCE WITH SECTION 1076 OF THE STANDARD SPECIFICATIONS. STAINLESS STEEL THREADED INSERTS MAY BE USED AS AN ALTERNATE.

THE PERMITTED THREADED INSERTS SHALL BE GROUTED BY THE CONTRACTOR IMMEDIATELY FOLLOWING REMOVAL OF THE FALSEWORK.

THE COST OF THE PERMITTED THREADED INSERTS SHALL BE INCLUDED IN THE PRICE BID FOR THE PRECAST UNITS.

THE DRAIN OPENING AT THE GUTTERLINE SHALL BE 4"X 8". THE HEIGHT OF THE BLOCKOUT IN THE VERTICAL CONCRETE BARRIER RAIL SHALL EXTEND FROM THE TOP OF CORED SLAB UNIT TO THE TOP OF THE DRAIN OPENING.

APPLY EPOXY PROTECTIVE COATING TO EXTERIOR FACE OF THE EXTERIOR CORED SLAB UNITS THAT REQUIRE DRAINS IN THE BARRIER RAIL.

FOR FIBER OPTIC CONDUIT SYSTEM, SEE SPECIAL PROVISIONS.

21/2"PVC PIPE SHALL BE RAISED ABOVE THE TOP OF DECK DRAIN OPENINGS

BR-0115 PROJECT NO. \_\_\_ **IREDELL** COUNTY 15+74.00 -L-STATION:

SHEET 4 OF 4

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION STANDARD 3'-0'' X 1'-9'' PRESTRESSED CONCRETE CORED SLAB UNIT (SPANS A & C)

	SHEET NO.				
BY: DATE:			BY:	S-9	
		3			TOTAL SHEETS
		4			23

STD. NO. 21' PCS3\_30\_60S

